


Existing
New
Remove
concrete patio



HTE# 17-5-41015R

Harnett County Department of Public Health

24811

PERMIT # 29632


Operation Permit

☒ New Installation
 ☒ Septic Tank
 ☒ Nitrification Line
 ☐ Repair
 ☐ Expansion
PROPERTY LOCATION 51425 Chalky RdName: (owner) Wynn Construction Inc SUBDIVISION Avon Park LOT # 23System Installer: Thompson Plumbing Registration # 8Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 0Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: Up to 25% Reductive System Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Other must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

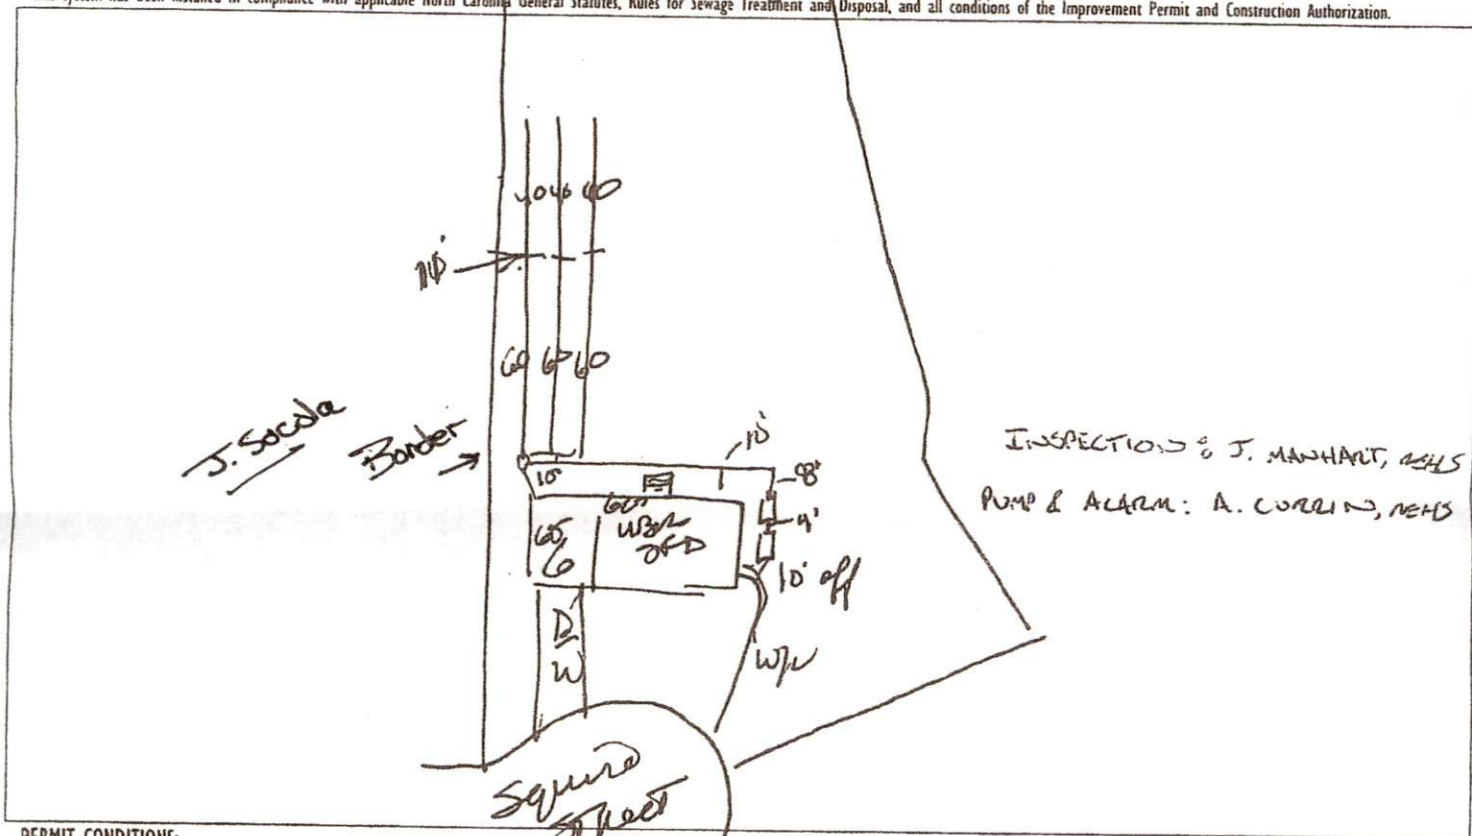

INSPECTION: J. MANHART, NCHS

PUMP & ALARM: A. CURRIN, NCHS

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

☐ D-Box
 ☐ Pump
 ☐ Alarm
 ☐ H2O Line
 ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% Reductive System Septic Tank: 1250 gallons Pump Tank: 1250 gallonsSubsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 100 feet ditches 3 feet ditches 18-16 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature]Date 07/06/2018