

GENERAL CONSTRUCTION SPECIFICATION

- 1. THE FOLLOWING DOCUMENTS ARE THE PROPERTY OF TYNDALE ENGINEERING & DESIGN, P.A. FOR USE SOLELY FOR THIS PROJECT AND SHALL NOT BE REPRODUCED, COPIED, OR USED FOR OTHER PURPOSES WITHOUT WRITTEN PERMISSION FROM TYNDALE ENGINEERING & DESIGN, P.A.
2. THE DESIGN PROFESSIONAL WHOSE SEAL APPEARS ON THESE DRAWINGS IS THE STRUCTURAL ENGINEER OF RECORD(SER) FOR THIS PROJECT. THE SER BEARS THE RESPONSIBILITY FOR THE PRIMARY STRUCTURAL ELEMENTS AND THE PERFORMANCE OF THIS STRUCTURE. NO OTHER PARTY MAY REVISE, ALTER, OR DELETE THESE CONSTRUCTION DOCUMENTS WITHOUT WRITTEN PERMISSION FROM TYNDALE ENGINEERING & DESIGN, P.A. OR THE SER.
3. THIS STRUCTURE IS ONLY STABLE IN ITS COMPLETED FORM. THE CONTRACTOR SHALL PROVIDE ALL REQUIRED TEMPORARY BRACING DURING CONSTRUCTION TO STABILIZE THE STRUCTURE. TEMPORARY SHORING AND BRACING METHODS ARE NOT THE RESPONSIBILITY OF TYNDALE ENGINEERING & DESIGN, P.A. AND ARE BEYOND THE SCOPE OF THESE DRAWINGS.
4. THE SER IS NOT RESPONSIBLE FOR CONSTRUCTION SEQUENCES, METHODS, OR TECHNIQUES IN CONNECTION WITH THE CONSTRUCTION OF THIS STRUCTURE. THE SER WILL NOT BE HELD RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CONFORM TO THE CONSTRUCTION DOCUMENTS, SHOULD ANY NON-CONFORMITIES OCCUR.
5. ANY STRUCTURAL ELEMENTS OR DETAILS NOT FULLY DEVELOPED ON THE CONSTRUCTION DRAWINGS SHALL BE COMPLETED UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER. THESE SHOP DRAWINGS SHALL BE SUBMITTED TO TYNDALE ENGINEERING & DESIGN, P.A. FOR REVIEW BEFORE ANY CONSTRUCTION BEGINS. SEE THE 'SUBMITTALS' SECTION OF THESE SPECIFICATIONS.
6. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH AND COORDINATED WITH THE ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, AND CIVIL DRAWINGS. THIS COORDINATION IS NOT THE RESPONSIBILITY OF THE SER. SHOULD ANY DISCREPANCIES BECOME APPARENT THE CONTRACTOR SHALL NOTIFY TYNDALE ENGINEERING & DESIGN, P.A. BEFORE ANY CONSTRUCTION BEGINS.
7. VERIFICATION OF ASSUMED FIELD CONDITIONS IS NOT THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER OF RECORD. THE CONTRACTOR SHALL VERIFY THE FIELD CONDITIONS FOR ACCURACY AND REPORT ANY DISCREPANCIES TO TYNDALE ENGINEERING & DESIGN, P.A. BEFORE CONSTRUCTION BEGINS.
8. THE STRUCTURAL ENGINEER OF RECORD IS NOT RESPONSIBLE FOR ANY SECONDARY STRUCTURAL ELEMENTS OR NON-STRUCTURAL ELEMENTS, EXCEPT FOR THE ELEMENTS SPECIFICALLY NOTED ON THE STRUCTURAL DRAWINGS.
9. THIS STRUCTURE AND ALL CONSTRUCTION SHALL CONFORM TO ALL APPLICABLE SECTIONS OF THE INTERNATIONAL BUILDING CODE AND ANY LOCAL LAWS WHERE THE STRUCTURE IS TO BE CONSTRUCTED.

SCOPE OF STRUCTURAL ENGINEERING SERVICES

TYNDALE ENGINEERING & DESIGN, P.A. HAS PERFORMED THE STRUCTURAL DESIGN AND PREPARED THE STRUCTURAL WORKING DRAWINGS FOR THIS PROJECT. "CONSTRUCTION REVIEW" SERVICES ARE NOT ALSO A PART OF OUR CONTRACT.

PORTIONS OF THE STRUCTURAL DESIGN (AS NOTED ON THE DRAWINGS) ARE THE RESPONSIBILITY OF THE MATERIAL SUPPLIERS.

THE SER IS RESPONSIBLE FOR THE DESIGN OF THE PRIMARY STRUCTURAL SYSTEM, EXCEPT FOR THE COMPONENTS NOTED ABOVE. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR ANY SECONDARY STRUCTURAL AND NON-STRUCTURAL SYSTEMS NOT SHOWN ON THE STRUCTURAL PLANS.

THE SER HAS NOT DONE A SUBSURFACE INVESTIGATION. THE FOUNDATION DESIGN IS BASED UPON AN ASSUMED ALLOWABLE BEARING PRESSURE AS SHOWN IN THE 'FOUNDATION' STRUCTURAL NOTES. THIS ALLOWABLE BEARING PRESSURE MUST BE VERIFIED BY THE CONTRACTOR OR OWNER. IF PROBLEMS ARE ENCOUNTERED, A SOILS ENGINEER SHALL BE RETAINED TO EVALUATE THE CONDITIONS AND RECOMMEND THE APPROPRIATE FOUNDATION SYSTEM.

THE SER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK, NOR WILL THE SER BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

FIELD MEASUREMENTS AND THE VERIFICATION OF FIELD DIMENSIONS ARE NOT PART OF TYNDALE ENGINEERING & DESIGN, P.A.'S RESPONSIBILITY. THE CONTRACTOR MUST CHECK ALL (ASSUMED) EXISTING CONDITIONS SHOWN ON THESE DRAWINGS FOR ACCURACY AND NOTIFY THE STRUCTURAL ENGINEER OF ANY DISCREPANCIES.

THE SER HAS ANALYZED THE NEW STRUCTURAL SLAB CONSTRUCTION FOR CONCENTRATED LOADS DUE TO VEHICLES. THE SLAB IS DESIGNED FOR UNIFORM LOADING AS NOTED IN THE 'DESIGN LOADS' PORTION OF THE STRUCTURAL NOTES AND CONCENTRATED LOADS IN ACCORDANCE WITH REQUIREMENTS OF THE BUILDING CODE.

THE SER HAS NOT DESIGNED THE STRUCTURE TO SUPPORT DYNAMIC LOADS FROM VIBRATING MACHINERY OR EQUIPMENT. ALL VIBRATING EQUIPMENT AND MACHINERY MUST BE ISOLATED FROM THE STRUCTURE.

THE SER HAS NOT PERFORMED AN ANALYSIS OF THE EXISTING BUILDING STRUCTURE ADJACENT TO THE NEW STRUCTURE. THE NEW BUILDING IS DESIGNED AS AN INDEPENDENT SELF-SUPPORTING STRUCTURE.

SUBMITTALS

- 1. SHOP DRAWINGS AND SUBMITTALS SHALL BE SUBMITTED TO TYNDALE ENGINEERING & DESIGN, P.A. FOR REVIEW BEFORE ANY CONSTRUCTION BEGINS. THESE SUBMITTALS WILL BE REVIEWED FOR OVERALL COMPLIANCE AS IT RELATES TO THE STRUCTURAL DESIGN OF THIS PROJECT. VERIFICATION OF THE SHOP DRAWINGS FOR DIMENSIONS, OR FOR ACTUAL FIELD CONDITIONS IS NOT THE RESPONSIBILITY OF TYNDALE ENGINEER & DESIGN, P.A.
2. ALLOW ENOUGH TIME FOR SUBMITTAL REVIEW, INCLUDING TIME FOR RESUBMITTALS. TIME FOR REVIEW SHALL COMMENCE UPON TYNDALE ENGINEERING & DESIGN'S RECEIPT OF SUBMITTAL. ALLOW 15 DAYS FOR INITIAL REVIEW OF EACH SUBMITTAL AND 15 DAYS FOR REVIEW OF EACH RESUBMITTAL.
3. CONTRACTOR SHALL HIGHLIGHT, ENCIRCLE, OR OTHERWISE SPECIFICALLY IDENTIFY DEVIATIONS FROM THE CONTRACT DOCUMENTS ON SUBMITTALS.
4. CONTRACTOR SHALL REVIEW EACH SUBMITTAL AND CHECK FOR COORDINATION WITH OTHER TRADES AND FOR COMPLIANCE WITH THE CONTRACT DOCUMENTS. NOTE CORRECTIONS AND FIELD DIMENSIONS. MARK WITH APPROVAL STAMP BEFORE SUBMITTING TO TYNDALE ENGINEERING & DESIGN, P.A. STAMP SHALL INCLUDE NAME OF REVIEWER, DATE OF CONTRACTOR'S APPROVAL, AND STATEMENT CERTIFYING THAT SUBMITTAL HAS BEEN REVIEWED, CHECKED, AND APPROVED FOR COMPLIANCE WITH THE CONTRACT DOCUMENTS.
5. WHERE PROFESSIONAL DESIGN SERVICE OR CERTIFICATIONS BY A DESIGN PROFESSIONAL ARE SPECIFICALLY REQUIRED OF THE CONTRACTOR BY THE CONTRACT DOCUMENTS, PROVIDE PRODUCTS AND SYSTEMS COMPLYING WITH SPECIFIC PERFORMANCE AND DESIGN CRITERIA INDICATED. IN ADDITION, SUBMIT COPIES OF A STATEMENT, SIGNED AND SEALED BY THE RESPONSIBLE DESIGN PROFESSIONAL, FOR EACH PRODUCT AND SYSTEM SPECIFICALLY ASSIGNED TO THE CONTRACTOR TO BE DESIGNED OR CERTIFIED BY A DESIGN PROFESSIONAL.
6. REVIEW OF SHOP DRAWINGS BY THE ENGINEER IS LIMITED TO COMPLIANCE OF THE COMPLETED STRUCTURE WITH THE DESIGN CONCEPT AND INFORMATION GIVEN IN THE CONTRACT DOCUMENTS. THE CONTRACTOR IS RESPONSIBLE FOR DIMENSIONS, QUANTITIES, PERFORMANCE, SAFETY, COORDINATION WITH OTHER WORKS, AND ALL OTHER REQUIREMENTS OF THE CONTRACT DOCUMENTS. REVIEW DOES NOT AUTHORIZE CHANGES TO THE CONTRACT.
7. PROVIDE THE FOLLOWING SUBMITTALS FOR THIS PROJECT:
a. CAST-IN-PLACE CONCRETE
i. IN ADDITION TO THE FOLLOWING, COMPLY WITH REQUIREMENTS IN ACI 301
ii. PRODUCT DATA FOR EACH TYPE OF PRODUCT INDICATED
iii. DESIGN MIXTURES FOR EACH CONCRETE MIXTURE
iv. REBAR SHOP DRAWINGS
v. SHOP DRAWINGS FOR THE DESIGN, ERECTION, AND REMOVAL OF FORMWORK, SHORES AND RESHORES PREPARED BY OR UNDER THE SUPERVISION OF A QUALIFIED PROFESSIONAL ENGINEER. SHOP DRAWINGS, INCLUDING STRUCTURAL ANALYSIS DATA, SIGNED AND SEALED BY THE QUALIFIED PROFESSIONAL ENGINEER RESPONSIBLE FOR THEIR PREPARATION. COMPLY WITH REQUIREMENTS IN 'ACI MANUAL OF CONCRETE PRACTICE'.
b. STRUCTURAL STEEL
i. PRODUCT DATA FOR EACH TYPE OF PRODUCT INDICATED
ii. SHOP DRAWINGS: SHOW FABRICATION OF STRUCTURAL STEEL COMPONENTS
iii. WELDING CERTIFICATES
c. UNIT MASONRY ASSEMBLIES
i. PRODUCT DATA FOR EACH TYPE OF PRODUCT INDICATED
d. COLD-FORMED METAL FRAMING
i. PRODUCT DATA FOR EACH TYPE OF COLD-FORMED METAL FRAMING PRODUCT AND ACCESSORY INDICATED
ii. SHOP DRAWINGS FOR TRUSSES PREPARED BY OR UNDER THE SUPERVISION OF A QUALIFIED PROFESSIONAL ENGINEER. SHOW FABRICATION AND INSTALLATION DETAILS FOR TRUSSES INCLUDING LOCATION, PITCH, SPAN, CAMBER, CONFIGURATION, SPACING, AND SPLICE DETAILS AND BEARING DETAILS FOR EACH TYPE OF TRUSS REQUIRED. ALSO, INDICATE LOCATIONS OF PERMANENT BRACING REQUIRED TO PREVENT BUCKLING OF INDIVIDUAL TRUSS MEMBERS DUE TO DESIGN LOADS.
iii. PRODUCT DATA FOR EACH TYPE OF PRODUCT INDICATED.

FOUNDATIONS
1. THE SCOPE OF SERVICES FOR THIS PROJECT PROVIDED BY TYNDALE ENGINEERING & DESIGN, P.A. BEGINS FROM THE BOTTOM OF THE FOUNDATION ELEMENTS. SUBSURFACE INVESTIGATIONS ARE BEYOND THE SCOPE OF THE STRUCTURAL SERVICES PROVIDED. THE FOUNDATION SYSTEM SHOWN ON THESE DRAWINGS ARE BASED UPON THE ASSUMED SOIL PROPERTIES LISTED BELOW. IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR, OWNER OR OWNER'S AGENT TO CONTACT TYNDALE ENGINEERING & DESIGN, P.A. IF ANY ADVERSE SOIL CONDITIONS ARE ENCOUNTERED DURING CONSTRUCTION. VERIFICATION OF THIS ASSUMED VALUE IS ALSO THE RESPONSIBILITY OF THE CONTRACTOR, OWNER OR OWNER'S AGENT.
a. ALLOWABLE SOIL BEARING PRESSURE 2000 PSF
b. SUB GRADE MODULUS (k) 100 PCI
c. ULTIMATE FRICTION COEFFICIENT BETWEEN CONCRETE FOUNDATIONS AND SOIL 0.30
d. UNIT WEIGHT OF SOIL 120 PCF
e. AT REST EARTH PRESSURE, K0 60 PSF/FT

- 2. THE BOTTOM OF ALL FOOTINGS SHALL EXTEND BELOW THE FROST LINE FOR THE REGION IN WHICH THE STRUCTURE IS TO BE CONSTRUCTED. HOWEVER, THE TOP OF FOOTING SHALL BE A MINIMUM OF 12" BELOW GRADE.
3. EXCAVATE TO INDICATED ELEVATIONS AND DIMENSIONS WITHIN A TOLERANCE OF +/- 1". IF APPLICABLE, EXTEND EXCAVATIONS A SUFFICIENT DISTANCE FROM STRUCTURES FOR PLACING AND REMOVING CONCRETE FORMWORK, FOR INSTALLING SERVICES AND OTHER CONSTRUCTION, AND FOR INSPECTIONS. DO NOT DISTURB BOTTOM OF EXCAVATION. EXCAVATE BY HAND TO FINAL GRADE. JUST BEFORE PLACING CONCRETE REINFORCEMENT, TRIM BOTTOMS TO REQUIRED LINES AND GRADES TO LEAVE SOLID BASE TO RECEIVE OTHER WORK.
4. ANY FILL SHALL BE PLACED UNDER THE DIRECTION OR RECOMMENDATION OF A LICENSED PROFESSIONAL ENGINEER USING SUITABLE SOILS OR ENGINEERED FILL. PLOW, SCARIFY, BENCH, OR BREAK UP SLOPED SURFACES STEEPER THAN 1 VERTICAL TO 4 HORIZONTAL SO FILL MATERIAL WILL BOND WITH EXISTING MATERIAL. PLACE BACKFILL AND FILL SOIL MATERIALS IN LAYERS NOT MORE THAN 8" IN LOOSE DEPTH FOR MATERIAL COMPACTED BY HEAVY COMPACTION EQUIPMENT, AND NOT MORE THAN 4" IN LOOSE DEPTH FOR MATERIAL COMPACTED BY HAND-OPERATED TAMERS. COMPACT SOIL MATERIALS TO NOT LESS THAN 95% OF MAXIMUM DRY UNIT WEIGHT ACCORDING TO ASTM D698, UNLESS A HIGHER PERCENTAGE IS RECOMMENDED BY THE GEOTECHNICAL ENGINEER. UNDER SLABS-ON-GRADE AND STEPS, SCARIFY AND RECOMPACT TOP 12" OF EXISTING SUBGRADE AND EACH LAYER OF BACKFILL OR FILL SOIL AT 98%.
5. IT IS STRONGLY RECOMMENDED THAT A QUALIFIED INDEPENDENT GEOTECHNICAL ENGINEERING TESTING AGENCY INSPECT AND TEST SUBGRADES AND EACH FILL OR BACKFILL LAYER, AND AT FOOTING SUBGRADES PERFORM TESTING TO VERIFY DESIGN BEARING CAPACITIES.
6. EXCAVATION FOR FOOTINGS SHALL BE LINED TEMPORARILY WITH A 6 MIL POLYETHYLENE IF PLACEMENT OF CONCRETE DOES NOT OCCUR WITHIN 24 HOURS OF EXCAVATION.
7. CONCRETE SHALL NOT BE POURED AGAINST ANY SUB GRADE CONTAINING WATER, ICE, FROST, OR LOOSE MATERIAL.

CONCRETE FLOOR AND SLABS

- 1. REQUIREMENTS NOTED IN THIS SECTION APPLY TO CONCRETE SLABS ON GRADE AND ELEVATED FLOOR SLABS. REFER TO THE CONCRETE SECTION OF THESE SPECIFICATIONS FOR FURTHER REQUIREMENTS.
2. CONCRETE SLABS ON GRADE SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 302.1R-04 "GUIDE FOR CONCRETE FLOOR AND SLAB CONSTRUCTION".
3. SLABS ON GRADE DEPEND ON THE INTEGRITY OF BOTH THE SLAB AND FILL SOIL SUPPORT. PROVIDE SATISFACTORY SOIL MATERIALS UNDER SLABS ON GRADE ACCORDING TO GEOTECHNICAL ENGINEER'S WRITTEN RECOMMENDATIONS. PROF.ROLL SUBGRADE BELOW THE BUILDING SLABS WITH HEAVY PNEUMATIC-TIRED EQUIPMENT TO IDENTIFY SOFT POCKETS AND AREAS OF EXCESS YIELDING.
4. COMPACT SOIL MATERIALS AND SUBGRADE TO NOT LESS THAN 98% OF MAXIMUM DRY UNIT WEIGHT, UNLESS OTHERWISE RECOMMENDED BY THE GEOTECHNICAL ENGINEER.
5. PROVIDE PLASTIC VAPOR RETARDER OVER THE SUBGRADE OR SUBBASE BUT UNDER THE BASE COURSE (GRANULAR FILL). VAPOR RETARDER SHALL CONFORM TO ASTM E1745, CLASS C, OR POLYETHYLENE SHEET, ASTM D4397, NOT LESS THAN 6 MILS THICK. VAPOR RETARDER MAY BE OMITTED ONLY WHEN STATED IN THE GEOTECHNICAL ENGINEER'S WRITTEN INSTRUCTIONS.
6. PROVIDE A MINIMUM OF 4" OF GRANULAR FILL DIRECTLY UNDER SLABS ON GRADE. FILL SHALL CONSIST OF A CLEAN MIXTURE OF CRUSHED STONE OR CRUSHED OR UNCRUSHED GRAVEL PER ASTM D448, SIZE 57, WITH 100% PASSING A 1-1/2" SIEVE AND 0% TO 5% PASSING A #8 SIEVE.
7. REINFORCE CONCRETE SLABS ON GRADE WITH WELDED WIRE FABRIC REINFORCEMENT (FABRIC) AS INDICATED. WELDED WIRE REINFORCEMENT SHALL BE SUPPLIED IN FLAT SHEETS AND INSTALLED IN LONGEST PRACTICAL LENGTHS ON BAR SUPPORTS SPACED TO MINIMIZE SAGGING. LAP EDGES AND ENDS OF ADJOINING SHEETS FOR AT LEAST ONE MESH SPACING. OFFSET LAPS OF ADJOINING SHEET WIDTHS TO PREVENT CONTINUOUS LAPS IN EITHER DIRECTION. LACE OVERLAPS WITH WIRE TIES AND DO NOT EXTEND REINFORCEMENT THROUGH JOINTS.
8. DEPOSIT AND CONSOLIDATE CONCRETE FOR FLOORS AND SLABS IN A CONTINUOUS OPERATION, WITHIN LIMITS OF CONSTRUCTION JOINTS, UNLESS PLACEMENT OF A PANEL OR SECTION IS COMPLETE AND AS FOLLOWS:
a. CONSOLIDATE CONCRETE DURING PLACEMENT OPERATIONS SO CONCRETE IS THOROUGHLY WORKED AROUND REINFORCEMENT AND OTHER EMBEDDED ITEMS AND INTO CORNERS.
b. MAINTAIN REINFORCEMENT IN POSITION ON CHAIRS DURING CONCRETE PLACEMENT.
c. SOREED SLAB SURFACES UNIFORMLY TO DRAINS WHERE REQUIRED.
d. SLOPE SURFACES UNIFORMLY TO DRAINS WHERE REQUIRED.
e. BEGIN INITIAL FLOATING USING BULL FLOATS OR DARBIES TO FORM A UNIFORM AND OPEN TEXTURED SURFACE PLANE, BEFORE EXCESS BLEEDWATER APPEARS ON THE SURFACE. DO NOT FURTHER DISTURB SLAB SURFACES BEFORE STARTING FINISHING OPERATIONS.
9. APPLY A TROWEL FINISH TO CONCRETE SLAB ON GRADE SURFACES UNLESS OTHERWISE NOTED. VERIFY THIS FINISH WITH THE ARCHITECTURAL REQUIREMENTS BEFORE CONSTRUCTION. AFTER APPLYING FLOAT FINISH, APPLY FIRST TROWELING AND CONSOLIDATE CONCRETE BY HAND OR POWER-DRIVEN TROWEL. CONTINUE TROWELING PASSES AND RESTRAIGHTEN UNTIL SURFACE IS FREE OF TROWEL MARKS AND UNIFORM IN TEXTURE AND APPEARANCE. GRIND SMOOTH ANY SURFACE DEFECTS THAT WOULD TELEGRAPH THROUGH APPLIED COATING OR FLOOR COVERINGS.
10. FORM WEAKENED-PLANE CONTRACTION JOINTS, SECTIONING CONCRETE INTO AREAS AS INDICATED BUT NOT MORE THAN 20'-0" O.C. CONSTRUCTION CONTRACTION JOINTS FOR A DEPTH EQUAL TO AT LEAST ONE-FOURTH OF CONCRETE THICKNESS. FORM CONTRACTION JOINTS WITH POWER SAWS EQUIPPED WITH SHATTERPROOF ABRASIVE OR DIAMOND-RIMMED BLADES WITHIN 4 TO 12 HOURS AFTER THE SLAB HAS BEEN FINISHED. CUT 1/8" WIDE JOINTS INTO CONCRETE WHEN CUTTING ACTION WILL NOT TEAR, ABRADE, OR OTHERWISE DAMAGE SURFACE AND BEFORE CONCRETE DEVELOPS RANDOM CONTRACTION CRACKS.
11. CURE CONCRETE SLABS ON GRADE FOR AT LEAST SEVEN DAYS BY ONE OF THE FOLLOWING METHODS: MOISTURE CURING, MOISTURE-RETAINING-COVER CURING, APPLICATION OF A CURING COMPOUND, OR BY APPLICATION OF A CURING AND SEALING COMPOUND.
12. THE CONCRETE SLAB ON GRADE HAS BEEN DESIGNED USING A SUBGRADE MODULUS OF K=100 pci AND A DESIGN LOADING AS NOTED IN THE 'DESIGN LOADS' SECTION OF THESE SPECIFICATIONS. THE SER IS NOT RESPONSIBLE FOR DIFFERENTIAL SETTLEMENT, SLAB CRACKING, OR OTHER FUTURE DEFECTS RESULTING FROM UNREPRESENTED CONDITIONS MITIGATING THE ABOVE ASSUMPTIONS.

CONCRETE

- 1. CONCRETE SHALL BE PROPORTIONED, MIXED, PLACED, AND TESTED IN ACCORDANCE WITH THE ACI MANUAL OF CONCRETE PRACTICE INCLUDING BUT NOT LIMITED TO ACI 318-02 'BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE' AND ACI 301-05 'SPECIFICATIONS FOR STRUCTURAL CONCRETE'. COMPLY WITH ACI 117-90 'SPECIFICATIONS FOR TOLERANCES FOR CONCRETE CONSTRUCTION AND MATERIALS'.
2. STEEL REINFORCEMENT SHALL COMPLY WITH THE FOLLOWING SPECIFICATIONS:
a. REINFORCING BARS ASTM A615, GRADE 60, DEFORMED
b. PLAIN-STEEL WIRE ASTM A82, AS DRAWN
c. EPOXY COATED BARS ASTM A775
d. PLAIN-STEEL WELDED WIRE REINFORCEMENT ASTM A185, FLAT SHEETS ONLY
3. CONCRETE DENOTED AS 'LIGHTWEIGHT CONCRETE' ON THESE DESIGN DOCUMENTS SHALL HAVE A UNIT WEIGHT OF 115 PCF. CONCRETE NOT SPECIFICALLY NOTED AS 'LIGHTWEIGHT' SHALL HAVE A UNIT WEIGHT OF 145 PCF. CONCRETE MATERIALS SHALL COMPLY WITH THE FOLLOWING:
a. PORTLAND CEMENT ASTM C150, TYPE I OR II
b. FLY ASH ASTM C618, CLASS F
c. BLENDED HYDRAULIC CEMENT ASTM C595, TYPE I
FOZZOLAN-MODIFIED PORTLAND
d. NORMAL-WEIGHT AGGREGATE ASTM C33, GRADED, 1/2" NOMINAL MAXIMUM AGGREGATE SIZE
e. LIGHTWEIGHT AGGREGATE ASTM C330, GRADED, 3/8" NOMINAL MAXIMUM AGGREGATE SIZE
f. WATER POTABLE
4. NO ADMIXTURES SHALL BE ADDED TO ANY STRUCTURAL CONCRETE WITHOUT THE EXPRESS WRITTEN PERMISSION OF TYNDALE ENGINEERING & DESIGN, P.A. ALL PROPOSED ADMIXTURES SHALL BE SUBMITTED TO TYNDALE ENGINEERING & DESIGN, P.A. FOR APPROVAL. THE ADMIXTURE MUST BE CERTIFIED BY THE MANUFACTURER THAT IT IS COMPARABLE TO OTHER ADMIXTURES AND DOES NOT CONTRIBUTE TO WATER-SOLUBLE CHLORIDE IONS EXCEEDING THOSE PERMITTED IN HARDENED CONCRETE. DO NOT USE CALCIUM CHLORIDE OR ANY ADMIXTURE CONTAINING CALCIUM CHLORIDE.
5. NORMAL-WEIGHT CONCRETE MIXTURES SHALL HAVE THE FOLLOWING PROPERTIES:
COMP. WATER- MINIMUM MAXIMUM
ELEMENT STRENGTH @ 28 DAYS CEMENT RATIO SLUMP LIMIT AIR CONTENT
a. FOOTINGS 3000 PSI 0.45 4" 0.0%
b. RETAINING WALLS 3000 PSI 0.45 4" 4.5%
c. SLABS-ON-GRADE 3000 PSI 0.45 4" 0.0%

NOTE: IT IS RECOMMENDED THAT INTERIOR SLABS BE GIVEN A SMOOTH, DENSE, HARD-TROWELED FINISH NOT CONTAINING ENTRAINED AIR OR DELAMINATION MAY OCCUR. IF A SLAB WILL BE EXPOSED TO DEICING OR OTHER AGGRESSIVE CHEMICALS, CONTACT TYNDALE ENGINEERING & DESIGN, P.A. FOR PROPER AIR ENTRAINMENT REQUIREMENTS.

LIGHTWEIGHT CONCRETE MIXTURES SHALL HAVE THE FOLLOWING PROPERTIES:

Table with columns: ELEMENT, MINIMUM COMP. STRENGTH @ 28 DAYS, MAXIMUM WATER CEMENT RATIO, SLUMP LIMIT, AIR CONTENT. Row a: ELEVATED SLABS, OVER DECKING, 3000 PSI, 0.63, 5", 0.0%

COMPLY WITH THE MINIMUM CONCRETE COVER FOR REINFORCEMENT AS FOLLOWS:

- a. CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3"
b. CONCRETE EXPOSED TO EARTH OR WEATHER
i. No. 5 BARS AND SMALLER 1-1/2"
ii. No. 6 BARS AND LARGER 2"
c. CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND
i. SLABS, WALLS, JOISTS, No. 11 BARS AND SMALLER 3/4"
ii. SLABS, WALLS, JOISTS, No. 14 AND No. 18 BARS 1-1/2"
iii. PRIMARY REINFORCEMENT, TIES, STIRRUPS, 1-1/2" AND SPIRALS FOR BEAMS OR COLUMNS

- 8. SPLICE REINFORCEMENT AS DETAILED OR AUTHORIZED BY TYNDALE ENGINEERING & DESIGN, P.A. MAKE BARS CONTINUOUS AROUND CORNERS. SPLICES SHALL BE MADE BY CONTACT TENSION LAP SPLICES, UNLESS OTHERWISE NOTED.
9. PLACING SLEEVES THROUGH CONCRETE ELEMENTS IS NOT PERMITTED UNLESS SHOWN ON THE DESIGN DOCUMENTS, OR APPROVED SLEEVE SHOP DRAWINGS, OR AS AUTHORIZED BY TYNDALE ENGINEERING & DESIGN, P.A.
10. LOCATE CONSTRUCTION JOINTS FOR MILD-REINFORCED ELEVATED CONCRETE WITHIN THE MIDDLE THIRD OF THE SPANS OF SLABS, BEAMS, AND GIRDERS. INDICATE PROPOSED CONSTRUCTION JOINT LOCATIONS ON REINFORCING STEEL SHOP DRAWINGS. LOCATE CONSTRUCTION JOINTS NOT FARTHER THAN 60 FEET APART IN ANY DIRECTION IN WALLS, SLABS, OR BEAMS. OFFSET JOINTS IN GIRDERS A MINIMUM DISTANCE OF TWO TIMES THE WIDTH OF INTERSECTING BEAMS. MAKE STOPS IN CONCRETE PLACEMENT WITH VERTICAL BULKHEADS AND HORIZONTAL KEYS, UNLESS OTHERWISE SHOWN. SUBMIT SHOP DRAWINGS INDICATING PROPOSED JOINT LOCATIONS AND REINFORCING STEEL TO BE PLACED IN THE SLAB. ANY STOP IN CONCRETE WORK MUST BE MADE WITH VERTICAL BULKHEADS, UNLESS OTHERWISE SHOWN.
11. COMPLY WITH ACI 301 FOR MEASURING, BATCHING, MIXING, TRANSPORTING, AND PLACING CONCRETE, BEFORE TEST SAMPLING AND PLACING CONCRETE. WATER MAY BE ADDED AT THE PROJECT SITE, SUBJECT TO LIMITATIONS OF ACI 301.
12. SEE ARCHITECTURAL DRAWINGS FOR FINISHING REQUIREMENTS OF FORMED CONCRETE SURFACES. FOR UNFORMED SURFACES, COMPLY WITH ACI 302.1R FOR SCREEDING, RESTRAIGHTENING, AND FINISHING OPERATIONS UNLESS OTHERWISE NOTED ON THE ARCHITECTURAL DRAWINGS.
13. CURE FORMED AND UNFORMED CONCRETE FOR AT LEAST SEVEN DAYS BY ONE OF THE FOLLOWING METHODS: MOISTURE CURING, MOISTURE-RETAINING-COVER CURING, APPLICATION OF A CURING COMPOUND, OR BY APPLICATION OF A CURING AND SEALING COMPOUND.
14. ENGAGE A QUALIFIED INDEPENDENT TESTING AGENCY TO SAMPLE MATERIALS, PERFORM TESTS, AND SUBMIT REPORTS DURING CONCRETE PLACEMENT ACCORDING TO ACI 301 AND IRC BUILDING CODE.

STRUCTURAL STEEL

- 1. STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE FOLLOWING STANDARDS AND THE LATEST EDITIONS OF SAID STANDARDS:
a. AISC'S 'CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES'
b. AISC 'S' SEISMIC PROVISIONS FOR STRUCTURAL STEEL BUILDINGS' AND 'SUPPLEMENT NO.2', IF THE RESPONSE MODIFICATION FACTOR IS GREATER THAN 3.0
c. AISC'S 'LOAD AND RESISTANCE FACTORED DESIGN SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS'
d. AISC'S 'SPECIFICATION FOR THE DESIGN OF STEEL HOLLOW STRUCTURAL SECTIONS'
e. RCSC'S 'SPECIFICATIONS FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS'
f. AWS'S STRUCTURAL WELDING CODE AWS D1.1
2. STEEL FABRICATORS FOR THIS PROJECT SHALL PARTICIPATE IN THE AISC QUALITY CERTIFICATION PROGRAM AND HAVE A MINIMUM DESIGNATION OF SBD. STEEL INSTALLERS FOR THIS PROJECT SHALL PARTICIPATE IN THE AISC QUALITY CERTIFICATION PROGRAM AND HAVE A MINIMUM DESIGNATION OF CSE. ALL PERSONNEL PERFORMING WELDING ON THIS PROJECT SHALL CONFORM TO THE QUALITY PROCEDURES ACCORDING TO AWS D1.1 'STRUCTURAL WELDING CODE - STEEL'.
3. ALL STRUCTURAL STEEL MATERIALS SHALL CONFORM TO THE FOLLOWING:
a. WIDE FLANGE SHAPES ASTM A992
b. CHANNELS, ANGLES, M-SHAPES, S-SHAPES ASTM A36
c. PLATE AND BAR ASTM A572
d. CORROSION-RESISTING STRUCTURAL STEEL ASTM A588
e. COLD-FORMED HOLLOW STRUCTURAL SECTIONS ASTM A600, GRADE B
f. STEEL PIPE ASTM A53
g. WELDING ELECTRODES CLASS E70XX
4. UNLESS OTHERWISE NOTED ON THE DESIGN DOCUMENTS, APPLY A ONE-COAT NON-ASPHALTIC PRIMER COMPLYING WITH SSPC-PP3 GUIDE 7.00 'PAINTING SYSTEM GUIDE 7.00: GUIDE FOR SELECTING ONE-COAT

SHOP PAINTING SYSTEMS', TO PROVIDE A DRY FILM THICKNESS OF NOT LESS THAN 1.5 MILS TO ALL STEEL SURFACES NOT EXPOSED TO WEATHER EXCEPT THE FOLLOWING:

- a. SURFACES EMBEDDED IN CONCRETE OR MORTAR. EXTEND PRIMING OF PARTIALLY EMBEDDED MEMBERS TO A DEPTH OF 2".
b. SURFACES TO BE FIELD WELDED.
c. SURFACES TO BE HIGH-STRENGTH BOLTED WITH SLIP-CRITICAL CONNECTIONS.
d. SURFACES TO RECEIVE SPRAYED-ON FIRE RESISTIVE MATERIALS.
e. GALVANIZED SURFACES.
5. APPLY A ZINC COATING BY THE HOT-DIPPED PROCESS ACCORDING TO ASTM A123 TO LOOSE ANGLE LINTELS, RELIEVING ANGLES (SHELF ANGLES) AND ALL STEEL EXPOSED TO WEATHER. FILL VENT HOLES AND GRIND SMOOTH AFTER GALVANIZING AS REQUIRED. REPAIR DAMAGED GALVANIZING COATINGS WITH GALVANIZED REPAIR PAINT ACCORDING TO ASTM A780 AND MANUFACTURER'S WRITTEN INSTRUCTIONS.
6. BOLTS, CONNECTORS, AND ANCHORS SHALL CONFORM TO THE FOLLOWING:
a. ASTM A325 BOLTED CONNECTIONS:
i. ASTM A325, TYPE 1 HEAVY HEX NUT STEEL STRUCTURAL BOLTS
ii. ASTM A563 HEAVY HEX CARBON-STEEL NUTS
iii. ASTM F436 HARDENED CARBON-STEEL WASHERS
THE FINISH FOR THESE BOLTED CONNECTIONS SHALL BE PLAIN UNLESS CONNECTING HOT-DIPPED GALVANIZED MATERIALS AND THEN SHALL HAVE A HOT-DIPPED ZINC COATING CONFORMING TO ASTM A153.
b. ASTM A490 BOLTED CONNECTIONS:
i. ASTM A490, TYPE 1 HEAVY HEX NUT STEEL STRUCTURAL BOLTS
ii. ASTM A563 HEAVY HEX CARBON-STEEL NUTS
iii. ASTM F436 HARDENED CARBON-STEEL WASHERS
THE FINISH FOR THESE BOLTED CONNECTIONS SHALL BE PLAIN.
c. ANCHOR RODS: ASTM F1554, GRADE 36
i. NUTS: ASTM A563
ii. PLATE WASHERS: 3/8" MINIMUM THICKNESS, ASTM A36 CARBON STEEL.
d. THREADED RODS: ASTM A307, GRADE A
i. NUTS: ASTM A563
ii. WASHERS: ASTM A36
iii. FINISH: PLAIN
e. CLEAVISES AND TURNBUCKLES: ASTM A108, GRADE 1035, COLD-FINISHED CARBON STEEL
f. EYE BOLTS AND NUTS: ASTM A108, GRADE 1030, COLD-FINISHED CARBON STEEL.

SELECT AND COMPLETE STEEL TO STEEL CONNECTIONS USING FULL-DEPTH CONNECTION AS INDICATED IN AISC'S 'MANUAL OF STEEL CONSTRUCTION, 13TH EDITION'

- 8. IN BOLTED CONNECTIONS, PROVIDE HIGH STRENGTH BOLTS, NUTS, AND WASHERS IN BOLTED STEEL CONNECTIONS AND INSTALL CONNECTORS ACCORDING TO RCSC'S 'SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS'. CUT, DRILL, OR PUNCH HOLES PERPENDICULAR TO METAL SURFACES. EITHER ASTM A325 OR A490 BOLTS MAY BE USED FOR SNUG TIGHTENED CONNECTIONS. ALL CONNECTIONS EXCEPT LISTED BELOW SHALL BE SNUG TIGHTENED:
a. JOINTS THAT UTILIZE OVERSIZED HOLES
b. JOINTS THAT CONNECT BRACING MEMBERS FOR LATERAL RESISTING SYSTEM
c. JOINTS THAT UTILIZE SLOTTED HOLES EXCEPT THOSE WITH APPLIED LOAD APPROXIMATELY NORMAL TO THE DIRECTION OF THE LONG DIMENSION OF THE SLOT.

IN WELDED CONNECTIONS, COMPLY WITH AWS D1.1 FOR WELDING PROCEDURE SPECIFICATIONS, TOLERANCES, APPEARANCE, AND QUALITY OF WELDS AND FOR METHODS USED IN CORRECTING WELDING WORK. COMPLY WITH AISC MINIMUM WELDING REQUIREMENTS.

SHEAR CONNECTORS (SHEAR STUDS) SHALL BE OF THE HEIGHT AND DIAMETER AS NOTED ON THE COMPOSITE FLOOR DECK DETAIL ON THESE DRAWINGS. CONNECTORS SHALL BE ASTM A108, GRADE 1015 THROUGH 1020, HEADED STUD, COLD-FINISHED CARBON STEEL, AWS D1.1, TYPE B. SPACE CONNECTORS UNIFORMLY ON EACH SIDE OF THE BEAM MIDSPAN IN THE PORTION OF THE DECK RIB CLOSEST TO THE NEAREST END OF THE BEAM, UNLESS OTHERWISE NOTED. IN ADDITION TO THE TESTING AND INSPECTIONS LISTED BELOW, TEST AND INSPECT FIELD WELDED SHEAR CONNECTORS ACCORDING TO REQUIREMENTS IN AWS D1.1 FOR STUD WELDING AND AS FOLLOWS:

- a. PERFORM BEND TESTS IF VISUAL INSPECTIONS REVEAL EITHER A LESS THAN CONTINUOUS 360 DEGREES FLASH OR WELDING REPAIRS TO ANY SHEAR CONNECTOR.
b. CONDUCT TESTS ON ADDITIONAL SHEAR CONNECTORS IF WELD FRACTURE OCCURS ON SHEAR CONNECTORS ALREADY TESTED, ACCORDING TO REQUIREMENTS IN AWS D1.1.
c. CORRECT DEFICIENCIES IN WORK THAT TEST REPORTS AND INSPECTIONS INDICATE SHEAR CONNECTORS NOT IN COMPLIANCE WITH THESE DOCUMENTS.

BASE AND BEARING PLATES WHICH ARE SUPPORTED OVER CONCRETE OR MASONRY SHALL BE PLACED OVER 2" OF GROUT WITH A TOLERANCE OF +/- 1/2" UNLESS OTHERWISE NOTED. CLEAN CONCRETE AND MASONRY SURFACES OF BOND REDUCING MATERIAL AND ROUGHEN SURFACES. SET PLATES FOR STRUCTURAL MEMBERS ON WEDGES, SHIMS, OR SETTING NUTS AS REQUIRED. TIGHTEN ANCHOR RODS AFTER MEMBER IS POSITIONED AND PLUMBED. DO NOT REMOVE WEDGES, BUT IF PROTRUDING, CUT OFF FLUSH WITH BASE PLATE. PROMPTLY PACK GROUT SOLIDLY BETWEEN BEARING SURFACES SO NO VOIDS REMAIN. GROUT SHALL CONFORM TO ASTM C1107, FACTORY-PACKAGED, NONMETALLIC AGGREGATE GROUT, NONCORROSIVE, NON STAINING, MIXED WITH WATER TO CONSISTENCY SUITABLE FOR APPLICATIONS. GROUT SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 5000 PSI.

FURNISH ANCHORAGE ITEMS EMBEDDED OR ATTACHED TO OTHER CONSTRUCTION BY USE OF SETTING DIAGRAMS AND TEMPLATES. DO NOT FLOAT-IN THESE ITEMS.


ACCURATELY FINISH ENDS OF COLUMNS AND OTHER MEMBERS TRANSMITTING BEARING LOADS.

PROVIDE TEMPORARY SHORES, GUYS, BRACES, AND OTHER SUPPORTS DURING ERECTION TO KEEP STRUCTURAL STEEL SECURE, PLUMB, AND IN ALIGNMENT AGAINST TEMPORARY CONSTRUCTION LOADS AND LOADS EQUAL IN INTENSITY TO DESIGN LOADS. ALSO, PROVIDE TEMPORARY SUPPORTS IN STEEL TO STEEL CONNECTIONS AND ALL OTHER LOCATIONS PER OSHA REQUIREMENTS.

MAINTAIN ERECTION TOLERANCES OF STRUCTURAL STEEL WITHIN AISC'S 'CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES'.

ONLY SPLICE MEMBERS WHERE INDICATED ON THE DESIGN DOCUMENTS.

ENGAGE A QUALIFIED INDEPENDENT TESTING AND INSPECTION AGENCY TO INSPECT FIELD WELDS AND HIGH-STRENGTH BOLTED CONNECTIONS. SHOP-BOLTED CONNECTIONS SHALL BE INSPECTED ACCORDING TO RCSC'S 'SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS'. FIELD WELDS SHALL BE VISUALLY INSPECTED ACCORDING TO AWS D1.1, EXCEPT FULL PENETRATION WELDS SHALL ALSO BE INSPECTED PER ULTRASONIC INSPECTION PER ASTM E164.

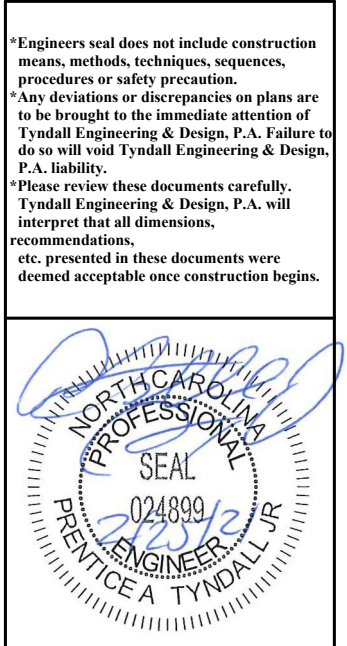

TYNDALE ENGINEERING & DESIGN, P.A.
1100 W. GARDNER DR. SUITE 200
RALEIGH, NC 27603
919.779.9797
www.tyndalle.com

W.S. ARCHITECT'S PA
3305-109 DURIAM DR RALEIGH, NC 27603
919-779-9797
MI CANCUN

GENERAL NOTES table with columns: No., Date, Remarks. Includes revision entries.

Sheet Number SO 1 of 4

FILENAME: Z:_DESIGNING_ENG\2020_STRUCTURAL_PROJECTS\2001-010539 - MI CANCUN\2001-010539_LINING SWD.DWG BY: PROVIDE TYNDALE LAST PLOT DATE: 02/25/2021 8:12 AM


DESIGN LOADS	
1. BUILDING CODES	
a. NORTH CAROLINA BUILDING CODE 2018 EDITION	
b. MINIMUM DESIGN LOADS FOR BUILDING AND OTHER STRUCTURES, ASCE 7-10	
2. ROOF DEAD LOAD 15PSF	
3. ROOF LIVE LOAD 20 PSF	
4. ROOF SNOW LOAD	
a. FLAT-ROOF SNOW LOAD, P _f	15 PSF
b. SNOW EXPOSURE FACTOR, C _e	0.9
c. SNOW IMPORTANCE FACTOR, I _s	1.0
d. THERMAL FACTOR, C _t	1.0
5. FLOOR DEAD LOAD	
a. TYPICAL FLOOR	15 PSF
6. FLOOR LIVE LOADS	
a. SLAB-ON-GRADE	100 PSF
7. WIND LOADS/DATA	
a. BASIC WIND SPEED (3 SECOND GUST)	120 MPH
b. RISK CATEGORY	II
c. EXPOSURE	B
d. INTERNAL PRESSURE COEFFICIENT, G _{cp}	+/-0.18
e. TOPOGRAPHY FACTOR, K _{zt}	1.00
f. APPLIED DIRECTIONALITY FACTOR, K _d	0.85
g. WIND BASE SHEAR	
W _x	7.2 KIPS
W _y	8.0 KIPS
8. SEISMIC LOADS/DATA	
a. ANALYSIS PROCEDURE	EQUIVALENT LATERAL FORCE
b. SITE CLASS	D
c. SEISMIC IMPORTANCE FACTOR I _e	1.0
f. SITE COEFFICIENT, F _a	1.6
g. SITE COEFFICIENT, F _v	2.4
h. SPECTRAL RESPONSE COEFFICIENT, S _{ds}	0.136
i. SPECTRAL RESPONSE COEFFICIENT, S _{d1}	0.101
BASIC STRUCTURAL SYSTEM	STEEL SYSTEMS NOT SPECIFICALLY DETAILED FOR SEISMIC RESISTANCE
j. RESPONSE MODIFICATION FACTOR, R	3
k. SEISMIC RESPONSE COEFFICIENT, C _s	0.061
q. SEISMIC BASE SHEARS	
S _x	1.5 KIPS
S _y	1.5 KIPS

ABBREVIATIONS

+/-	PLUS OR MINUS	GA	GAUGE
@	AT	GALV	GALVANIZED
&	AND	HD	HEADED
Ø	DIAMETER	HI	HIGH
AB	ANCHOR BOLTS	HORIZ	HORIZONTAL
ACI	AMERICAN CONCRETE INSTITUTE	HSS	HOLLOW STRUCTURAL SYSTEM
ADDL	ADDITIONAL	INT	INTERIOR
AFF	ABOVE FINISHED FLOOR	JT	JOINT
AISC	AMER. INSTITUTE OF STEEL CONSTRUCTION	K	KIP(S)
AISI	AMER. IRON & STEEL INSTITUTE	KB	KNEE BRACE
ALT	ALTERNATE	KSI	KIPS PER SQ. INCH
ARCH	ARCHITECTURAL/ARCHITECT'S	LB	LONG BAR
ASTM	AMER. SOCIETY FOR TESTING & WELDING	LBS	POUNDS
AWS	AMERICAN WELDING SOCIETY	LLH	LONG LEG HORIZONTAL
B/ OR BOT	BOTTOM	LLV	LONG LEG VERTICAL
BCX	BOTTOM CHORD EXTENSION	LO	LOW
BFF	BELOW FINISHED FLOOR	LOC	LOCATION
BLDG	BUILDING	LWC	LIGHT WEIGHT CONCRETE
BM	BEAM	MAX	MAXIMUM
BOS	BOTTOM OF STEEL	MC	MOMENT CONNECTION
BRG	BEARING	MECH	MECHANICAL
BTWN	BETWEEN	MFR	MANUFACTURER
MECH	MECHANICAL	MID	MIDDLE
CANT	CANTILEVER BEAM	MIN	MINIMUM
CJ	CONTROL JOINT	MISC	MISCELLANEOUS
CL	CENTERLINE	MOW	MIDDLE OF WALL
CLR	CLEAR	MP	MASONRY PILASTER
CMU	CONCRETE MASONRY UNIT	No OR #	NUMBER
COL	COLUMN	NS	NEAR SIDE
CONC	CONCRETE	NTS	NOT TO SCALE
CONN	CONNECTION	NWC	NORMAL WEIGHT CONCRETE
CONST JT	CONSTRUCTION JOINT	OC	ON CENTER
CONT	CONTINUOUS	OPNG	OPENING
CONTR	CONTRACTOR	OPP	OPPOSITE HAND
CTRD	CENTERED	PAF	POWDER ACTUATED FASTENER
d	NAILS (PENNY)	FED	PEDESTAL
DBA	DEFORMED BAR ANCHOR	*	PLATE
DEFL	DEFLECTION	PSF	POUNDS PER SQUARE FOOT
DEPR	DEPRESSION / DEPRESSED	PSI	POUNDS PER SQUARE INCH
DET	DETAIL	PT	PRESSURE TREATED
DIAG	DIAGONAL	REF	REFERENCE
DIM	DIMENSION	REINF	REINFORCING
DIST	DISTANCE	REQD	REQUIRED
DWG (S)	DRAWING (S)	SB	SHORT BAR
DWL (S)	DOWEL (S)	SCHD	SCHEDULE
EA	EACH	SIM	SIMILAR
EE	EACH END	SOG	SLAB ON GRADE
EF	EACH FACE	SPEC (S)	SPECIFICATION (S)
EJ	EXPANSION JOINT	SQ	SQUARE
ELEV	ELEVATION	STD	STANDARD
EMBED	EMBEDDED / EMBEDMENT	STIFF	STIFFENER
ENGR	ENGINEER	STIRR	STIRRUP (S)
EOD	EDGE OF DECK	STL	STEEL
EOS	EDGE OF SLAB	STR	STRUCTURAL
EQ	EQUAL	T	TOP
EQUIP	EQUIPMENT	TCX	TOP CHORD EXTENSION
EW	EACH WAY	TOC	TOP OF CONCRETE
EXIST	EXISTING	TOS	TOP OF STEEL
EXP	EXPANSION	TOW	TOP OF WALL
EXT	EXTERIOR	TYP	TYPICAL
FDN	FOUNDATION	UNO	UNLESS NOTED OTHERWISE
FFE	FINISHED FLOOR ELEVATION	VERT	VERTICAL
FOM	FACE OF MASONRY	VIF	VERIFY IN FIELD
FOW	FACE OF WALL	W	WITH
FS	FAR SIDE	WP	WORK POINT
FTG	FOOTING	WWF	WELDED WIRE FABRIC

*Engineers seal does not include construction means, methods, techniques, sequences, procedures or safety precautions. Any deviation or discrepancy on plans are to be brought to the immediate attention of Tynndall Engineering & Design, P.A. Failure to do so will void Tynndall Engineering & Design, P.A. liability.

*Please review these documents carefully. Tynndall Engineering & Design, P.A. will interpret that all dimensions, recommendations, etc. presented in these documents were deemed acceptable once construction begins.

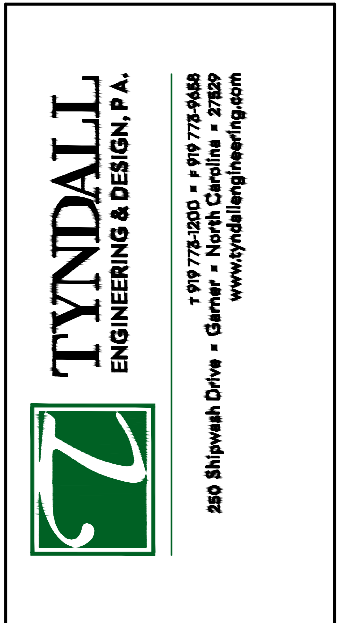

TYNDALL
ENGINEERING & DESIGN, P.A.
3305-109 DURHAM DR. RALEIGH, NC 27603
919-779-9797
www.tynndalleng.com

Client: **W.S. ARCHITECTS PA**
3305-109 DURHAM DR. RALEIGH, NC 27603
919-779-9797

Drawn: **MI CUNCUN**






GENERAL NOTES

Project #:	2001-010539
Date:	02/24/2021
Drawn/Design By:	KFR
DWG. Checked By:	PTII
Scale:	N/A

REVISIONS


No.	Date	Remarks
△		
△		
△		
△		

Sheet Number
S0.1
2 of 4

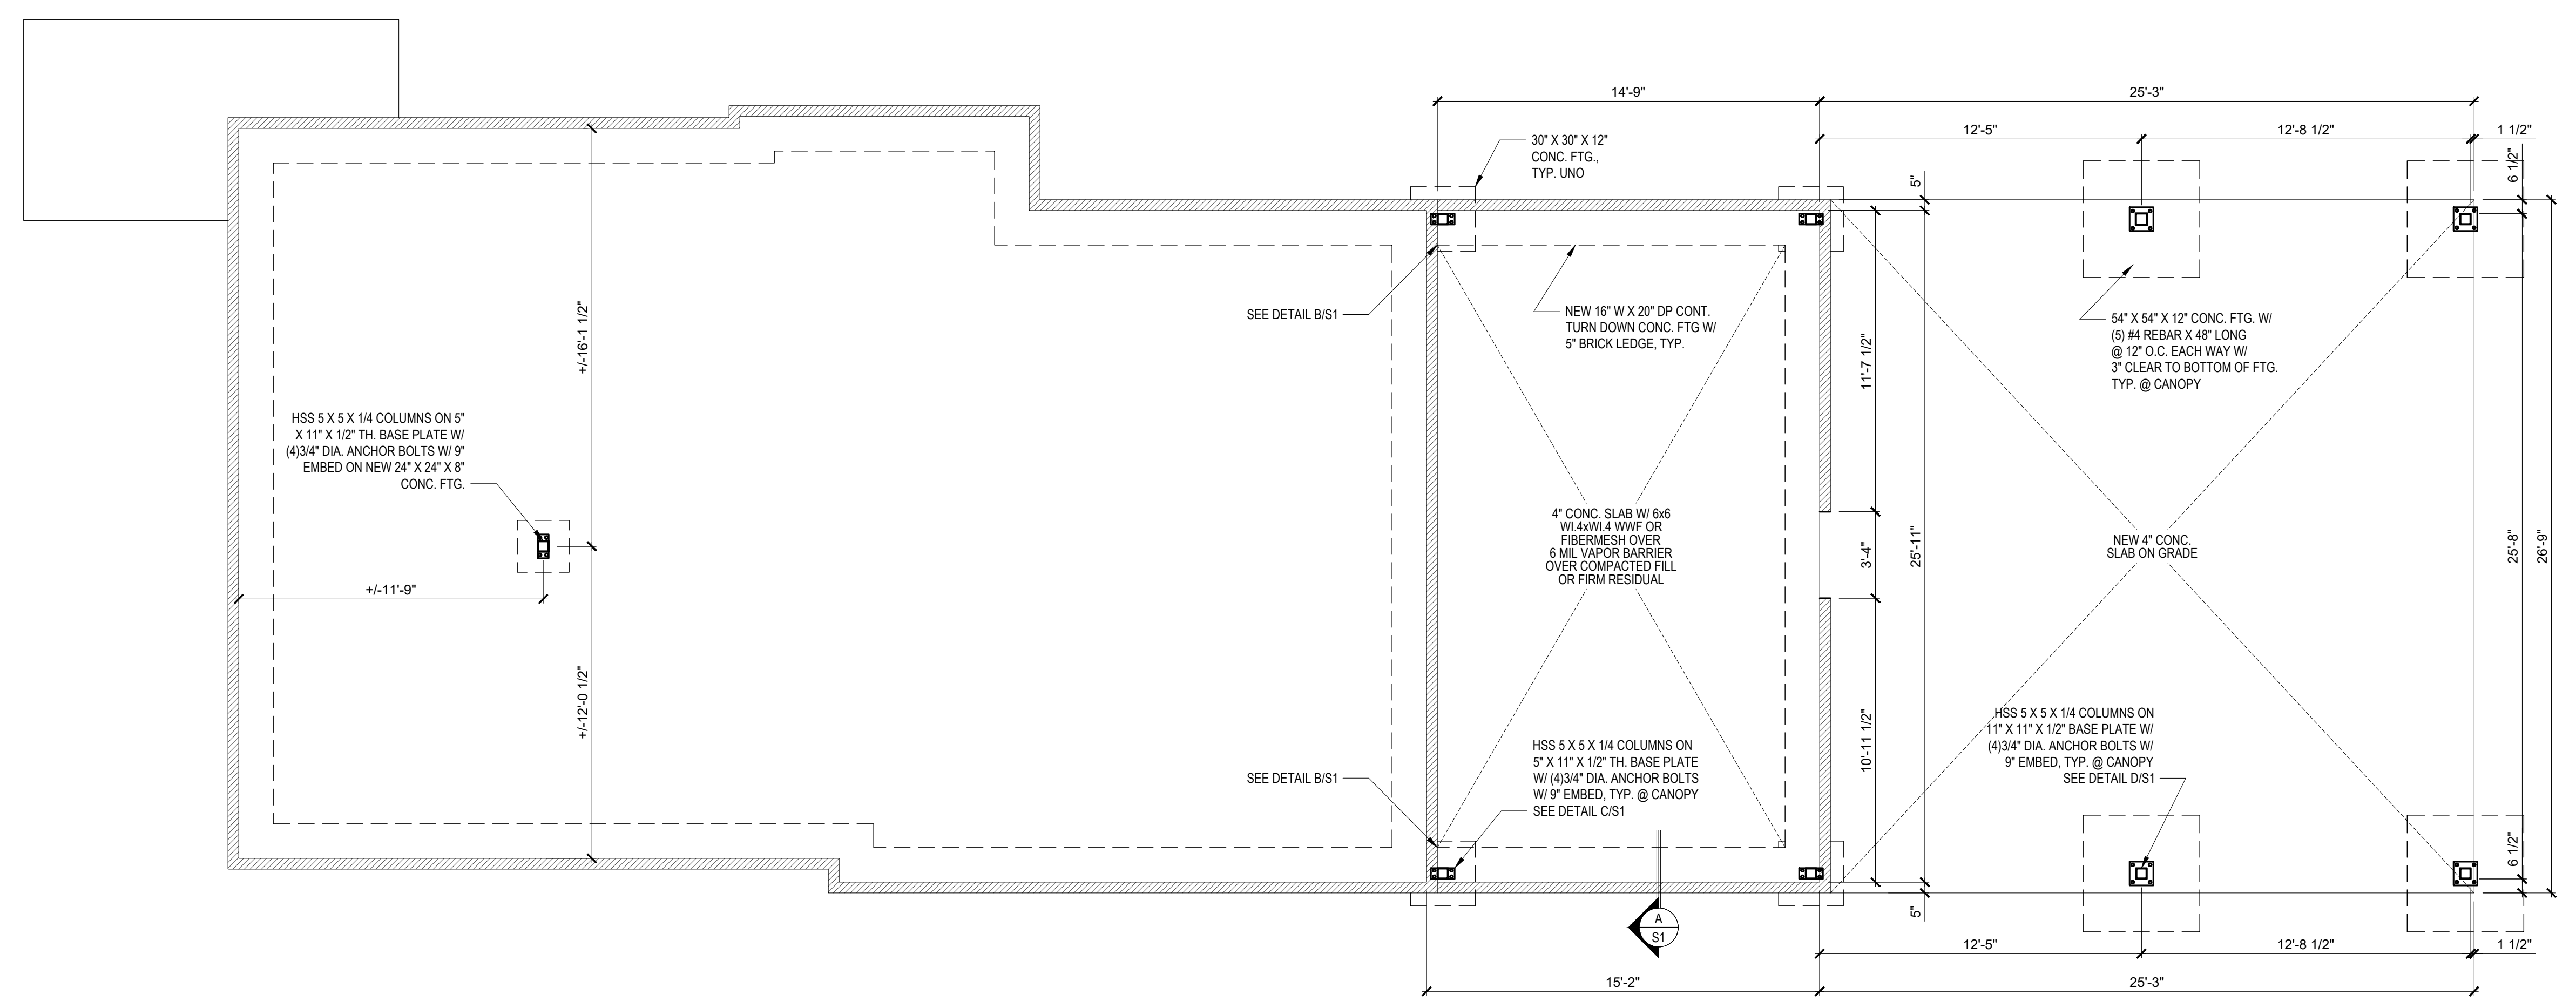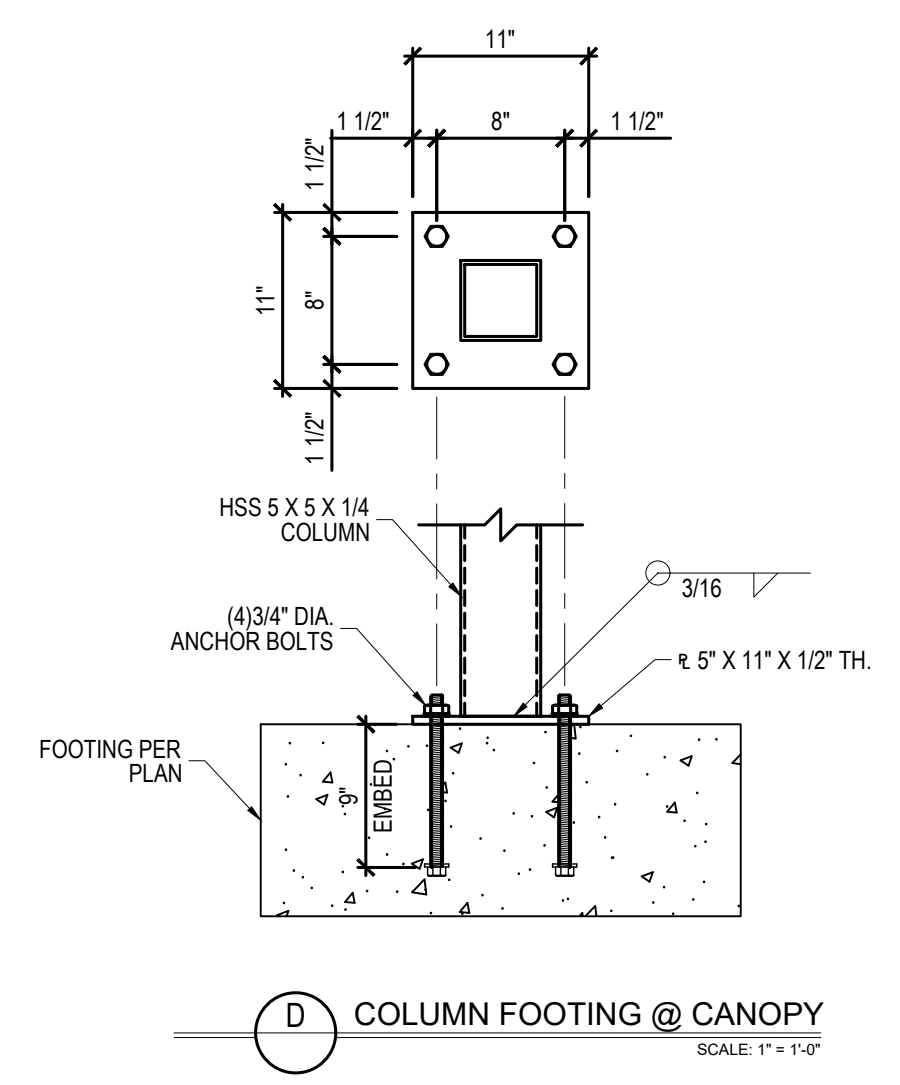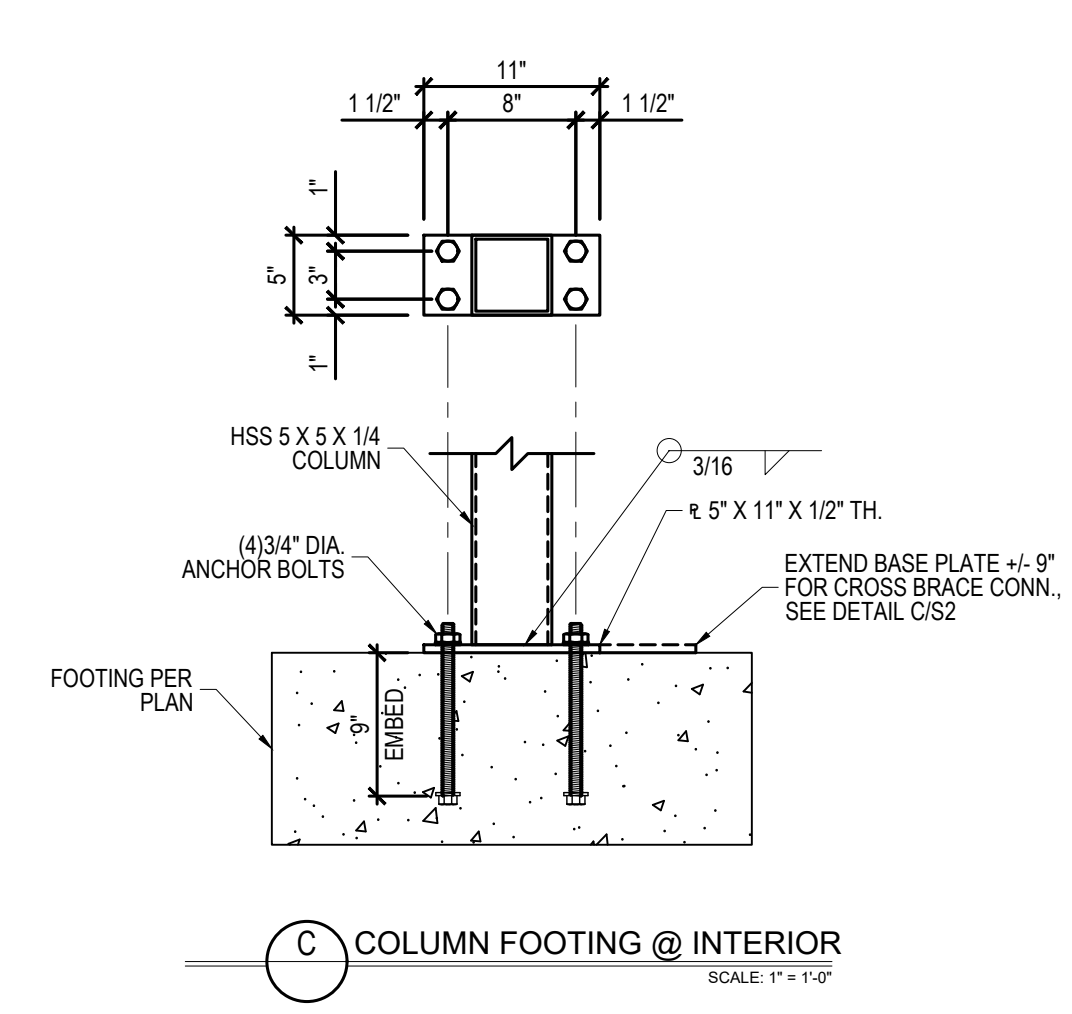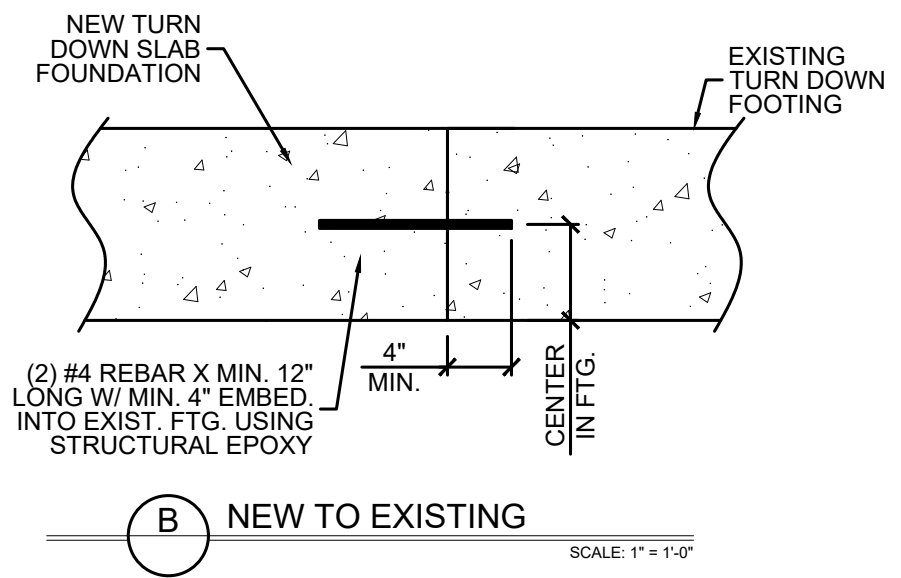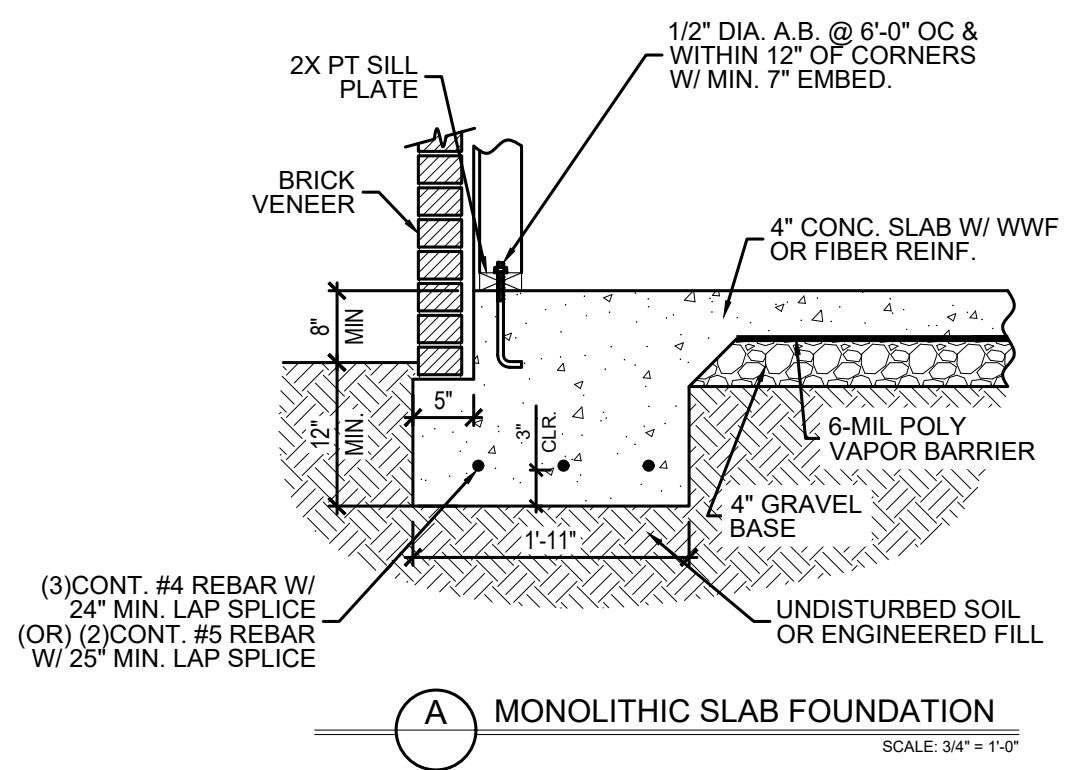

FOUNDATION PLAN
1/4" = 1'-0"

*Engineers seal does not include construction means, methods, techniques, sequences, procedures or safety precautions.
Any deviation or discrepancy on plans are to be brought to the immediate attention of Tyn dall Engineering & Design, P.A. Failure to do so will void Tyn dall Engineering & Design, P.A. liability.
*Please review these documents carefully. Tyn dall Engineering & Design, P.A. will interpret that all dimensions, recommendations, etc. presented in these documents were deemed acceptable once construction begins.

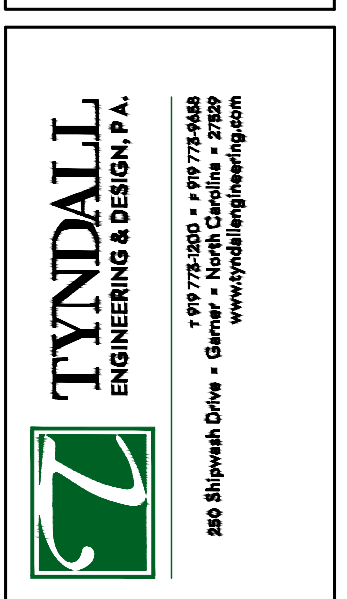

TYNDALL
ENGINEERING & DESIGN, P.A.
3305-109 DURHAM DR RALEIGH, NC 27603
919-779-9797
www.tyndallengineering.com

Client: W.S. ARCHITECTS PA
3305-109 DURHAM DR RALEIGH, NC 27603
919-779-9797

Project #: 2001-010539
Date: 02/24/2021
Drawn/Design By: KFR
DWG. Checked By: PTII
Scale: SEE PLAN

MI CUNCUN







FOUNDATION PLAN

Project #: 2001-010539
Date: 02/24/2021
Drawn/Design By: KFR
DWG. Checked By: PTII
Scale: SEE PLAN

REVISIONS		
No.	Date	Remarks


Sheet Number
S1
3 of 4

FILENAME: Z:\RESIDENTIAL\ENR\2020 STRUCTURAL PROJECTS\2001-010539 - MI CUNCUN\2001-010539_LAYOUTS\SWD BY: PROVIDENCE TYN DALL LAST PLOT DATE: 02/25/2021 8:12 AM

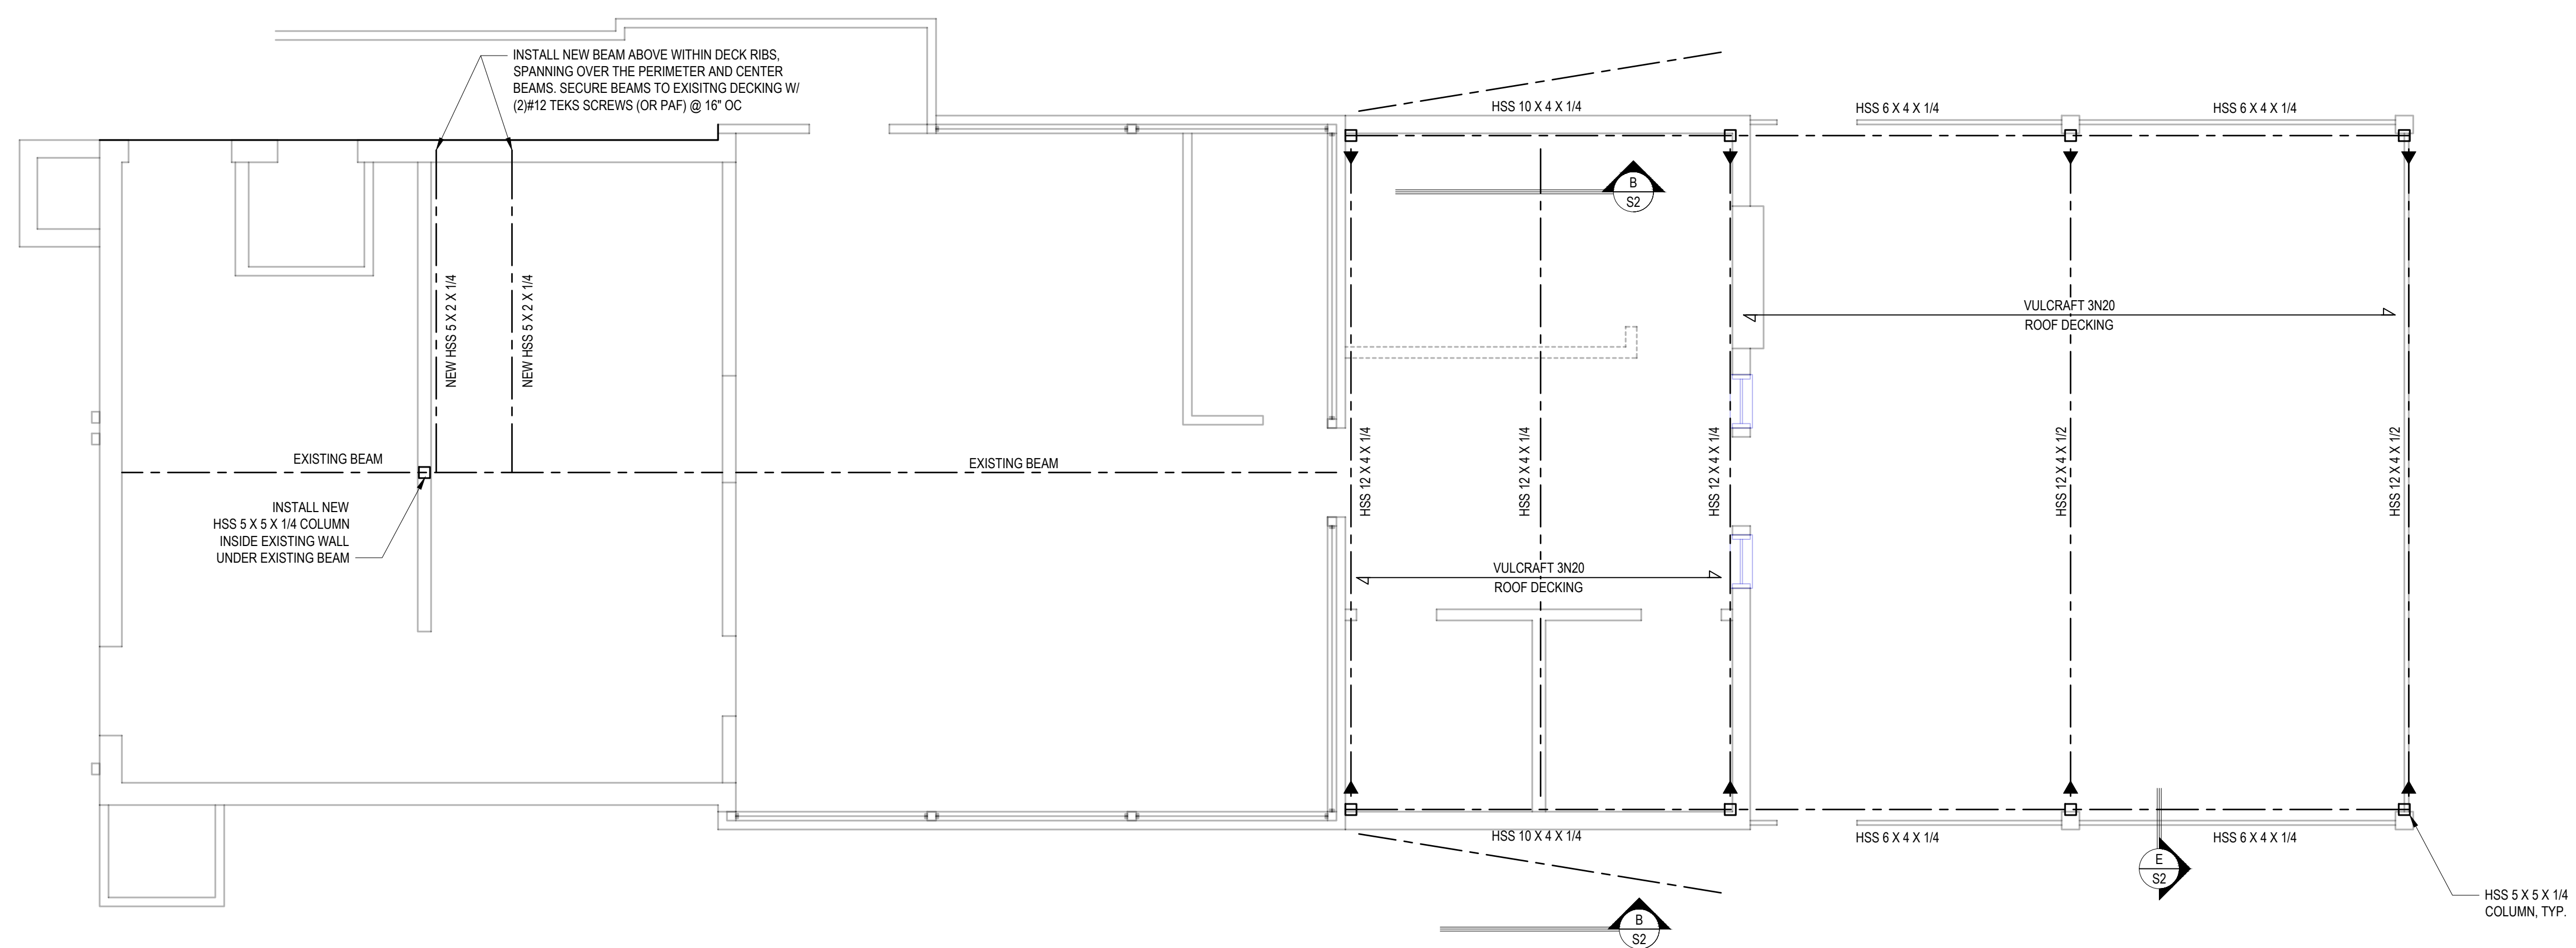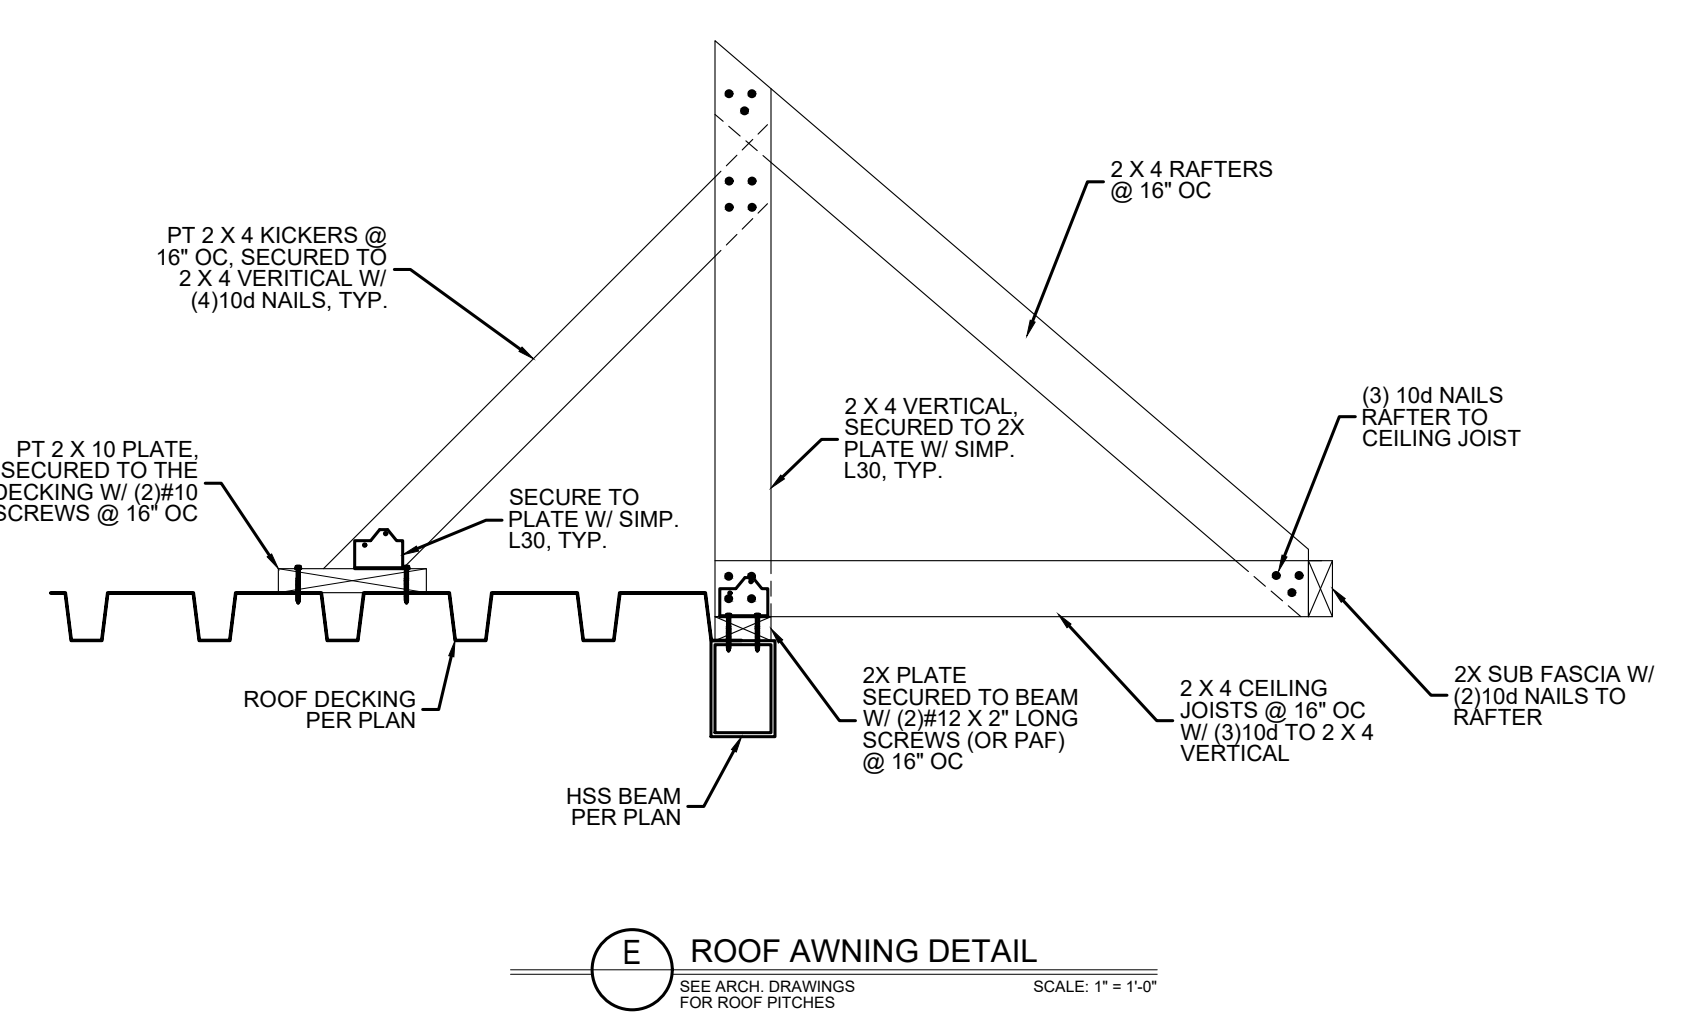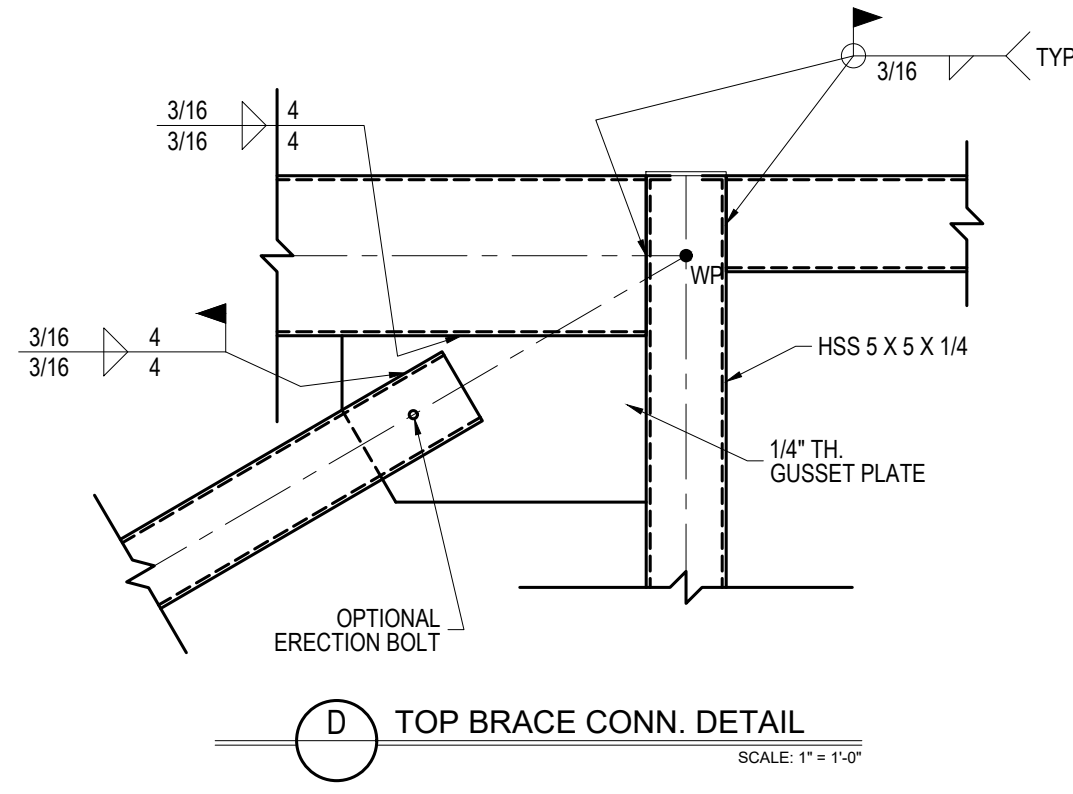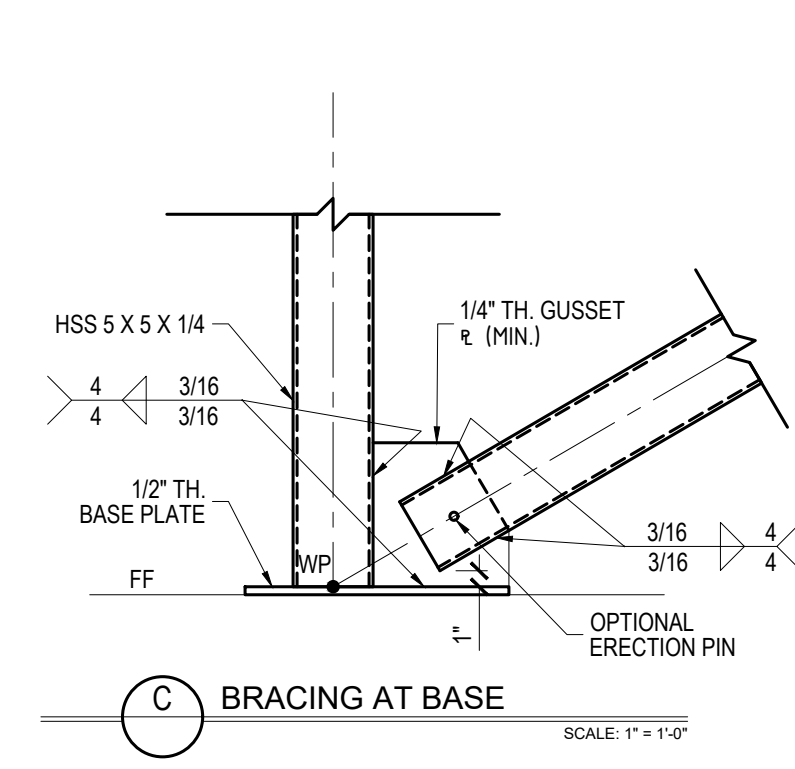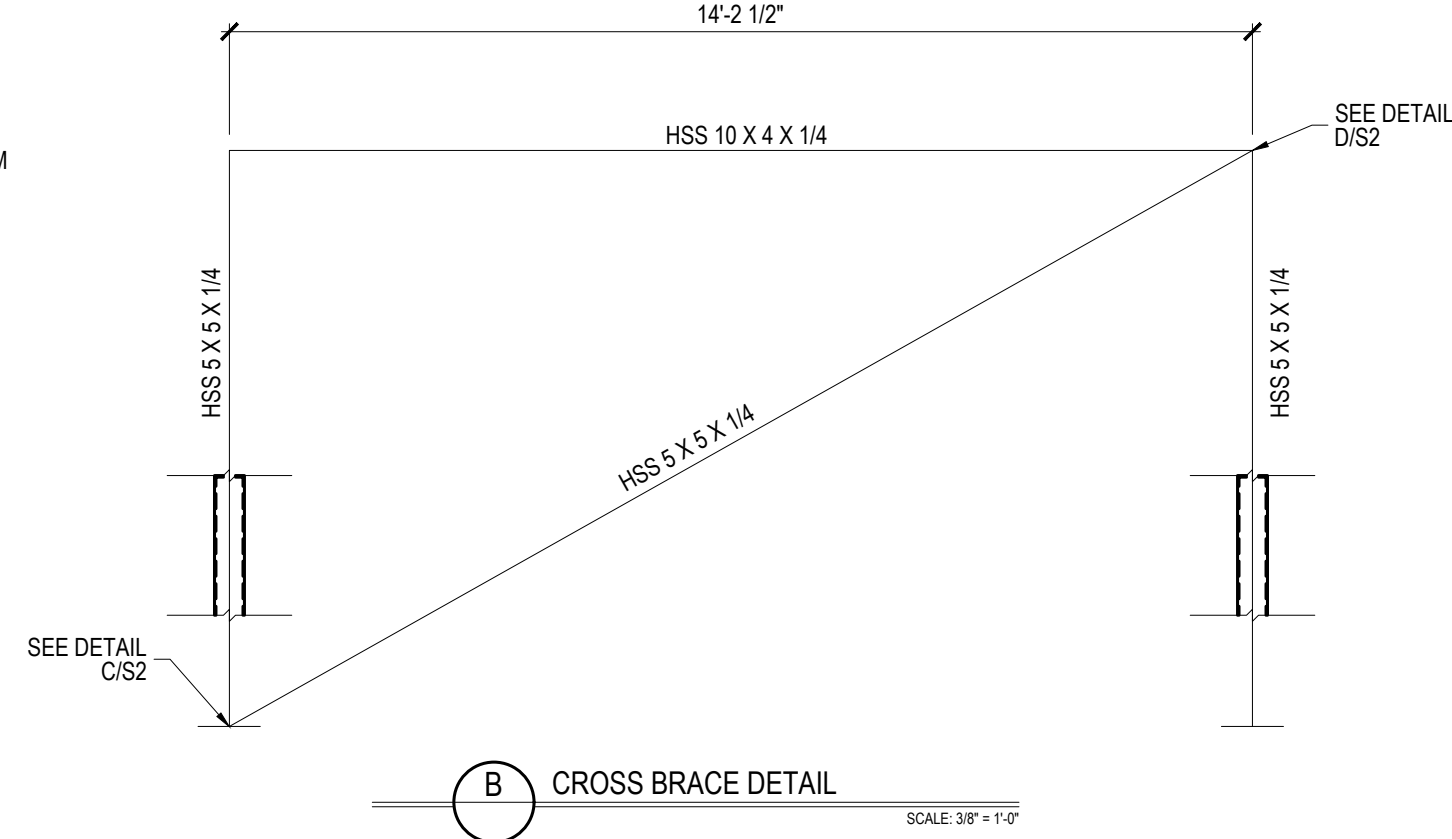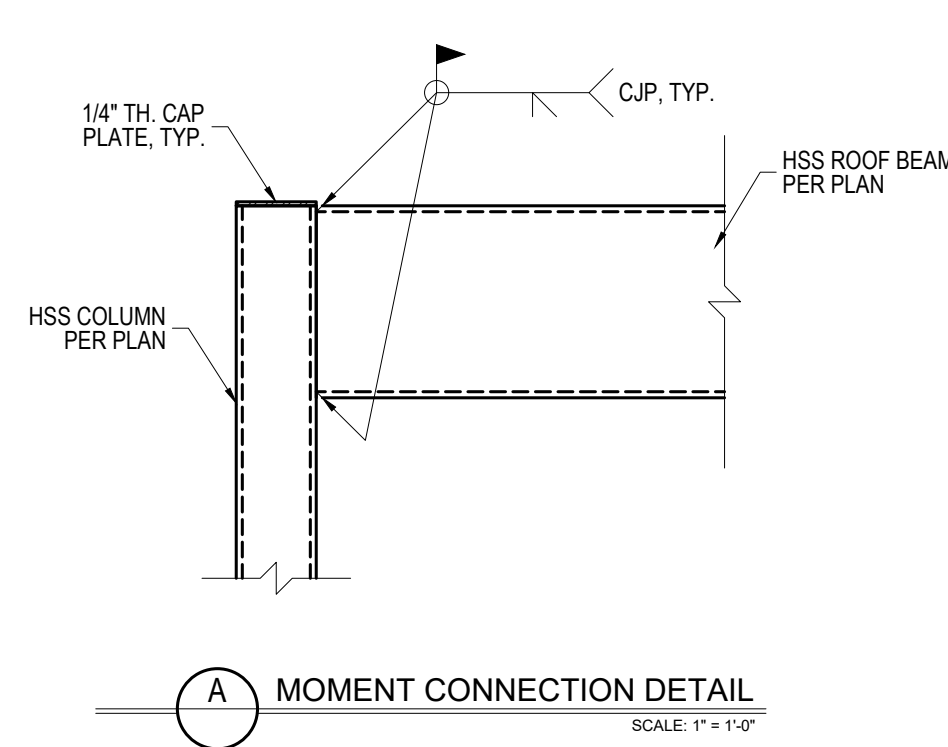

FIRST FLOOR PLAN
1/4" = 1'-0"

Engineers and designers are not responsible for construction methods, techniques, sequences, procedures or safety precautions. Any deviations or discrepancies on plans are to be brought to the immediate attention of Tyn dall Engineering & Design, P.A. Failure to do so will void Tyn dall Engineering & Design, P.A. liability. Please review these documents carefully. Tyn dall Engineering & Design, P.A. will interpret that all dimensions, recommendations, etc. presented in these documents were deemed acceptable once construction begins.

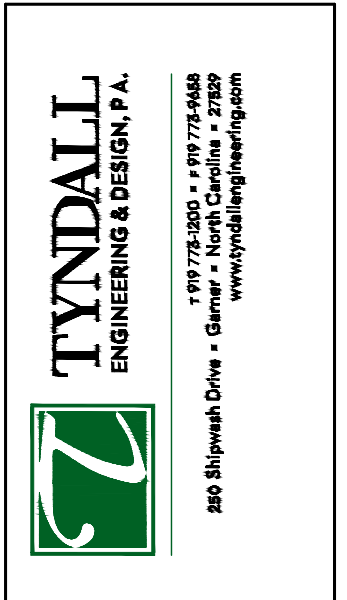

TYNDALL
ENGINEERING & DESIGN, P.A.
3305-109 DURHAM DR RALEIGH, NC 27603
919-779-9797
www.tyndallengineering.com

Client: W.S. ARCHITECTS PA
3305-109 DURHAM DR RALEIGH, NC 27603
919-779-9797

Project #: 2001-010539
Date: 02/24/2021
Drawn/Design By: KFR
DWG. Checked By: PTII
Scale: SEE PLAN

MI CUNCUN

1ST FLOOR HEADER

Project #: 2001-010539
Date: 02/24/2021
Drawn/Design By: KFR
DWG. Checked By: PTII
Scale: SEE PLAN

REVISIONS		
No.	Date	Remarks

Sheet Number
S2
4 of 4

FILENAME: Z:_RESIDENTIAL_ENR\2020_STRUCTURAL_PROJECTS\2001-010539_1ST FLOOR SWD.DWG BY: PROVIDENCE TYN DALL LAST PLOT DATE: 02/25/2021 8:12 AM