



# Ansul Pre-Engineered Fire Suppression System

Wet Chemical - Kitchen System


## Installation Location:

Rudino's Pizza and Grinders  
1574 NC 24-87  
Cameron, NC 28326

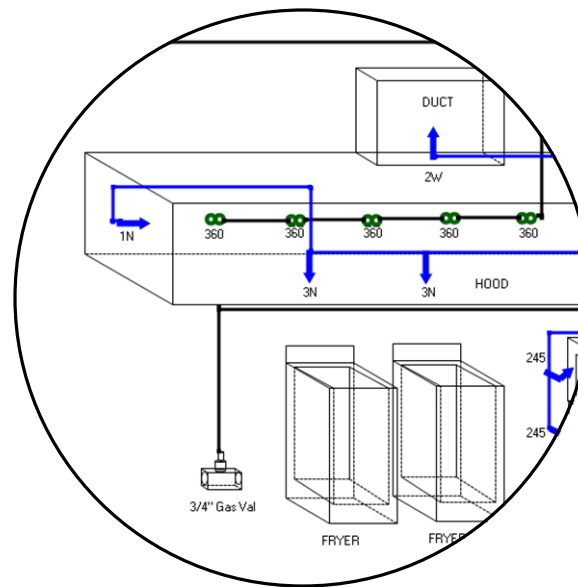

All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901  
910-496-0600  
msmith@allamericanfireusa.com

# Ansul Pre-Engineered Fire Suppression System

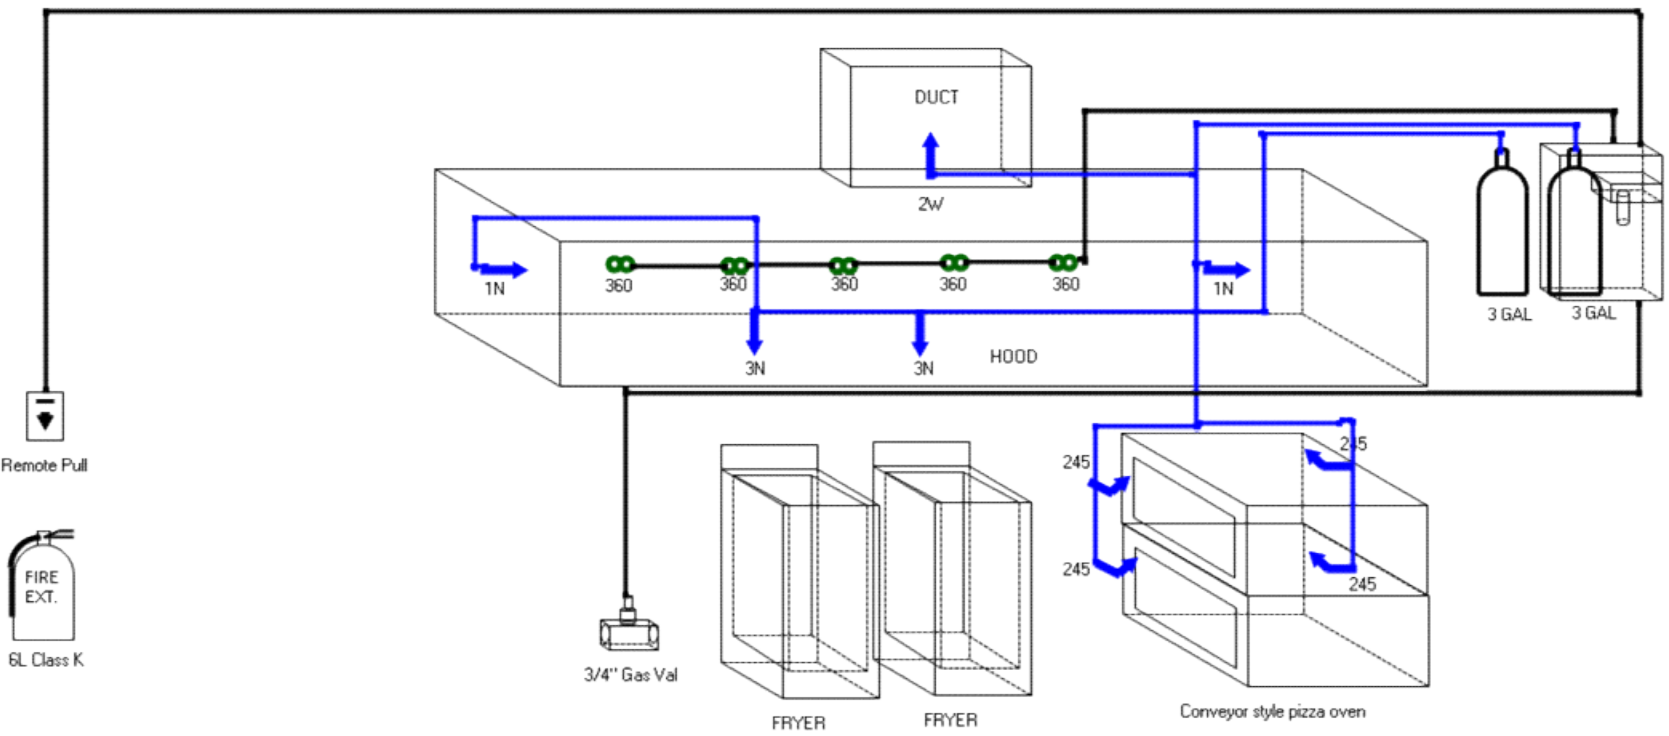

Total System Flow Points = 22 : Flow Points Used = 18



Designed & Installed by:  
 All American Fire Protection  
 159 S Main St  
 Spring Lake, NC 28390-3901  
 910-496-0600

For:  
 Rudino's Pizza and Grinders  
 1574 NC 24-87  
 Cameron, NC 28326

Designer:  
 Job: Correct coverage for new equipment  
 Date: 2/24/2023

# Ansul Pre-Engineered Fire Suppression System

## Notes

- Repipe system for new equipment coverage.

System- Ansul R102, 6 gallon wet chemical system with a 22 flow point capacity. This application uses 18. System uses 3/8" black steel piping, remote manual release mounted at rear exit door, automatic gas shutoff valve, fusible metal links. 1 tank covers pizza oven, 1 plenum nozzle and duct nozzle- 11 flows total. Second tank covers 1 plenum nozzle and 2 fryers - 7 flows total.



Designed & Installed by:  
All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901

For:  
Rudino's Pizza and Grinders  
1574 NC 24-87  
Cameron, NC 28326