

Ansul Pre-Engineered Fire Suppression System

Wet Chemical - Kitchen System

Installation Location:



Rudino's Pizza and Grinders
1574 NC 24-87
Cameron, NC 28326

Review For Fire Code Compliance




Leslie Jackson

03/01/2023 7:15:03 AM

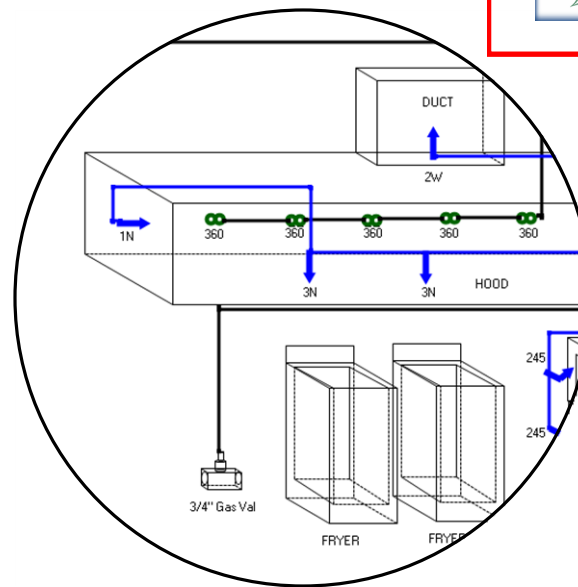

All American Fire Protection
159 S Main St
Spring Lake, NC 28390-3901
910-496-0600
msmith@allamericanfireusa.com

Ansul Pre-Engineered Fire Suppression System

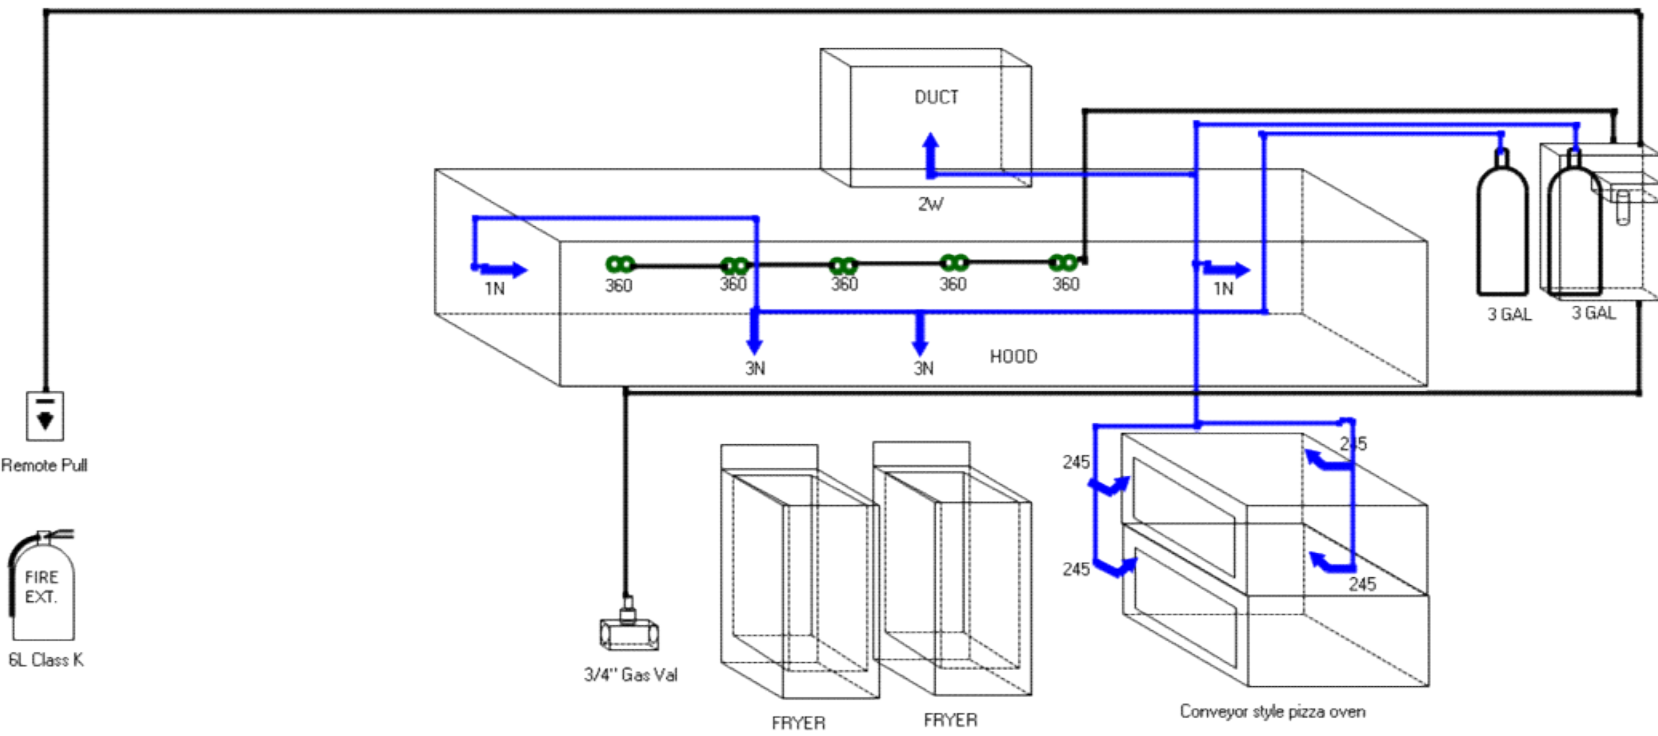

Total System Flow Points = 22 : Flow Points Used = 18



Designed & Installed by:
 All American Fire Protection
 159 S Main St
 Spring Lake, NC 28390-3901
 910-496-0600

For:
 Rudino's Pizza and Grinders
 1574 NC 24-87
 Cameron, NC 28326

Designer:
 Job: Correct coverage for new equipment
 Date: 2/24/2023

Ansul Pre-Engineered Fire Suppression System

Notes

- Repipe system for new equipment coverage.

System- Ansul R102, 6 gallon wet chemical system with a 22 flow point capacity. This application uses 18. System uses 3/8" black steel piping, remote manual release mounted at rear exit door, automatic gas shutoff valve, fusible metal links. 1 tank covers pizza oven, 1 plenum nozzle and duct nozzle- 11 flows total. Second tank covers 1 plenum nozzle and 2 fryers - 7 flows total.



Designed & Installed by:
All American Fire Protection
159 S Main St
Spring Lake, NC 28390-3901

For:
Rudino's Pizza and Grinders
1574 NC 24-87
Cameron, NC 28326