



# Pyro-Chem Pre-Engineered Fire Suppression System

Wet Chemical - Kitchen System


## Installation Location:

Thai Smiles 2Go  
68 Amarillo Lane  
Sanford, NC 27332

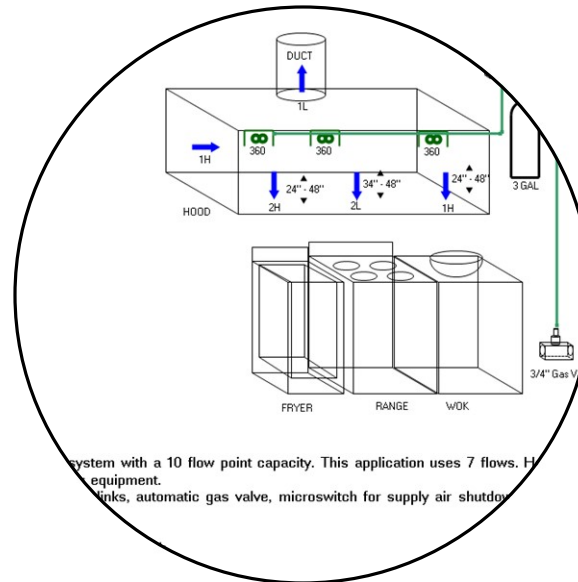

All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901  
910-496-0600  
msmith@allamericanfireusa.com

# Pyro-Chem Pre-Engineered Fire Suppression System

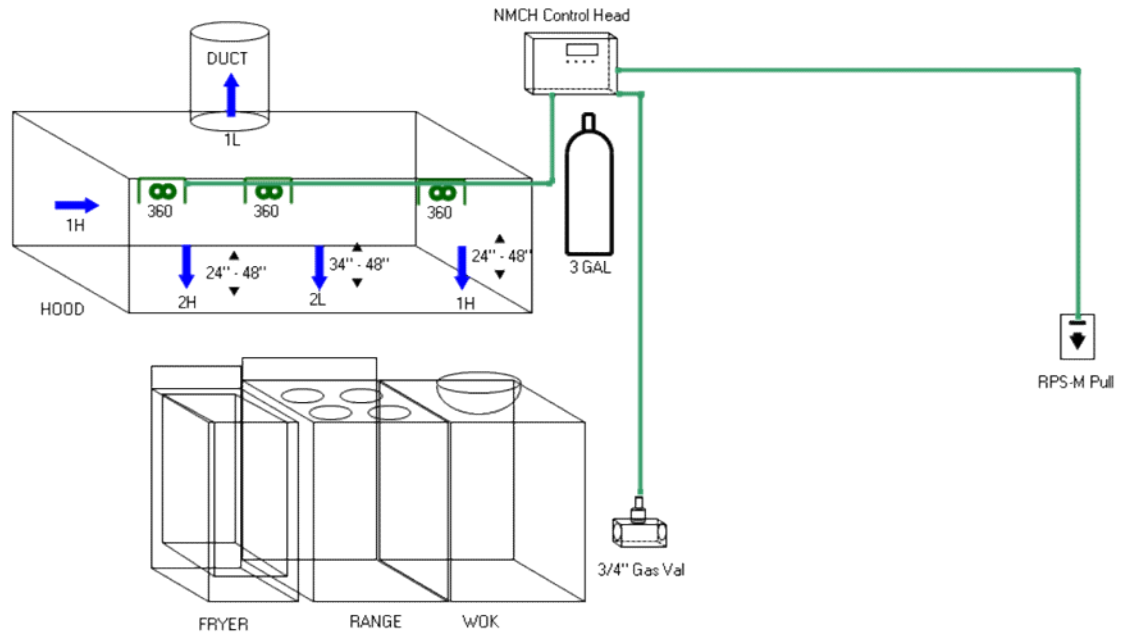

System is a Pyrochem PCL 300 wet chemical system with a 10 flow point capacity. This application uses 7 flows. Hood and system are existing.

Tank size is being changed to accommodate new equipment.

System uses 3/8" black steel piping, fusible metal links, automatic gas valve, microswitch for supply air shutdown, remote manual release.

Hood - 6'L x 4'W

Duct - 14" round

Equipment - 14" x 24" fryer, 24" x 24" 4 burner stove, 16" wok

Total System Flow Points = 10 : Flow Points Used = 7



Designed & Installed by:  
All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901  
910-496-0600

For:  
Thai Smiles 2Go  
68 Amarillo Lane  
Sanford, NC 27332

Job: Upgrade existing Pyrochem PCL system for proper

Designer: MS

Date: 7/2/2024

# Pyro-Chem Pre-Engineered Fire Suppression System

Notes



Designed & Installed by:  
All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901

For:  
Thai Smiles 2Go  
68 Amarillo Lane  
Sanford, NC 27332