


SITE/SOIL EVALUATION FOR ON-SITE WASTEWATER

APPLICANT NAME _____

DATE _____

FACTORS		PROFILES												
		1	2	3	4	5	6	7	8	9	10			
LANDSCAPE POSITION	.1940													
SLOPE (%)	.1940													
HORIZON 1 DEPTH		0-48	0-6	0-6	0-6	0-6	0-30	0-24						
Texture Group	.1941(A)(1)	USL	SL	SL	SL	SL	CL	CL						
Consistence	.1941													
Structure	.1941(A)(2)													
Mineralogy	.1941(A)(3)													
HORIZON 2 DEPTH			6-26	6-30	6-18	6-42	30-44	24-48						
Texture Group	.1941(A)(1)		CL	CL	CL	CL	SL	SL						
Consistence	.1941		IL/ML	IL										
Structure	.1941(A)(2)		SBL	SBL										
Mineralogy	.1941(A)(3)		SBP	SBP										
HORIZON 3 DEPTH					28-42									
Texture Group	.1941(A)(1)				SL/CL									
Consistence	.1941													
Structure	.1941(A)(2)													
Mineralogy	.1941(A)(3)													
HORIZON 4 DEPTH														
Texture Group	.1941(A)(1)													
Consistence	.1941													
Structure	.1941(A)(2)													
Mineralogy	.1941(A)(3)													
SOIL WETNESS	.1942	40"	24"	25"	—	—	42"	38"						
RESTRICTIVE HORIZON	.1944													
SAPROLITE	.1943/.1956													
CLASSIFICATION	.1948	PS	PS	P	PS	PC	PS	PS						
LONG TERM ACCEPTANCE RATE	.1955	.8	.4	.4	.5	.45	.8/7	.7						

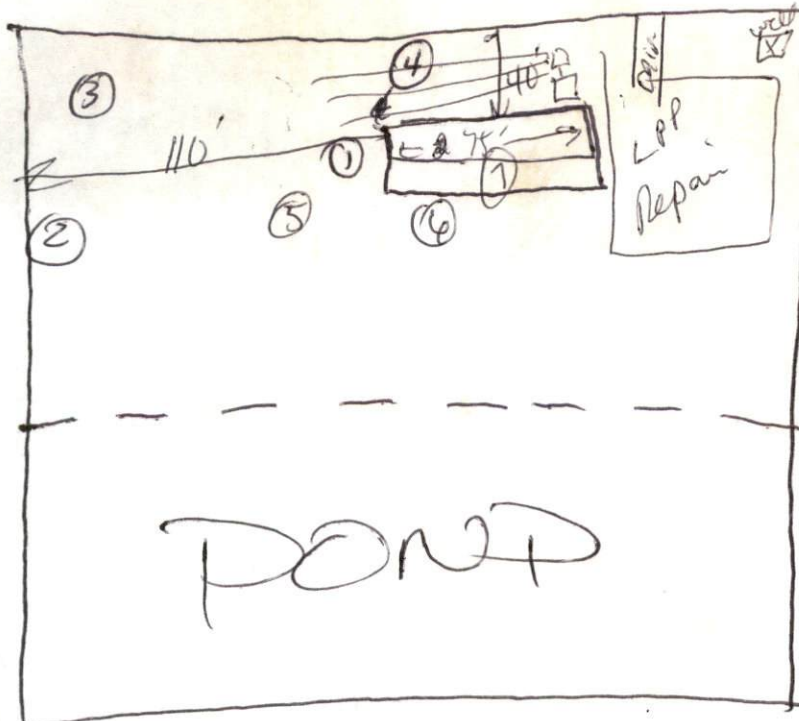

* start ditches at 3' at
 come out at 1'.
 * 6" cover req'd over system
 * 300' EBE-Lg
 * well 100'
 * Do not drive over system