

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) L.B. Hayes New Installation Septic Tank
 Property Location: SR# 1111 Repairs Nitrification Line

Subdivision Sweet Briar Est. Lot # 62

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 Lot Size: 100 x 463 x 100 x 477

Basement with Plumbing: Garage: NOTE CHANGES IN

Water Supply: Well Public Community HOUSE LOCATION

Distance From Well: 50min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 1 exact length of each ditch 240 ft. width of ditches 3 ft. depth of ditches 18 in. MAX

French Drain Required: _____ Linear feet

Date: 12-3-98

This permit is subject to revocation if site plans or intended use change.

Signed: J. W. ANI
 Environmental Health Specialist

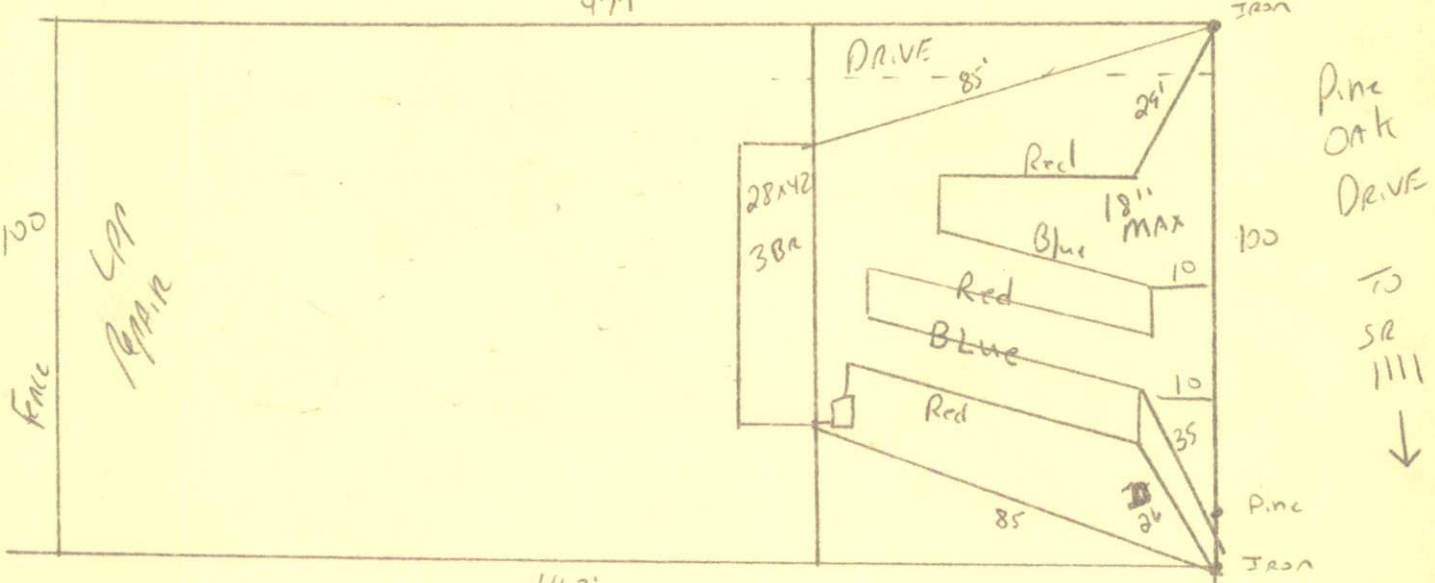

STUB OUT Plumbing shallow 18" MAX Ditch
 Depth Follow contours MANTAIN All Required
 set BACKS Do not DRIVE or park on septic
 SYSTEM

**HARNETT COUNTY HEALTH DEPARTMENT
AUTORIZATION TO CONSTRUCT**

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 15270. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent L.B. Hayes

Name: _____ Telephone # _____

Address: _____

Property Location: SR # 1111 Road Name Marks Rd

New Installation Repair _____ Septic Tank Nitrification Lines

Subdivision Street Branch Est. Lot # 62

Number of Bedrooms Proposed: 3 Lot size: 100x215x100x211

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public Minimum Well Setback: 50 ft.

Type of System: Conventional Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 1 Length of lines 240

Width of ditches 3 ft. Depth of ditches 18 MAX inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 12-3-98