

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Marcus + Nancy Whitt New Installation Septic Tank

Property Location: SR# off 1201 Repairs Nitrification Line

Hwy 27 to Ponderosa Rd to Brookstone on left

Subdivision Brookstone Lot # 55

Tax ID # 9566-59-1891 Split Quadrant # 09-9567-0097

Number of Bedrooms Proposed: THREE Lot Size: 2+ acres

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 100 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 3 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 15" in.

French Drain Required: _____ Linear feet

Date: 23 October 98

Signed: Vernest R. Doff
Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

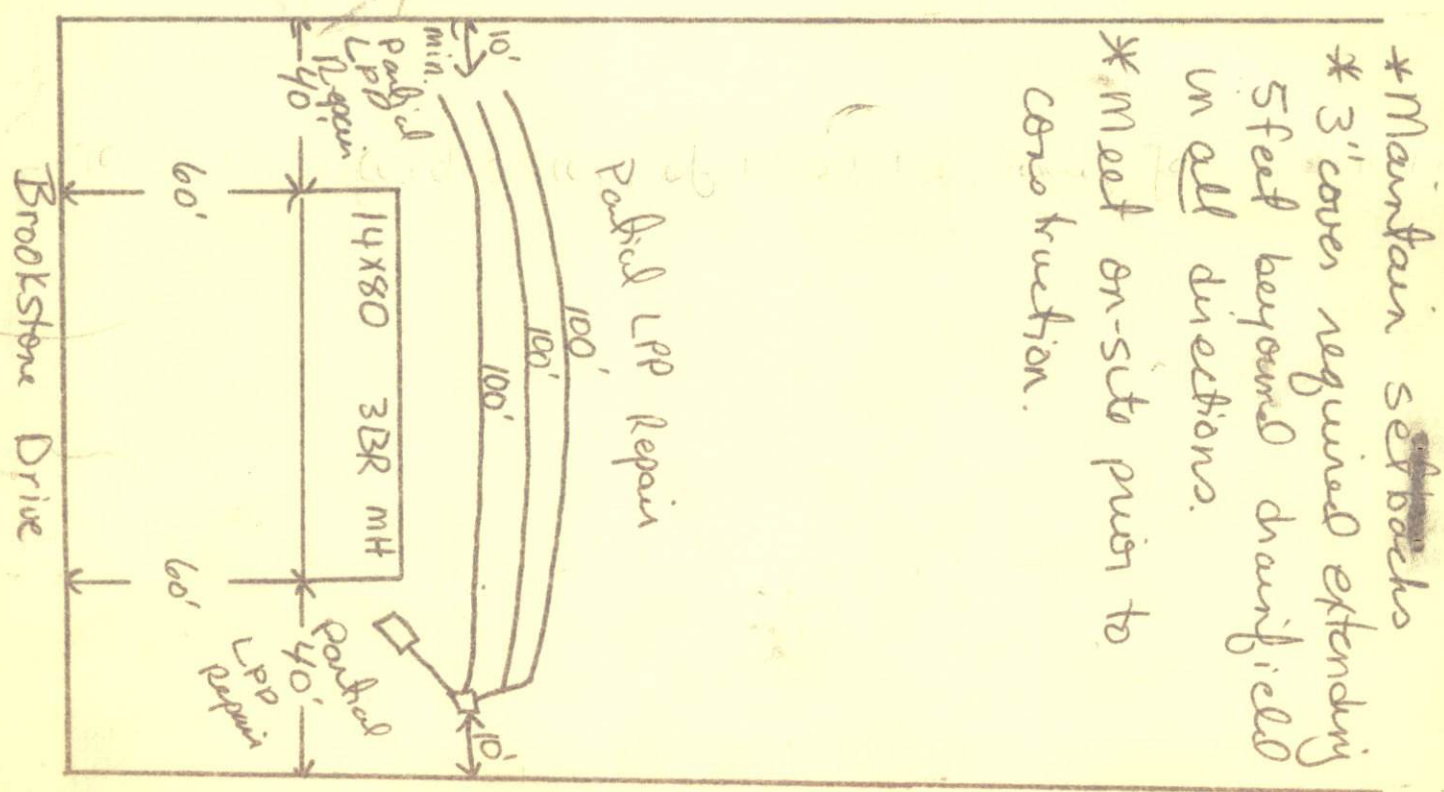

* Maintain setbacks
 * 3" covers required extending 5 feet beyond drainfield in all directions.
 * Meet on-site prior to construction.

**HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT**

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 14553. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent _____

Name: Marcus & Nancy Whitt Telephone # 499-2016

Address: 5625 Rossen Pitman Rd Sanford NC

Property Location: SR # off 1201 Road Name off Ponderosa

New Installation Repair _____ Septic Tank Nitrification Lines

Subdivision Brookstone Lot # 55

Number of Bedrooms Proposed: THREE Lot size: 2+ acres

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public Minimum Well Setback: 100 ft.

Type of System: Conventional Other Shallow Placement w/ 3" cover required

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 3 Length of lines 100

Width of ditches 3 ft. Depth of ditches 15 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: Vernon A. [Signature] Date: 23 Oct 98