

II... 'ROVEMENT PERM..

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Custom Contracting Corp.

[X] New Installation

[X] Septic Tank

Property Location: SR# off 1201 Ponderosa Rd.

[ ] Repairs

[X] Nitrification Line

Subdivision Carolina Seasons Sec. II

Lot # V-1

Tax ID #

Quadrant #

Number of Bedrooms Proposed: 3

Lot Size:

Basement with Plumbing: [ ]

Garage: [ ]

Water Supply: [ ] Well

[X] Public

[ ] Community

Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: [X] Conventional

[ ] Other

Size of tank: Septic Tank: 1000 gallons

Pump Tank: gallons

Subsurface Drainage Field

No. of ditches 1

exact length of each ditch 200 ft.

width of ditches 3 ft.

depth of ditches 18-24 in.

French Drain Required: Linear feet


Date: 4/24/98

Signed: Bruce M. Jewin / Board Health Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

\* Maintain all required setbacks

\* Move driveway against property line 10 ft max

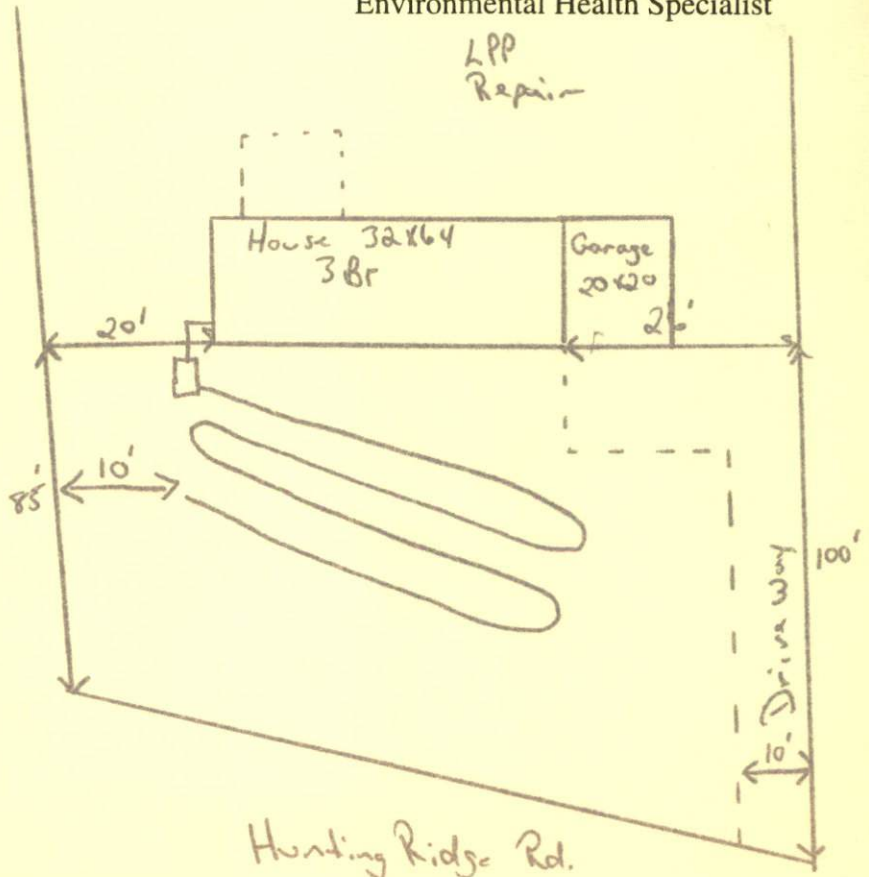

Hunting Ridge Rd.

HARNETT COUNTY HEALTH DEPARTMENT  
**AUTHORIZATION TO CONSTRUCT**

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 14856. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent \_\_\_\_\_

Name: Custom Contracting Corp Telephone # 775-1497  
ext. 17

Address: 1504 S. Horner Blvd. Sanford NC 27330

Property Location: SR # off 1201 Road Name off Penderosa

New Installation  Repair  Septic Tank  Nitrification Lines

Subdivision Carolina Seawoods Sect. IV Lot # V-1

Number of Bedrooms Proposed: 3 Lot size: \_\_\_\_\_

Basement  With Plumbing  Without Plumbing

Water Supply: Well  Public  Minimum Well Setback: 50 ft.

Type of System: Conventional  Other

Tank Volume: Septic Tank 1000 gallons Pump Chamber \_\_\_\_\_ gallons

**Nitrification Field Specifications**

Number of fields 1 Number of Lines per Field 1 Length of lines 200 ft.

Width of ditches 3 ft. Depth of ditches 18.24 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: Bryan McJannet Date: 4/24/98