

IMPROVEMENT PERMIT

Replaces # 13317

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Scott's Const.
Property Location: SR# 2045
New Installation, Septic Tank, Repairs, Nitrification Line

Subdivision Brander mill Lot # 13

Tax ID # Quadrant #

Number of Bedrooms Proposed: 3 Lot Size: 23,314 sq ft


Basement with Plumbing: Garage: Replaces permit # 13317
Water Supply: Well, Public, Community
Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional, Other
Size of tank: Septic Tank: 1000 gallons Pump Tank: gallons
Subsurface Drainage Field No. of ditches: 2 exact length of each ditch: 150 ft. width of ditches: 3 ft. depth of ditches: 18-24 in.
French Drain Required: Linear feet

Date: 2-26-98
Signed: J. Waters Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

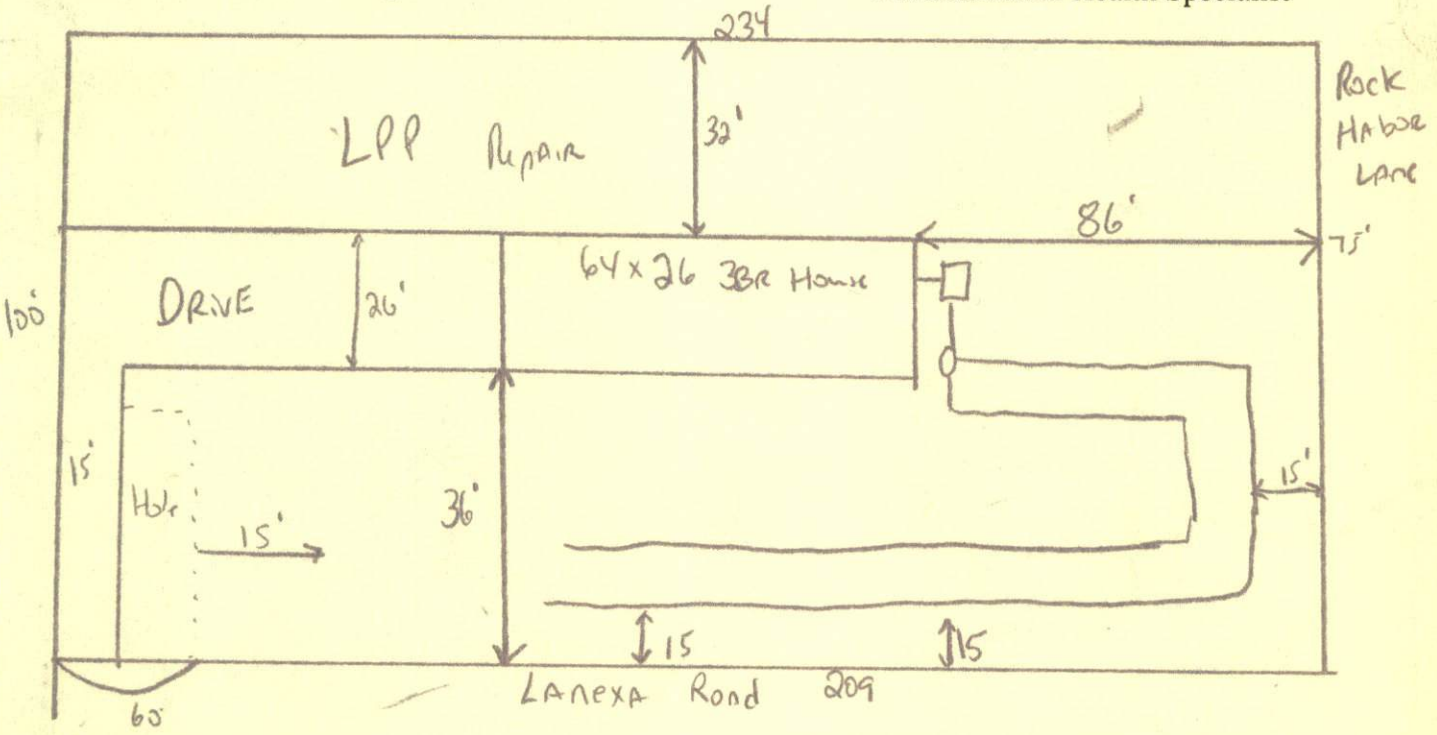

STUB out Plumbing shallow 18-24" Ditch Depth Follow contours maintain All required SETBACKS Keep 15' from 30x60 hole Along Property Line at the end of the Road

**HARNETT COUNTY HEALTH DEPARTMENT
AUT^HORIZATION TO CON^{STR}UCT**

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 13317. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Scotts Const.

Name: _____ Telephone # 485-0842

Address: _____

Property Location: SR # 2045 Road Name _____

New Installation Repair _____ Septic Tank Nitrification Lines

Subdivision Beardoe mill Lot # 13

Number of Bedrooms Proposed: 3 Lot size: 23,314.55/4

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well _____ Public Minimum Well Setback: _____ ft.

Type of System: Conventional Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 2 Length of lines 100

Width of ditches 3 ft. Depth of ditches 18.24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 2-26-98