

IMPROVEMENT PERM

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) O. L. Baker New Installation Septic Tank
Property Location: SR# 1409 Repairs Nitrification Line

Subdivision _____ Lot # _____

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 existing Lot Size: 2.304 ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: existing gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 2 exact length of each ditch 75 ft. width of ditches 3 ft. depth of ditches 24-36 in.

French Drain Required: _____ Linear feet

Date: 7-24-97

This permit is subject to revocation if site plans or intended use change.

Signed: Thomas O. Boyce R.S.
Environmental/Health Specialist

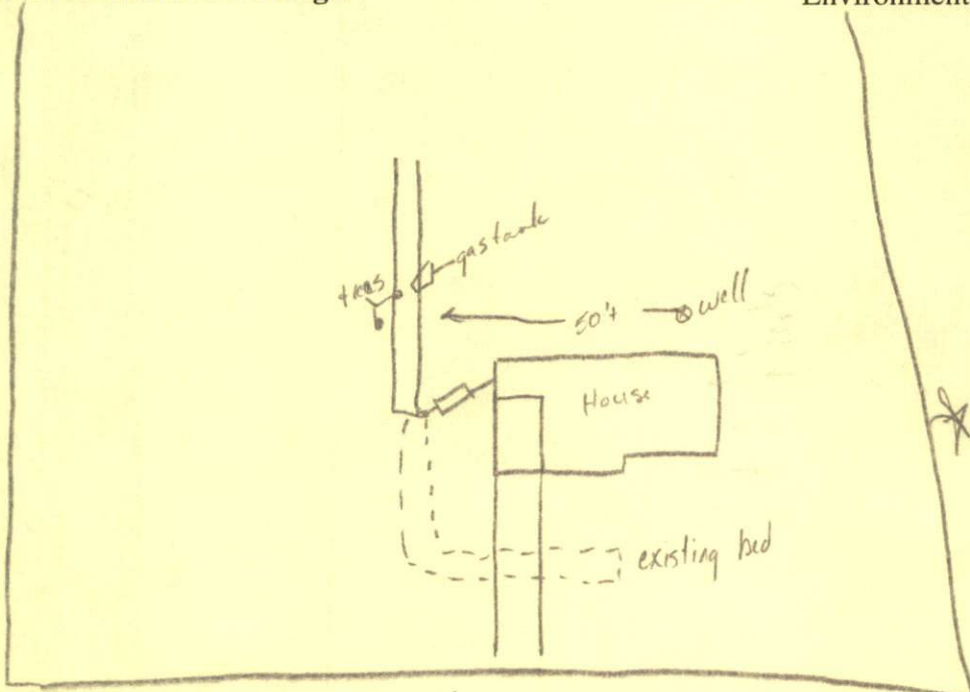

Maintain setbacks
 Install new tee in tank
 + pipe from tank to D-Box
 Install new D-Box
 Connect old lines to D-Box
 * Contractor to meet on site
 prior to installing

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 12816. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent O. L. Baker

Name: O. L. Baker Telephone # 557-1234

Address: Rt 1 Box 205 Fugate Valley NC 27576

Property Location: SR # 1409 Road Name Oakridge Duncan

New Installation Repair Septic Tank Nitrification Lines

Subdivision _____ Lot # _____

Number of Bedrooms Proposed: 3 existing Lot size: 2.304 ac

Basement With Plumbing Without Plumbing

Water Supply: Well Public Minimum Well Setback: 50+ ft.

Type of System: Conventional Other

Tank Volume: Septic Tank existing gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 2 Length of lines 75

Width of ditches 3 ft. Depth of ditches 24-36 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: Thomas J. Boyce R.S. Date: 7-24-97