

## II IMPROVEMENT PERM

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Brent A. Dinger ☒ New Installation ☒ Septic Tank  
 Property Location: SR# 1139 Tingen Rd ☐ Repairs ☒ Nitrification Line

Subdivision Richard Allen Smith II Lot # N/A

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 Lot Size: 1.59 AC

Basement with Plumbing: ☐ Garage: ☐

Water Supply: ☐ Well ☒ Public ☐ Community

Distance From Well: 55 m. ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: ☒ Conventional ☐ Other \_\_\_\_\_

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons


Subsurface Drainage Field No. of ditches 3 exact length of each ditch 70 ft. width of ditches 3 ft. depth of 18 in. <sup>max</sup>

French Drain Required: \_\_\_\_\_ Linear feet

Date: 8-28-97

This permit is subject to revocation if site plans or intended use change.

Signed: Joe L. ARJ  
 Environmental Health Specialist

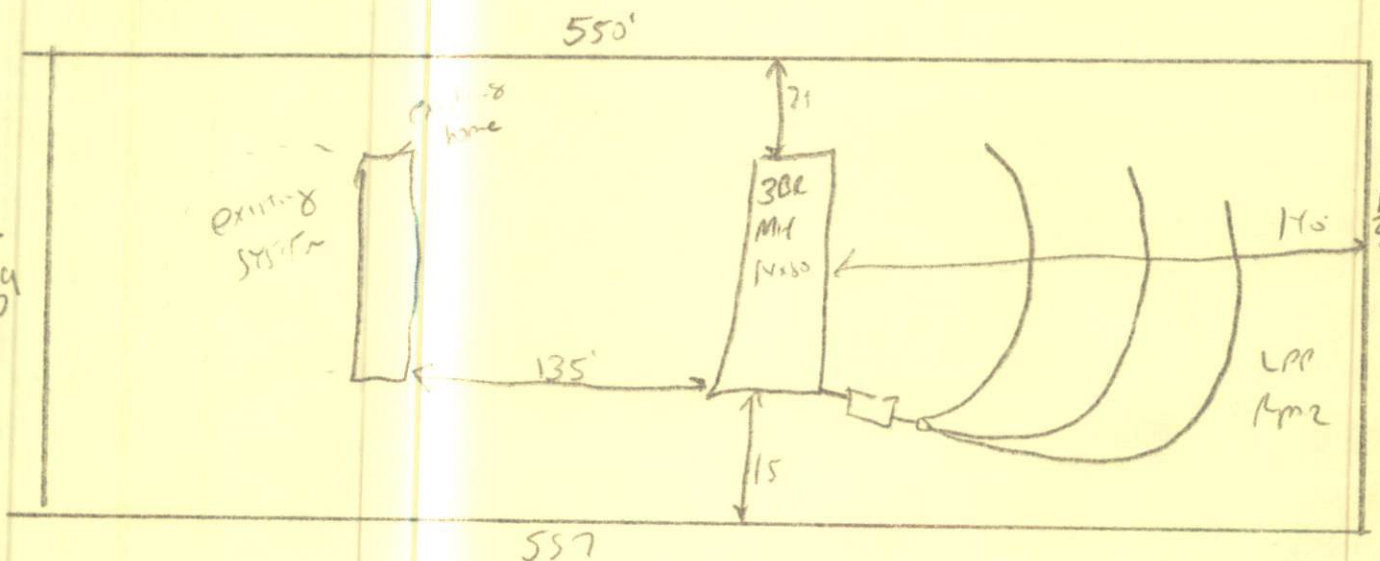

Stub Out Plumbing Shallow 18" max Ditch Depth  
 Follow Contours maintain all required set Backs

**HARNETT COUNTY HEALTH DEPARTMENT**  
**AUTI RIZATION TO CON RUCT**

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 12549. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Brent A Dinger

Name: \_\_\_\_\_ Telephone # \_\_\_\_\_

Address: \_\_\_\_\_

Property Location: SR # 1139 Road Name \_\_\_\_\_

New Installation ☒ Repair \_\_\_\_\_ Septic Tank ☒ Nitrification Lines ☒

Subdivision Richard Allen Smith II Lot # \_\_\_\_\_

Number of Bedrooms Proposed: 3 Lot size: 1.59 AC

Basement \_\_\_\_\_ With Plumbing \_\_\_\_\_ Without Plumbing \_\_\_\_\_

Water Supply: Well \_\_\_\_\_ Public ☒ Minimum Well Setback: 50 ft.

Type of System: Conventional ☒ Other \_\_\_\_\_

Tank Volume: Septic Tank 1000 gallons Pump Chamber \_\_\_\_\_ gallons

**Nitrification Field Specifications**

Number of fields 1 Number of Lines per Field 3 Length of lines 70

Width of ditches 3 ft. Depth of ditches 18<sup>min</sup> inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 8-28-97