

HTE# Repair

Harris County Department of Public Health

20915

PERMIT # 25823

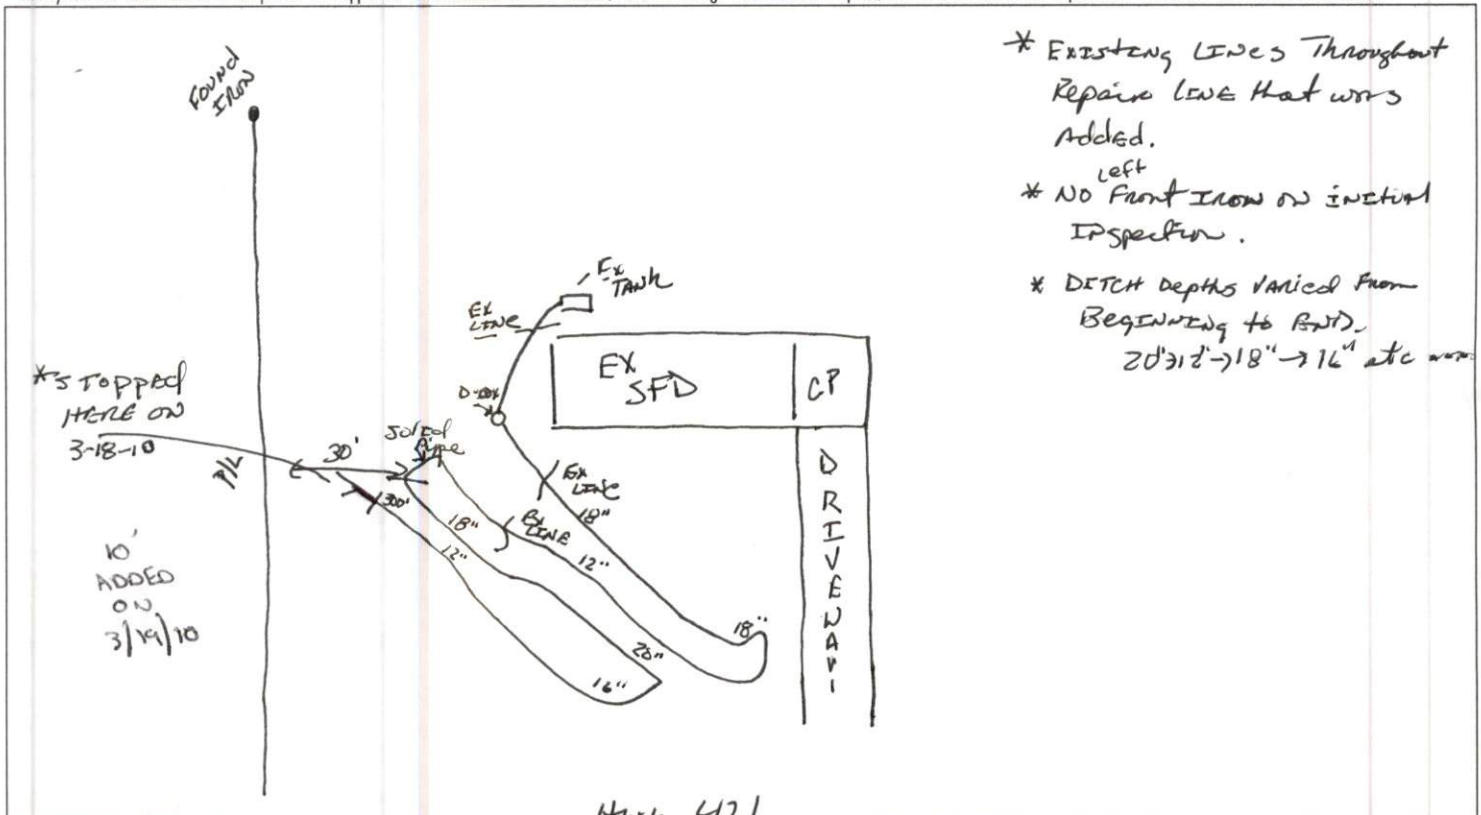
Operation Permit

☒ New Installation ☒ Septic Tank ☒ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: Hwy 4215 EwinName: (owner) STEVE Murphy SUBDIVISION _____ LOT # _____System Installer: Tommy Coley Registration # _____Basement with plumbing: ☐ Garage ☐ Number of Bedrooms 4Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: 25% REDUCTION System Type III G 6214g Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

* EXISTING LINES Throughout
Repair LINE that was
Added.* NO FRONT IRON ON INITIAL
INSPECTION.* DITCH DEPTHS VARIED FROM
BEGINNING TO END.
20' 31" → 18" → 16" etc.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes ☐ No ☐
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: WATER ENTERING DITCH AT 320'. NO FURTHER LINE ADDED.

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% REDUCTION Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 1 of each ditch 310 feet ditches 3 feet ditches 20 → 12 inches

French Drain Required: _____ Linear feet

Authorized State Agent _____

REMS

Date 3/19/10