

HTE# Repair

Harnett County Department of Public Health

21275

PERMIT # 25821


## Operation Permit

☐ New Installation ☒ Septic Tank ☒ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: Harnett Central Rd.Name: (owner) Charles Lane SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_System Installer: Jay Adcock Registration # \_\_\_\_\_Basement with plumbing: ☐ Garage ☐ Number of Bedrooms 3Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well \_\_\_\_\_ feetSystem Type: III b Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

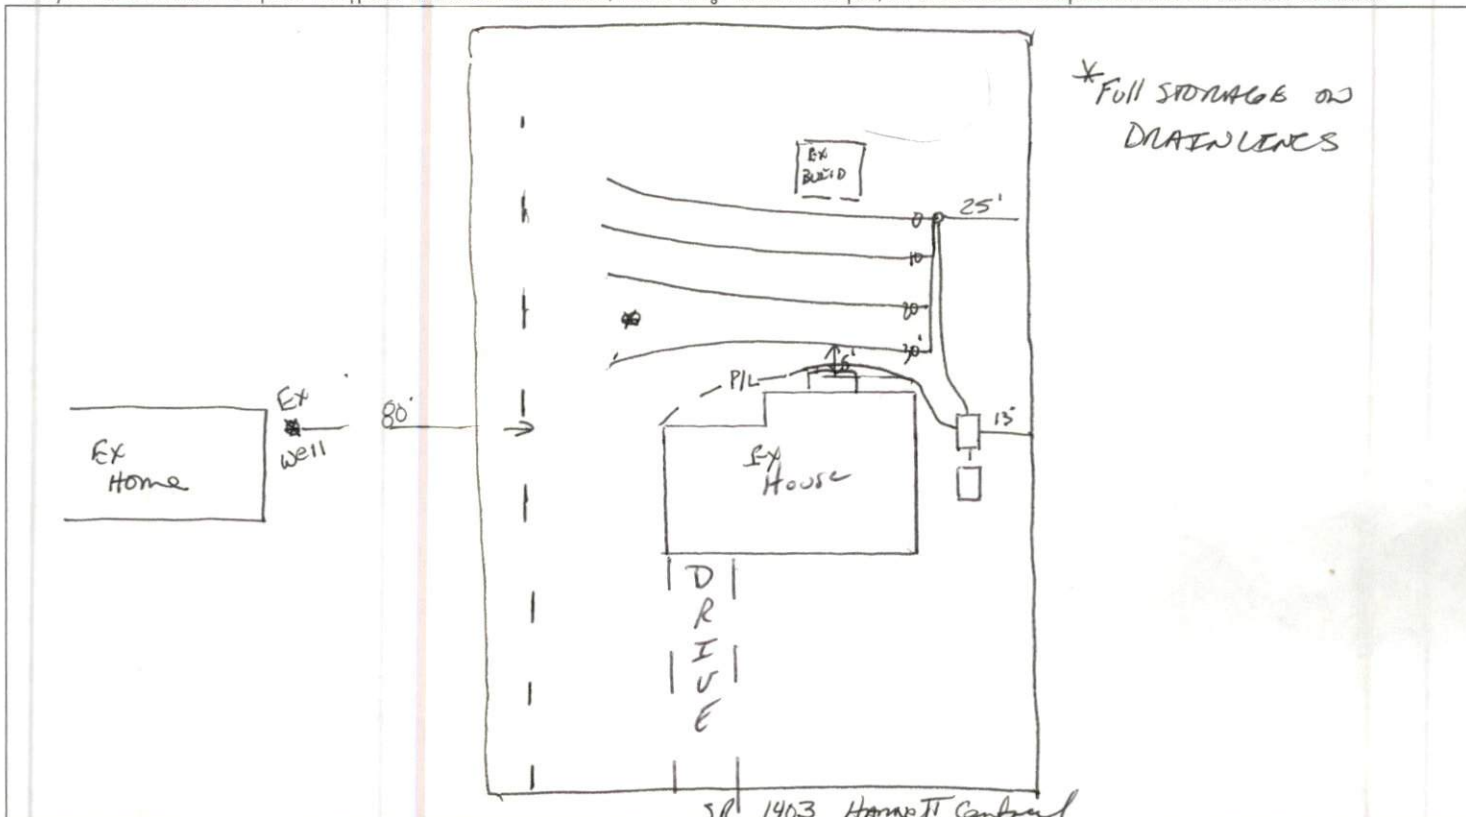

## PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: BMWell Abandoned on 2/18/2010 Tanks OK 2/22/2010

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☐ Other PL Pump to 25% REDUCTION TYPE III G Septic Tank: 1000 gallons Pump Tank: 1000 gallonsSubsurface No. of exact length width of depth of  
Drainage Field ditches 4 of each ditch 75 feet ditches 3 feet ditches 25-18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent

Jane E. MarstonDate 3-1-10