

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Rodney & Candace Lewis ☒ New Installation ☒ Septic Tank
Property Location: SR# 1001 Claude White ☐ Repairs ☒ Nitrification Line
SR 1001 Turen (B) onto Walter Waddell Rd (D) onto Wild Plum
Subdivision _____ Lot # _____

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 Lot Size: 1.00 AC

Basement with Plumbing: ☐ Garage: ☐

Water Supply: ☒ Well ☐ Public ☐ Community

Distance From Well: 100' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: ☒ Conventional ☐ Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 200 ft. width of ditches 3 ft. depth of ditches 18-24 in.

French Drain Required: _____ Linear feet

This permit is subject to revocation if site plans or intended use change.


Date: 7-15-98

Signed: Joe L. Smith

Environmental Health Specialist

30' Easement

285'

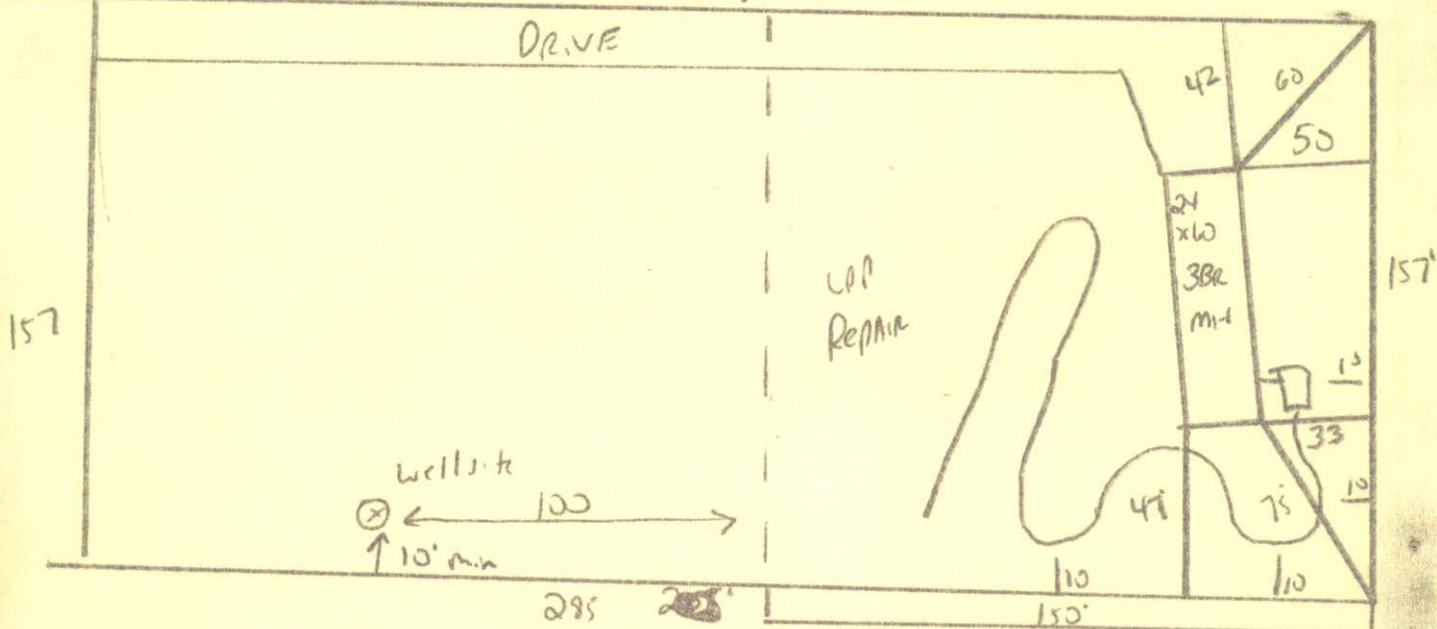

Do not Drive or Park on any Part of Septic System
Follow contours Maintain all Required Setbacks
Keep well 100' from septic system

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 14527. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Rodney J. McClure Lewis

Name: _____ Telephone # _____

Address: _____

Property Location: SR # 1001 Road Name _____

New Installation ☒ Repair _____ Septic Tank ☒ Nitrification Lines ☒

Subdivision _____ Lot # _____

Number of Bedrooms Proposed: 3 Lot size: 1.25 AC

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well ☒ Public _____ Minimum Well Setback: 100 ft.

Type of System: Conventional ☒ Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 1 Length of lines 200

Width of ditches 3 ft. Depth of ditches 18-24 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 7-15-98