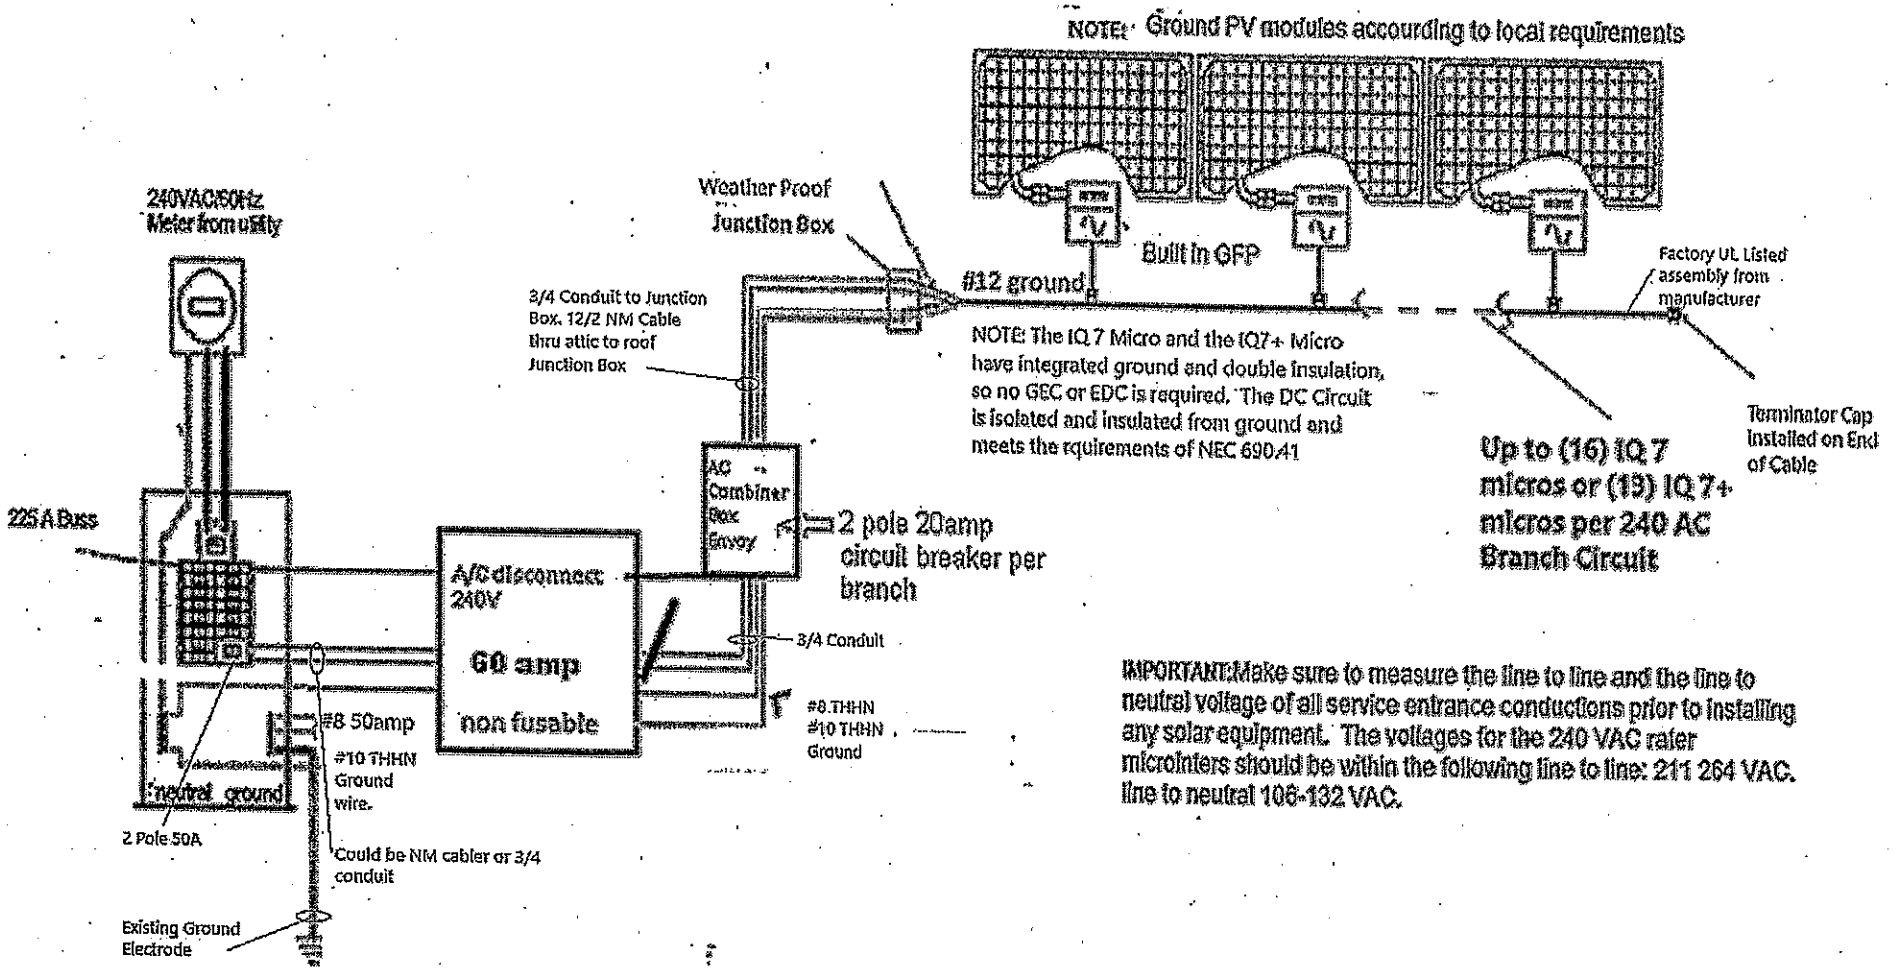

IMPORTANT: Make sure to measure the line to line and the line to neutral voltage of all service entrance conductions prior to installing any solar equipment. The voltages for the 240 VAC rater microinters should be within the following line to line: 211 264 VAC. line to neutral 106-132 VAC.

FIELD WIRING DIAGRAM
240VAC SINGLE PHASE

NAME: Barbara Castaneda
ADDRESS: 284 Perry Rd. Sanford NC 27332

MODEL: (10) enphase energy 0.3 kw (Model IQ7plus-72-x-US (240v) 295w)
PANEL: (10) Solaria 360w (Model Solaria Power XT-360R-AD)