## **GENERAL NOTES**

#### **CODES AND STANDARDS**

- 1. ALL WORK SHALL COMPLY WITH 2017 NATIONAL ELECTRIC CODE (NEC), 2018 NORTH CAROLINA BUILDING CODE (NCBC), 2015 INTERNATIONAL PLUMBING CODE, AND ALL STATE AND LOCAL BUILDING, ELECTRICAL, AND PLUMBING CODES.
- 2. DRAWINGS HAVE BEEN DETAILED ACCORDING TO UL LISTING REQUIREMENTS.

#### SITE NOTES / OSHA REGULATION

- 1. A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- 2. THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS AN UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- 3. THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- 4. ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SHALL SERVE TO PROTECT THE BUILDING OR STRUCTURE.

#### SOLAR CONTRACTOR

- 1. MODULE CERTIFICATIONS WILL INCLUDE UL1703, IEC61646, IEC61730.
- 2. IF APPLICABLE, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE MARKED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS.
- 3. AS INDICATED BY DESIGN, OTHER NRTL LISTED MODULE GROUNDING DEVICES MAY BE USED IN PLACE OF STANDARD GROUNDING LUGS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ.
- 4. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.
- 5. CONDUIT POINT OF PENETRATION FROM EXTERIOR TO INTERIOR TO BE INSTALLED AND SEALED WITH A SUITABLE SEALING COMPOUND.
- 6. DC WIRING LIMITED TO MODULE FOOTPRINT W/ ENPHASE AC SYSTEM.
- 7. ENPHASE WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY W/ SUITABLE WIRING CLIPS.
- 8. MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC UNLESS NOT AVAILABLE.
- 9. ALL INVERTERS, MOTOR GENERATORS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AC PHOTOVOLTAIC MODULES, DC COMBINERS, DC-TO-DC CONVERTERS, SOURCE CIRCUIT COMBINERS, AND CHARGE CONTROLLERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (B).
- 10. ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE.
- 11. TERMINALS AND LUGS WILL BE TIGHTENED TO MANUFACTURER TORQUE SPECIFICATIONS (WHEN PROVIDED) IN ACCORDANCE WITH NEC CODE 110.14(D) ON ALL ELECTRICAL CONNECTIONS.

#### **EQUIPMENT LOCATIONS**

- 1. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION [NEC 110.26].
- 2. EQUIPMENT INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY [NEC 690.31 (A)-(B)] AND [NEC TABLE 310.15 (B)].
- 3. ADDITIONAL AC DISCONNECTS SHALL BE PROVIDED WHERE THE INVERTER IS NOT ADJACENT TO THE UTILITY AC DISCONNECT, OR NOT WITHIN SIGHT OF THE UTILITY AC DISCONNECT.
- 4. ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES.
- 5. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

#### AERIAL VIEW



DESIGN CRITERIA

WIND SPEED: 115 MPH GROUND SNOW LOAD: 15 PSF WIND EXPOSURE FACTOR: C SEISMIC DESIGN CATEGORY: B SITE SPECIFICATIONS
OCCUPANCY - R3
CONSTRUCTION - V-B
ZONING: RESIDENTIAL

#### SCOPE OF WORK

INSTALLATION OF UTILITY INTERACTIVE PHOTOVOLTAIC SOLAR SYSTEM

12.80 kW DC PHOTOVOLTAIC SOLAR ARRAY

ROOF TYPE: Comp Shingle MODULES: (40) Trina 320

INVERTER(S): Enphase IQ7 Microinverters,----

RACKING: Unirac SFM Infinity



## SHEET INDEX

PV1 - COVER SHEET

PV2 - PROPERTY PLAN

PV3 - SITE PLAN

PV4 - EQUIPMENT & ATTACHMENT DETAIL

PV5 - ELECTRICAL SINGLE LINE DIAGRAM

PV6 - ELECTRICAL CALCULATIONS & ELECTRICAL NOTES

PV7 - MAIN BREAKER DERATE CALCS. (IF NEEDED)

**PV8 - LABELS & LOCATIONS** 

PV9 - CUSTOM DIRECTORY PLACARD (IF NEEDED - NEC 690.56(B))



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700

DC

SIZE:

STEM

S

DC

Travis Everette 1118 Oak Grove Church Road Angier, North Carolina 27501

DRAWING BY

SITE INFORMATION:

Eric Thomas

DATE

May 14, 2020

PROJECT NUMBER


72184329

SHEET NAME

COVER SHEET

PAGE NUMBER

Α

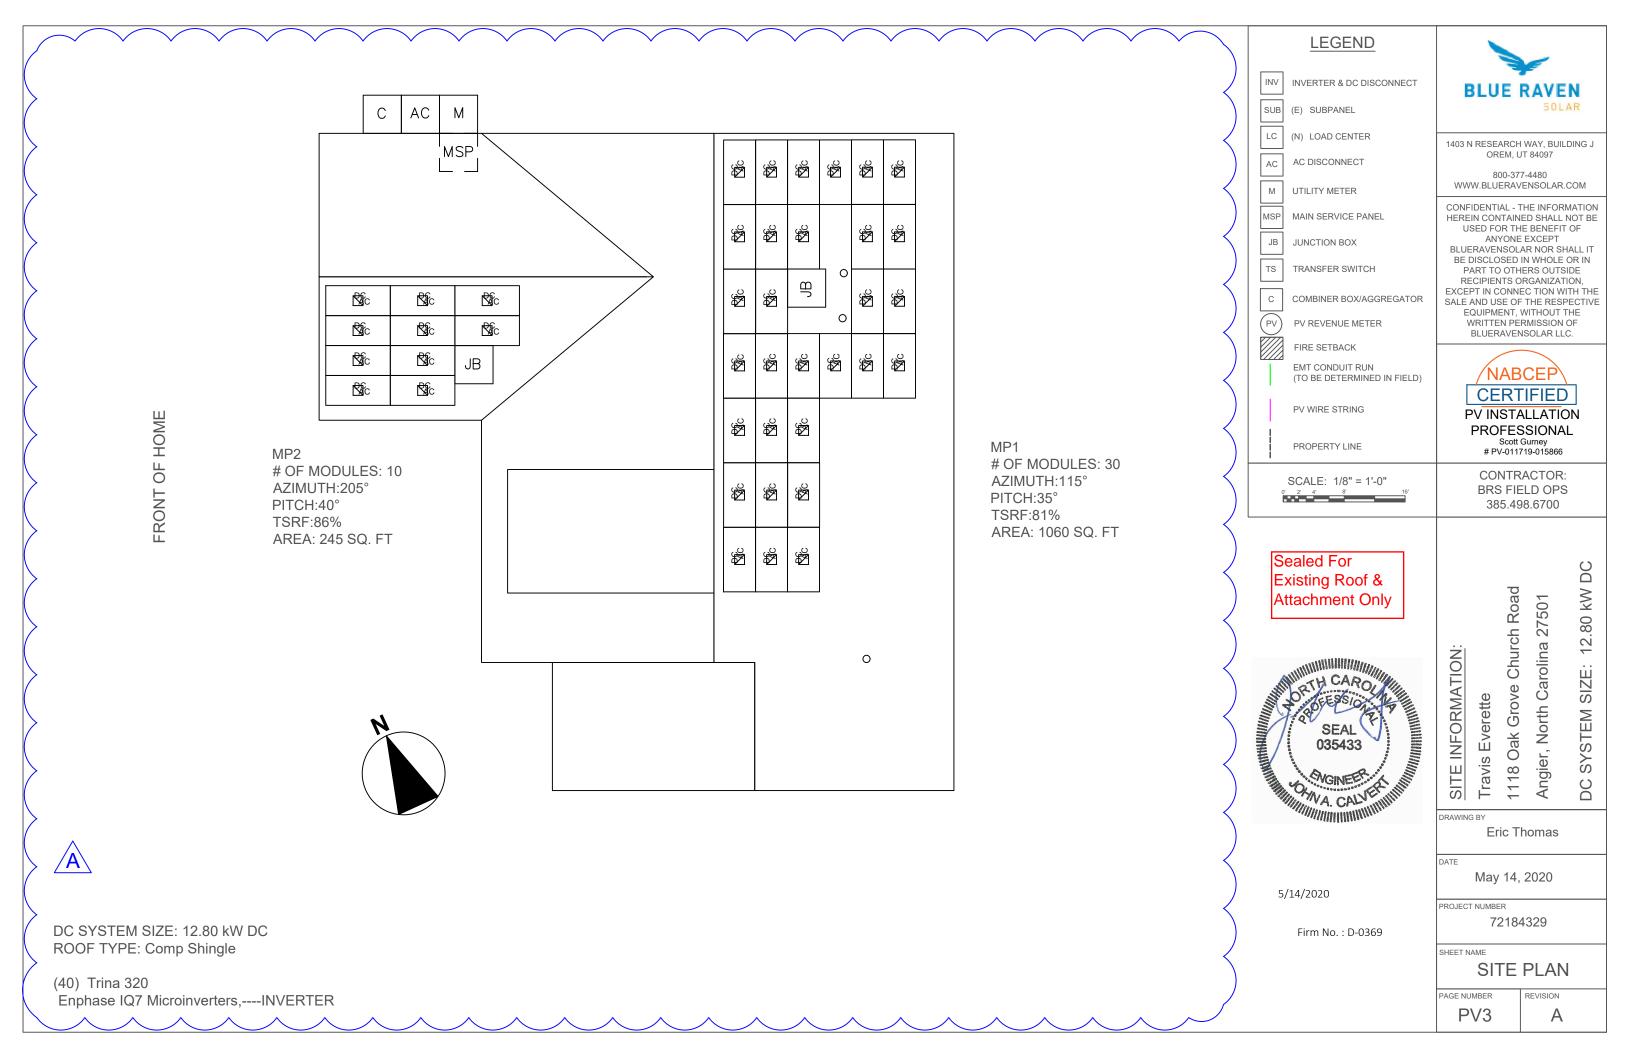

## PV ARRAY INFORMATION

PV MODULE COUNT: 40 MODULES

# OF ATTACHMENT POINTS: 66


ARRAY AREA: Module Count x 17.51ft<sup>2</sup> = 700.4ft<sup>2</sup>


ROOF AREA: 2415.0ft<sup>2</sup> % OF ARRAY/ROOF: 29.0%

ARRAY WEIGHT: Module Count x 50lbs = 2000.0lbs

DISTRIBUTED LOAD: Array Weight ÷ Array Area = 2.86 lbs/ft²

POINT LOAD: Array Weight ÷ Attachments = 30.3lbs/attachment

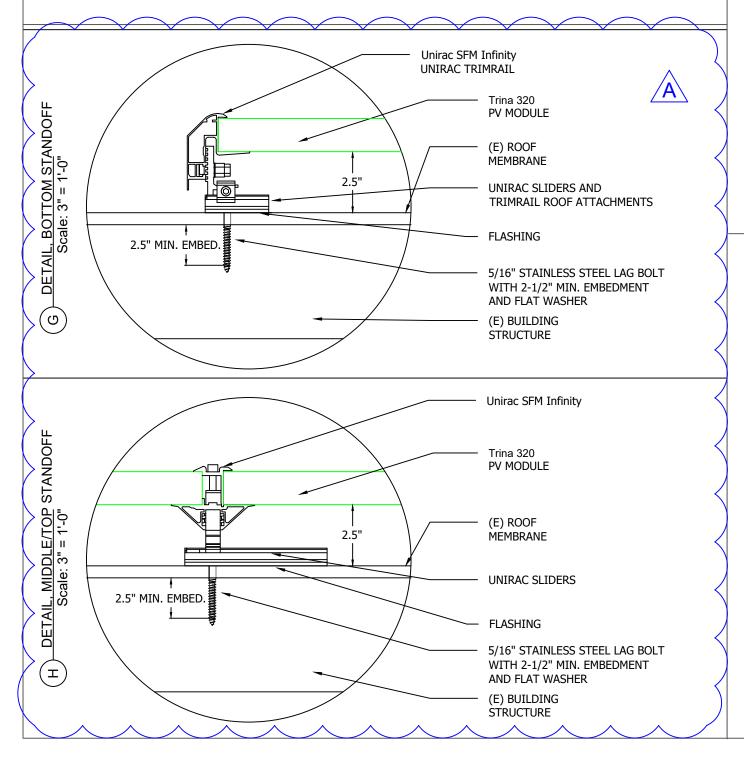

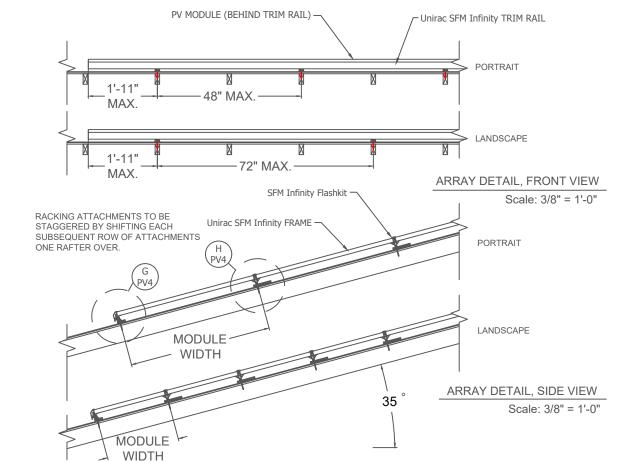

ROOF TYPE: Comp Shingle

ROOF FRAMING TYPE: Manufactured Truss

RAFTER OR TOP CHORD(TRUSS) 2x6 @ 24"O.C. CEILING JOIST OR BOTTOM CHORD(TRUSS) 2x4 @ 24"O.C.

Sealed For Existing Roof & Attachment Only



5/14/2020

Firm No.: D-0369



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700

DC

.80 kW

12.

SIZE:

SYSTEM

DC

Travis Everette 1118 Oak Grove Church Road Angier, North Carolina 27501

DRAWING BY

Eric Thomas

DATE

SITE INFORMATION:

May 14, 2020

PROJECT NUMBER

72184329

SHEET NAME

EQUIP. DETAIL

PAGE NUMBER

	(1) 6 AWG THHN/THWN-2, CU., BLACK (L1)	40.0 A AC	(3)	10 AWG THHN/THWN-2, CU., BLACK (L1)	MAX 15.0 A AC		(1) 10 - 2 UF-B (or NM) W/G, THHN/THWN-2, SC	MAX 15.0 A AC	(1) 12-2 TC-ER,THHN/THWN-2, CU.	MAX 15.0 A AC	$\overline{}$
15	(1) 6 AWG THHN/THWN-2, CU., RED (L2)	240 V AC	2 (3)	10 AWG THHN/THWN-2, CU., RED (L2)	240 V AC	2		240 V AC	(1) 6 AWG BARE, CU (EGC)	240 V AC	1
13	(1) 10 AWG THHN/THWN-2, CU., WHITE (N)		<b>5</b> (1)	10 AWG THHN/THWN-2, CU., GREEN (EGC)		_			1		
	(1) 10 AWG THHN/THWN-2, CU., GREEN (EGC)										
	(1) 3/4 INCH EMT	EXTERIOR	(1)	3/4 INCH EMT	EXTERIOR		_	INTERIOR		EXTERIOR	
	(1) 6 AWG THHN/THWN-2, CU., BLACK (L1)	40.0 A AC									í
16	(1) 6 AWG THHN/THWN-2, CU., RED (L2)	240 V AC									í
16	(1) 10 AWG THHN/THWN-2, CU., WHITE (N)										<u> </u>
	(1) 10 AWG THHN/THWN-2, CU., GREEN (EGC)										140

1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



Scott Gurney # PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 385.498.6700

DC

.80 kW

12.

SIZE

SYSTEM

DC

Church Road Carolina 27501 Grove Travis Everette Angier, North Oak 1118

DRAWING BY

SITE INFORMATION:

Eric Thomas

DATE

May 14, 2020

PROJECT NUMBER

SHEET NAME

72184329

ELEC. 3 LINE DIAG

PAGE NUMBER PV5

Α

/**A**\ 40 INVERTERS x 240 W AC = 9.60 kW AC (40) Trina 320 PANEL WATTAGE = 320 W DC UL 1703 COMPLIANT (40) Enphase IQ7 Microinverters MICRO INVERTERS UL 1741 COMPLIANT 10 MODULES MAX FOR ALL SUB-BRANCH JUNCTION BOX Enphase IQ Combiner 3 CIRCUIT(S) TO COMPLY WITH VRISE, CALCS (OPTIONAL IF UF-B X-IQ-AM1-240-3 CABLE USED FOR SUPPLY SIDE CONNECTION (SOLAR LOADS ONLY) JUNCTION BOX ENTIRE HOMERUN) PER NEC 230.46, NEC 230.79(D), (E)200A MAIN SERVICE PANEL NEC 705.12(A) (1) CIRCUIT (E)200A / 2P MAIN BREAKER (N)20A/2P OF 15 MODULES PV AC DISCONNECT FUSED, 100kAIC - R LOCKABLE, VISIBLE OPEN (E)200A / 2P SERVICE RATED 60A, 240V, 2-POLE JUNCTION BOX **FUSES** (1) CIRCUIT CLASS F (N)20A/2P OF 15 MODULES 120/240 VAC 60HZ 1 PHASE TO UTILITY JUNCTION BOX (1) CIRCUIT (N)20A/2P OF 10 MODULES GROUNDING

#### **INTERCONNECTION NOTES**

(1) 3/4 INCH EMT

1. SUPPLY SIDE INTERCONNECTION ACCORDING TO [NEC705.12(A)] WITH SERVICE ENTRANCE CONDUCTORS IN ACCORDANCE WITH [NEC 240.21(B)]

ELECTRODE (S)

EXTERIOR

#### **DISCONNECT NOTES**

1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS) 2. AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH





MODULE SPECIFICATIONS	Trinasolar 320 TSM-DD06M.05(II)
RATED POWER (STC)	320 W
MODULE VOC	40.3 V DC
MODULE VMP	33.4 V DC
MODULE IMP	9.58 A DC
MODULE ISC	10.2 A DC
VOC CORRECTION	-0.26 %/°C
VMP CORRECTION	-0.36 %/°C
SERIES FUSE RATING	20 A DC
ADJ. MODULE VOC @ ASHRAE LOW	TEMP 44.0 V DC
ADJ. MODULE VMP @ ASHRAE 2% AV	/G. HIGH TEMP 28.3 V DC

MICROINVERTER SPECIFICATIONS Enphase IQ7 Microinverters  POWER POINT TRACKING (MPPT) MIN/MAX 22 - 48 V DC  MAXIMUM INPUT VOLTAGE 48 V DC  MAXIMUM DC SHORT CIRCUIT CURRENT 15 A DC  MAXIMUM USABLE DC INPUT POWER 350 W  MAXIMUM OUTPUT CURRENT 1 A AC  AC OVERCURRENT PROTECTION 20 A
MAXIMUM INPUT VOLTAGE 48 V DC MAXIMUM DC SHORT CIRCUIT CURRENT 15 A DC MAXIMUM USABLE DC INPUT POWER 350 W MAXIMUM OUTPUT CURRENT 1 A AC
MAXIMUM DC SHORT CIRCUIT CURRENT 15 A DC MAXIMUM USABLE DC INPUT POWER 350 W MAXIMUM OUTPUT CURRENT 1 A AC
MAXIMUM USABLE DC INPUT POWER 350 W MAXIMUM OUTPUT CURRENT 1 A AC
MAXIMUM OUTPUT CURRENT 1 A AC
AC OVERCURRENT PROTECTION 20 A
MAXIMUM OUTPUT POWER 240 W
CEC WEIGHTED EFFICIENCY 97 %

AC PHOTOVOLATIC MODULE MARKING (N	NEC 690.52)
-----------------------------------	-------------

THE THE TOTAL CHIEF WIND BOLL IN MINING (MEE 050.52)	
NOMINAL OPERATING AC VOLTAGE	240 V AC
NOMINAL OPERATING AC FREQUENCY	47 - 68 HZ AC
MAXIMUM AC POWER	240 VA AC
MAXIMUM AC CURRENT	1.0 A AC
MAXIMUM OCPD RATING FOR AC MODULE	20 A AC

#### **DESIGN LOCATION AND TEMPERATURES** TEMPERATURE DATA SOURCE ASHRAE 2% AVG. HIGH TEMP STATE North Carolina CITY Angiei SEYMOUR-JOHNSON AFB WEATHER STATION ASHRAE EXTREME LOW TEMP (°C) -10

SYSTEM ELECTRICAL SPECIFICATIONS	CIR 1	CIR 2	CIR 3	CIR 4	CIR 5	CIR 6
NUMBER OF MODULES PER MPPT	15	15	10			
DC POWER RATING PER CIRCUIT (STC)	4800	4800	3200			
TOTAL MODULE NUMBER			40 MOD	ULES		
STC RATING OF ARRAY	12800W DC					
AC CURRENT @ MAX POWER POINT (IMP)	15.0	15.0	10.0			
MAX. CURRENT (IMP X 1.25)	18.75	18.75	12.5			
OCPD CURRENT RATING PER CIRCUIT	20	20	20			
MAX. COMB. ARRAY AC CURRENT (IMP)	40.0					
MAX. ARRAY AC POWER	9600W AC					

AC VOLTAGE RISE CALCULATIONS	DIST (FT)	COND.	/RISE(V)	VEND(V)	%VRISE	IQ7-10
VRISE SEC. 1 (MICRO TO JBOX)	36	12 Cu.	1.45	241.45	0.61%	
VRISE SEC. 2 (JBOX TO COMBINER BOX)	60	10 Cu.	2.29	242.29	0.95%	
VRISE SEC. 3 (COMBINER BOX TO POI)	10	6 Cu.	0.41	240.41	0.17%	
TOTAL VRISE			4.15	244.15	1.73%	

#### PHOTOVOLTAIC AC DISCONNECT OUTPUT LABEL (NEC 690.54)

ASHRAE 2% AVG. HIGH TEMP (°C)

AC OUTPUT CURRENT	40.0 A AC
NOMINAL AC VOLTAGE	240 V AC

#### CONDUCTOR SIZE CALCULATIONS

35

CONDUCTOR SIZE CAL	LCOLATIONS			
MICROINVERTER TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	15.0 A	A AC	
JUNCTION BOX (1)	MAX. CURRENT (ISC X1.25) =	18.8 A	A AC	
	CONDUCTOR (TC-ER, COPPER (90°C)) =	12 /	AWG	
	CONDUCTOR RATING =	30 A	A	
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	28.8	>	18.8
JUNCTION BOX TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	15.0 A	A AC	
JUNCTION BOX (2)	MAX. CURRENT (ISC X1.25) =	18.8 A	A AC	
	CONDUCTOR (UF-B, COPPER (60°C)) =	10 A	AWG	
	CONDUCTOR RATING =	30 A	Ą	
	CONDUIT FILL DERATE =	1		
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	28.8	>	18.8
JUNCTION BOX TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	15.0 A	A AC	
COMBINER BOX (3)	MAX. CURRENT (ISC X1.25) =	18.8 A	A AC	
	CONDUCTOR (UF-B, COPPER (60°C)) =	10 A	AWG	
	CONDUCTOR RATING =	30 A	Ą	
	CONDUIT FILL DERATE =	0.8		
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	23.04	>	18.8
COMBINER BOX TO	INVERTER RATED AMPS =	40.0 A	A AC	
MAIN PV OCPD (15)	MAX. CURRENT (RATED AMPS X1.25) =	50 A	A AC	
CONDU	JCTOR (THWN-2, COPPER (75°C TERM.)) =	6 /	٩WG	
	CONDUCTOR RATING =	65 A	A	
	CONDUIT FILL DERATE =	1		
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	62.4	>	50.0

#### **GROUNDING NOTES**

- 1. A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH [NEC 690-47] AND [NEC 250-50] THROUGH [NEC 250-60] SHALL BE PROVIDED. PER NEC, GROUNDING ELECTRODE SYSTEM OF EXISTING BUILDING MAY BE USED AND BONDED TO AT THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, OR IS ONLY METALLIC WATER PIPING, A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT GROUND ROD WITH ACORN CLAMP.
- 2. THE GROUNDING ELECTRODE CONDUCTOR SHALL BE PROTECTED FROM PHYSICAL DAMAGE BETWEEN THE GROUNDING ELECTRODE AND THE PANEL (OR INVERTER) IF SMALLER THAN #6 AWG COPPER WIRE PER NEC 250-64B. THE GROUNDING ELECTRODE CONDUCTOR WILL BE CONTINUOUS, EXCEPT FOR SPLICES OR JOINTS AT BUSBARS WITHIN LISTED EQUIPMENT PER [NEC 250.64C.].
- 3. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN #8 AWG AND NO GREATER THAN #6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM
- 4. PV SYSTEM SHALL BE GROUNDED IN ACCORDANCE TO [NEC 250.21], [NEC TABLE 250.122], AND ALL METAL PARTS OR MODULE FRAMES ACCORDING TO [NEC 690.461
- 5. MODULE SOURCE CIRCUITS SHALL BE GROUNDED IN ACCORDANCE TO [NEC 690.421
- 6. THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDED CONDUCTOR TO ANOTHER MODULE.
- 7. EACH MODULE WILL BE GROUNDED USING THE SUPPLIED CONNECTIONS POINTS IDENTIFIED IN THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 8. ENCLOSURES SHALL BE PROPERLY PREPARED WITH REMOVAL OF PAINT/FINISH AS APPROPRIATE WHEN GROUNDING EQUIPMENT WITH TERMINATION **GROUNDING LUGS**
- 9. GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVISES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR DIRECT BURIAL. 7. ALL CONDUCTORS AND OCPD SIZES AND TYPES SPECIFIED ACCORDING TO [NEC 10. GROUNDING AND BONDING CONDUCTORS SHALL BE COPPER, SOLID OR

STRANDED, AND BARE WHEN EXPOSED.

- 11. EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZE ACCORDING TO [NEC 690.45] AND BE A MINIMUM OF #10AWG WHEN NOT EXPOSED TO DAMAGE (#6AWG SHALL BE USED WHEN EXPOSED TO DAMAGE).
- 12. GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLOR CODED GREEN (OR MARKED GREEN IF #4 AWG OR LARGER)
- 13. ALL CONDUIT BETWEEN THE UTILITY AC DISCONNECT AND THE POINT OF CONNECTION SHALL HAVE GROUNDED BUSHINGS AT BOTH ENDS.
- 14. SYSTEM GEC SIZED ACCORDING TO [NEC 690.47], [NEC TABLE 250.66], DC SYSTEM GEC SIZED ACCORDING TO [NEC 250.166], MINIMUM #8AWG WHEN INSULATED, #6AWG WHEN EXPOSED TO DAMAGE.
- 15. EXPOSED NON-CURRENT CARRYING METAL PARTS OF MODULE FRAMES, EQUIPMENTS, AND CONDUCTOR ENCLOSURES SHALL BE GROUNDED IN ACCORDANCE WITH 250.134 OR 250.136(A) REGARDLESS OF VOLTAGE.

#### WIRING & CONDUIT NOTES

- 1. ALL CONDUIT SIZES AND TYPES, SHALL BE LISTED FOR ITS PURPOSE AND APPROVED FOR THE SITE APPLICATIONS
- 2. BOLTED CONNECTION REQUIRED IN DC DISCONNECTS ON THE WHITE GROUNDED CONDUCTOR (USE POLARIS BLOCK OR NEUTRAL BAR)
- 3. ANY CONNECTION ABOVE LIVE PARTS MUST BE WATERTIGHT. REDUCING WASHERS DISALLOWED ABOVE LIVE PARTS, MEYERS HUBS RECOMMENDED
- 4. UV RESISTANT CABLE TIES(NOT ZIP TIES) USED FOR PERMANENT WIRE MANAGEMENT OFF THE ROOF SURFACE IN ACCORDANCE WITH NEC 110.2,110.3(A-B). 300.4
- 5. SOLADECK JUNCTION BOXES MOUNTED FLUSH W/ROOF SURFACE TO BE USED FOR WIRE MANAGEMENT AND AS FLASHED ROOF PENETRATIONS FOR INTERIOR CONDUIT **RUNS**
- 6. ALL PV CABLES AND HOMERUN WIRES BE TYPE USE-2, AND SINGLE-CONDUCTOR CABLE LISTED AND IDENTIFIED AS PV WIRE, TYPE TC-ER, OR EQUIVALENT; ROUTED TO SOURCE CIRCUIT COMBINER BOXES AS REQUIRED

690.8] FOR MULTIPLE CONDUCTORS

- 8. ALL PV DC CONDUCTORS IN CONDUIT EXPOSED TO SUNLIGHT SHALL BE INSTALLED AT LEAST 7/8" ABOVE THE ROOF SURFACE AND DERATED ACCORDING TO [NEC TABLE 310.15 (B)(2)(a), NEC TABLE 310.15(B)(3)(a),& NEC 310.15(B)(3)(c)]
- 9. EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP EDGES
- 10. PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 600V
- 11. 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS.
- 12. ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION
- 13. VOLTAGE DROP LIMITED TO 2% FOR DC CIRCUITS AND 3% FOR AC CIRCUITS 14. NEGATIVE GROUNDED SYSTEMS DC CONDUCTORS SHALL BE COLOR CODED AS
- FOLLOWS: DC POSITIVE- RED (OR MARKED RED). DC NEGATIVE- GREY (OR MARKED GREY)
- 15. POSITIVE GROUNDED SYSTEMS DC CONDUCTORS COLOR CODED:
- DC POSITIVE- GREY (OR MARKED GREY), DC NEGATIVE- BLACK (OR MARKED BLACK) 16. AC CONDUCTORS >4AWG COLOR CODED OR MARKED:
- PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE, NEUTRAL-WHITE/GRAY
- \* USE-2 IS NOT INDOOR RATED BUT PV CABLE IS RATED THWN/THWN-2 AND MAY BE USED INSIDE
- \*\* USE-2 IS AVAILABLE AS UV WHITE
- 17. RIGID CONDUIT, IF INSTALLED, (AND/OR NIPPLES) MUST HAVE A PULL BUSHING TO PROTECT WIRES
- 18. IF CONDUIT DETERMINED TO BE RAN THROUGH ATTIC IN FIELD THEN CONDUIT WILL BE EITHER EMT, FMC, OR MC CABLE IF DC CURRENT COMPLYING WITH NEC 690.31, NEC 250.118(10). DISCONNECTING MEANS SHALL COMPLY WITH 690.13 AND 690.15 19. CONDUIT RAN THROUGH ATTIC WILL BE AT LEAST 18" BELOW ROOF SURFACE COMPLYING WITH NEC 230.6(4) AND SECURED NO GREATER THAN 6' APART PER NEC 330.30(B).



1403 N RESEARCH WAY, BUILDING J OREM. UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION. EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

> DC  $\stackrel{\mathsf{X}}{\geq}$ 501 80 27 7 rolina SIZE:

STEM

S

DC

Church Road Car Grove Everette North Oak Angier, Travis 2

DRAWING BY

**Eric Thomas** 

DATE

INFORMATION

Ш

 $\overline{S}$ 

May 14, 2020

PROJECT NUMBER

72184329

ELEC. CALCS.

PAGE NUMBER PV6

Α

## **MWARNING**

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED PUBLICUM IN THE OPEN POSITION STATES

**DIRECT CURRENT** 

MAXIMUM VOLTAGE

MAX CIRCUIT CURRENT

FOR PV DISCONNECTING MEANS WHERE ALL TERMINALS OF THE DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION. [NEC 690.13(B), NEC 705.22]

DC DISCONNECT AT THE INVERTER. PHOTOVOLTAIC POWER SOURCE [NEC 690.53, NEC 690.13(B)]

AT EACH DC DISCONNECTING MEANS, INCLUDING THE

## PHOTOVOLTAIC SYSTEM

VDC

**AMPS** 

RATED AC OUTPUT CURRENT NOMINAL OPERATING AC VOLTAGE

AC DISCONNECT

AT POINT OF INTERCONNECTION, MARKED AT AC DISCONNECTING MEANS [NEC 690.54, NEC 690.13 (B)]

**↑ WARNING DUAL POWER SUPPLY** 

SOURCES: UTILITY GRID AND PV SOLAR ELECTRIC SYSTEM

IF INTERCONNECTING ON THE LOAD SIDE, INSTALL THIS LABEL ANYWHERE THAT IS POWERED BY BOTH THE PANEL AND SUB-PANELS.

PLACED ADJACENT TO THE BACK-FED BREAKER

SIDE CONNECTION TO BUSBAR.

[NEC 705.12(B)(2)(3)(b)]

FROM THE INVERTER IF TIE IN CONSISTS OF LOAD

UTILITY AND THE SOLAR PV SYSTEM: THE MAIN SERVICE [NEC 705.12(B)(3)]

INVERTER OUTPUT CONNECTION

**∴WARNING** 

DO NOT RELOCATE THIS OVERCURRENT DEVICE

A BUSBAR)

SIGN LOCATED AT LOAD CENTER IF IT CONTAINS 3 OR MORE POWER SOURCES. [NEC 705.12(B)(2)(3)(C)]

# **AWARNING**

THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.

(ONLY IF 3 OR MORE SUPPLY SOURCES TO

- LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS. ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER CURRENT NEC AND LOCAL CODES AND MAKE APPROPRIATE ADJUSTMENTS
- LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRIC CODE, OSHA STANDARD 19010 145 ANSI 7535
- MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
- LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED AND SHALL NOT BE HANDWRITTEN [NEC 110.21]
- LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]

## WARNING: PHOTOVOLTAIC **POWER SOURCE**

AT DIRECT-CURRENT EXPOSED RACEWAYS, CABLE TRAYS, COVERS AND ENCLOSURES OF JUNCTION BOXES, AND OTHER WIRING METHODS; SPACED AT MAXIMUM 10FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS OR FLOORS [NEC 690.31(G)(3&4)]

#### SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

SOLAR PV SYSTEM EQUIPPED

WITH RAPID SHUTDOWN

RAPID SHUTDOWN

SWITCH FOR

SOLAR PV SYSTEM

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM SHOCK HAZARD IN THE ARRAY

TURN RAPID SHUTDOWN SWITCH

TO THE "OFF" POSITION
TO SHUT DOWN CONDUCTORS

OUTSIDE THE ARRAY

THE ARRAY REMAIN

ENERGIZED IN SUNLIGHT



[NEC 690.56(C)(1)(A)]

FOR PV SYSTEMS THAT ONLY SHUT DOWN CONDUCTORS LEAVING THE ARRAY: SIGN TO BE LOCATED ON OR NO MORE THAN 3 FT AWAY FROM SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION. [NEC 690.56(C)(1)(B)]

**EXISTING SUB PANEL** 

(IF WHERE POINT OF

INTERCONNECTION

(3)&(4)

BREAKER USED

(ONLY IF PV

ITERCONNECTIO

ONSISTS OF LOAD

SIDE BREAKER)

**EXISTING SUB PANEL** 

(IF WHERE POINT OF

INTERCONNECTION

(1)

IS MADE)

IS MADE)

FOR PV SYSTEMS THAT SHUT DOWN THE ARRAY

SIGN TO BE LOCATED ON OR NO MORE THAN 3

LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN

AND CONDUCTORS LEAVING THE ARRAY

FT AWAY FROM SERVICE DISCONNECTING

SWITCHES IF NOT AT THE SAME LOCATION.

MEANS TO WHICH THE PV SYSTEMS ARE

CONNECTED AND SHALL INDICATE THE

(8)

(3)&(4)

(11) OR (13)

OR PLACARD

(5)

(ONLY IF PV

NTERCONNECTIO

CONSISTS OF LOAD

SIDE BREAKER)

(1)

(3) & (4)

BREAKER USED

(8) OR(9)

LABELING DIAGRAM FOR STRING INV. / DC OPTIMIZER INV.:

BREAKER USED

LABELING DIAGRAM FOR MICRO INV.

MAIN SERVICE PANEL

MAIN SERVICE PANEL

000

\_ \_ \_ \_

SIGN LOCATED AT RAPID SHUT DOWN DISCONNECT SWITCH [NEC 690.56(C)(3)].

## **⚠ WARNING**

MAIN DISTRIBUTION UTILITY DISCONNECT(S) POWER TO THIS BUILDING IS ALSO SUPPLIED FROM A ROOF MOUNTED SOLAR ARRAY WITH A RAPID SHUTDOWN DISCONNECTING MEANS GROUPED AND LABELED WITHIN LINE OF SITE AND 10 FT OF THIS LOCATION.

## **↑ WARNING**

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM MAIN DISTRIBUTION UTILITY DISCONNECT LOCATED

## **↑ WARNING**

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM ROOF MOUNTED SOLAR ARRAY, SOLAR ARRAY RAPID SHUTDOWN DISCONNECT IS LOCATED OUTSIDE NEXT TO UTILITY METER.

PV COMBINER

IF USED TO COMBINE

PV OUTPUT CIRCUITS

(3)

(6)

(11)

PV COMBINER

IF USED TO COMBINE

PV OUTPUT CIRCUITS

SUBPANEL -

SURPANEL -

AC DISCONNECT

(12) OR

PLACARD

AC DISCONNECT

(3)

(3)

(10)

PERMANENT DIRECTORY TO BE LOCATED AT MAIN SERVICE EQUIPMENT LOCATION IF ALL ELECTRICAL POWER SOURCE DISCONNECTING MEANS (SOLAR ARRAY RAPID SHUTDOWN SWITCH) ARE GROUPED AND IN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 690.56(C) & NEC 705.10].

SOLAR ARRAY RAPID SHUTDOWN SWITCH DENOTING THE LOCATION OF THE SERVICE EQUIPMENT LOCATION IF SOLAR ARRAY RAPID SHUT DOWN DISCONNECT SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 705.10]

AC JUNCTION BOX

OR AC COMBINER BOX

INVERTER (S)

SERVICE EQUIPMENT DENOTING THE LOCATION OF THE PV RAPID SHUTDOWN SYSTEM DISCONNECTING MEANS IF SOLAR ARRAY RAPID SHUT DOWN DISCONNECT SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS, INEC 705.10. NEC 690.56(C)(1)]

PERMANENT DIRECTORY TO BE LOCATED AT

#### LABEL 13

PERMANENT DIRECTORY TO BE LOCATED AT MAIN

OREM, UT 84097 800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION. EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT. WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.

1403 N RESEARCH WAY, BUILDING J



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

DC

.80 kW

12.

SIZE:

SYSTEM

DC

Church Road 27501 Carolina Grove North Oak Angier, 1118

## DRAWING BY

INFORMATION:

Ш

SIT

Travis Everette

**Eric Thomas** 

DATE

May 14, 2020

PROJECT NUMBER

72184329

SHEET NAME

LABELS

REVISION

Α

PAGE NUMBER PV8

#### (3) (3)&(4)(11) or (13) IF BREAKER USED (12) OR JUNCTION BOX OR PLACARD OR COMBINER BOX (4) PLACARD (5)(ONLY IF PV 6 (ONLY IF PV (10) NTÈRCONNECTION NTÈRCONNECTION CONSISTS OF LOAD (11)CONSISTS OF LOAD (2)SIDE BREAKER) SIDE BREAKER) INTEGRATED DC DISCONNECT

\*ELECTRICAL DIAGRAM SHOWN ABOVE IS FOR LABELING PURPOSES ONLY. NOT AN ACTUAL REPRESENATION OF EQUIPMENT AND CONNECTIONS TO BE INSTALLED. LABEL LOCATIONS PRESENTED MAY VERY DEPENDING ON TYPE OF INTERCONNECTION METHOD AND LOCATION PRESENTED ON PV5 OF 3 LINE DIAGRAM. PV5 LINE DIAGRAM TO REFLECT ACTUAL REPRESENTATION OF PROPOSED SCOPE OF WORK.

Data Sheet Enphase Microinverters Region: AMERICAS

# **Enphase** IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready Enphase IQ 7 Micro™ and Enphase IQ 7+ Micro™ dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate with the Enphase IQ Envoy™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.



## Easy to Install

- · Lightweight and simple
- · Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

#### Productive and Reliable

- · Optimized for high powered 60-cell and 72-cell\* modules
- · More than a million hours of testing
- · Class II double-insulated enclosure
- UL listed

#### Smart Grid Ready

- · Complies with advanced grid support, voltage and frequency ride-through requirements
- · Remotely updates to respond to changing grid requirements
- · Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)
- \* The IQ 7+ Micro is required to support 72-cell modules.





## Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US /	IQ7-60-B-US	IQ7PLUS-72-2	-US / IQ7PLUS-72-B-US			
Commonly used module pairings <sup>1</sup>	235 W - 350 W -	+	235 W - 440 W -	235 W - 440 W +			
Module compatibility	60-cell PV mod	ules only	60-cell and 72-c	cell PV modules			
Maximum input DC voltage	48 V		60 V				
Peak power tracking voltage	27 V - 37 V		<mark>27 V</mark> - 45 V				
Operating range	16 V - 48 V		16 V - 60 V				
Min/Max start voltage	22 V / 48 V		22 V / 60 V				
Max DC short circuit current (module Isc)	15 A		15 A				
Overvoltage class DC port	II		H				
DC port backfeed current	0 A		0 A				
PV array configuration		ed array; No additio ion requires max 20					
OUTPUT DATA (AC)	IQ 7 Microinve	erter	IQ 7+ Microin	verter			
Peak output power	250 VA		295 VA				
Maximum continuous output power	240 VA		2 <mark>90 V</mark> A				
Nominal (L-L) voltage/range²	240 V / 211-264 V	208 V / 183-229 V	2 <mark>40 V</mark> / 2 <mark>11-2</mark> 64 V	208 V / 183-229 V			
Maximum continuous output current	1.0 A (240 V)	1.15 A (208 V)	1.21 A (240 V)	1.39 A (208 V)			
Nominal frequency	60 Hz	, ,	60 Hz	35. Z			
Extended frequency range	47 - 68 Hz		4 <mark>7 - 6</mark> 8 Hz				
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms				
Maximum units per 20 A (L-L) branch circuit <sup>3</sup>		13 (208 VAC)	1 <mark>3 (24</mark> 0 VAC)	11 (208 VAC)			
Overvoltage class AC port	III	, , , , , , , , , , , , , , , , , , , ,	111	, and the second			
AC port backfeed current	0 A		0 A				
Power factor setting	1.0		1.0				
Power factor (adjustable)	0.7 leading 0.	7 lagging	0 <mark>.7 le</mark> ading 0.	7 lagging			
EFFICIENCY	@240 V	@208 V	@240 V	@208 V			
Peak CEC efficiency	97.6 %	97.6 %	97.5 %	97.3 %			
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %			
MECHANICAL DATA							
Ambient temperature range	-40°C to +65°C						
Relative humidity range	4% to 100% (coi						
Connector type (IQ7-60-2-US & IQ7PLUS-72-2-L	Commission National St. Commission		Iditional O-DCC-5	adapter)			
Connector type (IQ7-60-B-US & IQ7PLUS-72-B-U	JS) Friends PV2 (M Adaptors for me - PV2 to MC4: o						
Dimensions (WxHxD)	212 mm x 175 n	nm x 30.2 mm (with	out bracket)				
Weight	1.08 kg (2.38 lb						
Cooling	Natural convect						
Approved for wet locations	Yes						
Pollution degree	PD3						
Enclosure		insulated, corrosio	n resistant nolvme	ric enclosure			
Environmental category / UV exposure rating			Joiotain poijine				
FEATURES	inclina type of						
Communication	Power Line Con	nmunication (PLC)					
Monitoring		ger and MyEnlighte	n monitoring optic	ons			
Disconnecting means	Both options re	quire installation of	an Enphase IQ En	voy.			
	disconnect requ	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.					
Compliance	UL 62109-1, UL1 CAN/CSA-C22. This product is NEC-2017 secti	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.					

- 1. No enforced DC/AC ratio. See the compatibility calculator at <a href="https://enphase.com/en-us/support/module-compatibility">https://enphase.com/en-us/support/module-compatibility</a>. Nominal voltage range can be extended beyond nominal if required by the utility.
- 3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

#### To learn more about Enphase offerings, visit enphase.com

© 2018 Enphase Energy, All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc.





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

SPEC SHEET


PAGE NUMBER SS

Data Sheet **Enphase Networking** 

# **Enphase IQ Combiner 3**

(X-IQ-AM1-240-3)

The Enphase IQ Combiner 3™ with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.



#### Smart

- · Includes IQ Envoy for communication and control
- · Flexible networking supports Wi-Fi, Ethernet, or cellular
- · Optional AC receptacle available for PLC
- · Provides production metering and optional consumption monitoring

#### Simple

- Reduced size from previous combiner
- · Centered mounting brackets support single stud mounting
- · Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

#### Reliable

- · Durable NRTL-certified NEMA type 3R enclosure
- · Five-year warranty
- UL listed



## **Enphase IQ Combiner 3**

MODEL NUMBER	
IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy* printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
ACCESSORIES and REPLACEMENT PARTS (no	ot included, order separately)
Enphase Mobile Connect™ CELLMODEM-03 (4G / 12-year data plan) CELLMODEM-01 (3G / 5-year data plan) CELLMODEM-M1 (4G based LTE-M / 5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity 2
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy
MECHANICAL DATA	
Dimensions (WxHxD)	$49.5 \times 37.5 \times 16.8 \text{ cm} (19.5" \times 14.75" \times 6.63")$ . Height is $21.06" (53.5 \text{ cm} \text{ with mounting brackets})$
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	<ul> <li>20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors</li> <li>60 A breaker branch input: 4 to 1/0 AWG copper conductors</li> <li>Main lug combined output: 10 to 2/0 AWG copper conductors</li> <li>Neutral and ground: 14 to 1/0 copper conductors</li> <li>Always follow local code requirements for conductor sizing.</li> </ul>
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M) (not included)
COMPLIANCE	
Compliance, Combiner	UL 1741 CAN/CSA C22.2 No. 107.1 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1
A 1 15 15	a a second and a second a second and a second a second and a second a second and a second a second and a second a second and a second a second and a second and a second a second a second a second a second and a second and a se

<sup>\*</sup> Consumption monitoring is required for Enphase Storage Systems.

#### To learn more about Enphase offerings, visit enphase.com

© 2018 Enphase Energy. All rights reserved. All trademarks or brands in this document are registered by their respective owner. 2018-09-13





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

SPEC SHEET

REVISION SS

0

To learn more about Enphase offerings, visit enphase.com

PAGE NUMBER

## **Residential** Module

#### MULTI-BUSBAR 120 HALF-CELL BOB MODULE

1403 N RESEARCH WAY, BUILDING J

OREM, UT 84097 800-377-4480 WWW.BLUERAVENSOLAR.COM CONFIDENTIAL - THE INFORMATION

HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS

ORGANIZATION, EXCEPT IN

CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE

EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE

RAVEN SOLAR LLC.

NABCEP

**CERTIFIED** 

PV INSTALLATION

**PROFESSIONAL** 

Scott Gurney # PV-011719-015866

CONTRACTOR:

**BRS FIELD OPS** 

385.498.6700

THE

# **Residential** Module

MULTI-BUSBAR120 HALF-CELL BOB MODULE

120-Cell

MONOCRYSTALLINE MODULE

310-335W

**POWER OUTPUT RANGE** 

19.7%

**MAXIMUM EFFICIENCY** 

0~+5W

**POSITIVE POWER TOLERANCE** 

Founded in 1997, Trina Solar is the world's leading total solution provider for solar energy. With local presence around the globe, Trina Solar is able to each market and deliver our innovative, reliable products with the backing of Trina as a strong, bankable brand. Trina Solar now distributes its PV products to over 100 countries all over the world. We are committed to building strategic, mutually benevicial collaborations with installers, developers distributors and other partners in driving smart energy together.

#### **Comprehensive Products** and System Certificates

IEC61215/IEC61730/IEC61701/IEC62716 ISO 9001: Quality Management System ISO 14001: Environmental Management System ISO14064: Greenhouse Gases Emissions Veriÿcation OHSAS 18001: Occupation Health and Safety Management System



















PRODUCTS

TSM-DD06M.05(II)

## High power output

BACKSHEET

COLOR

**POWER** 

RANGE

310-335W

- Reduce BOS cost with high power bin and module efficiency
- New cell string layout and split J-box location reduces the energy loss caused by inter-row shading
- Lower resistance of half-cut cells and increased MBB (Multi Busbar) reflectance ensure higher power



## High energy generation, low LCOE

- Excellent 3rd party validated IAM and low light performance with cell process and module material optimization
- Low Pmax temp coefficient (-0.36%) increases energy production
- Better anti-shading performance and lower operating temperature




## Outstanding visual appearance, easy to install


- Designed for superior rooftop aesthetics
- Thinner wires give a eye cacthing all black look
- Safe and easy to transport, handle, and install

## Certified to perform in highly challenging environment


- High PID resistance through cell process and module material control
- Resistant to salt, acid, sand, and ammonia
- Over 30 in-house tests (UV, TC, HF etc)
- Certified to 5400 Pa positive load and 2400 Pa negative load

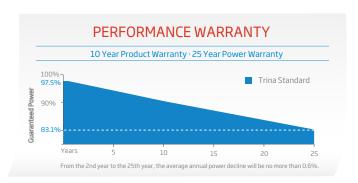


#### DIMENSIONS OF PV MODULE(mm)




String Inverter Configuration






#### I-V CURVES OF PV MODULE (335W)



#### P-V CURVES OF PV MODULE (335W)



## ELECTRICAL DATA (STC)

Peak Power Watts-P <sub>MAX</sub> (Wp)*	310	315	320	325	330	335
Power Output Tolerance-PMAX (W)			0 ~	+5		
Maximum Power Voltage-V <sub>MPP</sub> (V)	33.0	33.2	33.4	33.6	33.8	34.0
Maximum Power Current-I <sub>MPP</sub> (A)	9.40	9.49	9.58	9.67	9.76	9.85
Open Circuit Voltage-Voc (V)	39.9	40.1	40.3	40.4	40.6	40.7
Short Circuit Current-Isc (A)	10.03	10.12	10.20	10.30	10.40	10.50
Module Efficiency $\eta$ m(%)	18.2	18.5	18.8	19.1	19.4	19.7
STC: Irradiance 1000W/m², Cell Temperature 25						

#### **ELECTRICAL DATA (NMOT)**

Maximum Power-P <sub>MAX</sub> (Wp)	235	238	242	246	250	254
Maximum Power Voltage-V <sub>MPP</sub> (V)	31.0	31.2	31.4	31.6	31.7	31.9
Maximum Power Current-IMPP (A)	7.57	7.64	7.71	7.79	7.86	7.94
Open Circuit Voltage-Voc (V)	37.6	37.8	38.0	38.1	38.3	38.4
Short Circuit Current-Isc (A)	8.08	8.15	8.22	8.30	8.38	8.46

NMOT: Irradiance at 800W/m2, Ambient Temperature 20°C, Wind Speed 1m/s.

#### MECHANICAL DATA

Solar Cells	Monocrystalline
Cell Orientation	120 cells (6× 20)
Module Dimensions	1698 × 1004 × 35 mm (66.85 × 39.53 × 1.38 inches)
Weight	18.7kg (41.2lb)
Glass	3.2mm (0.13 inches), High Transmission, AR Coated Tempered Glass
Encapsulant Material	EVA
Backsheet	Black
Frame	35 mm (1.38 inches) Anodized Aluminium Alloy
J-Box	IP 68 rated
Cables	Photovoltaic Technology Cable 4.0mm² (0.006 inches²)  Portrait: N 140mm/P 285mm (5.51/11.22 inches)  Landscape: N 1200 mm /P 1200 mm (47.24/47.24 inches)
Connector	MC4

#### TEMPERATURE RATINGS

11°C (±3°C)
0.36%/°C
0.26%/°C
0.04%/°C
more strings i

## MAXIMUM RATINGS

MOT (Nominal Module Operating Temperature)	41°C (±3°C)	Operational Temperature	-40~+85°C
emperature Coefficient of PMAX	- 0.36%/°C	Maximum System Voltage	1000V DC (IEC)
emperature Coefficient of Voc	- 0.26%/°C		1000V DC (UL)
emperature Coefficient of Isc	0.04%/°C	Max Series Fuse Rating	20A

in parallel connection)

#### WARRANTY

10 year Product Workmanship Warranty	
25 year Power Warranty	

#### PACKAGING CONFIGURATION


Modules per box: 30 pieces
Modules per 40'container: 780 pieces



CAUTION: READ SAFETY AND INSTALL ATION INSTRUCTIONS BEFORE USING THE PRODUCT © 2019 Trina Solar Limited. All rights reserved. Specifications included in this datasheet are subject to change without notice. Version number: TSM\_DD06M.05(II)\_EN\_2019\_B

SPEC SHEET

PAGE NUMBER SS

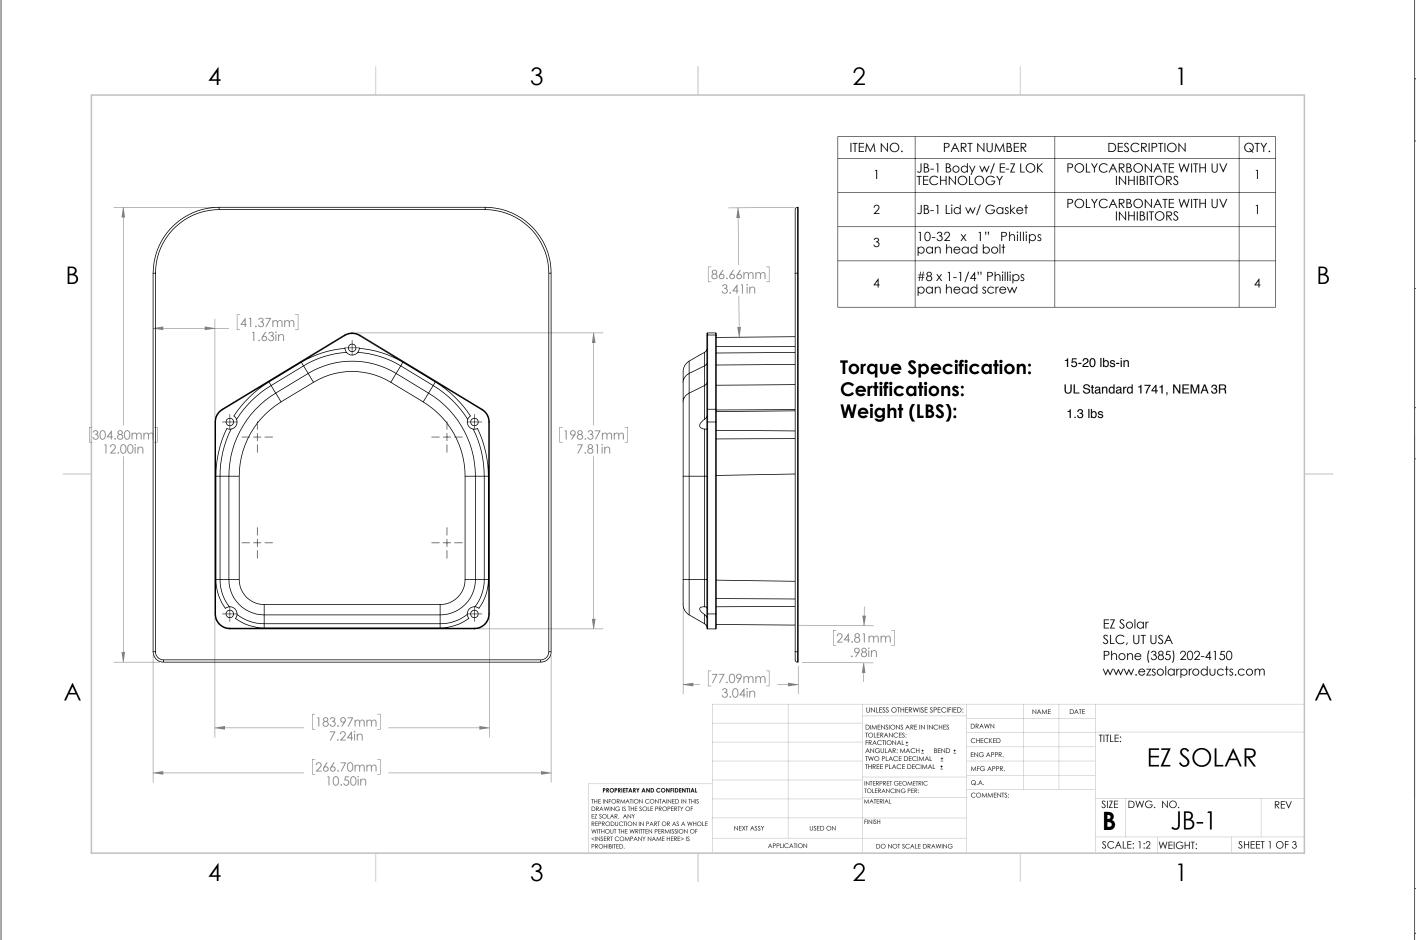



1403 N RESEARCH WAY, BUILDING J

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




CONTRACTOR: **BRS FIELD OPS** 385.498.6700

SPEC SHEET

0

PAGE NUMBER REVISION SS

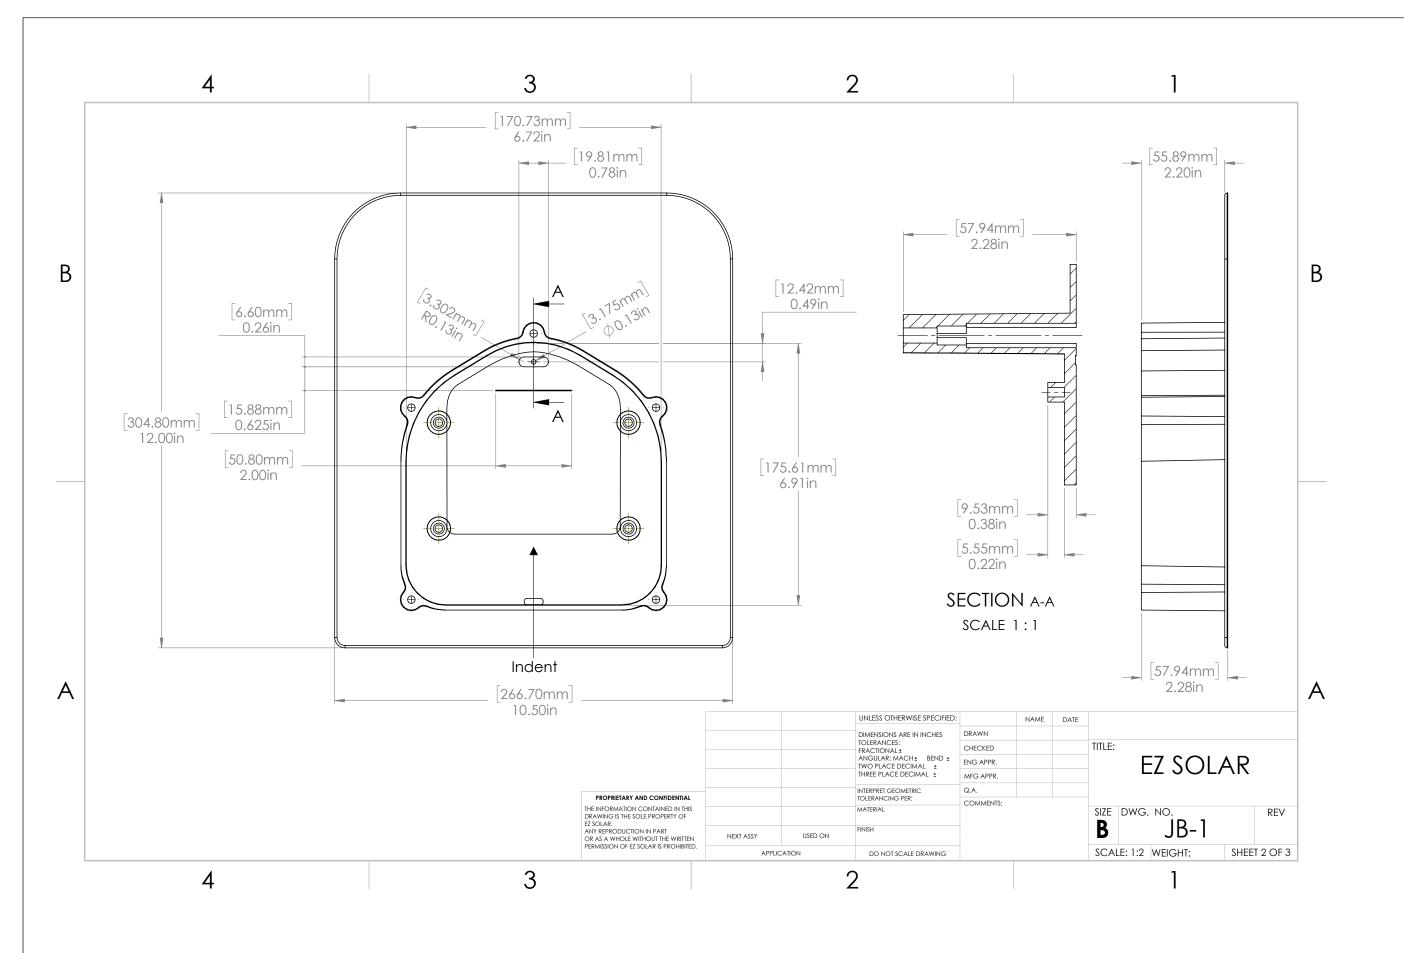



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




CONTRACTOR: BRS FIELD OPS 385.498.6700

SHEET NAM

SPEC SHEET

PAGE NUMBER

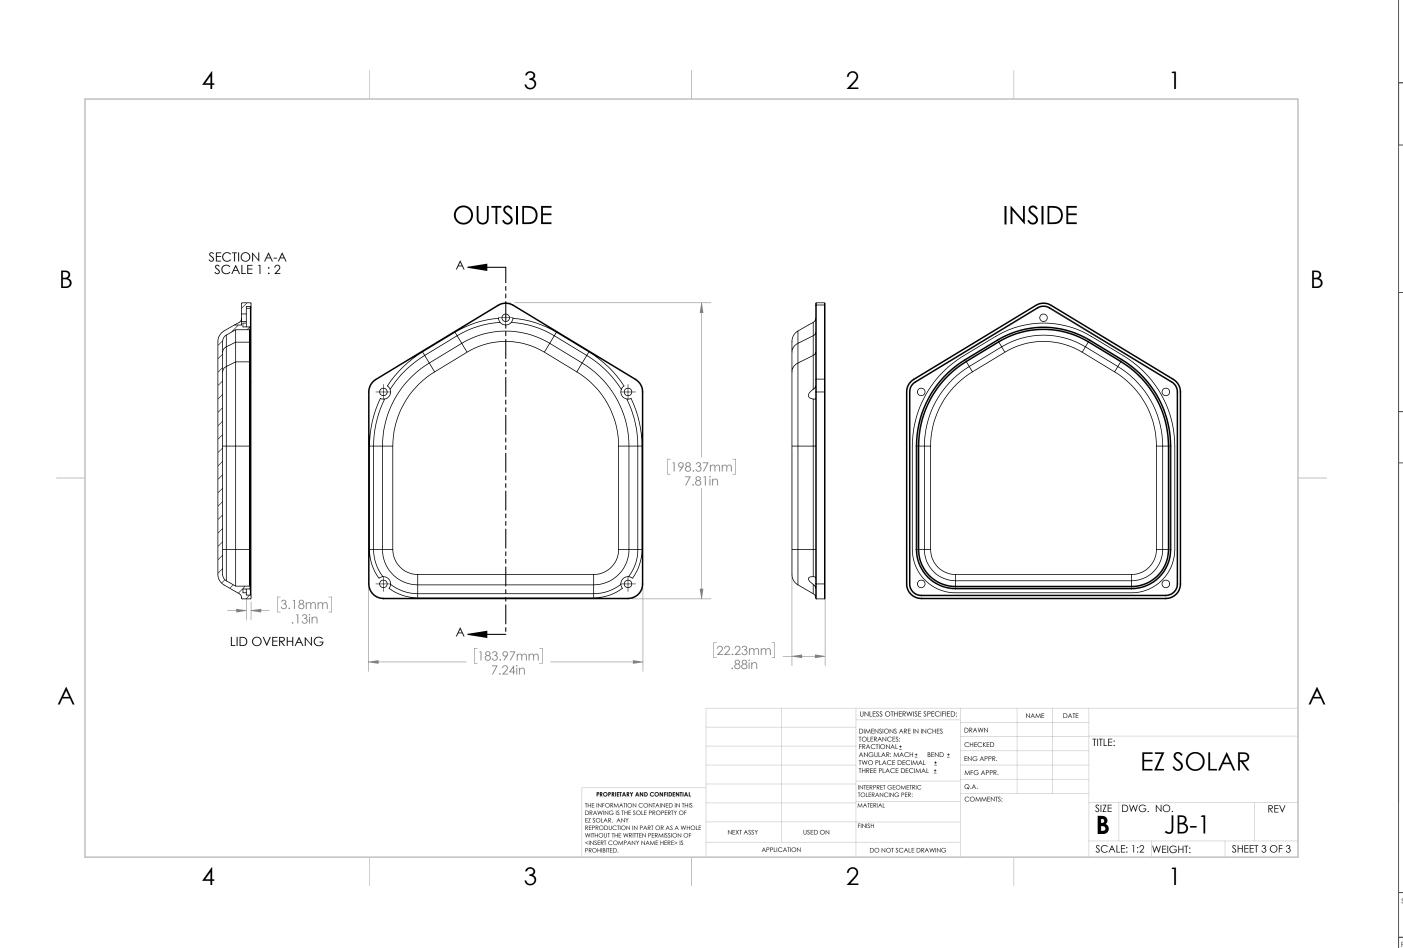



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700


SHEET NAME

SPEC SHEET

PAGE NUMBER



# SYSTEM BONDING & GROUNDING PAGE

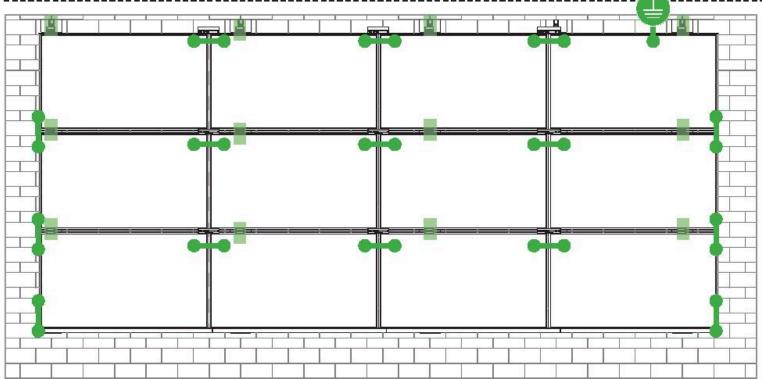



torque to the following: 4-6 AWG: 35in-lbs 8 AWG: 25 in-lbs 10-14 AWG: 20 in-lbs

## **LUG DETAIL & TORQUE INFO**

## Ilsco Lay-In Lug (GBL-4DBT)

- 10-32 mounting hardware
- Torque = 5 ft-lb
- AWG 4-14 Solid or Stranded



TERMINAL TORQUE, Install Conductor and torque to the following: 4-14 AWG: 35in-lbs

## **LUG DETAIL & TORQUE INFO**

## Ilsco Flange Lug(SGB-4)

- 1/4" mounting hardware
- Torque = 75 in-lb
- AWG 4-14 Solid or Stranded

## WEEBLUG Single Use Only



TERMINAL TORQUE, Install Conductor and torque to the following: 6-14 AWG: 7ft-lbs


## **LUG DETAIL & TORQUE INFO**

## Wiley WEEBLug (6.7)

- 1/4" mounting hardware
- Torque = 10 ft-lb
- AWG 6-14 Solid or Stranded


## NOTE: ISOLATE COPPER FROM ALUMINUM CONTACT TO PREVENT CORROSION


System bonding is accomplished through modules. System grounding accomplished by attaching a ground lug to any module at a location on the module specified by the module manufacturer.

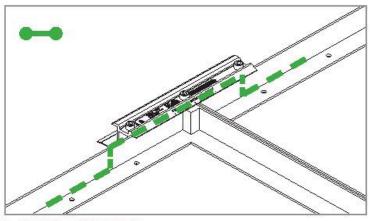

#### E-W BONDING PATH:


E-W module to module bonding is accomplished with 2 pre-installed bonding pins which engage on the secure side of the MicrorailTM and splice.






## N-S BONDING PATH:

N-S module to module bonding is accomplished with bonding clamp with 2 integral bonding pins. (refer also to alternate method)





#### TRIMRAIL BONDING PATH:

Trimrail to module bonding is accomplished with bonding clamp with integral bonding pin and bonding T-bolt. (refer also to alternate method)



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700

EET NAME

SPEC SHEET

PAGE NUMBER

0



Address:

USA

## **AUTHORIZATION TO MARK**

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Manufacturer: Cixi Emeka Aluminum Co. Ltd Unirac, Inc Applicant:

> No. 688 ChaoSheng Road 1411 Broadway Blvd NE

Cixi City Address: Albuquerque, NM 87102 Zhejiang Province 315311

Country:

China

Country: Klaus Nicolaedis Jia Liu Contact:

Contact: Robin Luo Tom Young

505-462-2190 +86-15267030962 Phone: Phone: 505-843-1418 +86-13621785753

FAX: FAX: NA

klaus.nicolaedis@unirac.com jia.liu@cxymj.com toddg@unirac.com Email: Email: buwan.luo@cxymj.com

Party Authorized To Apply Mark: Same as Manufacturer Report Issuing Office: Lake Forest, CA U.S.A.

Control Number: 5003705 Authorized by: for Dean Davidson, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

> Intertek Testing Services NA Inc. 545 East Algonquin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Standard(s): Plate Photovoltaic Modules and Panels [UL 2703: 2015 Ed.1] Photovoltaic Mounting System, Sun Frame Microrail - Installed Using Unirac Installation Guide, Rev Product: PUB2019MAR01 with Annex North Row Extension Installation Guide Rev PUB2019FEB20 Brand Name: Unirac Models: Unirac SFM

ATM for Report 102393982LAX-002 Page 1 of 1 ATM Issued: 9-Apr-2019 ED 16.3.15 (20-Apr-17) Mandatory



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700


SPEC SHEET

PAGE NUMBER SS

0





# FLASHING & SLIDERS INSTALLATION GUIDE PAGE




## PILOT HOLES:

Drill pilot holes for lag screws or structural screws (as necessary) at marked attachement points





FLASHINGS: Place flashings

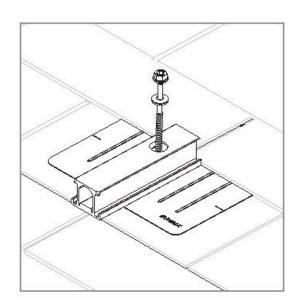


## INSTALL SLIDERS AND TRIMRAIL ROOF ATTACHMENTS:

• Insert flashings per manufacturer instructions

NOTE: Use Lag screw or structural fastener with a maximum diameter of 5/16"

- Attach sliders to rafters
- Verify proper row to row spacing for module size (Mod NS + 1")
- Ensure that TrimrailTM roof attachments in each row have sufficient engagement with slider dovetails for proper attachment.

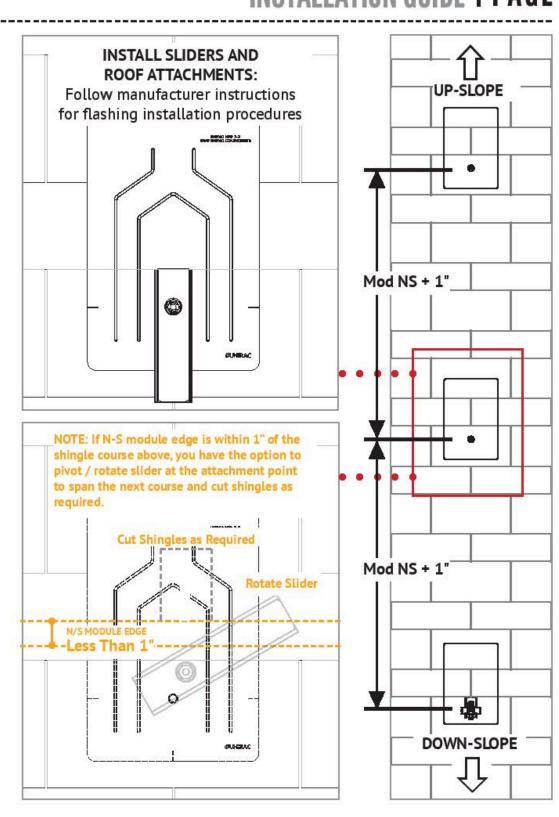



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION
HEREIN CONTAINED SHALL NOT BE
USED FOR THE BENEFIT OF
ANYONE EXCEPT BLUE RAVEN
SOLAR NOR SHALL IT BE
DISCLOSED IN WHOLE OR IN PART
TO OTHERS OUTSIDE RECIPIENTS
ORGANIZATION, EXCEPT IN
CONNECTION WITH THE SALE AND
USE OF THE RESPECTIVE
EQUIPMENT, WITHOUT THE
WRITTEN PERMISSION OF BLUE
RAVEN SOLAR LLC.



CONTRACTOR: BRS FIELD OPS

385.498.6700

SHEET NAME

SPEC SHEET

PAGE NUMBER

O