



Scott E. Wysling, PE, PP, CME

**Wysling Consulting**  
76 North Meadowbrook Drive  
Alpine, UT 84004  
office (201) 874-3483  
swysling@wyslingconsulting.com

August 5, 2020

Jon Kirchner, VP of Technology  
Sigora Solar  
1222 Harris Street  
Charlottesville, VA 22903

Re: Engineering Services  
Bradley Residence  
308 West E Street, Erwin NC  
4.800 kW System Size

Dear Mr. Kirchner:

Pursuant to your request, we have reviewed the following information regarding solar panel installation on the roof of the above referenced home:

1. Site Visit/Verification Form prepared by a Sigora Solar representative identifying specific site information including size and spacing of rafters for the existing roof structure.
2. Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information was prepared by Sigora Solar and will be utilized for approval and construction of the proposed system.
3. Photographs of the interior and exterior of the roof system identifying existing structural members and their conditions.

Based on the above information we have evaluated the structural capacity of the existing roof system to support the additional loads imposed by the solar panels and have the following comments related to our review and evaluation:

***Description of Residence:***

The existing residence is typical wood framing construction with the roof system consisting of truss system with all chords constructed of 2 x 4 dimensional lumber at 24" on center. The attic space is unfinished and photos indicate that there was free access to visually inspect the size and condition of the roof rafters. All wood material utilized for the roof system is assumed to be Doug-Fir #2 or better with standard construction components. The existing roofing material consists of composite asphalt shingles. Photos of the dwelling also indicate that there is a permanent foundation.

***A. Loading Criteria Used***

- 115 MPH wind loading based on ASCE 7-10 Exposure Category "C" at a slope of 21 degrees
- 7 PSF = Dead Load roofing/framing                      Live Load = 20 PSF                      Snow Load = 15 PSF
- 3 PSF = Dead Load solar panels/mounting hardware

*Total Dead Load = 10 PSF*

*The above values are within acceptable limits of recognized industry standards for similar structures in accordance with the North Carolina Residential Code (2018). Analysis performed of the existing roof structure utilizing the above loading criteria indicates that the existing rafters will support the additional panel loading without damage, if installed correctly.*

**B. Solar Panel Anchorage**

1. The solar panels shall be mounted in accordance with the most recent “*Everest Installation Manual*”, which can be found on the Everest website (<https://everest-solarsystems.com/>). If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
2. Maximum allowable pullout per lag screw is 235 lbs/inch of penetration as identified in the National Design Standards (NDS) of timber construction specifications for Doug-Fir #2 *assumed*. Based on our evaluation, the pullout value, utilizing a penetration depth of 2 ½”, is less than what is allowable per connection and therefore is adequate. Based on the variable factors for the existing roof framing and installation tolerances, using a thread depth of 2 ½” with a minimum size of 5/16” lag screw per attachment point for panel anchor mounts should be adequate with a sufficient factor of safety.
3. Considering the roof slopes, the size, spacing, condition of roof, the panel supports shall be placed no greater than 48” o/c.
4. Panel supports connections shall be staggered to distribute load to adjacent Trusses.

**C. Solar Panel Layout**



Based on the above evaluation, it is the opinion of this office that with appropriate panel anchors being utilized the roof system will adequately support the additional loading imposed by the solar panels. This evaluation is in conformance with the North Carolina Residential Code (2018), current industry and standards, and based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Very truly yours,

  
Scott E. Wyssling, PE  
North Carolina License No. 46546



# PROJECT DESCRIPTION:


15 x SILFAB SOLAR: SIL-320 BL 320W MONO MODULES  
 ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES  
 DC SYSTEM SIZE: 4.800kW DC  
 AC SYSTEM SIZE: 3.600kW AC

## EQUIPMENT SUMMARY

15 SILFAB SOLAR: SIL-320 BL 320W MONO MODULES  
 15 ENPHASE IQ7-60-2-US MICRO INVERTERS

ROOF ARRAY AREA #1:- 274.50 SQ FT.

AUTHORITIES HAVING JURISDICTION  
 BUILDING: HARNETT, COUNTY OF (NC)  
 ZONING: HARNETT, COUNTY OF (NC)



APPLICABLE CODES & STANDARDS  
 NCBC 2018  
 NEC 2017


## DESIGN SPECIFICATION

OCCUPANCY: II  
 CONSTRUCTION: SINGLE-FAMILY  
 ZONING: RESIDENTIAL  
 GROUND SNOW LOAD: REFER STRUCTURAL LETTER  
 WIND EXPOSURE: REFER STRUCTURAL LETTER  
 WIND SPEED: REFER STRUCTURAL LETTER

# 1 | PLOT PLAN WITH ROOF PLAN

PV-1


SCALE: 1/16" = 1'-0"

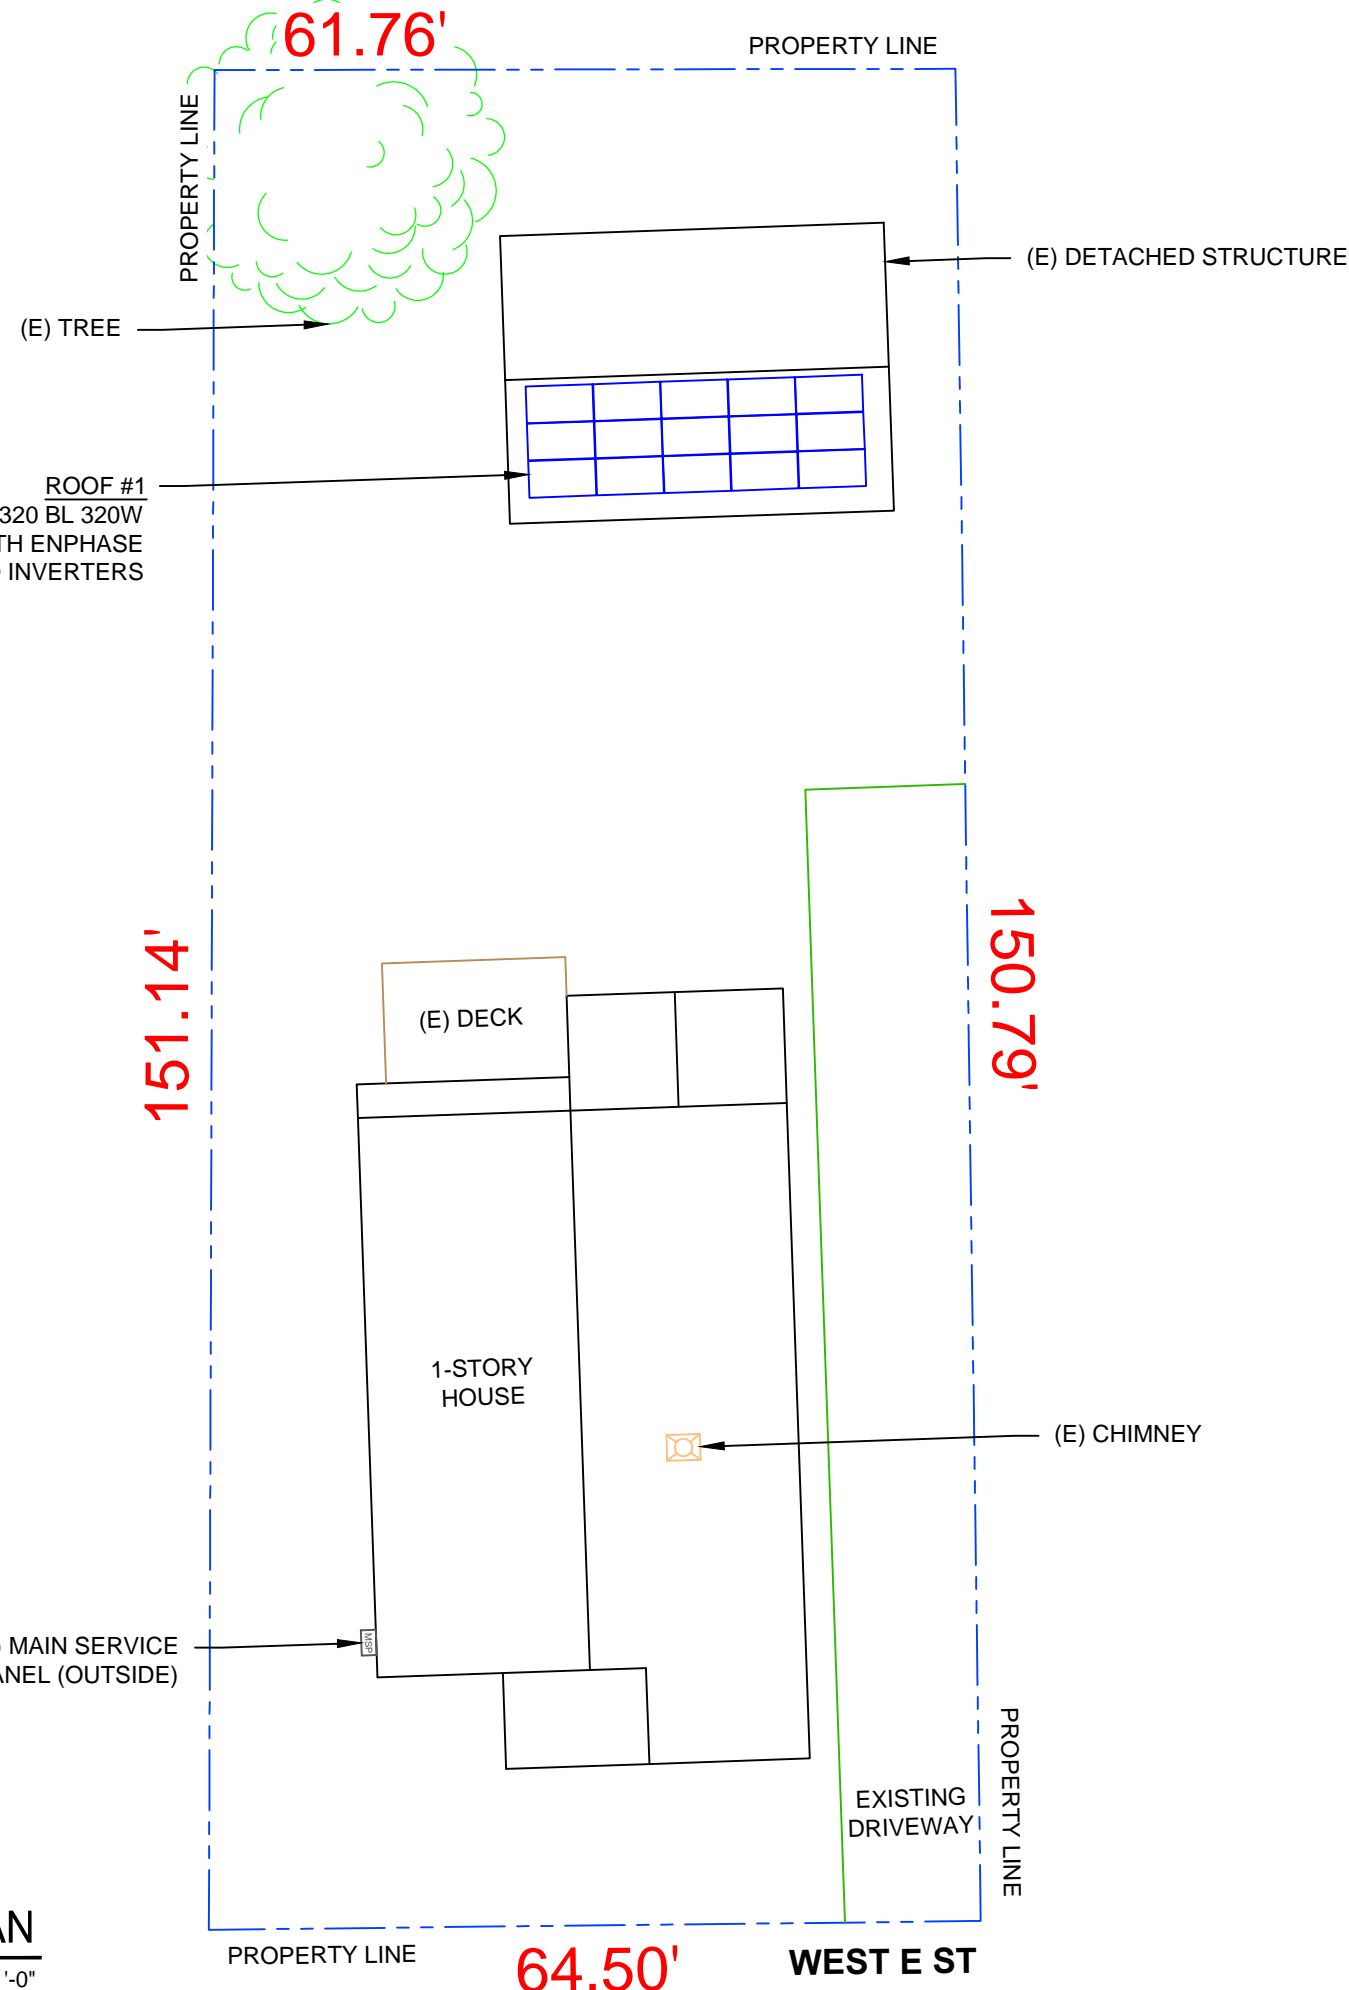

# 2 | HOUSE PHOTO

PV-1

SCALE: NTS

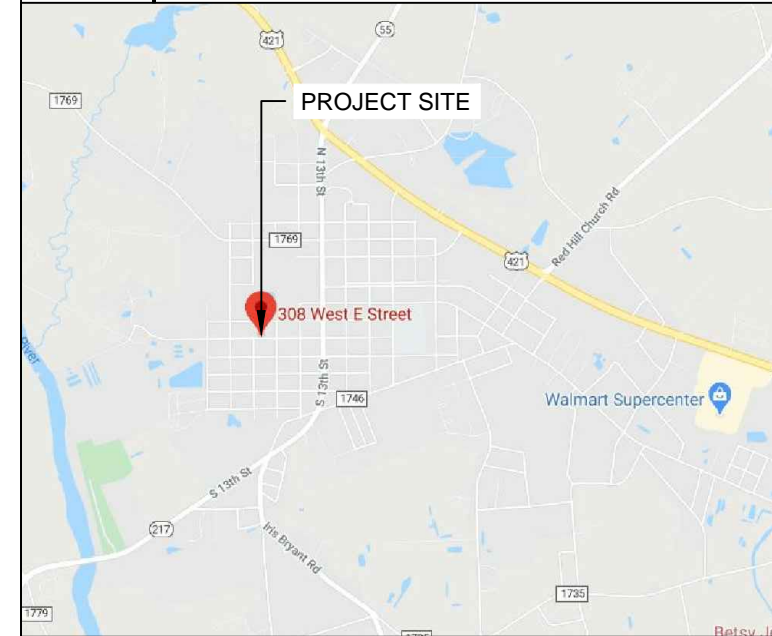

# 3 | VICINITY MAP

PV-1

SCALE: NTS

## SHEET INDEX

- PV-1 PLOT PLAN WITH ROOF PLAN
- PV-2 ROOF PLAN & MODULES
- PV-2A CIRCUIT LAYOUT
- PV-3 ATTACHMENT DETAIL
- PV-4 ELECTRICAL LINE DIAGRAM
- PV-5 PLACARD
- PV-6 MICRO INVERTER CHART
- PV-7+ EQUIPMENT SPECIFICATIONS

SIGORA SOLAR LLC  
 490 WESTFIELD RD STE A  
 CHARLOTTEVILLE, VA 22901

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

PROJECT NAME & ADDRESS

**JEAN BRADLEY  
 RESIDENCE**

308 WEST E ST,  
 ERWIN, NC 28339

DRAWN BY

**ESR**

SHEET NAME

**PLOT PLAN WITH  
 ROOF PLAN**

SHEET SIZE



**ANSI B  
 11" X 17"**

SHEET NUMBER

**PV-1**


# MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 15 MODULES  
 MODULE TYPE = SILFAB SOLAR: SIL-320 BL 320W MONO MODULES  
 MODULE WEIGHT = 40.10 LBS / 18.2KG.  
 MODULE DIMENSIONS = 66.9"x 39.4" = 18.30 SF

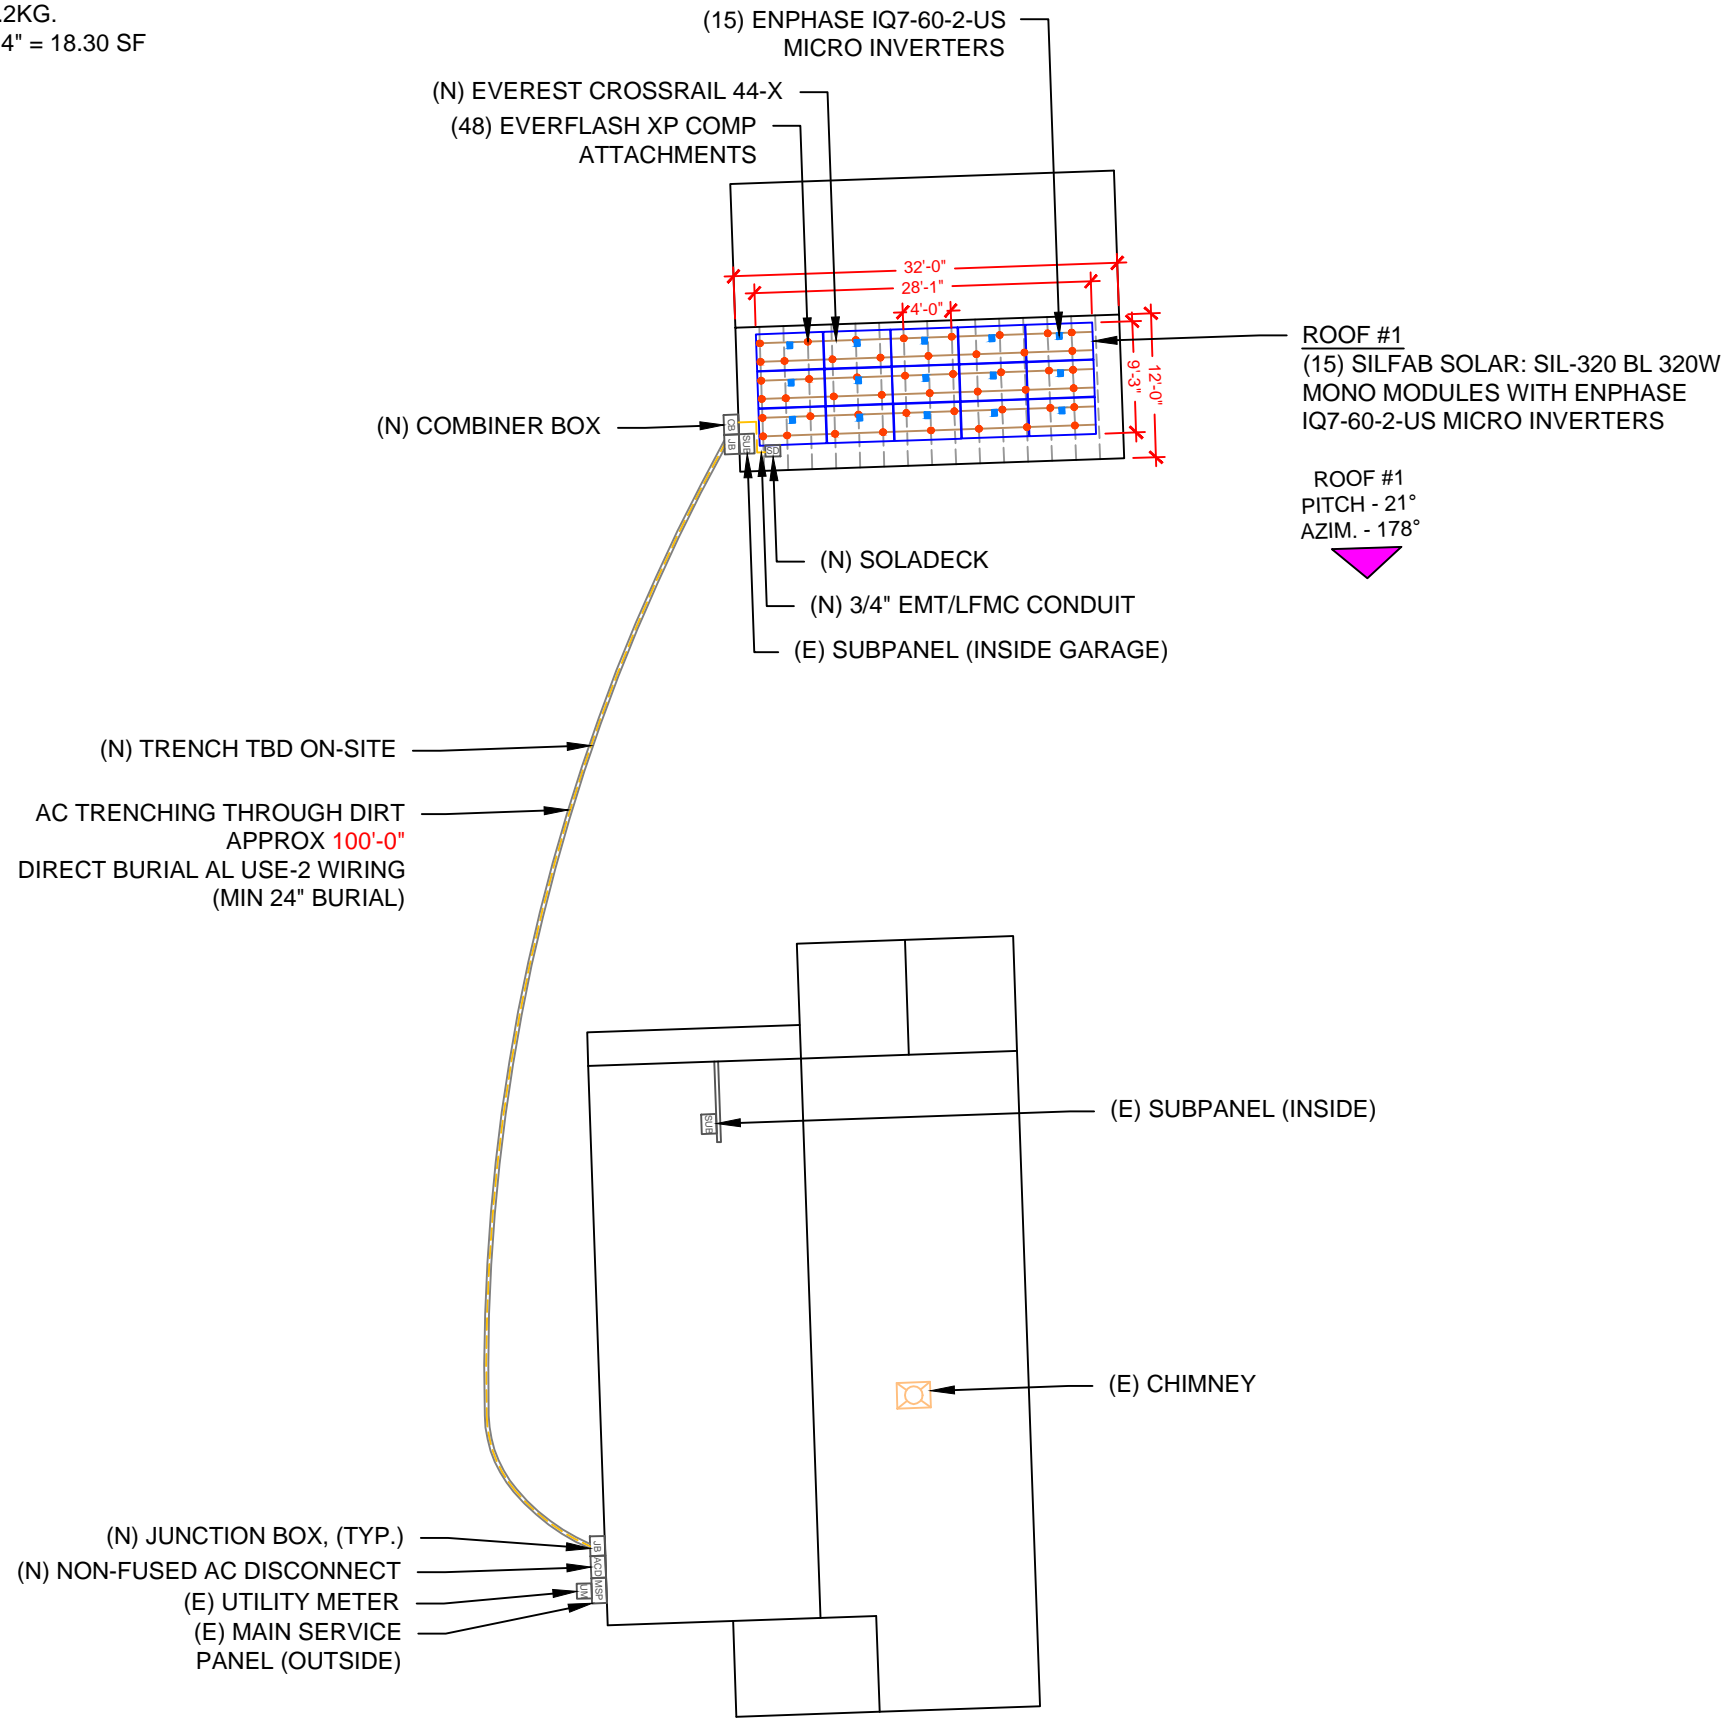

ROOF #1  
 (15) SILFAB SOLAR: SIL-320 BL 320W  
 MONO MODULES WITH ENPHASE  
 IQ7-60-2-US MICRO INVERTERS

ROOF #1  
 PITCH - 21°  
 AZIM. - 178°

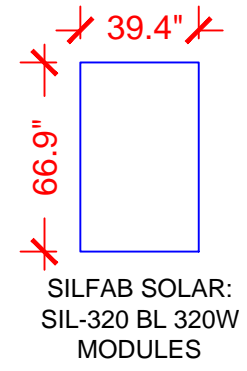

ROOF DESCRIPTION				
ROOF TYPE		COMPOSITE SHINGLE		
ROOF LAYER		1 LAYER		
ROOF	ROOF PITCH	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	21°	178°	2X4	24"

ARRAY AREA & ROOF AREA CALC'S				
ROOF	# OF MODULES	ARRAY AREA (Sq. Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)
#1	15	274.50	384.00	71

SIGORA SOLAR LLC  
 490 WESTFIELD RD STE A  
 CHARLOTTEVILLE, VA 22901

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

PROJECT NAME & ADDRESS  
**JEAN BRADLEY RESIDENCE**  
 308 WEST E ST,  
 ERWIN, NC 28339

DRAWN BY  
**ESR**



SHEET NAME  
**ROOF PLAN & MODULES**

SHEET SIZE  
**ANSI B  
 11" X 17"**

SHEET NUMBER  
**PV-2**

### LEGEND

- SD - SOLADECK
- INV - INVERTER
- CB - COMBINER BOX
- ACD - AC DISCONNECT
- LC - LOAD CENTER
- UM - UTILITY METER
- MSP - MAIN SERVICE PANEL
- VENT, ATTIC FAN (ROOF OBSTRUCTION)
- - ROOF ATTACHMENT
- - TRUSS
- - - - - CONDUIT

CIRCUIT LEGENDS	
	CIRCUIT #1
	CIRCUIT #2

BILL OF MATERIALS		
EQUIPMENT	QTY	DESCRIPTION
SOLAR PV MODULES	15	SILFAB SOLAR: SIL-320 BL 320W
MICRO INVERTERS	15	ENPHASE IQ7-60-2-US MICRO INVERTERS
SOLADECK	1	SOLADECK
MODULE CLAMPS	24	MID MODULE CLAMPS
END CLAMPS	12	END CLAMPS / STOPPER SLEEVE
ATTACHMENT	48	EVERFLASH XP COMP
BOLT	48	LAG BOLT



SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

PROJECT NAME & ADDRESS

**JEAN BRADLEY  
RESIDENCE**

308 WEST E ST,  
ERWIN, NC 28339

DRAWN BY

**ESR**

SHEET NAME


**CIRCUIT  
LAYOUT**

SHEET SIZE

**ANSI B  
11" X 17"**

SHEET NUMBER

**PV-2A**

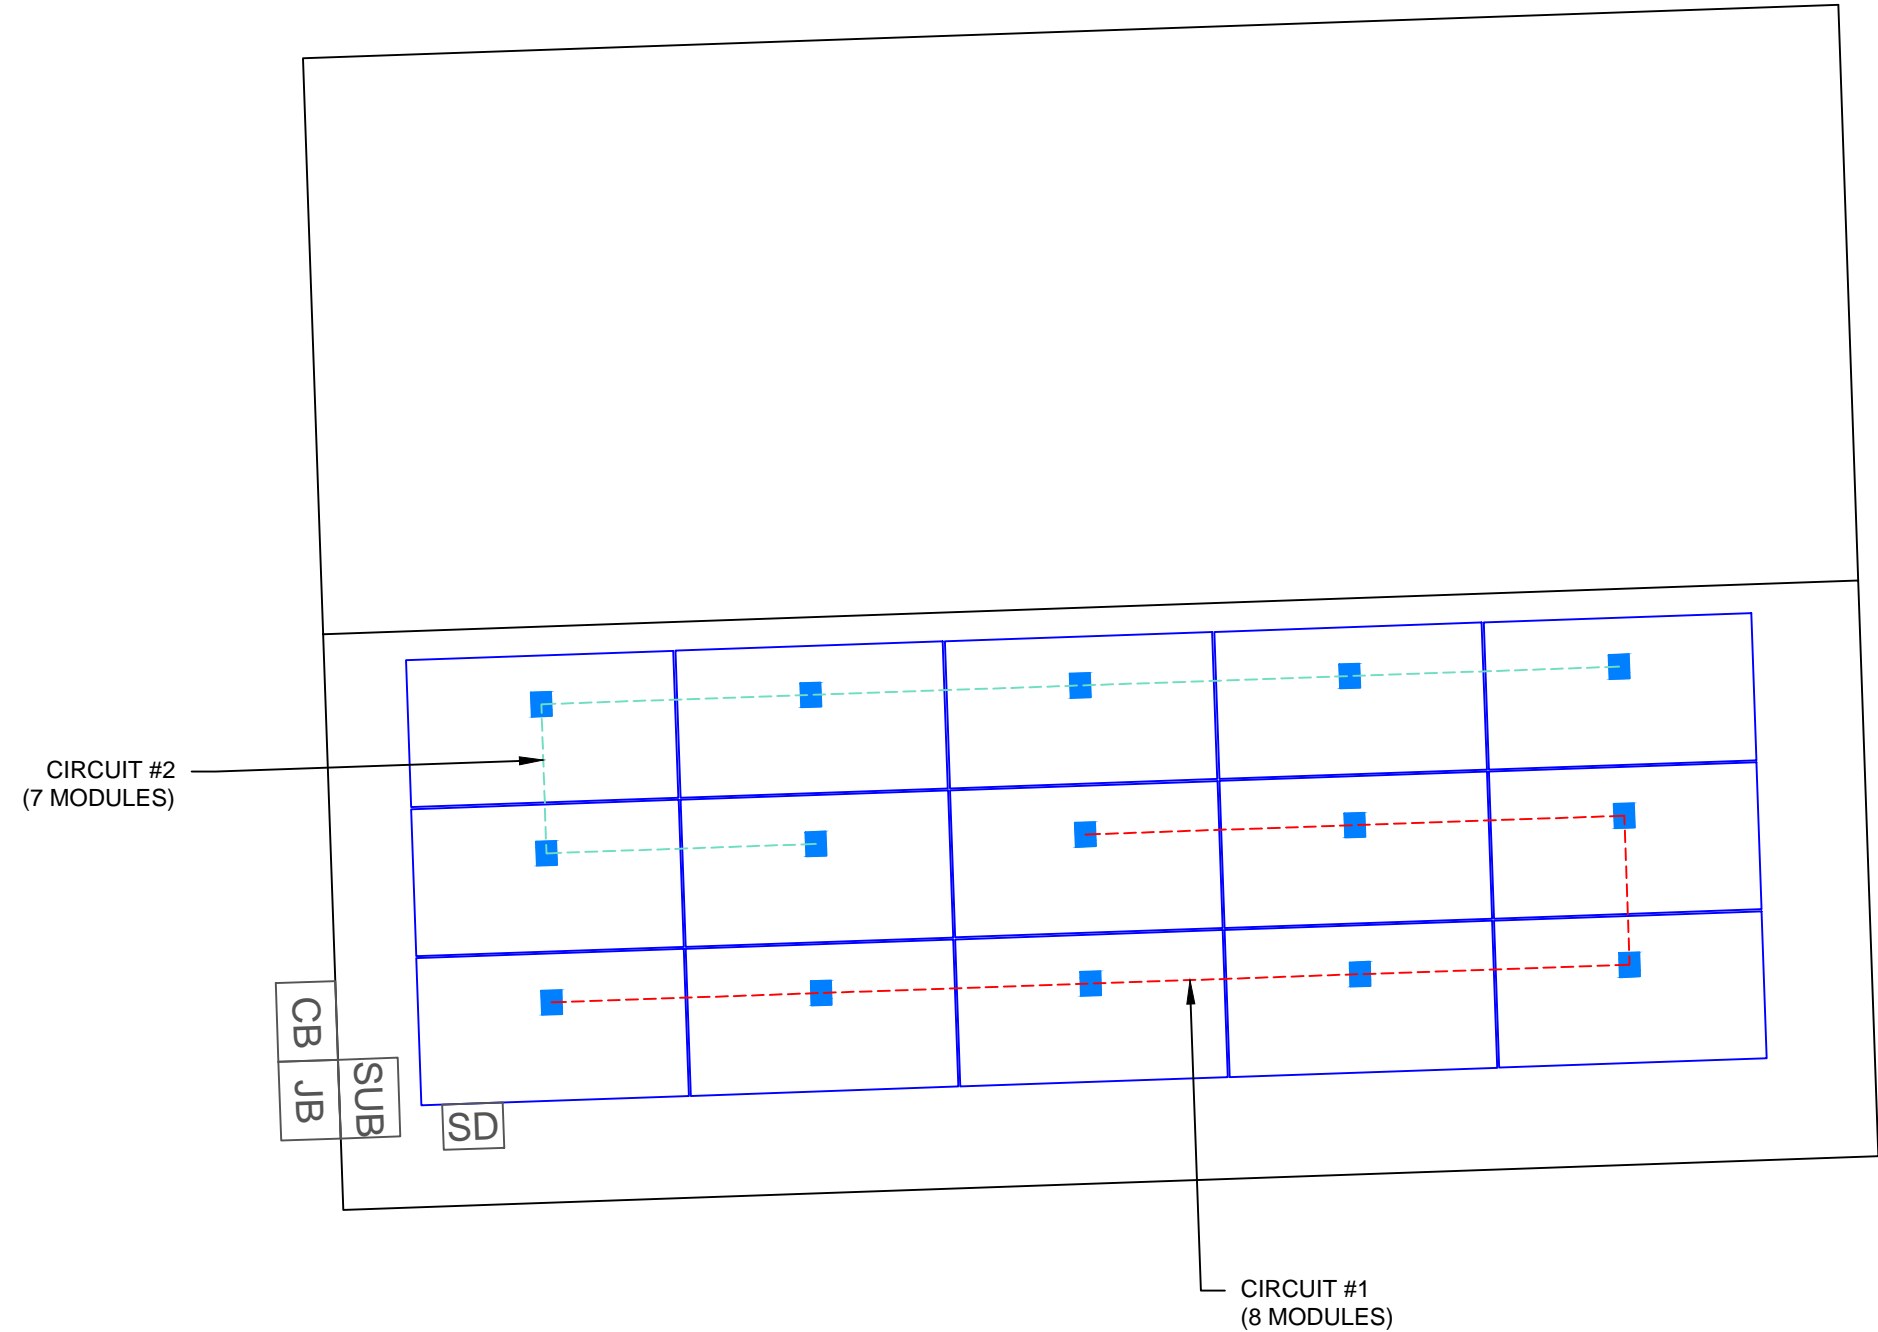



REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

PROJECT NAME & ADDRESS

**JEAN BRADLEY  
RESIDENCE**  
  
308 WEST E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME


**ATTACHMENT  
DETAIL**

SHEET SIZE


**ANSI B  
11" X 17"**

SHEET NUMBER


PV-3

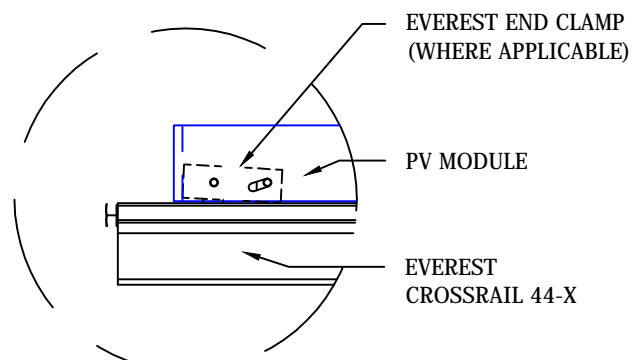


**1** END CLAMP DETAILS

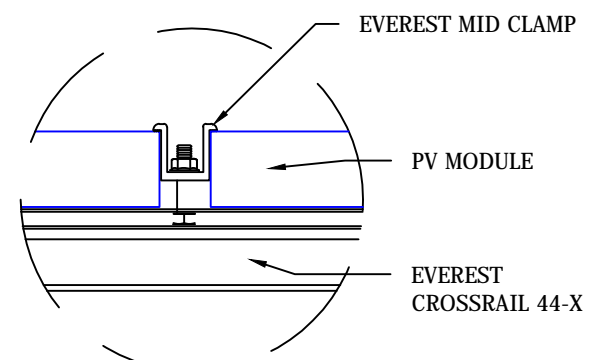


**2** MID CLAMP DETAILS

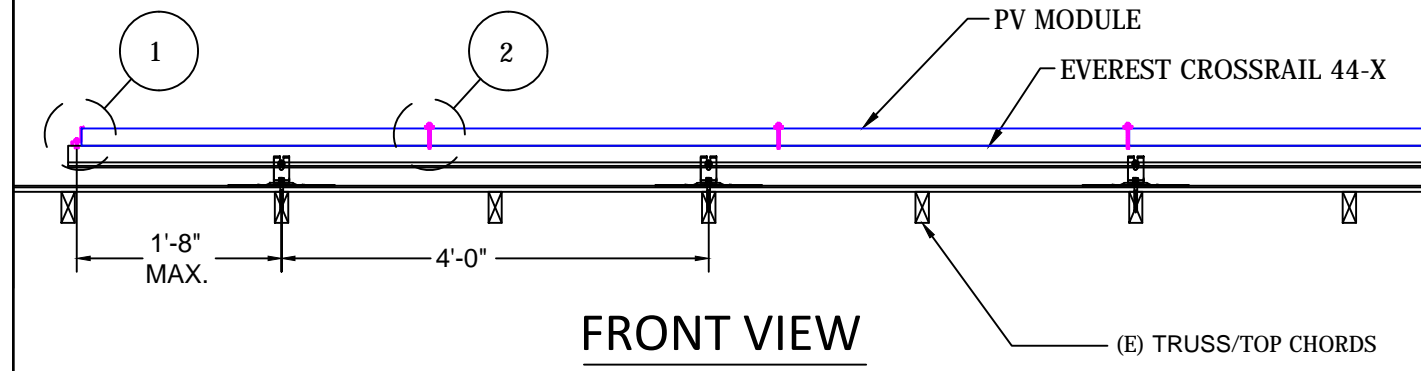

**FRONT VIEW**

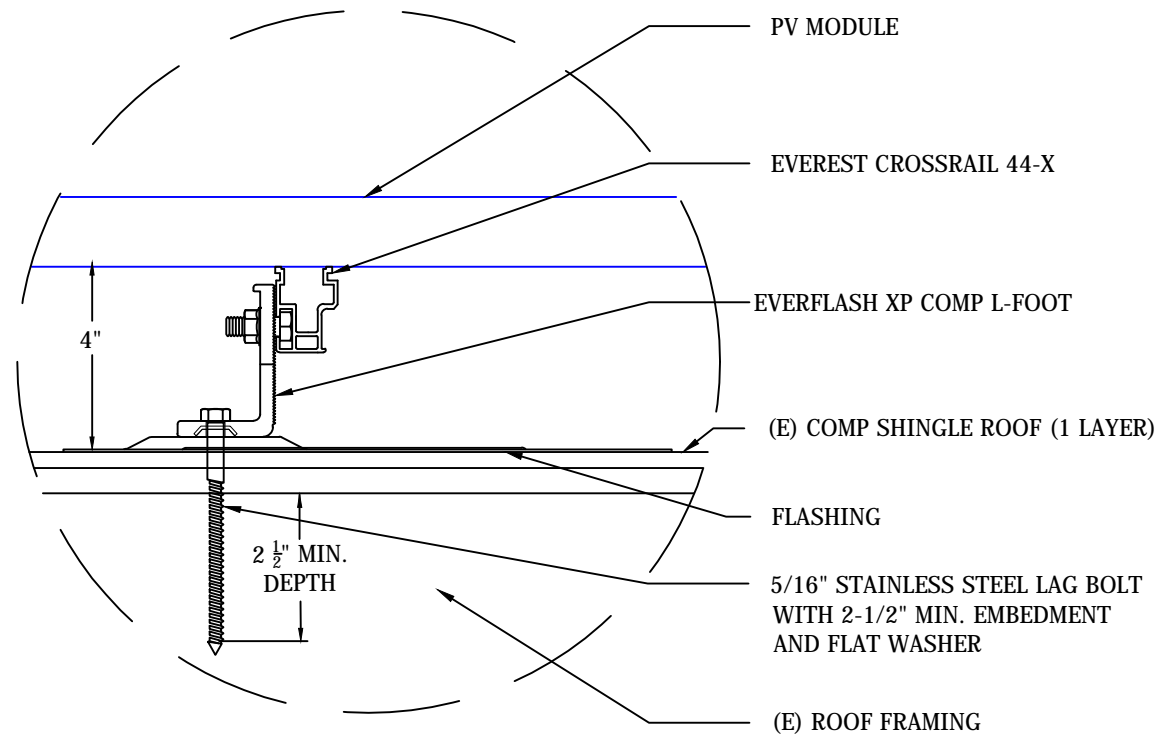

**3** DETAIL, MOUNTING AND FLASHING

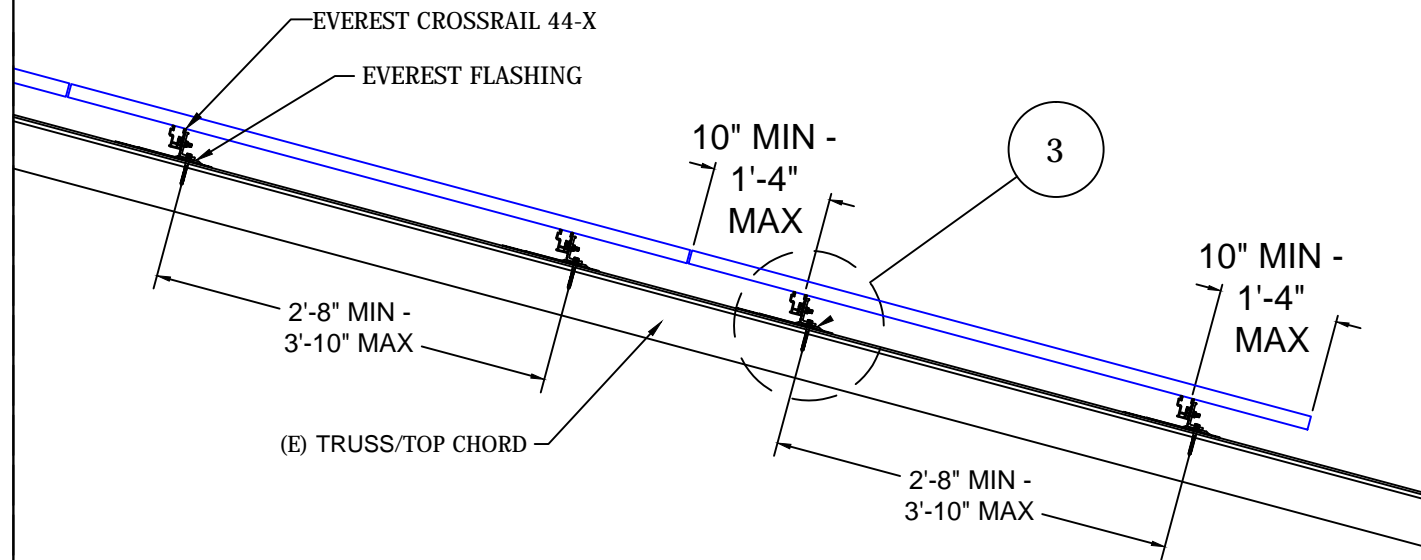

**SIDE VIEW**

DC SYSTEM SIZE: 4.800 kW DC  
AC SYSTEM SIZE: 3.600 kW AC

(15) SILFAB SOLAR: SIL-320 BL 320W MONO MODULES WITH (15) ENPHASE IQ7-60-2-US MICRO INVERTERS  
(1) BRANCH CIRCUIT OF 8 MODULE AND  
(1) BRANCH CIRCUIT OF 7 MODULES CONNECTED IN PARALLEL

**INTERCONNECTION NOTES:**


1. INTERCONNECTION SIZING, LIMITATIONS AND COMPLIANCE DETERMINED IN ACCORDANCE WITH [NEC 705.12], AND [NEC 690.64].
2. GROUND FAULT PROTECTION IN ACCORDANCE WITH [NEC 215.9], [NEC 230.95] AND [NEC 690.5]
3. ALL EQUIPMENT TO BE RATED FOR BACKFEEDING.
4. PV BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUSBAR RELATIVE TO THE MAIN BREAKER.

**DISCONNECT NOTES:**

1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)
2. AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH

**GROUNDING & GENERAL NOTES:**

1. A SECOND FACILITY GROUNDING ELECTRODE IS NOT REQUIRED PER [NEC 690.47(C)(3)]
2. PV INVERTER IS UNGROUNDED, TRANSFORMER-LESS TYPE.
3. DC GEC AND AC EGC TO REMAIN UNSPLICED, OR SPLICED TO EXISTING ELECTRODE
4. ANY EXISTING WIRING INVOLVED WITH PV SYSTEM CONNECTION THAT IS FOUND TO BE INADEQUATE PER CODE SHALL BE CORRECTED PRIOR TO FINAL INSPECTION.
5. SOLADECK QUANTITIES, AND PLACEMENT SUBJECT TO CHANGE IN THE FIELD - SOLADECKES DEPICTED ON ELECTRICAL DIAGRAM REPRESENT WIRE TYPE TRANSITIONS.
6. AC DISCONNECT NOTED IN EQUIPMENT SCHEDULE OPTIONAL IF OTHER AC DISCONNECTING MEANS IS LOCATED WITHIN 10' OF SERVICE DISCONNECT
7. RACEWAYS AND CABLES EXPOSED TO SUNLIGHT ON ROOFTOPS SHOULD BE INSTALLED MORE THAN 7/8" ABOVE THE ROOF USING CONDUIT SUPPORTS.

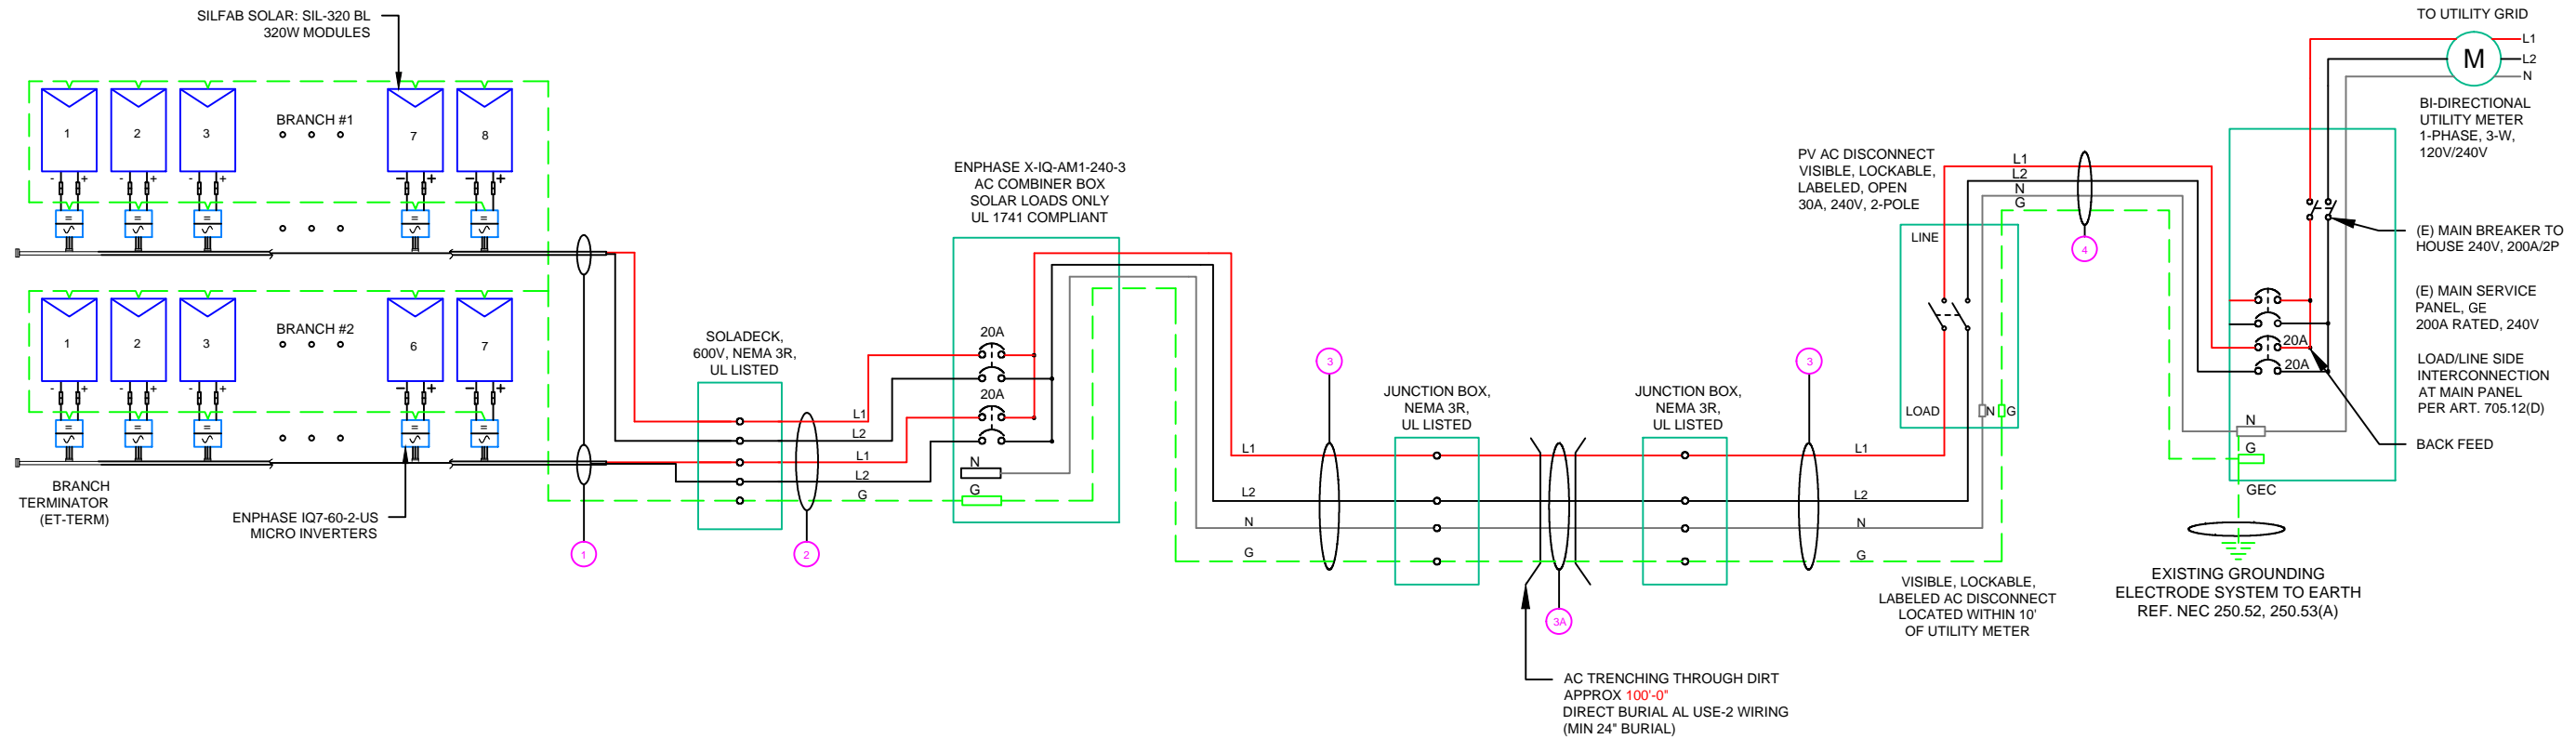

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

PROJECT NAME & ADDRESS  
**JEAN BRADLEY RESIDENCE**  
308 WEST E ST,  
ERWIN, NC 28339


DRAWN BY <b>ESR</b>
SHEET NAME <b>ELECTRICAL LINE DIAGRAM</b>
SHEET SIZE <b>ANSI B 11" X 17"</b>
SHEET NUMBER <b>PV-4</b>

QTY	CONDUCTOR INFORMATION	CONDUIT TYPE	CONDUIT SIZE
1 (4)	#12AWG - ENPHASE ENGAGE CABLE (L1 & L2 NO NUETRAL)	N/A	N/A
1 (1)	#6AWG - BARE COPPER IN FREE AIR		
2 (4)	#10AWG - CU,THWN-2 (L1,L2)	EMT OR LFMC IN ATTIC	3/4"
2 (1)	#10AWG - CU,THWN-2 GND		
3 (2)	#2AWG - AL USE-2 (L1,L2)		
3 (1)	#4AWG - AL USE-2 N	DIRECT BURIAL (24" DEPTH MIN.)	N/A
3 (1)	#6AWG - AL USE-2 GND		
4 (2)	#10AWG - CU,THWN-2 (L1,L2)		
4 (1)	#10AWG - CU,THWN-2 N	EMT, LFMC OR PVC	3/4"
4 (1)	#10AWG - CU,THWN-2 GND		
4 (2)	#10AWG - CU,THWN-2 (L1,L2)		
4 (1)	#10AWG - CU,THWN-2 N	EMT, LFMC OR PVC	3/4"
4 (1)	#10AWG - CU,THWN-2 GND		





SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

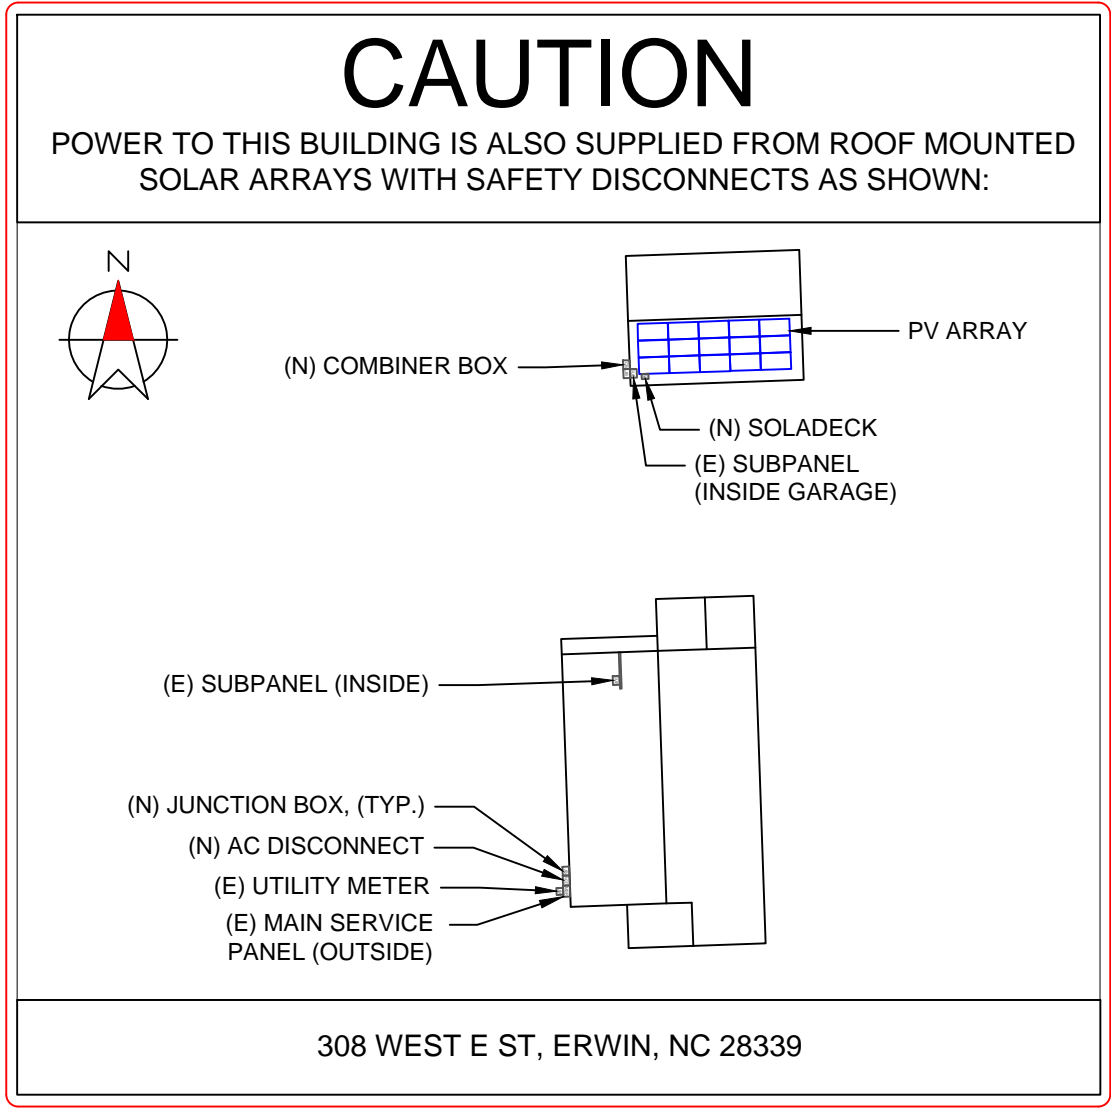


**DIRECTORY**  
PERMANENT PLAQUE OR DIRECTORY PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM.

(ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS OUTLINED WITHIN:  
NEC 690.56(B)&(C), [NEC 705.10])

**LABELING NOTES:**

1. LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS. ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER CURRENT NEC AND LOCAL CODES AND MAKE APPROPRIATE ADJUSTMENTS.
2. LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRIC CODE, OSHA STANDARD 19010.145, ANSI Z535.
3. MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
4. LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED [NEC 110.21]
5. LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]

**LABELING DIAGRAM:**

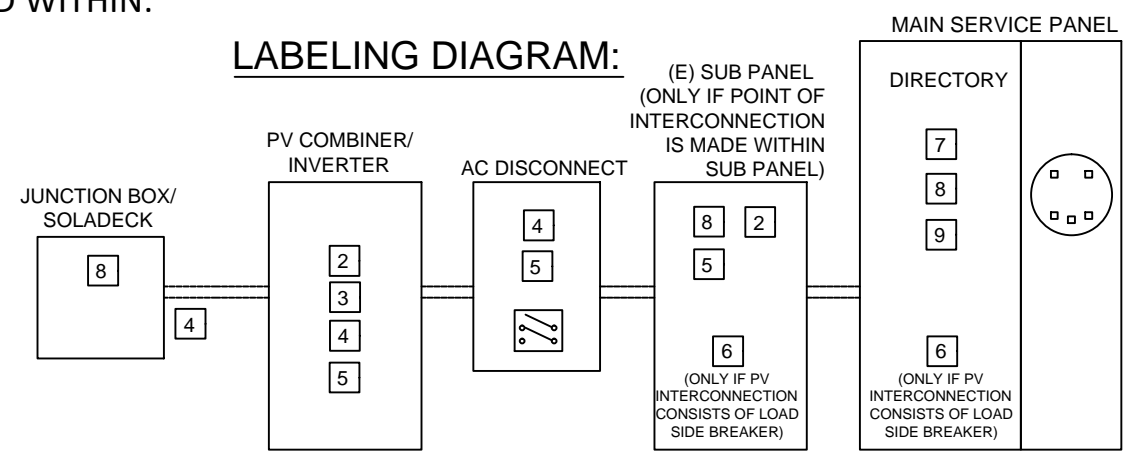

\*\* ELECTRICAL DIAGRAM SHOWN ABOVE IS FOR LABELING PURPOSES ONLY. NOT AN ACTUAL REPRESENTATION OF EQUIPMENT AND CONNECTIONS TO BE INSTALLED. LABEL LOCATIONS PRESENTED MAY VARY DEPENDING ON TYPE OF INTERCONNECTION METHOD AND LOCATION PRESENTED ELECTRICAL DIAGRAM PAGE. \*\*

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

**PROJECT NAME & ADDRESS**

**JEAN BRADLEY  
RESIDENCE**  
  
308 WEST E ST,  
ERWIN, NC 28339

DRAWN BY  
**ESR**

SHEET NAME  
**PLACARD**

SHEET SIZE  
**ANSI B  
11" X 17"**


SHEET NUMBER  
**PV-5**



1-10    11-20    21-30    31-40    41-50    51-60    61-70    71-80    81-90    91-100    101-110    111-120    121-130

1													
2													
3													
4													
5													

# MICRO INVERTER CHART

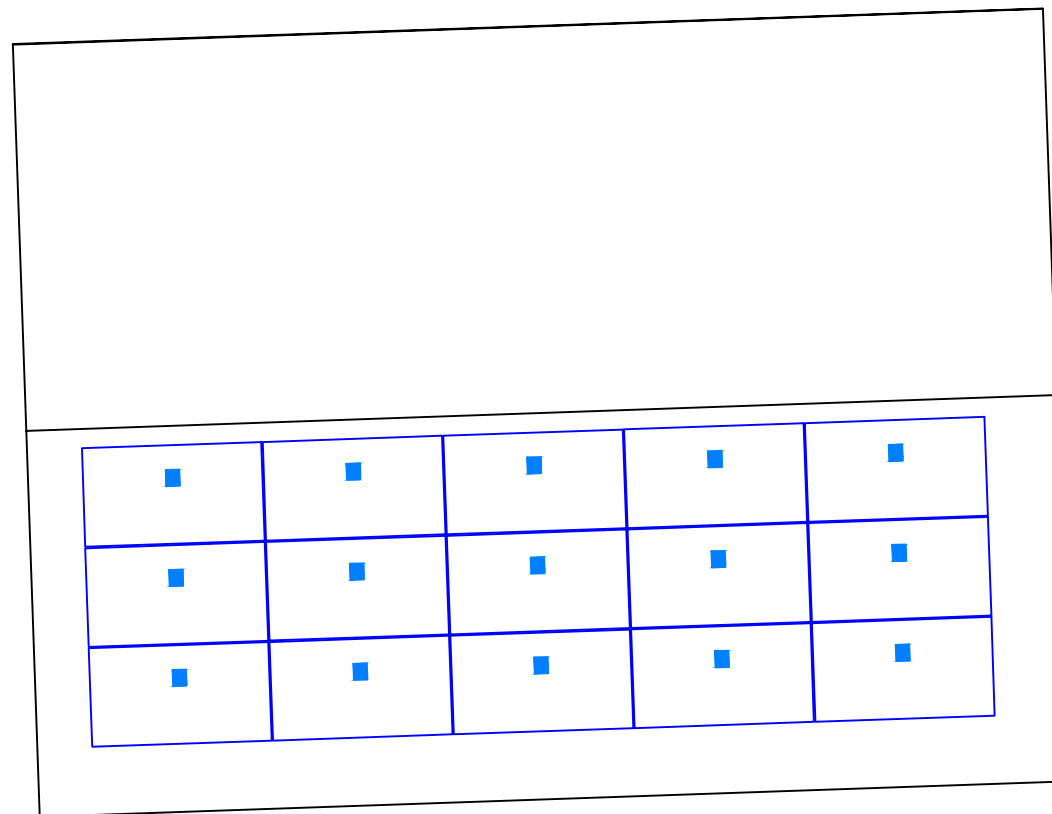

SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

PROJECT NAME & ADDRESS

JEAN BRADLEY  
RESIDENCE  
308 WEST E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME

MICRO INVERTER  
CHART

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-6



# BC Series SIL-320 BL



## 126 Cell Monocrystalline PV Module



**CHUBB\***  
\* Chubb provides error and omission insurance to Silfab Solar Inc.

### INDUSTRY LEADING WARRANTY


All our products include an industry leading 25-year product workmanship and 30-year performance warranty.

### MAXIMUM ENERGY OUTPUT

Silfab BC Series utilizes next generation Back Contact technology to reduce production/manufacturing steps and improve quality while maximizing power. Ideal for residential and commercial projects where maximum power density is preferred.

### NORTH AMERICAN QUALITY

Silfab is the leading automated solar module manufacturer in North America. Utilizing premium quality materials and strict quality control management to deliver the highest efficiency, premium quality PV modules 100% made in North America.

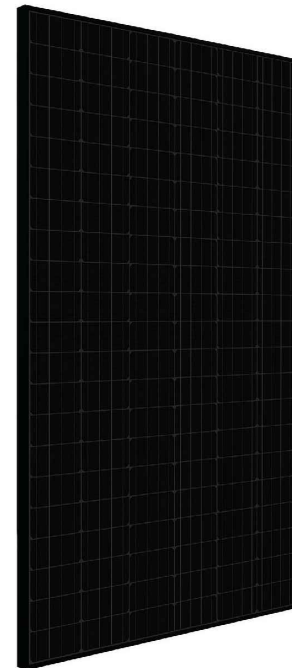

### PROVIDES MAXIMUM EFFICIENCY

126 high-efficiency half-cut cells combined with a black conductive back-sheet resulting in a maximum power rating of 320Wp.

### 35+ YEARS OF SOLAR INNOVATION

Leveraging over 35+ years of worldwide experience in the solar industry, Silfab is dedicated to superior manufacturing processes and innovations such as Bifacial and Back Contact technologies to ensure our partners have the latest in solar innovation.

### BAA / ARRA COMPLIANT

Silfab panels are designed and manufactured to meet Buy American Act Compliance. The US State Department, US Military and FAA have all utilized Silfab panels in their solar installations.

### LIGHT AND DURABLE

Engineered to accommodate low load bearing structures up to 5400Pa. The light-weight frame is exclusively designed for wide-ranging racking compatibility and durability.

### QUALITY MATTERS

Total automation ensures strict quality controls during the entire manufacturing process at our ISO certified facilities.

### DOMESTIC PRODUCTION

Silfab Solar manufactures PV modules in two automated locations within North America. Our 500+ North American team is ready to help our partners win the hearts and minds of customers, providing customer service and product delivery that is direct, efficient and local.

### SUPERIOR POWER

Super power achieved through relocation of tabbing ribbon to reduce shading on module front service and circuit resistance.

### AESTHETICALLY PLEASING

Sleek aesthetics from black cells to black back-sheet without tabbing or bus-bar ribbons, ideal for residential applications.

### STABLE PERFORMANCE

Enhanced life-time performance through reduced thermal stresses and increased current flow paths.

### PID RESISTANT

PID Resistant due to advanced cell technology and material selection. In accordance to IEC 62804-1.

Electrical Specifications	SIL-320 BL mono PERC MWT Technology		
Test Conditions		STC	NOCT
Module Power (Pmax)	Wp	320	239.4
Maximum power voltage (Vpmax)	V	34.36	32.18
Maximum power current (Ipmax)	A	9.32	7.44
Open circuit voltage (Voc)	V	42.04	39.5
Short circuit current (Isc)	A	9.77	7.88
Module efficiency	%	18.84	17.60
Maximum system voltage (VDC)	V		1000
Series fuse rating	A		20
Power Tolerance	Wp		0 to +10

Measurement conditions: STC 1000 W/m<sup>2</sup> • AM 1.5 • Temperature 25 °C • NOCT 800 W/m<sup>2</sup> • AM 1.5 • Measurement uncertainty ≤ 3%  
• Sun simulator calibration reference modules from Fraunhofer Institute. Electrical characteristics may vary by ±5% and power by 0 to +10W.

Temperature Ratings	SIL-320 BL mono PERC MWT Technology		
Temperature Coefficient Isc	+0.046 %/°C		
Temperature Coefficient Voc	-0.279 %/°C		
Temperature Coefficient Pmax	-0.377 %/°C		
NOCT (± 2°C)	43.5 °C		
Operating temperature	-40/+85 °C		

Mechanical Properties and Components	SIL-320 BL mono PERC MWT Technology	
	Metric	Imperial
Module weight	18.2 kg	40.1±0.4 lbs
Dimensions (H x L x D)	1700 mm x 1000 mm x 38 mm	66.9 in x 39.4 in x 1.5 in
Maximum surface load (wind/snow)*	4000 Pa rear load / 5400 Pa front load	83.5/112.8 lb/ft <sup>2</sup>
Hail impact resistance	Ø 25 mm at 83 km/h	Ø 1 in at 51.6 mph
Cells	126 high-efficiency half-cut mono-PERC MWT c-Si cells	126 high-efficiency half-cut mono-PERC MWT c-Si cells
Glass	3.2 mm high transmittance, tempered, DSM anti-reflective coating	0.126 in high transmittance, tempered, DSM anti-reflective coating
Cables and connectors (refer to installation manual)	1000 mm Ø 5.7 mm, MC4 compatible	39.4 in, Ø 0.22 in, MC4 compatible
Backsheet	Multilayer, integrated insulation film and electrically conductive backsheet	
Frame	Anodized Aluminum (Black)	
Bypass diodes	3 diodes-30SQ045T (45V max DC blocking voltage, 30A max forward rectified current)	
Junction Box	UL 3730 Certified, IP67 rated	

Warranties	SIL-320 BL mono PERC MWT Technology			
Module product workmanship warranty	25 years**			
Linear power performance guarantee	30 years			
	≥ 97% end 1 <sup>st</sup> year	≥ 90% end 12 <sup>th</sup> year	≥ 82% end 25 <sup>th</sup> year	≥ 80% end 30 <sup>th</sup> year


Certifications	SIL-320 BL mono PERC MWT Technology	
Product	ULC ORD C1703, UL 1703, CEC listed. Product durability proven up to 3 x IEC, climate chamber tests up to DH3000-TC600-HF30, UL Fire Rating: Type 1	
Factory	ISO9001:2015	

■ Modules Per Pallet: 26  
■ Pallets Per Truck: 36  
■ Modules Per Truck: 936  
\*Please refer to the Safety and Installation Manual for mounting specifications.  
\*\*12 year extendable to 25 years subject to registration and conditions outlined under "Warranty" at [www.silfabsolar.com](http://www.silfabsolar.com).  
\* ⚠ Warning: Read the installation and User Manual before handling, installing and operating modules.  
Third-party generated pan files from Fraunhofer-Institute for Solar Energy Systems ISE are available for download at: [www.silfabsolar.com/downloads](http://www.silfabsolar.com/downloads)



Silfab Solar Inc.  
240 Courtneypark Drive East  
Mississauga ON L5T 2Y3 Canada  
Tel +1 905-255-2501 | Fax +1 905-696-0267  
[info@silfabsolar.com](mailto:info@silfabsolar.com) | [www.silfabsolar.com](http://www.silfabsolar.com)

Silfab Solar Inc.  
800 Cornwall Ave  
Bellingham WA 98225 USA  
Tel +1 360-569-4733

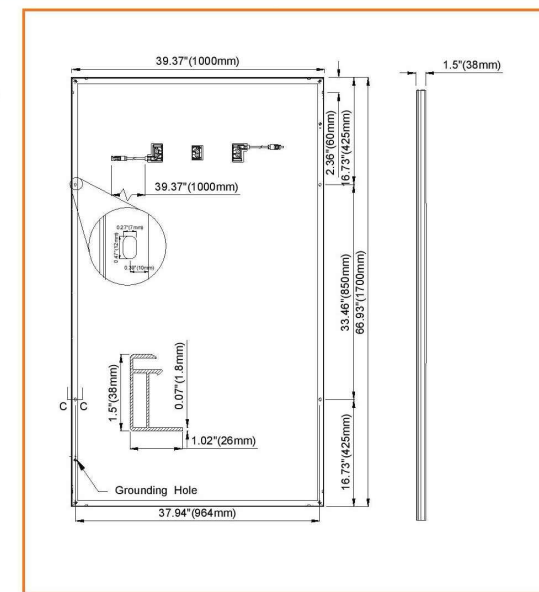

Silfab-SIL-320-BL-20200309 - No reproduction of any kind is allowed. Data and information is subject to modifications without notice. ©Silfab, 2020.



SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

### PROJECT NAME & ADDRESS

**JEAN BRADLEY  
RESIDENCE**  
**308 WEST E ST,  
ERWIN, NC 28339**

### DRAWN BY

**ESR**

### SHEET NAME

**EQUIPMENT  
SPECIFICATION**

### SHEET SIZE

**ANSI B  
11" X 17"**

### SHEET NUMBER

**PV-7**



## Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready **Enphase IQ 7 Micro™** and **Enphase IQ 7+ Micro™** dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate with the Enphase IQ Envoy™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.

### Easy to Install

- Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

### Productive and Reliable

- Optimized for high powered 60-cell and 72-cell\* modules
- More than a million hours of testing
- Class II double-insulated enclosure
- UL listed

### Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

\*The IQ 7+ Micro is required to support 72-cell modules.



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2-US	
Commonly used module pairings <sup>1</sup>	235 W - 350 W +		235 W - 440 W +	
Module compatibility	60-cell PV modules only		60-cell and 72-cell PV modules	
Maximum input DC voltage	48 V		60 V	
Peak power tracking voltage	27 V - 37 V		27 V - 45 V	
Operating range	16 V - 48 V		16 V - 60 V	
Min/Max start voltage	22 V / 48 V		22 V / 60 V	
Max DC short circuit current (module Isc)	15 A		15 A	
Overvoltage class DC port	II		II	
DC port backfeed current	0 A		0 A	
PV array configuration	1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit			
OUTPUT DATA (AC)	IQ 7 Microinverter		IQ 7+ Microinverter	
Peak output power	250 VA		295 VA	
Maximum continuous output power	240 VA		290 VA	
Nominal (L-L) voltage/range <sup>2</sup>	240 V / 211-264 V	208 V / 183-229 V	240 V / 211-264 V	208 V / 183-229 V
Maximum continuous output current	1.0 A (240 V)	1.15 A (208 V)	1.21 A (240 V)	1.39 A (208 V)
Nominal frequency	60 Hz		60 Hz	
Extended frequency range	47 - 68 Hz		47 - 68 Hz	
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms	
Maximum units per 20 A (L-L) branch circuit <sup>3</sup>	16 (240 VAC)	13 (208 VAC)	13 (240 VAC)	11 (208 VAC)
Overvoltage class AC port	III		III	
AC port backfeed current	0 A		0 A	
Power factor setting	1.0		1.0	
Power factor (adjustable)	0.85 leading ... 0.85 lagging		0.85 leading ... 0.85 lagging	
EFFICIENCY	@240 V	@208 V	@240 V	@208 V
Peak efficiency	97.6 %	97.6 %	97.5 %	97.3 %
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %
MECHANICAL DATA				
Ambient temperature range	-40°C to +65°C			
Relative humidity range	4% to 100% (condensing)			
Connector type (IQ7-60-2-US & IQ7PLUS-72-2-US)	MC4 (or Amphenol H4 UTX with additional Q-DCC-5 adapter)			
Dimensions (WxHxD)	212 mm x 175 mm x 30.2 mm (without bracket)			
Weight	1.08 kg (2.38 lbs)			
Cooling	Natural convection - No fans			
Approved for wet locations	Yes			
Pollution degree	PD3			
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure			
Environmental category / UV exposure rating	NEMA Type 6 / outdoor			
FEATURES				
Communication	Power Line Communication (PLC)			
Monitoring	Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy.			
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.			
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.			

1. No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>  
 2. Nominal voltage range can be extended beyond nominal if required by the utility.  
 3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2019 Enphase Energy. All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc. 2019-3-26



SIGORA SOLAR LLC  
 490 WESTFIELD RD STE A  
 CHARLOTTEVILLE, VA 22901

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

### PROJECT NAME & ADDRESS

JEAN BRADLEY  
 RESIDENCE  
 308 WEST E ST,  
 ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME  
 EQUIPMENT  
 SPECIFICATION

SHEET SIZE

ANSI B  
 11" X 17"

SHEET NUMBER

PV-8



# Enphase IQ Combiner 3 (X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.



### Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring

### Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

### Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year warranty
- UL listed



To learn more about Enphase offerings, visit [enphase.com](http://enphase.com)



## Enphase IQ Combiner 3

### MODEL NUMBER

IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
------------------------------	--

### ACCESSORIES and REPLACEMENT PARTS (not included, order separately)

Enphase Mobile Connect™ CELLMODEM-03 (4G / 12-year data plan) CELLMODEM-01 (3G / 5-year data plan) CELLMODEM-M1 (4G based LTE-M / 5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity 2
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3

### ELECTRICAL SPECIFICATIONS

Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy

### MECHANICAL DATA

Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	<ul style="list-style-type: none"> <li>• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors</li> <li>• 60 A breaker branch input: 4 to 1/0 AWG copper conductors</li> <li>• Main lug combined output: 10 to 2/0 AWG copper conductors</li> <li>• Neutral and ground: 14 to 1/0 copper conductors</li> </ul> Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)

### INTERNET CONNECTION OPTIONS

Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M) (not included)

### COMPLIANCE

Compliance, Combiner	UL 1741 CAN/CSA C22.2 No. 107.1 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1

\* Consumption monitoring is required for Enphase Storage Systems.

To learn more about Enphase offerings, visit [enphase.com](http://enphase.com)

© 2018 Enphase Energy. All rights reserved. All trademarks or brands in this document are registered by their respective owner.  
2018-09-13



SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

### PROJECT NAME & ADDRESS

JEAN BRADLEY  
RESIDENCE  
308 WEST E ST,  
ERWIN, NC 28339

### DRAWN BY

ESR

### SHEET NAME

EQUIPMENT  
SPECIFICATION

### SHEET SIZE


ANSI B  
11" X 17"

### SHEET NUMBER

PV-9



# CrossRail System

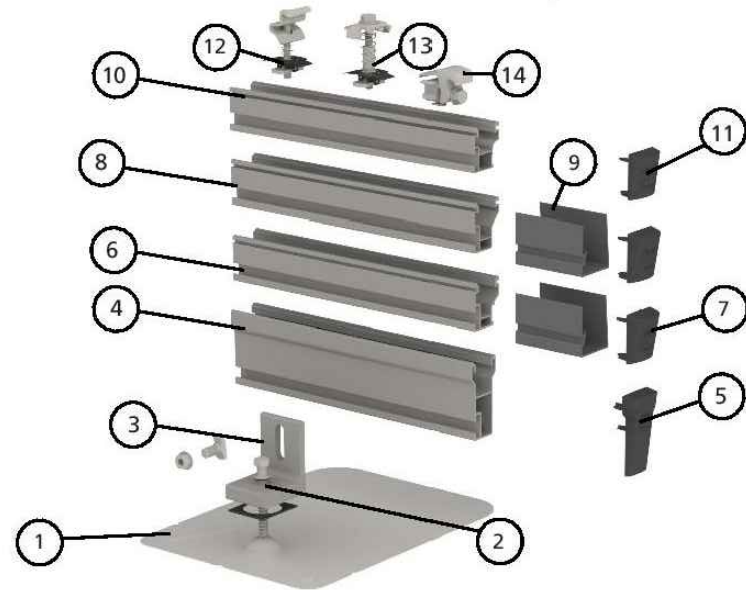

Item No.	Description	Part No.
1	EverFlash XP Comp Kit, Mill or Dark	4000060, 4000061, 4000057
2	Lag Bolt D145/16 x 4" SS	4000359
3	L-Foot XP Set, Mill or Dark	4000036, 4000038
4	CrossRail 80 168" Rail, Mill	4000508
5	CrossRail 80 End Cap, Black	4001221
6	CrossRail 48-XL 166", Mill or Dark	4000695, 4000705
7	CrossRail 48-X/48-XL End Cap or Flat End Cap	4000433, 4000431
8	CrossRail 48-X 166" or 180", Mill or Dark	4000662, 4000675, 4000663
9	CrossRail 48-X/48-XL 3" Sleeve	4000583
10	CrossRail 44-X 166", Mill or Dark	4000019, 4000020
11	CrossRail 44-X End Cap	4000067
12	CR Mid Clamp Silver or Dark	4000601-H, 4000602-H
13	CR End Clamp Silver or Dark	4000429, 4000430
14	Yeti Clamp (Hidden End Clamp)	40000050-H

www.everest-solarsystems.com

## CrossRail 44-X




### Mechanical Properties

	CrossRail 44-X
Material	6000 Series Aluminum
Ultimate Tensile Strength	37.7 ksi (260 MPa)
Yield Strength	34.8 ksi (240 MPa)
Weight	0.47 lbs/ft (0.699 kg/m)
Finish	Mill or Dark Anodized

### Section Properties

	CrossRail 44-X
Sx	0.1490 in <sup>3</sup> (0.3785 cm <sup>3</sup> )
Sy	0.1450 in <sup>3</sup> (0.3683 cm <sup>3</sup> )
A (X-Section)	0.4050 in <sup>2</sup> (1.0287 cm <sup>2</sup> )

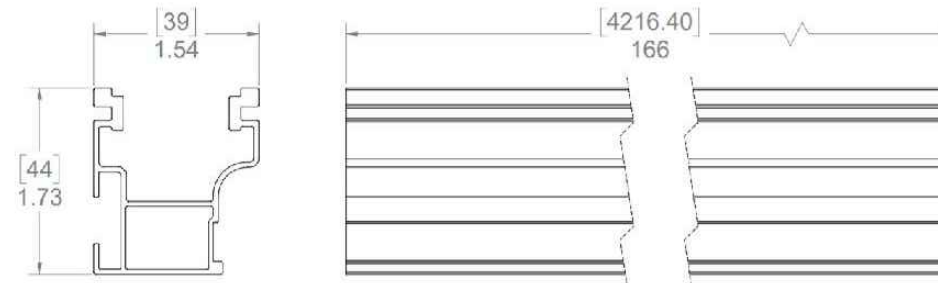

Dimensions in [mm] Inches

#### Notes:

- Structural values and span charts determined in accordance with Aluminum Design Manual and ASCE 7-16
- UL2703 Listed System for Fire and Bonding

www.everest-solarsystems.com



SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

#### REVISIONS

DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

#### PROJECT NAME & ADDRESS

JEAN BRADLEY  
RESIDENCE  
308 WEST E ST,  
ERWIN, NC 28339

#### DRAWN BY

ESR

#### SHEET NAME

EQUIPMENT  
SPECIFICATION

#### SHEET SIZE

ANSI B  
11" X 17"

#### SHEET NUMBER

PV-10






# EverFlash XP Comp



Part Number	Description
4000057	EverFlash XP Kit, Mill LF, Dark Flash
4000060	EverFlash XP Comp Kit, Dark
4000061	EverFlash XP Comp Kit, Mill

- ▶ Everest's very own comp shingle flashing and mount!
- ▶ Best in class - 3 stages of waterproofing
- ▶ All CrossRail hardware included and preassembled
- ▶ UL 441 Section 27 Rain test
- ▶ TAS 100-95 Wind driven rain test

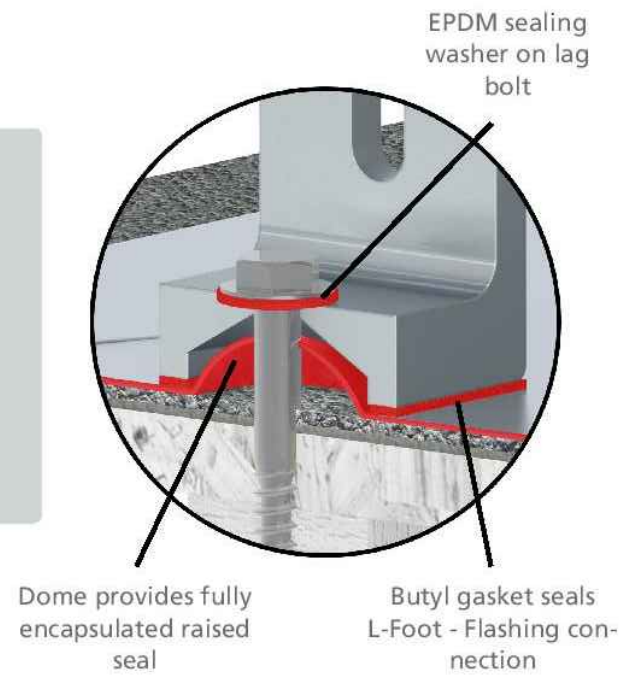

[www.everest-solarsystems.com](http://www.everest-solarsystems.com)

EverFlash XP Comp Product Sheet US02 | 1019 · Subject to change · Product illustrations are exemplary and may differ from the original.



SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

### PROJECT NAME & ADDRESS

**JEAN BRADLEY  
RESIDENCE**  
  
308 WEST E ST,  
ERWIN, NC 28339

DRAWN BY

**ESR**

SHEET NAME

**EQUIPMENT  
SPECIFICATION**

SHEET SIZE

**ANSI B  
11" X 17"**

SHEET NUMBER

**PV-11**



# SolaDeck

FLASHED PV ROOF-MOUNT COMBINER/ENCLOSURE



SolaDeck Model SD 0783

### Basic Features

- Stamped Seamless Construction
- 18 Gauge Galvanized Steel
- Powder Coated Surfaces
- Flashes into the roof deck
- 3 Roof deck knockouts .5", .75", 1"
- 5 Centering dimples for entry/exit fittings or conduit
- 2 Position Ground lug installed
- Mounting Hardware Included



### SolaDeck UL50 Type 3R Enclosures

Available Models:

- Model SD 0783 - (3" fixed Din Rail)
- Model SD 0786 - (6" slotted Din Rail)



### SolaDeck UL 1741 Combiner/Enclosures

Models SD 0783-41 and SD 0786-41 are labeled and ETL listed UL STD 1741 according to the UL STD 1741 for photovoltaic combiner enclosures.

Max Rated - 600VDC, 120AMPS

**Model SD 0783-41** 3" Fixed Din Rail fastened using Norlock System

**\*\*Typical System Configuration**

- 4- Din Rail Mounted Fuse Holders 600VDC 30 AMP
- 1- Power Distribution Block 600VDC 175AMP
- 1- Bus Bar with UL lug

**Model SD 0786-41** 6" Slotted Din Rail fastened using steel studs

**\*\*Typical System Configuration**

- 4- Din Rail Mounted Fuse Holders 600VDC 30 AMP
- 4- Din Rail Mounted Terminal Blocks
- Bus Bars with UL lug

\*\*Fuse holders and terminal blocks added in the field must be UL listed or recognized and meet 600 VDC 30 AMP 110C for fuse holders, 600V 50 AMP 90C for rail mounted terminal blocks and 600 V 175 AMP 90C for Power Distribution Blocks. Use Copper Wire Conductors.



Cover is trimmed to allow conduit or fittings, base is center dimpled for fitting locations.



Model SD 0783-41, wired with Din Rail mounted fuse holders, bus bar and power distribution block.



Model SD 0786-41, wired with Din Rail mounted fuse holders, terminal blocks and bus bars.

### GENERAL GUIDELINES

- Always refer to roofing manufacturer's instructions prior to starting work.
- Refer to the American Wood Council's guidelines for Lag pull-out capacities (NDS 2005, Table 11.2A).
- Everest Solar recommends consulting a professional roofer prior to beginning work.
- Installer is responsible for verifying the structural integrity of the roof prior to installation.

### ASSEMBLY: STEP BY STEP



1 of 5

Locate the rafters and snap horizontal and vertical lines to mark the installation position for each EverFlash flashing.

Materials required: Tape measure, string line



2 of 5

Drill a pilot hole (1/4" diameter) for the lag bolt. Remove any saw dust and fill the hole with the roofing manufacturer's recommended sealant.


Materials required: Drill



3 of 5

Insert the flashing so the top part is under the next row of shingles and pushed far enough up slope to prevent water infiltration through vertical joint in shingles. The leading edge of flashing must butt against upper row of nails to prevent turning when torqued.

Materials required: EverFlash flashing



4 of 5

Line up pilot hole with EverFlash flashing hole. Insert the lag bolt through the EPDM bonded washer, the L-Foot, the gasketed hole in the flashing and into the rafter.



5 of 5

Torque: The range is between 8.3 - 11.6 lb-ft depending on the type of wood and time of year. The visual indicator for proper torque is when the EPDM on the underside of the bonded washer begins to push out the sides as the washer compresses. If using an impact wrench to install the fasteners be careful not to over torque the fastener. You may need to stop and use a ratchet to finish the install.



Ready!

Install Everest Mounting System (refer to CrossRail 48/80 installation manual)

The EverFlash is simple and fast to install. Please contact us for further assistance:

**SERVICE-HOTLINE + 1 760.301.5300**

Everest Solar Systems, LLC  
3809 Ocean Ranch Blvd., Suite 111  
Oceanside, CA 92056  
Service-Hotline +1.760.301.5300  
info@everest-solarsystems.com  
www.everest-solarsystems.com

EverFlash Technical Flyer | L51-0015  
Product images are for illustrative purposes only. Specifications are subject to change without notice. All products are UL listed. © 2015 Everest Solar Systems, LLC. All rights reserved.



SIGORA SOLAR LLC  
490 WESTFIELD RD STE A  
CHARLOTTEVILLE, VA 22901

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL	08/06/2020	

DATE:08/06/2020

### PROJECT NAME & ADDRESS

JEAN BRADLEY  
RESIDENCE  
308 WEST E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-12

RSTC Enterprises, Inc • 2219 Heimstead Road • Eau Claire, WI 54703  
For product information call 1(866) 367-7782