


SolaDeck

FLASHED PV ROOF-MOUNT COMBINER/ENCLOSURE

SolaDeck Model 0783-41

ETL Listed UL STD 1741
Combiner/Enclosure


Shown 4 Strings with UL Recognized
Fuse Holders for PV Positive
Power Block for PV Negative
Fuses combined with positive Bus Bar
PV negative combined with power block

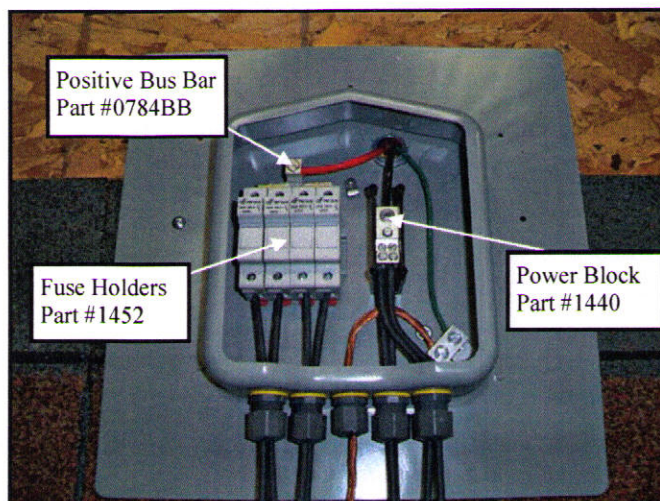

SolaDeck Model 0786

ETL Listed UL 50 Type 3R
Rain tight enclosure for outdoor use.


Shown with ER 6 Terminal blocks
Transition outdoor wire to THWN wire.
ER 6 Terminal block used for positive
And negative.

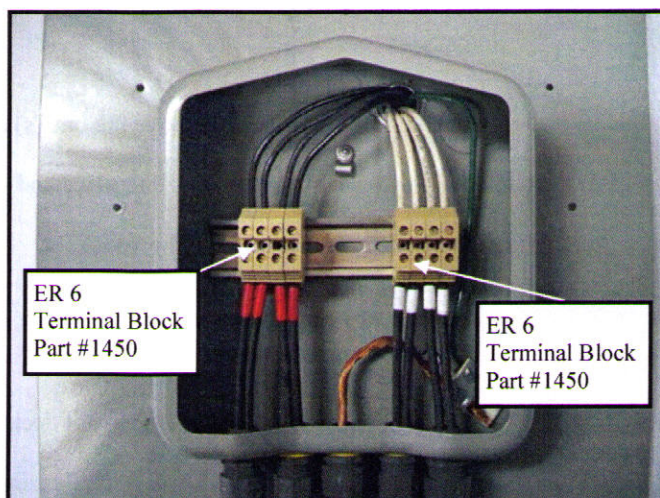

SolaDeck Model 0786-41

ETL Listed UL STD 1741
Combiner/Enclosure

Shown 4 Strings with UL Recognized
Fuse Holders for PV Positive
ER 10 Terminal blocks for PV negative
Fuses combined with positive Bus bar
ER 10 Terminal blocks combined using
Negative Bus Bar

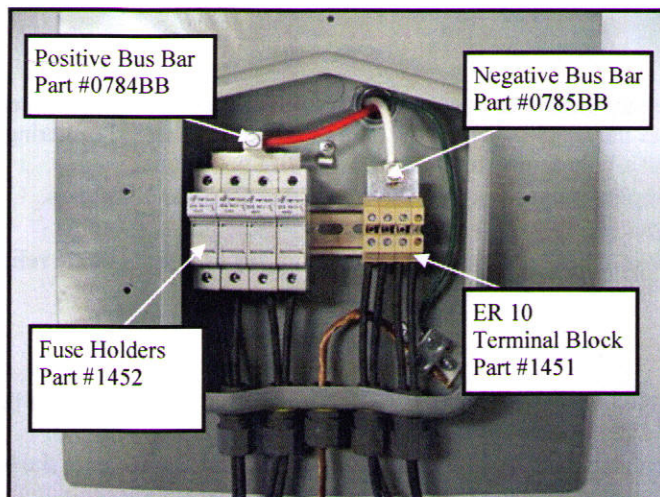

For more information call (866) 367-7782
or simply request more info at sales@commdeck.com

www.COMMDECK.com