



LEADING THE WAY
Structural Engineering Firm
NC License No. C-2499

168 Quade Drive
Cary, North Carolina 27513
www.rbengineering.com

Phone: 919-677-9662 / Cell: 919-280-2695 / Fax: 919-677-9663

E-mail: rbittler@rbengineering.com

Mr. Max Middleton

October 9, 2020

Yes! Solar Solutions of the Triangle

E-mail: mmiddleton@yessolarsolutions.com

Subject: Proposed roof solar panels – Dawkins Residence
5267 NC 27 E
Coats, North Carolina 27521

File No.: RB-206550

Dear Max:

RB Engineering, Inc. is pleased to provide the following summary engineering letter concerning the subject project. The roof system is constructed with timber trusses at 24 inches on center, an OSB roof deck and a composition asphalt shingle roof. We have reviewed the proposed solar layout and have structurally evaluated the additional proposed roof loading with the following conclusions:

- The total surface area of the new proposed solar array (43 PV modules) is approximately 780 SF. The solar panel installation has been evaluated for an ultimate design wind speed of 115 mph.
- The subject roof mounted PV system attachment method is structurally adequate to transfer the design uplift loads in accordance with the current North Carolina residential building code.
- The existing roof system is structurally adequate to transfer the applicable design loads - including the additional or modified design loading (dead, wind and snow loads) due to the proposed solar panel installation - in accordance with the current North Carolina residential building code.

Our services were provided in accordance with the standard of practice for structural engineering and within the limits imposed by scope, schedule, and budget. If you have any questions or if I can be of further assistance to you on this project, please contact me at (919) 677-9662.

Respectfully submitted,

Ron Bittler, PE
President / Structural Engineer
RB Engineering, Inc.

Ron
Bittler,
PE

Digitally signed by Ron
Bittler, PE
DN: cn=Ron Bittler, PE,
o=RB Engineering, Inc.,
ou,
email=rbittler@rbengine
ering.com, c=US
Date: 2020.10.09 14:28:22
-04'00'



GENERAL NOTES

- 1.1.1 **PROJECT NOTES:**
- 1.1.2 THIS PHOTOVOLTAIC (PV) SYSTEM SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE (NEC) ARTICLE 690, ALL MANUFACTURERS'S LISTING AND INSTALLATION INSTRUCTIONS, AND THE RELEVANT CODES AS SPECIFIED BY THE AUTHORITY HAVING JURISDICTION'S (AHJ) APPLICABLE CODES.
- 1.1.3 THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION
- 1.1.4 ALL PV SYSTEM COMPONENTS; MODULES, UTILITY-INTERACTIVE INVERTERS, AND SOURCE CIRCUIT COMBINER BOXES ARE IDENTIFIED AND LISTED FOR USE IN PHOTOVOLTAIC SYSTEMS AS REQUIRED BY NEC 690.4: **PV MODULES:** UL1703, IEC61730, AND IEC61215, AND NFPA 70 CLASS C FIRE **INVERTERS:** UL 1741 CERTIFIED, IEEE 1547, 929, 519 **COMBINER BOX(ES):** UL 1703 OR UL 1741 ACCESSORY
- 1.1.5 MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC. IF UNAVAILABLE, MAX DC VOLTAGE CALCULATED ACCORDING TO NEC 690.7.
- 1.1.6 ALL INVERTERS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AND SOURCE CIRCUIT COMBINERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (D). SHALL BE INSTALLED ACCORDING TO ANY INSTRUCTIONS FROM LISTING OR LABELING [NEC 110.3].
- 1.1.7 ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.
- 1.2.1 **SCOPE OF WORK:**
- 1.2.2 PRIME CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE GRID-TIED PHOTOVOLTAIC SYSTEM RETROFIT. PRIME CONTRACTOR WILL BE RESPONSIBLE FOR COLLECTING EXISTING ONSITE REQUIREMENTS TO DESIGN, SPECIFY, AND INSTALL THE EXTERIOR ROOF-MOUNTED PORTION OF THE PHOTOVOLTAIC SYSTEMS DETAILED IN THIS DOCUMENT.
- 1.3.1 **WORK INCLUDES:**
- 1.3.2 PV ROOF ATTACHMENTS - SNAP-N-RACK ULTRA RAIL COMP KIT
- 1.3.3 PV RACKING SYSTEM INSTALLATION - SNAPNRACK UR-40
- 1.3.4 PV MODULE AND INVERTER INSTALLATION - REC REC330TP3M / SOLAR EDGE SE11400H-US
- 1.3.5 PV EQUIPMENT GROUNDING
- 1.3.6 PV SYSTEM WIRING TO A ROOF-MOUNTED JUNCTION BOX
- 1.3.7 PV LOAD CENTERS (IF INCLUDED)
- 1.3.8 PV METERING/MONITORING (IF INCLUDED)
- 1.3.9 PV DISCONNECTS
- 1.3.10 PV FINAL COMMISSIONING
- 1.3.11 (E) ELECTRICAL EQUIPMENT RETROFIT FOR PV
- 1.3.12 SIGNAGE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE

SCOPE OF WORK

SYSTEM SIZE: STC: 43 x 330W = 14.190kW
 PTC: 43 x 308.8W = 13.278kW
 (43) REC REC330TP3M
 (1) SOLAR EDGE SE11400H-US (240V)
 (1) TESLA BACKUP GATEWAY 2
 (2) TESLA POWERWALL 2 AC

ATTACHMENT TYPE: SNAP-N-RACK ULTRA RAIL COMP KIT

MSP UPGRADE: NO

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
 COATS, NC 27521


ASSESSOR'S #: 1600-26-8872.000



01

AERIAL PHOTO


NOT TO SCALE

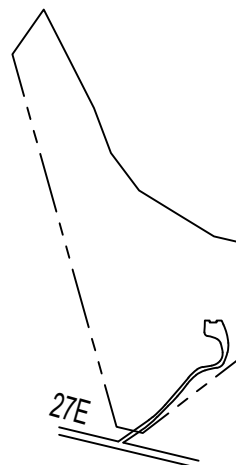

02

PLAT MAP

NOT TO SCALE



SHEET LIST TABLE

SHEET NUMBER	SHEET TITLE
T-001	COVER PAGE
G-001	NOTES
A-101	SITE PLAN
A-102	ELECTRICAL PLAN
A-103	SOLAR ATTACHMENT PLAN
E-601	LINE DIAGRAM
E-602	DESIGN TABLES
E-603	PLACARDS
S-501	ASSEMBLY DETAILS
R-001	RESOURCE DOCUMENT
R-002	RESOURCE DOCUMENT
R-003	RESOURCE DOCUMENT
R-004	RESOURCE DOCUMENT
R-005	RESOURCE DOCUMENT
R-006	RESOURCE DOCUMENT
R-007	RESOURCE DOCUMENT
R-008	RESOURCE DOCUMENT

PROJECT INFORMATION

OWNER

NAME: RAY DAWKINS
 PHONE: 919-413-2250
 E-MAIL: RAY.DAWKINS@ICLOUD.COM

PROJECT MANAGER

NAME: MAXWELL D. MIDDLETON
 PHONE: 9193390453

CONTRACTOR

NAME: YES SOLAR SOLUTIONS
 PHONE: 919-459-2846

AUTHORITIES HAVING JURISDICTION

BUILDING: HARNETT COUNTY
 ZONING: HARNETT COUNTY
 UTILITY: DUKE ENERGY PROGRESS

DESIGN SPECIFICATIONS

OCCUPANCY: II
 CONSTRUCTION: SINGLE-FAMILY
 ZONING: RESIDENTIAL
 GROUND SNOW LOAD: 15 PSF
 WIND EXPOSURE: B
 WIND SPEED: 118 MPH

APPLICABLE CODES & STANDARDS

BUILDING: NCSBC 2018 NCSRC 2018
 ELECTRICAL: NEC 2017
 FIRE: NCSFC 2018



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
 CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
 COATS, NC 27521
 APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

COVER PAGE

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

T-001.00

(SHEET 1)

	A	B	C	D	E	F	G	H
1	2.1.1	SITE NOTES:		2.4.9	THE GROUNDING ELECTRODE SYSTEM COMPLIES WITH CEC 690.47 AND CEC 250.50 THROUGH 250.106. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM PROVIDED ACCORDING TO CEC 250, CEC 690.47 AND AHJ.	2.7.5	PV WIRE BLACK WIRE MAY BE FIELD-MARKED WHITE [CEC 200.6 (A)(6)].	
	2.1.2	A LADDER WILL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.				2.7.6	MODULE WIRING SHALL BE LOCATED AND SECURED UNDER THE ARRAY.	
	2.1.3	THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH STORAGE BATTERIES.		2.4.10	DC PV ARRAYS SHALL BE PROVIDED WITH DC GROUND-FAULT PROTECTION MEETING THE REQUIREMENTS OF 690.41(B)(1) AND (2) TO REDUCE FIRE HAZARDS	2.7.7	ACCORDING TO CEC 200.7, UNGROUNDED SYSTEMS DC CONDUCTORS COLORED OR MARKED AS FOLLOWS: DC POSITIVE- RED, OR OTHER COLOR EXCLUDING WHITE, GREY AND GREEN DC NEGATIVE- BLACK, OR OTHER COLOR EXCLUDING WHITE, GREY AND GREEN	
	2.1.4	THE SOLAR PV INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.						
	2.1.5	PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION CEC 110.26.		2.5.1	INTERCONNECTION NOTES:			
	2.1.6	ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SERVES TO PROTECT THE BUILDING OR STRUCTURE.		2.5.2	LOAD-SIDE INTERCONNECTION SHALL BE IN ACCORDANCE WITH [CEC 705.12 (B)]	2.7.8	AC CONDUCTORS COLORED OR MARKED AS FOLLOWS: PHASE A OR L1- BLACK PHASE B OR L2- RED, OR OTHER CONVENTION IF THREE PHASE PHASE C OR L3- BLUE, YELLOW, ORANGE*, OR OTHER CONVENTION NEUTRAL- WHITE OR GREY	
2	2.2.1	EQUIPMENT LOCATIONS		2.5.3	THE SUM OF THE UTILITY OCPD AND INVERTER CONTINUOUS OUTPUT MAY NOT EXCEED 120% OF BUSBAR RATING [CEC 705.12(B)(2)(3)].			
	2.2.2	ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS AS REQUIRED BY CEC 110.26.		2.5.4	THE SUM OF 125 PERCENT OF THE POWER SOURCE(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR, PV DEDICATED BACKFEED BREAKERS MUST BE LOCATED OPPOSITE END OF THE BUS FROM THE UTILITY SOURCE OCPD [CEC 705.12(B)(2)(3)].			
	2.2.3	WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY CEC 690.31 (A),(C) AND CEC TABLES 310.15 (B)(2)(A) AND 310.15 (B)(3)(C).		2.5.5	AT MULTIPLE ELECTRIC POWER SOURCES OUTPUT COMBINER PANEL, TOTAL RATING OF ALL OVERCURRENT DEVICES SHALL NOT EXCEED AMPACITY OF BUSBAR. HOWEVER, THE COMBINED OVERCURRENT DEVICE MAY BE EXCLUDED ACCORDING TO CEC 705.12 (B)(2)(3)(C).			
	2.2.3	JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES ACCORDING TO CEC 690.34.		2.5.6	FEEDER TAP INTERCONNECTION (LOAD SIDE) ACCORDING TO CEC 705.12 (B)(2)(1)			
	2.2.4	ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT.		2.5.7	SUPPLY SIDE TAP INTERCONNECTION ACCORDING TO CEC 705.12 (A) WITH SERVICE ENTRANCE CONDUCTORS IN ACCORDANCE WITH CEC 230.42			
	2.2.5	ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO CEC APPLICABLE CODES.		2.5.8	BACKFEEDING BREAKER FOR ELECTRIC POWER SOURCES OUTPUT IS EXEMPT FROM ADDITIONAL FASTENING [CEC 705.12 (B)(5)].			
	2.2.6	ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.						
3	2.3.1	STRUCTURAL NOTES:						
	2.3.2	RACKING SYSTEM & PV ARRAY WILL BE INSTALLED ACCORDING TO CODE-COMPLIANT INSTALLATION MANUAL. TOP CLAMPS REQUIRE A DESIGNATED SPACE BETWEEN MODULES, AND RAILS MUST ALSO EXTEND A MINIMUM DISTANCE BEYOND EITHER EDGE OF THE ARRAY/SUBARRAY, ACCORDING TO RAIL MANUFACTURER'S INSTRUCTIONS.		2.6.1	DISCONNECTION AND OVER-CURRENT PROTECTION NOTES:			
	2.3.3	JUNCTION BOX WILL BE INSTALLED PER MANUFACTURERS' SPECIFICATIONS. IF ROOF-PENETRATING TYPE, IT SHALL BE FLASHED & SEALED PER LOCAL REQUIREMENTS.		2.6.2	DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING ENERGIZED ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS).			
	2.3.4	ROOFTOP PENETRATIONS FOR PV RACEWAY WILL BE COMPLETED AND SEALED W/ APPROVED CHEMICAL SEALANT PER CODE BY A LICENSED CONTRACTOR.		2.6.3	DISCONNECTS TO BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH.			
4	2.3.5	ALL PV RELATED ROOF ATTACHMENTS TO BE SPACED NO GREATER THAN THE SPAN DISTANCE SPECIFIED BY THE RACKING MANUFACTURER.		2.6.4	BOTH POSITIVE AND NEGATIVE PV CONDUCTORS ARE UNGROUNDED. THEREFORE BOTH MUST OPEN WHERE A DISCONNECT IS REQUIRED, ACCORDING TO CEC 690.13.			
	2.3.6	WHEN POSSIBLE, ALL PV RELATED RACKING ATTACHMENTS WILL BE STAGGERED AMONGST THE ROOF FRAMING MEMBERS.		2.6.5	ISOLATING DEVICES OR EQUIPMENT DISCONNECTING MEANS SHALL BE INSTALLED IN CIRCUITS CONNECTED TO EQUIPMENT AT A LOCATION WITHIN THE EQUIPMENT, OR WITHIN SIGHT AND WITHIN 10 FT OF THE EQUIPMENT. AN EQUIPMENT DISCONNECTING MEANS SHALL BE PERMITTED TO BE REMOTE FROM THE EQUIPMENT WHERE THE EQUIPMENT DISCONNECTING MEANS CAN BE REMOTELY OPERATED FROM WITHIN 10 FT OF THE EQUIPMENT, ACCORDING TO CEC 690.15 (A).			
	2.4.1	GROUNDING NOTES:		2.6.6	PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION TO REDUCE SHOCK HAZARD FOR EMERGENCY RESPONDERS IN ACCORDANCE WITH 690.12(A) THROUGH (D)			
	2.4.2	GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVICES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR SUCH USE.		2.6.7	ALL OCPD RATINGS AND TYPES SPECIFIED ACCORDING TO CEC 690.8, 690.9, AND 240.			
	2.4.3	PV SYSTEMS REQUIRE AN EQUIPMENT GROUNDING CONDUCTOR. ALL METAL ELECTRICAL EQUIPMENT AND STRUCTURAL COMPONENTS BONDED TO GROUND, IN ACCORDANCE WITH 250.134 OR 250.136(A). ONLY THE DC CONDUCTORS ARE UNGROUNDED.		2.6.8	BOTH POSITIVE AND NEGATIVE PV CONDUCTORS ARE UNGROUNDED, THEREFORE BOTH REQUIRE OVER-CURRENT PROTECTION, ACCORDING TO CEC 240.21. (SEE EXCEPTION IN CEC 690.9)			
5	2.4.4	PV EQUIPMENT SHALL BE GROUNDED ACCORDING TO CEC 690.43 AND MINIMUM CEC TABLE 250.122.		2.6.9	IF REQUIRED BY AHJ, SYSTEM WILL INCLUDE ARC-FAULT CIRCUIT PROTECTION ACCORDING TO CEC 690.11 AND UL1699B.			
	2.4.5	METAL PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURE CONSIDERED GROUNDED IN ACCORD WITH 250.134 AND 250.136(A).						
	2.4.6	EACH MODULE WILL BE GROUNDED USING WEEB GROUNDING CLIPS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ. IF WEEBS ARE NOT USED, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE SPECIFIED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS.		2.7.1	WIRING & CONDUIT NOTES:			
	2.4.7	THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.		2.7.2	ALL CONDUIT AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.			
6	2.4.8	GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLORED GREEN OR MARKED GREEN IF #4 AWG OR LARGER [CEC 250.119]		2.7.3	ALL CONDUCTORS SIZED ACCORDING TO CEC 690.8, CEC 690.7.			
				2.7.4	EXPOSED PV SOURCE CIRCUITS AND OUTPUT CIRCUITS SHALL USE WIRE LISTED AND IDENTIFIED AS PHOTOVOLTAIC (PV) WIRE [690.31 (C)]. PV MODULES WIRE LEADS SHALL BE LISTED FOR USE ON PV ARRAYS, ACCORDING TO CEC 690.31 (A).			



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846
ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356
HIC. NO.:
ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

**DAWKINS
RESIDENCE**

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

NOTES

DATE: 10.08.2020
DESIGN BY: V.H.
CHECKED BY: M.M.

REVISIONS

G-001.00
(SHEET 2)

GENERAL NOTES

1. FIELD VERIFY ALL MEASUREMENTS
2. ITEMS BELOW MAY NOT BE ON THIS PAGE

----- PROPERTY LINE



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

SITE PLAN

DATE: 10.08.2020


DESIGN BY: V.H.

CHECKED BY: M.M.


REVISIONS


A-101.00

(SHEET 3)

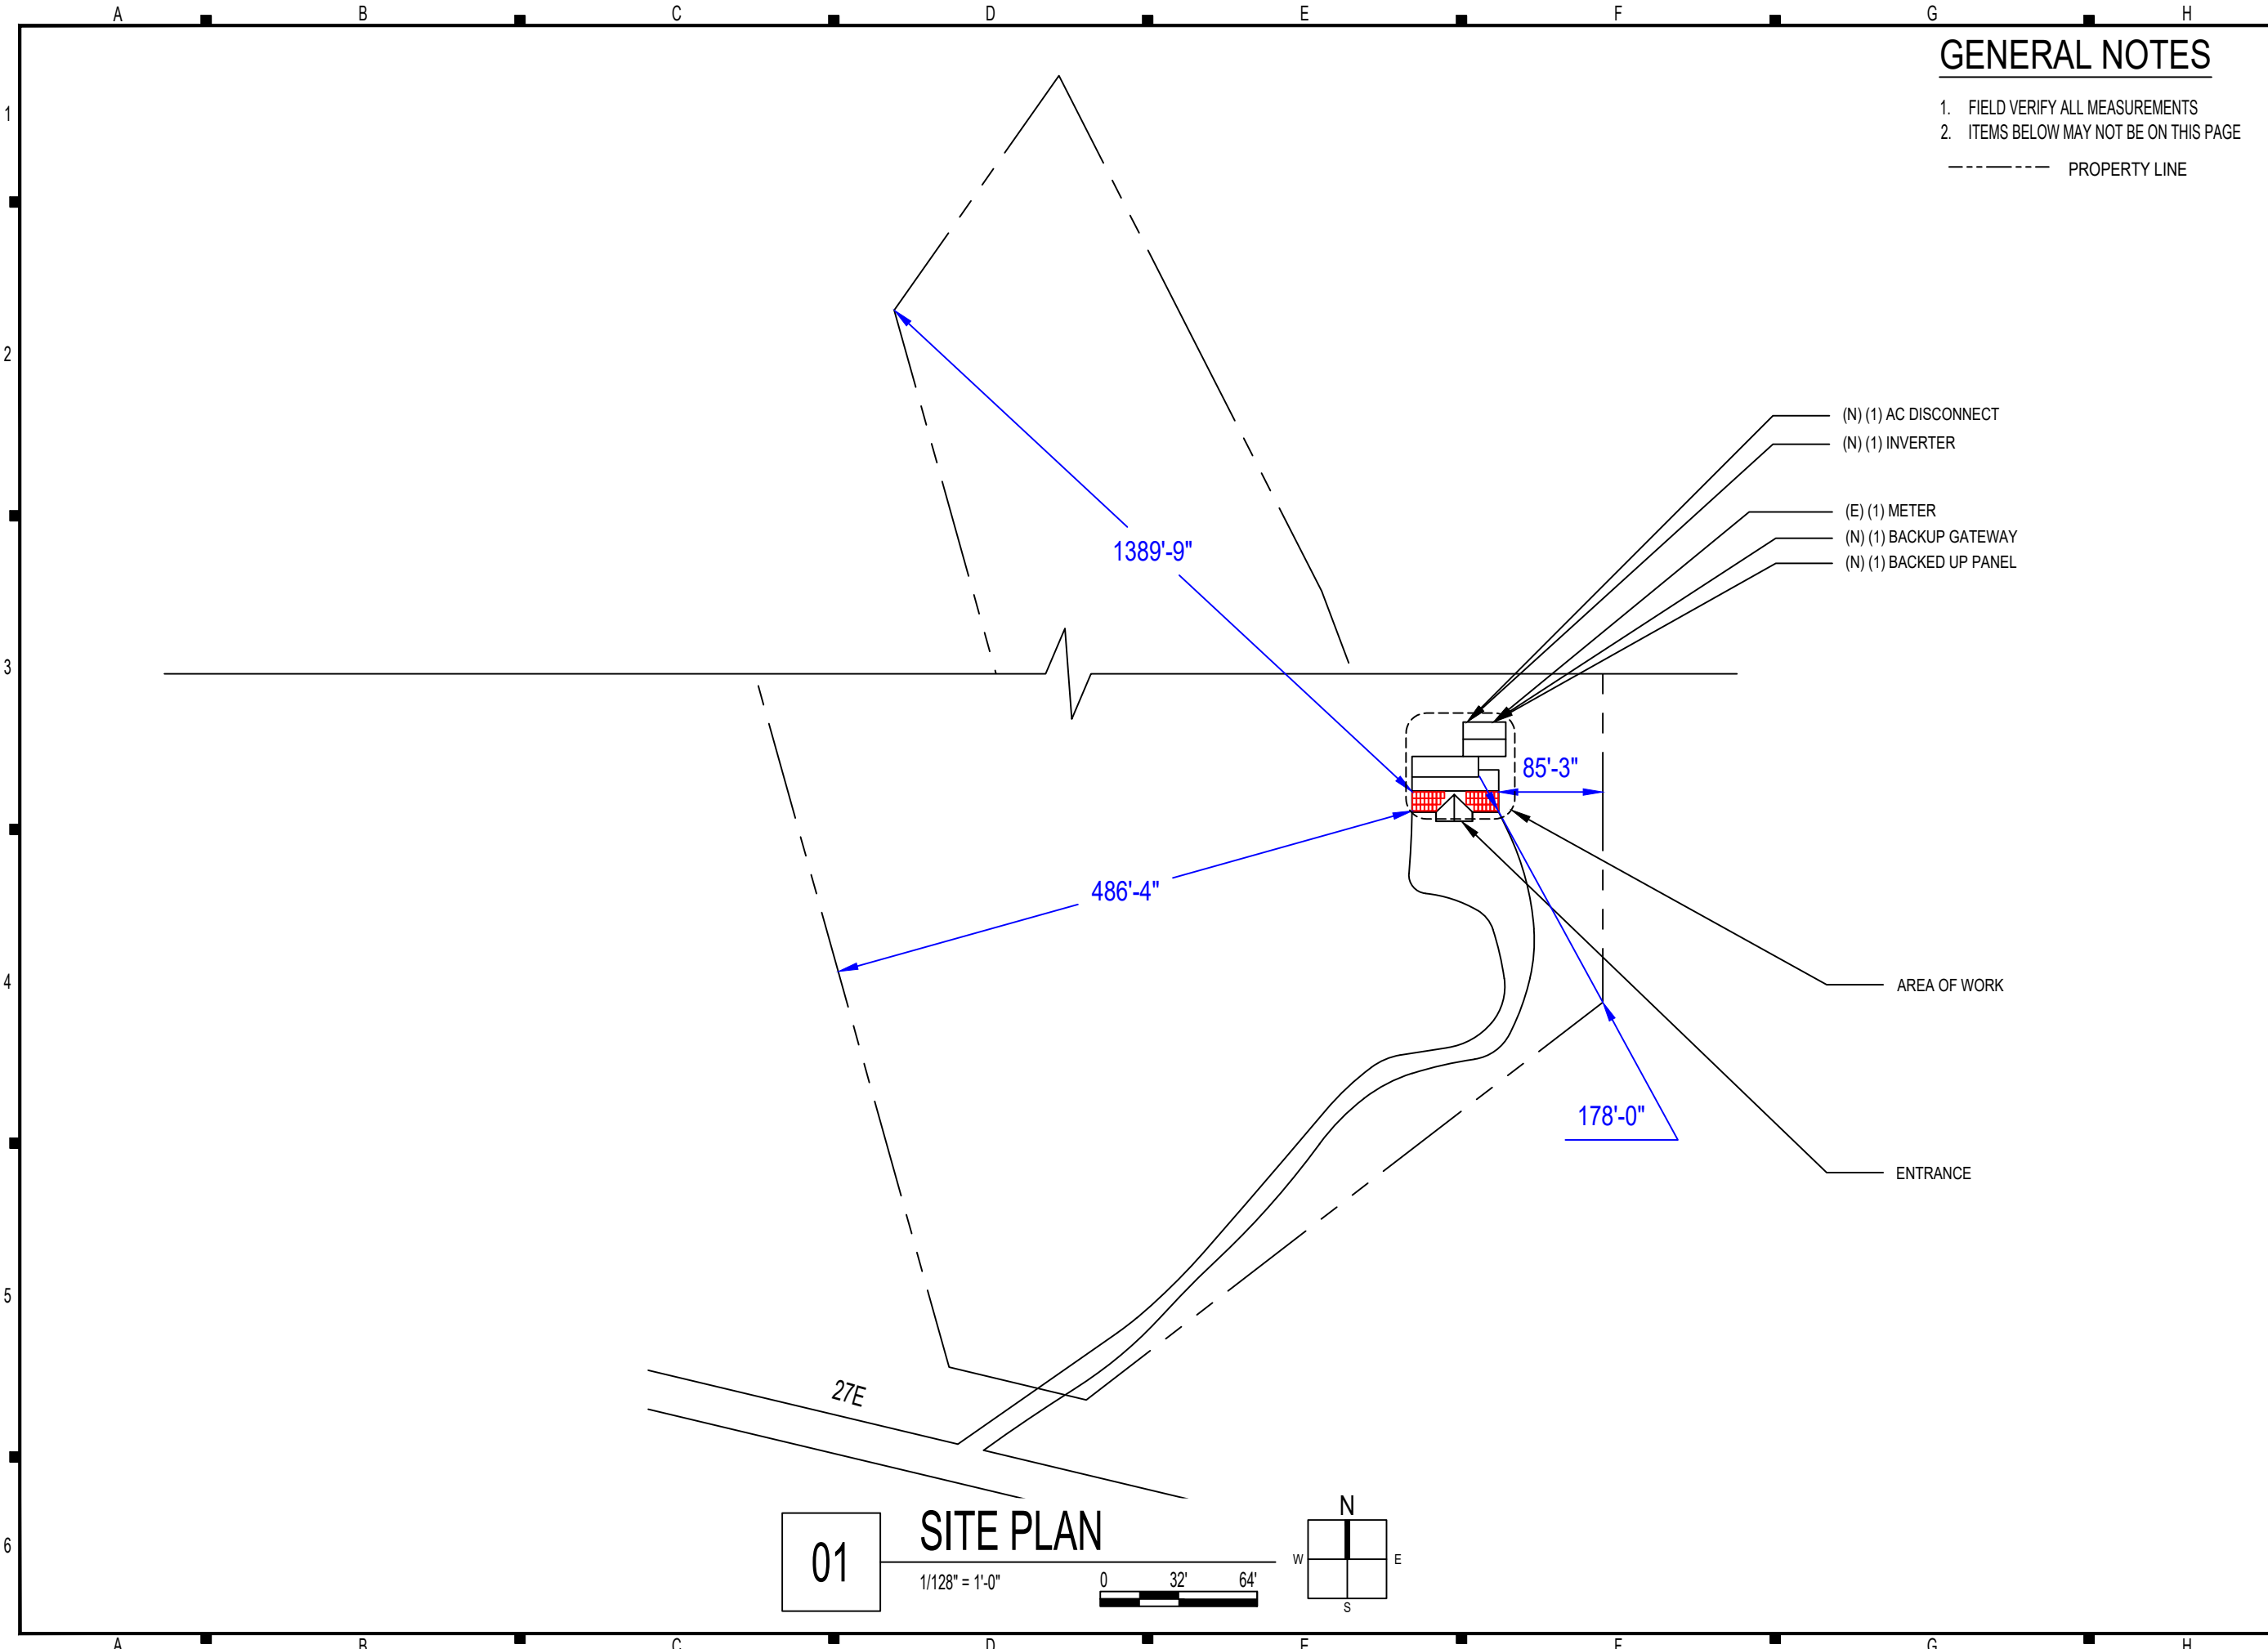

01 **SITE PLAN**
1/128" = 1'-0"

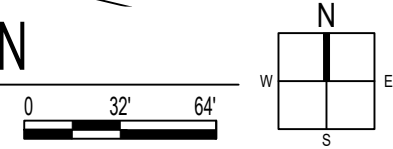

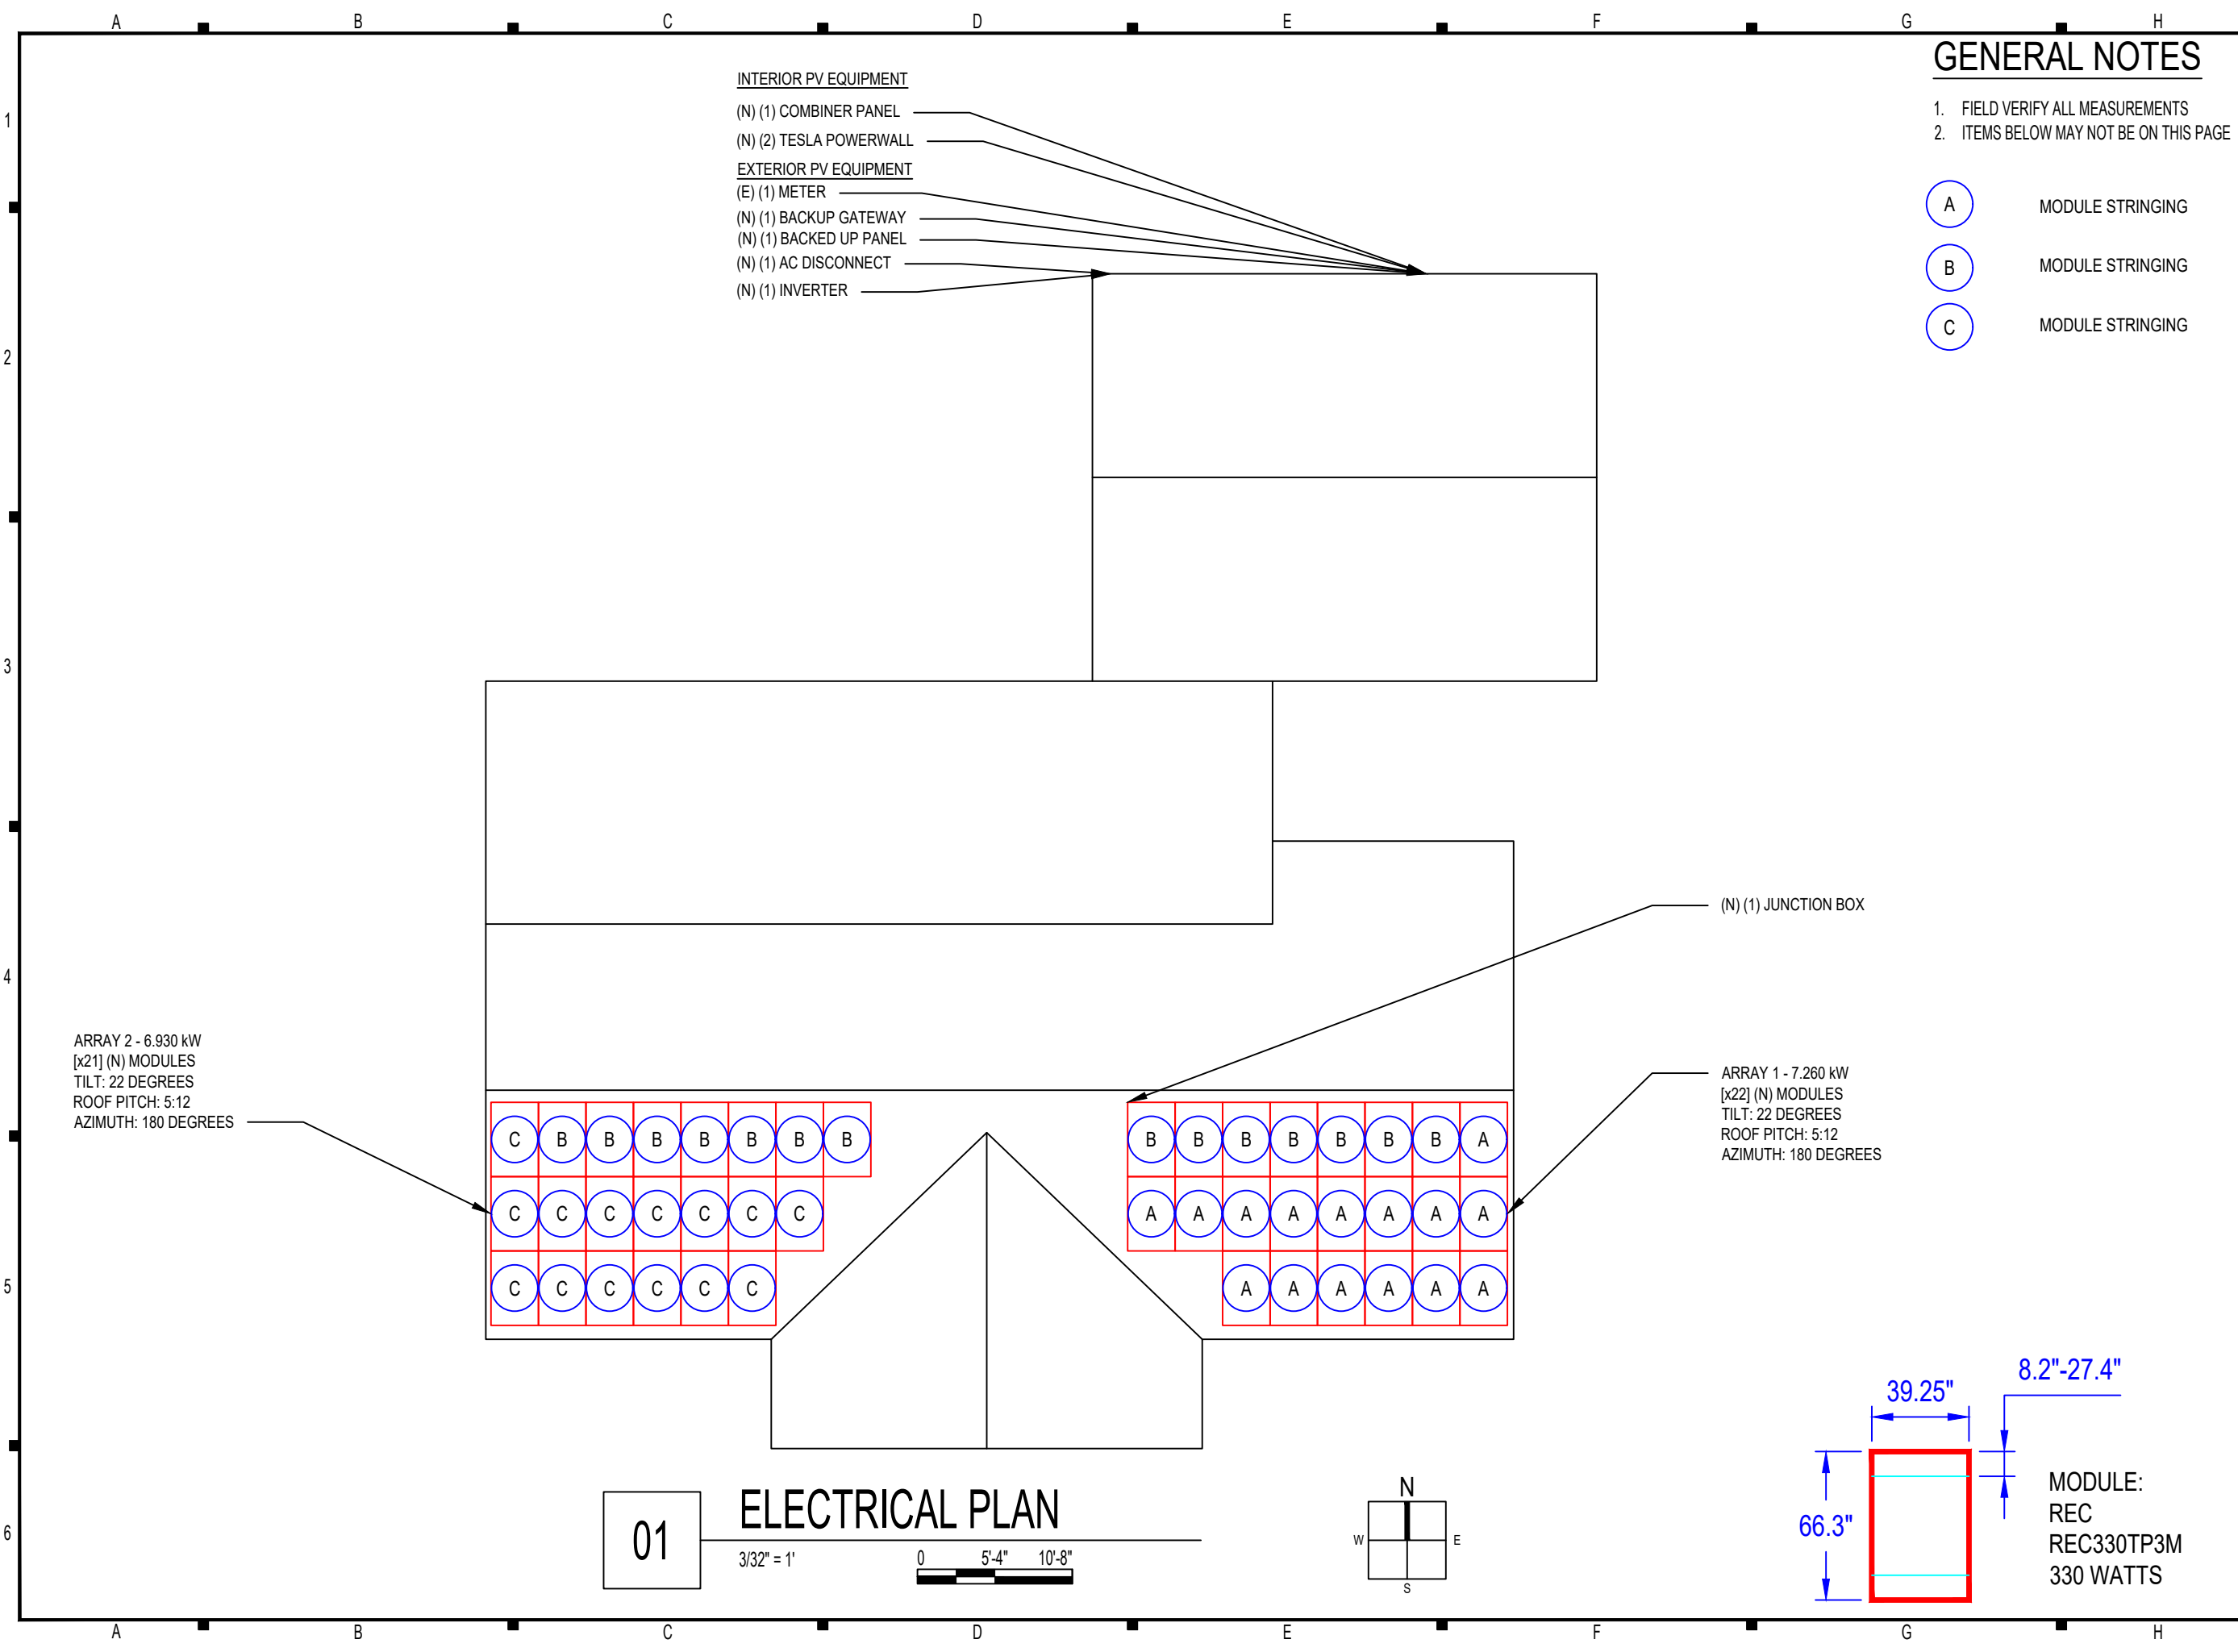

INTERIOR PV EQUIPMENT

- (N) (1) COMBINER PANEL
 - (N) (2) TESLA POWERWALL
- EXTERIOR PV EQUIPMENT**
- (E) (1) METER
 - (N) (1) BACKUP GATEWAY
 - (N) (1) BACKED UP PANEL
 - (N) (1) AC DISCONNECT
 - (N) (1) INVERTER

GENERAL NOTES

1. FIELD VERIFY ALL MEASUREMENTS
2. ITEMS BELOW MAY NOT BE ON THIS PAGE

- A MODULE STRINGING
- B MODULE STRINGING
- C MODULE STRINGING



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846
 ADDRESS: 202 NORTH DIXON AVENUE
 CARY, NC 27513

LIC. NO.: 67356
 HIC. NO.:
 ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
 COATS, NC 27521
 APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

ELECTRICAL PLAN


DATE: 10.08.2020
 DESIGN BY: V.H.
 CHECKED BY: M.M.

REVISIONS

A-102.00
 (SHEET 4)

01 ELECTRICAL PLAN

3/32" = 1'

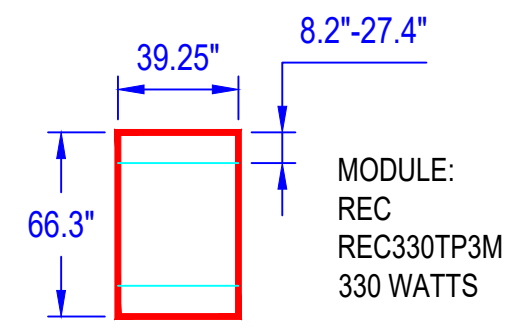

ARRAY 2 - 6.930 kW
 [x21] (N) MODULES
 TILT: 22 DEGREES
 ROOF PITCH: 5:12
 AZIMUTH: 180 DEGREES

(N) (1) JUNCTION BOX

ARRAY 1 - 7.260 kW
 [x22] (N) MODULES
 TILT: 22 DEGREES
 ROOF PITCH: 5:12
 AZIMUTH: 180 DEGREES

GENERAL NOTES

1. FIELD VERIFY ALL MEASUREMENTS
2. ITEMS BELOW MAY NOT BE ON THIS PAGE

--- ROOF TRUSS



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

SOLAR ATTACHMENT PLAN

DATE: 10.08.2020


DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS


A-103.00

(SHEET 5)

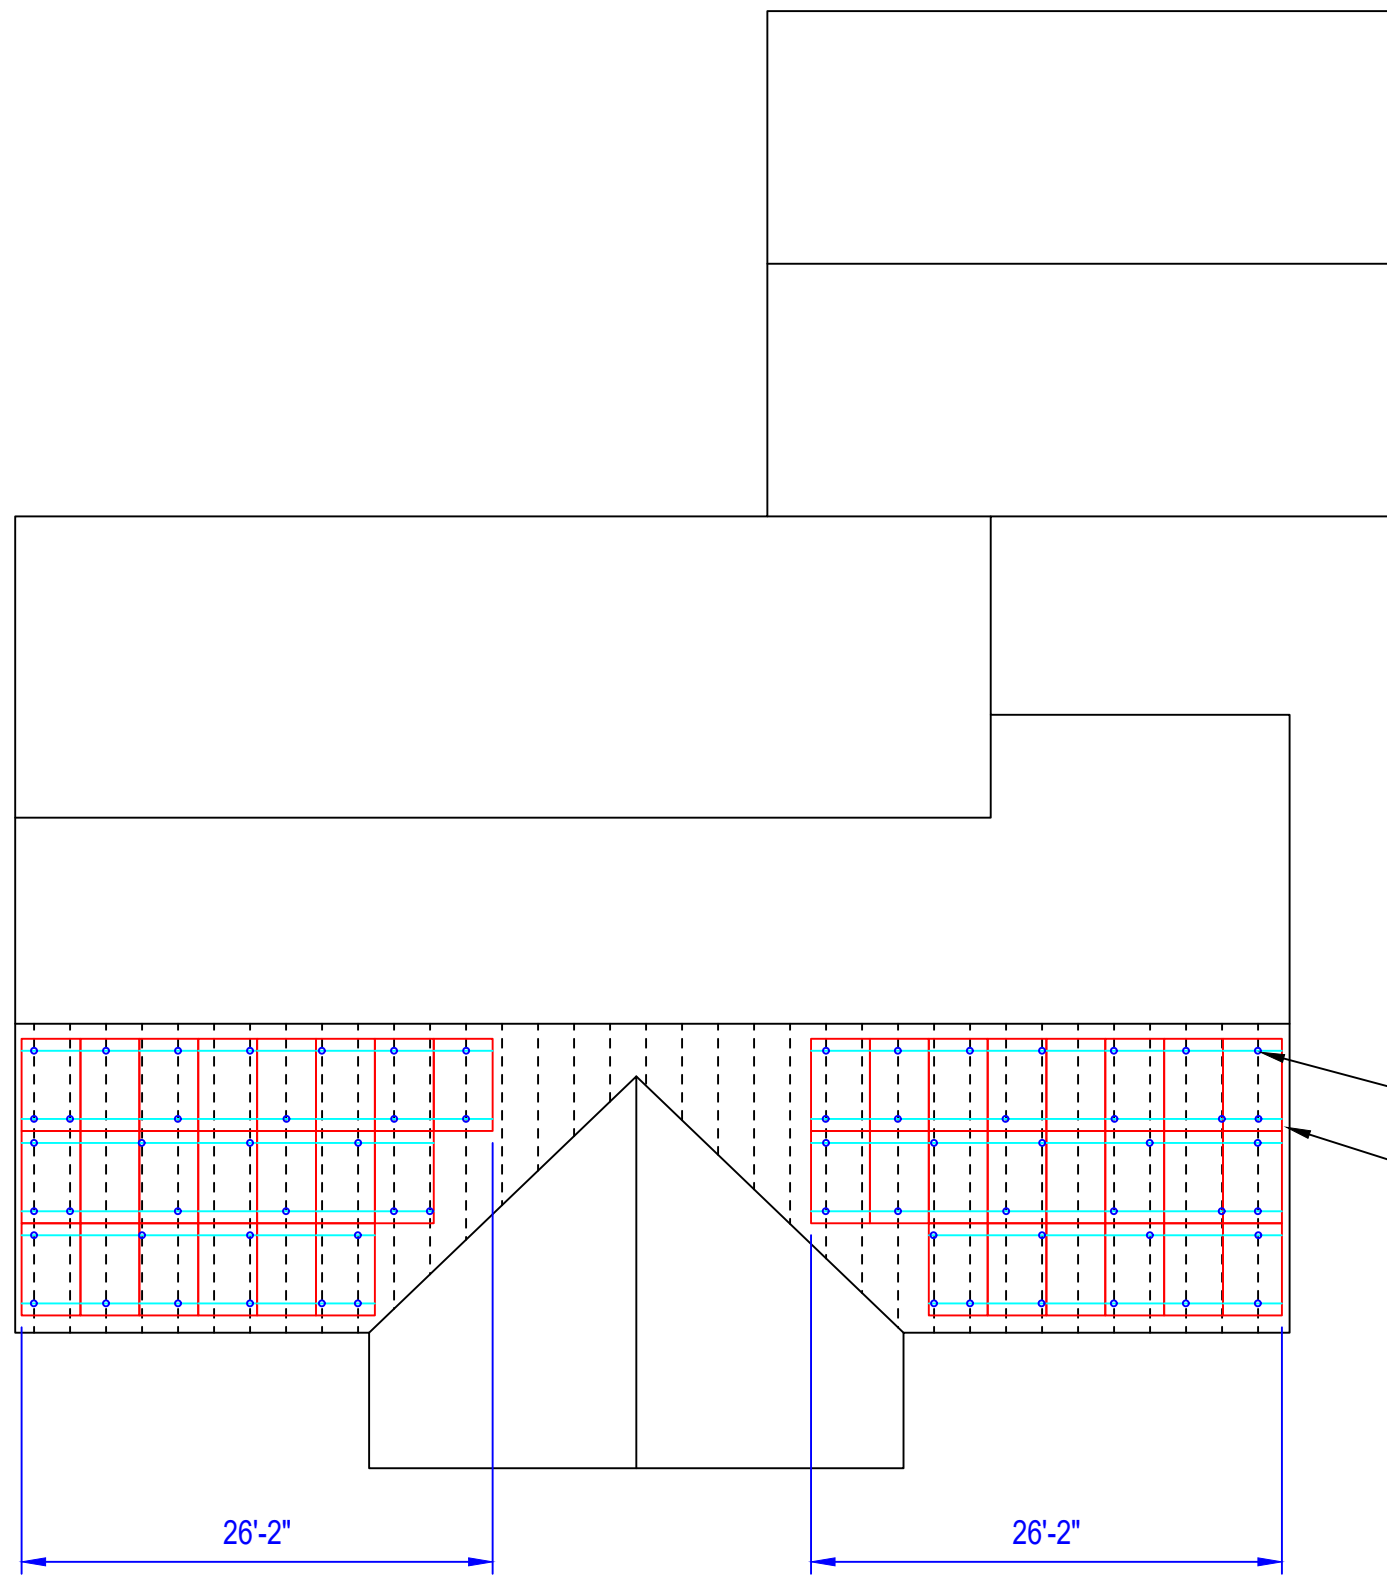

FLUSH MOUNT SOLAR MODULES
ATTACHED TO ROOF SURFACE (SEE
SHEET S-501 FOR MOUNTING DETAILS)



ROOF MATERIAL IS ASPHALT SHINGLE

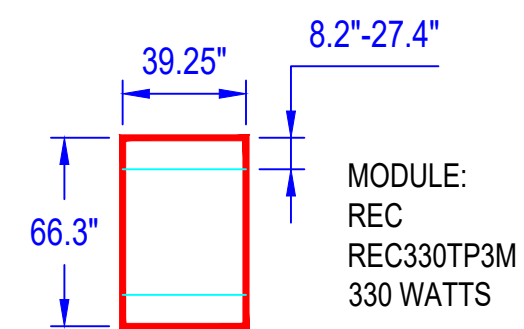

01

SOLAR ATTACHMENT PLAN

3/32" = 1'



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

LINE DIAGRAM

DATE: 10.08.2020


DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

E-601.00

(SHEET 6)

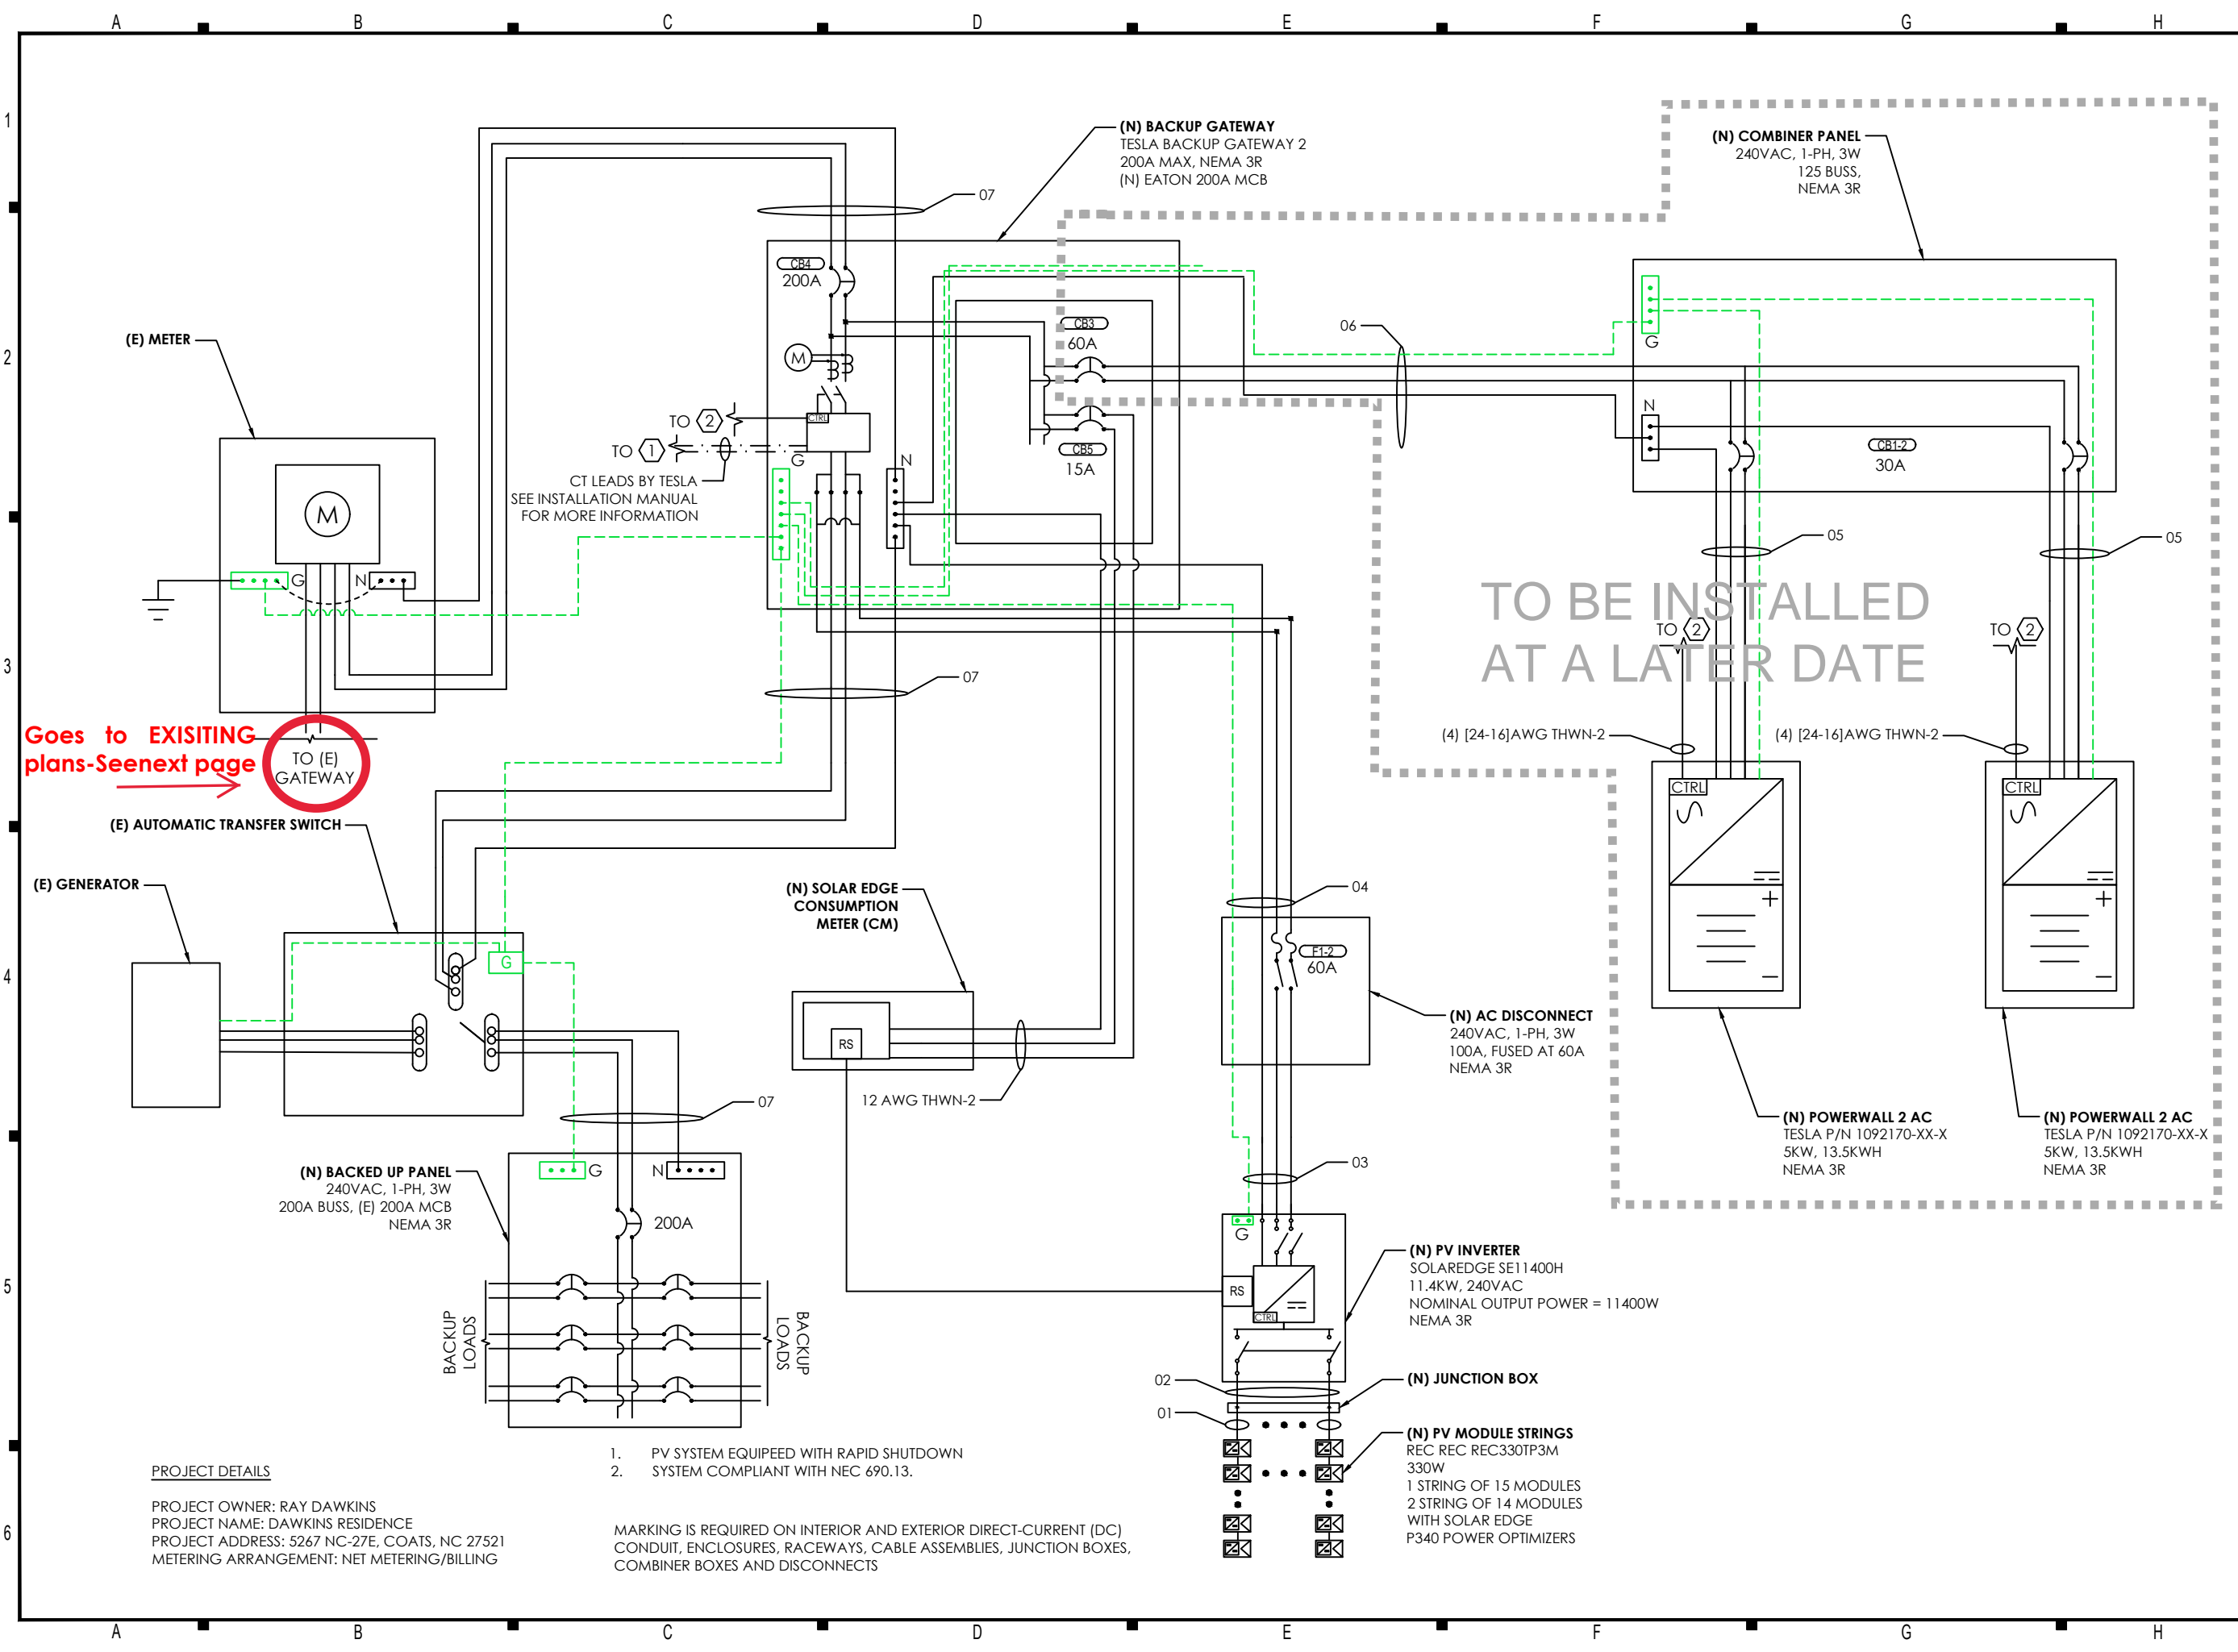

Goes to EXISTING plans-Seenext page

TO BE INSTALLED AT A LATER DATE

1. PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN
2. SYSTEM COMPLIANT WITH NEC 690.13.

MARKING IS REQUIRED ON INTERIOR AND EXTERIOR DIRECT-CURRENT (DC) CONDUIT, ENCLOSURES, RACEWAYS, CABLE ASSEMBLIES, JUNCTION BOXES, COMBINER BOXES AND DISCONNECTS

PROJECT DETAILS

PROJECT OWNER: RAY DAWKINS
PROJECT NAME: DAWKINS RESIDENCE
PROJECT ADDRESS: 5267 NC-27E, COATS, NC 27521
METERING ARRANGEMENT: NET METERING/BILLING

PV Module Information
 Mission Solar MSE295SQ5T
 Open circuit voltage = 40.11 V
 Maximum permissible system voltage = 1000 V
 Short circuit current = 9.52 A
 Maximum power at STC = 295 W
 Maximum power voltage = 32.72 V
 Maximum power current = 9.03 A

Inverter 1 Information
 SolarEdge 10000H-US
 Nominal output power = 10000 W
 Maximum output power = 10000 W
 Nominal DC input voltage = 400 V
 Maximum useable DC input current = 27 A
 Nominal AC output voltage = 240 V
Maximum Continuous AC current = 42 A

Module Optimizer Information
 SolarEdge P320
 Maximum module wattage = 320 W
 MPPT operating range = 8 - 48 Vdc
 Maximum Voc = 48 V
 Maximum Isc = 11 Adc
 Maximum output Current = 15 Adc

Array Information
 Mission Solar 295W / 10,620 W PV Array
 2 Strings of 18 Modules and Optimizers
Label per 690.53 on inverter #1 DC disconnect
Maximum Voltage = 480 V
Maximum Circuit Current = 26.55 A
Max. Rated DC-DC Current = 30 A

Storage Information
 Tesla Powerwall 2 Storage Battery and Battery Inverter
 Maximum output Power = 7000 W
 Operating output Voltage = 240 V
 Maximum Peak Current = 29.17
Operating output Current = 20.83 A

**** All SolarEdge Inverters are Rapid Shutdown Compliant per NEC 690.12 ****


All work shall comply with the 2017 National Electrical Code (NEC) and all applicable local electrical code requirements.

Labeling
 Contractor will supply labels per NEC Article 110, 225.37, 690, and 705.


Interconnection Standards Compliance
 The inverters listed have been tested to be in compliance with UL1741 Standard for Inverters, Converters, Controllers, and Interconnection System Equipment for Use With Distributed Energy Resources.

The inverters listed have been tested to be in compliance with IEEE 1547 Standard for Interconnecting Distributed Resources with Electric Power Systems. UL 1741 is the standard applied by Underwriters Laboratory to the Inverter to verify it meets the recommendations of IEEE 1547. Refer to both documents for details of these recommendations and test procedures.

All outdoor conduit and EMT fittings shall be raintight. Conduits emerging from below grade must be sealed to prevent moisture from entering enclosures. All fasteners, strut channels, brackets, clamps, and straps other than those provided by the racking manufacturer must be galvanized steel, aluminum, or stainless steel. Zinc plated steel is not approved for corrosion resistance in outdoor locations.

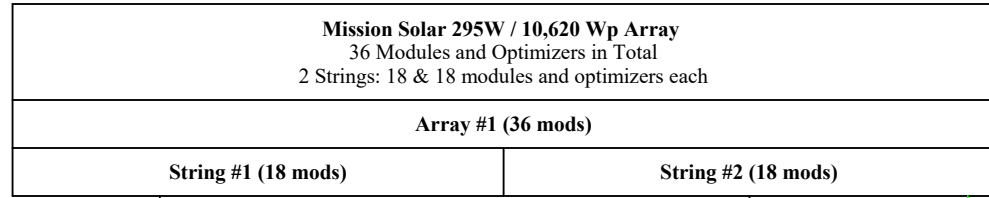


(4) #10 PV wire
 (1) #6 Bare Copper
 In free Air
 Approx. 30'



(1) 3/4" FMC
 (2) #10 THWN(Red)
 (2) #10 THWN(Black)
 (1) #10 THWN(Green)
 Approx. 20'

(1) 3/4" EMT
 (2) #10 THWN(Red)
 (2) #10 THWN(Black)
 (1) #10 THWN(Green)
 Approx. 15'



Monitoring

CAT 5
 To Router
 or PLC



On Roof

Attic



Exterior Wall on Workshop

Interior Wall in Workshop

(1) 3/4" EMT
 (1) #6 THWN(Black)
 (1) #6 THWN(Red)
 (1) #6 THWN(White)
 (1) #10 THWN(Green)
 Approx. 3'




(2) 3/4" EMT
 (2) #10 THWN(Black)
 (2) #10 THWN(Red)
 (2) #10 THWN(White)
 (2) #10 THWN(Green)
 Approx. 5'

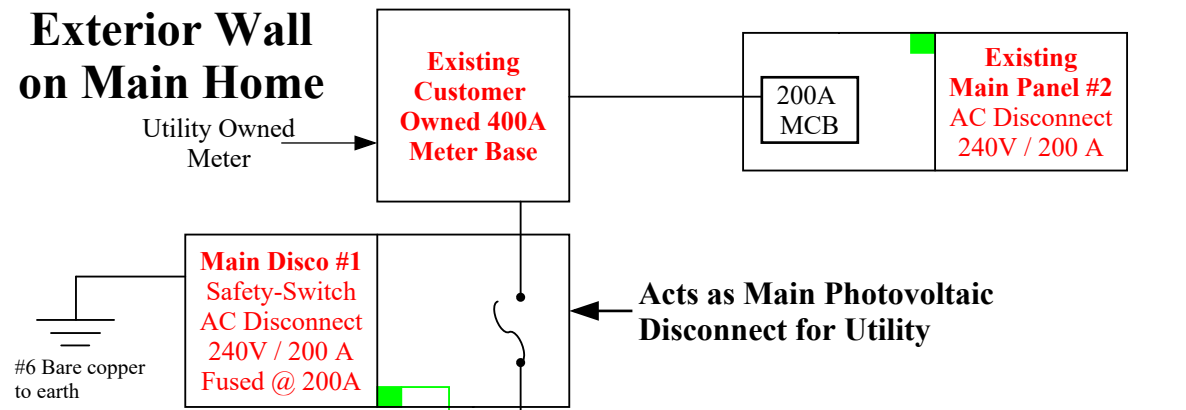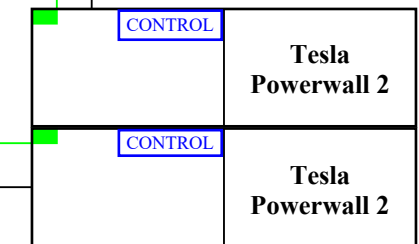


Acts as Main Photovoltaic Disconnect for Utility


(1) #4/0 USE Cable
 Aluminum
 Approx. 20'

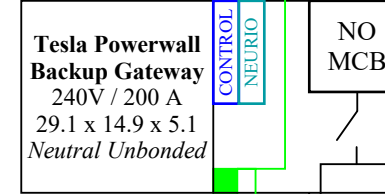

(1) #4/0 SER Cable
 Aluminum
 Approx. 5'

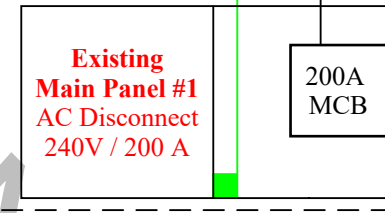

(1) #4/0 SER Cable
 Aluminum
 Approx. 3'

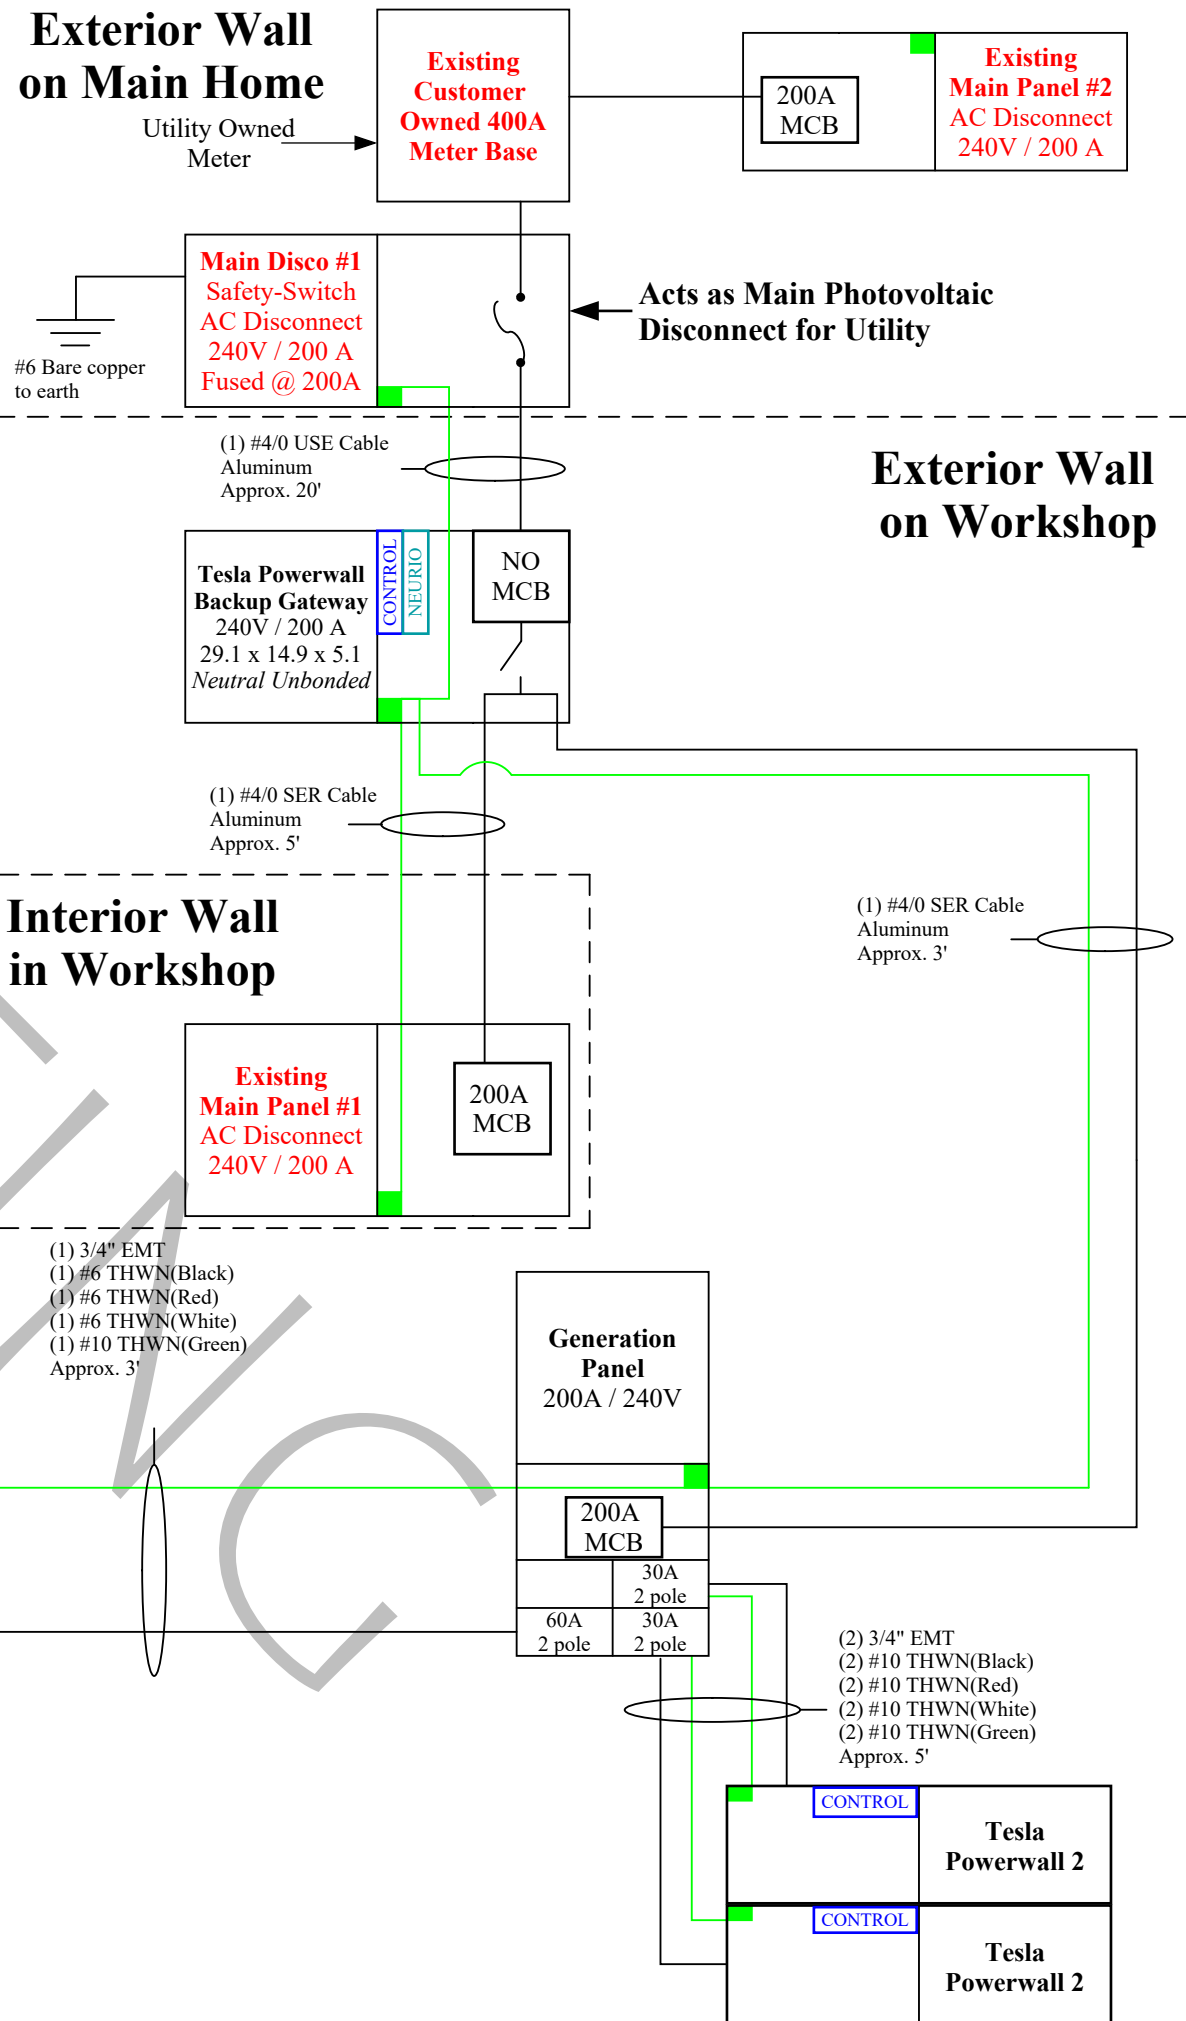

PV 5 Single Line Diagram

Drawn By: Darren Q
 Approved By: Rob Smith
 Date: 12/19/2018
 Rev. Date: 4/8/2019
 Rev. Number: 1 DQ
 Scale: NTS

Property of Yes Solar Solutions
 Any specifications, reprints, or data furnished to bidder or seller shall remain Yes Solar Solutions property. Shall be kept confidential for the purpose of the bid and shall be returned upon Yes Solar Solutions request. Patent rights embodied in designs, tools, or exclusive rights for the use in reproduction thereof are reserved by Yes Solar Solutions.

YES SOLAR SOLUTIONS
 202 N. Dixon Ave.
 Cary, NC 27513
 Phone: 919.459.4155
 GC License: 67356
 EC License: 31227

Ray Dawkins
 5267 NC 27 E.
 Coats, NC 27521

CONDUCTOR AND CONDUIT SCHEDULE W/ELECTRICAL CALCULATIONS

ID	TYPICAL	CONDUCTOR	CONDUIT	CURRENT-CARRYING CONDUCTORS IN CONDUIT	OCPD	EGC	TEMP. CORR. FACTOR	CONDUIT FILL FACTOR	CONT. CURRENT	MAX. CURRENT (125%)	BASE AMP.	DERATED AMP.	TERM. TEMP. RATING	AMP. @ TERMINAL
01	3	10 AWG PV WIRE, COPPER	FREE AIR	2	N/A	6 AWG BARE, COPPER	0.91 (37.1 °C)	1	15A	18.75A	55A	50.05A	75°C	50A
02	1	10 AWG THWN-2, COPPER	0.75" DIA EMT	6	N/A	10 AWG THWN-2, COPPER	0.91 (37.1 °C)	0.8	15A	18.75A	40A	29.12A	75°C	35A
03	1	6 AWG THWN-2, COPPER	0.75" DIA EMT	2	60A	6 AWG THWN-2, COPPER	0.91 (37.1 °C)	1	47.5A	59.38A	75A	68.25A	75°C	65A
04	1	6 AWG THWN-2, COPPER	0.75" DIA EMT	2	N/A	6 AWG THWN-2, COPPER	0.91 (37.1 °C)	1	47.5A	59.38A	75A	68.25A	75°C	65A
05	2	10 AWG THWN-2, COPPER	0.5" DIA EMT	2	30A	10 AWG THWN-2, COPPER	0.91 (37.1 °C)	1	-	30A	40A	36.4A	75°C	35A
06	1	6 AWG THWN-2, COPPER	0.75" DIA EMT	2	60A	10 AWG THWN-2, COPPER	0.91 (37.1 °C)	1	-	60A	75A	68.25A	75°C	65A
07	3	3/O AWG THWN-2, COPPER	2" DIA EMT	2	N/A	6 AWG THWN-2, COPPER	0.91 (37.1 °C)	1	-	200A	225A	204.75A	75°C	200A

SYSTEM SUMMARY

	INVERTER #1		
	STRING #1	STRING #2	STRING #3
POWERBOX MAX OUTPUT CURRENT	15A	15A	15A
OPTIMIZERS IN SERIES	15	14	14
NOMINAL STRING VOLTAGE	400V	400V	400V
ARRAY OPERATING CURRENT	12.38A	11.55A	11.55A
ARRAY STC POWER	14,190W		
ARRAY PTC POWER	13,278W		
MAX AC CURRENT	47.5A		
MAX AC POWER	11,400W		
DERATED (CEC) AC POWER	11,400W		

MODULES

REF.	QTY.	MAKE AND MODEL	PMAX	PTC	ISC	IMP	VOC	VMP	TEMP. COEFF. OF VOC	FUSE RATING
PM1-43	43	REC REC330TP3M	330W	308.8W	10.39A	9.62A	39.9V	34.3V	-0.112V/°C (-0.28%/°C)	20A

POWER OPTIMIZERS

REF.	QTY.	MODEL	RATED INPUT POWER	MAX OUTPUT CURRENT	MAX INPUT ISC	MAX DC VOLTAGE	WEIGHTED EFFICIENCY
PO1-43	43	SOLAR EDGE P340	340W	15A	11A	48V	98.8%

INVERTERS

REF.	QTY.	MAKE AND MODEL	AC VOLTAGE	GROUND	OCPD RATING	RATED POWER	MAX OUTPUT CURRENT	MAX INPUT CURRENT	MAX INPUT VOLTAGE	CEC WEIGHTED EFFICIENCY
I1	1	SOLAR EDGE SE11400H-US (240V)	240V	FLOATING	60A	11400W	47.5A	30.5A	480V	99.0%

DISCONNECTS

REF.	QTY.	MAKE AND MODEL	RATED CURRENT	MAX RATED VOLTAGE
SW1	1	EATON DG223NRB OR EQUIV.	100A	240VAC

OCPDS

REF.	QTY.	RATED CURRENT	MAX VOLTAGE
CB1-2	2	30A	240VAC
CB3	1	60A	240VAC
CB4	1	200A	240VAC
CB5	1	15A	240VAC
F1-2	2	60A	240VAC

ASHRAE EXTREME LOW	-11.1°C (12.0°F), SOURCE: HARTNETT COUNTY (35.38°; -78.73°)
ASHRAE 2% HIGH	37.1°C (98.8°F), SOURCE: HARTNETT COUNTY (35.38°; -78.73°)



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

DESIGN TABLES

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

E-602.00

(SHEET 7)

LABELING NOTES
 1.1 LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRICAL CODE, INTERNATIONAL FIRE CODE 605.11, OSHA STANDARD 1910.145, ANSI Z535
 1.2 MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
 1.3 LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.
 1.4 LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8" AND PERMANENTLY AFFIXED.
 1.5 ALERTING WORDS TO BE COLOR CODED. "DANGER" WILL HAVE RED BACKGROUND; "WARNING" WILL HAVE ORANGE BACKGROUND; "CAUTION" WILL HAVE YELLOW BACKGROUND. [ANSI Z535]
 1.6 ALL SIGNAGE MUST BE PERMANENTLY ATTACHED AND BE WEATHER RESISTANT/SUNLIGHT RESISTANT AND CANNOT BE HAND-WRITTEN PER NEC 110.21(B)

WARNING
 ELECTRICAL SHOCK HAZARD
 TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

WARNING: PHOTOVOLTAIC POWER SOURCE

INTERACTIVE PHOTOVOLTAIC SYSTEM CONNECTED PHOTOVOLTAIC SYSTEM DISCONNECT LOCATED NORTH SIDE OF THE HOUSE

LABEL 1
 AT EACH DISCONNECTING MEANS FOR PHOTOVOLTAIC EQUIPMENT (2" X 4"). [NEC 690.13].

LABEL 4
 AT EXPOSED RACEWAYS, CABLE TRAYS, AND OTHER WIRING METHODS; SPACED AT MAXIMUM 10 FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS (5 3/4" X 1 1/8"). [NEC 690.31(G)]
 LETTERS AT LEAST 3/8 INCH; WHITE ON RED BACKGROUND; REFLECTIVE [IFC 605.11.1.1]

DIRECTORY
 PERMANENT PLAQUE OR DIRECTORY PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS IF NOT IN THE SAME LOCATION (5 3/4" X 1 1/8"). [NEC 690.56(B)]
 WHERE THE PV SYSTEMS ARE REMOTELY LOCATED FROM EACH OTHER, A DIRECTORY IN ACCORDANCE WITH 705.10 SHALL BE PROVIDED AT EACH PV SYSTEM DISCONNECTING MEANS.
 PV SYSTEM EQUIPMENT AND DISCONNECTING MEANS SHALL NOT BE INSTALLED IN BATHROOMS [NEC 690.4(D),(E)]

WARNING
 POWER SOURCE OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

PHOTOVOLTAIC SOLAR AC DISCONNECT

DIRECT CURRENT PHOTOVOLTAIC POWER SOURCE
 MAXIMUM VOLTAGE: 480 V DC
 MAXIMUM CIRCUIT CURRENT: 30.5 A DC
 MAX RATED OUTPUT CURRENT OF THE CHARGE CONTROLLER OR DC-TO-DC CONVERTER: 45 A DC

LABEL 2
 AT POINT OF INTERCONNECTION OVERCURRENT DEVICE (2" X 4"). [NEC 705.12(B)(2)(3)(B)].

LABEL 5
 AT RAPID SHUTDOWN DISCONNECT SWITCH (5 1/4" X 2"). [NEC 690.56(C)(3)].

PHOTOVOLTAIC SOLAR DC DISCONNECT

LABEL 12
 AT EACH DC DISCONNECTING MEANS (3" X 4"). [NEC 690.53].

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN ARRAY

CAUTION
 SOLAR ELECTRIC SYSTEM CONNECTED

LABEL 10
 AT EACH DC DISCONNECTING MEANS (4" X 1"). [NEC 690.13(B)].

PHOTOVOLTAIC SYSTEM AC DISCONNECT
 RATED AC OUTPUT CURRENT 47.5 A
 NOMINAL OPERATING AC VOLTAGE 240 V

LABEL 6
 AT UTILITY METER (5 3/4" X 1 1/8") [NEC 690.56(B)]


WARNING
 TRIPLE POWER SUPPLY SOURCES: UTILITY GRID, BATTERY AND PV SOLAR ELECTRIC SYSTEM

WARNING
 SOLAR ELECTRIC CIRCUIT BREAKER IS BACKFED

LABEL 3
 AT RAPID SHUTDOWN SYSTEM (3 3/4" X 5 1/4"). [NEC 690.56(C)(1)(A)].

LABEL 7
 AT POINT OF INTERCONNECTION (2 3/4" X 1 5/8"). [NEC 705.12(B)(3)]

LABEL 8
 AT POINT OF INTERCONNECTION (2" X 1"). [NEC 705.12(B)(3)]

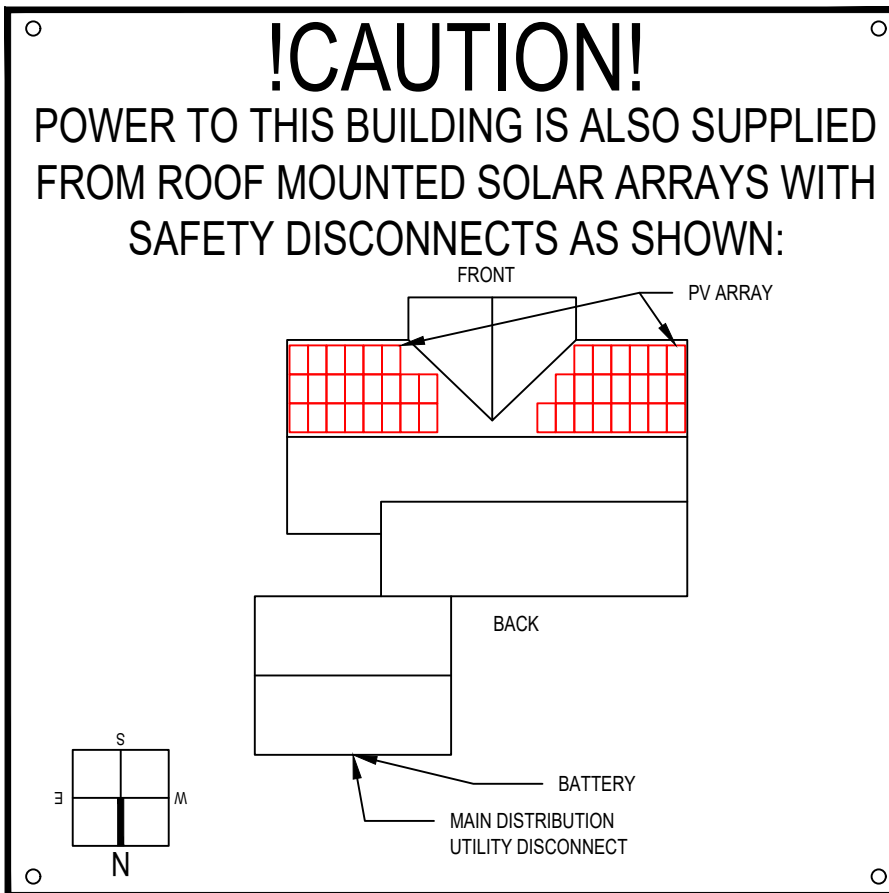

CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846
 ADDRESS: 202 NORTH DIXON AVENUE
 CARY, NC 27513

LIC. NO.: 67356
 HIC. NO.:
 ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
 COATS, NC 27521
 APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

PLACARDS

DATE: 10.08.2020


DESIGN BY: V.H.

CHECKED BY: M.M.


REVISIONS

E-603.00
 (SHEET 8)


A B C D E F G H

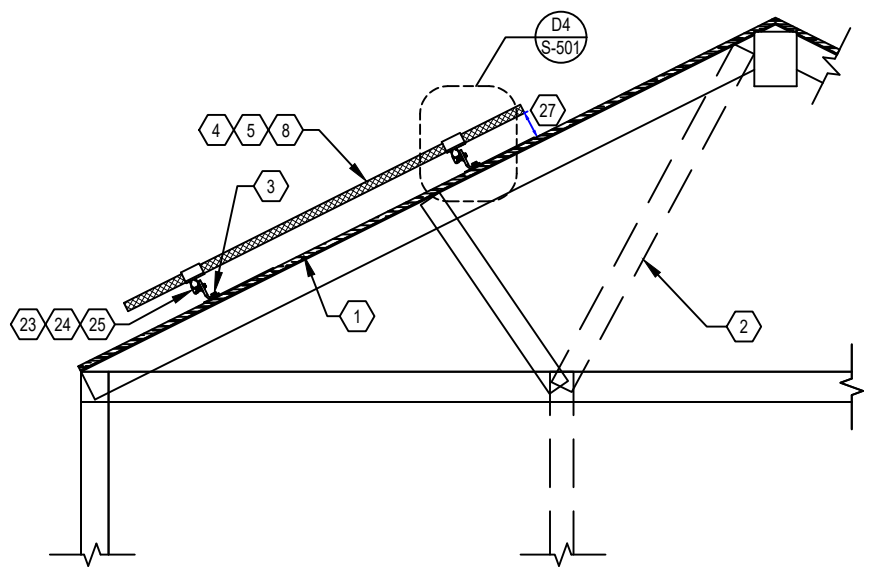


D1 RACKING DETAIL (TRANSVERSE)
NOT TO SCALE

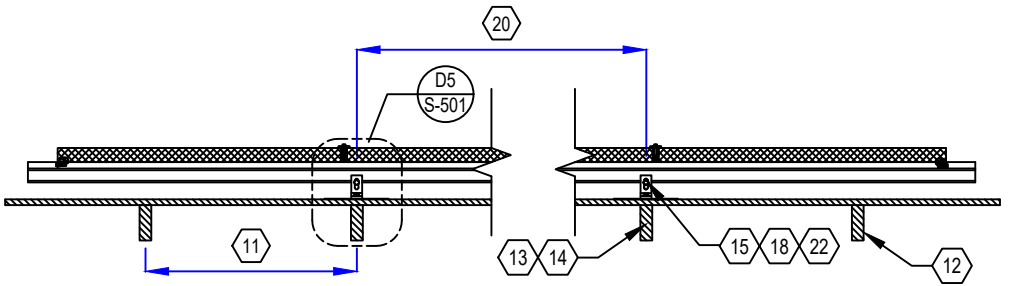


D2 RACKING DETAIL (LONGITUDINAL)
NOT TO SCALE

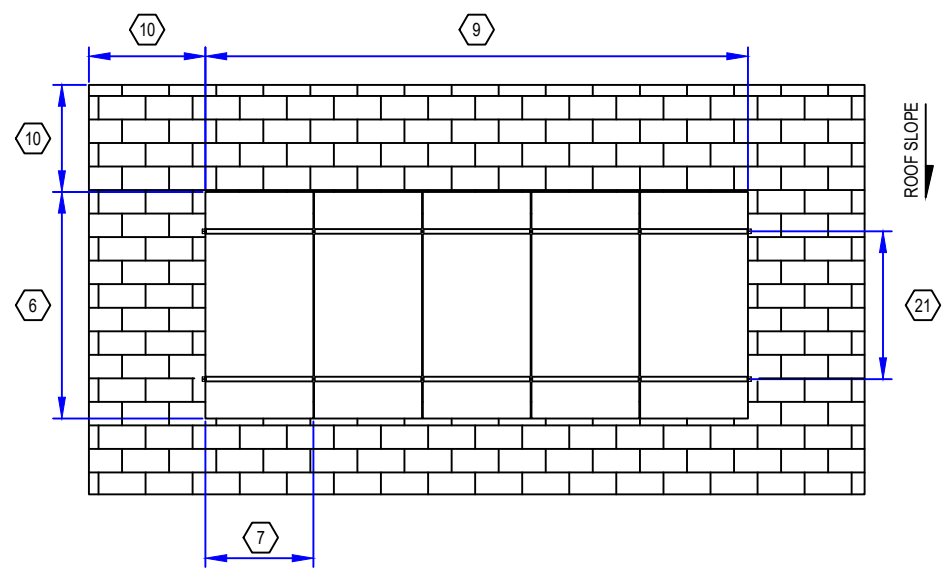

D3 RACKING DETAIL (TOP)
NOT TO SCALE

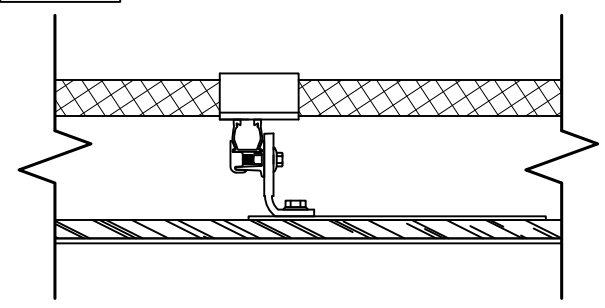

D4 DETAIL (TRANSVERSE)
NOT TO SCALE

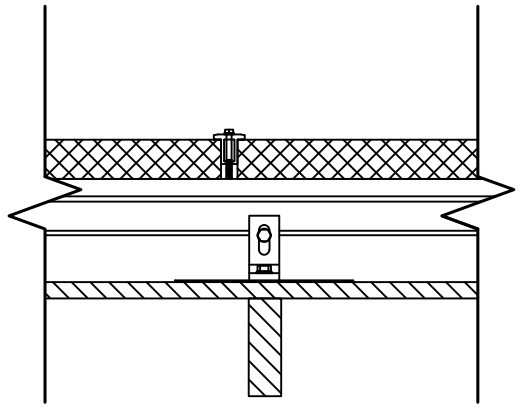

D5 DETAIL (LONGITUDINAL)
NOT TO SCALE

GENERAL NOTES

1. FIELD VERIFY ALL MEASUREMENTS

SHEET KEYNOTES

1. ROOF MATERIAL: ASPHALT SHINGLE
2. ROOF STRUCTURE: TRUSS
3. ATTACHMENT TYPE: SNAP N RACK ULTRA RAIL COMP KIT
4. MODULE MANUFACTURER: REC
5. MODULE MODEL: REC330TP3M
6. MODULE LENGTH: 66.3"
7. MODULE WIDTH: 39.25"
8. MODULE WEIGHT: 41.7 LBS.
9. SEE SHEET A-103 FOR DIMENSION(S)
10. MIN. FIRE OFFSET: NO FIRE CODE ENFORCED
11. TRUSS SPACING: 24 IN. O.C.
12. TRUSS SIZE: 2X4 NOMINAL
13. LAG BOLT DIAMETER: 5/16 IN.
14. LAG BOLT EMBEDMENT: 2-1/2 IN.
15. TOTAL # OF ATTACHMENTS: 67
16. TOTAL AREA: 777.07 SQ. FT.
17. TOTAL WEIGHT: 1971.44 LBS.
18. WEIGHT PER ATTACHMENT: 29.42 LBS.
19. DISTRIBUTED LOAD: 2.54 PSF
20. MAX. HORIZONTAL STANDOFF: 72 IN.
21. MAX. VERTICAL STANDOFF:
LANDSCAPE: 26 IN., PORTRAIT: 33 IN.
22. STANDOFF STAGGERING: YES
23. RAIL MANUFACTURER (OR EQUIV.): SNAP N RACK
24. RAIL MODEL (OR EQUIVALENT): UR-40 RAIL
25. RAIL WEIGHT: 0.42 PLF.
26. MAX. TRUSS SPAN: N/A
27. MODULE CLEARANCE: 3 IN. MIN., 6 IN. MAX.



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846
ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356
HIC. NO.:
ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

**DAWKINS
RESIDENCE**

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

ASSEMBLY DETAILS

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

S-501.00

(SHEET 9)

A B C D E F G H



REC TWINPEAK 3 MONO BLACK SERIES


PREMIUM SOLAR PANELS WITH SUPERIOR PERFORMANCE

REC TwinPeak 3 Mono Black Series solar panels feature an innovative design with high panel efficiency and power output, enabling customers to get the most out of the space used for the installation.

Combined with industry-leading product quality and the reliability of a strong and established European brand, REC TwinPeak 3 Mono Black panels are ideal for residential and commercial rooftops worldwide.



REC TWINPEAK 3 MONO BLACK SERIES

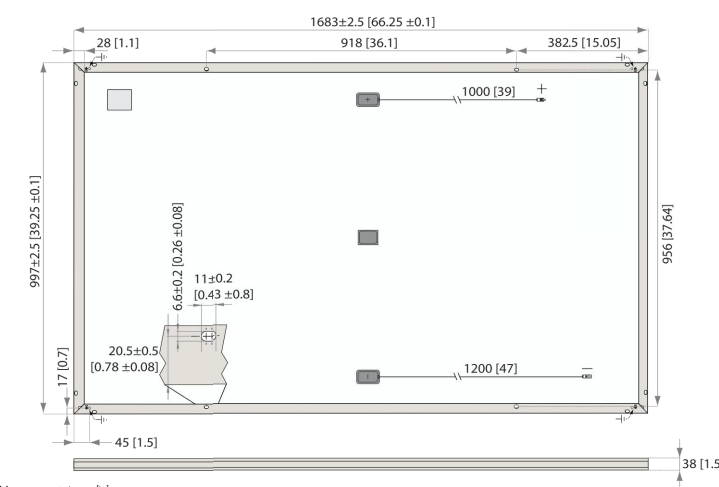

Measurements in mm [in]


ELECTRICAL DATA @ STC		Product code: RECxxxTP3M Black				
Power Output - P _{MAX} (Wp)		315	320	325	330	335
Watt Class Sorting - (W)		-0/+5	-0/+5	-0/+5	-0/+5	-0/+5
Nominal Power Voltage - V _{MPP} (V)		33.6	33.8	34.1	34.3	34.6
Nominal Power Current - I _{MPP} (A)		9.40	9.50	9.54	9.62	9.69
Open Circuit Voltage - V _{OC} (V)		38.7	39.1	39.5	39.9	40.2
Short Circuit Current - I _{SC} (A)		10.30	10.30	10.36	10.39	10.42
Panel Efficiency (%)		18.8	19.1	19.4	19.7	20.0

Values at standard test conditions (STC: air mass AM1.5, irradiance 1000 W/m², temperature 25°C), based on a production spread with a tolerance of P_{MAX}, V_{OC} & I_{SC} ±3% within one watt class. At a low irradiance of 200 W/m² at least 95% of the STC module efficiency will be achieved. *Where xxx indicates the nominal power class (P_{MAX}) at STC indicated above.

ELECTRICAL DATA @ NMOT		Product code: RECxxxTP3M Black				
Power Output - P _{MAX} (Wp)		235	238	242	246	250
Nominal Power Voltage - V _{MPP} (V)		31.3	31.5	31.7	31.9	32.2
Nominal Power Current - I _{MPP} (A)		7.51	7.57	7.63	7.70	7.75
Open Circuit Voltage - V _{OC} (V)		36.1	36.4	36.8	37.1	37.5
Short Circuit Current - I _{SC} (A)		8.23	8.26	8.29	8.31	8.34

Nominal module operating temperature (NMOT: air mass AM1.5, irradiance 800 W/m², temperature 20°C, windspeed 1 m/s). *Where xxx indicates the nominal power class (P_{MAX}) at STC indicated above.

CERTIFICATIONS



WARRANTY

	Standard		REC ProTrust	
	No	Yes	Yes	Yes
Installed by an REC Certified Solar Professional	No	Yes	Yes	Yes
System Size	Any	≤25 kW	25-500 kW	
Product Warranty (yrs)	20	25	25	25
Power Warranty (yrs)	25	25	25	25
Labor Warranty (yrs)	0	25	10	
Power in Year 1	97.5%	97.5%	97.5%	
Annual Degradation	0.7%	0.7%	0.7%	
Power in Year 25	80.7%	80.7%	80.7%	

See warranty documents for details. Some conditions apply.

20.0% EFFICIENCY

20 YEAR PRODUCT WARRANTY

25 YEAR LINEAR POWER OUTPUT WARRANTY

TEMPERATURE RATINGS

Nominal Module Operating Temperature:	44.6°C (±2°C)
Temperature coefficient of P _{MAX} :	-0.37 %/°C
Temperature coefficient of V _{OC} :	-0.28 %/°C
Temperature coefficient of I _{SC} :	0.04 %/°C

GENERAL DATA

Cells:	120 half-cut mono-Si p-type PERC cells 6 strings of 20 cells in series
Glass:	0.13" (3.2 mm) solar glass with anti-reflective surface treatment
Back sheet:	Highly resistant polyester polyolefin construction (black)
Frame:	Anodized aluminum (black)
Junction box:	3-part with 3 bypass diodes, IP67 rated 12 AWG (4 mm ²) PV wire, 39" + 47" (1.0 m + 1.2 m)
Connectors:	Stäubli MC4 PV-KBT4/PV-KST4 12 AWG (4 mm ²)

MAXIMUM RATINGS

Operational temperature:	-40 ... +185°F (-40 ... +85°C)
Maximum system voltage:	1000 V
Design load (+): snow	3600 Pa (75.2 lbs/ft ²) [*]
Maximum test load (+):	5400 Pa (112.8 lbs/ft ²) [*]
Design load (-): wind	1600 Pa (33.4 lbs/ft ²) [*]
Maximum test load (-):	2400 Pa (50 lbs/ft ²) [*]
Max series fuse rating:	20 A
Max reverse current:	20 A

* Calculated using a safety factor of 1.5
* See installation manual for mounting instructions

MECHANICAL DATA

Dimensions:	66.3 x 39.25 x 1.5 (1683 x 997 x 38 mm)
Area:	17.98 ft ² (1.68 m ²)
Weight:	41.7 lbs (18.9 kg)

Note! Specifications subject to change without notice.



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846
ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356
HIC. NO.:
ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

R-001.00

(SHEET 10)

MORE POWER OUTPUT PER M²

IMPROVED PERFORMANCE IN SHADED CONDITIONS

100% PID FREE

REDUCES BALANCE OF SYSTEM COSTS

ELIGIBLE FOR

REC Group is an international pioneering solar energy company dedicated to empowering consumers with clean, affordable solar power in order to facilitate global energy transitions. Committed to quality and innovation, REC offers photovoltaic modules with leading high quality, backed by an exceptional low warranty claims rate of less than 100ppm. Founded in Norway in 1996, REC employs 2,000 people and has an annual solar panel capacity of 1.8 GW. With over 10 GW installed worldwide, REC is empowering more than 16 million people with clean solar energy. REC Group is a Bluesolar Elkem company with headquarters in Norway, operational headquarters in Singapore, and regional bases in North America, Europe, and Asia-Pacific.



Specifications subject to change without notice. Ref: PM-D5-07-16 Rev-A_05.20

Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / **SE11400H-US**



INVERTERS

Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014 and 2017, per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / **SE11400H-US**

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US		
APPLICABLE TO INVERTERS WITH PART NUMBER	SEXXXXH-XXXXXX4								
OUTPUT									
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac	
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac	
AC Frequency (Nominal)	59.3 - 60 - 60.5 ⁽¹⁾							Hz	
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A	
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A	
Power Factor	1, Adjustable - 0.85 to 0.85								
GFDI Threshold	1							A	
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes								
INPUT									
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W	
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W	
Transformer-less, Ungrounded	Yes								
Maximum Input Voltage	480							Vdc	
Nominal DC Input Voltage	380							Vdc	
Maximum Input Current @240V ⁽²⁾	8.5	10.5	13.5	16.5	20	27	30.5	Adc	
Maximum Input Current @208V ⁽²⁾	-	9	-	13.5	-	-	27	Adc	
Max. Input Short Circuit Current	45							Adc	
Reverse-Polarity Protection	Yes								
Ground-Fault Isolation Detection	600ka Sensitivity								
Maximum Inverter Efficiency	99	99.2						%	
CEC Weighted Efficiency	99							99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption	< 2.5							W	

⁽¹⁾ For other regional settings please contact SolarEdge support
⁽²⁾ A higher current source may be used; the inverter will limit its input current to the values stated



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

R-002.00

(SHEET 11)

Power Optimizer

For North America

P320 / P340 / P370 / P400 / P405 / P485 / P505



**25
YEAR
WARRANTY**

POWEROPTIMIZER

PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

solaredge.com



Power Optimizer For North America

P320 / P340 / P370 / P400 / P405 / P485 / P505

Optimizer model (typical module compatibility)	P320 (for 60-cell modules)	P340 (for high-power 60-cell modules)	P370 (for higher-power 60 and 72-cell modules)	P400 (for 72 & 96-cell modules)	P405 (for high-voltage modules)	P485 (for high-voltage modules)	P505 (for higher current modules)	
INPUT								
Rated Input DC Power ⁽¹⁾	320	340	370	400	405	485	505	W
Absolute Maximum Input Voltage (Voc at lowest temperature)	48		60	80	125 ⁽²⁾		83 ⁽²⁾	Vdc
MPPT Operating Range	8 - 48		8 - 60	8 - 80	12.5 - 105		12.5 - 83	Vdc
Maximum Short Circuit Current (Isc)		11			10.1		14	Adc
Maximum DC Input Current		13.75			12.5		17.5	Adc
Maximum Efficiency				99.5				%
Weighted Efficiency				98.8			98.6	%
Overvoltage Category				II				
OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREEDGE INVERTER)								
Maximum Output Current				15				Adc
Maximum Output Voltage		60			85			Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREEDGE INVERTER OR SOLAREEDGE INVERTER OFF)								
Safety Output Voltage per Power Optimizer				1 ± 0.1				Vdc
STANDARD COMPLIANCE								
EMC	FCC Part15 Class B, IEC61000-6-2, IEC61000-6-3							
Safety	IEC62109-1 (class II safety), UL1741							
Material	UL94 V-0, UV Resistant							
RoHS	Yes							
INSTALLATION SPECIFICATIONS								
Maximum Allowed System Voltage	1000							
Compatible inverters	All SolarEdge Single Phase and Three Phase inverters							
Dimensions (W x L x H)	129 x 153 x 27.5 / 5.1 x 6 x 1.1		129 x 153 x 33.5 / 5.1 x 6 x 1.3		129 x 159 x 49.5 / 5.1 x 6.3 x 1.9		129 x 162 x 59 / 5.1 x 6.4 x 2.3	
Weight (including cables)	630 / 1.4		750 / 1.7		845 / 1.9		1064 / 2.3	
Input Connector	MC4 ⁽³⁾					Single or dual MC4 ⁽³⁾⁽⁴⁾		MC4 ⁽³⁾
Input Wire Length	0.16 / 0.52							
Output Wire Type / Connector	Double Insulated / MC4							
Output Wire Length	0.9 / 2.95		1.2 / 3.9		1.2 / 3.9		1.2 / 3.9	
Operating Temperature Range ⁽⁵⁾	-40 - +85 / -40 - +185							
Protection Rating	IP68 / NEMA6P							
Relative Humidity	0 - 100							

⁽¹⁾ Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed

⁽²⁾ NEC 2017 requires max input voltage be not more than 80V

⁽³⁾ For other connector types please contact SolarEdge

⁽⁴⁾ For dual version for parallel connection of two modules use the P485. In the case of an odd number of PV modules in one string, installing one P485 dual version power optimizer

⁽⁵⁾ For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details.

PV System Design Using a SolarEdge Inverter ⁽⁶⁾⁽⁷⁾	Single Phase HD-Wave	Single phase	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	P320, P340, P370, P400	8	10	18	
	P405, P485, P505	6	8	14	
Maximum String Length (Power Optimizers)		25	25	50 ⁽⁸⁾	
Maximum Power per String		5700 (6000 with SE7600-US - SE11400-US)	5250	6000 ⁽⁹⁾	12750 ⁽¹⁰⁾ W
Parallel Strings of Different Lengths or Orientations			Yes		

⁽⁶⁾ For detailed string sizing information refer to: http://www.solaredge.com/sites/default/files/string_sizing_na.pdf

⁽⁷⁾ It is not allowed to mix P405/P485/P505 with P320/P340/P370/P400 in one string

⁽⁸⁾ A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement

⁽⁹⁾ For 208V grid: it is allowed to install up to 6,500W per string when the maximum power difference between each string is 1,000W

⁽¹⁰⁾ For 277/480V grid: it is allowed to install up to 17,550W per string when the maximum power difference between each string is 2,000W

© SolarEdge Technologies Ltd. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/2019/V02/ENG NAM. Subject to change without notice.



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

R-003.00

(SHEET 12)

Energy Meter with Modbus Connection for North America

SE-MTR240-NN-S-S1

METERING

5
YEAR
WARRANTY



Energy Meter for Residential Installations:

- Simple installations and connectivity
- Type NEMA 3R enclosure for outdoor protection
- Provides high accuracy meter readings
- Communicates over RS485 to provide monitoring data
- Suitable for export limitation, consumption monitoring and StorEdge™ applications

solareedge.com

solareedge


Energy Meter with Modbus Connection for North America

SE-MTR240-NN-S-S1

SUPPORTED INVERTERS	SINGLE PHASE INVERTERS	UNITS
ELECTRICAL SERVICE		
AC Input Voltage (Nominal)	240	Vac
AC Frequency (Nominal)	60	Hz
Max AC Input Current	100	mA
Connector Type	Terminal block - 22 to 12	AWG
Grids supported	L1 / L2 / N / PE L1 / L2 / PE	
Power Consumption (Nominal)	3	W
METER ACCURACY (@ 77°F / 25°C, PF:0.7- 1)		
1 - 100% of Rated Current CT	±1.0	%
CURRENT TRANSFORMERS⁽¹⁾		
Nominal Input (at CT Rated Current)	CT1, CT2: 0.333	Vac RMS
Rated RMS current ⁽²⁾	200	A
Dimensions (Internal / External)	0.8 x 0.8; 2.4 x 2.4 / 20 x 20; 61 x 61	1.26 x 1.83; 3.3 x 4.5 / 32 x 46.5; 83.4 x 114
STANDARD COMPLIANCE		
Safety	UL 1741:2010 Ed.2(Supplement SA)+R: 07 Sep 2016	
Emissions	FCC 47 CFR Part 15 Subpart B	
ENVIRONMENTAL		
Operating Temperatures	-40 to +140 / -40 to +60	°F / °C
Relative Humidity (noncondensing)	5-90	%
Enclosure type	High impact, ABS and/or ABS/PC plastic UL 94V-0, IEC FV-0	
Protection Rating	NEMA Type 3R	
INSTALLATION SPECIFICATIONS		
Dimensions (HxWxD)	8.1 x 12.4 x 4.6 / 206.6 x 316 x 117.5	in / mm
Weight	3.9 / 1.8	lb / kg
Conduit Entry Diameters	0.75 or 1 / 19 or 25	in
Mounting Type	Bracket mount	

⁽¹⁾ Current Transformers should be ordered separately: SEACT0750-200NA-20 (200A) or SEACT1250-400NA-20 (400A), 20 per box
⁽²⁾ For other ratings contact SolarEdge

Current Transformer Dimensions

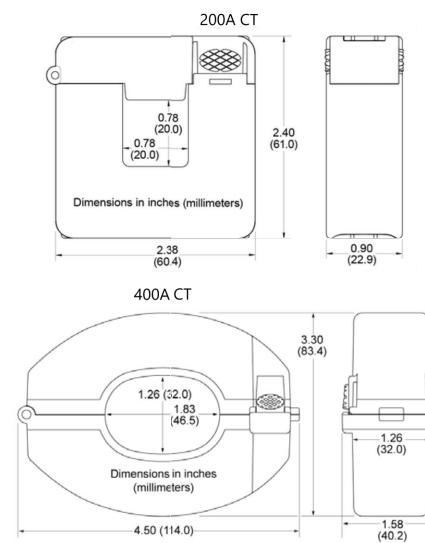


* Current Transformers (CTs) should be ordered separately: SEACT0750-200NA-20 (200A); SEACT1250-400NA-20 (400A). Each comes in boxes of 20.

© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 02/2019/V01/ENG NAM. Subject to change without notice.

FC RoHS

Connecting the Energy Meter

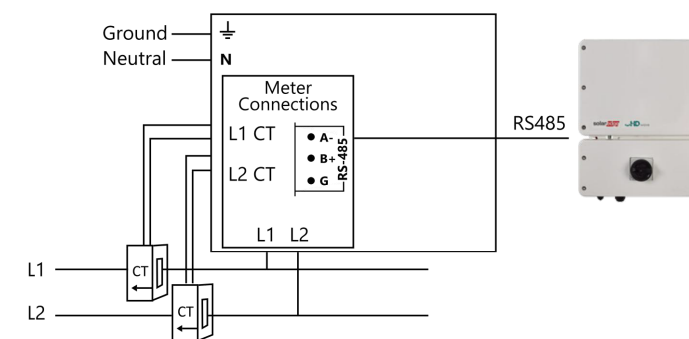

CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

R-004.00

(SHEET 13)



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

**DAWKINS
RESIDENCE**

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020

DESIGN BY: V.H.

CHECKED BY: M.M.

REVISIONS

R-005.00

(SHEET 14)

**POWERWALL
Backup Gateway 2**

The Backup Gateway 2 for Tesla Powerwall provides energy management and monitoring for solar self-consumption, time-based control, and backup.

The Backup Gateway 2 controls connection to the grid, automatically detecting outages and providing a seamless transition to backup power. When equipped with a main circuit breaker, the Backup Gateway 2 can be installed at the service entrance. When the optional internal panelboard is installed, the Backup Gateway 2 can also function as a load center.

The Backup Gateway 2 communicates directly with Powerwall, allowing you to monitor energy use and manage backup energy reserves from any mobile device with the Tesla app.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Input Short Circuit Current	10 kA ¹
Overcurrent Protection Device	100-200A; Service Entrance Rated ¹
Overvoltage Category	Category IV
AC Meter	Revenue accurate (+/- 0.2 %)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) ²
User Interface	Tesla App
Operating Modes	Support for solar self-consumption, time-based control, backup, and off-grid
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200A 6-space / 12 circuit Eaton BR Circuit Breakers
Warranty	10 years


¹When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.
²The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

COMPLIANCE INFORMATION

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 149 mm (26 in x 16 in x 6 in)
Weight	20.4 kg (45 lb)
Mounting options	Wall mount, Semi-flush mount

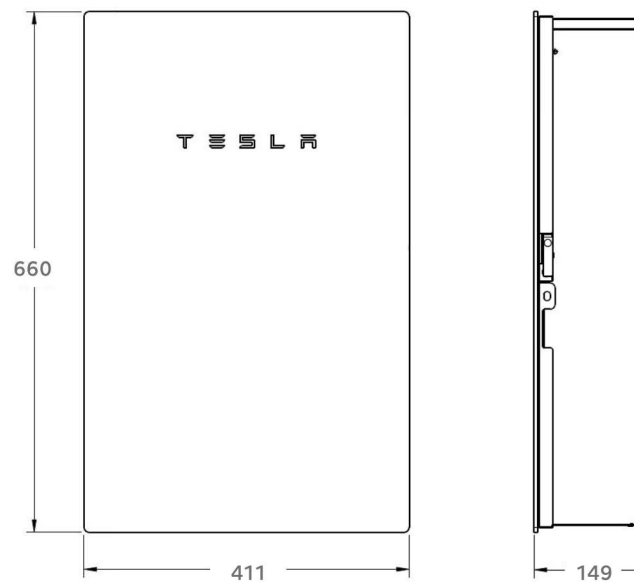

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R




POWERWALL 2 AC

The Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, load shifting and backup power.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.

TYPICAL SYSTEM LAYOUT

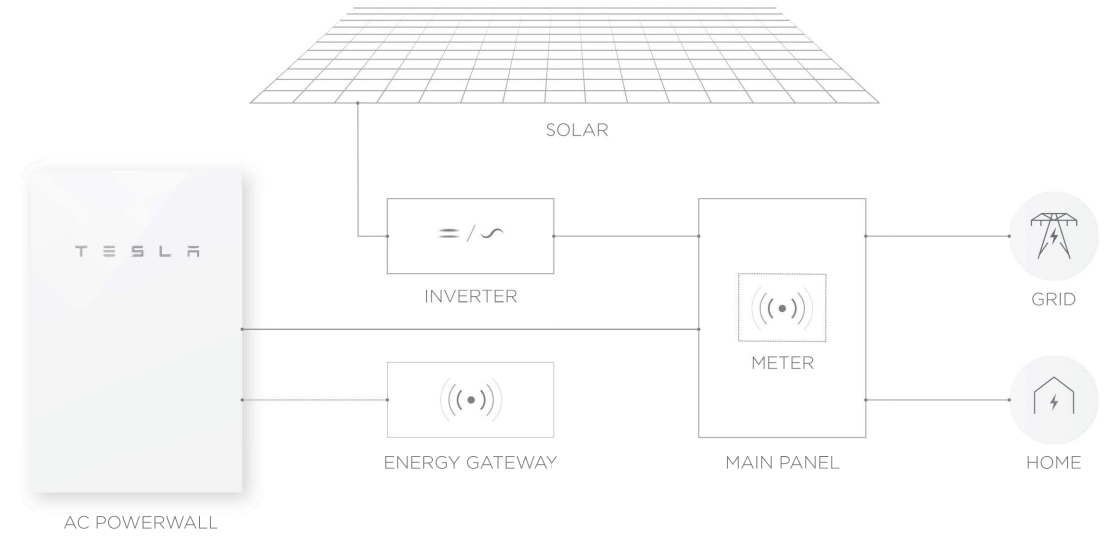

PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	208 V, 220 V, 230 V, 277 V, 100/200 V, 120/240 V
Feed-In Type	Single & Split-Phase
Grid Frequency	50 and 60 Hz
AC Energy ¹	13.2 kWh
Real Power, max continuous ²	5 kW (charge and discharge)
Real Power, peak (10 s) ²	7 kW (discharge only)
Apparent Power, max continuous ²	5.8 kVA (charge and discharge)
Apparent Power, peak (10 s) ²	7.2 kVA (discharge only)
Imbalance for Single-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor (full-rated power)	+/- 0.85
Depth of Discharge	100%
Internal Battery DC Voltage	50 V
Round Trip Efficiency ^{1,3}	89.0%
Warranty	10 years

¹Values provided for 25°C (77°F), 3.3 kW charge/discharge power.
²Values region-dependent.
³AC to battery to AC, at beginning of life.

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Storage Temperature	-30°C to 60°C (-22°F to 140°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Altitude	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP56 (Wiring)
Noise Level @ 1m	<40 dBA at 30°C (86°F)

MECHANICAL SPECIFICATIONS

Dimensions	1150 mm x 755 mm x 155 mm (45.3 in x 29.7 in x 6.1 in)
Weight	122 kg (269 lbs)
Mounting options	Floor or wall mount

ENERGY GATEWAY SPECIFICATIONS

User Interface	Tesla App
Connectivity	Wi-Fi, Ethernet, 3G
AC Meter	Revenue grade
Operating Modes	Support for wide range of usage scenarios
Backup Operation	Optional automatic disconnect switch
Modularity	Supports up to 9 AC-coupled Powerwalls

COMPLIANCE INFORMATION

Safety	UL 1642, UL 1741, UL 1973, UL 9540, UN 38.3, IEC 62109-1, IEC 62619, CSA C22.2.107.1
Grid Standards	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003, EN 61000 Class B
Environmental	RoHS Directive 2011/65/EU, WEEE Directive 2012/19/EU, 2006/66/EC
Seismic	AC156, IEEE 693-2005 (high)



CONTRACTOR

YES SOLAR SOLUTIONS
 PHONE: (919) 459-2846
 ADDRESS: 202 NORTH DIXON AVENUE
 CARY, NC 27513

LIC. NO.: 67356
 HIC. NO.:
 ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
 COATS, NC 27521
 APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)
RESOURCE DOCUMENT

DATE: 10.08.2020
 DESIGN BY: V.H.
 CHECKED BY: M.M.

REVISIONS

R-006.00
 (SHEET 15)

DESCRIPTION:

SNAPNRACK, UR-40 RAIL

DRAWN BY:

mwatkins



REVISION:

B



595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA
PHONE (415) 580-6900 • FAX (415) 580-6902

THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.

PART NUMBER(S):

232-02449, 232-02450, 232-02451

UR-40 RAIL PROPERTIES	
SKU	FINISH
232-02449	MILL
232-02450	CLEAR
232-02451	BLACK

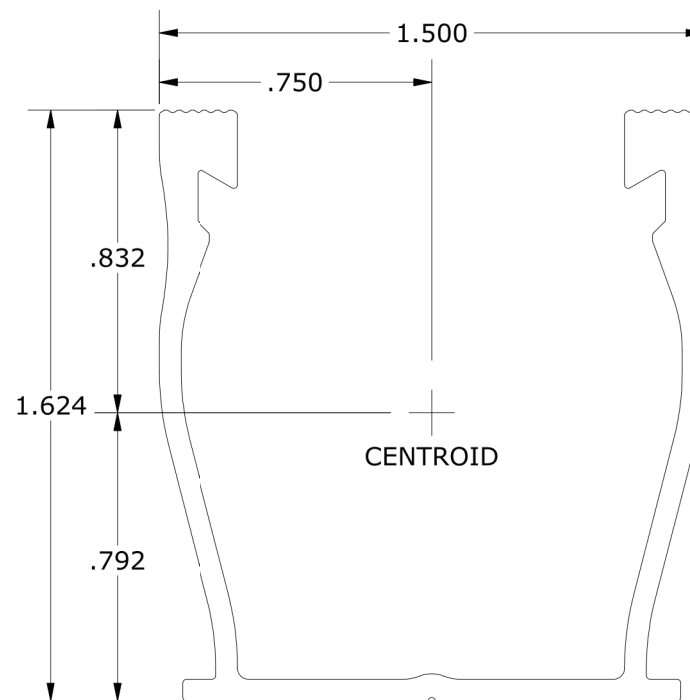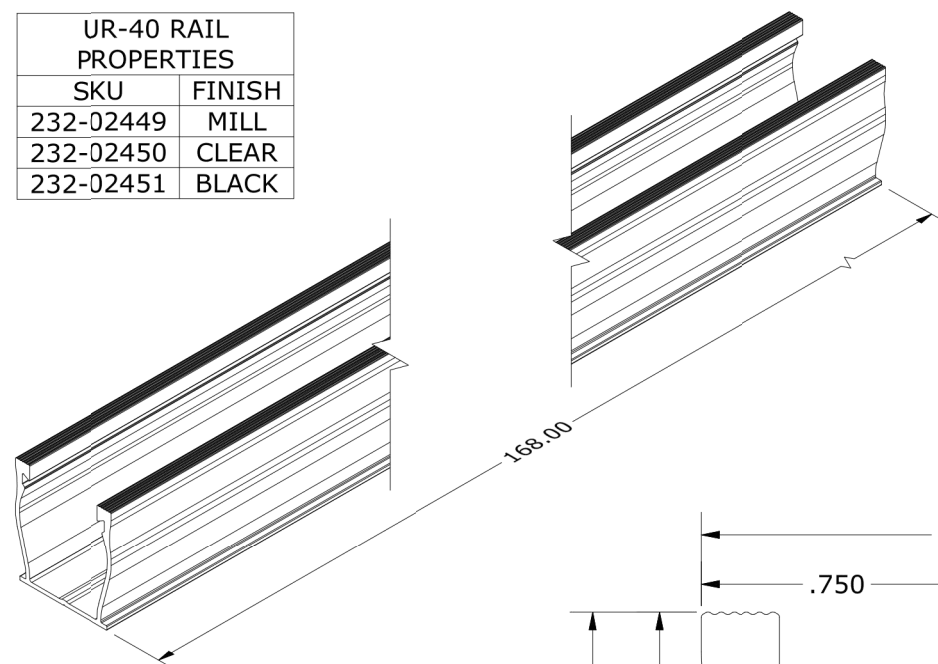

EQUIVALENT PROPERTIES	
A	0.357 in ²
Ixx	0.125 in ⁴
Iyy	0.132 in ⁴
Sx (TOP)	0.150 in ³
Sx (BOT)	0.158 in ³
Sy (LEFT)	0.175 in ³
Sy (RIGHT)	0.175 in ³

ALL DIMENSIONS IN INCHES

MATERIALS:	6000 SERIES ALUMINUM	OPTIONS:
DESIGN LOAD (LBS):	N/A	CLEAR / BLACK ANODIZED
ULTIMATE LOAD (LBS):	N/A	MILL FINISH
TORQUE SPECIFICATION:	N/A LB-FT	BUNDLES OF 144
CERTIFICATION:	UL 2703, FILE E359313	BOXES OF 8
WEIGHT (LBS):	5.85	



CONTRACTOR

YES SOLAR SOLUTIONS

PHONE: (919) 459-2846

ADDRESS: 202 NORTH DIXON AVENUE
CARY, NC 27513

LIC. NO.: 67356

HIC. NO.:

ELE. NO.: 31227-U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
COATS, NC 27521
APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020


DESIGN BY: V.H.


CHECKED BY: M.M.


REVISIONS

R-007.00

(SHEET 16)


DESCRIPTION: SNAPNRACK, ULTRA RAIL COMP KIT	DRAWN BY: mwatkins	 595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 580-6900 • FAX (415) 580-6902 <small>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</small>
PART NUMBER(S): SEE BELOW	REVISION: B	

DESCRIPTION: SNAPNRACK, ULTRA RAIL COMP KIT	DRAWN BY: mwatkins	 595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 580-6900 • FAX (415) 580-6902 <small>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</small>
PART NUMBER(S): SEE BELOW	REVISION: B	

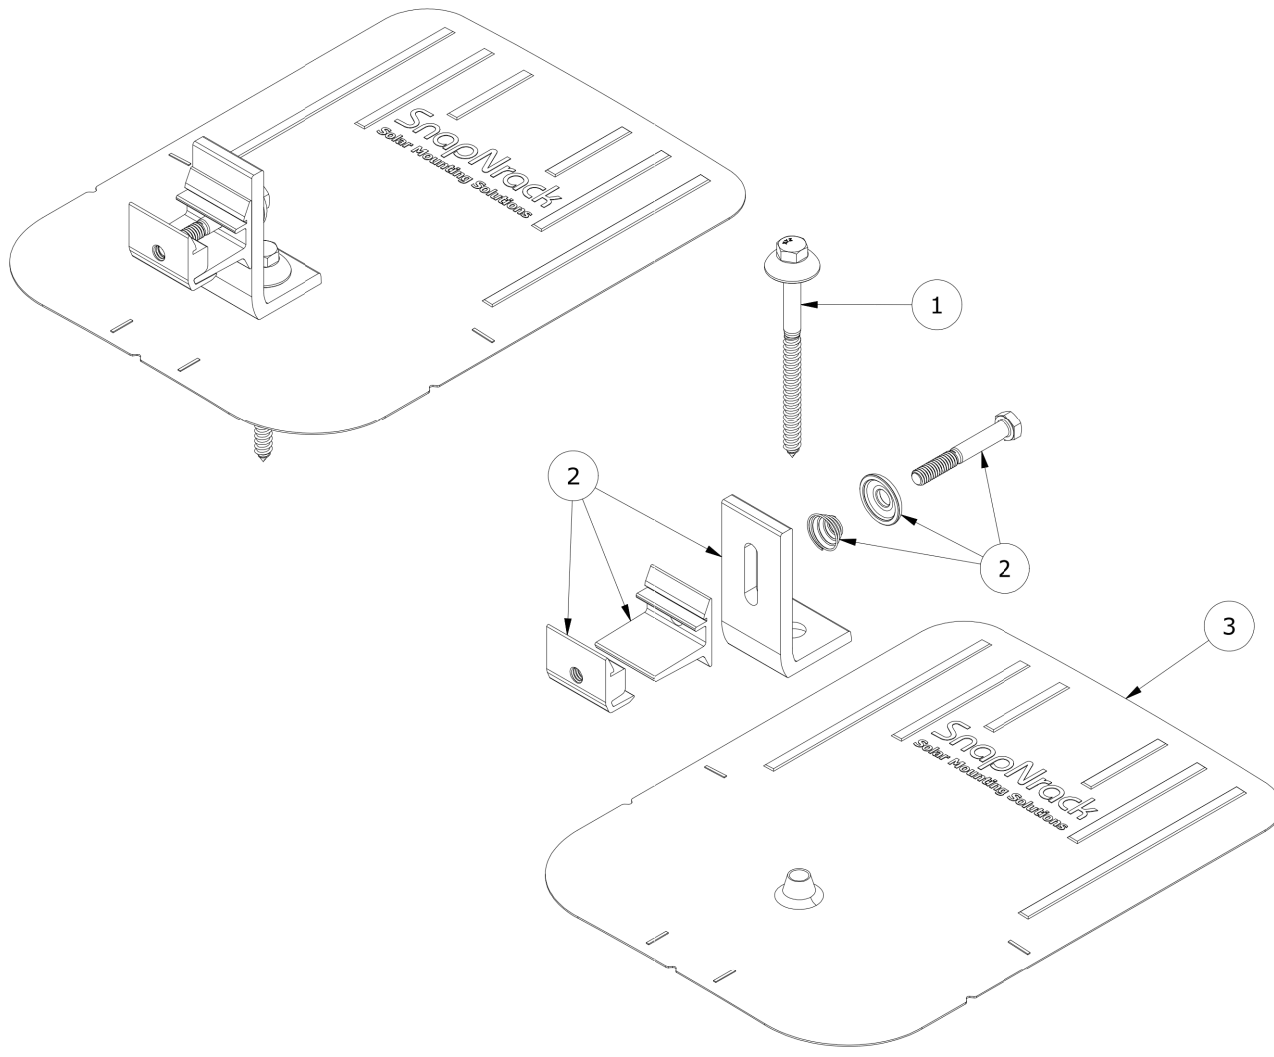


PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	242-92266	SNAPNRACK, UMBRELLA LAG, TYPE 3, 4IN, SS
2	1	242-01219, 242-01220	SNAPNRACK, ULTRA FOOT FOR U FLASHING, SILVER / BLACK
3	1	232-01375, 232-01376	SNAPNRACK, COMP FLASHING, 9IN X 12IN, SILVER / BLACK ALUM

MATERIALS:	6000 SERIES ALUMINUM, STAINLESS STEEL, RUBBER
DESIGN LOAD (LBS):	405 UP, 788 DOWN, 236 SIDE
ULTIMATE LOAD (LBS):	2006 UP, 4000 DOWN, 1070 SIDE
TORQUE SPECIFICATION:	12 LB-FT
CERTIFICATION:	UL 2703, FILE E359313
WEIGHT (LBS):	0.80

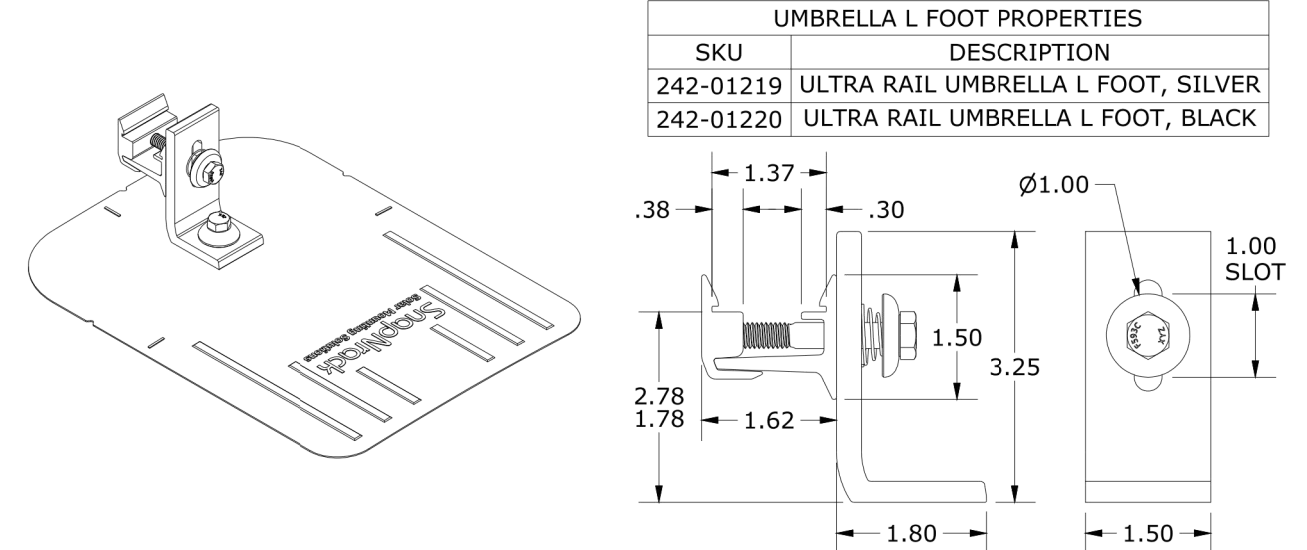

UMBRELLA L FOOT PROPERTIES	
SKU	DESCRIPTION
242-01219	ULTRA RAIL UMBRELLA L FOOT, SILVER
242-01220	ULTRA RAIL UMBRELLA L FOOT, BLACK

COMP FLASHING PROPERTIES	
SKU	DESCRIPTION
232-01375	COMP FLASHING, 9" X 12", BLACK ALUM
232-01376	COMP FLASHING, 9" X 12", SILVER ALUM

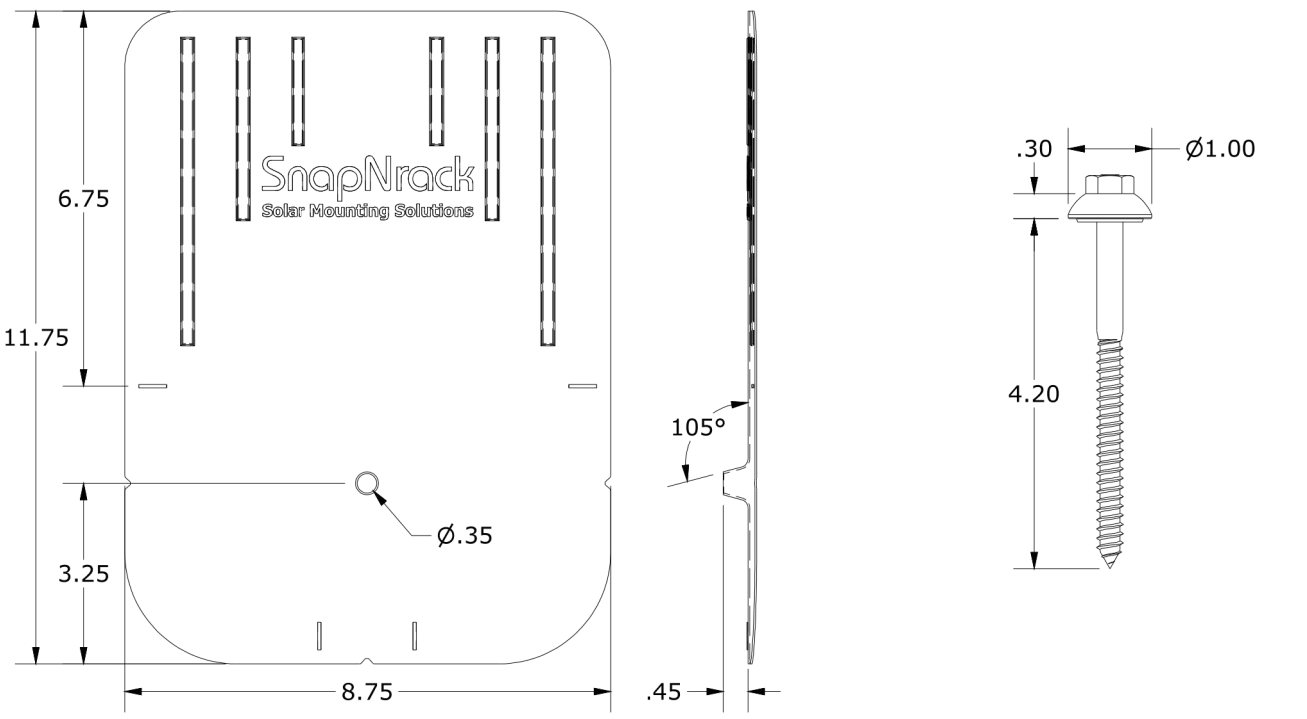

ALL DIMENSIONS IN INCHES



CONTRACTOR

YES SOLAR SOLUTIONS
 PHONE: (919) 459-2846
 ADDRESS: 202 NORTH DIXON AVENUE
 CARY, NC 27513

LIC. NO.: 67356
 HIC. NO.:
 ELE. NO.: 31227-U
UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 14.190 kWp

DAWKINS RESIDENCE

5267 NC-27E
 COATS, NC 27521
 APN: 1600-26-8872.000

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10.08.2020
 DESIGN BY: V.H.
 CHECKED BY: M.M.

REVISIONS

R-008.00
 (SHEET 17)