

October 9, 2020

To: Blue Raven Solar  
1403 N. Reasearch Way, Bldg. J  
Orem, UT. 84097

Subject: Certification Letter  
Turlington Residence  
1150 S. Lincoln St.  
Coats, NC. 27521

To Whom It May Concern,

A jobsite observation of the condition of the existing framing system was performed by an audit team of Blue Raven Solar. All attached structural calculations are based on these observations and the design criteria listed below.

On the above referenced project, the roof structural framing has been reviewed for additional loading due to the installation of the solar PV addition to the roof. The structural review, including the plans and calculations only apply to the section of the roof that is directly supporting the solar PV system and its supporting elements. The observed roof framing is described below.

The roof structure of (MP1) consists of composition shingle on roof plywood that is supported by 2x6 rafters @ 16"o.c. with ceiling joists acting as rafter ties. The rafters have a max projected horizontal span of 12'-0", with a slope of 22 degrees. The rafters are connected at the ridge to a ridge board and are supported at the eave by a load bearing wall.

The existing roof framing system of (MP1) is judged to be adequate to withstand the loading imposed by the installation of the solar panels. No reinforcement is necessary.

The spacing of the solar standoffs should be kept at 64" o.c. for landscape and 48" o.c. for portrait orientation, with a staggered pattern to ensure proper distribution of loads.

The scope of this report is strictly limited to an evaluation of the fastener attachment, underlying framing and supporting structure only. The attachment's to the existing structure are required to be in a staggered pattern to ensure proper distribution of loading. All panels, racking and hardware shall be installed per manufacturer specifications and within specified design limitations. All waterproofing shall be provided by the manufacturer.


Design Criteria:

- Applicable Codes = 2018 North Carolina State Building Code (NCSBC), ASCE7-10, and NDS-12
- Roof Dead Load = 8 psf (MP1)
- Roof Live Load = 20 psf
- Wind Speed = 115 mph, Exposure C
- Ground Snow Load = 15 psf - Roof Snow Load = 10.5 psf
- Attachments: (1) 5/16" dia lag screw with 2.5" min embedment depth, at spacing shown above.

Please contact me with any further questions or concerns regarding this project.

Sincerely,

John Calvert, P.E.  
Project Engineer

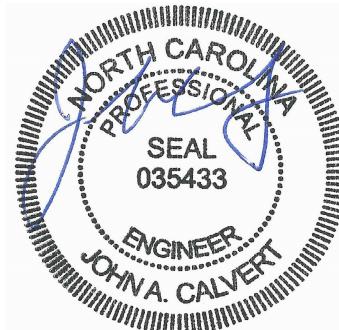



BLUE RAVEN SOLAR, LLC  
Firm License No. D-0396  
1403 North Research Way  
Building J  
Orem , UT 84097

## Gravity Loading

Roof Snow Load Calculations	
$p_g$ = Ground Snow Load =	15 psf
$p_f = 0.7 C_e C_t I p_g$	(ASCE7 - Eq 7-1)
$C_e$ = Exposure Factor =	1 (ASCE7 - Table 7-2)
$C_t$ = Thermal Factor =	1 (ASCE7 - Table 7-3)
$I$ = Importance Factor =	1
$p_f$ = Flat Roof Snow Load =	10.5 psf
$p_s = C_s p_f$	(ASCE7 - Eq 7-2)
$C_s$ = Slope Factor =	1
$p_s$ = Sloped Roof Snow Load =	10.5 psf

### PV Dead Load = 3 psf (Per Blue Raven Solar)

PV System Weight	
Weight of PV System (Per Blue Raven Solar)	3.0 psf
X Standoff Spacing =	4.00 ft
Y Standoff Spacing =	5.50 ft
Standoff Tributary Area =	22.00 sft
<b>Point Loads of Standoffs</b>	<b>66 lb</b>

Note: PV standoffs are staggered to ensure proper distribution of loading

### Roof Live Load = 20 psf

Note: Roof live load is removed in area's covered by PV array.

Roof Dead Load (MP1)	
Composition Shingle	4.00
Roof Plywood	2.00
2x6 Rafters @ 16"o.c.	1.72
Vaulted Ceiling	0.00 (Ceiling Not Vaulted)
Miscellaneous	0.28
<b>Total Roof DL (MP1)</b>	<b>8.0 psf</b>
DL Adjusted to 22 Degree Slope	8.6 psf

### Wind Calculations

#### Per ASCE7-10 Components and Cladding

Input Variables	
Wind Speed	115 mph
Exposure Category	C
Roof Shape	Gable/Hip
Roof Slope	22 degrees
Mean Roof Height	20 ft
Effective Wind Area	19.3 ft

#### Design Wind Pressure Calculations

$$\text{Wind Pressure } P = qh^*G^*C_n$$

$$qh = 0.00256 * K_z * K_{zt} * K_d * V^2 \quad (\text{Eq. 30.3-1})$$

$$K_z (\text{Exposure Coefficient}) = 0.9 \quad (\text{Table 30.3-1})$$

$$K_{zt} (\text{topographic factor}) = 1 \quad (\text{Fig. 26.8-1})$$

$$K_d (\text{Wind Directionality Factor}) = 0.85 \quad (\text{Table 26.6-1})$$

$$V (\text{Design Wind Speed}) = 115 \text{ mph} \quad (\text{Fig. 26.5-1A})$$

$$\text{Risk Category} = \text{II} \quad (\text{Table 1.5-1})$$

$$qh = 25.90$$

$$0.6 * qh = 15.54$$

#### Standoff Uplift Calculations-Portrait

	Zone 1	Zone 2	Zone 3	Positive	
G <sub>Cp</sub> =	-0.86	-1.51	-2.37	0.42	(Fig. 30.4-1)
Uplift Pressure =	-13.40 psf	-23.47 psf	-36.86 psf	11.0 psf	
X Standoff Spacing =	4.00	4.00	2.67		
Y Standoff Spacing =	5.50	2.75	2.75		
Tributary Area =	22.00	11.00	7.33		
Footing Uplift =	-295 lb	-258 lb	-270 lb		

#### Standoff Uplift Calculations-Landscape

	Zone 1	Zone 2	Zone 3	Positive	
G <sub>Cp</sub> =	-0.86	-1.51	-2.37	0.42	(Fig. 30.4-1)
Uplift Pressure =	-13.40 psf	-23.47 psf	-36.86 psf	10.0 psf	(Minimum)
X Standoff Spacing =	5.33	5.33	3.56		
Y Standoff Spacing =	3.50	1.75	1.75		
Tributary Area =	18.67	9.33	6.22		
Footing Uplift =	-250 lb	-219 lb	-229 lb		

#### Standoff Uplift Check

Maximum Design Uplift = -295 lb

Standoff Uplift Capacity = 450 lb

450 lb capacity > 295 lb demand **Therefore, OK**

#### Fastener Capacity Check

Fastener = 1 - 5/16" dia Lag

Number of Fasteners = 1

Embedment Depth = 2.5

Pullout Capacity Per Inch = 250 lb

Fastener Capacity = 625 lb

w/ F.S. of 1.5 & DOL of 1.6= 667 lb

667.2 lb capacity > 295 lb demand **Therefore, OK**


### Framing Check

(MP1)

PASS

Dead Load            8.6 psf  
PV Load            3.0 psf  
Live Load          20.0 psf

Governing Load Combo = DL + LL  
Total Load        31.6 psf

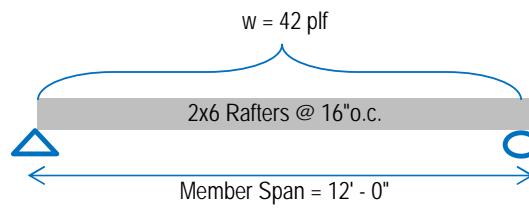

#### Member Properties

Member Size	S (in^3)	I (in^4)	Lumber Sp/Gr	Member Spacing @ 16"o.c.
2x6	7.56	20.80	DF#2	

#### Check Bending Stress

Fb (psi) =	f'b	x	Cd	x	Cf	x	Cr	(NDS Table 4.3.1)
	900	x	1.25	x	1.3	x	1.15	

Allowed Bending Stress = 1681.8 psi

$$\begin{aligned} \text{Maximum Moment} &= (wL^2) / 8 \\ &= 759.079 \text{ ft}\# \\ &= 9108.94 \text{ in}\# \end{aligned}$$

$$\begin{aligned} \text{Actual Bending Stress} &= (\text{Maximum Moment}) / S \\ &= 1204.5 \text{ psi} \end{aligned}$$

Allowed > Actual -- 71.7% Stressed -- Therefore, OK

#### Check Deflection

Allowed Deflection (Total Load) =	$L/180$	(E = 1600000 psi Per NDS)
	= 0.8 in	
Deflection Criteria Based on =	Continuous Span	
Actual Deflection (Total Load) =	$(w^2 L^4) / (185 E I)$	
	= 0.246 in	
	= $L/586$ > $L/180$	Therefore OK

$$\text{Allowed Deflection (Live Load)} = \frac{L}{240}$$

0.6 in

$$\begin{aligned} \text{Actual Deflection (Live Load)} &= \frac{(w^2 L^4)}{(185 E I)} \\ &= 0.156 \text{ in} \\ &= \frac{L}{924} > \frac{L}{240} \quad \text{Therefore OK} \end{aligned}$$

#### Check Shear

Member Area = 8.3 in^2	Fv (psi) = 180 psi	(NDS Table 4A)
Allowed Shear = $F_v * A = 1485 \text{ lb}$		Max Shear (V) = $w * L / 2 = 253 \text{ lb}$

Allowed > Actual -- 17.1% Stressed -- Therefore, OK