# **GENERAL NOTES**

# **AERIAL VIEW**

## CODES AND STANDARDS

1. ALL WORK SHALL COMPLY WITH 2017 NATIONAL ELECTRIC CODE (NEC), 2018 NORTH CAROLINA BUILDING CODE (NCBC), 2018 NORTH CAROLINA RESIDENTIAL CODE (NCRC), PLUMBING CODE (NCPC), AND ALL STATE AND LOCAL BUILDING, ELECTRICAL, AND PLUMBING CODES.

2. DRAWINGS HAVE BEEN DETAILED ACCORDING TO UL LISTING REQUIREMENTS.

### SITE NOTES / OSHA REGULATION

1. A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS 2. THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES

3. THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS

4. ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SHALL SERVE TO PROTECT THE BUILDING OR STRUCTURE.

### SOLAR CONTRACTOR

1. MODULE CERTIFICATIONS WILL INCLUDE UL1703, IEC61646, IEC61730.

2. IF APPLICABLE, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE MARKED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS.

3. AS INDICATED BY DESIGN, OTHER NRTL LISTED MODULE GROUNDING DEVICES MAY BE USED IN PLACE OF STANDARD GROUNDING LUGS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ.

4. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.

5. CONDUIT POINT OF PENETRATION FROM EXTERIOR TO INTERIOR TO BE INSTALLED AND SEALED WITH A SUITABLE SEALING COMPOUND.

6. DC WIRING LIMITED TO MODULE FOOTPRINT W/ ENPHASE AC SYSTEM.

7. ENPHASE WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY W/ SUITABLE WIRING CLIPS.

8. MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC UNLESS NOT AVAILABLE.

9. ALL INVERTERS, MOTOR GENERATORS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AC PHOTOVOLTAIC MODULES, DC COMBINERS, DC-TO-DC CONVERTERS, SOURCE CIRCUIT

COMBINERS, AND CHARGE CONTROLLERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (B). 10. ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE

11. TERMINALS AND LUGS WILL BE TIGHTENED TO MANUFACTURER TORQUE SPECIFICATIONS (WHEN PROVIDED) IN ACCORDANCE WITH NEC CODE 110.14(D) ON ALL ELECTRICAL CONNECTIONS.

## EQUIPMENT LOCATIONS

1. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION INEC 110.261.

2. EQUIPMENT INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY [NEC 690.31 (A)] AND [NEC TABLE 310.15 (B)].

3. ADDITIONAL AC DISCONNECTS SHALL BE PROVIDED WHERE THE INVERTER IS NOT ADJACENT


TO THE UTILITY AC DISCONNECT, OR NOT WITHIN SIGHT OF THE UTILITY AC DISCONNECT.

4. ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES.

5. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE



Sealed For Existing Roof & Attachment Only

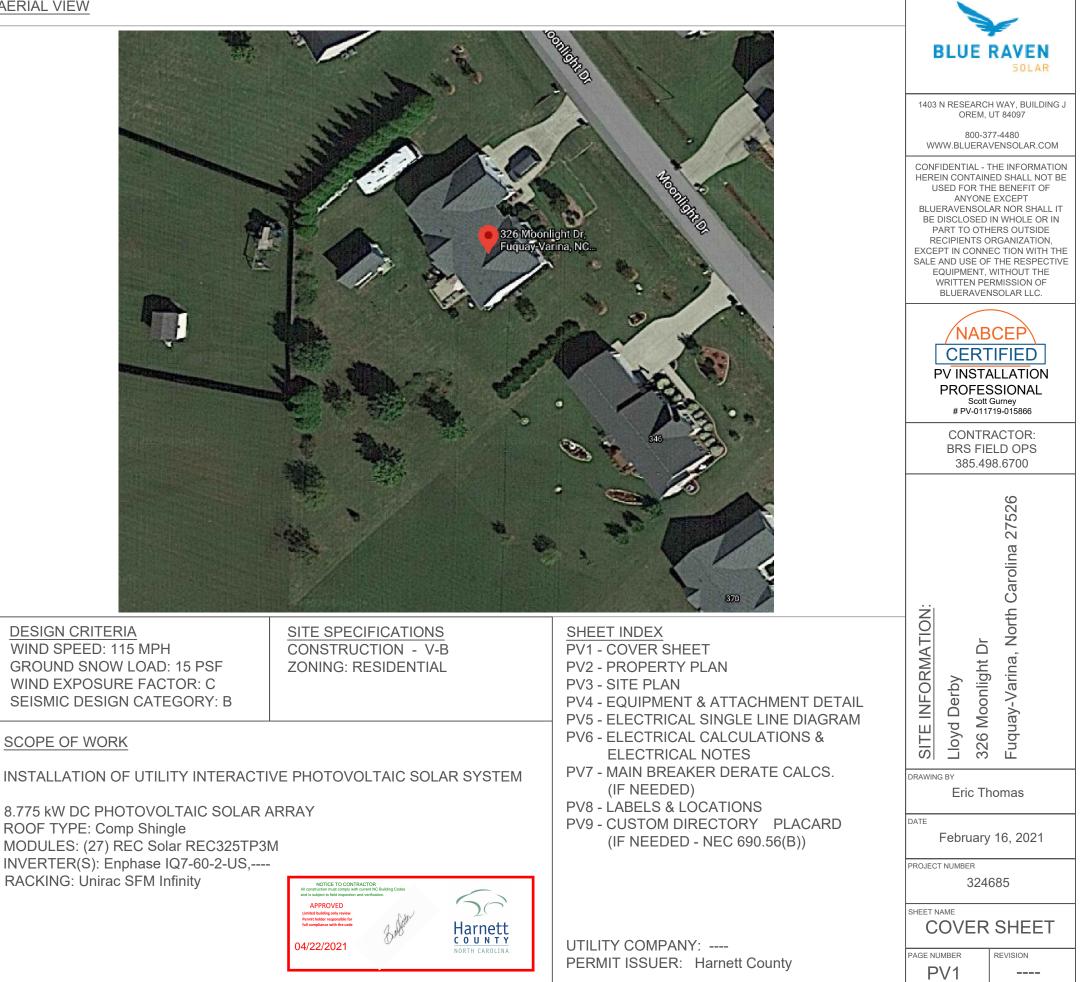


**DESIGN CRITERIA** WIND SPEED: 115 MPH **GROUND SNOW LOAD: 15 PSF** WIND EXPOSURE FACTOR: C SEISMIC DESIGN CATEGORY: B

SCOPE OF WORK

8.775 kW DC PHOTOVOLTAIC SOLAR ARRAY **ROOF TYPE: Comp Shingle** MODULES: (27) REC Solar REC325TP3M INVERTER(S): Enphase IQ7-60-2-US,----**RACKING: Unirac SFM Infinity** 



2/19/2021

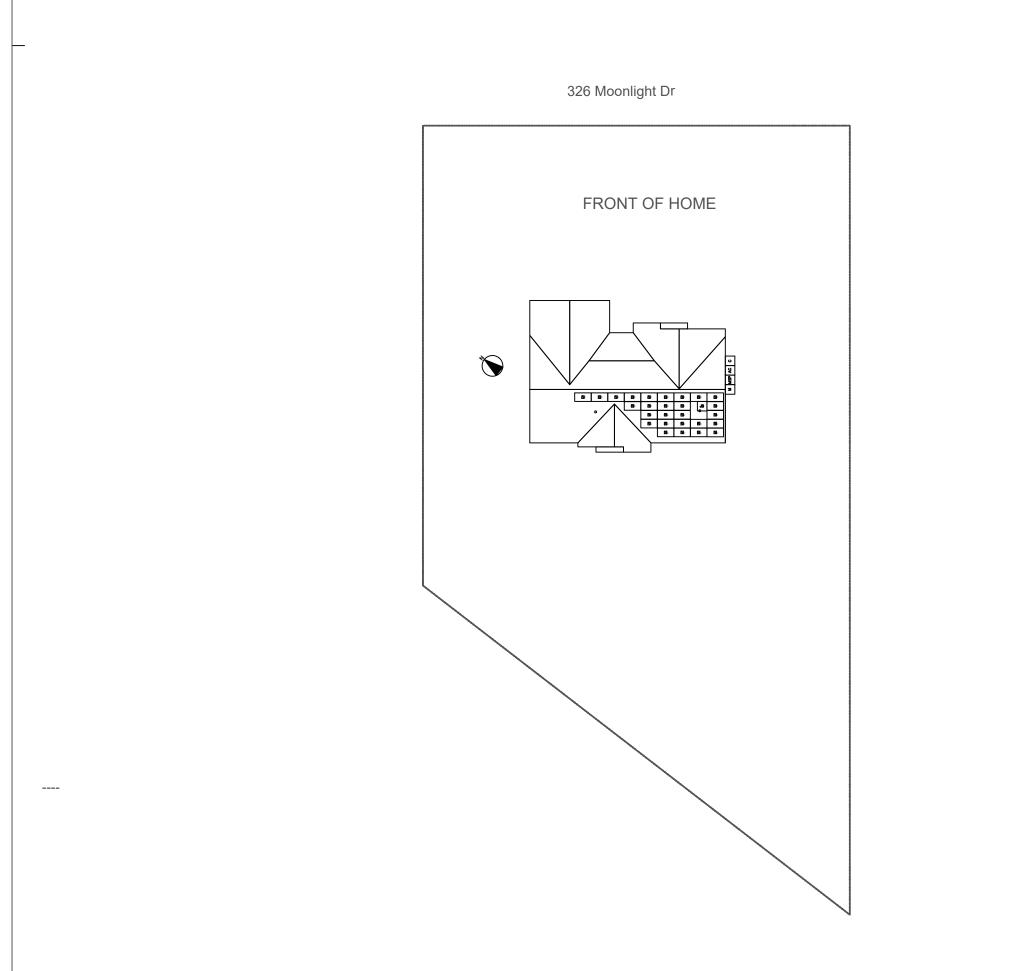





2/19/2021


LEGEND		
INV INVERTER & DC DISCONNECT	BLUE	RAVEN
SUB (E) SUBPANEL		SOLAR
LC (N) LOAD CENTER	1403 N RESEARCH	I WAY, BUILDING J
AC DISCONNECT	OREM, U	JT 84097 7-4480
		/ENSOLAR.COM
MSP MAIN SERVICE PANEL	HEREIN CONTAIN	HE INFORMATION ED SHALL NOT BE
	ANYONE	E BENEFIT OF EXCEPT AR NOR SHALL IT
TS TRANSFER SWITCH	PART TO OTH	IN WHOLE OR IN ERS OUTSIDE
C COMBINER BOX/AGGREGATOR	EXCEPT IN CONNE	RGANIZATION, EC TION WITH THE THE RESPECTIVE
(PV) PV REVENUE METER	WRITTEN PE	WITHOUT THE RMISSION OF ISOLAR LLC.
FIRE SETBACK	BLUERAVEN	ISOLAR LLC.
EMT CONDUIT RUN (TO BE DETERMINED IN FIELD)		- \
PV WIRE STRING		LLATION
PROPERTY LINE		Gurney Gurney 19-015866
SCALE: 1/16" = 1'-0"	BRS FIE	ACTOR: ELD OPS 18.6700
Sealed For Existing Roof & Attachment Only	<u>SITE INFORMATION:</u> Lloyd Derby 326 Moonlight Dr	Fuquay-Varina, North Carolina 27526
	drawing by Eric T	homas
	Februar	y 16, 2021
	PROJECT NUMBER	685
	SHEET NAME PROPER	TY PLAN
	PAGE NUMBER	REVISION

MMMMMM

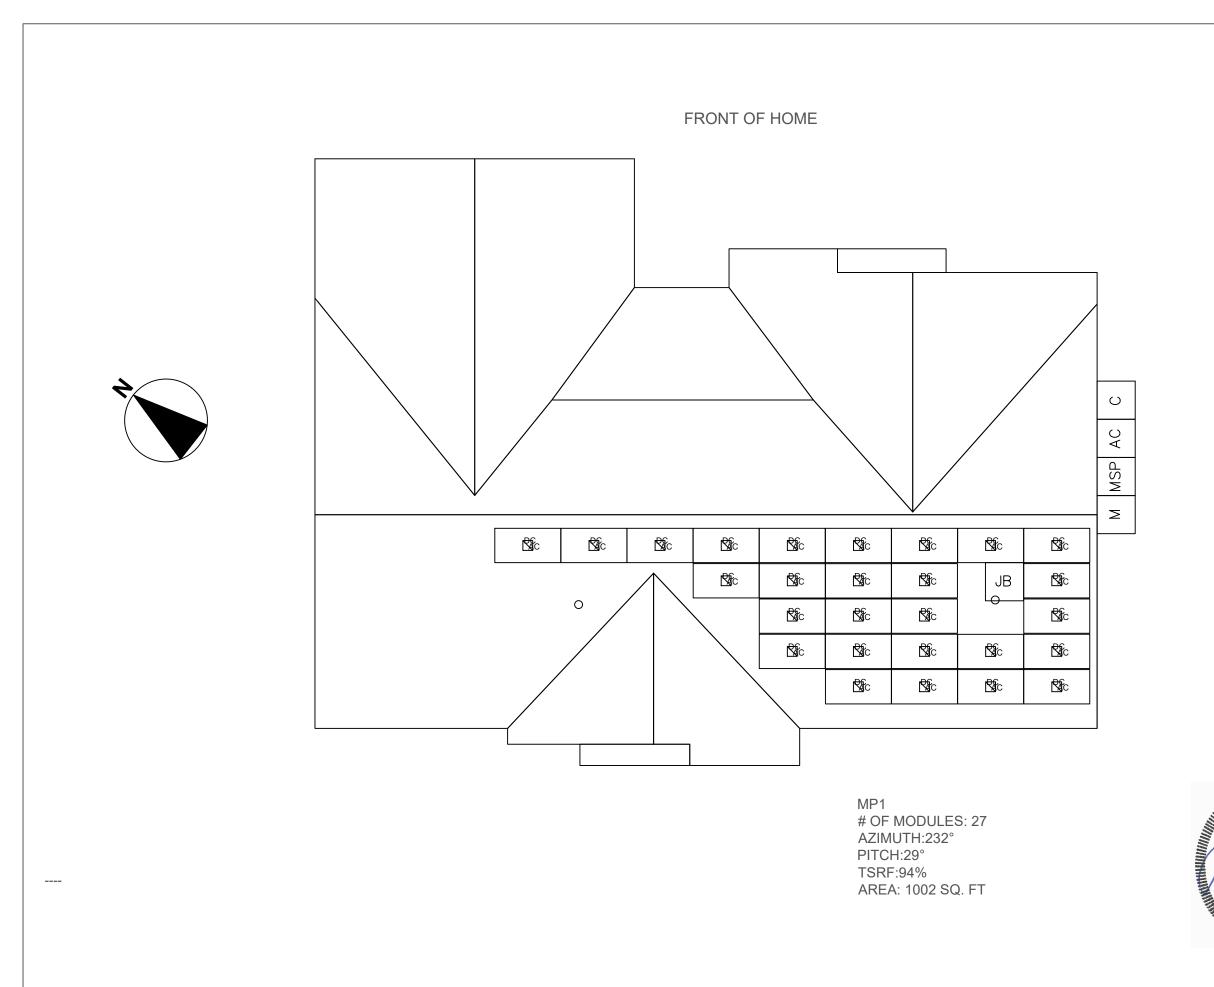

	LEGEND		
	INV INVERTER & DC DISCONNECT	BLUE	RAVEN SOLAR
	LC (N) LOAD CENTER	1403 N RESEARCH	
	AC AC DISCONNECT	OREM, U 800-37	JT 84097
	M UTILITY METER	WWW.BLUERAV	
	MSP MAIN SERVICE PANEL	HEREIN CONTAIN USED FOR TH	ED SHALL NOT BE IE BENEFIT OF
	JB JUNCTION BOX	BLUERAVENSOL BE DISCLOSED	EXCEPT AR NOR SHALL IT IN WHOLE OR IN
	TS TRANSFER SWITCH	RECIPIENTS C	IERS OUTSIDE DRGANIZATION, EC TION WITH THE
	C COMBINER BOX/AGGREGATOR	EQUIPMENT,	THE RESPECTIVE WITHOUT THE RMISSION OF
	FIRE SETBACK		NSOLAR LLC.
	EMT CONDUIT RUN (TO BE DETERMINED IN FIELD)		
	PV WIRE STRING	PV INSTA	IFIED ALLATION SSIONAL
	PROPERTY LINE	Scott	Gurney 719-015866
	SCALE: 1/8" = 1'-0"	BRS FIE	ACTOR: ELD OPS 08.6700
E	ealed For xisting Roof & ttachment Only	SITE INFORMATION: Lloyd Derby 326 Moonlight Dr	Euquay-Varina, North Carolina 27526
Will OP	OFE SSION P	drawing by Eric T	homas
	SEAL 035433	Februar	y 16, 2021
	WGINEER-	PROJECT NUMBER	685
-11		SHEET NAME	PLAN
2,	/19/2021		REVISION
		PV3	

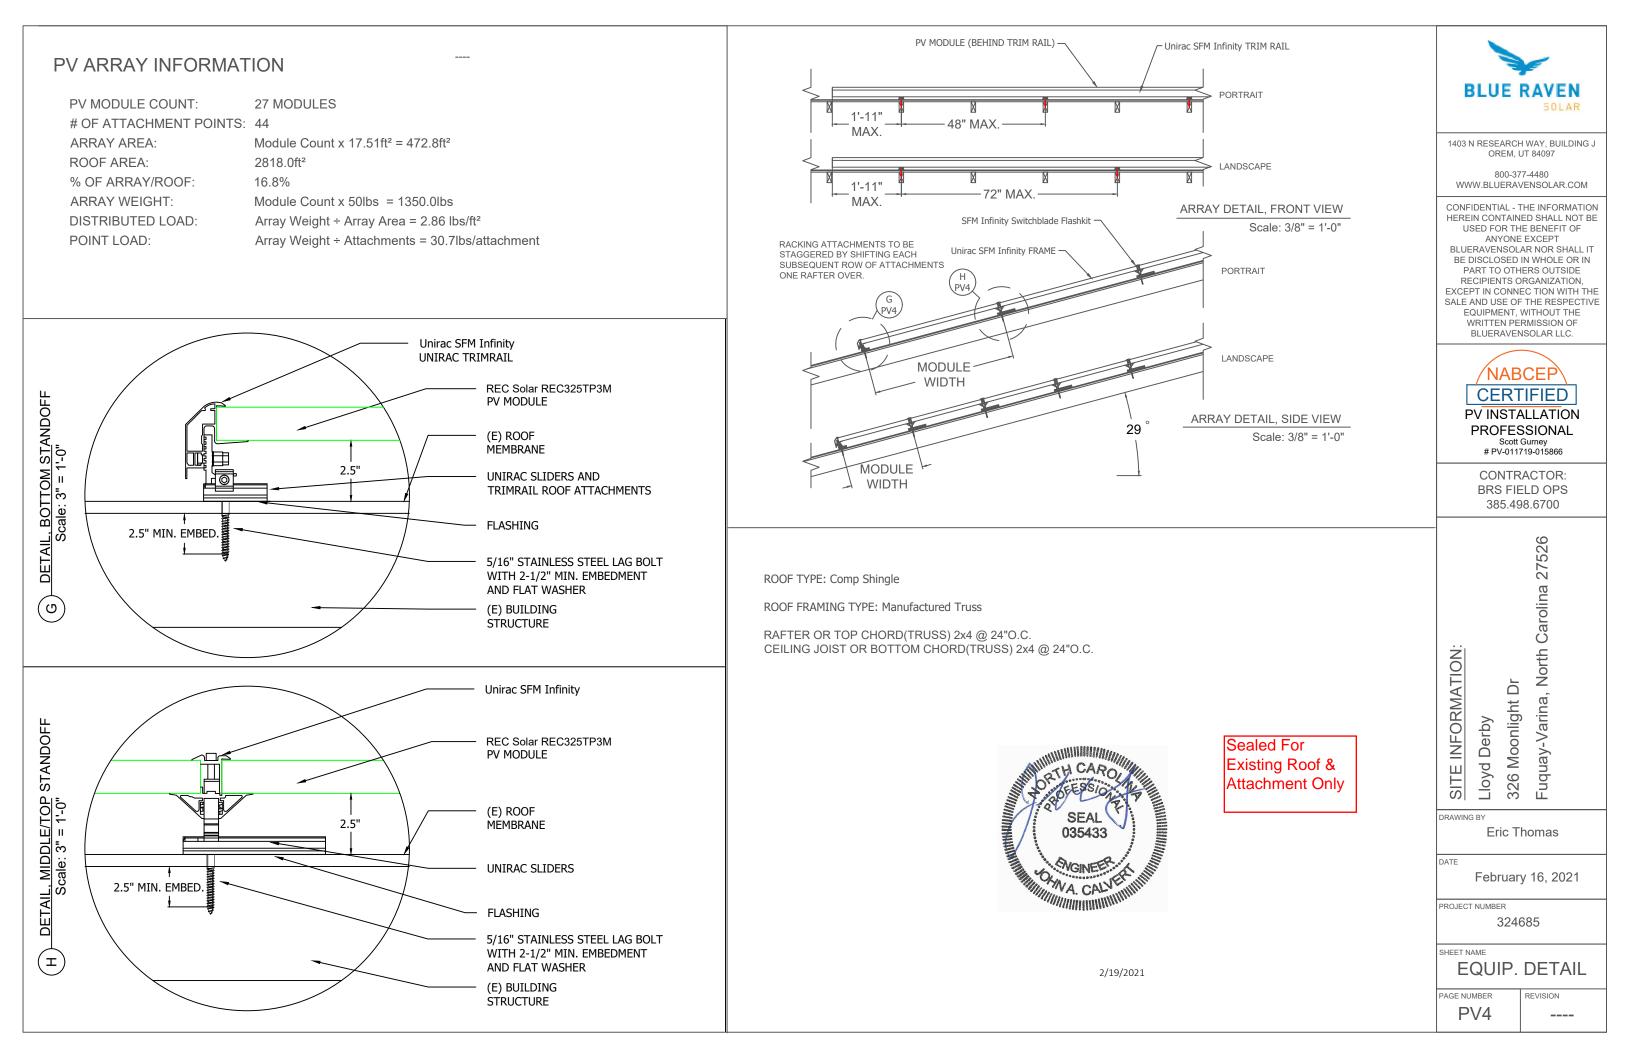

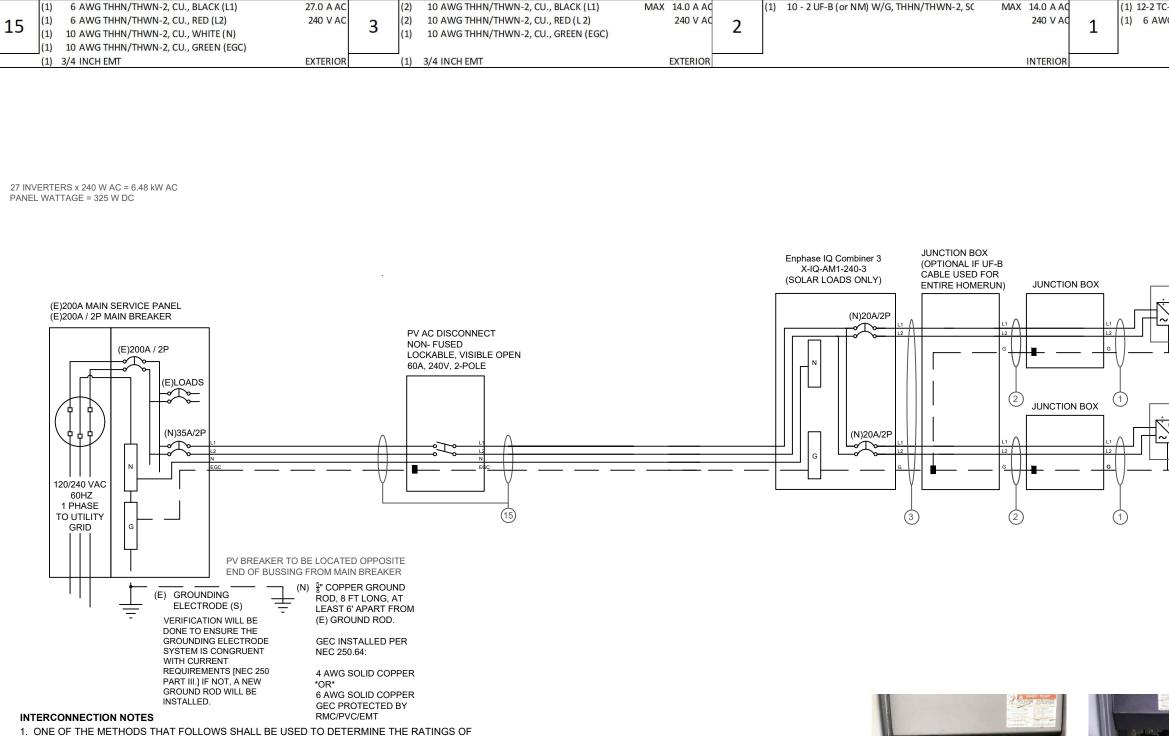

1. ONE OF THE METHODS THAT FOLLOWS SHALL BE USED TO DETERMINE THE RATINGS OF BUSBARS AND PANELBOARDS. (a) THE SUM OF 125 PERCENT OF THE INVERTER(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED THE AMPACITY OF THE BUS BAR. (b) WHERE TWO SOURCES, ONE THE UTILITY AND THE OTHER AN INVERTER ARE LOCATED AT OPPOSITE ENDS OF A BUSBAR THAT CONTAINS LOADS, THE SUM OF 125 PERCENT OF THE INVERTER(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR [NEC 705.12].

### **DISCONNECT NOTES**

 DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)
 AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH



КОЛ КЕС Solar REC325TP3 (2) перьвае 107-00-200 пукетка (2) перьвае 107-00-200 пукетка (2) поровае 107-00-200 пукетка (2) поровае 107-00-200 пукетка (2) поровае 107-00-200 пукетка (2) поровае 100-00-100-00-00-00-00-00-00-00-00-00-00					-	-	
(27) REC Solar REC325TP3M (LI 1741 COMPLIANT TAYL COMPLIANT (DECIDES MAX FOR ALL SUB-BRANCIC)         (I) CIRCUIT (S) TO COMPLY WITH VRISE CALC (I) CIRCUIT (S) TO COMPLY WITH VRISE CALC (I) CIRCUIT (I)	E	XTERIOR	B	BLU	EF		
(27) REC Solar REC32STP3M UL 1703 COMPLIANT (27) Enghase 107-80-21/85 MICRO INVERTERS UL 1741 COMPLIANT CROUT(S) TO COMPLY WITH VRISE CALCS         (1) CIRCUIT OF 14 MODULES       (1) CIRCUIT OF 14 MODULES         (1) CIRCUIT OF 13 MODULES       (1) CIRCUIT OF 13 MODULES         (2) CONTRACTOR: BRS FIELD OPS			1403 M				LDING J
(L1) TO3 COMPLIANT         (UI) TO3 COMPLIANT         (UI) TO1 COMPLANT         YMODULES MAX FOR ALL SUB-BRANCH         CRUIT(S) TO COMPLY WITH VRISE CALCS         (I) CIRCUIT         (II) CIRCUIT         (II) CIRCUIT         (III) CIRCUIT         (IIII) CIRCUIT         (IIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIII			ww				.COM
Image: Construction of the second	UL 1703 COMPLIANT (27) Enphase IQ7-60-2-US MICRO INVER UL 1741 COMPLIANT 7 MODULES MAX FOR ALL SUB-BRAN CIRCUIT(S) TO COMPLY WITH VRISE C	ксн	HERE US BLUE BE D PA RE EXCEP SALE A EC	IN CON SED FC AN RAVEN DISCLO ART TC CIPIEN PT IN C AND US QUIPMI VRITTE	ITAINE PR THE YONE NSOLA SED II OTHE ITS OF ONNE SE OF ENT, V	ED SHALL E BENEFIT EXCEPT AR NOR SH N WHOLE ERS OUTS RGANIZAT C TION W THE RESH WITHOUT	NOT BE T OF HALL IT OR IN SIDE TON, THT THE PECTIVE THE OF
BRS FIELD OPS 385.498.6700				CE V IN PRO # P\	STA STA FES Scott G /-0117	IFIEC LLATIC SIONA Gurney 19-015866	L
INTERVISION INTER				BRS	5 FIE	LD OPS	
Eric Thomas DATE February 16, 2021 PROJECT NUMBER 324685 SHEET NAME ELEC. 3 LINE DIAG. PAGE NUMBER REVISION					326 Moonlight Dr	orth Carolina	× ₹
DATE February 16, 2021 PROJECT NUMBER 324685 SHEET NAME ELEC. 3 LINE DIAG. PAGE NUMBER REVISION			DRAWING		ic Th	nomas	
PROJECT NUMBER 324685 SHEET NAME ELEC. 3 LINE DIAG. PAGE NUMBER REVISION			DATE	Febr	ruary	/ 16, 20	21
SHEET NAME ELEC. 3 LINE DIAG. PAGE NUMBER REVISION	128 T KB						
					3 LI		DIAG.
						REVISION	

MODULE SPECIFICATIONS REG	C Solar REC325TP3M	DESIGN LOCATION AND TEMPERATURES		CONDUCTOR SIZE CALCULATIONS	
RATED POWER (STC)	325 W	TEMPERATURE DATA SOURCE	ASHRAE 2% AVG. HIGH TEMP	MICROINVERTER TO MAX. SHORT CIRCUIT CURRRENT (ISC) = 14.0 A AC	
MODULE VOC	39.5 V DC	STATE	North Carolina	JUNCTION BOX (1) MAX. SHORT EIRCOTT CONTRELET (ISC) = $14.0$ A AC	
MODULE VMP	34.1 V DC	CITY	Fuquay-Varina	CONDUCTOR (TC-ER, COPPER (90°C)) = 12 AWG	BLUE RAVEN
MODULE IMP	9.54 A DC		SEYMOUR-JOHNSON AFB		SOLAR
			SETWOOK-JOHNSON AFB		SULAR
MODULE ISC	10.36 A DC	ASHRAE EXTREME LOW TEMP (°C)	-10	AMB. TEMP. AMP. CORRECTION = 0.96	
VOC CORRECTION	-0.28 %/°C	ASHRAE 2% AVG. HIGH TEMP (°C)	35	ADJUSTED AMP. = 28.8 > 17.5	1403 N RESEARCH WAY, BUILDING J OREM, UT 84097
VMP CORRECTION	-0.37 %/°C			JUNCTION BOX TO MAX. SHORT CIRCUIT CURRRENT (ISC) = 14.0 A AC	
SERIES FUSE RATING	20 A DC	SYSTEM ELECTRICAL SPECIFICATIONS CIR 1	CIR 2 CIR 3 CIR 4 CIR 5 CIR 6	JUNCTION BOX (2) MAX. CURRENT (ISC X1.25) = 17.5 A AC	800-377-4480 WWW.BLUERAVENSOLAR.COM
ADJ. MODULE VOC @ ASHRAE LOW TEMP	43.4 V DC	NUMBER OF MODULES PER MPPT 14	13	$CONDUCTOR (UF-B, COPPER (60^{\circ}C)) = 10 \text{ AWG}$	CONFIDENTIAL - THE INFORMATION
ADJ. MODULE VMP @ ASHRAE 2% AVG. HIGH TEM	VIP 28.8 V DC	DC POWER RATING PER CIRCUIT (STC) 4550	4225	CONDUCTOR RATING = 30 A	HEREIN CONTAINED SHALL NOT BE
		TOTAL MODULE NUMBER	27 MODULES	CONDUIT FILL DERATE = 1	USED FOR THE BENEFIT OF ANYONE EXCEPT
	e IQ7 Microinverters	STC RATING OF ARRAY	8775W DC	AMB. TEMP. AMP. CORRECTION = 0.96	BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN
POWER POINT TRACKING (MPPT) MIN/MAX 2	22 - 48 V DC	AC CURRENT @ MAX POWER POINT (IMP) 14.0	13.0	ADJUSTED AMP. = 28.8 > 17.5	PART TO OTHERS OUTSIDE
MAXIMUMINPUT VOLTAGE	48 V DC	MAX. CURRENT (IMP X 1.25) 17.5	16.25	JUNCTION BOX TO MAX. SHORT CIRCUIT CURRRENT (ISC) = 14.0 A AC	RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE
MAXIMUM DC SHORT CIRCUIT CURRENT	15 A DC	OCPD CURRENT RATING PER CIRCUIT 20	20	COMBINER BOX (3) MAX. CURRENT (ISC X1.25) = 17.5 A AC	SALE AND USE OF THE RESPECTIVE
MAXIMUM USABLE DC INPUT POWER	350 W	MAX. COMB. ARRAY AC CURRENT (IMP)	27.0	CONDUCTOR (UF-B, COPPER (60°C)) = 10 AWG	EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF
MAXIMUM OUTPUT CURRENT	1 A AC	MAX. ARRAY AC POWER	6480W AC	CONDUCTOR RATING = 30 A	BLUERAVENSOLAR LLC.
AC OVERCURRENT PROTECTION	20 A			CONDUIT FILL DERATE = 0.8	
MAXIMUM OUTPUT POWER	240 W	AC VOLTAGE RISE CALCULATIONS DIST (FT)	) COND. VRISE(V) VEND(V) %VRISE IQ7-7	AMB. TEMP. AMP. CORRECTION = 0.96	NABCEP
CEC WEIGHTED EFFICIENCY	97 %	VRISE SEC. 1 (MICRO TO JBOX) 25.2	12 Cu. 0.71 240.71 0.30%	ADJUSTED AMP. = 23.04 > 17.5	CERTIFIED
		VRISE SEC. 2 (JBOX TO COMBINER BOX) 30	10 Cu. 1.07 241.07 0.44%	COMBINER BOX TO INVERTER RATED AMPS = 27.0 A AC	
AC PHOTOVOLATIC MODULE MARKING (NEC 690.	.52)	VRISE SEC. 3 (COMBINER BOX TO POI) 10	6 Cu. 0.28 240.28 0.11%	MAIN PV OCPD (15) MAX. CURRENT (RATED AMPS X1.25) = 33.75 A AC	PV INSTALLATION
NOMINAL OPERATING AC VOLTAGE	240 V AC	TOTAL VRISE	2.05 242.05 0.86%	CONDUCTOR (THWN-2, COPPER (75°C TERM.)) = 6 AWG	PROFESSIONAL Scott Gurney
NOMINAL OPERATING AC FREQUENCY	47 - 68 HZ AC			CONDUCTOR RATING = 65 A	# PV-011719-015866
MAXIMUMAC POWER	240 VA AC	PHOTOVOLTAIC AC DISCONNECT OUTPUT LABEL (N	NFC 690 54)	CONDUIT FILL DERATE = 1	CONTRACTOR:
MAXIMUMACCURRENT	1.0 A AC	AC OUTPUT CURRENT	27.0 A AC	AMB. TEMP. AMP. CORRECTION = 0.96	BRS FIELD OPS
MAXIMUM OCPD RATING FOR AC MODULE	20 A AC	NOMINAL AC VOLTAGE	240 V AC	ADJUSTED AMP. = 62.4 > 33.8	385.498.6700
<ul> <li>[NEC 250-50] THROUGH [NEC 250-60] SHALL BE PROVIE GROUNDING ELECTRODE SYSTEM OF EXISTING BUILE BONDED TO AT THE SERVICE ENTRANCE. IF EXISTING OR INADEQUATE, OR IS ONLY METALLIC WATER PIPIN GROUNDING ELECTRODE WILL BE USED AT THE INVER CONSISTING OF A UL LISTED 8 FT GROUND ROD WITH</li> <li>2. THE GROUNDING ELECTRODE CONDUCTOR SHALL DAMAGE BETWEEN THE GROUNDING ELECTRODE ANI SMALLER THAN #6 AWG COPPER WIRE PER NEC 250-6 CONDUCTOR WILL BE CONTINUOUS, EXCEPT FOR SPL WITHIN LISTED EQUIPMENT PER [NEC 250.64C.].</li> <li>3. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO GREATER THAN #6 AWG COPPER AND BONDED TO ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM.</li> <li>4. PV SYSTEM SHALL BE GROUNDED IN ACCORDANCE 250.122], AND ALL METAL PARTS OR MODULE FRAME: 690.46].</li> <li>5. MODULE SOURCE CIRCUITS SHALL BE GROUNDED 690.42].</li> <li>6. THE GROUNDING CONNECTION TO A MODULE SHALL THE REMOVAL OF A MODULE DOES NOT INTERRUPT A TO ANOTHER MODULE.</li> <li>7. EACH MODULE WILL BE GROUNDED USING THE SUP</li> </ul>	DING MAY BE USED AND SYSTEM IS INACCESSIE AG, A SUPPLEMENTAL RETER LOCATION A ACORN CLAMP. BE PROTECTED FROM ID THE PANEL (OR INVER 64B. THE GROUNDING EI LICES OR JOINTS AT BU E NO LESS THAN #8 AWG D THE EXISTING GROUNI E TO [NEC 250.21], [NEC ES ACCORDING TO [NEC D IN ACCORDANCE TO [N ALL BE ARRANGED SUCH	SHALL BE USED WHEN EXPOSED TO DAM 12. GROUNDING AND BONDING CONDUCT CODED GREEN (OR MARKED GREEN IF # 13. ALL CONDUIT BETWEEN THE UTILITY CONNECTION SHALL HAVE GROUNDED B HYSICAL 14. SYSTEM GEC SIZED ACCORDING TO [NEC ECTRODE INSULATED, #6AWG WHEN EXPOSED TO 1 BARS 15. EXPOSED NON-CURRENT CARRYING I EQUIPMENTS, AND CONDUCTOR ENCLOS AND ACCORDANCE WITH 250.134 OR 250.136(A ING WIRING & CONDUIT NOTES ABLE 1. ALL CONDUIT SIZES AND TYPES, SHALL APPROVED FOR THE SITE APPLICATIONS 2. BOLTED CONNECTION REQUIRED IN DO C CONDUCTOR (USE POLARIS BLOCK OR N 3. ANY CONNECTION ABOVE LIVE PARTS, THAT DISALLOWED ABOVE LIVE PARTS, MEYER VR 4. UV RESISTANT CABLE TIES(NOT ZIP TH OFF THE ROOF SURFACE IN ACCORDANCE	MAGE). TORS, IF INSULATED, SHALL BE COLOR 44 AWG OR LARGER) AC DISCONNECT AND THE POINT OF BUSHINGS AT BOTH ENDS. [NEC 690.47], [NEC TABLE 250.66], DC C 250.166], MINIMUM #8AWG WHEN DAMAGE. METAL PARTS OF MODULE FRAMES, SURES SHALL BE GROUNDED IN A) REGARDLESS OF VOLTAGE. L BE LISTED FOR ITS PURPOSE AND S IC DISCONNECTS ON THE WHITE GROUNDED NEUTRAL BAR) S MUST BE WATERTIGHT. REDUCING WASHERS RS HUBS RECOMMENDED JES) USED FOR PERMANENT WIRE MANAGEMENT	AT LEAST 7/8" ABOVE THE ROOF SURFACE AND DERATED ACCORDING TO [NEC TABLE 310.15 (B)(2)(a), NEC TABLE 310.15(B)(3)(a),& NEC 310.15(B)(3)(c)]. 9. EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP EDGES 10. PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 600V 11. 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS. 12. ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION 13. VOLTAGE DROP LIMITED TO 2% FOR DC CIRCUITS AND 3% FOR AC CIRCUITS 14. NEGATIVE GROUNDED SYSTEMS DC CONDUCTORS SHALL BE COLOR CODED AS FOLLOWS: DC POSITIVE- RED (OR MARKED RED), DC NEGATIVE- GREY (OR MARKED GREY) 15. POSITIVE GROUNDED SYSTEMS DC CONDUCTORS COLOR CODED: DC POSITIVE- GREY (OR MARKED GREY), DC NEGATIVE- BLACK (OR MARKED GREY) 16. AC CONDUCTORS >4AWG COLOR CODED OR MARKED: PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE, NEUTRAL- WHITE/GRAY * USE-2 IS NOT INDOOR RATED BUT PV CABLE IS RATED THWN/THWN-2 AND MAY BE USED INSIDE ** USE-2 IS AVAILABLE AS UV WHITE 17. RIGID CONDUIT, IF INSTALLED, (AND/OR NIPPLES) MUST HAVE A PULL BUSHING TO	DC SYSTEM SIZE: 8.775 KW DC SYSTEM SIZE: 8.775 KW BLOQUIIDA DALE DC SYSTEM SIZE: 8.775 KW BLOTH Carolina
	JPPLIED CONNECTIONS	JINTS 5. SOLADECK JUNCTION BOXES MOUNTE	ED FLUSH W/ROOF SURFACE TO BE USED FOR	PROTECT WIRES.	324685
IDENTIFIED IN THE MANUFACTURER'S INSTALLATION I 8. ENCLOSURES SHALL BE PROPERLY PREPARED WI AS APPROPRIATE WHEN GROUNDING EQUIPMENT WI GROUNDING LUGS. 9. GROUNDING SYSTEM COMPONENTS SHALL BE LIST GROUNDING DEVISES EXPOSED TO THE ELEMENTS S 10. GROUNDING AND BONDING CONDUCTORS SHALL	INSTRUCTIONS. ITH REMOVAL OF PAINT/ ITH TERMINATION TED FOR THEIR PURPOS SHALL BE RATED FOR DII	WIRE MANAGEMENT AND AS FLASHED RO NISH RUNS. 6. ALL PV CABLES AND HOMERUN WIRES CABLE LISTED AND IDENTIFIED AS PV WI	COOF PENETRATIONS FOR INTERIOR CONDUIT S BE TYPE USE-2, AND SINGLE-CONDUCTOR IRE, TYPE TC-ER, OR EQUIVALENT; ROUTED TO REQUIRED		324685 SHEET NAME ELEC. CALCS. PAGE NUMBER PV6

**WARNING** ELECTRIC SHOCK HAZARD TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

DIRECT CURRENT

PHOTOVOLTAIC POWER SOURCE

PHOTOVOLTAIC SYSTEM

AC DISCONNECT

**DUAL POWER SUPPLY** 

SOURCES: UTILITY GRID AND

PV SOLAR ELECTRIC SYSTEM

INVERTER OUTPUT CONNECTION

DO NOT RELOCATE

THIS OVERCURRENT

DEVICE

RATED AC OUTPUT CURRENT

NOMINAL OPERATING AC VOLTAGE

VDC

AMPS

V

MAXIMUM VOLTAGE

MAX CIRCUIT CURRENT

LABEL 1 FOR PV DISCONNECTING MEANS WHERE ALL TERMINALS OF THE DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION. [NEC 690.13(B), NEC 705.22]

AT EACH DC DISCONNECTING MEANS, INCLUDING THE

AT POINT OF INTERCONNECTION, MARKED AT AC

IF INTERCONNECTING ON THE LOAD SIDE, INSTALL THIS

UTILITY AND THE SOLAR PV SYSTEM: THE MAIN SERVICE

LABEL ANYWHERE THAT IS POWERED BY BOTH THE

DC DISCONNECT AT THE INVERTER.

[NEC 690.53, NEC 690.13(B)]

DISCONNECTING MEANS

PANEL AND SUB-PANELS.

[NEC 705.12(B)(3)]

LABEL

[NEC 690.54, NEC 690.13 (B)]

LABEL :

# WARNING: PHOTOVOLTAIC POWER SOURCE

SOLAR PV SYSTEM EQUIPPED

WITH RAPID SHUTDOWN

SOLAR PV SYSTEM EQUIPPED

WITH RAPID SHUTDOWN

П

Π

TURN RAPID SHUTDOWN

SWITCH TO THE "OFF" POSITION TO

SHUT DOWN PV SYSTEM

AND REDUCE

SHOCK HAZARD

URN RAPID SHUTDOWN SWITCH

TO THE "OFF" POSITION

TO SHUT DOWN CONDUCTORS

OUTSIDE THE ARRAY CONDUCTORS WITHIN

THE ARRAY REMAIN

ENERGIZED IN SUNLIGHT

### LABEL 7

AT DIRECT-CURRENT EXPOSED RACEWAYS, CABLE TRAYS, COVERS AND ENCLOSURES OF JUNCTION BOXES, AND OTHER WIRING METHODS: SPACED AT MAXIMUM 10FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS. [NEC 690.31(G)(3&4)]

FOR PV SYSTEMS THAT SHUT DOWN THE ARRAY AND CONDUCTORS LEAVING THE ARRAY SIGN TO BE LOCATED ON OR NO MORE THAN 3 FT AWAY FROM SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION. [NEC 690,56(C)(1)(A)]

## AREL C

FOR PV SYSTEMS THAT ONLY SHUT DOWN CONDUCTORS LEAVING THE ARRAY SIGN TO BE LOCATED ON OR NO MORE THAN 3 FT AWAY FROM SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION. [NEC 690.56(C)(1)(B)]

LABEL 10 SIGN LOCATED AT RAPID SHUT DOWN DISCONNECT SWITCH [NEC 690.56(C)(3)].

MAIN DISTRIBUTION UTILITY DISCONNECT(S)

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM A ROOF MOUNTED SOLAR ARRAY WITH A RAPID SHUTDOWN DISCONNECTING MEANS GROUPED AND LABELED WITHIN LINE OF SITE AND 10 FT OF THIS LOCATION.

POWER TO THIS BUILDING IS ALSO

SUPPLIED FROM MAIN DISTRIBUTION

UTILITY DISCONNECT LOCATED

PERMANENT DIRECTORY TO BE LOCATED AT SOLAR ARRAY RAPID SHUTDOWN SWITCH DENOTING THE LOCATION OF THE SERVICE EQUIPMENT LOCATION IF SOLAR ARRAY RAPID SHUT DOWN DISCONNECT SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 705.10]

# \Lambda WARNING


POWER TO THIS BUILDING IS ALSO SUPPLIED. FROM ROOF MOUNTED SOLAR ARRAY, SOLAR ARRAY RAPID SHUTDOWN DISCONNECT IS LOCATED OUTSIDE NEXT TO UTILITY METER.


PERMANENT DIRECTORY TO BE LOCATED AT MAIN SERVICE EQUIPMENT DENOTING THE LOCATION OF THE PV RAPID SHUTDOWN SYSTEM DISCONNECTING MEANS IF SOLAR ARRAY RAPID SHUT DOWN DISCONNECT SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 705.10, NEC 690.56(C)(1)]


ABEL 14


PHOTOVOLTAIC SYSTEM **COMBINER PANEL** 


🔿 WARNING DO NOT ADD LOADS




















AC JUNCTION BO

SIDE CONNECTION TO BUSBAR. [NEC 705.12(B)(2)(3)(b)]

PLACED ADJACENT TO THE BACK-FED BREAKER

FROM THE INVERTER IF TIE IN CONSISTS OF LOAD

# **AWARNING**

THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.


# (ONLY IF 3 OR MORE SUPPLY SOURCES TO A BUSBAR)

SIGN LOCATED AT LOAD CENTER IF IT [NEC 705.12(B)(2)(3)(C)]

### LABELING NOTES

- LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS. ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER CURRENT NEC AND LOCAL CODES AND MAKE APPROPRIATE ADJUSTMENTS
- LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRIC CODE, OSHA STANDARD 19010 145 ANSI 7535
- MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION. 3
- LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED AND SHALL NOT BE HANDWRITTEN [NEC 110.21]
- 5 LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]

CONTAINS 3 OR MORE POWER SOURCES.

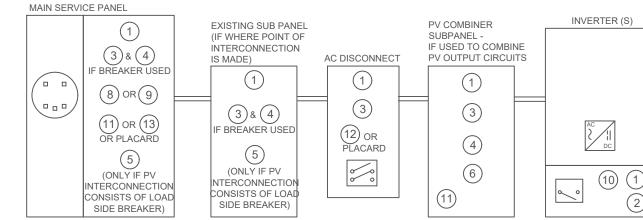

## INTEGRATED DC DISCONNECT

\*ELECTRICAL DIAGRAM SHOWN ABOVE IS FOR LABELING PURPOSES ONLY. NOT AN ACTUAL REPRESENATION OF EQUIPMENT AND CONNECTIONS TO BE INSTALLED. LABEL LOCATIONS PRESENTED MAY VERY DEPENDING ON TYPE OF INTERCONNECTION METHOD AND LOCATION PRESENTED ON PV5 OF 3 LINE DIAGRAM. PV5 LINE DIAGRAM TO REFLECT ACTUAL REPRESENTATION OF PROPOSED SCOPE OF WORK.

# LABELING DIAGRAM FOR MICRO INV .:

BREAKER USED

(11) OR (13)

OR PLACARD

(5)

(ONLY IF PV

NTERCONNECTIO

CONSISTS OF LOAD

SIDE BREAKER)

LABELING DIAGRAM FOR STRING INV. / DC OPTIMIZER INV.:



´o o

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

## LABEL 11

PERMANENT DIRECTORY TO BE LOCATED AT MAIN SERVICE EQUIPMENT LOCATION IF ALL ELECTRICAL POWER SOURCE DISCONNECTING MEANS (SOLAR ARRAY RAPID SHUTDOWN SWITCH) ARE GROUPED AND IN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 690.56(C) & NEC 705.10].

### LABEL 13

PERMANENT DIRECTORY TO BE LOCATED AT AC COMBINER PANEL [NEC 110.21(B)]

X				
R	B	С	))	<

S)		
	JUNCTION BOX	
	OR COMBINER E	BOX
	(7)	
(1)		
(2)		



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION. EXCEPT IN CONNEC TION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

27526 ОС Carolina k∛ 775 North ( õ **INFORMATION:** SIZE: Ď

Fuquay-Varina, 326 Moonlight SYSTEM Derby Lloyd I Шı SIT Ю

DRAWING BY

Eric Thomas

February 16, 2021

PROJECT NUMBER

SHEET NAME

DATE

PAGE NUMBER PV8 REVISION \_\_\_\_

Data Sheet **Enphase Microinverters** Region: AMERICAS

# **Enphase** IQ 7 and IQ 7+ **Microinverters**



The high-powered smart grid-ready Enphase IQ 7 Micro<sup>™</sup> and Enphase IQ 7+ Micro<sup>™</sup> dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate with the Enphase IQ Envoy<sup>™</sup>, Enphase IQ Battery<sup>™</sup>, and the Enphase Enlighten<sup>™</sup> monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.

# Easy to Install

- · Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

## Productive and Reliable

- Optimized for high powered 60-cell/120 half-cell and 72cell/144 half-cell\* modules
- More than a million hours of testing
- · Class II double-insulated enclosure
- UL listed

## Smart Grid Ready

- · Complies with advanced grid support, voltage and frequency ride-through requirements
- · Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

\* The IQ 7+ Micro is required to support 72-cell/144 half-cell modules.

# Enphase IO 7 and IO 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2
Commonly used module pairings <sup>1</sup>	235 W - 350 W +	F	235 W - 440 W
Module compatibility	60-cell/120 half	f-cell PV modules	60-cell/120 ha
	only		cell/144 half-c
Maximum input DC voltage	48 V		60 V
Peak power tracking voltage	27 V - 37 V		27 V - 45 V
Operating range	16 V - 48 V		16 V - 60 V
Min/Max start voltage	22 V / 48 V		22 V / 60 V
Max DC short circuit current (module lsc)	15 A		15 A
Overvoltage class DC port	II		II
DC port backfeed current	0 A		0 A
PV array configuration			ional DC side prote 20A per branch circ
OUTPUT DATA (AC)	IQ 7 Microinve	erter	IQ 7+ Microi
Peak output power	250 VA		295 VA
Maximum continuous output power	240 VA		290 VA
Nominal (L-L) voltage/range <sup>2</sup>	240 V /	208 V /	240 V /
	211-264 V	183-229 V	211-264 V
Maximum continuous output current	1.0 A (240 V)	1.15 A (208 V)	1.21 A (240 V)
Nominal frequency	60 Hz		60 Hz
Extended frequency range	47 - 68 Hz		47 - 68 Hz
AC short circuit fault current over 3 cycles	5.8 Arms	12 (200 \/A C)	5.8 Arms
Maximum units per 20 A (L-L) branch circuit <sup>3</sup> Overvoltage class AC port	16 (240 VAC) 	13 (208 VAC)	13 (240 VAC) III
AC port backfeed current	18 mA		18 mA
Power factor setting	1.0		1.0
Power factor (adjustable)	0.85 leading (	0.85 lagging	0.85 leading
EFFICIENCY	@240 V	@208 V	@240 V
Peak efficiency	97.6 %	97.6 %	97.5 %
CEC weighted efficiency	97.0 %	97.0 %	97.0 %
MECHANICAL DATA	57.0 %	37.0 %	57.0 %
Ambient temperature range	-40°C to +65°C		
Relative humidity range	4% to 100% (cor	ndensina)	
Connector type		0,	additional Q-DCC-5
Dimensions (HxWxD)	· ·	nm x 30.2 mm (w	
Weight	1.08 kg (2.38 lb		
Cooling	Natural convect	,	
Approved for wet locations	Yes		
Pollution degree	PD3		
Enclosure		insulated corros	ion resistant polym
Environmental category / UV exposure rating	NEMA Type 6 /		ion reolocant polym
FEATURES	itelant type o /	outdoor	
Communication	Power Line Con	nmunication (PL	<u>;)</u>
Monitoring	Enlighten Mana	ger and MyEnligh	nten monitoring opti of an Enphase IQ Ei
Disconnecting means	The AC and DC	connectors have	been evaluated and
Compliance	disconnect required by NEC 690. CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Ec 2017, and NEC 2020 section 690.12 and C22.1-2015 for AC and DC conductors, when installed according		



1. No enforced DC/AC ratio. See the compatibility calculator at https://enphase.com/en-us/support/module-compatibility. Nominal voltage range can be extended beyond nominal if required by the utility.
 Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.



# **ENPHASE**. To learn more about Enphase offerings, visit **enphase.com**

© 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enphase IQ 7, Enphase IQ 7+, Enphase IQ Battery, Enphase Enlighten, Enphase IQ Envoy, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2020-08-12

To learn more about Enphase offerings, visit enphase.com

2-	US

N + alf-cell and 72cell PV modules

ection required; rcuit oinverter

> 208 V / 183-229 V 1.39 A (208 V)

11 (208 VAC)

0.85 lagging

@208 V 97.3 % 97.0 %

5 adapter

neric enclosure

tions.

Envov

nd approved by UL for use as the load-break

ICES-0003 Class B,

quipment and conforms with NEC 2014, NEC Rule 64-218 Rapid Shutdown of PV Systems, ng manufacturer's instructions.





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

HEET NAME SPEC SHEET

AGE NUMBER

REVISION

SS

# Enphase **IQ Combiner 3**

(X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3**<sup>™</sup> with Enphase IQ Envoy<sup>™</sup> consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

# LISTED

To learn more about Enphase offerings, visit enphase.com

# Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring

## Simple


- · Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

# Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- UL listed

# Enphase IQ Combiner 3

	MODEL NUMBER	
	IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy <sup>™</sup> printed or production metering (ANSI C12.20 +/- 0.5%) and
	ACCESSORIES and REPLACEMENT PARTS (no	t included, order separately)
	Enphase Mobile Connect <sup>™</sup> CELLMODEM-03 (4G/12-year data plan) CELLMODEM-01 (3G/5-year data plan) CELLMODEM-M1 (4G based LTE-M/5-year data plan) Consumption Monitoring* CT CT-200-SPLIT * Consumption monitoring is required for Enphase Storage Systems	Plug and play industrial grade cellular modem w microinverters. (Available in the US, Canada, Me where there is adequate cellular service in the in Split core current transformers enable whole ho
	Wireless USB adapter COMMS-KIT-01 Circuit Breakers	Installed at the IQ Envoy. For communications wit Enpower <sup>™</sup> smart switch. Includes USB cable for c and allows redundant wireless communication wi Supports Eaton BR210, BR215, BR220, BR230, B
	BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
	EPLC-01	Power line carrier (communication bridge pair), o
	XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in I
	XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCI
	ELECTRICAL SPECIFICATIONS	
	Rating	Continuous duty
	System voltage	120/240 VAC, 60 Hz
	Eaton BR series busbar rating	125 A
	Max. continuous current rating (output to grid)	65 A
	Max. fuse/circuit rating (output)	90 A
	Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Ge
	Max. continuous current rating (input from PV)	64 A
	Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envo
	Production Metering CT	200 A solid core pre-installed and wired to IQ En
	MECHANICAL DATA	
	Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Hei
	Weight	7.5 kg (16.5 lbs)
	Ambient temperature range	-40° C to +46° C (-40° to 115° F)
	Cooling	Natural convection, plus heat shield
	Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarl
	Wire sizes	<ul> <li>20 A to 50 A breaker inputs: 14 to 4 AWG copp</li> <li>60 A breaker branch input: 4 to 1/0 AWG copp</li> <li>Main lug combined output: 10 to 2/0 AWG cop</li> <li>Neutral and ground: 14 to 1/0 copper conduct</li> <li>Always follow local code requirements for conduct</li> </ul>
	Altitude	To 2000 meters (6,560 feet)
	INTERNET CONNECTION OPTIONS	
	Integrated Wi-Fi	802.11b/g/n
	Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet ca
	Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM (not included)
	COMPLIANCE	
	Compliance, Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Par Production metering: ANSI C12.20 accuracy class
	Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1






© 2018 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 3, and other trademarks or service 


circuit board for integrated revenue grade PV d optional* <b>consumption</b> monitoring (+/- 2.5%).	BLUE	RAVEN SOLAR
vith data plan for systems up to 60		H WAY, BUILDING J UT 84097
exico, Puerto Rico, and the US Virgin Islands, nstallation area.) ome <b>consumption</b> metering (+/- 2.5%).		77-4480 VENSOLAR.COM
th Enphase Encharge <sup>™</sup> storage and Enphase connection to IQ Envoy or Enphase IQ Combiner <sup>™</sup> /ith Encharge and Enpower. 3R240, BR250, and BR260 circuit breakers. quantity - one pair	HEREIN CONTAIN USED FOR TH ANYONE EXCE SOLAR NOF DISCLOSED IN W TO OTHERS OUT ORGANIZATIO CONNECTION WII USE OF THE EQUIPMENT, WRITTEN PERM	THE INFORMATION IED SHALL NOT BE IE BENEFIT OF PT BLUE RAVEN & SHALL IT BE (HOLE OR IN PART 'SIDE RECIPIENTS ON, EXCEPT IN ITH THE SALE AND RESPECTIVE WITHOUT THE IISSION OF BLUE OLAR LLC.
IQ Combiner 3 (required for EPLC-01)		
CB) for Combiner 3	PROFES	
eneration (DG) breakers only (not included)	BRS FIE	ACTOR: ELD OPS 98.6700
oy breaker included		
nvoy		
eight is 21.06" (53.5 cm with mounting brackets).		
rbonate construction		
per conductors per conductors pper conductors tors ductor sizing.		
cable (not included) 1-03 (4G) or CELLMODEM-M1 (4G based LTE-M)		
rt 15, Class B, ICES 003 ass 0.5 (PV production)		
e names are the	SHEET NAME	HEET
	PAGE NUMBER	REVISION
-	SS	0

# REC TWINPEAK 3 MONO BL

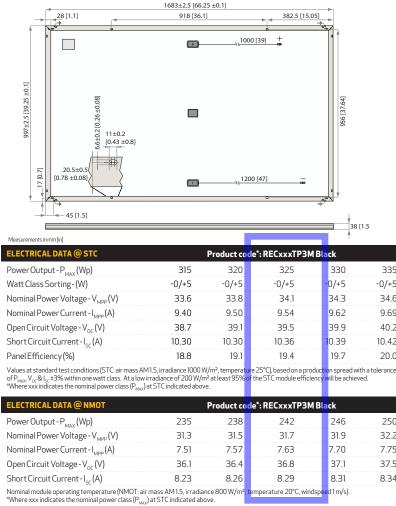

(E 🗆 🕾 🕲

UL 1703, Fire classification: Type 2; IEC 61215, IEC 61730; ISO 9001: 2015, ISO 14001: 2004, OHSAS 18001: 2007



GE

MA

335

-0/+5

34.6

9.69

40.2

10.42

20.0

250

32.2

7.75

	Standard	REC	ProTrust
nstalled by an REC Certified Solar Professional	No	Yes	Yes
System Size	Any	≤25kW	25-500 kW
Product Warranty (yrs)	20	25	25
Power Warranty (yrs)	25	25	25
abor Warranty (yrs)	0	25	10
Power in Year 1	97.5%	97.5%	97.5%
Annual Degradation	0.7%	0.7%	0.7%
Power in Year 25 See warranty document	80.7% s for details	80.7% Some con	80.7% ditions apply.

REC Group is an international pioneering solar ener consumers with clean, affordable solar power in orde Committed to quality and innovation, REC offers p quality, backed by an exceptional low warranty claim Norway in 1996, REC employs 2,000 people and has a With over 10 GW installed worldwide, REC is empower solar energy. REC Group is a Bluestar Elkem company headquarters in Singapore, and regional bases in Nori

SOLAR'S MOST TRUSTED **REC** 

# **REC TWINPEAK 3** MONO BLACK ᠵ╟ᅳᠫ

# **PREMIUM SOLAR PANELS** WITH SUPERIOR PERFORMANCE

REC TwinPeak 3 Mono Black Series solar panels feature an innovative design with high panel efficiency and power output, enabling customers to get the most out of the space used for the installation.

Combined with industry-leading product quality and the reliability of a strong and established European brand, REC TwinPeak 3 Mono Black panels are ideal for residential and commercial rooftops worldwide.



**OUTPUT PER M<sup>2</sup>** 













**PID FREE** 



**ELIGIBLE FOR** 

IMPROVED PERFORMANCE IN SHADED CONDITIONS

	BLUE RAVEN
ACK SERIES	
	1403 N RESEARCH WAY, BUILDING J OREM, UT 84097
	800-377-4480 WWW.BLUERAVENSOLAR.COM
20.0%       EFFICIENCY         YEAR PRODUCT WARRANTY	CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART
25 YEAR LINEAR POWER OUTPUT WARRANTY MPERATURE RATINGS	TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE
minal Module Operating Temperature: 44.6°C (±2°C)	RAVEN SOLAR LLC.
mperature coefficient of P <sub>MAX</sub> : -0.37 %/°C mperature coefficient of V <sub>oc</sub> : -0.28 %/°C mperature coefficient of I <sub>sc</sub> : 0.04 %/°C	NABCEP CERTIFIED PV INSTALLATION
lls: 120 half-cut mono-Si p-type PERC cells 6 strings of 20 cells in series ass: 0.13" (3.2 mm) solar glass with 불	PROFESSIONAL Scott Gurney
ass: 0.13" (3.2 mm) solar glass with g anti-reflective surface treatment g ck sheet: Highly resistant polyester	# PV-011719-015866 CONTRACTOR:
polyolefin construction (black) المعنية ame: Anodized aluminum (black) ق	BRS FIELD OPS
nction box: 3-part with 3 bypass diodes, IP67 rated	385.498.6700
ck sheet: 0.13" (3.2 mm) solar glass with anti-reflective surface treatment ck sheet: Highly resistant polyester polyolefin construction (black) ame: Anodized aluminum (black) nction box: 3-part with 3 bypass diodes, IP67 rated 12AWG (4 mm <sup>2</sup> ) PV wire, 39" + 47" (1.0m + 1.2m) nnectors: Stäubli MC4 PV-KBT4/PV-KST4, 12 AWG (4 mm <sup>2</sup> )	
erational temperature: -40 +185°F (-40 +85°C) aximum system voltage: 1000 V	
sign load (+): snow 3600 Pa (75.2 lbs/ft²)* aximum test load (+): 5400 Pa (112.8 lbs/ft²)*	
sign load (-): wind 1600 Pa (33.4 lbs/ft²)*	
aximum test load (-): 2400 Pa (50 lbs/ft²)* ax series fuse rating: 20 A	
av rovorco current: 20 A	
*Calculated using a safety factor of 1.5 *See installation manual for mounting instructions *CHANICAL DATA mensions: 66.3 x 39.25 x 1.5 (1683 x 997 x 38 mm) ea: 17.98 ft² (1.68 m²)	
mensions: 66.3 x 39.25 x 1.5 (1683 x 997 x 38 mm)	
ea: 17.98 ft² (1.68 m²) 불 aintt: 41.7 lbs (18.9 km²)	
<b>te!</b> Specifications subject to change without notice.	
	-
ergy company dedicated to empowering der to facilitate global energy transitions. s photovoltaic modules with leading high ims rate of less than 100pm. Founded in	
s an annual solar panel capacity of 1.8 GW. reference than 16 million people with clean	
ywithheadquarters in Norway, operational rth America, Europe, and Asia-Pacific. www.recgroup.com	
	SPEC SHEET
	PAGE NUMBER REVISION
	SS 0

Intertek Total Quality Assure

# hE/Z /E X > "dd"Z Z"WKZd

 $^{\rm KW''}$  K& tKZ< ``/d/KE K& DK`h> "^ dK d, " hE/Z ^&D `Z íìîïõïõôî> yrììî

Z″WKEZND ″Z íìððïìîíì> yrììí

/^^h″ ` d″ îðr^°≻ırîìîì

W '″^ ï

`K hD"Ed KEdZK> EhD "Z '&drKWríì ~îír:µv°rîìíõ ž îìíõ /Ed″Zd″<



> "dd"Z Z"WKZd

^°)ı°u°"îðUîìîì

<o µ' E] }o ^^]' hv], /vX íðíí "}^ÁÇoÀ^E″ ο μ‰μ°"‰μ°U ED ôóíìîríñðñ h ^ lo μ'Xv] }o ^^]'łμv]" X }u

îñóõí }uu°"°vı"°˘"]À° d°o°→Z}v°W õõõrõõõrõíìì & ']u]o°W õõõrõõõrõ¶opal Quality. Assured. ÁÁÁX]vı°"ı°IX }u

> ~ dd ~ Z Z ~ W K Z d

E}X 'íìððïìîíìX

/vı°"ı°l Z°→}"ı E}X íìððïìî∱ĭ>dyKĭèlíï /vı°"ı°lW"}i°ıE}X'MVòZðKï:ìĩíd^dh^Ÿd/KE

W"}i° I D`v P°.,X

^µ i° ı₩^]ı]}v }( u}^µo°' ı} ıZ° hv], ^&D ˘Z íìîïõïõôî>

~° " <ο μ'U

d]ıo°W

dZ]'o°ıı°" "°>}"ı "°>"°'°vı'ıZ° "°'µoı'}(}µ" °À oµ ı]}v } ι} IZ° "°‰μ]"°u°vι' }vι ]v°^ ]v IZ° (}oo}Á]vP 'ι v^ "^'W

ALL. ^]Pv ıµ"°W

• hðriðriii

 $D \mu v_1 P ^C'_1 u'U D \mu v_1 P ^{A} U o u P Z^{A}$ >µP'(}, h'` Á]ıZ &o ırWo ı` WZ}ı}À}oı] D}^µo'' Ĭ

^″ d/KE í

^hDD Zz

°"ı](] ı]}v u "l'X

dZ]']vˡ'ı]Pı]}vÁ' µıZ}"]̰^ ljµ}ı° · Yµrìííìíóïî ^ı° ìôríórîìîìX ıΖ° > "}i゚ ı Á ' ı} ° À ομ ι° v^ ^^ u}^µο° (" u°' ı} ıΖ° ^&D ˘Z íìîïõïõôî>

## ^″d/KEî

s > h d/KE

dZ° (}oo}Á]vP Ws u}^µo°' Á°"° Å ομ ι°^ (}" }v^]vPIP"}µv^]vP →μ"→}'°' →→"}À°^ ι} ° ]v'ι oo°^ µ']vP ιZ° hv]" ^&D u}^°oW


D νμ( ιμ"°"	D } ^ ° o	]
,vÁZY°oo	YXW" < `hK >r'óU YXW" < YXW" < `hK >r'óXîU YXW" YXW" < `hK >r'ôU YXW" < YXW" < `hK >r'ôU YXW" <	< <sup>˘</sup> hK >r'óXïU ˘hK >r'ôXíU
Ζ″	dWïDU dWïD o I	
^]o(	^/>r	

→ "}P., uX s°"']}vW òrD "Zrîìíó

W P°î}(ï

s°"']}vW òrD "Zrîìíó

'&drKWríì

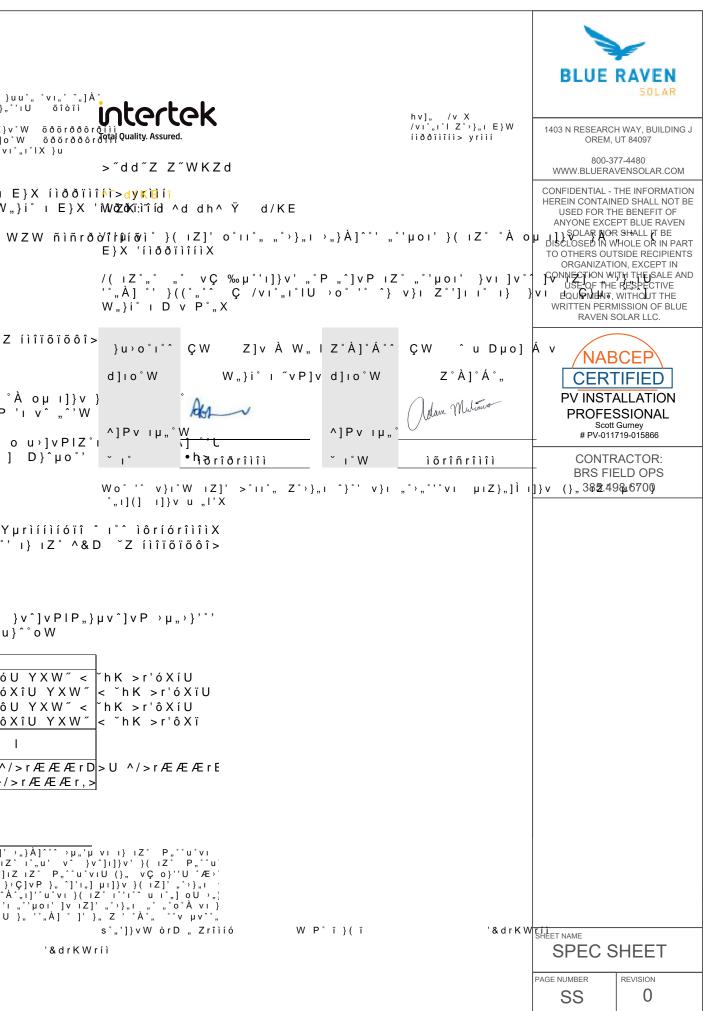



pe.eaton.com

# General Duty Non-Fusible Safety Switch

# DG222UGB

# UPC:782114731130

# **Dimensions:**

- Height: 7 IN
- Length: 6.41 IN
- Width: 8.4 IN

# Weight:6 LB

**Notes:**WARNING! Switch is not approved for service entrance unless a neutral kit is installed.

# Warranties:

• Eaton Selling Policy 25-000, one (1) year from the date of installation of the Product or eighteen (18) months from the date of shipment of the Product, whichever occurs first.

# Specifications:

- Type: General Duty/Non-Fusible
- Amperage Rating: 60A
- Enclosure: NEMA 1
- Enclosure Material: Painted steel
- Fuse Configuration: Non-fusible
- Number Of Poles: Two-pole
- Number Of Wires: Two-wire
- Product Category: General Duty Safety Switch
- Voltage Rating: 240V

# Supporting documents:

- Eatons Volume 2-Commercial Distribution
- Eaton Specification Sheet DG222UGB

# **Certifications:**

• UL Listed

Product compliance: No Data





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.





CONTRACTOR: BRS FIELD OPS 385.498.6700


SPEC SHEET

REVISION


PAGE NUMBER

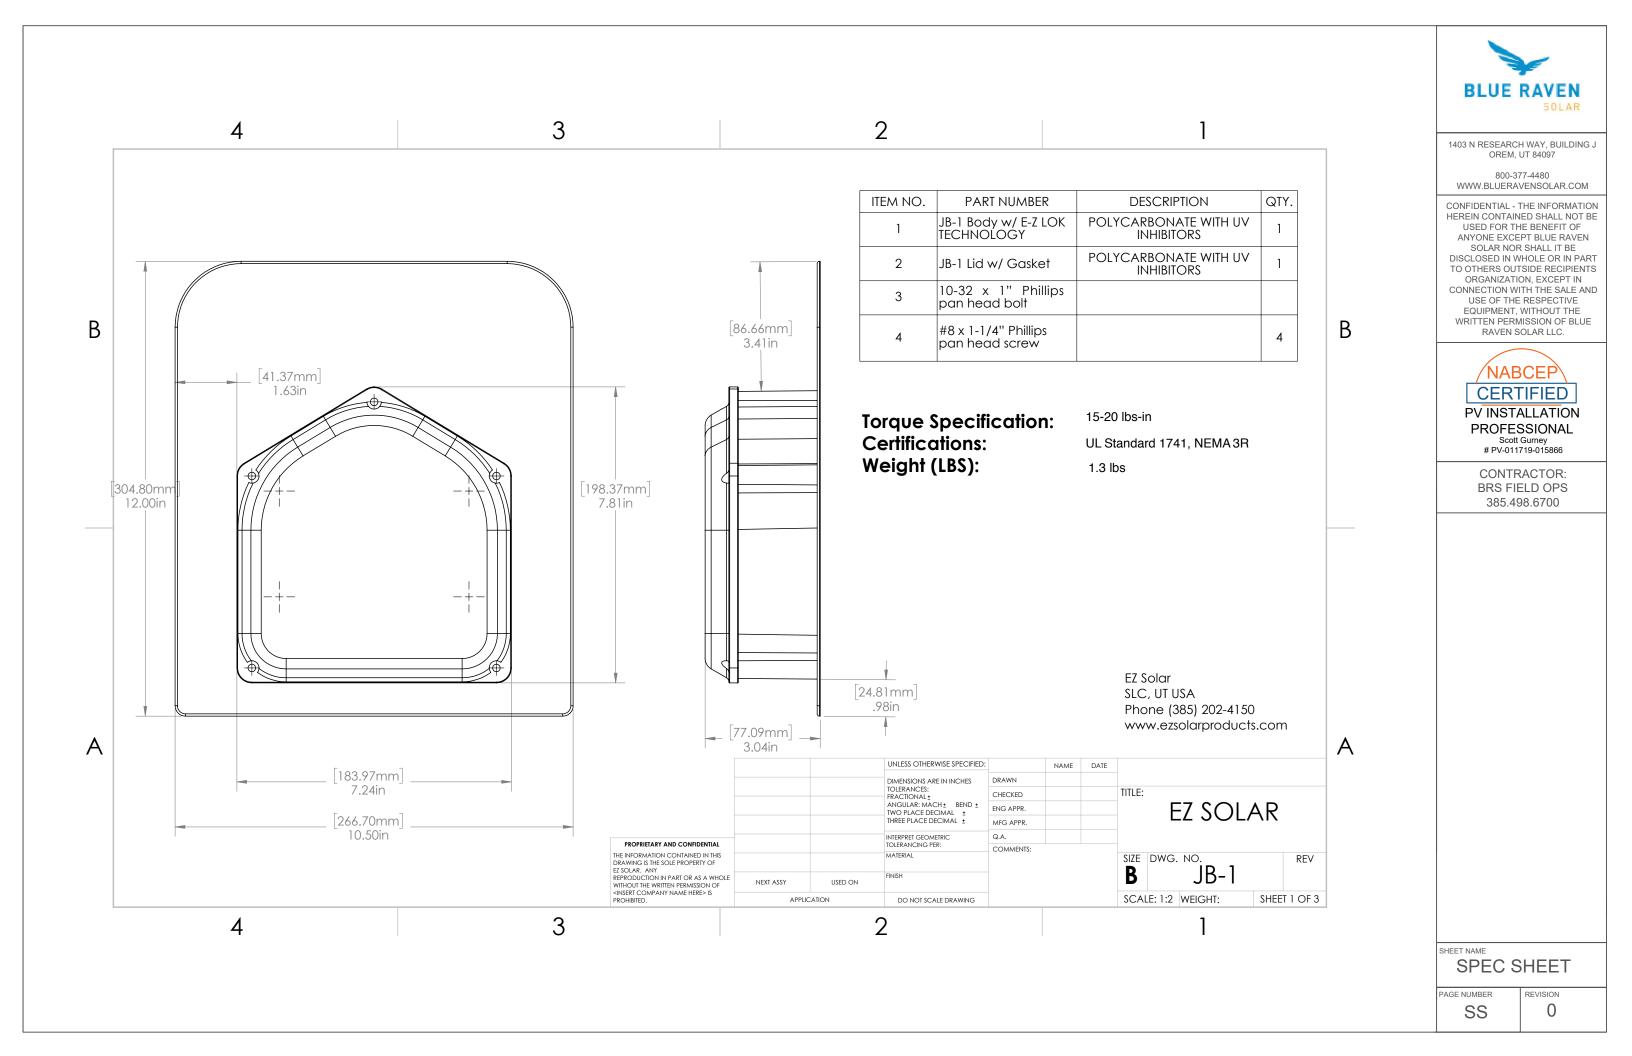

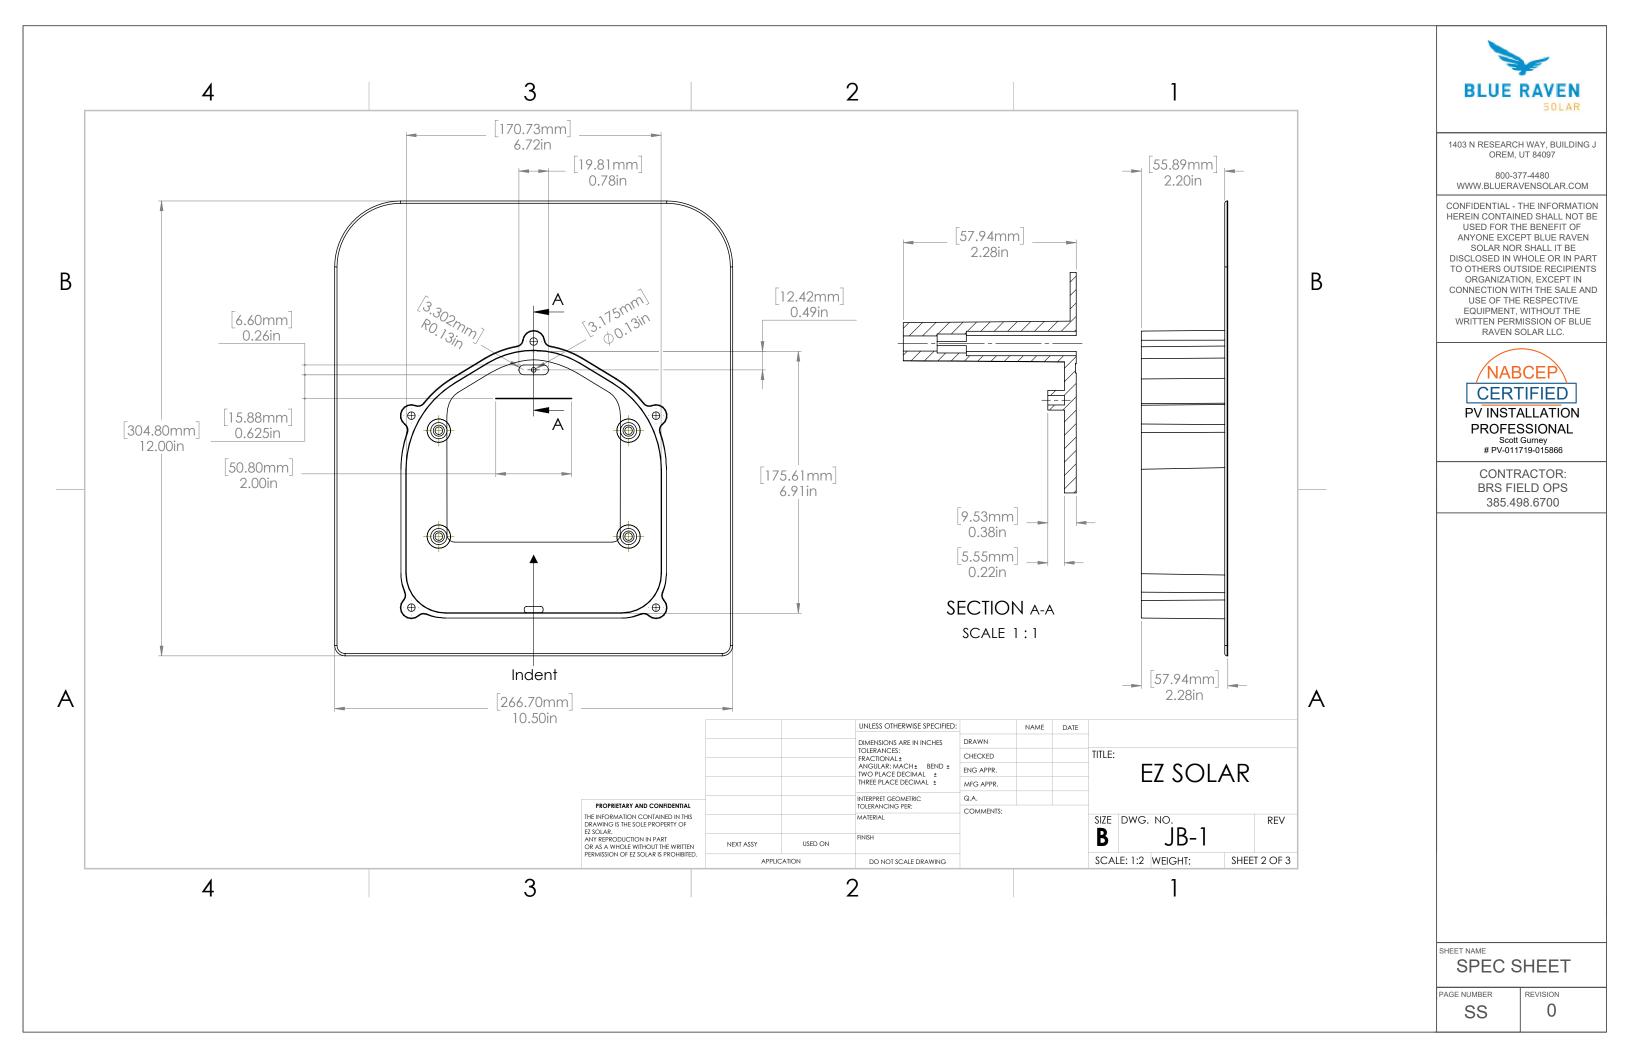

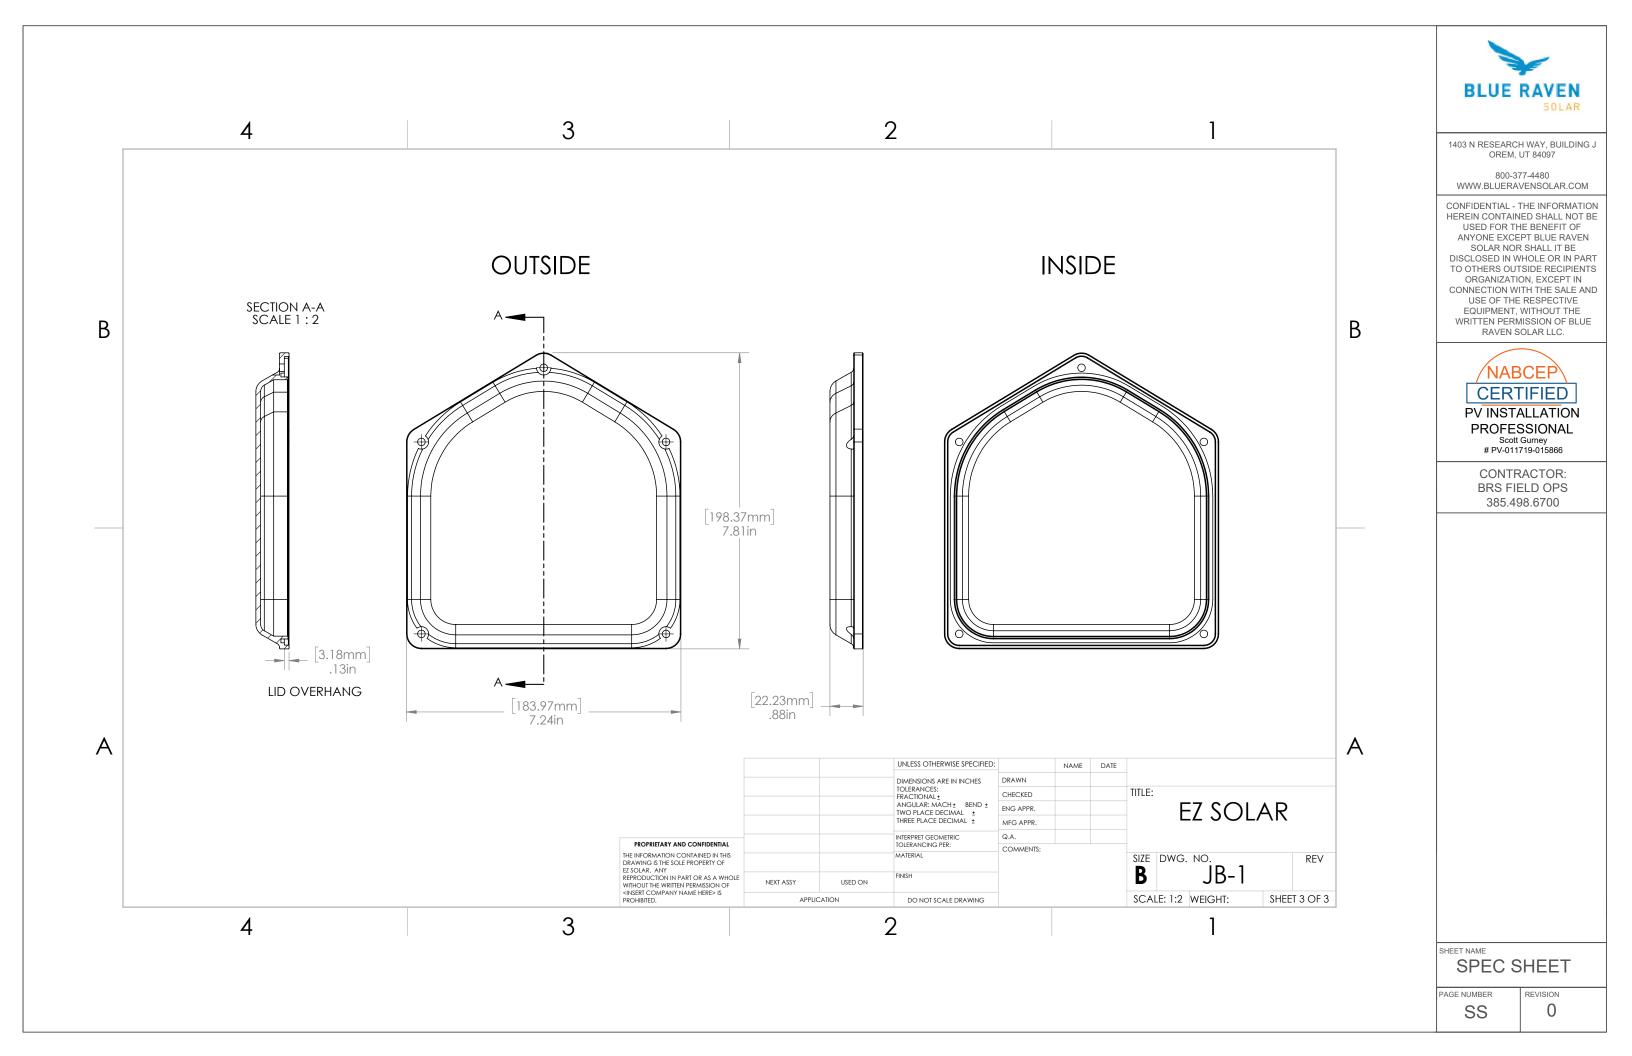

# **SYSTEM BONDING & GROUNDING** INSTALLATION GUIDE PAGE

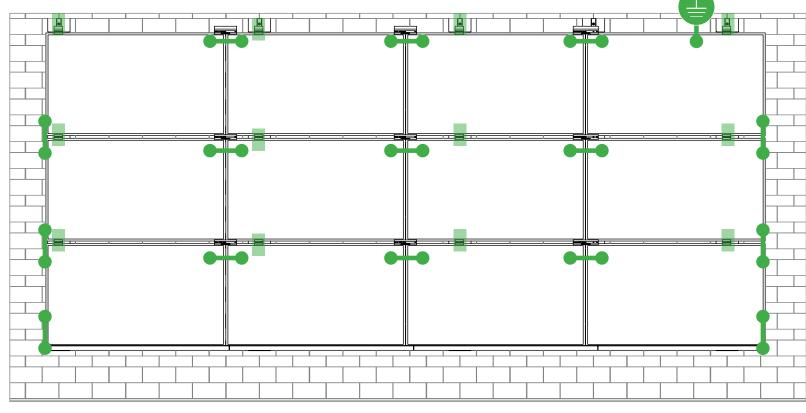

**Star Washer is** Single Use Only


# **TERMINAL TOROUE**, **Install Conductor and**

S

torque to the following: 4-6 AWG: 35in-lbs 8 AWG: 25 in-lbs 10-14 AWG: 20 in-lbs

# LUG DETAIL & TOROUE INFO Ilsco Lay-In Lug (GBL-4DBT)

- 10-32 mounting hardware
- Torque = 5 ft-lb
- AWG 4-14 Solid or Stranded



**TERMINAL TOROUE**, **Install Conductor and** torque to the following: 4-14 AWG: 35in-lbs

# LUG DETAIL & TOROUE INFO Ilsco Flange Lug(SGB-4)

- 1/4" mounting hardware
- Toraue = 75 in-lb
- AWG 4-14 Solid or Stranded

# **WEEBLUG Single Use Only**




**TERMINAL TOROUE**, Install Conductor and torque to the following: 6-14 AWG: 7ft-lbs

# LUG DETAIL & TOROUE INFO Wiley WEEBLug (6.7)

- 1/4" mounting hardware
- Toraue = 10 ft-lb
- AWG 6-14 Solid or Stranded


# NOTE: ISOLATE COPPER FROM ALUMINUM CONTACT TO PREVENT CORROSION

System bonding is accomplished through modules. System grounding accomplished by attaching a ground lug to any module at a location on the module specified by the module manufacturer.

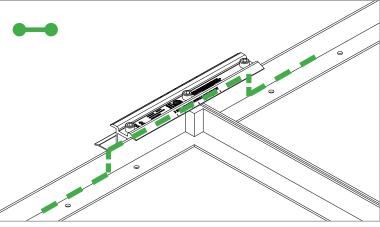


# **E-W BONDING PATH:**

E-W module to module bonding is accomplished with 2 pre-installed bonding pins which engage on the secure side of the MicrorailTM and splice.




# **N-S BONDING PATH:**

N-S module to module bonding is accomplished with bonding clamp with 2 integral bonding pins. (refer also to alternate method )



# **TRIMRAIL BONDING PATH:**

Trimrail to module bonding is accomplished with bonding clamp with integral bonding pin and bonding T-bolt. (refer also to alternate method)







1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BI USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PAR TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

HEET NAME SPEC SHEET

REVISION

AGE NUMBER SS



# UL CODE COMPLIANCE NOTES Installation guide Page

# SYSTEM LEVEL FIRE CLASSIFICATION

The system fire class rating requires installation in the manner specified in the SUNFRAME MICRORAIL (SFM) Installation Guide. SFM has been classified to the system level fire portion of UL 1703. This UL 1703 classification has been incorporated into the UL 2703 product certification. SFM has achieved Class A, B & C system level performance for low slope & steep sloped roofs when used in conjunction with type 1 and type 2 modules. Class A, B & C system level fire

performance is inherent in the SFM design, and no additional mitigation measures are required. The fire classification rating is valid for any roof pitch. There is no required minimum or maximum height limitation above the roof deck to maintain the Class A, B & C fire rating for SFM. SUNFRAME MICRORAIL<sup>™</sup> components shall be mounted over a fire resistant roof covering rated for the application.

Module Type	Roof Slope	System Level Fire Rating	Microrail Direction	Module Orientation	Mitigation Rec
Type 1 and Type 2	Steep Slope & Low Slope	Class A, B & C	East-West	Landscape OR Portrait	None Require


# **UL2703 TEST MODULES**

See page "S" for a list of modules that were electrically and mechanically tested or qualified with the SUNFRAME MICRORAIL (SFM) components outlined within this Installation Guide.

- Maximum Area of Module = 22.3 sqft
- UL2703 Design Load Ratings:
  - Downward Pressure 113 PSF / 5400 Pa a)
  - Upward Pressure 50 PSF / 2400 Pa b)
  - c) Down-Slope Load - 30 PSF / 1400 Pa
- Tested Loads:
  - Downward Pressure 170 PSF / 8000 Pa a)
  - b) Upward Pressure - 75 PSF / 3500 Pa
  - c) Down-Slope Load – 45 PSF / 2100 Pa
- Maximum Span = 6ft
- Use with a maximum over current protection device OCPD of 30A
- System conforms to UL Std 2703, certified to LTR AE-001-2012
- Rated for a design load of 2400 Pa / 5400 Pa with 24 inch span

# LABEL MARKINGS

- System fire class rating: See installation instructions for installation requirements to achieve a specified system fire class rating with Unirac.
- Unirac SUNFRAME MICRORAIL<sup>™</sup> is listed to UL 2703.
- All splices within a system are shipped with marking indicating date and location of manufacture.

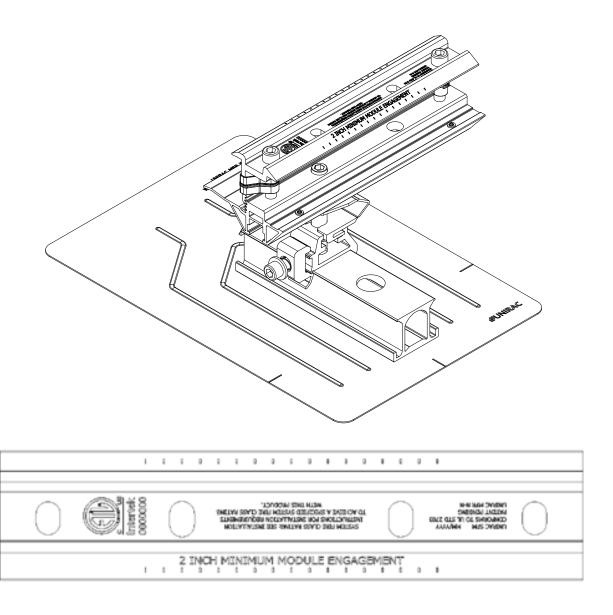



# equired red



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BI USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PAR TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.

> NABCE CERTIFIED **PV INSTALLATION** PROFESSIONAL Scott Gurney # PV-011719-015866

> > CONTRACTOR: **BRS FIELD OPS** 385.498.6700

HEET NAME SPEC SHEET

AGE NUMBER

REVISION

SS

# **TESTED / CERTIFIED MODULE LIST** INSTALLATION GUIDE PAGE

Manufacture	Module Model / Series	Manufacture	Module Model / Series	Manufacture	Module Model / Series
Aleo Astronergy	P-Series         CHSM6612P, CHSM6612P/HV, CHSM6612M,         CHSM6612M/HV, CHSM6610M (BL)(BF)/(HF),         CHSM72M-HC	JA Solar	JAP6 60-xxx, JAM6-60-xxx/SI, JAM6(K)-60/ xxx, JAP6(k)-72-xxx/4BB, JAP72SYY-xxx/ZZ, JAP6(k)-60-xxx/4BB, JAP60SYY-xxx/ZZ, JAM6(k)-72-xxx/ZZ, JAM72SYY-xxx/ZZ,	REC	PEAK Energy Series, PEAK Energy BLK2 Series, PEAK Energy 72 Series, TwinPeak 2 Series,
Auxin	AXN6M610T, AXN6P610T, AXN6M612T & AXN6P612T		JAM6(k)-60-xxx/ZZ, JAM60SYY-xxx/ZZ. i. YY: 01, 02, 03, 09, 10		TwinPeak 2 BLK2 Series, TwinPeak Series
Axitec	AXI Power, AXI Premium, AXI Black Premium		ii. ZZ: SC, PR, BP, HiT, IB, MW	Renesola	Vitrus2 Series & 156 Series
Boviet	BVM6610, BVM6612	Jinko	JKM & JKMS Series	Risen	RSM Series
BYD	P6K & MHK-36 Series	Kyocera	KU Series	S-Energy	SN72 & SN60 Series (40mm)
	CS6V-M, CS6P-P, CS6K-M, CS5A-M,		LG xxx S1C-A5, LG xxx N1C-A5,	Seraphim	SEG-6 & SRP-6 Series
	CS6K-MS, CS6U-P, CS6U-M, CS6X-P, CS6K-MS,		LGxxxQ1C(Q1K)-A5, LGxxxN1C(N1K)-A5,	Sharp	NU-SA & NU-SC Series
	CS6K-M, CS6K-P, CS6P-P, CS6P-M, CS3U-P,		LGxxxS1CA5, LGxxxA1C-A5, LGxxxN2T-A4,	Silfab	SLA, SLG & BC Series
Canadian Solar	CS3U-MS, CS3K-P, CS3K-MS, CS1K-MS, CS3K,	LG Electronics	LGxxxN2T-A5, LGxxxN2W-A5	Solaria	PowerXT
	CS3U, CS3U-MB-AG, CS3K-MB-AG, CS6K, CS6U, CS3L, CS3W, CS1H-MS, CS1U-MS	LGxxxS2W-A5, LGxxxE1C-A5, LGxxxS2W-G4 LGxxxN1C(N1K)-G4, LGxxxN2W-G4, LGxxxS1C-G4, LGxxxE1K-A5, LGxxxN2T-J5,	SolarWorld	Sunmodule Protect, Sunmodule Plus	
Centrosolar America	C-Series & E-Series		LGxxxS1C-G4, LGxxxE1K-A5, LGxxxN2T-J5,	Sonali	SS 230 - 265
			LGxxxN1K(N1C)-V5, LGxxxQ1C(N2W)-V5,	Suntech	STP
CertainTeed	CT2xxMxx-01, CT2xxPxx-01, CTxxxMxx-02, CTxxxM-03,	LONGi	LR6-60 & LR6-72 Series,	Suniva	MV Series & Optimus Series
	CTxxxMxx-04, CTxxxHC11-04		LR4-60 & LR4-72 Series	Sun Edison/Flextronics	F-Series, R-Series & FLEX FXS Series
Dehui	DH-60M	Mission Solar Energy	MSE Series	SunPower	X-Series, E-Series & P-Series
Eco Solargy	Orion 1000 & Apollo 1000	Mitsubishi	MJE & MLE Series	Talesun	TP572, TP596, TP654, TP660,
FreeVolt	Mono PERC	Neo Solar Power Co.	D6M & D6P Series		TP672, Hipor M, Smart
GCL	GCL-P6 & GCL-M6 Series		VBHNxxxSA15 & SA16,	Tesla	SC, SC B, SC B1, SC B2
Hansol	TD-AN3, TD-AN4, UB-AN1, UD-AN1	Panasonic	VBHNxxxSA17 & SA18,PanasonicVBHNxxxSA17(E/G) & SA18E,VBHNxxxKA01 & KA03 & KA04,	Trina	PA05, PD05, DD05, DE06, DD06, PE06, PD14, PE14, DD14, DE14, DE15, PE15H
Heliene	36M, 60M, 60P, 72M & 72P Series			Upsolar	UP-MxxxP(-B), UP-MxxxM(-B)
	HT60-156(M) (NDV) (-F),		VBHNxxxZA01, VBHNxxxZA02,	URE	D7MxxxH8A, D7KxxxH8A, D7MxxxH7A
HT Solar	HT 72-156(M/P)		VBHNxxxZA03, VBHNxxxZA04	Vikram	Eldora, Solivo, Somera
lyundai	KG, MG, TG, RI, RG, TI, MI, HI & KI Series	Peimar	SGxxxM (FB/BF)	Waaree	AC & Adiya Series
TEK	iT, iT-HE & iT-SE Series	Phono Solar	PS-60, PS-72	Winaico	WST & WSP Series
Japan Solar	JPS-60 & JPS-72 Series	Q.Cells	Plus, Pro, Peak, G3, G4, G5, G6(+), G7, G8(+) Pro, Peak L-G2, L-G4, L-G5, L-G6, L-G7	Yingli	YGE & YLM Series

Please see the SFM UL2703Construction Data Report at Unirac.com to ensure the exact solar module selected is approved for use with SFM. SFM Infinity is not compatible with module frame height of less than 32mm and more than 40mm. See page J for further information.





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700

PAGE NUMBER

SS

SHEET NAME

REVISION 0

SPEC SHEET

# intertek

# **AUTHORIZATION TO MARK**

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Applicant: Unirac, Inc Manufacturer: 1411 Broadway Blvd NE Address: Address: Albuquerque, NM 87102 USA Country: Country: Klaus Nicolaedis Contact: Contact: Todd Ganshaw 505-462-2190 Phone: Phone: 505-843-1418 FAX: NA FAX: klaus.nicolaedis@unirac.com Email: Email: toddg@unirac.com Party Authorized To Apply Mark: Same as Manufacturer **Report Issuing Office:** Lake Forest, CA Control Number: 5003705 Authorized by: Intertek This document supersedes all previous Authorizations to Mark for the noted Report Number. This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect. Intertek Testing Services NA Inc. 545 East Algonguin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672 Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Plate Photovoltaic Modules and Panels [UL 2703: 2015 Ed.1] Standard(s):

Photovoltaic Module Racking Systems [CSA LTR AE-001:2012 Ed.2012/10/23]

Photovoltaic Mounting System, Sun Frame Microrail Installation Guide, PUB2020MAY04 Product: Brand Name: Unirac Unirac SFM Models:

ATM for Report 102393982LAX-002

Page 1 of 2

ATM Issued: 2-Jun-2020 ED 16.3.15 (20-Apr-17) Mandatory

intertek Total Quality. Assured

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Applicant:	Unirac, Inc		Manufacturer:
Address:	1411 Broadway Blvd N Albuquerque, NM 871		Address:
Country: Contact: Phone: FAX: Email:	USA Klaus Nicolaedis Todd Ganshaw 505-462-2190 505-843-1418 NA klaus.nicolaedis@unir toddg@unirac.com	rac.com	Country: Contact: Phone: FAX: Email:
Party Authoria Report Issuin	zed To Apply Mark: g Office:	Same as Manufacture Lake Forest, CA	Claud
Control Numb	per: <u>5003705</u>	Authorized by:	for L. Matthew S
		Ē	

Intertek This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are

limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

> Intertek Testing Services NA Inc. 545 East Algonquin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Standard(s):	Mounting Systems, Mounting Devices, Clamping/Retention Devices, an Plate Photovoltaic Modules and Panels [UL 2703: 2015 Ed.1]
	Photovoltaic Module Racking Systems [CSA LTR AE-001:2012 Ed.201
Product:	Photovoltaic Mounting System, Sun Frame Microrail Installation Guide,
Brand Name:	Unirac
Models:	Unirac SFM

ATM for Report 102393982LAX-002

Page 1 of 2

# AUTHORIZATION TO MARK

den ladynsti

nd Ground Lugs for Use with Flat-

2/10/23]

PUB2020MAY04

ATM Issued: 2-Jun-2020 ED 16.3.15 (20-Apr-17) Mandatory



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

SPEC SHEET PAGE NUMBER


HEET NAME

REVISION

SS

# S

# **SYSTEM COMPONENTS** INSTALLATION GUIDE PAGE

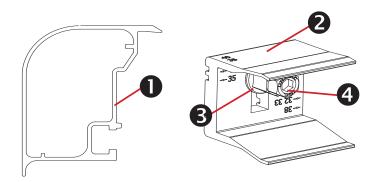

# **Trimrail<sup>™</sup> and Module Clips**

# Sub-Components:

- 1. Trim Rail
- 2. Module Clip
- 3. T-Bolt
- Tri-Drive Nut 4.

# Trimrail™

# **Functions:**

- Required front row structural support (with module clips) ٠
- Module mounting ٠
- Installation aid ٠
- . Aesthetic trim

# Features:

- Mounts directly to L-feet ٠
- Aligns and captures module leading edge •
  - Supports discrete module thicknesses from 32, 33, 35, 38, and 40mm


# **Module Clips**

# **Functions:**

- Required front row structural support (with trimrail)
- Module mounting ٠

# Features:

- Mounts to Trimrail<sup>™</sup> with T-bolt and tri-drive nut .
- Manually adjustable to fit module thicknesses 32, 33, 35, ٠ 38, and 40mm.

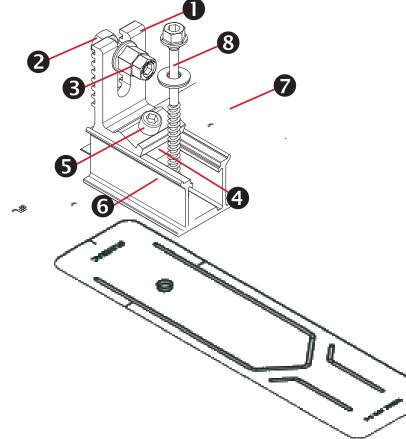

# Trimrail<sup>™</sup> Flashkit

# **Sub-Components:**

L-Foot Hex bolt Tri-drive nut Channel Nut Scocket Head Cap Screw 3"Channel/Slider w/grommet 3" Wide Flashing Structural Screw & SS EPDM Washer

# Functions:

- Attach Trimrail<sup>™</sup> to roof attachment / flashing
- Patented roof sealing technology at roof attachment point •

# Features:

.

- Slot provides vertical adjustments to level array
- Slider provides north/south adjustment along the ٠ slope of the roof
- Shed and Seal Technology

# **Trimrail<sup>™</sup> Splice**

# Sub-Components:


- 1. Structural Splice Extrusion
- 2. Bonding Clip

# Functions:

- Front row structural support
- Installation aid

# Features:

- Tool-less installation





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




Structurally connects 2 pieces of Trimrail<sup>™</sup> Electrically bonds 2 pieces of Trimrail<sup>™</sup>

Aligns and connects Trimrail<sup>™</sup> pieces

NABCEP CERTIFIED PV INSTALLATION PROFESSIONAL Scott Gurmey # PV-011719-015866
CONTRACTOR: BRS FIELD OPS 385.498.6700
SPEC SHEET
PAGE NUMBER REVISION SS 0

# **SYSTEM COMPONENTS** INSTALLATION GUIDE PAGE

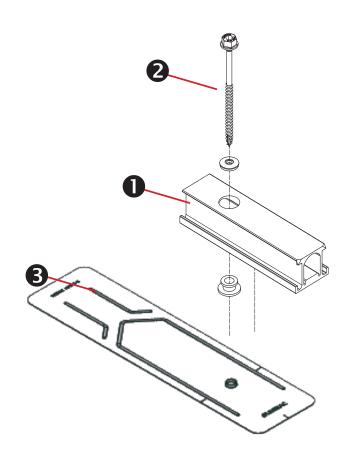

# SFM Slider Flashkit

S

# Sub-Components:


- 1. Slider w/grommet
- Structural Screw & SS EPDM washer 2.
- 3. 3" Wide Flashing

# Functions:

- Patented Shed & Seal roof sealing technology at roof attach-. ment point
- For use with compatible 2" Microrail or 8" Attached Splices ٠

# Features:

- . Slider provides north/south adjustment along the slope of the roof
- Shed and Seal Technology •




# Module-to-Module N-S Bonding

# Sub-Components:

- 1. Clamp
- Bonding Pins (2) 2.
- 3. 5/16" Socket Head Cap Screw
- 4. Clamp Base

# **Functions/ Features:**

- Row to row bonding
- Single Use Only
- Fits module sizes 32-40mm




# Trim -to- Module Bonding Clamp and Floating Trim Clamp

# **Sub-Components:**

- 1. Wedge
- Bonding Pin 2.
- 3. T-Bolt
- 4. Nut
- Cast Base 5.

# **Functions/ Features:**

- Module to Trimrail<sup>™</sup> bonding single use only •
- Attaches Trimrail<sup>™</sup> to module when fewer than . 2 rafter attachment points are available
- Fits module sizes 32-40mm
- Fits module sizes 32-40mm




# Wire Bonding Clip w/ 8AWG

# Functions:

- Row to row bonding
- Module to Trimrail<sup>™</sup> bonding Single Use Only
- Features:

Tool-less installation



# **MLPE Mounting Assembly**

# **Sub-Components:**

- 1. MLPE Mount Base
- 2. 5/16 Socket Head Cap Screw
- 3. Bonding Pin


# Functions:

- MLPE to module bonding

# Features:

UL2703 Recognized

MLPE = Module Level Power Electronics, e.g. microinverter or power optimizer



Securely mounts MLPE to module frames

Mounts easily to typical module flange



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




CONTRACTOR: **BRS FIELD OPS** 385.498.6700


HEET NAME SPEC SHEET

AGE NUMBER SS

REVISION 0




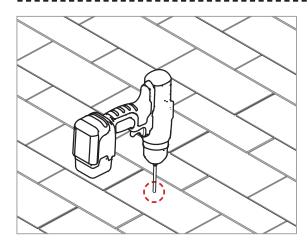

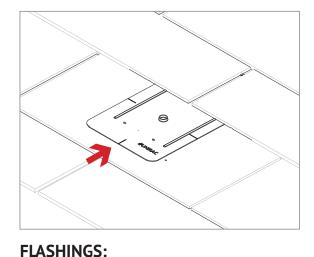

Place flashings

**PILOT HOLES:** Drill pilot holes for lag screws or structural screws (as necessary) at marked attachement points

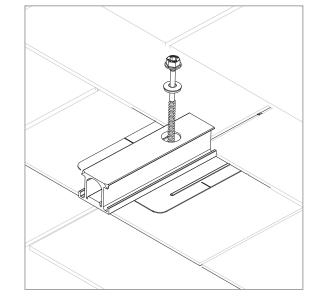

# **INSTALL SLIDERS AND TRIMRAIL ROOF ATTACHMENTS:**

• Insert flashings per manufacturer instructions

NOTE: Use Lag screw or structural fastener with a maximum diameter of 5/16"

- Attach sliders to rafters •
- Verify proper row to row spacing for module size (Mod NS + 1") •
- Ensure that TrimrailTM roof attachments in each row have sufficient • engagement with slider dovetails for proper attachment.

