

BUILDING CODES: 2017 NEC, AND 2018 NORTH CAROLINA RESIDENTIAL CODE

**NEWNAM, JOSH PV SYSTEM**  
**66 NEWBURY DRIVE.**  
**ANGIER, NC, 27501**  
**JURISDICTION: HARNETT COUNTY**  
**UTILITY:DUKE PROGRESS NC**

**GENERAL INFORMATION**


SYSTEM SIZE: 7.810 kW-DC-STC  
 6.000 kW-AC  
 ROOF PITCHED: 26 DEGREES  
 INVERTER: (1) SOLAREEDGE SE6000H-US W/ P370 OPTIMIZERS  
 MODULES: (22) LG355N1K-B6  
 STRINGS: (2)x11 MODULE SERIES STRINGS  
 ELECTRICAL SERVICE RATING: 200A  
 PV SYSTEM OVERCURRENT RATING: 35A  
 PV SYSTEM DISCONNECT SWITCH: EATON DG222URB (60A / 2P)  
 ROOF TYPE: COMP  
 ROOF FRAMING: MANUFACTURED/ENGINEERED TRUSS  
 RACKING: EVEREST  
 ATTACHMENT METHOD: MIN. 5/16" x 3 1/2 LAG SCREWS EA. STANDOFF

**TABLE OF CONTENTS**

REQUIRED INFORMATION	SHEET NAME	SHEET NUMBER
SITE INFORMATION	COVER PAGE	PV 1
MODULE AND EQUIPMENT LAYOUT	SITE PLAN	PV2
LOCATION & QUANTITY OF PACKING & STANDOFFS	PV LAYOUT	PV 3
RACKING LOAD & UPLIFT CALCULATIONS	PV LAYOUT	PV 3
ROOF ATTACHMENT DETAILS	DETAILS	PV 4
ELECTRICAL 1 LINE DIAGRAM	ONE LINE	PV 5
ELECTRICAL 3 LINE DIAGRAM	THREE LINE	PV 6
OCB & WIRE SIZING CALCULATIONS	1 & 3 LINE	PV 5 & 6
ARRAY & INVERTER ELECTRICAL SPECIFICATIONS	1 & 3 LINE	PV 5 & 6
EQUIPMENT SPECIFICATIONS	1 & 3 LINE	PV 5 & 6
LABEL NOTES	LABELS	PV 7
PV EQUIPMENT LABELING DETAIL	LABELS	PV 7
DIRECTORY LABEL	PLACARD	PV-8
PV EQUIPMENT SPECIFICATIONS	EQUIPMENT SPEC.	PV 9 - 16
DATA SHEETS & ADDITIONAL INFORMATION	SUPPLEMENTAL MATERIAL	


**VICINITY MAP**

SCALE: NTS

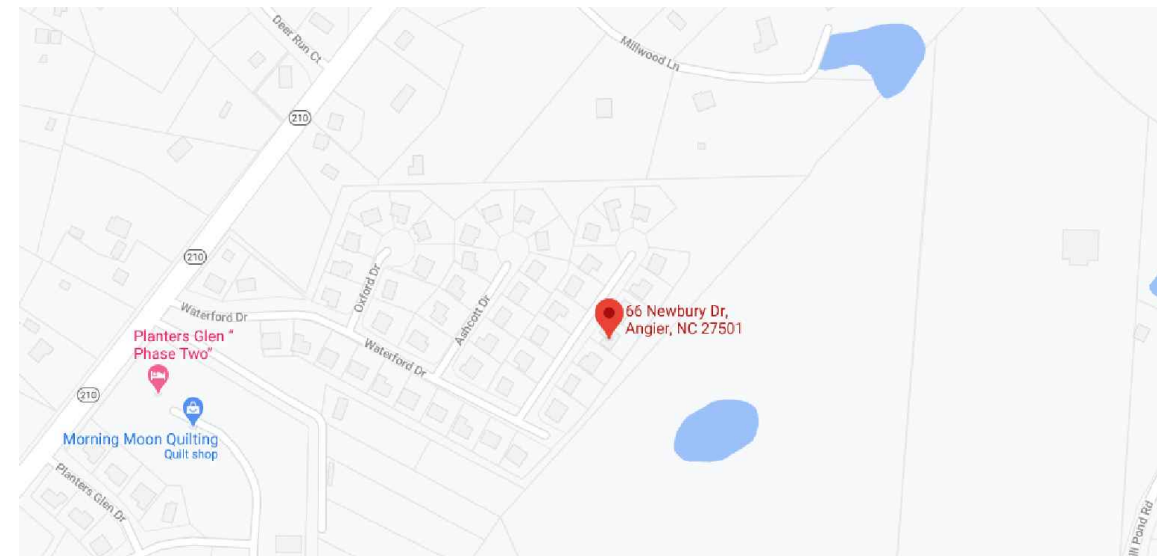

**AERIAL MAP**

SCALE: NTS

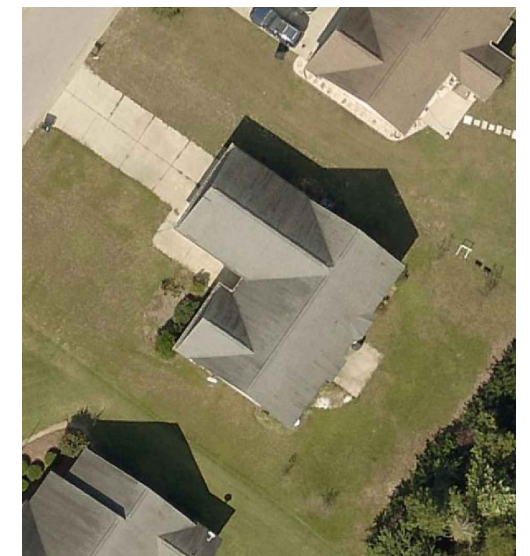

**NOTES**

**EQUIPMENT LOCATION**

- ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS AS REQUIRED BY NEC 110.26.
- WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC690.31(A),(C) AND NEC TABLES 310.15(B)(2)(A) AND 310.15(B)(3)(C).
- JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES ACCORDING TO NEC 690.34.
- ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT.
- ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES.
- ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

**WIRING & CONDUIT NOTES**

- ALL CONDUITS AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.
- CONDUCTORS SIZED ACCORDING TO NEC 690.8, NEC 690.7.
- DC WIRING LIMITED TO MODULE FOOTPRINT. MICRO INVERTER WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY WITH SUITABLE WIRING CLIPS.
- AC CONDUCTORS COLORED OR MARKED AS FOLLOWS: PHASE A OR L1- BLACK, PHASE B OR L-2 RED, OR OTHER CONVENTION IF THREE PHASE, PHASE C OR L3-BLUE, YELLOW, ORANGE, OR OTHER CONVENTION NEUTRAL- WHITE OR GREY IN 4-WIRE DELTA CONNECTED SYSTEMS THE PHASE WITH THE HIGHER VOLTAGE TO BE MARKED ORANGE NEC 110.15.

**GENERAL NOTES**

- MODULES ARE LISTED UNDER UL 1703 AND CONFORM TO THE STANDARDS.
- INVERTERS ARE LISTED UNDER UL 1741 AND CONFORM TO THE STANDARDS.
- DRAWINGS ARE DIAGRAMMATIC, INDICATING GENERAL ARRANGEMENT OF THE PV SYSTEM AND THE ACTUAL SITE CONDITION MIGHT VARY.
- WORKING CLEARANCES AROUND THE NEW PV ELECTRICAL EQUIPMENT WILL BE MAINTAINED IN ACCORDANCE WITH NEC 110.26.
- ALL GROUND WIRING CONNECTED TO THE MAIN SERVICE GROUNDING IN MAIN SERVICE PANEL/SERVICE COMPONENT.
- ALL CONDUCTORS SHALL BE 600V, 75° C STANDARD COPPER UNLESS OTHERWISE NOTED.
- WHEN REQUIRED, A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- THE SYSTEM WILL NOT BE INTERCONNECTED BY THE CONTRACTOR UNTIL APPROVAL FROM THE LOCAL JURISDICTION AND/OR THE UTILITY.
- ROOF ACCESS POINT SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREES, WIRES OR SIGNS.
- PV ARRAY COMBINER/JUNCTION BOX PROVIDES TRANSITION FROM ARRAY WIRING TO CONDUIT WIRING.




10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
 SEPERMITTING@TITANSOLARPOWER.COM  
 (877) 997-7652

NEWNAM, JOSH RESIDENCE  
 66 NEWBURY DRIVE, ANGIER, NC, 27501  
 LAT:35.479407, LON:-78.766903  
 TSP-68239

(22) LG355N1K-B6  
 (1) SOLAREEDGE SE6000H-US  
 7.810 kW DC SYSTEM SIZE  
 6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
 REV:A  
 DRAWN BY: DH

COVER PAGE  
**PV 1**

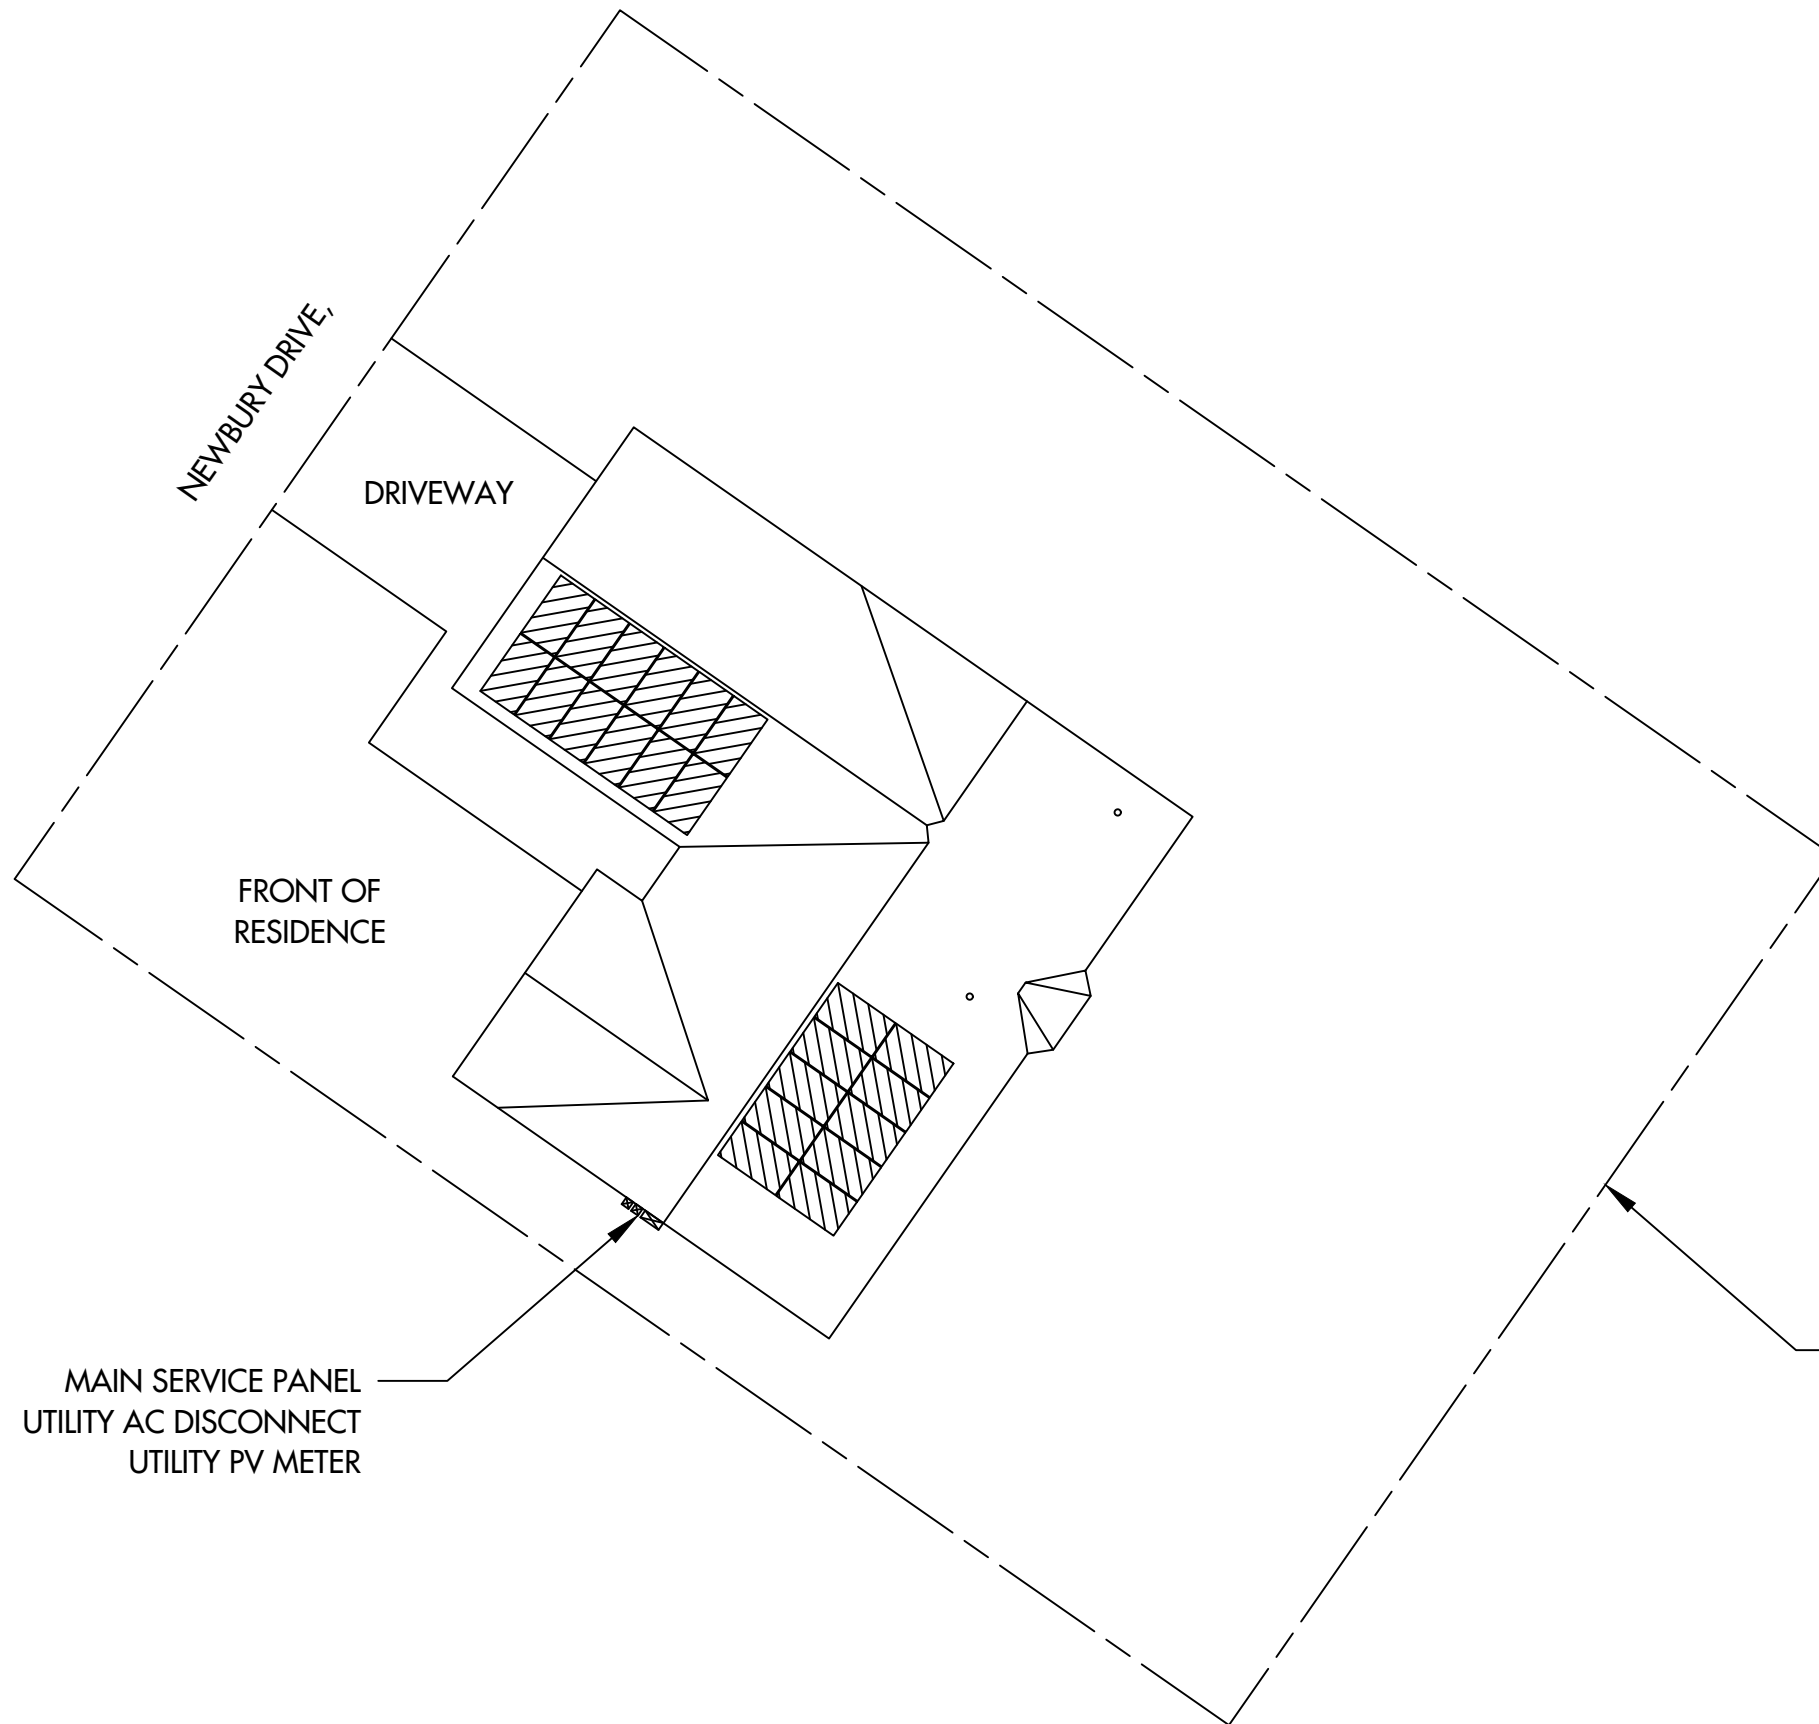


**PROJECT NOTES**

1. UTILITY SHALL HAVE 24HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC COMPONENTS LOCATED AT SES EQUIPMENT
2. NO LOCKED GATES, DOGS, ETC SHALL IMPEDE ACCESS TO SES EQUIPMENT
3. WORKSPACE IN FRONT OF AC ELECTRICAL SYSTEM COMPONENTS SHALL BE IN ACCORDANCE WITH UTILITY AND NEC REQUIREMENTS.
4. STATEWIDE UNIFORM REQUIREMENTS OF INSPECTION PROCEDURES FOR SOLAR PHOTOVOLTAIC SYSTEMS INSTALLED ON RESIDENTIAL ROOFTOPS.

MAIN SERVICE PANEL  
UTILITY AC DISCONNECT  
UTILITY PV METER

PROPERTY BOUNDARY TYP.

NOTE: NO GATES - NO FENCES



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

SCALE:0.005441  
DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

SITE PLAN  
**PV 2**

ARRAY


AR-01

QUANTITY: 12  
MOUNTING TYPE: FLUSH  
ARRAY TILT: 26°  
AZIMUTH: 215°  
ATTACHMENT SPACING: 6'  
ROOF TYPE: COMP



AR-02

QUANTITY: 10  
MOUNTING TYPE: FLUSH  
ARRAY TILT: 26°  
AZIMUTH: 125°  
ATTACHMENT SPACING: 6'  
ROOF TYPE: COMP

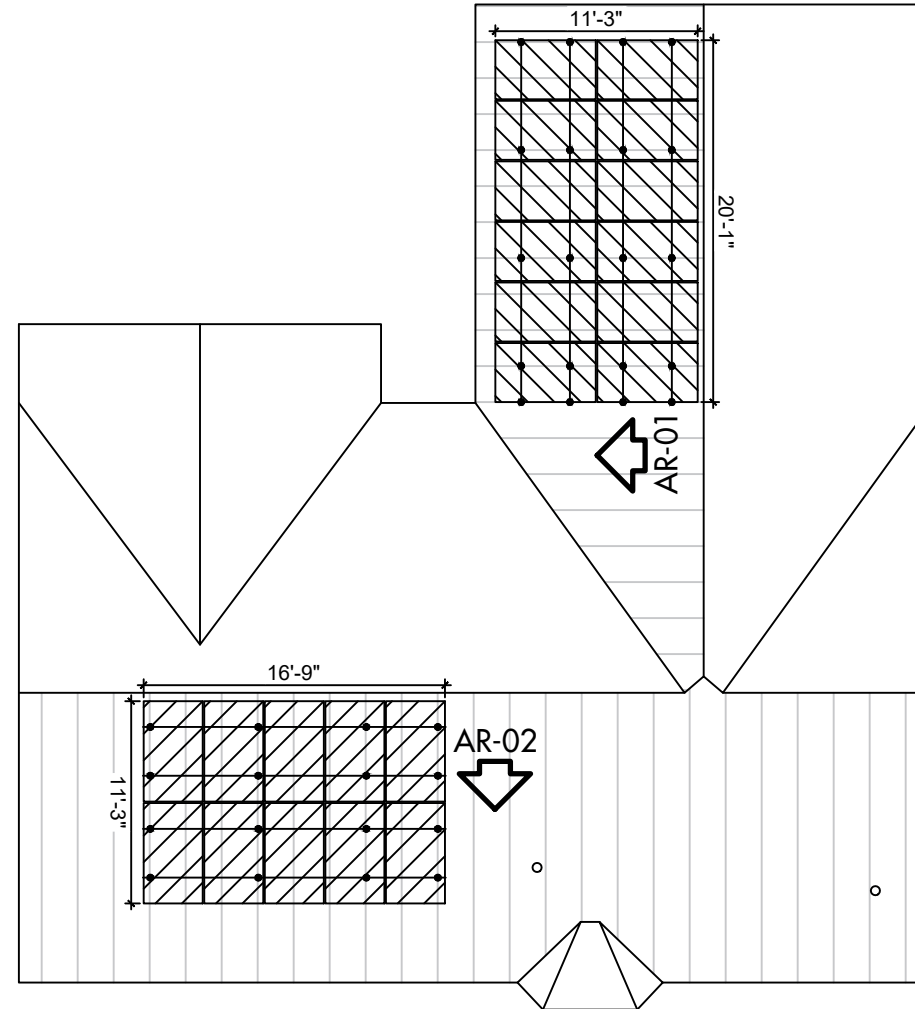

NOTES

- ROOF VENTS, SKYLIGHTS, WILL NOT BE COVERED UPON PV INSTALLATION
- TOTAL ROOF AREA = 2293 SQ-FT
- TOTAL ARRAY AREA = 429.08 SQ-FT
- ARRAY COVERAGE = 18.71%



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

SCALE: 3/32" = 1'-0"  
DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

PV LAYOUT  
**PV 3**

**MODULE & RACKING INFORMATION**

MODULE: LG355N1K-B6  
MODULE WEIGHT: 41 LBS  
MODULE DIMENSIONS: 68.5" x 41" x 1.5"  
RACKING/RAIL: QUICKBOLT / EVEREST

**ROOF & FRAMING INFORMATION**

MATERIAL: COMP  
RAFTER/TRUSS SIZE: 2" x 4"  
RAFTER/TRUSS SPACING: 2'

**ARRAY INFORMATION:**

ARRAY 01: 12 MODULES  
UPLIFT CALCULATION:  
PANEL GROUP AREA: = MODULE AREA: 19.50  
SQ.FT \* MODULE QTY. 12 = 234.04 SQ.FT

TOTAL UPLIFT: = PANEL GROUP AREA: 234.04  
SQ. FT. \* WIND LOAD 30 PSF =  
TOTAL LOAD 7021.25 LBS.

POINT LOAD CALCULATION:  
ARRAY WEIGHT: MODULE WEIGHT (41 +3.5)  
\* MODULE QTY. 12 = 534.00 LBS / 20  
MOUNTING POINTS = 26.70 LBS. PER  
MOUNTING POINT

PULLOUT STRENGTH CALCULATION:  
CONNECTOR TYPE: 5/16" LAG SCREW  
(EMBED MIN. 2.5")  
PULLOUT STRENGTH: = OF MOUNTING  
POINTS: 20 \* 2.5 (EMBED DEPTH) \* 210 LBS =  
10500.00 LBS.

DISTRIBUTED LOAD CALCULATION:  
ARRAY WEIGHT: 534.00 LBS. / MODULE  
GROUP AREA: 234.04 SQ. FT. = 2.28 PSF

MODULE & RACKING WEIGHT:  
(MODULE WEIGHT + 3.5LBS) \* MODULE QTY.  
(44.5 LBS)\*12 = 534.00 LBS


ARRAY 02: 10 MODULES  
UPLIFT CALCULATION:  
PANEL GROUP AREA: = MODULE AREA: 19.50  
SQ.FT \* MODULE QTY. 10 = 195.03 SQ.FT  
TOTAL UPLIFT: = PANEL GROUP AREA: 195.03  
SQ. FT. \* WIND LOAD 30 PSF =  
TOTAL LOAD 5851.04 LBS.

POINT LOAD CALCULATION:  
ARRAY WEIGHT: MODULE WEIGHT (41 +3.5)  
\* MODULE QTY. 10 = 445.00 LBS / 16  
MOUNTING POINTS = 27.81 LBS. PER  
MOUNTING POINT

PULLOUT STRENGTH CALCULATION:  
CONNECTOR TYPE: 5/16" LAG SCREW  
(EMBED MIN. 2.5")  
PULLOUT STRENGTH: = OF MOUNTING  
POINTS: 16 \* 2.5 (EMBED DEPTH) \* 210 LBS =  
8400.00 LBS.

DISTRIBUTED LOAD CALCULATION:  
ARRAY WEIGHT: 445.00 LBS. / MODULE  
GROUP AREA: 195.03 SQ. FT. = 2.28 PSF

MODULE & RACKING WEIGHT:  
(MODULE WEIGHT + 3.5LBS) \* MODULE QTY.  
(44.5 LBS)\*10 = 445.00 LBS

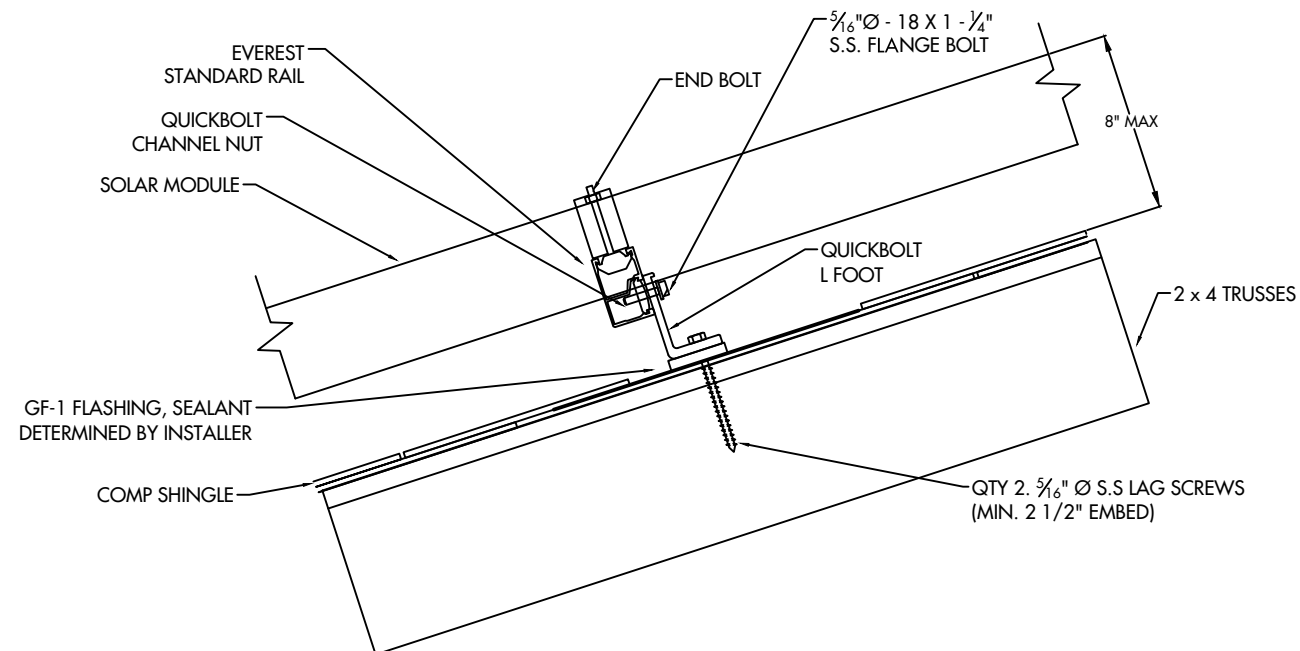

10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

DETAILS  
PV 4

**PV MODULE**

LG355N1K-B6  
 W = 355W  
 ISC = 10.72 ADC  
 VOC = 41.5 VDC  
 IMP = 10.15 ADC  
 VMP = 35 VDC  
 TVOC = -0.26% / °C

**WIRE SCHEDULE**

A - (4) #10 AWG-CU PV WIRE (HR)  
 - (1) #10 AWG-CU BARE COPPER WIRE (GND)  
 IN FREE AIR


B - (4) #10 AWG-CU THWN-2 WIRE (HR)  
 - (1) #10 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT

C - (3) #8 AWG-CU THWN-2 WIRE (HR)  
 - (1) #8 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT

**MAIN SERVICE PANEL**

BUS RATING = 200A  
 MAX. CURRENT RATING = 240A (200A X 1.2)

SOLAR BREAKER = 35A  
 MAIN BREAKER = 200A  
 TOTAL = 235A

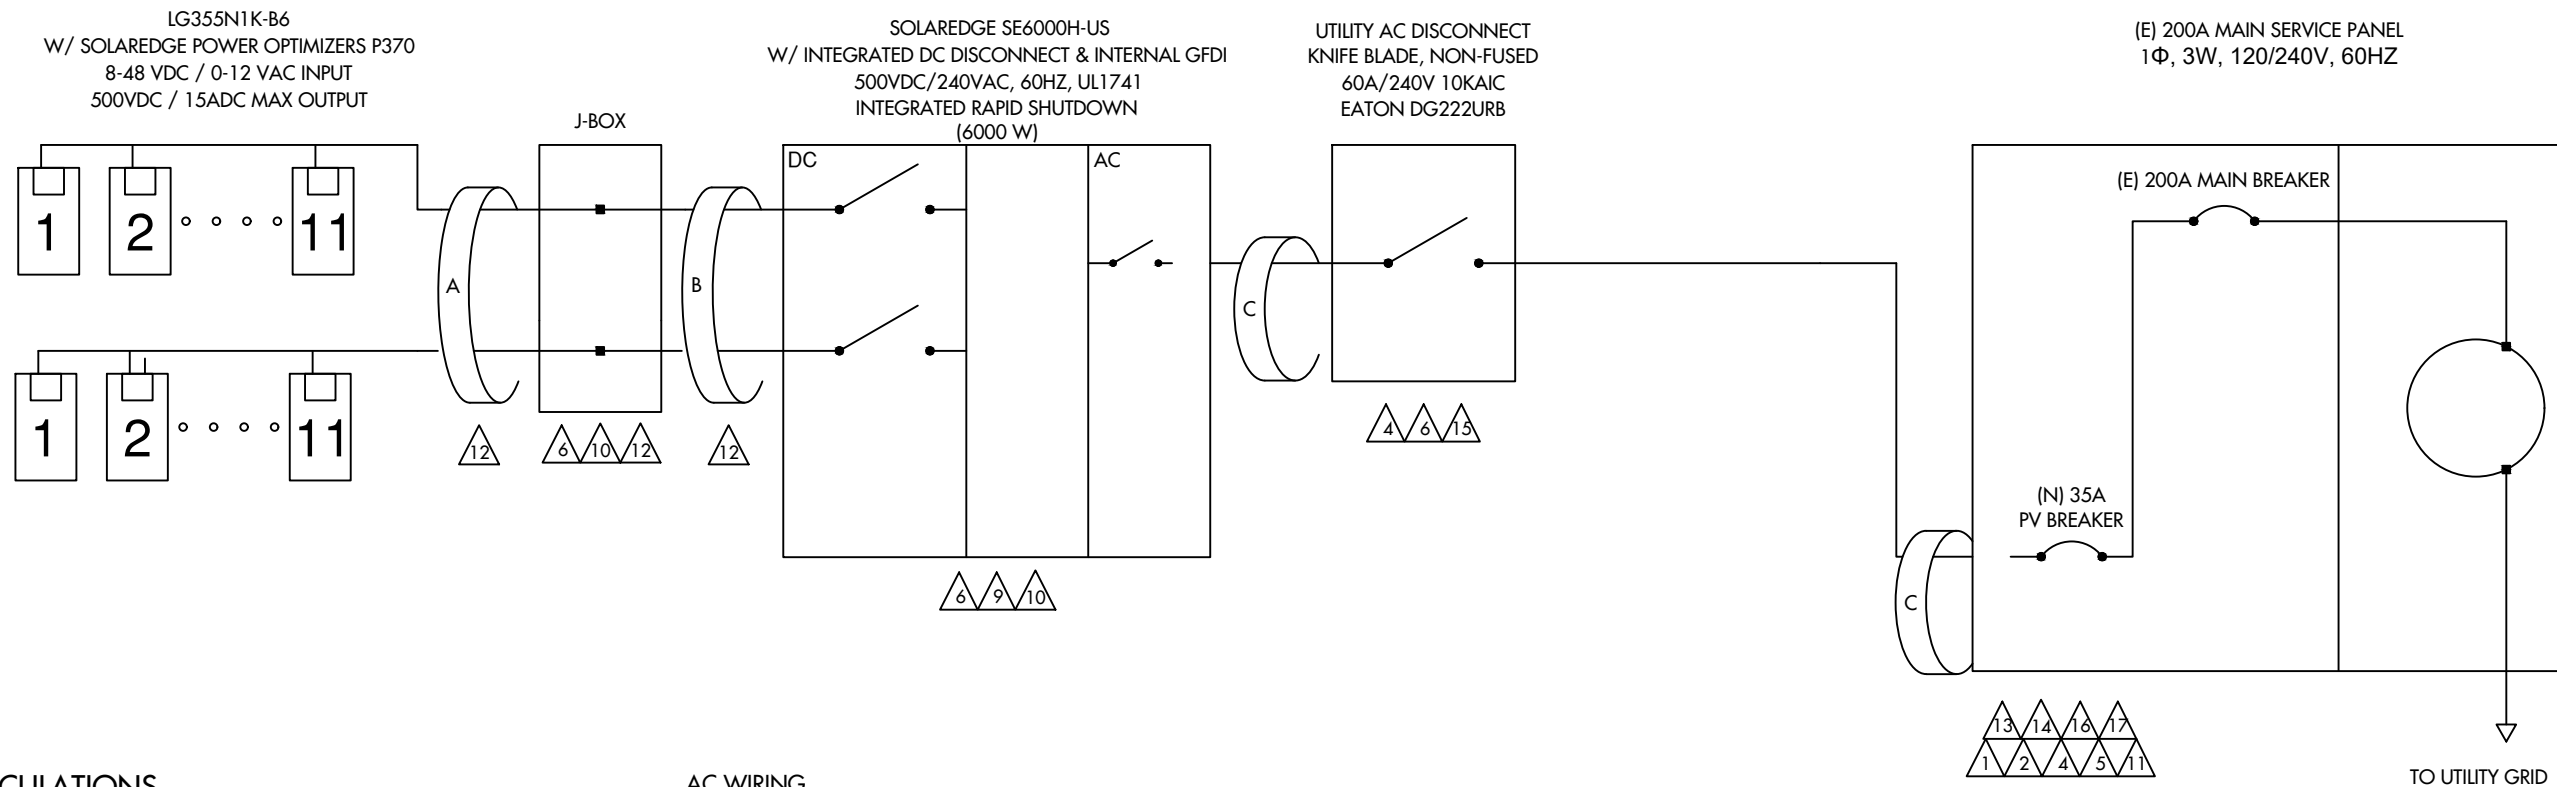

**WIRE SIZE CALCULATIONS**

TEMP CORRECTION FACTOR: 0.87 (109° AMBIENT)  
 ROOF TOP TEMP CORRECTION FACTOR: 1 (109°)  
 (2" ABOVE ROOFTOP / 0° TEMP ADDERS - AS OCCURS)  
 (TEMP DATA TAKEN FROM ASHRAE 2% AVG HIGH TEMP)

**DC WIRING**  
 CONDUIT FILL FACTOR = 0.8  
 OPTIMIZER MAX. CURRENT = 18.75ADC (15A X 1.25)  
 #10 - AWG CU. AMPACITY = 45.10A (55A X 1.0 X 0.87) FREE AIR  
 #10 - AWG CU. AMPACITY = 32A (40A X 1 X 0.8) ROOFTOP CONDUIT

**AC WIRING**  
 CONDUIT FILL FACTOR = 1 (3) CONDUCTORS  
 MAX. INVERTER CURRENT = 25A (PER INVERTER SPECS)  
 MIN. INVERTER OCP = 31.25A (25A X 1.25)  
 INVERTER OCP = 35A  
 #8 - AWG CU AMPACITY = 47.85A (55A X 1.0 X 0.87)



NEWNAM, JOSH RESIDENCE  
 66 NEWBURY DRIVE, ANGIER, NC, 27501  
 LAT:35.479407, LON:-78.766903  
 TSP-68239

(22) LG355N1K-B6  
 (1) SOLAREGE SE6000H-US  
 7.810 kW DC SYSTEM SIZE  
 6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
 REV:A  
 DRAWN BY: DH

ONE LINE  
**PV 5**

**PV MODULE**

LG355N1K-B6  
 W = 355W  
 ISC = 10.72 ADC  
 VOC = 41.5 VDC  
 IMP = 10.15 ADC  
 VMP = 35 VDC  
 TVOC = -0.26% / °C

**WIRE SCHEDULE**


A - (4) #10 AWG-CU PV WIRE (HR)  
 - (1) #10 AWG-CU BARE COPPER WIRE (GND)  
 IN FREE AIR

B - (4) #10 AWG-CU THWN-2 WIRE (HR)  
 - (1) #10 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT

C - (3) #8 AWG-CU THWN-2 WIRE (HR)  
 - (1) #8 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT

**MAIN SERVICE PANEL**

BUS RATING = 200A  
 MAX. CURRENT RATING = 240A (200A X 1.2)  
 SOLAR BREAKER = 35A  
 MAIN BREAKER = 200A  
 TOTAL = 235A

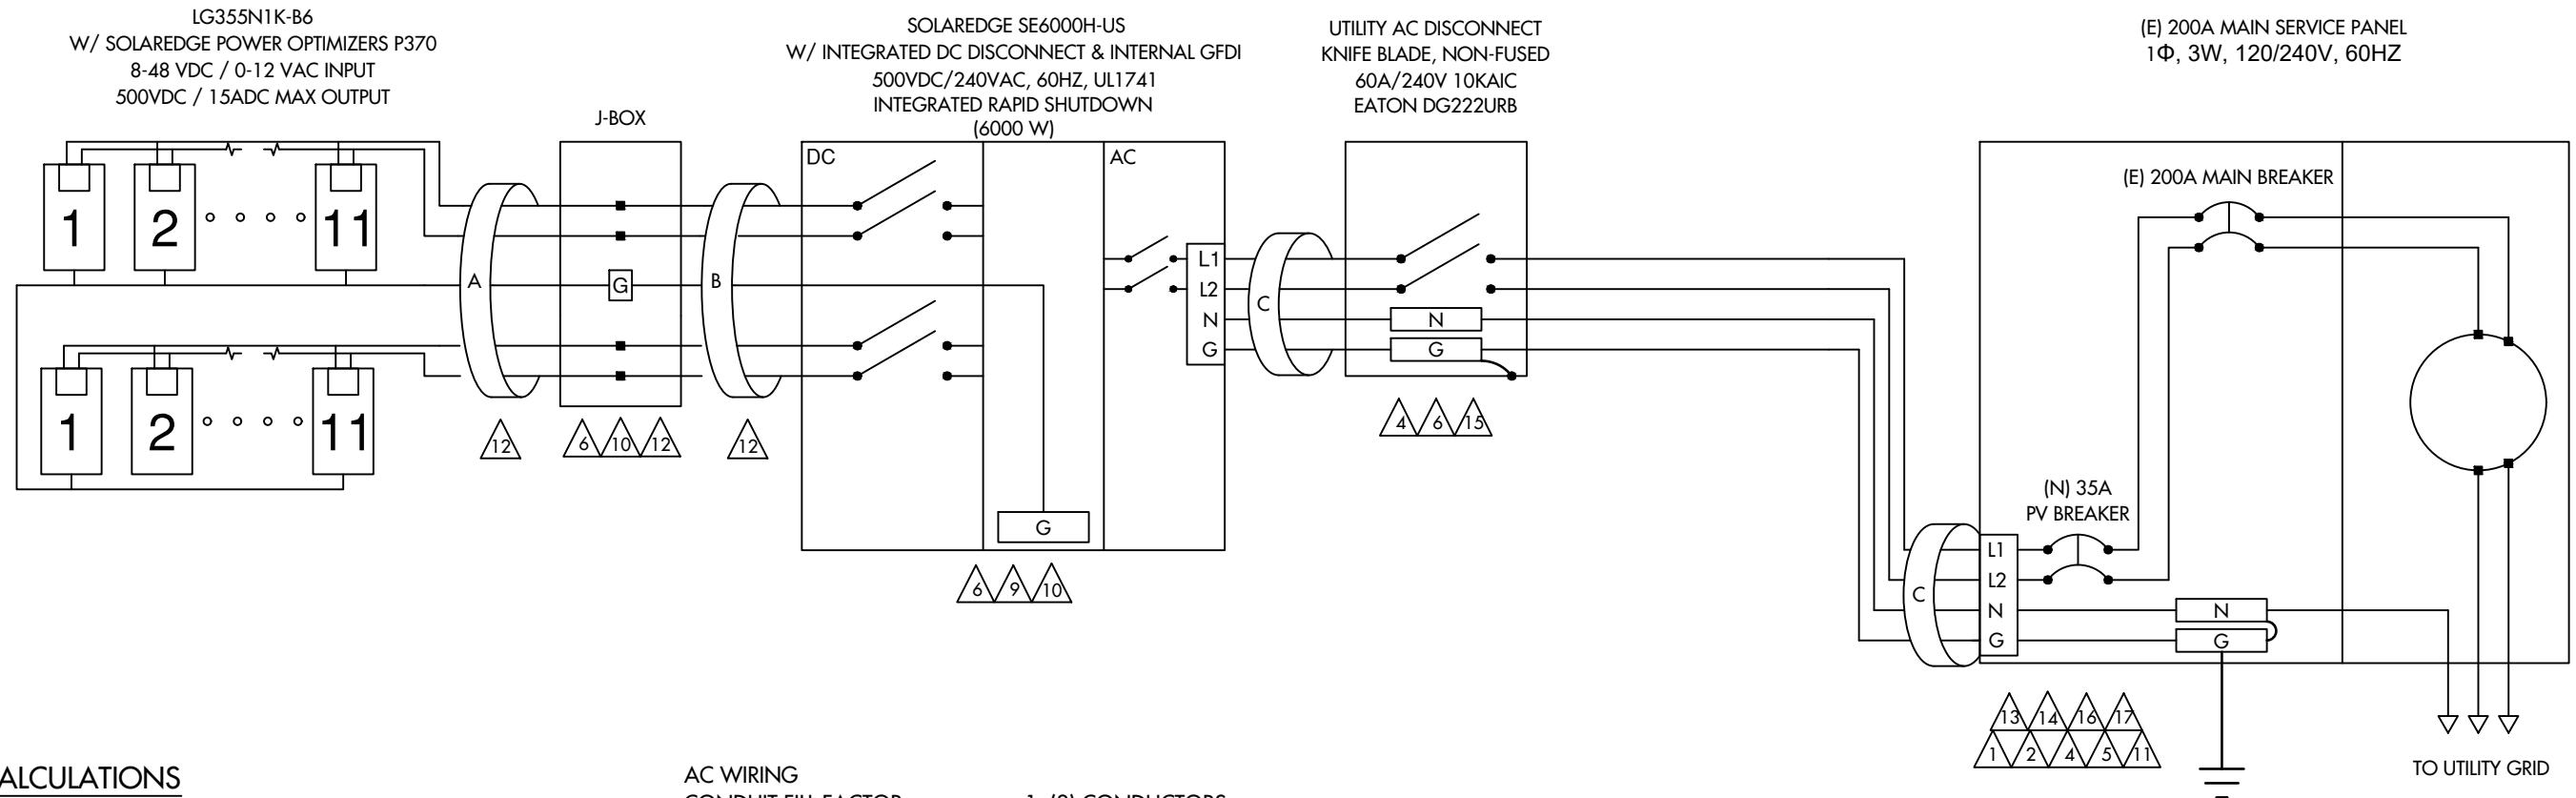

**WIRE SIZE CALCULATIONS**

TEMP CORRECTION FACTOR: 0.87 (109° AMBIENT)  
 ROOF TOP TEMP CORRECTION FACTOR: 1 (109°)  
 (2" ABOVE ROOFTOP / 0° TEMP ADDERS - AS OCCURS)  
 (TEMP DATA TAKEN FROM ASHRAE 2% AVG HIGH TEMP)

**DC WIRING**

CONDUIT FILL FACTOR = 0.8  
 OPTIMIZER MAX. CURRENT = 18.75ADC (15A X 1.25)  
 #10 - AWG CU. AMPACITY = 45.10A (55A X 1.0 X 0.87) FREE AIR  
 #10 - AWG CU. AMPACITY = 32A (40A X 1 X 0.8) ROOFTOP CONDUIT

**AC WIRING**

CONDUIT FILL FACTOR = 1 (3) CONDUCTORS  
 MAX. INVERTER CURRENT = 25A (PER INVERTER SPECS)  
 MIN. INVERTER OCP = 31.25A (25A X 1.25)  
 INVERTER OCP = 35A  
 #8 - AWG CU AMPACITY = 47.85A (55A X 1.0 X 0.87)



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
 SEPERMITTING@TITANSOLARPOWER.COM  
 (877) 997-7652

NEWNAM, JOSH RESIDENCE  
 66 NEWBURY DRIVE, ANGIER, NC, 27501  
 LAT:35.479407, LON:-78.766903  
 TSP-68239

(22) LG355N1K-B6  
 (1) SOLAREEDGE SE6000H-US  
 7.810 kW DC SYSTEM SIZE  
 6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
 REV:A  
 DRAWN BY: DH

THREE LINE  
**PV 6**



1 **CAUTION**  
PHOTOVOLTAIC SYSTEM CIRCUIT IS BACKFED  
LOCATION: BACKFED BREAKER  
CODE REF: NEC 705.12(4)

2 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
INVERTER OUTPUT CURRENT  
DEVICE. DO NOT RELOCATE THIS  
OVERCURRENT DEVICE.  
LOCATION: BACKFED BREAKER  
CODE REF: 2017 NEC 705.12(2)(3)(b)

3 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
A GENERATION SOURCE IS CONNECTED TO  
THE SUPPLY (UTILITY) SIDE OF THE MAIN SERVICE  
DISCONNECT. FOLLOW THE PROPER  
LOCK-OUT/TAG-OUT PROCEDURES TO ENSURE  
THE PHOTOVOLTAIC SYSTEM UTILITY  
DISCONNECT SWITCH IS OPENED PRIOR TO  
PERFORMING WORK ON THIS DEVICE  
LOCATION: (IF APPLICABLE)  
SUPPLY SIDE TAP  
LOAD PANEL  
CODE REF: UTILITY

4 **PHOTOVOLTAIC AC DISCONNECT**  
RATED AC OPERATING CURRENT: 25AAC  
NOMINAL OPERATING AC VOLTAGE: 240VAC  
LOCATION: MAIN PANEL  
AC DISCONNECT(S)  
CODE REF: NEC 690.54

5 **RAPID SHUTDOWN  
SWITCH FOR  
SOLAR PV SYSTEM**  
LOCATION: MAIN PANEL (EXTERIOR)  
PV BREAKER (INTERIOR)  
CODE REF: NEC 690.56(C)(3)

6 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
LOCATION: COMBINER PANEL  
AC DISCONNECT  
JUNCTION BOX  
INVERTER(S)  
CODE REF: NEC 690.13(B)

7 **PHOTOVOLTAIC  
SYSTEM METER**  
LOCATION: DEDICATED KWH METER  
CODE REF: NEC 690.4(B) UTILITY

8 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
PHOTOVOLTAIC COMBINER PANEL.  
DO NOT ADD LOADS  
LOCATION: AC COMBINER PANEL  
CODE REF: NEC 690.13(B)

9 **MAXIMUM VOLTAGE: 480VDC**  
**MAXIMUM CIRCUIT CURRENT: 15.0ADC**  
**MAX. RATED OUTPUT CURRENT  
OF THE CHARGE CONTROLLER  
OR DC-TO-DC- CONVERTER  
(IF INSTALLED) 15.0ADC**  
LOCATION: DC DISCONNECT  
INVERTER  
CODE REF: UTILITY

10 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
DC VOLTAGE IS ALWAYS PRESENT  
WHEN SOLAR MODULES ARE  
EXPOSED TO SUNLIGHT  
LOCATION: DC DISCONNECT, COMBINE BOX  
CODE REF: NEC 690.13(B)

11 **SOLAR PV SYSTEM EQUIPPED  
WITH RAPID SHUTDOWN**  
TURN RAPID SHUTDOWN  
SWITCH TO THE "OFF"  
POSITION TO SHUT DOWN  
PV SYSTEM AND REDUCE  
SHOCK HAZARD IN THE  
ARRAY.  
SOLAR ELECTRIC  
PV PANELS  
LOCATION: MAIN SERVICE (OUTSIDE COVER)  
CODE REF: NEC 690.12  
NEC 690.56(C)(1)(a)  
YELLOW STICKER

12 **WARNING PHOTOVOLTAIC POWER SOURCE**  
LOCATION: DC CONDUIT  
JUNCTION BOX  
NO MORE THAN 10FT  
CODE REF: NEC 690.31(G)(3)  
NEC 690.31(G)(4)  
REFLECTIVE AND WEATHER RESISTANT  
LABEL REQUIRES CAPITALIZED LETTERS WITH A MINIMUM HEIGHT OF 3/8 INCH, WHITE LETTERS ON RED BACKGROUND  
LABELS SHALL BE PLACED ON INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, AND CABLE ASSEMBLIES  
EVERY 10 FEET, WITHIN 1 FOOT OF TURNS OR BENDS AND WITHIN 1 FOOT ABOVE AND BELOW PENETRATIONS OF  
ROOF/CEILING ASSEMBLIES, WALLS OR BARRIERS.

13 **CAUTION**  
DUAL POWER SOURCE  
SECOND SOURCE IS  
PHOTOVOLTAIC  
LOCATION: SERVICE METER  
MAIN PANEL  
CODE REF: UTILITY

14 **WARNING**  
INVERTER OUTPUT CONNECTION  
DO NOT RELOCATE THIS  
OVERCURRENT DEVICE  
LOCATION: (IF APPLICABLE)  
SERVICE PANEL  
CODE REF: NEC 705.12(7)

15 **PHOTOVOLTAIC SYSTEM  
UTILITY DISCONNECT SYSTEM**  
LOCATION: AC DISCONNECT  
CODE REF: UTILITY

16 **PV SOLAR BREAKER**  
DO NOT RELOCATE THIS  
OVERCURRENT DEVICE  
LOCATION: MAIN PANEL:(EXTERIOR)  
PV BREAKER: (INTERIOR)  
CODE REF: NEC 705.12(B)(2)(3)(B)

17 **WARNING**  
TURN OFF PHOTOVOLTAIC AC  
DISCONNECT PRIOR TO  
WORKING INSIDE PANEL  
LOCATION: MAIN PANEL:(EXTERIOR)  
CODE REF: OSHA 1910.145



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE


DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

LABELS  
PV 7



# CAUTION

POWER TO THIS BUILDING IS  
SUPPLIED FROM THE FOLLOWING  
SOURCES WITH DISCONNECTS AS  
SHOWN:

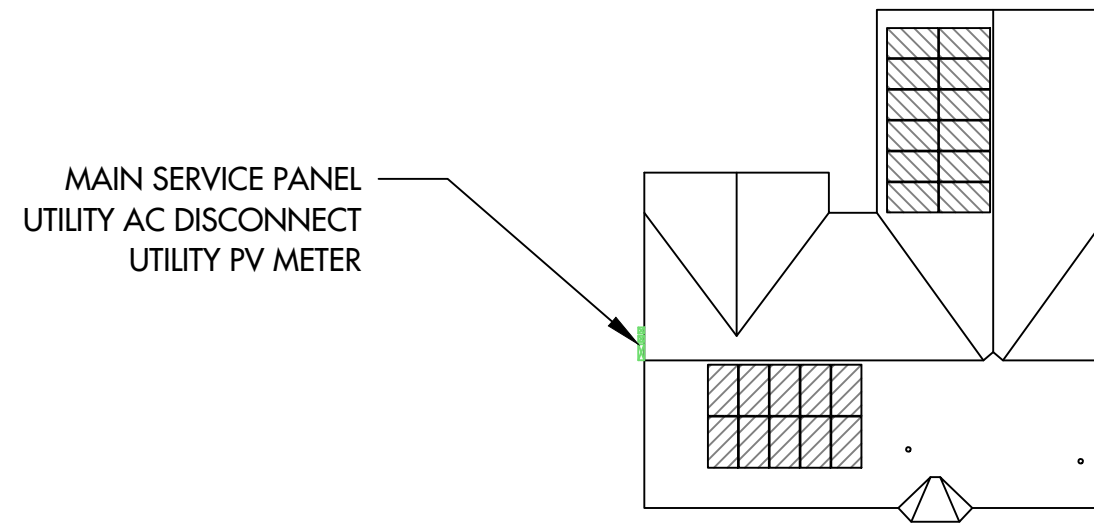

DIRECTORY PLAQUE IN  
ACCORDANCE WITH  
NEC690.56(A)(B), 705.10



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

PLACARD  
PV 8



# Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

12-25 YEAR WARRANTY



INVERTERS

## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014 and 2017, per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
APPLICABLE TO INVERTERS WITH PART NUMBER	SEXXXXH-XXXXXX4							
<b>OUTPUT</b>								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac
AC Frequency (Nominal)	59.3 - 60 - 60.5 <sup>(1)</sup>							Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A
Power Factor	1, Adjustable - 0.85 to 0.85							
GFDI Threshold	1							A
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes							
<b>INPUT</b>								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded	Yes							
Maximum Input Voltage	480							Vdc
Nominal DC Input Voltage	380							Vdc
Maximum Input Current @240V <sup>(2)</sup>	8.5	10.5	13.5	16.5	20	27	30.5	Adc
Maximum Input Current @208V <sup>(2)</sup>	-	9	-	13.5	-	-	27	Adc
Max. Input Short Circuit Current	45							Adc
Reverse-Polarity Protection	Yes							
Ground-Fault Isolation Detection	600k $\Omega$ Sensitivity							
Maximum Inverter Efficiency	99				99.2			%
CEC Weighted Efficiency			99				99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption	< 2.5							W

<sup>(1)</sup> For other regional settings please contact SolarEdge support.  
<sup>(2)</sup> A higher current source may be used; the inverter will limit its input current to the values stated.

## Single Phase Inverter with HD-Wave Technology for North America


SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US		
<b>ADDITIONAL FEATURES</b>									
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)								
Revenue Grade Metering, ANSI C12.20	Optional <sup>(1)</sup>								
Consumption metering									
Inverter Commissioning	With the SetApp mobile application using Built-in Wi-Fi Access Point for Local Connection								
Rapid Shutdown - NEC 2014 and 2017 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect								
<b>STANDARD COMPLIANCE</b>									
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.I.L. M-07								
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (H)								
Emissions	FCC Part 15 Class B								
<b>INSTALLATION SPECIFICATIONS</b>									
AC Output Conduit Size / AWG Range	1" Maximum / 14-6 AWG			1" Maximum / 14-4 AWG					
DC Input Conduit Size / # of Strings / AWG Range	1" Maximum / 1-2 strings / 14-6 AWG			1" Maximum / 1-3 strings / 14-6 AWG					
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 6.8 / 450 x 370 x 174			21.3 x 14.6 x 7.3 / 540 x 370 x 185					in / mm
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.9	38.8 / 17.6					lb / kg
Noise	< 25			< 50					dBA
Cooling	Natural Convection								
Operating Temperature Range	-40 to +140 / -40 to +60 <sup>(1)</sup>							°F / °C	
Protection Rating	NEMA 4X (Inverter with Safety Switch)								

<sup>(1)</sup> Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BN4. For consumption metering, current transformers should be ordered separately: SEACT0750-200NA-20 or SEACT0750-400NA-20, 20 units per box.  
<sup>(2)</sup> Full power up to at least 50°C / 122°F; for power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>

## How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

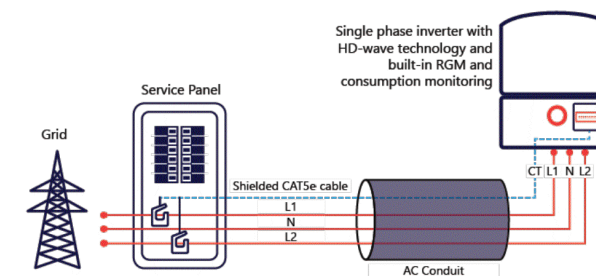

© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 01/2020/V01/ENG-NAM. Subject to change without notice.



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

EQUIPMENT SPECIFICATIONS  
PV 9




This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

<b>Applicant:</b> SolarEdge Technologies Ltd <b>Address:</b> 1 HaMada Street Herzeliya 4673335	<b>Manufacturer:</b> Celestica Romania <b>Address:</b> 88 Soseaua Borsului, Bors, Bihor county, 417075
<b>Country:</b> Israel <b>Contact:</b> Mr. Oren Bachar or Mr. Meir Adest	<b>Country:</b> Romania <b>Contact:</b> Renata Bodan
<b>Phone:</b> +972 9 957 6620 #293 or +972 9 957 6620 #131	<b>Phone:</b> +40-359-403-661
<b>FAX:</b> 972 9 957 6591 <b>Email:</b> OREB.B@SOLAREEDGE.COM MEIR.A@SOLAREEDGE.COM	<b>FAX:</b> +40-722-964-215 <b>Email:</b> rbodan@celestica.com

**Party Authorized To Apply Mark:** Same as Manufacturer  
**Report Issuing Office:** Cortland NY 13045

**Control Number:** 4004590 **Authorized by:**   
Ulla-Pia Johansson-Nilsson  
for Dean Davidson, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc.  
545 East Algonquin Road, Arlington Heights, IL 60005  
Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

<b>Standard(s):</b> Inverters, Converters, Controllers And Interconnection System Equipment For Use With Distributed Energy Resources [UL 1741:2010 Ed.2(Supplement SA)+R:07Sep2016]  Power Conversion Equipment [CSA C22.2#107.1:2016 Ed.4].  UL SUBJECT 1699B Issued: 2013/01/14 Ed: 2 Outline of Investigation for Photovoltaic (PV) DC ARC-Fault Circuit Protection
<b>Product:</b> Grid support Utility Interactive Inverter - Non Isolated Photovoltaic Inverter with MPPT function and Rapid
<b>Brand Name:</b> SolarEdge
<b>Models:</b> SE3000H-US, SE3800H-US, SE5000H-US, SE6000H-US, SE7600H-US, SE10000H-US and SE11400H-US


*HEG*

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

<b>Applicant:</b> SolarEdge Technologies Ltd <b>Address:</b> 1 HaMada Street Herzeliya 4673335	<b>Manufacturer:</b> Jabil Circuit (Guangzhou) LTD <b>Address:</b> DEV EAST DISTRICT 128 JUN CHENG RD GUANGZHOU, GUANGDONG 510530 China
<b>Country:</b> Israel <b>Contact:</b> Mr. Oren Bachar or Mr. Meir Adest	<b>Country:</b> China <b>Contact:</b> Elaine Ouyang
<b>Phone:</b> +972 9 957 6620 #293 or +972 9 957 6620 #131	<b>Phone:</b> 020-2805-4025/ 135-7023-5852
<b>FAX:</b> 972 9 957 6591 <b>Email:</b> OREB.B@SOLAREEDGE.COM MEIR.A@SOLAREEDGE.COM	<b>FAX:</b> N/A <b>Email:</b> Elaine.ouyang@jabil.com

**Party Authorized To Apply Mark:** Same as Manufacturer  
**Report Issuing Office:** Cortland NY 13045

**Control Number:** 4004590 **Authorized by:**   
Ulla-Pia Johansson-Nilsson  
for Dean Davidson, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc.  
545 East Algonquin Road, Arlington Heights, IL 60005  
Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

<b>Standard(s):</b> Inverters, Converters, Controllers And Interconnection System Equipment For Use With Distributed Energy Resources [UL 1741:2010 Ed.2(Supplement SA)+R:07Sep2016]  Power Conversion Equipment [CSA C22.2#107.1:2016 Ed.4].  UL SUBJECT 1699B Issued: 2013/01/14 Ed: 2 Outline of Investigation for Photovoltaic (PV) DC ARC-Fault Circuit Protection
<b>Product:</b> Grid support Utility Interactive Inverter - Non Isolated Photovoltaic Inverter with MPPT function and Rapid
<b>Brand Name:</b> SolarEdge
<b>Models:</b> SE3000H-US, SE3800H-US, SE5000H-US, SE6000H-US, SE7600H-US, SE10000H-US and SE11400H-US

*HEG*



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

EQUIPMENT  
SPECIFICATIONS  
**PV 10**



# Power Optimizer

For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505



POWER OPTIMIZER

## PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

[solaredge.com](http://solaredge.com)



## Power Optimizer For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505

Optimizer model (typical module compatibility)	P320 (for 60-cell modules)	P340 (for high-power 60-cell modules)	P370 (for higher-power 60 and 72-cell modules)	P400 (for 72 & 96-cell modules)	P401 (for high power 60 and 72 cell modules)	P405 (for high-voltage modules)	P485 (for high-voltage modules)	P505 (for higher current modules)		
<b>INPUT</b>										
Rated Input DC Power <sup>(1)</sup>	320	340	370	400		405	485	505	W	
Absolute Maximum Input Voltage (Voc at lowest temperature)	48		60	80	60	125 <sup>(2)</sup>		83 <sup>(2)</sup>	Vdc	
MPPT Operating Range	8 - 48		8 - 60	8 - 80	8-60	12.5 - 105		12.5 - 83	Vdc	
Maximum Short Circuit Current (Isc)	11			10.1	11.75	11		14	Adc	
Maximum Efficiency	99.5									
Weighted Efficiency	98.8							98.6		
Overvoltage Category	II									
<b>OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREEDGE INVERTER)</b>										
Maximum Output Current					15					Adc
Maximum Output Voltage	60					85			Vdc	
<b>OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREEDGE INVERTER OR SOLAREEDGE INVERTER OFF)</b>										
Safety Output Voltage per Power Optimizer	1 ± 0.1									Vdc
<b>STANDARD COMPLIANCE</b>										
EMC	FCC Part15 Class B, IEC61000-6-2, IEC61000-6-3									
Safety	IEC62109-1 (class II safety), UL1741									
Material	UL94 V-0, UV Resistant									
RoHS	Yes									
<b>INSTALLATION SPECIFICATIONS</b>										
Maximum Allowed System Voltage	1000									Vdc
Compatible inverters	All SolarEdge Single Phase and Three Phase inverters									
Dimensions (W x L x H)	129 x 153 x 27.5 / 5.1 x 6 x 1.1			129 x 153 x 33.5 / 5.1 x 6 x 1.3	129 x 153 x 29.5 / 5.1 x 6 x 1.16	129 x 159 x 49.5 / 5.1 x 6.3 x 1.9		129 x 162 x 59 / 5.1 x 6.4 x 2.3		mm / in
Weight (including cables)	630 / 1.4			750 / 1.7	655 / 1.5	845 / 1.9		1064 / 2.3		gr / lb
Input Connector	MC4 <sup>(3)</sup>						Single or dual MC4 <sup>(3)(4)</sup>	MC4 <sup>(3)</sup>		
Input Wire Length	0.16 / 0.52									m / ft
Output Wire Type / Connector	Double Insulated / MC4									
Output Wire Length	0.9 / 2.95			1.2 / 3.9						m / ft
Operating Temperature Range <sup>(5)</sup>	-40 - +85 / -40 - +185									°C / °F
Protection Rating	IP68 / NEMA6P									
Relative Humidity	0 - 100									%

(1) Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed.  
 (2) NEC 2017 requires max input voltage be not more than 80V.  
 (3) For other connector types please contact SolarEdge.  
 (4) For dual version for parallel connection of two modules use P485-4NMDMRM. In the case of an odd number of PV modules in one string, installing one P485 dual version power optimizer connected to one PV module. When connecting a single module seal the unused input connectors with the supplied pair of seals.  
 (5) For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details.

PV System Design Using a SolarEdge Inverter <sup>(6)(7)</sup>	Single Phase HD-Wave	Single phase	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	P320, P340, P370, P400, P401	8	10	18	
	P405, P485, P505	6	8	14	
Maximum String Length (Power Optimizers)		25	25	50 <sup>(8)</sup>	
Maximum Power per String	5700 (6000 with SE7600-US - SE11400-US)	5250	6000 <sup>(9)</sup>	12750 <sup>(10)</sup>	W
Parallel Strings of Different Lengths or Orientations	Yes				

(6) For detailed string sizing information refer to: [http://www.solaredge.com/sites/default/files/string\\_sizing\\_na.pdf](http://www.solaredge.com/sites/default/files/string_sizing_na.pdf)  
 (7) It is not allowed to mix P405/P485/P505 with P320/P340/P370/P400/P401 in one string.  
 (8) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement.  
 (9) For 208V grid, it is allowed to install up to 7,200W per string when the maximum power difference between each string is 1,000W.  
 (10) For 277/480V grid, it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W.

© SolarEdge Technologies Ltd. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 07/2020/02/ENG NAM. Subject to change without notice.



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
 SEPERMITTING@TITANSOLARPOWER.COM  
 (877) 997-7652

NEWNAM, JOSH RESIDENCE  
 66 NEWBURY DRIVE, ANGIER, NC, 27501  
 LAT:35.479407, LON:-78.766903  
 TSP-68239

(22) LG355N1K-B6  
 (1) SOLAREEDGE SE6000H-US  
 7.810 kW DC SYSTEM SIZE  
 6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
 REV:A  
 DRAWN BY: DH

EQUIPMENT SPECIFICATIONS  
**PV 11**



# LG NeON<sup>®</sup> 2 Black

The LG NeON<sup>®</sup> 2 Black is one of the most powerful and versatile modules on the market today, combining LG's Cello technology and monocrystalline N-type solar cells with a stunning black design. The LG NeON<sup>®</sup> 2 Black includes a 25-year product and 90.1% performance warranty for higher performance and reliability.

## LG355N1K-B6

### FEATURES

**90.1%**  
in year 25

#### Enhanced Performance Warranty

LG NeON<sup>®</sup>2 Black comes with an enhanced performance warranty. After 25 years of use, the LG NeON<sup>®</sup>2 Black is guaranteed to provide at least 90.1% of initial performance.

**25**  
YEARS  
WARRANTY

#### Industry-Leading Product Warranty

LG offers an industry-leading 25 year product warranty on the NeON<sup>®</sup>2 Black.




#### Reliable Quality

LG NeON<sup>®</sup>2 Black offers reliable and proven quality through rigorous testing.



#### Sleek Rooftop Design

The LG NeON<sup>®</sup>2 Black is designed to make the entire module look black, providing a sleek, modern design that blends in seamlessly with the rooftop.

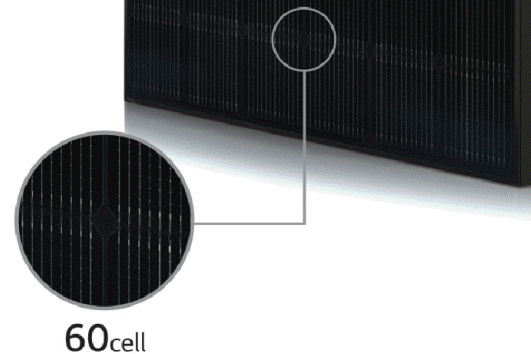

#### About LG Electronics

LG is transforming today's solar landscape, offering high-efficiency solar panels for customers who demand high performance, reliability and consistently strong energy yield from a brand they can trust. LG's modules feature high power outputs, outstanding durability, appealing aesthetics and high-efficiency technology.



# LG NeON<sup>®</sup> 2 Black

Preliminary

## LG355N1K-B6

### General Data

Cell Properties (Material / Type)	Monocrystalline / N-type
Cell Maker	LG
Cell Configuration	60 Cells (6 x 10)
Number of Busbars	12 EA
Module Dimensions (L x W x H)	1,740 x 1,042 x 40mm
Weight	18.6 kg
Glass (Material)	Tempered Glass with AR coating
Backsheet (Color)	Black
Frame (Material)	Anodized Aluminium
Junction Box (Protection Degree)	IP 68 with 3 Bypass Diodes
Cables (Length)	1,100 mm x 2 EA
Connector (Type / Maker)	MC4 / MC

### Certifications and Warranty

Certifications	IEC 61215-1 / -1-1 / 2:2016, IEC 61730-1 / 2:2016, UL 61730-1:2017, UL 61730-2:2017 ISO 9001, ISO 14001, ISO 50001 OHSAS 18001
Salt Mist Corrosion Test	IEC 61701 : 2011 Severity 6
Ammonia Corrosion Test	IEC 62716 : 2013
Module Fire Performance	Type 2 (UL 61730)
Fire Rating	Class C (UL 790)
Solar Module Product Warranty	25 Years
Solar Module Output Warranty	Linear Warranty*

\* 1) First years : 98%, 2) After 1st year : -0.33%/year, 3) 90.1% for 25 years

### Temperature Characteristics


NMOT*	[°C]	42 ± 3
Pmax	[%/°C]	-0.35
Voc	[%/°C]	-0.26
Isc	[%/°C]	0.03

\* NMOT (Nominal Module Operating Temperature)  
: Irradiance 800W/m<sup>2</sup>, Ambient temperature 20°C, Wind speed 1m/s, Spectrum AM 1.5

### Electrical Properties (NMOT)

Model	LG355N1K-B6
Maximum Power (Pmax)	[W] 266
MPP Voltage (Vmpp)	[V] 32.9
MPP Current (Impp)	[A] 8.10
Open Circuit Voltage (Voc)	[V] 39.1
Short Circuit Current (Isc)	[A] 8.61

### I-V Curves

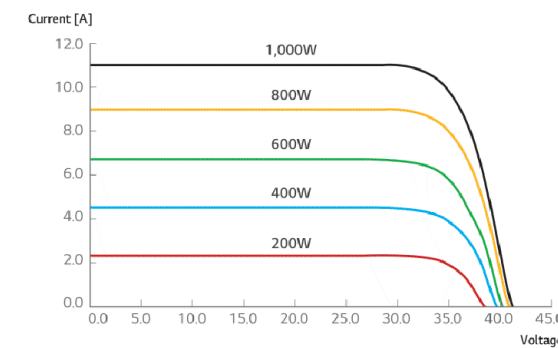

### Electrical Properties (STC\*)

Model	LG355N1K-B6
Maximum Power (Pmax)	[W] 355
MPP Voltage (Vmpp)	[V] 35.0
MPP Current (Impp)	[A] 10.15
Open Circuit Voltage (Voc, ± 5%)	[V] 41.5
Short Circuit Current (Isc, ± 5%)	[A] 10.72
Module Efficiency	[%] 19.6
Power Tolerance	[%] 0 - +3

\* STC (Standard Test Condition)  
: Irradiance 1,000 W/m<sup>2</sup>, Cell temperature 25°C, AM 1.5, Measure tolerance of Pmax : ±3%

### Operating Conditions


Operating Temperature	[°C] -40 ~ +85
Maximum System Voltage	[V] 1,000
Maximum Series Fuse Rating	[A] 20
Mechanical Test Load* (Front)	[Pa] 5,400
Mechanical Test Load* (Rear)	[Pa] 4,000

\* Based on IEC 61215-2 : 2016 (Test Load = Design Load x Safety Factor(1.5))  
※ Mechanical Test Loads 6,000 Pa / 5,400 Pa based on IEC 61215 : 2005

### Packaging Configuration

Number of Modules Per Pallet	[EA] 25
Number of Modules Per 40ft HQ Container	[EA] 650
Packaging Box Dimensions (L x W x H)	[mm] 1,790 x 1,120 x 1,213
Packaging Box Gross Weight	[kg] 500

### Dimensions (mm/inch)

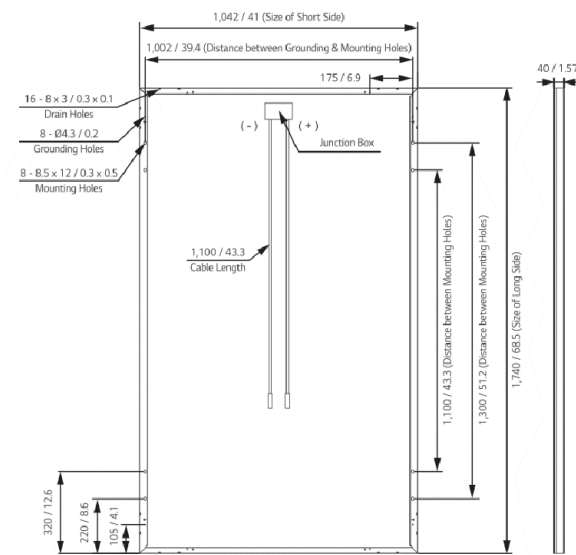

LG Electronics Inc.  
Energy Business Division  
LG Twin Towers, 128 Yeouui-daero, Yeongdeungpo-gu, Seoul 07336, Korea  
www.lg-solar.com

Product specifications are subject to change without notice.  
© 2021 LG Electronics. All rights reserved.



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239

(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
REV:A  
DRAWN BY: DH


EQUIPMENT  
SPECIFICATIONS  
PV 12





Patent #8448407

**LOW PROFILE QUICKBOLT**  
With 3" Microflashing® | Fixed Height




PN#	BOX QTY
17664	5.25" Bolts (10)
17666	Bolts + 3" Microflashing® (10ea.)
17667SS	Bolts + 3" Microflashing® + SS L-Foot + Nuts (25ea.)

First & only Microflashing® in the industry  
Stainless Steel L-Foot  
Fastest installation in the industry  
UL Certified



Patent #8448407

**LOW PROFILE QUICKBOLT**  
With 4" Microflashing® | Fixed Height




PN#	BOX QTY
17664	5.25" Bolts (10)
17720	Bolts + 4" Microflashing® (10ea.)
17721SS	Bolts + 4" Microflashing® + SS L-Foot + Nuts (20ea.)

First & only Microflashing® in the industry  
Stainless Steel L-Foot  
4" Microflashing® provides more coverage  
Fastest installation in the industry  
UL Certified



Patent #8448407

**7" QUICKBOLT**  
With 3" Microflashing® | Adjustable




PN#	BOX QTY
17670	7" Bolts (10)
17671	Bolts + 3" Microflashing® (10ea.)
17672SS	Bolts (20) + 3" Microflashing® (20) + SS L-Foot (20) + Nuts (40)

First & only Microflashing® in the industry  
Stainless Steel L-Foot  
UL Certified



Patent #8448407

**7" QUICKBOLT**  
With 4" Microflashing® | Adjustable




PN#	BOX QTY
17670	7" Bolts (10)
17723	Bolts + 4" Microflashing® (10ea.)
17724SS	Bolts (15) + 4" Microflashing® (15) + SS L-Foot (15) + Nuts (30)

First & only Microflashing® in the industry  
Stainless Steel L-Foot  
4" Microflashing® provides more coverage  
UL Certified



Patent #8448407

**3" & 4" MICROFLASHING®**  
For QuickBOLT




PN#	BOX QTY
17669	3" Microflashing® (10)
17659	4" Microflashing® (40)

First & only Microflashing® in the industry  
Original Microflashing® design  
EPDM on bottom, Stainless Steel on top  
Compresses to composite shingle roof  
Leak-proof seal  
UL Certified



Patent #8448407

**LOW PROFILE & OFFSET L-FOOT**  
For QuickBOLT



PN#	BOX QTY
15891SS	SS L-Foot (10)
15894SS	SS L-Foot (10)

Stainless Steel  
Rail slot for adjustability when connecting T-Bolts



Patent #8448407

**QUICK RATCHET CONDUIT CLAMP**  
For QuickBOLT Mounting Kits




PN#	BOX QTY	SCREW SIZE
16255	10 Clamps	N/A

For running conduit  
Attaches directly to any QuickBOLT Mounting Kit  
Offers flexibility in bundling cables/wires



Patent #8448407

**L-FOOT MOUNTING KIT**  
Fixed Height | Black Galva Flashing

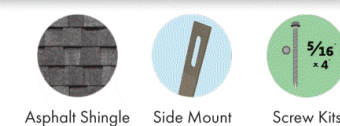

PN#	BOX QTY	SCREW SIZE
17713	20 Flashing + L-Foot	5/16" x 4"

Stainless Steel L-Foot mounting system  
Stronger than Aluminum Flashing



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
SEPERMITTING@TITANSOLARPOWER.COM  
(877) 997-7652

NEWNAM, JOSH RESIDENCE  
66 NEWBURY DRIVE, ANGIER, NC, 27501  
LAT:35.479407, LON:-78.766903  
TSP-68239


(22) LG355N1K-B6  
(1) SOLAREEDGE SE6000H-US  
7.810 kW DC SYSTEM SIZE  
6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
REV:A  
DRAWN BY: DH

EQUIPMENT  
SPECIFICATIONS  
**PV 13**



# CrossRail 48-X

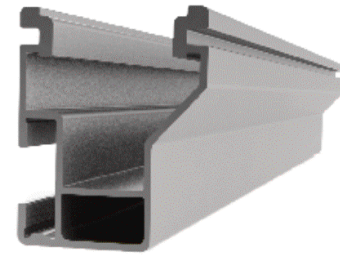


## Mechanical Properties

CrossRail 48-X	
Material	6000 Series Aluminum
Ultimate Tensile Strength	37.7 ksi (260 MPa)
Yield Strength	34.8 ksi (240 MPa)
Weight	0.56 lbs/ft (0.833 kg/m)
Finish	Mill or Dark Anodized

## Section Properties

CrossRail 48-X	
Sx	0.1980 in <sup>3</sup> (3.261 cm <sup>3</sup> )
Sy	0.1510 in <sup>3</sup> (2.507 cm <sup>3</sup> )
A (X-Section)	0.4650 in <sup>2</sup> (3.013 cm <sup>2</sup> )

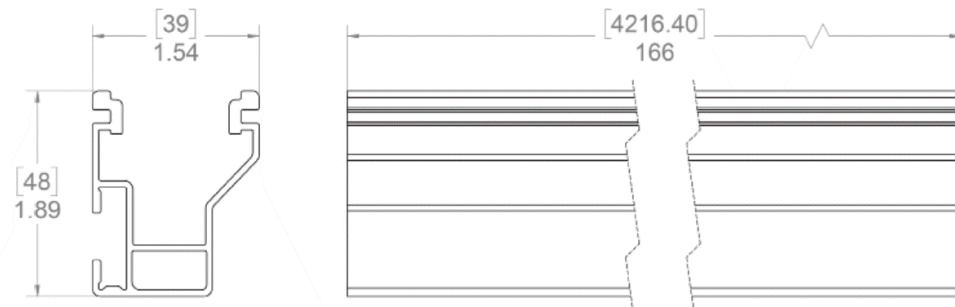

Dimensions in [mm] Inches

**Notes:**

- ▶ Structural values and span charts determined in accordance with Aluminum Design Manual and ASCE 7-10
- ▶ UL2703 Listed System for Fire and Bonding

[www.everest-solarsystems.com](http://www.everest-solarsystems.com)



10345 NATIONS FORD RD SUITE W, CHARLOTTE, NC 28273  
 SEPERMITTING@TITANSOLARPOWER.COM  
 (877) 997-7652

NEWNAM, JOSH RESIDENCE  
 66 NEWBURY DRIVE, ANGIER, NC, 27501  
 LAT:35.479407, LON:-78.766903  
 TSP-68239

(22) LG355N1K-B6  
 (1) SOLAREEDGE SE6000H-US  
 7.810 kW DC SYSTEM SIZE  
 6.000 kW AC SYSTEM SIZE

DATE: 3/12/2021  
 REV:A  
 DRAWN BY: DH

EQUIPMENT SPECIFICATIONS  
**PV 14**