











202123029543

202123020588

202123028929

202123029549

202123021437

202122102040

202123027096

202123025097

202123028530

202123023732

202122133392

202123020219

202123026547

202123025119

202122124915

202123023824

202123023314

202123025098

202123028941

202122132447

202123024298

202123025928

202123020311

202123025103

202123026282

202122133750

202123007015

202123028538

202123022247

202123020404

202123024944

202123022361

202123021304

202123017985

Bottom

Row



202123029543

202123020588

202123028929

202123029549

202123021437

202122102040

202123027096

202123025097

202123028530

202123023732

202122133392

202123020219

202123026547

202123025119

202122124915

202123023824

202123023314

202123025098

202123028941

202122132447

202123024298

202123025928

202123020311

202123025103

202123026282

202122133750

202123007015

202123028538

202123022247

202123020404

202123024944

202123022361

202123021304

202123017985



DAILY SOLAR INSTALL SHEET

INSTALL DATE:

08-19

PROJECT #:

CUSTOMER'S NAME:

DOO JAMES

INSTALLER'S NAME:

Please print as clearly as possible

	MODEL	DESCRIPTION		BOM	OUT	USED	DAMAGED	RETURN TO WAREHOUSE
Panels	SOLAR PANEL	JA 300	◆					
	SOLAR PANEL	LG 325	◆					
	SOLAR PANEL	LG 335 **Baywa**	◆					
	SOLAR PANEL	LG 345 **Baywa**	◆					
	SOLAR PANEL	LG 360	◆					
	SOLAR PANEL ✓	LG 365	◆		34	35		
	SOLAR PANEL	Mission 300	◆					
	SOLAR PANEL	LG 335 **LG**	◆					
	SOLAR PANEL	LG 345 **LG**	◆					
	SOLAR PANEL	Longi 310	◆					
	SOLAR PANEL OTHER							
Ends	UNI-302022D	ENDS-TRINA/JA	↑					
	UNI-302026D	ENDS-LG	↑		16	20		
Mids	UNI-302029D	MIDS	↑		64	80		
Inverters	IQ7-60-2-US	Enphase IQ7	↑					
	IQ7PLUS-72-2-US	Enphase IQ7 Plus	↑		36	39		

OUT Warehouse Initials: \_\_\_\_\_

IN Warehouse Initials: \_\_\_\_\_

















PM Initials: \_\_\_\_\_



DAILY SOLAR INSTALL SHEET

INSTALL DATE: \_\_\_\_\_  
 PROJECT #: \_\_\_\_\_  
 CUSTOMER'S NAME: \_\_\_\_\_  
 INSTALLER'S NAME: \_\_\_\_\_

Please print as clear as possible

	MODEL	DESCRIPTION		BOM	OUT	USED	DAMAGED	RETURN WAREHOUSE
Inverter Bolts	UNI-008013S	MICROINVERTER BOLTS 1/4" X 3/4" SS		36	40			
	UNI-320168M	STANDARD RAIL		22				
	UNI-009020S	RAIL T BOLT 3/8 X 3/4 SS		22	26			
	UNI-303019M	SPLICE BARS		14	18			
Trunk	EN-Q-12-10-240	TRUNK CABLE PORTRAIT		45				
Hardware	EN-Q-CLIP-100	Q-CABLE CLIPS		72	100			
	EN-Q-SEAL-01	WATER TIGHT COVERS-TRUNK		2	6			
	EN-Q-TERM-01	ENDCAP TRUNK CABLE BRANCH TERM		2	4			
	WEEBLUGS-6.7	GROUND LUGS		8	14			
	SD-0799-5G	SOLADECK		1	1			
	EN-Q-CONN-10F	FEMALE TRUNK CONNECTOR						
	EN-Q-CONN-10M	MALE TRUNK CONNECTOR						
Monitoring	EN-X-IQ-AM1-240-3	AC COMBINER BOX						
	EN-CT-200-SPLIT	SPLIT CORE TRANS						
	MTC-H5-B03	EN-CELLMODEM-01						
	TP AV600	TP LINK						
	EN-XA-PLUG-120-3	AC COMBINER PLUG						

OUT Warehouse Initials: \_\_\_\_\_

IN Warehouse Initials: \_\_\_\_\_

PM Initials: \_\_\_\_\_




















DAILY SOLAR INSTALL SHEET

PROJECT #:

CUSTOMER'S NAME:

INSTALLER'S NAME:

Please print as clearly as possible

MODEL	DESCRIPTION		BOM	OUT	USED	DAMAGED	RETURN TO WAREHOUSE
UNI-004055M	Flashkit Pro						
UNI-004085M	Flashloc						
4" Stand Offs	4" Stand Offs(Used w/ E-curb)			7080			
5" E-curb	5" E-curb						
7" Sunmodo	7" Sunmodo						
QMCP-C-B-12	CONDUIT PEN. FLASHING (COMP. ROOF)						
QMTRS3.25-A-12	S-Tile (*BASEMOUNT)						
QMTR-W4-A-12	W-Tile (*BASEMOUNT)						
QMTR-BM-A-12	BASEMOUNT						
QMCPT-A-12	CONDUIT PEN. FLASHING (TILE ROOF)						
QMTR-F3.25-A-12	Flat Tile						
QM-QMHL-A-12	Tile Low Hooks						
QM-QMHSS-A-12	Tile High Hooks						
ZILLA - ZDSFA-AL BLK XL	Zilla						
S-5 PROTEABRACKET	PROTEA						
S-5-H	H-BRACKET						
S-5-N	S-5-N						
S-5-N 1.5	N-BRACKET (1.5")						
S-5-S	S-BRACKET						
S-5-U	U-BRACKET						
S-5-VERSABRACKET-47	VERSA						
S-5-SOLARFOOT	SOLARFOOT (*L Feet)						
UNI-304001C	L FEET						
OTHER MOUNT							

OUT Warehouse Initials: \_\_\_\_\_












IN Warehouse Initials: \_\_\_\_\_



Please print as clear as possible

NAME: \_\_\_\_\_

INSTALLER'S NAME: \_\_\_\_\_

	MODEL	DESCRIPTION	BOM	OUT	USED	DAMAGED	RETURN WAREHOUSE
Ground Mount	GROUND MOUNT	Nuance Ground Mount Kit					
	403211C ULA	FRONT CAP 2"					
	403214C ULA	REAR CAP 2"					
	403215C ULA	SLIDER 2" AL					
	403213C ULA	RAIL BRACKET 2"					
	403201C ULA	BRACE 2"					
	410168M	SMHD 168"					
Ballast System	UNI-310710	Ballast					
	UNI-008114M	SFM MLPE MOUNT					
	UNI-310750	RM MODULE CLIP					
	UNI-310751	RM HEX BOLTS					
	UNI-310760	UNIRAC ROOF PAD					
	Tesla Powerwall	Tesla Powerwall					
	Tesla Gateway	Tesla Gateway					
Tesla Bundle 1 or 2	Tesla Bundle 1 or 2						
Tesla Stacking Kit	Tesla Stacking Kit						
OTHER							
OTHER							
OTHER							

\_\_\_\_\_  
 Manager Signature

\_\_\_\_\_  
 Date

\_\_\_\_\_  
 Manager Name

OUT Warehouse Initials: \_\_\_\_\_

IN Warehouse Initials: \_\_\_\_\_

\_\_\_\_\_  
 /22/20

PM Initials: \_\_\_\_\_



403211C ULA	FRONT CAP 2"						
GROUND MOUNT	Nuance Ground Mount Kit						
MODEL	DESCRIPTION	BOM	OUT	USED	DAMAGED	RETURN TO WAREHOUSE	

INSTALLER'S NAME: \_\_\_\_\_

Address: \_\_\_\_\_

- Sign in the yard
- Yard and gutters cleaned
- Paint all exposed rails
- Sola deck completed
- Pictures of any damage to roof before install
- Pictures of everything on the roof before the panels go on. Q-mnts/S-5, rails, trunk, inverters.
- Pictures of inside of Sola deck (s)
- Pictures of Final array on Each roof
- Pictures taken and uploaded to customer's file

**SHADE ANALYSIS**

- Shade analysis completed
- Tilt & direction for each array
- Suneye pictures numbered (delete *any* excess pictures)
- Checked pictures, grid is straight
- Named pictures; homeowners' last name first ex: Smith, John

Job 100% Complete

Can Final Inspection be Scheduled?

Yes

No

Reason: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

Did you make a case in salesforce?

Bottom

Rosendo D. Ball  
Homeowner Signature

08/21/2021  
Date

Were you offered a **free** \$25 Gift Card?

[Signature]  
Lead Installer Signature

08/21/2021  
Date

Emanuel Aguirre \_\_\_\_\_

David Fortenberry \_\_\_\_\_

Steven Carrillo \_\_\_\_\_

APPROVED BY

OFFICE USE ONLY





**SOLADECK**  
www.rstcenterprises.com  
Photovoltaic Combiner/Enclosure Conforms to UL 1741; Certified to CSA C22.2 No. 290; Nema Type 3B



q1 q2 q3 q4 21 22 23 24  
0799 Series 0799 E-Series 0766-41AD  
Maximum Ratings: 1000 VDC/180 AMPS; 480 VAC/60 AMPS

**WARNING**


HIGH VOLTAGE. KEEP OUT!  
RISK OF ELECTRICAL SHOCK. ONLY TRAINED SERVICE PERSONNEL ALLOW ACCESS. SUITABLE FOR PHOTOVOLTAIC USE. APPROVED FOR USE WITH FIELD-INSTALLED CONDUCTORS SIZED FOR AN ALLOWABLE AMPACITY OF 55 AT 90 C°. AN EXTERNAL OUTPUT CIRCUIT DISCONNECTING MEANS SHALL BE PROVIDED WHEN REQUIRED BY THE CANADIAN ELECTRICAL CODE. PART 1. WARNING: MORE THAN ONE LIVE CIRCUIT. SEE DIAGRAM.

**AVERTISSEMENT**

HAUTE TENSION, GARDER HORS!  
RISQUE DE CHOC ELECTRIQUE. SEUL LE PERSONNEL DE MAINTENANCE QUALIFIE EST ACCES-AUTORISE. POUR USAGE PHOTOVOLTAIQUE. APPROUVE POUR UTILISATION AVEC DES CONDUCTEURS INSTALES SUR PLACE DE GROSSEUR CONVENANT A UN COURANT ADMISSIBLE DE 55 A 90°C. DISPOSITIF DE SECTIONNEMENT DU CIRCUIT DE SORTIE EXTERIEUR OBLIGATOIRE SI EXIGE PAR LE CODE CANADIEN DE L'ELECTRICITE. PREMIERE PARTIE. AVERTISSEMENT: PLUSIEURS CIRCUITS SOUS TENSION. VOIR SCHEMA.

R.S.T.C. Enterprises  
Patent No. US 7,626,118 B1



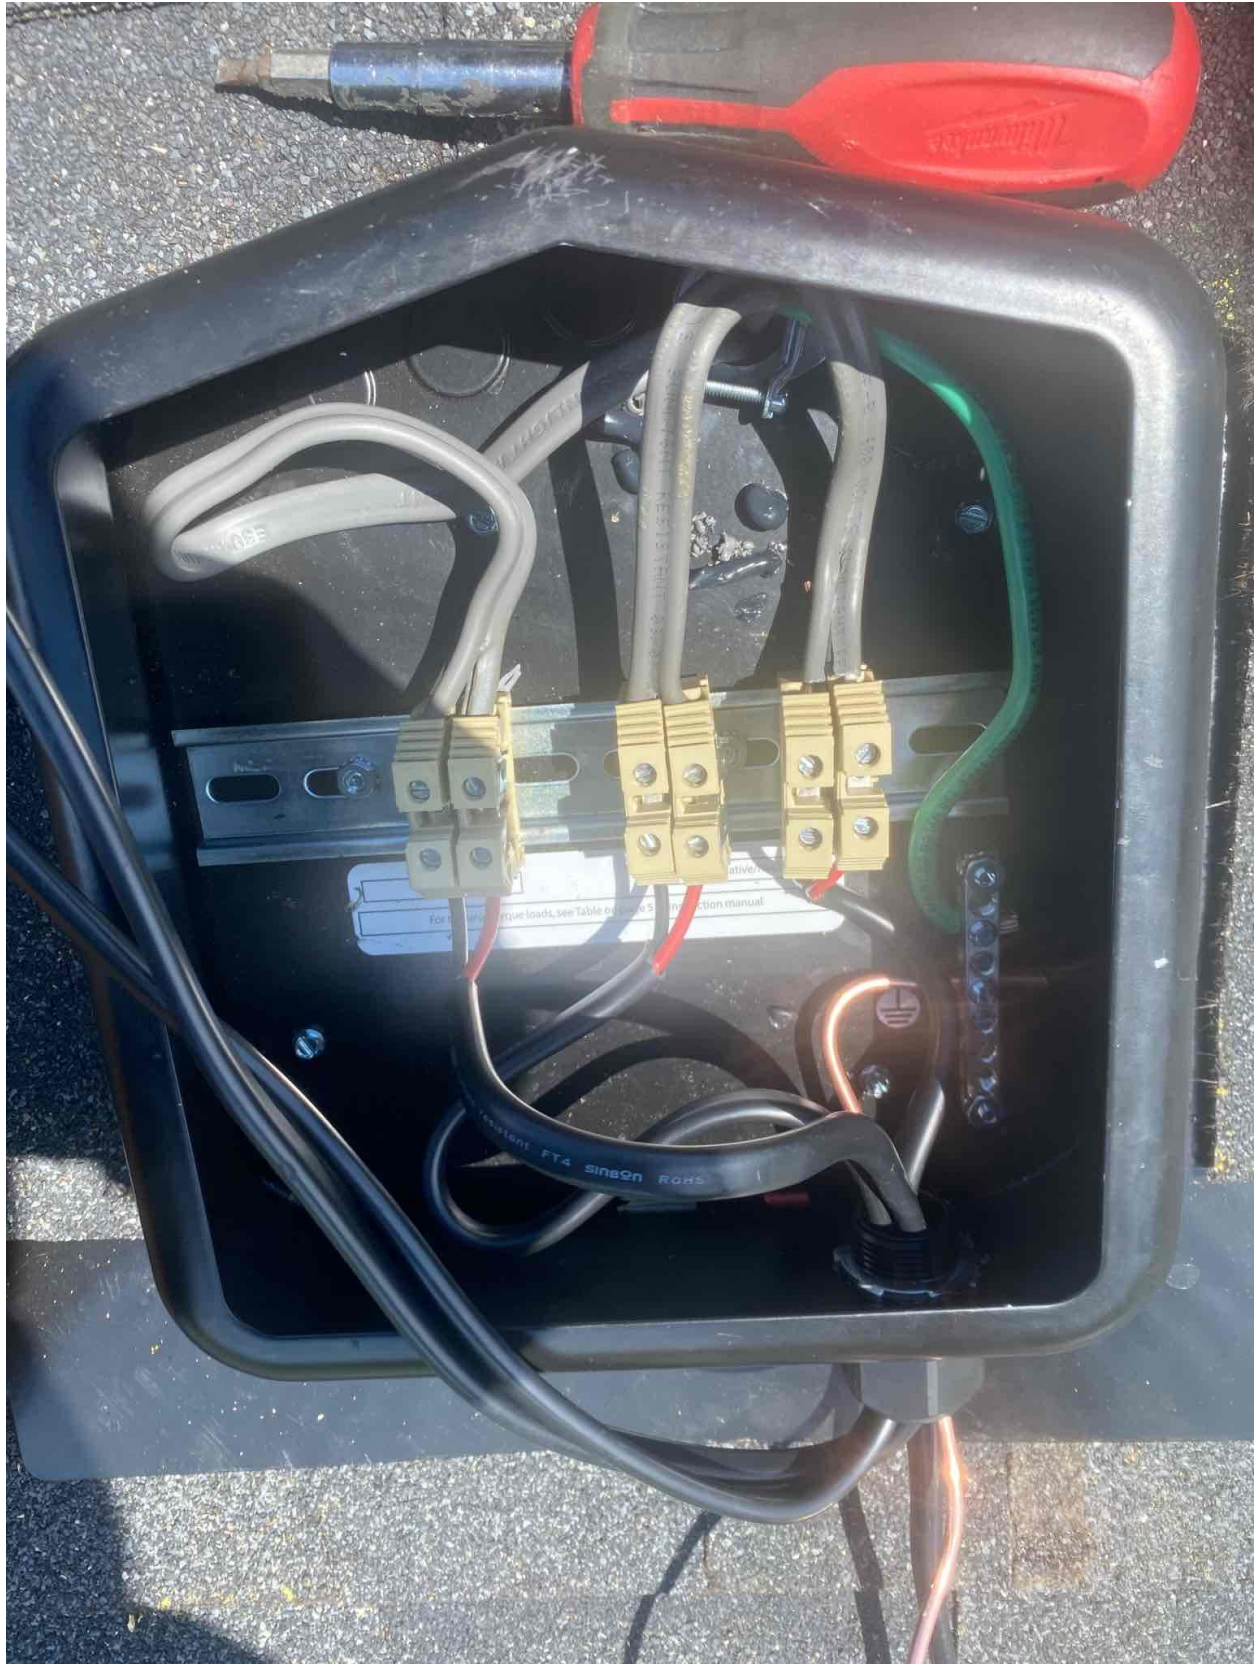













LG365N1C - A6




Serial No.	107U1GR2H41W	Pmax (Bif 100)	365.7	W
Manufactured Date	210718	Pmax Bifaciality coefficient	0.04	
Pmax (-0/+3)%	365	Voc Bifaciality coefficient	0.88	
Vmpp	34.50	Isc Bifaciality coefficient	0.05	V
Imp	10.58	Max. Sys. Voltage (UL)	1,000	V
Voc (-5/+5)%	41.60	Max. Sys. Voltage (IEC/CSA)	1,000	V
Isc (-5/+5)%	11.27	Max. Series Fuse	20	A
Max. Test Load	5,400	Fire Type	Type 1	

\*See Installation Instructions for Installation Requirements to Achieve a Specified System  
 Fire Class Rating with this Product.  
 \*Standard Test Condition : 1,000W/m<sup>2</sup>, AM 1.5 Spectrum, Cell temperature 25°C  
 \*See module installation manual for appropriate mating connectors.  
 \*Tested to IEC 61215-2: 2016, IEC 61730-1: 2016, UL/CSA 61730


⚠ WARNING/AVERTISSEMENT


**Risk of electric shock/Précaution de choc électrique**  
**DO NOT** connect or disconnect plug contacts while a system is under load current. **DO NOT** approach the damaged or broken module, unless you are an expert. Otherwise, it may result in a hazardous situation or a serious injury.  
 Ne connectez ou déconnectez pas le connecteur pendant qu'un système est sous la charge électrique. Ne approchez pas un module endommagé ou détérioré, si vous n'êtes pas un expert. Sinon, il peut en résulter une situation hasardeuse ou une blessure sérieuse.


**Risk of fires and burns/Précaution de feu et incendie**  
**DO NOT** contact with electrically active parts.  
 Ne touchez pas des parts actives électriquement.  
 Refer to installation and operation manual before installing, operation or servicing this unit.  
 Avant d'installer ou mettre en service cette unité, se référer au manuel d'installation et d'opération.



J-Box Polarity







\*Maximum series overcurrent protective device, where required, for a field connections, use 12AWG copper wires only insulated to ultraviolet radiation (where exposed).







 **ENPHASE**  
**IQ7+**

IQ 7+ Grid Support Interactive Inverter  
For Enphase patent information, refer to:  
<http://enphase.com/company/patents/>

Power Factor Range: +/- 0.85  
DC input range: 16 - 60V  
Max. input short-circuit current: 15A  
Max. input continuous current: 12A  
AC output voltages: 208 / 240V  
AC output currents: 1.39 / 1.21A  
AC output frequency: 60Hz  
AC output power (max. continuous): 290VA  
Operating temperature: -40°C to +65°C  
Ingress protection: NEMA Type 6  
Photovoltaic Rapid Shutdown Equipment  
NEC 690.12 and C22.1-2015 Rule 64-218  
UL1741 SA Compliant | Assembled in Mexico



This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference. (2) This device must accept any interference received, including interference that may cause undesired operation.



**CAUTION: RISK OF SHOCK. WARRANTY VOID IF COVER REMOVED. NO USER SERVICEABLE PARTS INSIDE. REFER SERVICING TO QUALIFIED SERVICE PERSONNEL.**

**WARNING:** ELECTRIC SHOCK HAZARD. DC CONDUCTORS OF THIS PHOTOVOLTAIC SYSTEM ARE UNGROUNDED AND MAY BE ENERGIZED. AC AND DC VOLTAGE SOURCES TERMINATE INSIDE THIS EQUIPMENT. DISCONNECT BOTH BEFORE SERVICING. PHOTOVOLTAIC ARRAY SUPPLIES A DC VOLTAGE TO THIS EQUIPMENT WHEN EXPOSED TO LIGHT. HOT SURFACES: TO REDUCE THE RISK OF BURNS - DO NOT TOUCH.

**ATTENTION:** RISQUE D'ELECTROCUTION. LES CONDUCTEURS CC DE CE SYSTEME PHOTOVOLTAIQUE NE SONT PAS RELIES A LA TERRE ET PEUVENT ETRE SOUS TENSION. DES SOURCES DE TENSION CA ET CC SONT CONNECTEES A CET APPAREIL. ISOLER LES DEUX SOURCES AVANT TOUTE INTERVENTION. LES CABLES COURANT CONTINU SONT SOUS TENSION LORSQUE LE CHAMP PHOTOVOLTAIQUE EST EXPOSE A LA LUMIERE. RISQUE DE BRULURE, NE PAS TOUCHER.



202123029543

202123020588

202123028929

202123029549

202123021437

202122102040

202123027096

202123025097

202123028530

202123023732

202122133392

202123020219

202123026547

202123025119

202122124915

202123023824

202123023314

202123025098

202123028941

202122132447

202123024298

202123025928

202123020311

202123025103

202123026282

202122133750

202123007015

202123028538

202123022247

202123020404

202123024944

202123022361

202123021304

202123017985



202123029543

202123020588

202123028929

202123029549

202123021437

202122102040

202123027096

202123025097

202123028530

202123023732

202122133392

202123020219

202123026547

202123025119

202122124915

202123023824

202123023314

202123025098

202123028941

202122132447

202123024298

202123025928

202123020311

202123025103

202123026282

202122133750

202123007015

202123028538

202123022247

202123020404

202123024944

202123022361

202123021304

202123017985

Bottom

Row














































1 | ATTACHMENT PLAN  
SCALE: 3/16" = 1'-0"

ARRAY 1  
TILT: 30 DEG  
AZIMUTH - 280 DEG

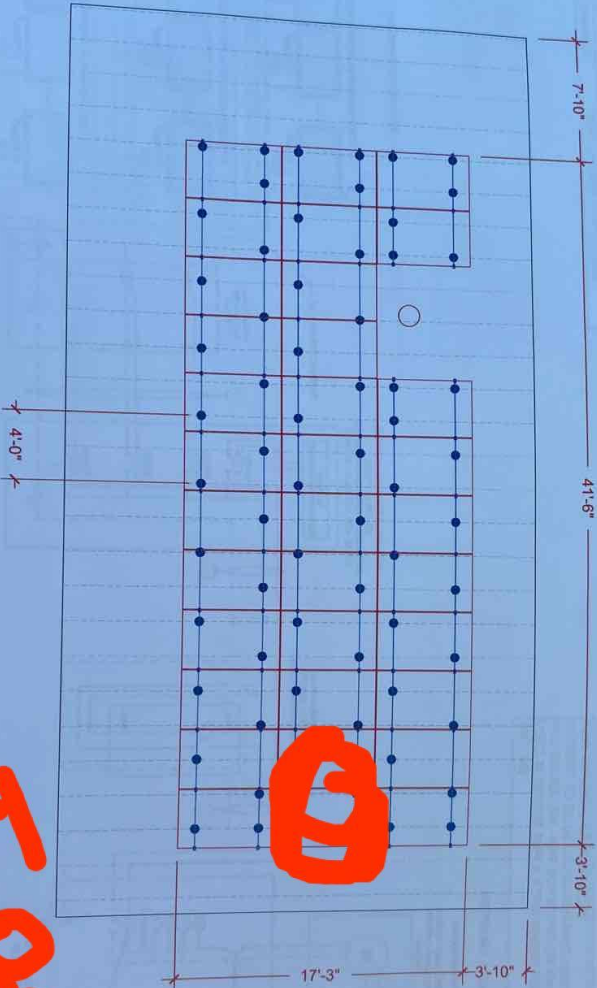

- CLAMP
  - UNIRAC FLASHLOC
  - RAIL
  - RAFTER
- 68 - TOTAL MOUNT

**5-BOX**

**SUNPR**  
CONTRACTOR

22171 MCH RD  
MANDREVILLE, LA 70471  
PHONE: 9152011490

SYSTEM SIZE:  
DC SIZE: 12.410 KW DC-(STC)  
AC SIZE: 9.860 KW / AC

CUSTOMER NAME & ADDRESS  
**DON JAMES**  
134 SOUTHERN  
PL LILLINGTON,  
NC 27546, USA

REV	DESCRIPTION

DESIGN DATE: 7/14/2021  
DESIGN BY: BVP  
REVIEWED BY:   
Signature with Seal

ATTACHMENT PLAN  
SHEET NUMBER  
**A-103**









