GENERAL NOTES

CODES AND STANDARDS

- 1. ALL WORK SHALL COMPLY WITH 2017 NATIONAL ELECTRIC CODE (NEC), 2018 NORTH CAROLINA BUILDING CODE (NCBC), 2018 NORTH CAROLINA RESIDENTIAL CODE (NCRC), PLUMBING CODE (NCPC), AND ALL STATE AND LOCAL BUILDING, ELECTRICAL, AND PLUMBING CODES
- 2. DRAWINGS HAVE BEEN DETAILED ACCORDING TO UL LISTING REQUIREMENTS.

SITE NOTES / OSHA REGULATION

- 1. A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS. 2. THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY
- INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- 3. THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- 4. ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SHALL SERVE TO PROTECT THE BUILDING OR STRUCTURE.

5. NO. OF SHINGLE LAYERS: 1

SOLAR CONTRACTOR

- 1. MODULE CERTIFICATIONS WILL INCLUDE UL1703, IEC61646, IEC61730
- 2. IF APPLICABLE, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE MARKED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS.
- 3. AS INDICATED BY DESIGN, OTHER NRTL LISTED MODULE GROUNDING DEVICES MAY BE USED IN PLACE OF STANDARD GROUNDING LUGS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AH.I
- 4. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.
- 5. CONDUIT POINT OF PENETRATION FROM EXTERIOR TO INTERIOR TO BE INSTALLED AND SEALED WITH A SUITABLE SEALING COMPOUND.
- 6. DC WIRING LIMITED TO MODULE FOOTPRINT W/ ENPHASE AC SYSTEM
- 7. ENPHASE WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY W/ SUITABLE WIRING CLIPS.
- 8. MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC UNLESS NOT AVAILABLE
- 9. ALL INVERTERS, MOTOR GENERATORS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AC PHOTOVOLTAIC MODULES, DC COMBINERS, DC-TO-DC CONVERTERS, SOURCE CIRCUIT COMBINERS, AND CHARGE CONTROLLERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (B).
- 10. ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE
- 11. TERMINALS AND LUGS WILL BE TIGHTENED TO MANUFACTURER TORQUE SPECIFICATIONS (WHEN PROVIDED) IN ACCORDANCE WITH NEC CODE 110.14(D) ON ALL ELECTRICAL CONNECTIONS.

EQUIPMENT LOCATIONS

- 1. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION [NEC 110.26].
- 2. EQUIPMENT INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY [NEC 690.31 (A)] AND [NEC TABLE 310.15 (B)].
- 3. ADDITIONAL AC DISCONNECTS SHALL BE PROVIDED WHERE THE INVERTER IS NOT ADJACENT TO THE UTILITY AC DISCONNECT, OR NOT WITHIN SIGHT OF THE UTILITY AC DISCONNECT.
- 4. ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO **NEC APPLICABLE CODES**
- 5. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

AERIAL VIEW



DESIGN CRITERIA WIND SPEED: 115 MPH **GROUND SNOW LOAD: 15 PSF** WIND EXPOSURE FACTOR: C SEISMIC DESIGN CATEGORY: B

SITE SPECIFICATIONS CONSTRUCTION - V-B **ZONING: RESIDENTIAL**

SCOPE OF WORK

INSTALLATION OF UTILITY INTERACTIVE PHOTOVOLTAIC SOLAR SYSTEM

6 kW DC PHOTOVOLTAIC SOLAR ARRAY

ROOF TYPE: Comp Shingle

MODULES: (16) JinKO Solar Eagle JKM375M-6RL3-B INVERTER(S): Enphase IQ7PLUS-72-2-US,----

RACKING: Unirac SFM Infinity



SHEET INDEX

PV1 - COVER SHEET

PV2 - PROPERTY PLAN

PV3 - SITE PLAN

PV4 - EQUIPMENT & ATTACHMENT DETAIL

PV5 - ELECTRICAL SINGLE LINE DIAGRAM

PV6 - ELECTRICAL CALCULATIONS & **ELECTRICAL NOTES**

PV7 - MAIN BREAKER DERATE CALCS. (IF NEEDED)

PV8 - LABELS & LOCATIONS

PV9 - CUSTOM DIRECTORY PLACARD (IF NEEDED - NEC 690.56(B))

UTILITY COMPANY: Duke Energy NC PERMIT ISSUER: Harnett County



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

Carolina 27501 SIZE: 119 Bella Vita Way North Angier, S

kW DC

9

STEM

DC

SITE INFORMATION: lan RAWING BY

ENPHASE ENERGY

June 24, 2021

PROJECT NUMBER

371796

SHEET NAME **COVER SHEET**

AGE NUMBER PV1 REVISION 0

Sealed For Existing Roof & Attachment Only


035433

6/24/2021

Digitally signed by John A. Calvert Date: 2021.06.24 13:27:54

-06'00'

Firm No.: D-0369

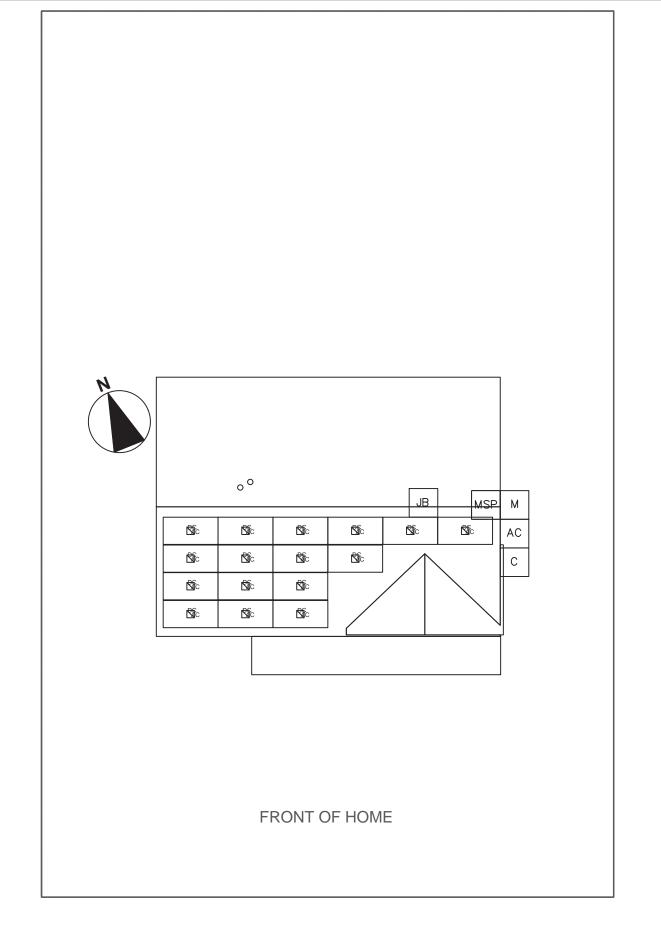

LEGEND

INVERTER & DC DISCONNECT

SUB (E) SUBPANEL

(N) LOAD CENTER

AC AC DISCONNECT

UTILITY METER

MSP MAIN SERVICE PANEL

JB JUNCTION BOX

TS TRANSFER SWITCH

COMBINER BOX/AGGREGATOR

PV REVENUE METER

FIRE SETBACK

EMT CONDUIT RUN (TO BE DETERMINED IN FIELD)

PV WIRE STRING

PROPERTY LINE

SCALE: 3/32" = 1'-0" 0' 4' 8' 16

1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

Carolina 27501

9

SIZE:

SYSTEM 8

DC

Sealed For Existing Roof & Attachment Only

6/24/2021



Angier, North 119 **ENPHASE ENERGY**

lan Mack

Vita Way

Bella \

DATE

SITE INFORMATION:


June 24, 2021

PROJECT NUMBER

371796

SHEET NAME PROPERTY PLAN

PAGE NUMBER PV2

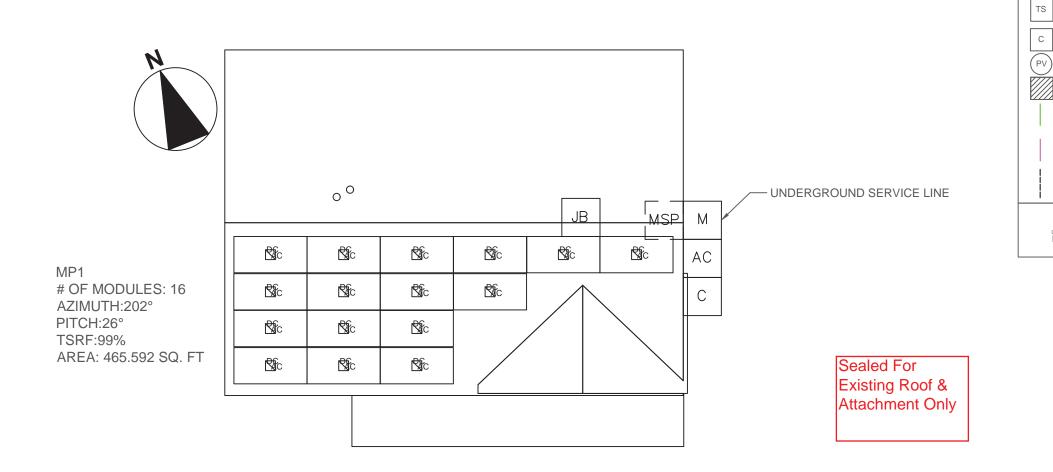

LEGEND

INVERTER & DC DISCONNECT

SUB (E) SUBPANEL

(N) LOAD CENTER

AC AC DISCONNECT

UTILITY METER

MSP

MAIN SERVICE PANEL

JUNCTION BOX

TRANSFER SWITCH

PV REVENUE METER

COMBINER BOX/AGGREGATOR

FIRE SETBACK

EMT CONDUIT RUN (TO BE DETERMINED IN FIELD)

PV WIRE STRING

PROPERTY LINE

SCALE: 1/8" = 1'-0"

0' 2' 4' 8' 16

CONTRACTOR: **BRS FIELD OPS** 385.498.6700

1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION

HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT

BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN

PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE

SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.

/NABCEP

CERTIFIED

PV INSTALLATION PROFESSIONAL Scott Gurney # PV-011719-015866

FRONT OF HOME



Firm No. : D-0369

DC Carolina 27501 9 SITE INFORMATION: SIZE: Vita Way Angier, North SYSTEM Bella \ lan Mack 119 DC

ENPHASE ENERGY

DATE

June 24, 2021

PROJECT NUMBER

371796

SHEET NAME

SITE PLAN

PAGE NUMBER PV3

0

PV ARRAY INFORMATION

PV MODULE COUNT: 16 MODULES

OF ATTACHMENT POINTS1: 32


ARRAY AREA: Module Count x 17.51ft² = 280.2ft²


ROOF AREA: 1221.7ft² 22.9% % OF ARRAY/ROOF:


ARRAY WEIGHT: Module Count x 50lbs = 800.0lbs DISTRIBUTED LOAD: Array Weight ÷ Array Area = 2.86 lbs/ft²

POINT LOAD: Array Weight ÷ Attachments = 25.0lbs/attachment

- Number of attachment points estimated and may vary based on on-site conditions as long as maximum attachment spacing followed per engineered plans.

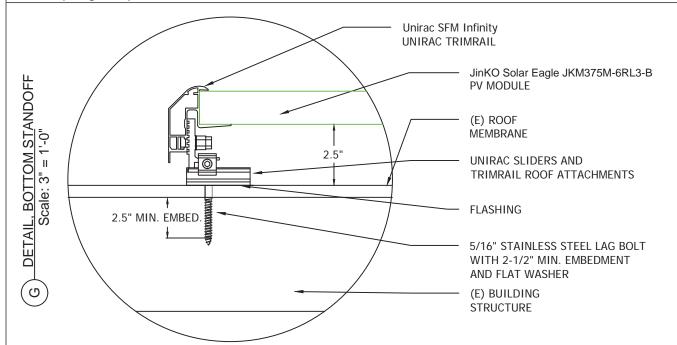

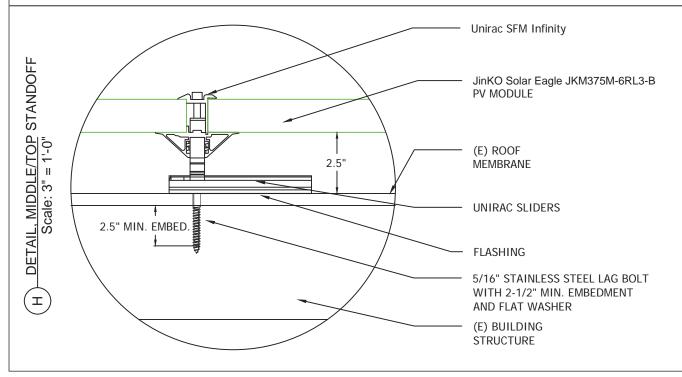

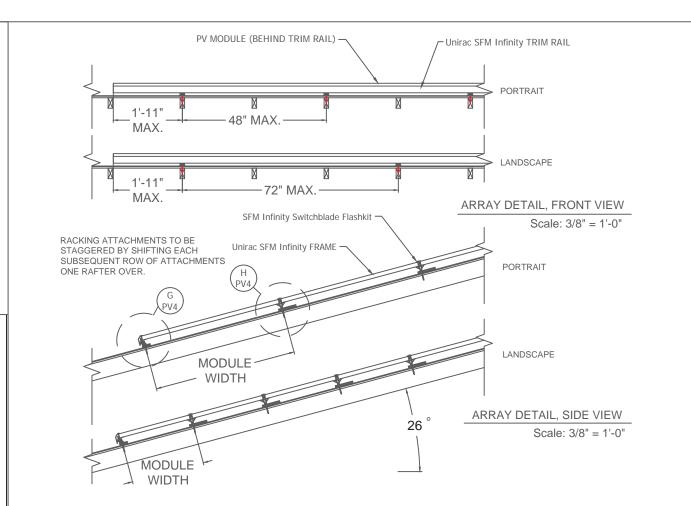

ROOF TYPE: Comp Shingle

ROOF FRAMING TYPE: Manufactured Truss

RAFTER OR TOP CHORD(TRUSS) 2x4 @ 24"O.C. CEILING JOIST OR BOTTOM CHORD(TRUSS) 2x4 @ 24"O.C.

Sealed For Existing Roof & Attachment Only

6/24/2021

Firm No.: D-0369





1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

6 kW DC Carolina 27501 SIZE: Vita Way Angier, North SYSTEM Bella \ lan Mack 119 DC

SITE INFORMATION:

ENPHASE ENERGY

DATE

June 24, 2021

PROJECT NUMBER

371796

SHEET NAME


EQUIP. DETAIL

PAGE NUMBER PV4

10 AWG THHN/THWN-2, CU., BLACK (L1) 10 AWG THHN/THWN-2, CU., BLACK (L1) MAX 9.7 A AC 10 - 2 UF-B (or NM) W/G, THHN/THWN-2, SO MAX 9.7 A AC 12-2 TC-ER, THHN/THWN-2, CU. 10 AWG THHN/THWN-2, CU., RED (L2) 240 V AC 10 AWG THHN/THWN-2, CU., RED (L 2) 240 V AC 240 V AC 6 AWG BARE, CU (EGC) 240 V AC 10 AWG THHN/THWN-2, CU., WHITE (N) 10 AWG THHN/THWN-2, CU., GREEN (EGC) 10 AWG THHN/THWN-2, CU., GREEN (EGC) (1) 3/4 INCH EMT EXTERIOR EXTERIOR INTERIOR EXTERIOR 3/4 INCH EMT

16 INVERTERS x 290.4 W AC = 4.6464 kW AC PANEL WATTAGE = 375 W DC

> **UL 1741 COMPLIANT** 8 MODULES MAX FOR ALL SUB-BRANCH JUNCTION BOX Enphase IQ Combiner 3 CIRCUIT(S) TO COMPLY WITH VRISE CALCS (OPTIONAL IF UF-B X-IQ-AM1-240-3 CABLE USED FOR (SOLAR LOADS ONLY) JUNCTION BOX ENTIRE HOMERUN) (E)200A MAIN SERVICE PANEL (1) CIRCUIT (E)200A / 2P MAIN BREAKER (N)20A/2F OF 8 MODULES PV AC DISCONNECT NON- FUSED (E)200A / 2P LOCKABLE, VISIBLE OPEN 30A, 240V, 2-POLE JUNCTION BOX (1) CIRCUIT (N)25A/2P (N)20A/2P OF 8 MODULES 120/240 VAC 60HZ 1 PHASE (15) TO UTILITY

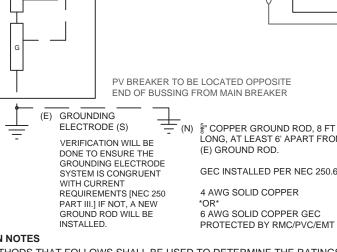

(N) 5 COPPER GROUND ROD, 8 FT LONG, AT LEAST 6' APART FROM (E) GROUND ROD.

GEC INSTALLED PER NEC 250.64:

4 AWG SOLID COPPER

6 AWG SOLID COPPER GEC

INTERCONNECTION NOTES

GRID

1. ONE OF THE METHODS THAT FOLLOWS SHALL BE USED TO DETERMINE THE RATINGS OF BUSBARS AND PANELBOARDS. (a) THE SUM OF 125 PERCENT OF THE INVERTER(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED THE AMPACITY OF THE BUS BAR. (b) WHERE TWO SOURCES, ONE THE UTILITY AND THE OTHER AN INVERTER ARE LOCATED AT OPPOSITE ENDS OF A BUSBAR THAT CONTAINS LOADS, THE SUM OF 125 PERCENT OF THE INVERTER(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR [NEC 705.12].

1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS) 2. AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH





(16) JinKO Solar Eagle JKM375M-6RL3-B

UL 1703 COMPLIANT

(16) Enphase IQ7PLUS-72-2-US MICRO

INVERTERS

1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNEC TION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

DC Carolina 27501 SIZE Vita Way North STEM Bella lan Mack Angier, S 119 DC

E INFORMATION:

SIT

ENPHASE ENERGY

DATE

June 24, 2021

PROJECT NUMBER

371796

SHEET NAME

ELEC. 3 LINE DIAG

PAGE NUMBER PV₅

0

MODULE SPECIFICATIONS	JinKO Solar Eagle JKM375M-6RL3-B
RATED POWER (STC)	375 W
MODULE VOC	44.12 V DC
MODULEVMP	36.8 V DC
MODULEIMP	10.19 A DC
MODULEISC	11.01 A DC
VOC CORRECTION	-0.28 %/°C
VMP CORRECTION	-0.35 %/°C
SERIES FUSE RATING	20 A DC
ADJ. MODULE VOC @ ASHRAE LOV	W TEMP 48.4 V DC
ADJ. MODULE VMP @ ASHRAE 2%	AVG. HIGH TEMP 31.4 V DC

MICROINVERTER SPECIFICATIONS Enpha	ase IQ7+ Microinverters
POWER POINT TRACKING (MPPT) MIN/MAX	22 - 60 V DC
MAXIMUM INPUT VOLTAGE	60 V DC
MAXIMUM DC SHORT CIRCUIT CURRENT	15 A DC
MAXIMUM USABLE DC INPUT POWER	440 W
MAXIMUM OUTPUT CURRENT	1.21 A AC
AC OVERCURRENT PROTECTION	20 A
MAXIMUM OUTPUT POWER	290 W
CEC WEIGHTED EFFICIENCY	97 %

AC PHOTOVOLATIC MODULE MARKING (NEC 690 52)

MAXIMUM OCPD RATING FOR AC MODULE	20 A AC
MAXIMUM AC CURRENT	1.0 A AC
MAXIMUM AC POWER	240 VA AC
NOMINAL OPERATING AC FREQUENCY	47 - 68 HZ AC
NOMINAL OPERATING AC VOLTAGE	240 V AC
ACT TIO TO VODATIC IVIO DOLL IVIANNING (IVEC 050	1.32

DESIGN LOCATION AND TEMPERATURES	
TEMPERATURE DATA SOURCE	ASHRAE 2% AVG. HIGH TEMP
STATE	North Carolina
CITY	Angier
WEATHER STATION	SEYMOUR-JOHNSON AFB
ASHRAE EXTREME LOW TEMP (°C)	-10
ASHRAE 2% AVG. HIGH TEMP (°C)	35

SYSTEM ELECTRICAL SPECIFICATIONS	CIR 1	CIR 2	CIR 3	CIR 4	CIR 5	CIR 6
NUMBER OF MODULES PER MPPT	8	8				
DC POWER RATING PER CIRCUIT (STC)	3000	3000				
TOTAL MODULE NUMBER	(311.317.3.2.1		16 MOD	ULES		
STC RATING OF ARRAY	6000W DC					
AC CURRENT @ MAX POWER POINT (IMP)	9.7	9.7				
MAX. CURRENT (IMP X 1.25)	12.1	12.1				
OCPD CURRENT RATING PER CIRCUIT	20	20				
MAX. COMB. ARRAY AC CURRENT (IMP)	19.4			7		
MAX. ARRAY AC POWER	3840W AC					

AC VOLTAGE RISE CALCULATIONS	DIST (FT)	COND.	VRISE(V)	VEND(V)	%VRISE
VRISE SEC. 1 (MICRO TO JBOX)	28.8	12 Cu.	0.93	240.93	0.39%
VRISE SEC. 2 (JBOX TO COMBINER BOX)	45	10 Cu.	1.11	241.11	0.46%
VRISE SEC. 3 (COMBINER BOX TO POI)	10	10 Cu.	0.49	240.49	0.20%
TOTAL VRISE			2.53	242.53	

PHOTOVOLTAIC AC DISCONNECT OUTPUT LABEL (NEC 690.54)
--

AC OUTPUT CURRENT	19.4 A AC
NOMINAL AC VOLTAGE	240 V AC

CONDUCTOR SIZE CA	LCULATIONS			
MICROINVERTER TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	9.7	A AC	
JUNCTION BOX (1)	MAX. CURRENT (ISC X1.25) =	12.1	AAC	
	CONDUCTOR (TC-ER, COPPER (90°C)) =	12	AWG	
	CONDUCTOR RATING =	30	Α	
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	28.8	>	12.1
JUNCTION BOX TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	9.7	A AC	
JUNCTION BOX (2)	MAX. CURRENT (ISC X1.25) =	12.1	AAC	
	CONDUCTOR (UF-B, COPPER (60°C)) =	10	AWG	
	CONDUCTOR RATING =	30	A	
	CONDUIT FILL DERATE =	1		
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	28.8	>	12.1
JUNCTION BOX TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	9.7	AAC	
COMBINER BOX (3)	MAX. CURRENT (ISC X1.25) =	12.1	AAC	
	CONDUCTOR (UF-B, COPPER (60°C)) =	10	AWG	
	CONDUCTOR RATING =	30	A	
	CONDUIT FILL DERATE =	0.8		
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	23.04	>	12.1
COMBINER BOX TO	INVERTER RATED AMPS =	19.4	A AC	
MAIN PV OCPD (15)	MAX. CURRENT (RATED AMPS X1.25) =	24.2	AAC	
CONDU	JCTOR (THWN-2, COPPER (75°C TERM.)) =	10	AWG	
	CONDUCTOR RATING =	35	Α	
	CONDUIT FILL DERATE =	1		
	AMB. TEMP. AMP. CORRECTION =	0.96		
	ADJUSTED AMP. =	33.6	>	24.2



1403 N RESEARCH WAY, BUILDING J OREM. UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION. EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

GROUNDING NOTES

- 1. A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH [NEC 690-47] AND [NEC 250-50] THROUGH [NEC 250-60] SHALL BE PROVIDED. PER NEC, GROUNDING ELECTRODE SYSTEM OF EXISTING BUILDING MAY BE USED AND BONDED TO AT THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, OR IS ONLY METALLIC WATER PIPING, A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT GROUND ROD WITH ACORN CLAMP.
- 2. THE GROUNDING ELECTRODE CONDUCTOR SHALL BE PROTECTED FROM PHYSICAL DAMAGE BETWEEN THE GROUNDING ELECTRODE AND THE PANEL (OR INVERTER) IF SMALLER THAN #6 AWG COPPER WIRE PER NEC 250-64B. THE GROUNDING ELECTRODE CONDUCTOR WILL BE CONTINUOUS, EXCEPT FOR SPLICES OR JOINTS AT BUSBARS WITHIN LISTED EQUIPMENT PER [NEC 250.64C.].
- 3. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN #8 AWG AND NO GREATER THAN #6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM.
- 4. PV SYSTEM SHALL BE GROUNDED IN ACCORDANCE TO [NEC 250.21], [NEC TABLE 250.122], AND ALL METAL PARTS OR MODULE FRAMES ACCORDING TO [NEC 690.46].
- 5. MODULE SOURCE CIRCUITS SHALL BE GROUNDED IN ACCORDANCE TO [NEC 690.421
- 6. THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDED CONDUCTOR TO ANOTHER MODULE.
- 7. EACH MODULE WILL BE GROUNDED USING THE SUPPLIED CONNECTIONS POINTS IDENTIFIED IN THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 8. ENCLOSURES SHALL BE PROPERLY PREPARED WITH REMOVAL OF PAINT/FINISH AS APPROPRIATE WHEN GROUNDING EQUIPMENT WITH TERMINATION **GROUNDING LUGS**
- 9. GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVISES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR DIRECT BURIAL. 7. ALL CONDUCTORS AND OCPD SIZES AND TYPES SPECIFIED ACCORDING TO [NEC 10. GROUNDING AND BONDING CONDUCTORS SHALL BE COPPER, SOLID OR

STRANDED, AND BARE WHEN EXPOSED.

- 11. EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZE ACCORDING TO [NEC 690.45] AND BE A MINIMUM OF #10AWG WHEN NOT EXPOSED TO DAMAGE (#6AWG SHALL BE USED WHEN EXPOSED TO DAMAGE).
- 12. GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLOR CODED GREEN (OR MARKED GREEN IF #4 AWG OR LARGER)
- 13. ALL CONDUIT BETWEEN THE UTILITY AC DISCONNECT AND THE POINT OF CONNECTION SHALL HAVE GROUNDED BUSHINGS AT BOTH ENDS.
- 14. SYSTEM GEC SIZED ACCORDING TO [NEC 690.47], [NEC TABLE 250.66], DC SYSTEM GEC SIZED ACCORDING TO [NEC 250.166], MINIMUM #8AWG WHEN INSULATED, #6AWG WHEN EXPOSED TO DAMAGE.
- 15. EXPOSED NON-CURRENT CARRYING METAL PARTS OF MODULE FRAMES, EQUIPMENTS, AND CONDUCTOR ENCLOSURES SHALL BE GROUNDED IN ACCORDANCE WITH 250.134 OR 250.136(A) REGARDLESS OF VOLTAGE.

WIRING & CONDUIT NOTES

- 1. ALL CONDUIT SIZES AND TYPES, SHALL BE LISTED FOR ITS PURPOSE AND APPROVED FOR THE SITE APPLICATIONS
- 2. BOLTED CONNECTION REQUIRED IN DC DISCONNECTS ON THE WHITE GROUNDED CONDUCTOR (USE POLARIS BLOCK OR NEUTRAL BAR)
- 3. ANY CONNECTION ABOVE LIVE PARTS MUST BE WATERTIGHT. REDUCING WASHERS DISALLOWED ABOVE LIVE PARTS, MEYERS HUBS RECOMMENDED
- 4. UV RESISTANT CABLE TIES(NOT ZIP TIES) USED FOR PERMANENT WIRE MANAGEMENT OFF THE ROOF SURFACE IN ACCORDANCE WITH NEC 110.2,110.3(A-B). 300.4
- 5. SOLADECK JUNCTION BOXES MOUNTED FLUSH W/ROOF SURFACE TO BE USED FOR WIRE MANAGEMENT AND AS FLASHED ROOF PENETRATIONS FOR INTERIOR CONDUIT
- 6. ALL PV CABLES AND HOMERUN WIRES BE TYPE USE-2, AND SINGLE-CONDUCTOR CABLE LISTED AND IDENTIFIED AS PV WIRE, TYPE TC-ER, OR EQUIVALENT; ROUTED TO SOURCE CIRCUIT COMBINER BOXES AS REQUIRED

690.8] FOR MULTIPLE CONDUCTORS

- 8. ALL PV DC CONDUCTORS IN CONDUIT EXPOSED TO SUNLIGHT SHALL BE INSTALLED AT LEAST 7/8" ABOVE THE ROOF SURFACE AND DERATED ACCORDING TO [NEC TABLE 310.15 (B)(2)(a), NEC TABLE 310.15(B)(3)(a),& NEC 310.15(B)(3)(c)].
- 9. EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP EDGES
- 10. PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 600V
- 11. 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS.
- 12. ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION
- 13. VOLTAGE DROP LIMITED TO 2% FOR DC CIRCUITS AND 3% FOR AC CIRCUITS 14. NEGATIVE GROUNDED SYSTEMS DC CONDUCTORS SHALL BE COLOR CODED AS
- FOLLOWS: DC POSITIVE- RED (OR MARKED RED), DC NEGATIVE- GREY (OR MARKED GREY)
- 15. POSITIVE GROUNDED SYSTEMS DC CONDUCTORS COLOR CODED:
- DC POSITIVE- GREY (OR MARKED GREY), DC NEGATIVE- BLACK (OR MARKED BLACK) 16. AC CONDUCTORS >4AWG COLOR CODED OR MARKED:
- PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE, NEUTRAL-WHITE/GRAY
- * USE-2 IS NOT INDOOR RATED BUT PV CABLE IS RATED THWN/THWN-2 AND MAY BE USED INSIDE
- ** USE-2 IS AVAILABLE AS UV WHITE
- 17. RIGID CONDUIT, IF INSTALLED, (AND/OR NIPPLES) MUST HAVE A PULL BUSHING TO PROTECT WIRES.
- 18. IF CONDUIT DETERMINED TO BE RAN THROUGH ATTIC IN FIELD THEN CONDUIT WILL BE EITHER EMT, FMC, OR MC CABLE IF DC CURRENT COMPLYING WITH NEC 690.31, NEC 250.118(10). DISCONNECTING MEANS SHALL COMPLY WITH 690.13 AND 690.15 19. CONDUIT RAN THROUGH ATTIC WILL BE AT LEAST 18" BELOW ROOF SURFACE COMPLYING WITH NEC 230.6(4) AND SECURED NO GREATER THAN 6' APART PER NEC 330.30(B).

27 Carolina SIZE: Way North STEM Bella Angi 0 lan

S

ENPHASE ENERGY

 $\overline{\Omega}$

June 24, 2021

PROJECT NUMBER

371796

ELEC. CALCS.

PAGE NUMBER PV6

0

↑WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

DIRECT CURRENT

PHOTOVOLTAIC SYSTEM

AC DISCONNECT

RATED AC OUTPUT CURRENT

NOMINAL OPERATING AC VOLTAGE

FOR PV DISCONNECTING MEANS WHERE ALL TERMINALS OF THE DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION. [NEC 690.13(B), NEC 705.22]

PHOTOVOLTAIC POWER SOURCE

MAXIMUM VOLTAGE MAX CIRCUIT CURRENT

VDC **AMPS**

AT EACH DC DISCONNECTING MEANS, INCLUDING THE DC DISCONNECT AT THE INVERTER. [NEC 690.53, NEC 690.13(B)]

AT POINT OF INTERCONNECTION, MARKED AT AC DISCONNECTING MEANS [NEC 690.54, NEC 690.13 (B)]

↑ WARNING

DUAL POWER SUPPLY SOURCES: UTILITY GRID AND PV SOLAR ELECTRIC SYSTEM

LABEL ANYWHERE THAT IS POWERED BY BOTH THE PANEL AND SUB-PANELS. [NEC 705.12(B)(3)]

IF INTERCONNECTING ON THE LOAD SIDE, INSTALL THIS UTILITY AND THE SOLAR PV SYSTEM: THE MAIN SERVICE

PLACED ADJACENT TO THE BACK-FED BREAKER FROM THE INVERTER IF TIE IN CONSISTS OF LOAD SIDE CONNECTION TO BUSBAR. [NEC 705.12(B)(2)(3)(b)]

DO NOT RELOCATE THIS OVERCURRENT DEVICE

↑WARNING

INVERTER OUTPUT CONNECTION

AWARNING

THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.

(ONLY IF 3 OR MORE SUPPLY SOURCES TO A BUSBAR)

SIGN LOCATED AT LOAD CENTER IF IT CONTAINS 3 OR MORE POWER SOURCES. [NEC 705.12(B)(2)(3)(C)]

- LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS. ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER CURRENT NEC AND LOCAL CODES AND MAKE APPROPRIATE ADJUSTMENTS
- LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRIC CODE, OSHA STANDARD 19010 145 ANSI 7535
- MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
- LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED AND SHALL NOT BE HANDWRITTEN [NEC 110.21]
- LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]

WARNING PHOTOVOLTAIC **POWER SOURCE**

SOLAR PV SYSTEM EQUIPPED

WITH RAPID SHUTDOWN TURN RAPID SHUTDOWN SWITCH TO THE OFF POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



SOLAR PV SYSTEM EQUIPPED

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN CONDUCTORS CONDUCTORS WITHIN THE ADDAY DEMAIN ENERGIZED IN SUNUGHT

RAPID SHUTDOWN

SWITCH FOR

SOLAR PV SYSTEM



SIGN LOCATED AT RAPID SHUT DOWN DISCONNECT SWITCH [NEC 690.56(C)(3)].

AT DIRECT-CURRENT EXPOSED RACEWAYS, CABLE

WALLS, PARTITIONS, CEILINGS, OR FLOORS.

AND CONDUCTORS LEAVING THE ARRAY:

FT AWAY FROM SERVICE DISCONNECTING

SWITCHES IF NOT AT THE SAME LOCATION.

FOR PV SYSTEMS THAT ONLY SHUT DOWN

FT AWAY FROM SERVICE DISCONNECTING

SWITCHES IF NOT AT THE SAME LOCATION.

MEANS TO WHICH THE PV SYSTEMS ARE

CONNECTED AND SHALL INDICATE THE

SIGN TO BE LOCATED ON OR NO MORE THAN 3

LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN

CONDUCTORS LEAVING THE ARRAY:

MEANS TO WHICH THE PV SYSTEMS ARE

CONNECTED AND SHALL INDICATE THE

FOR PV SYSTEMS THAT SHUT DOWN THE ARRAY

SIGN TO BE LOCATED ON OR NO MORE THAN 3

LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN

[NEC 690.31(G)(3&4)]

[NEC 690.56(C)(1)(A)]

[NEC 690.56(C)(1)(B)]

AND OTHER WIRING METHODS; SPACED AT MAXIMUM

TRAYS, COVERS AND ENCLOSURES OF JUNCTION BOXES,

10FT SECTION OR WHERE SEPARATED BY ENCLOSURES,

▲ WARNING

MAIN DISTRIBUTION UTILITY DISCONNECTIST POWER TO THIS BUILDING IS ALSO SUPPLIED FROM A ROOF MOUNTED SOLAR ARRAY WITH GROUPED AND LABELED WITHIN LINE OF SITE AND 10 FT OF THIS LOCATION.

▲ WARNING

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM MAIN DISTRIBUTION UTILITY DISCONNECT LOCATED

▲ WARNING

POWER TO THIS BUILDING IS ALSO SUPPLIED. FROM ROOF MOUNTED SOLAR ARRAY, SOLAR ARRAY RAPID SHUTDOWN DISCONNECT IS LOCATED OUTSIDE NEXT TO UTILITY METER.

↑ WARNING

PHOTOVOLTAIC SYSTEM COMBINER PANEL DO NOT ADD LOADS


PERMANENT DIRECTORY TO BE LOCATED AT MAIN SERVICE EQUIPMENT LOCATION IF ALL **ELECTRICAL POWER SOURCE DISCONNECTING** MEANS (SOLAR ARRAY RAPID SHUTDOWN SWITCH) ARE GROUPED AND IN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 690.56(C) & NEC 705.10].

PERMANENT DIRECTORY TO BE LOCATED AT MAIN SERVICE EQUIPMENT DENOTING THE LOCATION OF THE PV RAPID SHUTDOWN SYSTEM DISCONNECTING MEANS IF SOLAR ARRAY RAPID SHUT DOWN DISCONNECT SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 705.10, NEC 690.56(C)(1)]

PERMANENT DIRECTORY TO BE LOCATED AT SOLAR ARRAY RAPID SHUTDOWN SWITCH DENOTING THE LOCATION OF THE SERVICE **EQUIPMENT LOCATION IF SOLAR ARRAY RAPID** SHUT DOWN DISCONNECT SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [NEC 705.10]


PERMANENT DIRECTORY TO BE LOCATED AT AC COMBINER PANEL [NEC 110.21(B)]

LABELING DIAGRAM FOR MICRO INV.:

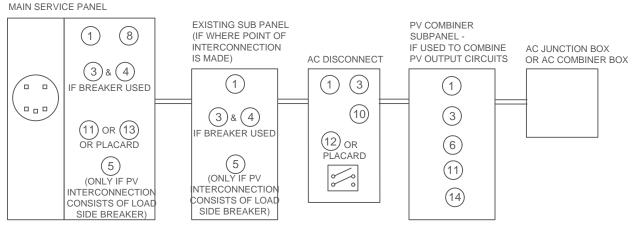

LABELING DIAGRAM FOR STRING INV. / DC OPTIMIZER INV.:



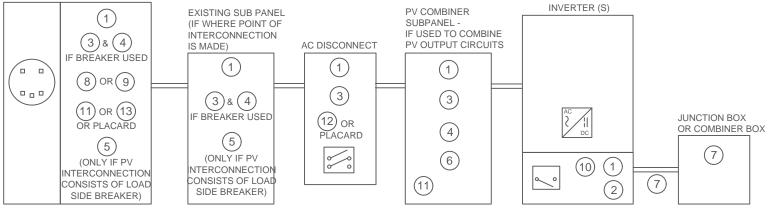

INTEGRATED DC DISCONNECT

*ELECTRICAL DIAGRAM SHOWN ABOVE IS FOR LABELING PURPOSES ONLY. NOT AN ACTUAL REPRESENATION OF EQUIPMENT AND CONNECTIONS TO BE INSTALLED. LABEL LOCATIONS PRESENTED MAY VERY DEPENDING ON TYPE OF INTERCONNECTION METHOD AND LOCATION PRESENTED ON PV5 OF 3 LINE DIAGRAM. PV5 LINE DIAGRAM TO REFLECT ACTUAL REPRESENTATION OF PROPOSED SCOPE OF WORK.



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUERAVENSOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION. EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUERAVENSOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

DC 27501 $\stackrel{\diamond}{\geq}$ Carolina 9 INFORMATION: SIZE: Way Vita North STEM Bella Mack Angier, 1 SX Ш 119 lan SIT DC

RAWING BY

ENPHASE ENERGY

DATE

June 24, 2021

PROJECT NUMBER

371796

SHEET NAME LABELS

PAGE NUMBER REVISION

PV8

0

Enphase IQ 7 and IQ 7+ **Microinverters**

The high-powered smart grid-ready Enphase IQ 7 Micro™ and Enphase IQ 7+ Micro™ dramatically simplify the installation process while

achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate with the Enphase IQ Envoy™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.



Easy to Install

- · Lightweight and simple
- · Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

Productive and Reliable

- · Optimized for high powered 60-cell/120 half-cell and 72cell/144 half-cell* modules
- More than a million hours of testing
- · Class II double-insulated enclosure
- UL listed

Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- · Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

 $^{^{\}star}$ The IQ 7+ Micro is required to support 72-cell/144 half-cell modules.




Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2	-US	
Commonly used module pairings ¹	235 W - 350 W +		235 W - 440 W +		
Module compatibility	60-cell/120 half	-cell PV modules	60-cell/120 half-cell and 72-		
	only		cell/144 half-ce	II PV modules	
Maximum input DC voltage	48 V		60 V		
Peak power tracking voltage	27 V - 37 V		27 V - 45 V		
Operating range	16 V - 48 V		16 V - 60 V		
Min/Max start voltage	22 V / 48 V		22 V / 60 V		
Max DC short circuit current (module Isc)	15 A		15 A		
Overvoltage class DC port	II		II		
DC port backfeed current	0 A		0 A	0 A	
PV array configuration	1 x 1 ungrounded array; No additio				
		ion requires max 20			
OUTPUT DATA (AC)	IQ 7 Microinve	erter	IQ 7+ Microinverter		
Peak output power	250 VA		295 VA		
Maximum continuous output power	240 VA		290 VA		
Nominal (L-L) voltage/range ²	240 V / 211-264 V	208 V / 183-229 V	240 V / 211-264 V	208 V / 183-229 V	
Maximum continuous output current	1.0 A (240 V)	1.15 A (208 V)	1.21 A (240 V)	1.39 A (208 V)	
Nominal frequency	60 Hz		60 Hz		
Extended frequency range	47 - 68 Hz		47 - 68 Hz		
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms		
Maximum units per 20 A (L-L) branch circuit ³	16 (240 VAC)	13 (208 VAC)	13 (240 VAC)	11 (208 VAC)	
Overvoltage class AC port	III		III		
AC port backfeed current	18 mA		18 mA		
Power factor setting	1.0		1.0		
Power factor (adjustable)	0.85 leading (0.85 lagging	0.85 leading ().85 lagging	
EFFICIENCY	@240 V	@208 V	@240 V	@208 V	
Peak efficiency	97.6 %	97.6 %	97.5 %	97.3 %	
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %	
MECHANICAL DATA					

MECHANICAL DATA
Ambient temperature range

Relative humidity range	4% to 100% (condensing)
Connector type	MC4 (or Amphenol H4 UTX with additional Q-DCC-5 adapter)
Dimensions (HxWxD)	212 mm x 175 mm x 30.2 mm (without bracket)
Weight	1.08 kg (2.38 lbs)
Cooling	Natural convection - No fans
Approved for wet locations	Yes
Pollution degree	PD3
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure
Environmental category / UV exposure rating	NEMA Type 6 / outdoor
FEATURES	
Communication	Power Line Communication (PLC)
Monitoring	Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy.
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems for AC and DC conductors, when installed according manufacturer's instructions.



Enphase Enlighten, Enphase IQ Envoy, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2020-08-12

-40°C to +65°C

2. Nominal voltage range can be extended beyond nominal if required by the utility.
3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.



ENPHASE

SPEC SHEET PAGE NUMBER REVISION

SS

0

1403 N RESEARCH WAY, BUILDING J OREM, UT 84097 800-377-4480 WWW.BLUERAVENSOLAR.COM CONFIDENTIAL - THE INFORMATION

HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF

ANYONE EXCEPT BLUE RAVEN

SOLAR NOR SHALL IT BE

ORGANIZATION, EXCEPT IN

CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE

EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE

RAVEN SOLAR LLC.

NABCEP

CERTIFIED

PV INSTALLATION **PROFESSIONAL**

Scott Gurney # PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 385.498.6700

DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS

To learn more about Enphase offerings, visit enphase.com

ENPHASE. To learn more about Enphase offerings, visit **enphase.com**

Enphase IQ Combiner 3

(X-IQ-AM1-240-3)



Smart

busbar assembly.

 Includes IQ Envoy for communication and control

The **Enphase IQ Combiner 3**™ with Enphase

streamlines PV and storage installations by

providing a consistent, pre-wired solution for

residential applications. It offers up to four

2-pole input circuits and Eaton BR series

IQ Envoy™ consolidates interconnection

equipment into a single enclosure and

- · Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC
- · Provides production metering and optional consumption monitoring

Simple

- · Reduced size from previous combiner
- · Centered mounting brackets support single stud mounting
- · Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- · 80 A total PV or storage branch circuits

Reliable

- · Durable NRTL-certified NEMA type 3R enclosure
- · Five-year limited warranty
- UL listed

Enphase IQ Combiner 3

MODEL NUMBER

IQ Combiner 3 IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV X-IQ-AM1-240-3 production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).

ACCESSORIES and REPLACEMENT PARTS (not included, order separately)

Enphase Mobile Connect™ CELLMODEM-03 (4G/12-year data plan) CELLMODEM-01 (3G/5-year data plan) Consumption Monitorina* CT CT-200-SPLIT * Consumption monitoring is required for Enphase Storage Systems

Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, CELLMODEM-M1 (4G based LTE-M/5-year data plan) where there is adequate cellular service in the installation area.) Split core current transformers enable whole home consumption metering (+/- 2.5%).

Wireless USB adapter Installed at the IQ Envoy. For communications with Enphase Encharge™ storage and Enphase COMMS-KIT-01 Enpower™ smart switch. Includes USB cable for connection to IQ Envoy or Enphase IQ Combiner™ and allows redundant wireless communication with Encharge and Enpower Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit Breakers BRK-10A-2-240 Circuit breaker, 2 pole, 10A, Eaton BR210

BRK-15A-2-240 Circuit breaker, 2 pole, 15A, Eaton BR215 BRK-20A-2P-240 Circuit breaker, 2 pole, 20A, Eaton BR220 EPLC-01 Power line carrier (communication bridge pair), quantity - one pair

XA-PLUG-120-3 Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)

XA-ENV-PCBA-3 Replacement IQ Envoy printed circuit board (PCB) for Combiner 3

ELECTRICAL SPECIFICATIONS

Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy

MECHANICAL DATA

WEGITANIOAL DATA	
Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets)
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors 60 A breaker branch input: 4 to 1/0 AWG copper conductors Main lug combined output: 10 to 2/0 AWG copper conductors Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)

INTERNET CONNECTION OPTIONS

	00044144
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M)
COMPLIANCE	(not included)

COMPLIANCE

Compliance, Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit enphase.com

© 2018 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 3, and other trademarks or service names are the



SPEC SHEET

1403 N RESEARCH WAY, BUILDING J

OREM, UT 84097

800-377-4480

WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION

HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF

ANYONE EXCEPT BLUE RAVEN

SOLAR NOR SHALL IT BE

DISCLOSED IN WHOLE OR IN PART

TO OTHERS OUTSIDE RECIPIENTS.

ORGANIZATION, EXCEPT IN

CONNECTION WITH THE SALE AND

USE OF THE RESPECTIVE

EQUIPMENT, WITHOUT THE

WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.

NABCEP

CERTIFIED PV INSTALLATION **PROFESSIONAL** # PV-011719-015866 CONTRACTOR: **BRS FIELD OPS** 385.498.6700

SS

REVISION 0

To learn more about Enphase offerings, visit enphase.com





EAGLE 66TR G4

370-390 WATT TILING RIBBON MODULE

Positive power tolerance of 0~+3%

- NYSE-listed since 2010, Bloomberg Tier 1 manufacturer
- . Best-selling panel globally for last 4 years
- . Top performance in the strictest 3rd party labs
- . 99.9% on-time delivery to the installer
- Premium solar panel factories in USA and Malaysia

KEY FEATURES



Tiling Ribbon eliminates cell gaps to increase module efficiency and power.



9BB Half Cell Technology

Uniquely designed 9 busbar half cut solar cells deliver ultra-high power in a small footprint.



even with shading by trees or debris.



Designed for Long Life

Uses the same DuPont protective film as the Space




Leading Warranty

12-year product and 25-year linear power warranty, 98% guaranteed first year, max 0.55% annual loss.

BUILDING YOUR TRUST IN SOLAR, JINKOSOLAR, US

ENGINEERING DRAWINGS








Length: +/- 2mm Width: +/- 2mm Height: +/- 1mm Row Pitch: +/- 2mm

ELECTRICAL PERFORMANCE & TEMPERATURE DEPENDENCE

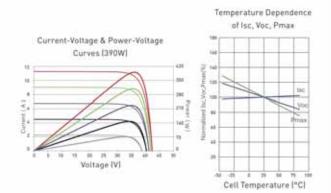

MECHANICAL CHARACTERISTICS

No. of Cells	132 [2×66]
Dimensions	1855x1029x35mm [73.03x40.51x1.37 in]
Weight	21.5 kg (47.40 tbs)
Front Glass	3.2mm, Anti-Reflection Coating High Transmission, Low Iron, Tempered Glass
Frame	Anodized Aluminum Allay
Junction Box	IP67 Rated
Output Cables	12 AWG, 2053mm (80.83in) or Customized Length
Connector	MC4
Fire Type	Type 1
Pressure Rating	5400Pa (Snow) & 2400Pa (Wird)

TEMPERATURE CHARACTERISTICS

Temperature Coefficients of Pmax	-0.35%/°C	
Temperature Coefficients of Voc	-0.28%/°C	
Temperature Coefficients of Isc	0.048%/°C	
Nominal Operating Cell Temperature INOCTI	45 ± 2°C	

MAXIMUM RATINGS

Operating Temperature (°C)	-40°C-+85°C
Maximum System Voltage	1000VDC
Maximum Series Fuse Rating	20A

PACKAGING CONFIGURATION

2 pallets = 1 stack; 31pcs/pallets, 62pcs/stack, 744pcs/ 40°HQ Container

- . ISO9001:2008 Quality Standards
- . ISO14001:2004 Environmental Standards
- . IEC61215, IEC61730 certified products . UL61730 Certification
- . ISO45001:2018 Occupational Health & Safety Standards







ELECTRICAL CHARACTERISTICS

Module Type	JKM370N	1-6RL3-B	JKM3751	4-6RL3-B	JKM380N	4-6RL3-B	JKM385	M-6RL3-B	JKM390	M-6RL3-B
	STC	NOCT	STC	NOCT	STC	NOCT	STC	NOCT	5TC	NOCT
Maximum Power [Pmax]	370Wp	275Wp	375Wp	279Wp	380Wp	283Wp	385Wp	286Wp	390Wp	290Wp
Maximum Power Voltage (Vmp)	36.71V	33.49V	36.80V	33.57V	36.90V	33.70V	37.02V	33.90V	37,15V	34.02V
Maximum Power Current (Imp)	10.08A	8.22A	10.19A	A1E.8	10.30A	8.39A	10.40A	B.45A	10.50A	8.53A
Open-circuit Voltage (Voc)	44.02V	41.55V	44.12V	41.64V	44.22V	41,74V	44.344	41.85V	44.47V	41.97V
Short-circuit Current (Isc)	10.90A	8.80A	11.01A	8.89A	11.12A	8.98A	11.22A	9.06A	11.32A	9.14A
Module Efficiency STC (%)	19.5	8%	19.	65%	19.5	71%	20	17%	20	43%

*STC: . Irradiance 1000W/m2 NOCT: Irradiance 800W/m1

*Power measurement toterance: +/- 3%

♣ Cell Temperature 25°C Ambient Temperature 20°C AM = 1.5 AM = 1.5

The company reserves the final right for explanation on any of the information presented hereby, JKM370-390M-6RL3-B-A1-US

BUILDING YOUR TRUST IN SOLAR, JINKOSOLAR, US





1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC



PV INSTALLATION **PROFESSIONAL**

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 385-498-6700

SHEET NAME:

SPEC SHEETS

REVISION: PAGE NUMBER: 0

SS



pe.eaton.com

Eaton general duty non-fusible safety switch

DG221UGB

UPC:782113120102

Dimensions:

Height: 10.69 IN
 Length: 6.88 IN
 Width: 6.38 IN

Weight:6 LB

Notes: WARNING! Switch is not approved for service entrance unless a neutral kit is installed.

Warranties:

 Eaton Selling Policy 25-000, one (1) year from the date of installation of the Product or eighteen (18) months from the date of shipment of the Product, whichever occurs first.

Specifications:

• Type: Non-fusible, single-throw

Amperage Rating: 30A

· Enclosure: NEMA 1, Indoor

· Enclosure Material: Painted steel

· Fuse Configuration: Non-fusible

• Number Of Poles: Two-pole

Number Of Wires: Two-wire

· Product Category: General duty safety switch

Voltage Rating: 240V

Supporting documents:

- Eatons Volume 2-Commercial Distribution
- Eaton Specification Sheet DG221UGB

Certifications:

UL Listed

Product compliance: No Data





1220 S. 630 E STE. 430 AMERICAN FORK, UT 84003

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




CONTRACTOR: BRS FIELD OPS 385.498.6700

SHEET NAM

SPEC SHEET

PAGE NUMBER

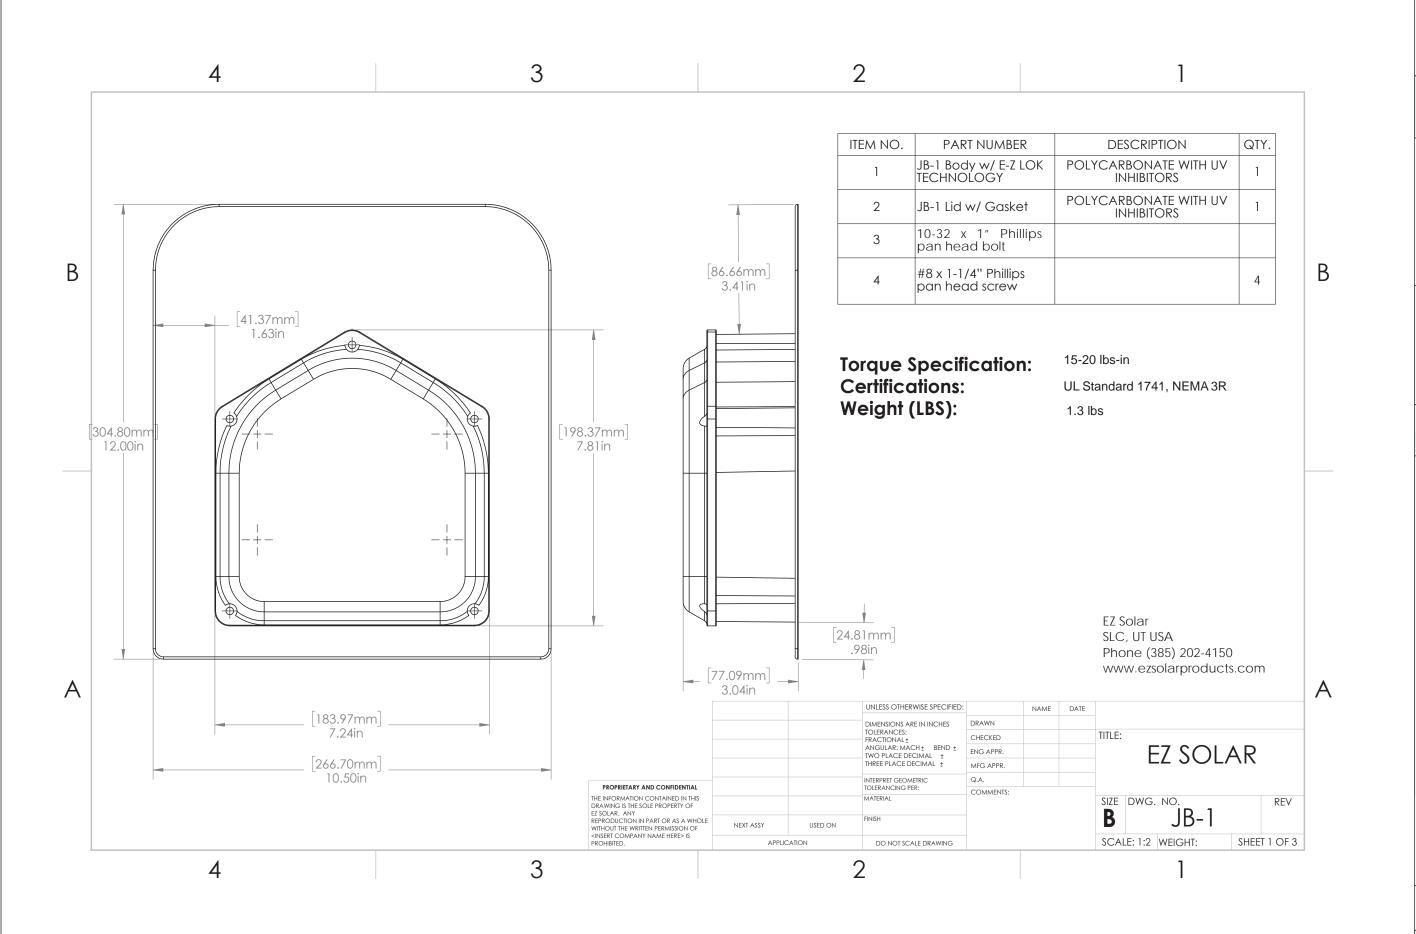



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




CONTRACTOR: BRS FIELD OPS 385.498.6700

EET NAME

SPEC SHEET

PAGE NUMBER

0

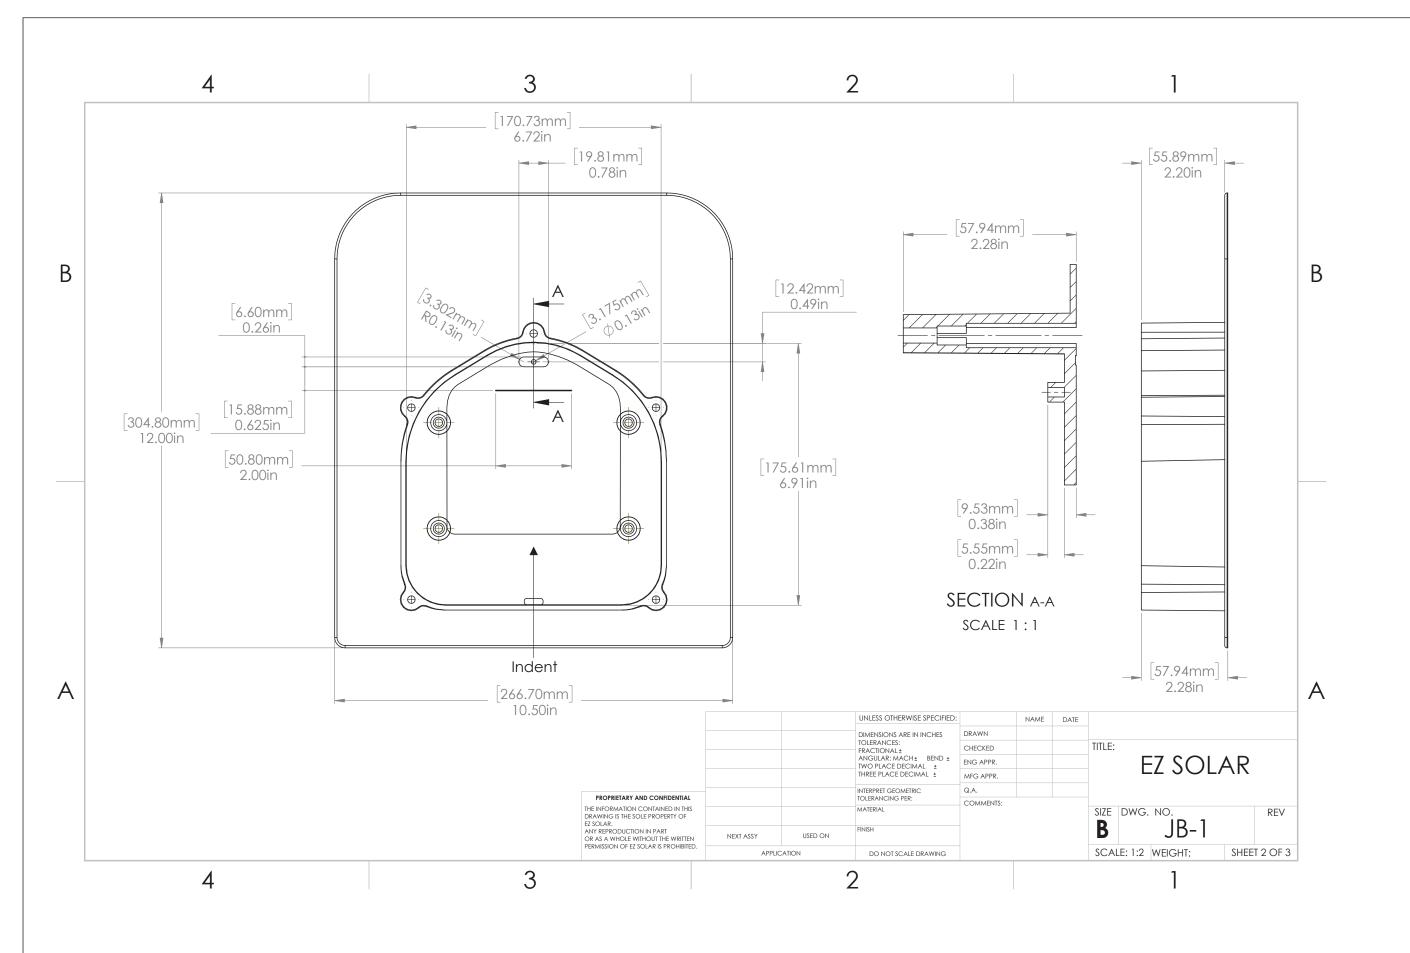



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.




CONTRACTOR: BRS FIELD OPS 385.498.6700

SHEET NAM

SPEC SHEET

PAGE NUMBER

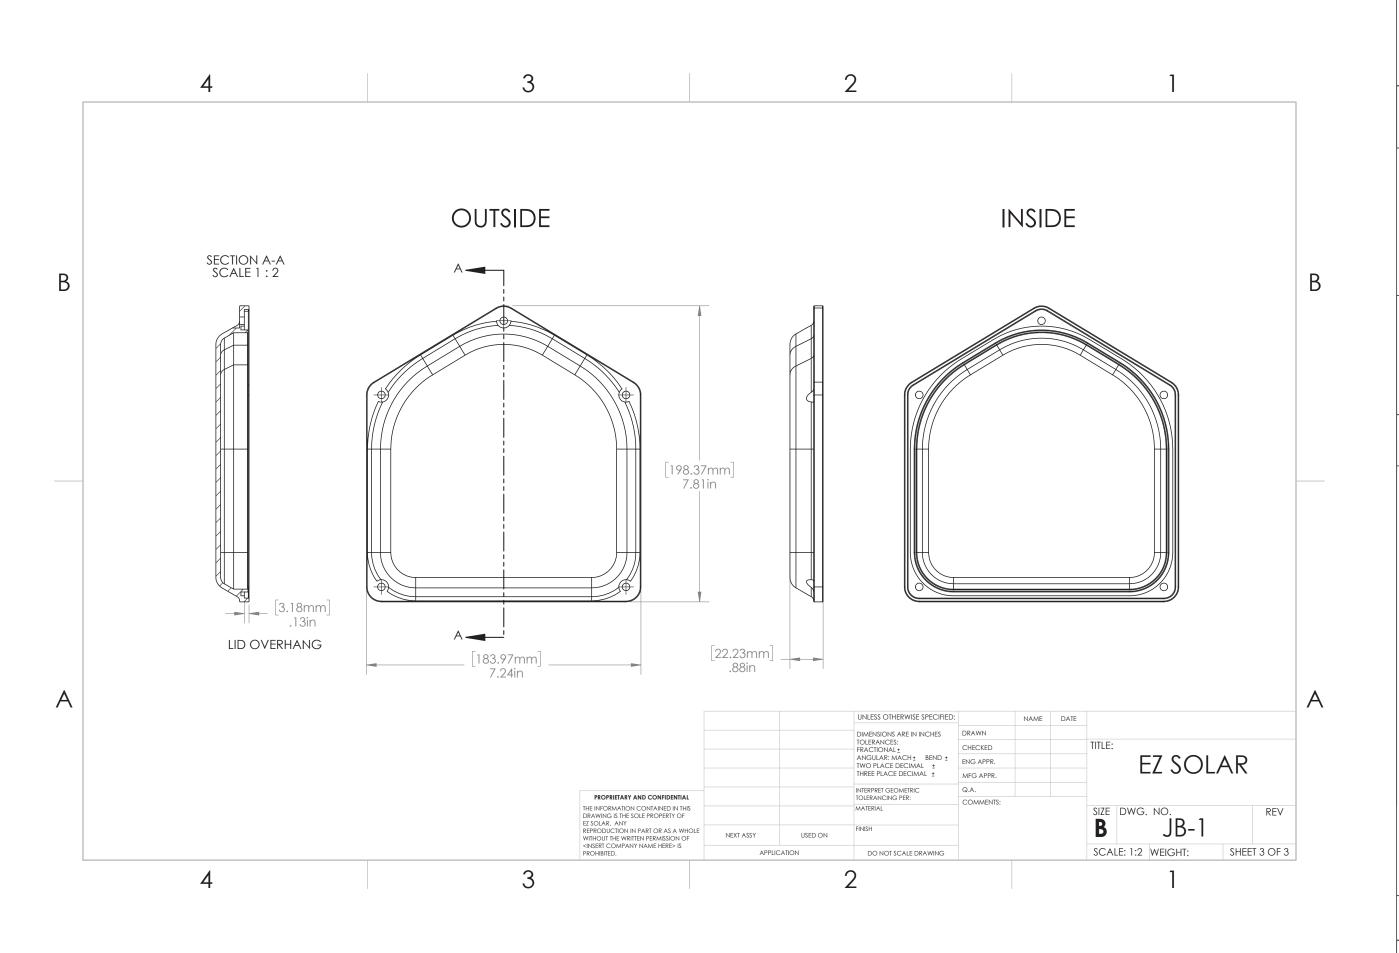



1403 N RESEARCH WAY, BUILDING J OREM, UT 84097

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700


SHEET NAME

SPEC SHEET

PAGE NUMBER



SYSTEM BONDING & GROUNDING PAGE

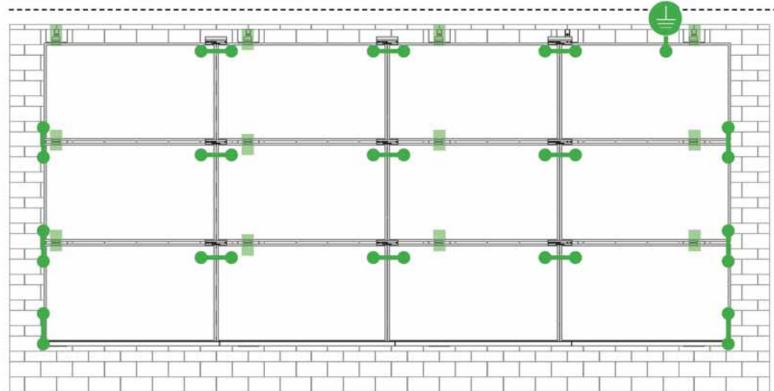

Star Washer is Single Use Only

TERMINAL TORQUE, Install Conductor and torque to the following:

4-6 AWG: 35in-lbs 8 AWG: 25 in-lbs 10-14 AWG: 20 in-lbs

LUG DETAIL & TORQUE INFO

Ilsco Lay-In Lug (GBL-4DBT)

- · 10-32 mounting hardware
- Torque = 5 ft-lb
- AWG 4-14 Solid or Stranded



TERMINAL TORQUE, Install Conductor and torque to the following: 4-14 AWG: 35in-lbs

LUG DETAIL & TORQUE INFO

Ilsco Flange Lug(SGB-4)

- 1/4" mounting hardware
- Torque = 75 in-lb
- AWG 4-14 Solid or Stranded

WEEBLUG Single Use Only



TERMINAL TORQUE, Install Conductor and torque to the following: 6-14 AWG: 7ft-lbs


LUG DETAIL & TORQUE INFO

Wiley WEEBLug (6.7)

- 1/4" mounting hardware
- Torque = 10 ft-lb
- AWG 6-14-Solid or Stranded


NOTE: ISOLATE COPPER FROM ALUMINUM CONTACT TO PREVENT CORROSION


System bonding is accomplished through modules. System grounding accomplished by attaching a ground lug to any module at a location on the module specified by the module manufacturer.

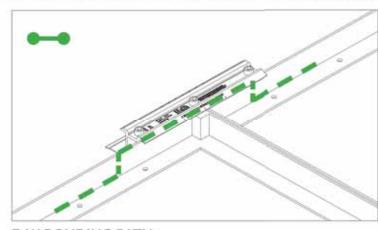

E-W BONDING PATH:


E-W module to module bonding is accomplished with 2 pre-installed bonding pins which engage on the secure side of the MicrorailTM and splice.






N-S BONDING PATH:

N-S module to module bonding is accomplished with bonding clamp with 2 integral bonding pins. (refer also to alternate method)





TRIMRAIL BONDING PATH:

Trimrail to module bonding is accomplished with bonding clamp with integral bonding pin and bonding T-bolt. (refer also to alternate method)



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BILLE RAVEN SOLAR LIC



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

SHEET NAME:

0

SPEC SHEETS

REVISION:

PAGE NUMBER:

SS





SYSTEM LEVEL FIRE CLASSIFICATION

The system fire class rating requires installation in the manner specified in the SUNFRAME MICRORAIL (SFM) Installation Guide. SFM has been classified to the system level fire portion of UL 1703. This UL 1703 classification has been incorporated into the UL 2703 product certification. SFM has achieved Class A, B & C system level performance for low slope & steep sloped roofs when used in conjunction with type 1 and type 2 modules. Class A, B & C system level fire

performance is inherent in the SFM design, and no additional mitigation measures are required. The fire classification rating is valid for any roof pitch. There is no required minimum or maximum height limitation above the roof deck to maintain the Class A, B & C fire rating for SFM. SUNFRAME MICRORAIL™ components shall be mounted over a fire resistant roof covering rated for the application.

Module Type	Roof Slope	System Level Fire Rating	Microrail Direction	Module Orientation	Mitigation Required
Type 1 and Type 2	Steep Slope & Low Slope	Class A, B & C	East-West	Landscape OR Portrait	None Required


UL2703 TEST MODULES

See page "S" for a list of modules that were electrically and mechanically tested or qualified with the SUNFRAME MICRORAIL (SFM) components outlined within this Installation Guide.

- Maximum Area of Module = 22.3 sqft
- UL2703 Design Load Ratings:
 - a) Downward Pressure 113 PSF / 5400 Pa
 - b) Upward Pressure 50 PSF / 2400 Pa
 - Down-Slope Load 30 PSF / 1400 Pa
- Tested Loads:
 - a) Downward Pressure 170 PSF / 8000 Pa
 - b) Upward Pressure 75 PSF / 3500 Pa
 - Down-Slope Load 45 PSF / 2100 Pa
- Maximum Span = 6ft
- Use with a maximum over current protection device OCPD of 30A
- System conforms to UL Std 2703, certified to LTR AE-001-2012
- Rated for a design load of 2400 Pa / 5400 Pa with 24 inch span

LABEL MARKINGS

- System fire class rating: See installation instructions for installation requirements to achieve a specified system fire class rating with Unirac.
- Unirac SUNFRAME MICRORAIL™ is listed to UL 2703.
- All splices within a system are shipped with marking indicating date and location of manufacture.

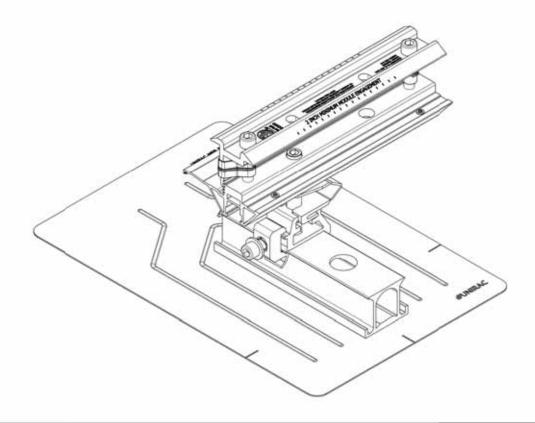





1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BILLE RAVEN SOLAR LLC



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

SHEET NAME:

SPEC SHEETS

REVISION:

0

PAGE NUMBER

SS



TESTED / CERTIFIED MODULE LIST | S INSTALLATION GUIDE | PAGE

Manufacture	Module Model / Series			
Aleo	P-Series			
Astronergy	CHSM6612P, CHSM6612P/HV, CHSM6612M, CHSM6612M/HV, CHSM6610M (BL)(BF)/(HF), CHSM72M-HC			
Auxin	AXN6M610T, AXN6P610T, AXN6M612T & AXN6P612T			
Axitec	AXI Power, AXI Premium, AXI Black Premium			
Boviet	BVM6610, BVM6612			
BYD	P6K & MHK-36 Series			
Canadian Solar	CS6V-M, CS6P-P, CS6K-M, CS5A-M, CS6K-MS, CS6U-P, CS6U-M, CS6X-P, CS6K-MS, CS6K-M, CS6K-P, CS6P-P, CS6P-M, CS3U-P, CS3U-MS, CS3K-P, CS3K-MS, CS1K-MS, CS3K, CS3U, CS3U-MB-AG, CS3K-MB-AG, CS6K, CS6U, CS3L, CS3W, CS1H-MS, CS1U-MS			
Centrosolar America	C-Series & E-Series			
CertainTeed	CT2xxMxx-01, CT2xxPxx-01, CTxxxMxx-02, CTxxxM-03, CTxxxMxx-04, CTxxxHC11-04			
Dehui	DH-60M			
Eco Solargy	Orion 1000 & Apollo 1000			
FreeVolt	Mono PERC			
GCL	GCL-P6 & GCL-M6 Series			
Hansol	TD-AN3,TD-AN4, UB-AN1,UD-AN1			
Heliene	36M, 60M, 60P, 72M & 72P Series			
HT Solar	HT60-156(M) (NDV) (-F), HT 72-156(M/P)			
Hyundai	KG, MG, TG, RI, RG, TI, MI, HI & KI Series			
ITEK	iT, iT-HE & iT-SE Series			
Japan Solar	JPS-60 & JPS-72 Series			

Manufacture	Module Model / Series			
JA Solar	JAP6 60-xxx, JAM6-60-xxx/SI, JAM6(K)-60/ xxx, JAP6(k)-72-xxx/4BB, JAP72SYY-xxx/ZZ, JAP6(k)-60-xxx/4BB, JAP60SYY-xxx/ZZ, JAM6(k)-72-xxx/ZZ, JAM72SYY-xxx/ZZ, JAM6(k)-60-xxx/ZZ, JAM60SYY-xxx/ZZ. i. YY: 01, 02, 03, 09, 10 ii. ZZ: SC, PR, BP, HiT, IB, MW			
Jinko	JKM & JKMS Series			
Kyocera	KU Series			
LG Electronics	LG xxx S1C-A5, LG xxx N1C-A5, LGxxxQ1C(Q1K)-A5, LGxxxN1C(N1K)-A5, LGxxxS1CA5, LGxxxA1C-A5, LGxxxN2T-A4, LGxxxN2T-A5, LGxxxN2W-A5 LGxxxS2W-A5, LGxxxE1C-A5, LGxxxS2W-G4 LGxxxN1C(N1K)-G4, LGxxxN2W-G4, LGxxxS1C-G4, LGxxxE1K-A5, LGxxxN2T-J5, LGxxxN1K(N1C)-V5, LGxxxQ1C(N2W)-V5,			
LONGi	LR6-60 & LR6-72 Series, LR4-60 & LR4-72 Series			
Mission Solar Energy	MSE Series			
Mitsubishi	MJE & MLE Series			
Neo Solar Power Co.	D6M & D6P Series			
Panasonic	VBHNxxxSA15 & SA16, VBHNxxxSA17 & SA18, VBHNxxxSA17(E/G) & SA18E, VBHNxxxKA01 & KA03 & KA04, VBHNxxxZA01,VBHNxxxZA)2, VBHNxxxZA03,VBHNxxxZA)4			
Peimar	SGxxxM (FB/BF)			
Phono Solar	PS-60, PS-72			
Q.Cells	Plus, Pro, Peak, G3, G4, G5, G6(+), G7, G8(+) Pro, Peak L-G2, L-G4, L-G5, L-G6, L-G7			

Manufacture	Module Model / Series			
	PEAK Energy Series,			
	PEAK Energy BLK2 Series,			
	PEAK Energy 72 Series,			
REC	TwinPeak Series			
	TwinPeak 2 Series,			
	TwinPeak 2 BLK2 Series,			
	TwinPeak 3 Series (38mm)			
Renesola	Vitrus2 Series & 156 Series			
Risen	RSM Series			
S-Energy	SN72 & SN60 Series (40mm)			
Seraphim	SEG-6 & SRP-6 Series			
Sharp	NU-SA & NU-SC Series			
Silfab	SLA, SLG & BC Series			
Solaria	PowerXT			
6 to 112 to	Sunmodule Protect,			
SolarWorld	Sunmodule Plus			
Sonali	SS 230 - 265			
Suntech	STP			
Suniva	MV Series & Optimus Series			
Sun Edison/Flextronics	F-Series, R-Series & FLEX FXS Series			
SunPower	X-Series, E-Series & P-Series			
	TP572, TP596, TP654, TP660,			
Talesun	TP672, Hipor M, Smart			
Tesla .	SC, SC B, SC B1, SC B2			
	PA05, PD05, DD05, DE06, DD06, PE06,			
Trina	PD14, PE14, DD14, DE14, DE15, PE15H			
Upsolar	UP-MxxxP(-B), UP-MxxxM(-B)			
URE	D7MxxxH8A, D7KxxxH8A, D7MxxxH7A			
Vikram	Eldora, Solivo, Somera			
Waaree	AC & Adiya Series			
Winaico	WST & WSP Series			
Yingli	YGE & YLM Series			

Please see the SFM UL2703Construction Data Report at Unirac.com to ensure the exact solar module selected is approved for use with SFM. SFM Infinity is not compatible with module frame height of less than 30mm and more than 40mm. See page J for further information.



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BILLE RAVEN SOLAR LIC



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

SHEET NAME:

SPEC SHEETS

REVISION:

0

PAGE NUMBER:



AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Address:

Applicant: Unirac, Inc Manufacturer:

Address: 1411 Broadway Blvd NE

Albuquerque, NM 87102

Country: USA Country:

Klaus Nicolaedis
Contact: Contact:

Contact: Todd Ganshaw

Email: klaus.nicolaedis@unirac.com toddg@unirac.com Email:

Party Authorized To Apply Mark: Report Issuing Office:

Same as Manufacturer Lake Forest, CA

Control Number: 5003705 Authorized by:

Jorany along

for L. Matthew Snyder, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between intertek and its Client, Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any part, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or dentitudes of this Authorization to Mark and then only in its sentirety. Use of Intertek's Certification mark is restricted to the conditions failed out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc. 545 East Algonquin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Standard(s):

Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Plate Photovoltaic Modules and Panels [UL 2703: 2015 Ed.1]

Photovoltaic Module Racking Systems [CSA LTR AE-001:2012]

Product: Photovoltaic Mounting System, Sun Frame Microrail Installation Guide, PUB2021JAN13

Brand Name: Unirac

Models: Unirac SFM

ATM for Report 102393982LAX-002

Page 1 of 3

ATM Issued: 13-May-2021 ED 16.3.15 (15-Oct-20) Mandatory intertek

Email:

AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Applicant: Unirac, Inc Manufacturer:

Address: 1411 Broadway Blvd NE Address: Address:

Albuquerque, NM 87102

Country: USA Country:

Klaus Nicolaedis Contact:

Phone: Todd Ganshaw 505-462-2190 505-843-1418 Phone: FAX: NA FAX:

Party Authorized To Apply Mark: Same as Manufacturer
Report Issuing Office: Lake Forest, CA

klaus.nicolaedis@unirac.com

Control Number: 5014989 Authorized by:

for L. Matthew Snyder, Certification Manager

Email:

Intertek

This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc. 545 East Algonquin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Standard(s):

Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Plate Photovoltaic Modules and Panels [UL 2703: 2015 Ed.1]

Photovoltaic Module Racking Systems [CSA LTR AE-001:2012]

Product: Photovoltaic Mounting System, Sun Frame Microrail Installation Guide, PUB2021JAN13

Brand Name: Unirac

Models: Unirac SFM

ATM for Report 102393982LAX-002

Page 2 of 3

ATM Issued: 13-May-2021 ED 16.3.15 (15-Oct-20) Mandatory BLUE RAVEN SOLAR

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL Scott Gurney

#PV-011719-015866 CONTRACTOR:

BRS FIELD OPS

385-498-6700

SHEET NAME:

0

SPEC SHEETS

REVISION:

SS

PAGE NUMBER





1403 N RESEARCH WAY, BUILDING J


800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



Scott Gurney # PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385.498.6700

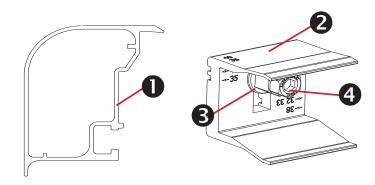

Trimrail™ and Module Clips

Sub-Components:

- 1. Trim Rail
- 2. Module Clip
- 3. T-Bolt
- 4. Tri-Drive Nut

Trimrail™

Functions:

- Required front row structural support (with module clips)
- Module mounting
- Installation aid
- Aesthetic trim

Features:

- Mounts directly to L-feet
- Aligns and captures module leading edge
 - Supports discrete module thicknesses from 32, 33, 35, 38, and 40mm


Module Clips


Functions:

- Required front row structural support (with trimrail)
- Module mounting

Features:

- Mounts to Trimrail[™] with T-bolt and tri-drive nut
- Manually adjustable to fit module thicknesses 32, 33, 35, 38, and 40mm.

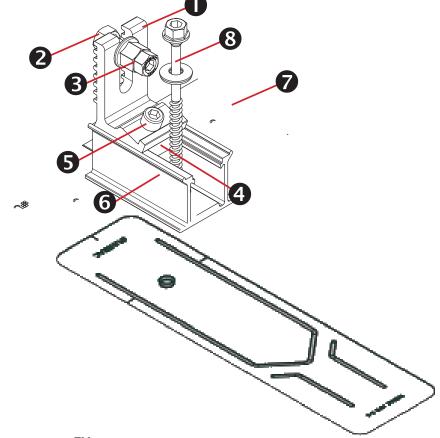



Sub-Components:

L-Foot

Hex bolt

Tri-drive nut

Channel Nut

Scocket Head Cap Screw

3"Channel/Slider w/grommet

3" Wide Flashing

Structural Screw & SS EPDM Washer

Functions:

- Attach TrimrailTM to roof attachment / flashing
- Patented roof sealing technology at roof attachment point

Features:

- Slot provides vertical adjustments to level array
- Slider provides north/south adjustment along the slope of the roof
- Shed and Seal Technology

Trimrail™ Splice

Sub-Components:

- 1. Structural Splice Extrusion
- 2. Bonding Clip

Functions:

- Front row structural support
- Installation aid
- Structurally connects 2 pieces of Trimrail™
- Electrically bonds 2 pieces of Trimrail[™]

Features:

- Aligns and connects Trimrail[™] pieces
- Tool-less installation

SHEET NAME

SPEC SHEET

PAGE NUMBER






1403 N RESEARCH WAY, BUILDING J

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: BRS FIELD OPS 385.498.6700




Module-to-Module N-S Bonding

Sub-Components:

- 1. Clamp
- 2. Bonding Pins (2)
- 3. 5/16" Socket Head Cap Screw
- 4. Clamp Base

Functions/ Features:

- Row to row bonding
- Single Use Only
- Fits module sizes 32-40mm




Trim -to- Module Bonding Clamp and Floating Trim Clamp

Sub-Components:

- 1. Wedge
- 2. Bonding Pin
- 3. T-Bolt
- 4. Nut
- 5. Cast Base

Functions/ Features:

- Module to Trimrail™ bonding single use only
- Attaches Trimrail[™] to module when fewer than
 2 rafter attachment points are available
- Fits module sizes 32-40mm
- Fits module sizes 32-40mm




Wire Bonding Clip w/ 8AWG

Functions:

- Row to row bonding
- Module to Trimrail™ bonding
- Single Use Only

Features:

Tool-less installation

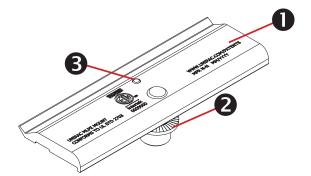

MLPE Mounting Assembly

Sub-Components:

- 1. MLPE Mount Base
- 2. 5/16 Socket Head Cap Screw
- 3. Bonding Pin

Functions:

- Securely mounts MLPE to module frames
- MLPE to module bonding

Features:

- Mounts easily to typical module flange
- UL2703 Recognized

MLPE = Module Level Power Electronics, e.g. microinverter or power optimizer

Functions:

- Patented Shed & Seal roof sealing technology at roof attachment point
- For use with compatible 2" Microrail or 8" Attached Splices

Features:

- Slider provides north/south adjustment along the slope of the roof
- Shed and Seal Technology

SFM Slider Flashkit

2. Structural Screw & SS EPDM washer

Sub-Components:

1. Slider w/grommet

3" Wide Flashing

SHEET NAME


SPEC SHEET

PAGE NUMBER




3" FLASHING & SLIDERS | GINSTALLATION GUIDE | PAGE




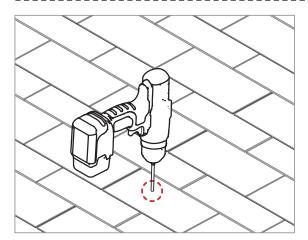


PILOT HOLES:

Drill pilot holes for lag screws or structural screws (as necessary) at marked attachement points



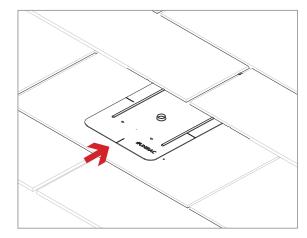

FLASHINGS: Place flashings

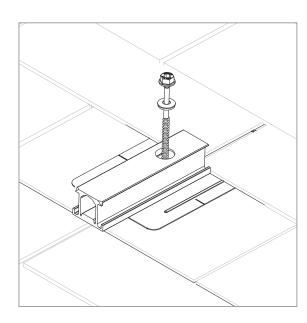


INSTALL SLIDERS AND TRIMRAIL ROOF ATTACHMENTS:

Insert flashings per manufacturer instructions

NOTE: Use Lag screw or structural fastener with a maximum diameter of 5/16"

- Attach sliders to rafters
- Verify proper row to row spacing for module size (Mod NS + 1")
- Ensure that TrimrailTM roof attachments in each row have sufficient engagement with slider dovetails for proper attachment.

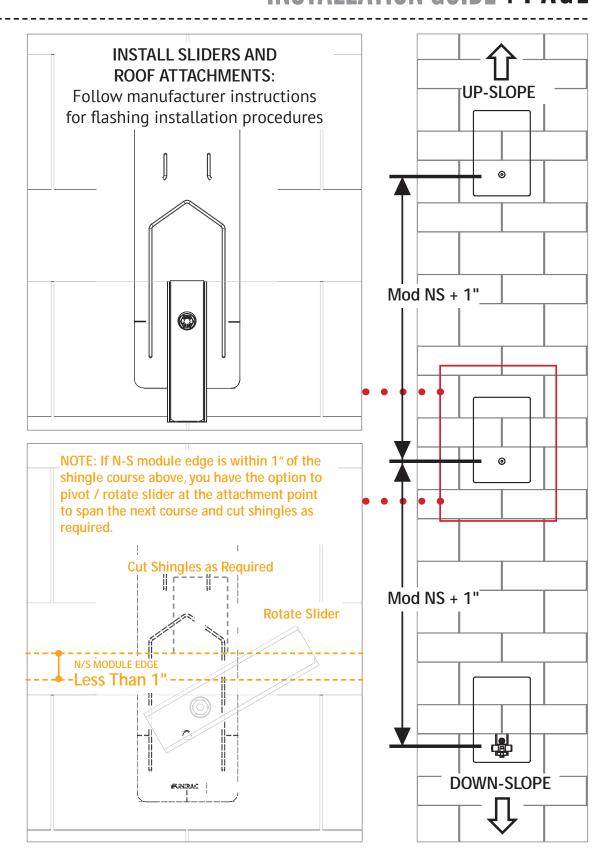



1403 N RESEARCH WAY, BUILDING J

800-377-4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL - THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



CONTRACTOR: **BRS FIELD OPS** 385.498.6700

SPEC SHEET

AGE NUMBER SS

0