



LEADING THE WAY
Structural Engineering Firm
NC License No. C-2499

168 Quade Drive
Cary, North Carolina 27513
www.rbengineering.com

Phone: 919-677-9662 / Cell: 919-280-2695 / Fax: 919-677-9663

E-mail: rbittler@rbengineering.com

Mr. Evan McNeil

May 4, 2022

Yes! Solar Solutions of the Triangle

E-mail: emcneil@yessolarsolutions.com

Subject: Roof mounted solar panels – Flocke Residence
256 Rolling Pines Drive
Spring Lake, North Carolina 28390

File No.: RB-227986

Dear Evan:

RB Engineering, Inc. is pleased to provide the following summary engineering letter concerning the subject project. The existing roof system is constructed with 2-inch by 8-inch timber rafters at 16 inches on center, an OSB roof deck and a composition asphalt shingle roof. We have reviewed the proposed solar layout and have structurally evaluated the additional proposed roof loading with the following conclusions:

- The total surface area of the new proposed solar array (34 PV modules) is approximately 590 SF. The solar panel installation has been evaluated for an ultimate design wind speed of 120 mph.
- The subject roof mounted PV system attachment method is structurally adequate to transfer the design uplift loads in accordance with the current North Carolina residential building code.
- The existing roof system is structurally adequate to transfer the applicable design loads - including the additional or modified design loading (dead, wind and snow loads) due to the proposed solar panel installation - in accordance with the current North Carolina residential building code.

Our services were provided in accordance with the standard of practice for structural engineering and within the limits imposed by scope, schedule, and budget. If you have any questions or if I can be of further assistance to you on this project, please contact me at (919) 677-9662.

Respectfully submitted,

Ron Bittler, PE
President / Structural Engineer
RB Engineering, Inc.

Ron
Bittler,
PE

Digitally signed by
Ron Bittler, PE
DN: cn=Ron Bittler,
PE, o, ou,
email=rbittler@rbengi-
neering.com, c=US
Date: 2022.05.04
12:33:28 -04'00'



SCOPE OF WORK

PHOTOVOLTAIC SYSTEM SUMMARY

SYSTEM SIZE: DC - 12.410 KW

AC - 10.000 KW

MODULES: (34) REC SOLAR REC365NP2 BLACK (365W) MODULES

INVERTER: (1) SOLAREEDGE SE10000H-US INVERTER

ROOF 1:-ARRAY TILT: 35°

ROOF 1:-AZIMUTH: 272°

ELECTRICAL INFORMATION

UTILITY COMPANY: SOUTH RIVER EMC

MAIN SERVICE AMPERAGE: 200A

GOVERNING CODES & STANDARDS

INTERNATIONAL RESIDENTIAL CODE 2018

INTERNATIONAL BUILDING CODE 2018

INTERNATIONAL FIRE CODE 2018

NATIONAL ELECTRIC CODE 2020

GENERAL NOTES:

- CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS PRIOR TO INITIATING CONSTRUCTION.
- CONTRACTOR SHALL REVIEW ALL MANUFACTURER INSTALLATION DOCUMENTS PRIOR TO INITIATING CONSTRUCTION.
- ALL EQUIPMENT SHALL BE LISTED BY U.L. (OR EQUAL) AND LISTED FOR ITS SPECIFIC APPLICATION.
- ALL EQUIPMENT SHALL BE RATED FOR THE ENVIRONMENT IN WHICH IT IS INSTALLED.
- ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- ACCESS TO ELECTRICAL COMPONENTS OVER 150 VOLTS TO GROUND SHALL BE RESTRICTED TO QUALIFIED PERSONNEL.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, CONTRACTOR SHALL SIZE THEM ACCORDING TO APPLICABLE CODES.
- PV MODULE FRAMES SHALL BE BONDED TO RACKING RAIL OR BARE COPPER G.E.C. PER THE MODULE MANUFACTURER'S LISTED INSTRUCTION SHEET.
- PV MODULE RACKING RAIL SHALL BE BONDED TO BARE COPPER G.E.C. VIA WEEB LUG, ILSCO GBL-4DBT LAY-IN LUG, OR EQUIVALENT LISTED LUG.
- GROUNDING ELECTRODE CONDUCTOR (G.E.C.) SHALL BE CONTINUOUS AND/OR IRREVERSIBLY SPLICED/WELDED.
- ALL JUNCTION BOXES, COMBINER BOXES, AND DISCONNECTS SHALL BE INSTALLED IN AN ACCESSIBLE LOCATION.
- WORKING SPACE AROUND ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26

SHEET INDEX

PV-0	COVER SHEET
PV-1	SITE PLAN AND ROOF PLAN
PV-2	ROOF PLAN & MODULES
PV-2A	ELECTRICAL SITE PLAN
PV-3	ATTACHMENT DETAIL
PV-4	ELECTRIC LINE DIAGRAM
PV-5	WIRING CALCULATIONS
PV-6	PLACARDS
PV-7	OPTIMIZER CHART
PV-8 to 15	EQUIPMENT SPECIFICATION

STRUCTURAL REVIEW PROVIDED BY:

RONALD P. BITTLER, PE

RB ENGINEERING, INC. (C-2499)

168 QUADE DRIVE

CARY, NC 27513

919-677-9662

PROJECT #RB-227986

Ron
Bittler,
PE


Digitally signed by Ron
Bittler, PE
DN: cn=Ron Bittler, PE,
o, ou,
email=bittler@rbengin
eering.com, c=US
Date: 2022.05.04
12:35:26 -04'00'



1 | AERIAL VIEW

PV-0

SCALE: NTS

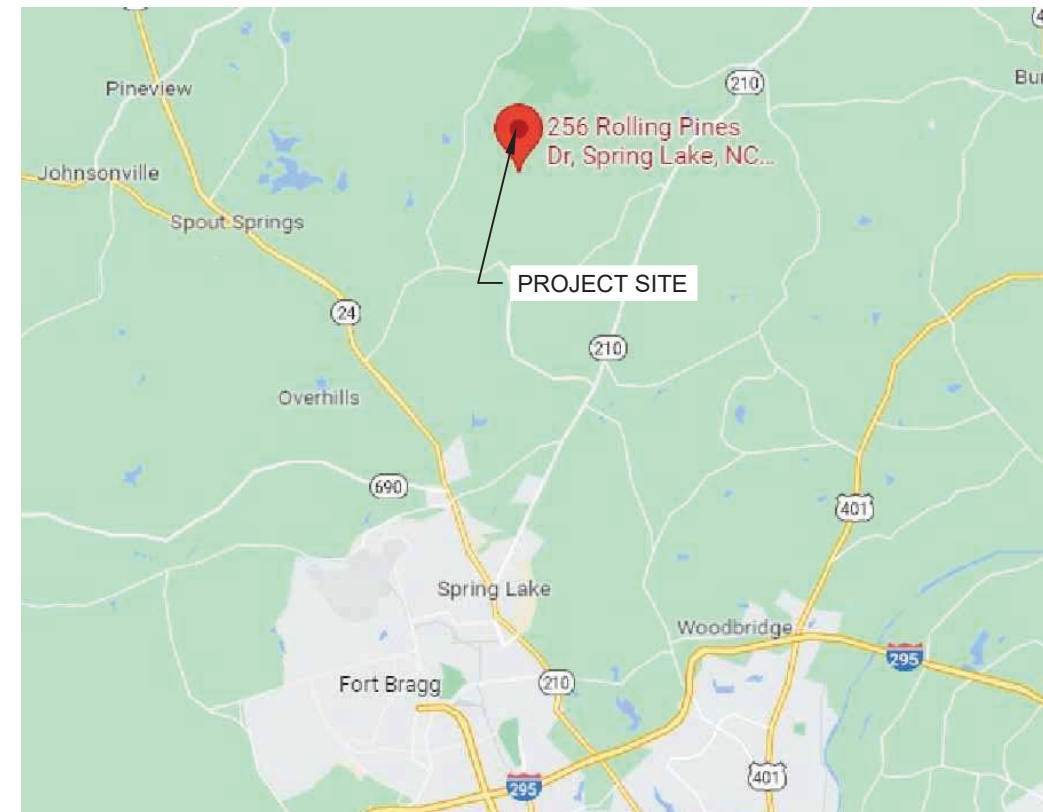

2 | VICINITY MAP

PV-0

SCALE: NTS



**YES SOLAR
SOLUTIONS**

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal



STRUCTURAL
05.04.2022

PROJECT NAME & ADDRESS

**FLOCKE
RESIDENCE**
256 ROLLING PINES DR
SPRING LAKE, NC 28390


DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
COVER SHEET

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-0

ROOF ACCESS POINT SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS OR DOORS, AND LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION IN LOCATIONS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREE LIMBS, WIRES OR SIGNS.



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS


FLOCKE RESIDENCE
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
SITE PLAN & ROOF PLAN

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-1

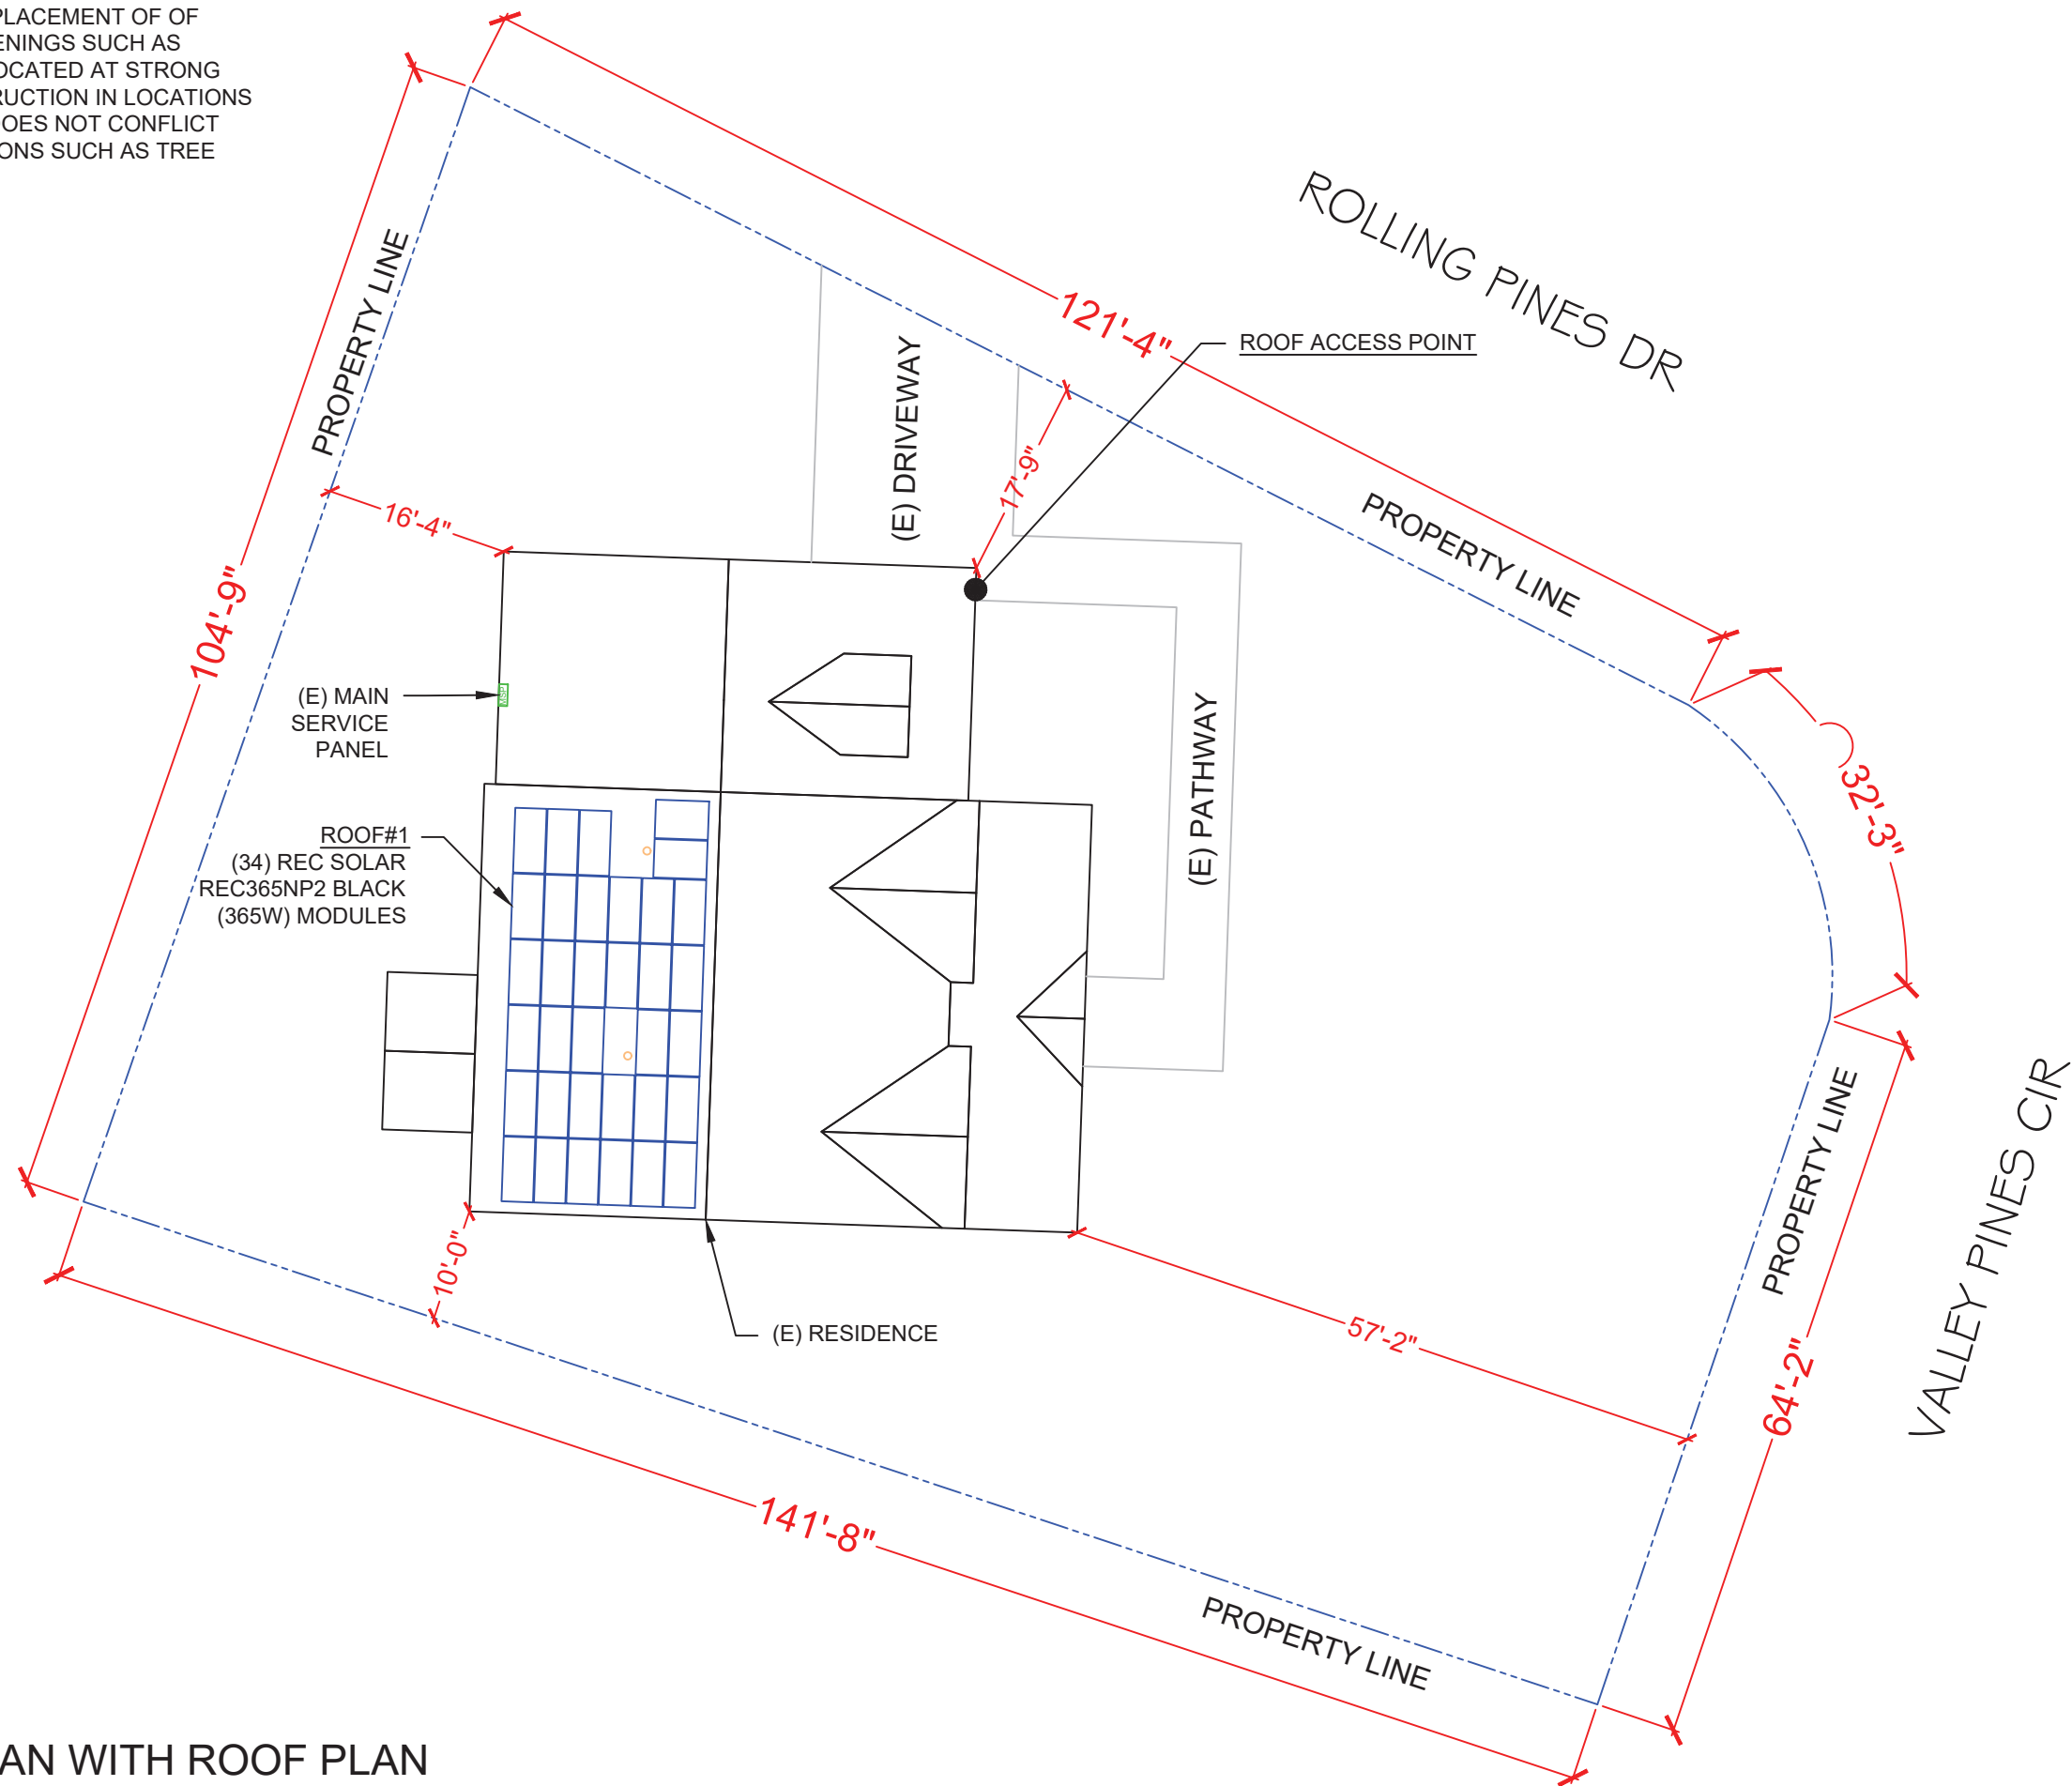

1 PLOT PLAN WITH ROOF PLAN



PV-1

SCALE: 1/16" = 1'-0"

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 34 MODULES
 MODULE TYPE = REC SOLAR REC365NP2 BLACK (365W) MODULES
 MODULE WEIGHT = 40.0 LBS / 20.0 KG.
 MODULE DIMENSIONS = 69.1" x 40.94" = 17.24 SF
 UNIT WEIGHT OF ARRAY = 2.32 PSF

ROLLING PINES DR
 (E) FRONT YARD

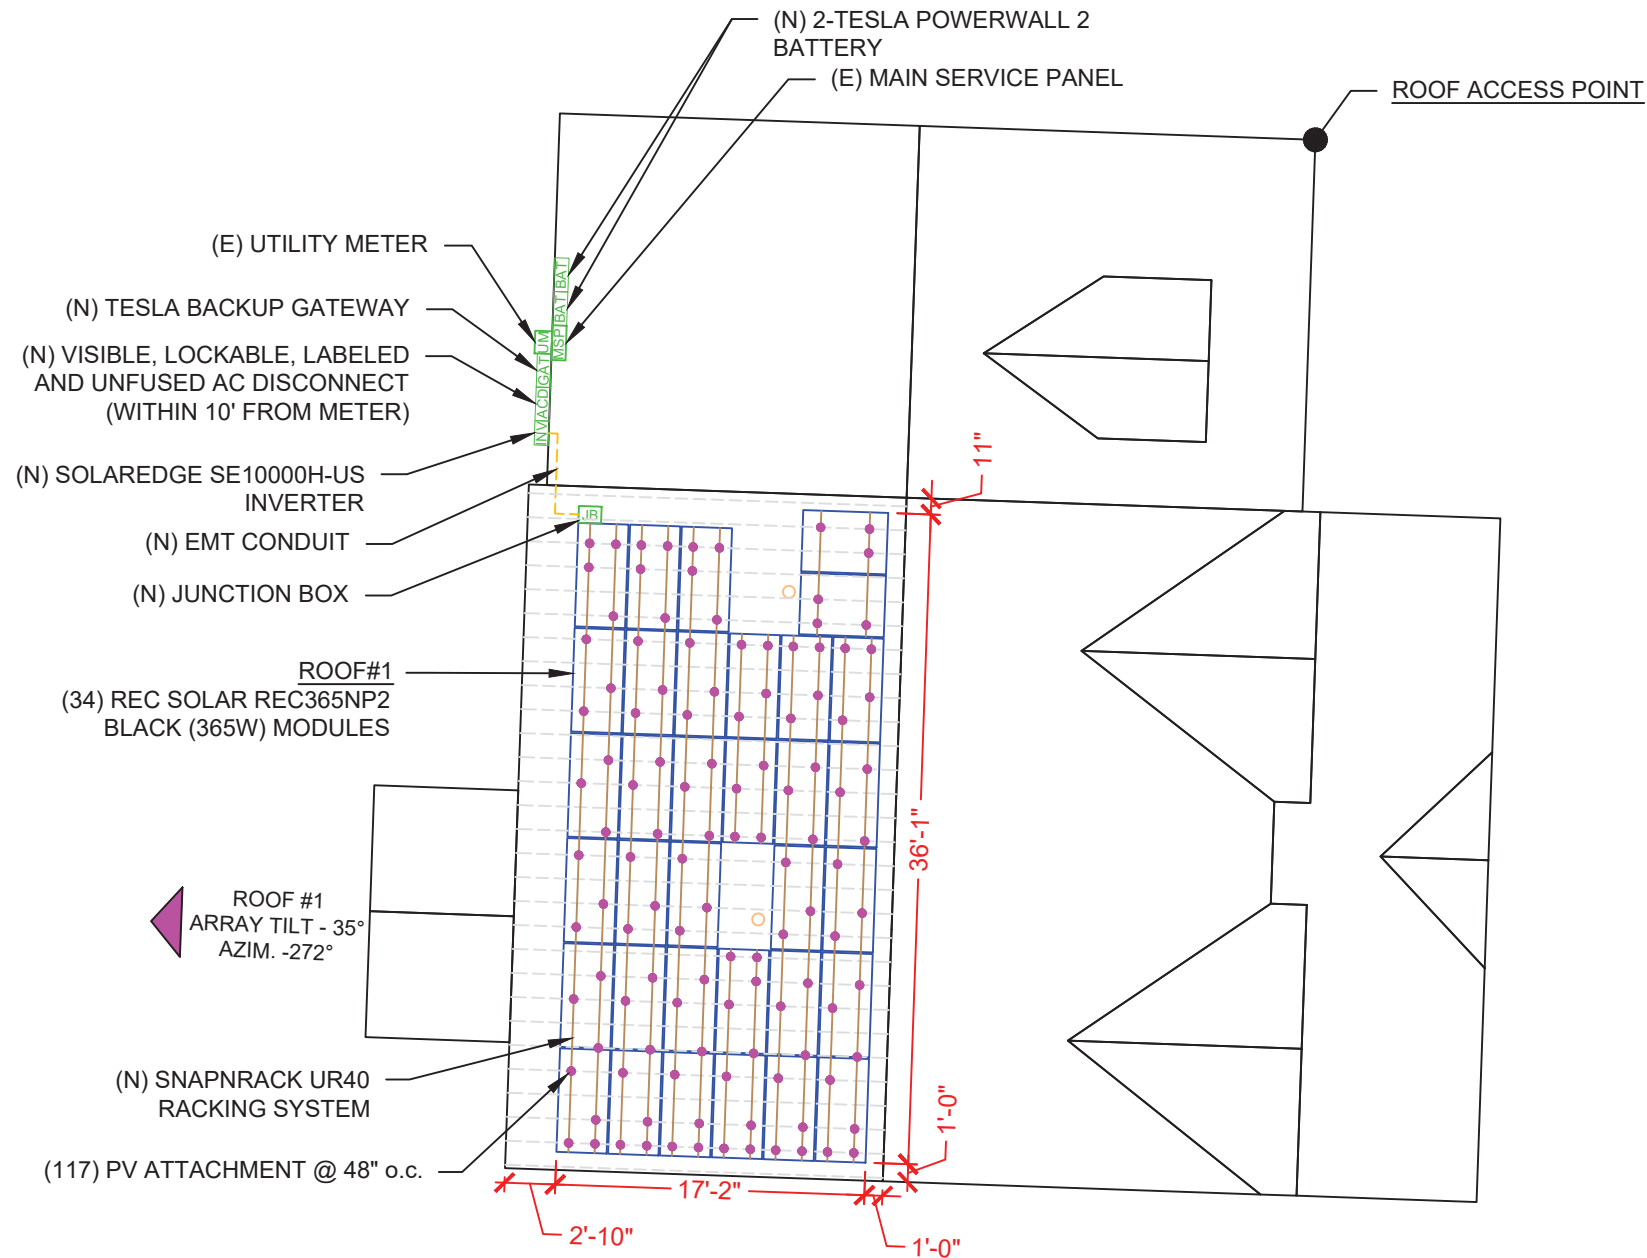

ROOF DESCRIPTION				
ROOF TYPE			COMPOSITE SHINGLE	
ROOF	ARRAY TILT	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	35°	272°	2"X8"	16" O.C.

ARRAY AREA				
ROOF	# OF MODULES	ARRAY AREA (Sq. Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)
#1	34	586.16	798.00	73.45

YES SOLAR SOLUTIONS
 202 N. DIXON AVE.
 CARY, NC 27513
 LICENSE #: 67356

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

 05.04.2022

PROJECT NAME & ADDRESS

FLOCKE RESIDENCE
 256 ROLLING PINES DR
 SPRING LAKE, NC 28390


DC SIZE: 12.410 KW
 AC SIZE: 10.000 KW

SHEET NAME
ROOF PLAN & MODULES

SHEET SIZE
**ANSI B
 11" X 17"**

SHEET NUMBER
PV-2

VALLEY PINES CIR

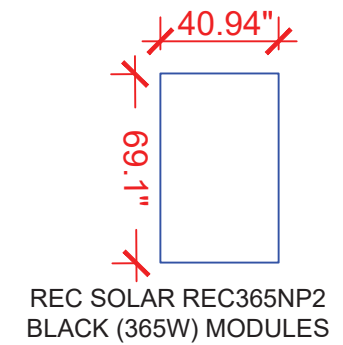

LEGEND

MSP - MAIN SERVICE PANEL	 - VENT, ATTIC FAN (ROOF OBSTRUCTION)
JB - JUNCTION BOX	● - PV ATTACHMENT @ 48" o.c.
ACD - AC DISCONNECT	--- - CONDUIT
INV - INVERTER	

(E) BACK YARD

1 ROOF PLAN & MODULES

PV-2


SCALE: 3/32" = 1'-0"

BILL OF MATERIALS		
EQUIPMENT	QTY	DESCRIPTION
SOLAR PV MODULE	34	REC SOLAR REC365NP2 BLACK (365W) MODULES
INVERTER	1	SOLAREEDGE SE10000H-US INVERTER
OPTIMIZER	34	SOLAREEDGE POWER OPTIMIZER S440
BACKUP GATEWAY	1	TESLA BACKUP GATEWAY
AC DISCONNECT	1	60A UNFUSED, 240V, NEMA 3R, UL LISTED,
BATTERY	2	TESLA POWERWALL 2 BATTERY
ATTACHMENT	117	PV ATTACHMENT @ 48" O.C.
MID CLAMPS	52	MID CLAMPS
END CLAMPS	32	END CLAMPS

DC SYSTEM SIZE- 12.410 KW
AC SYSTEM SIZE- 10.000 KW

(34) REC SOLAR REC365NP2 BLACK (365W) MODULES
(01) SOLAREEDGE SE10000H-US INVERTER

(01) CIRCUIT OF 12 MODULES
(02) CIRCUIT OF 11 MODULES



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

**FLOCKE
RESIDENCE**

256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
**ELEC. SITE
PLAN**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-2A



REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal



05.04.2022

PROJECT NAME & ADDRESS


**FLOCKE
RESIDENCE**
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
**RACKING
DETAIL**

SHEET SIZE
**ANSI B
11" X 17"**


SHEET NUMBER
PV-3

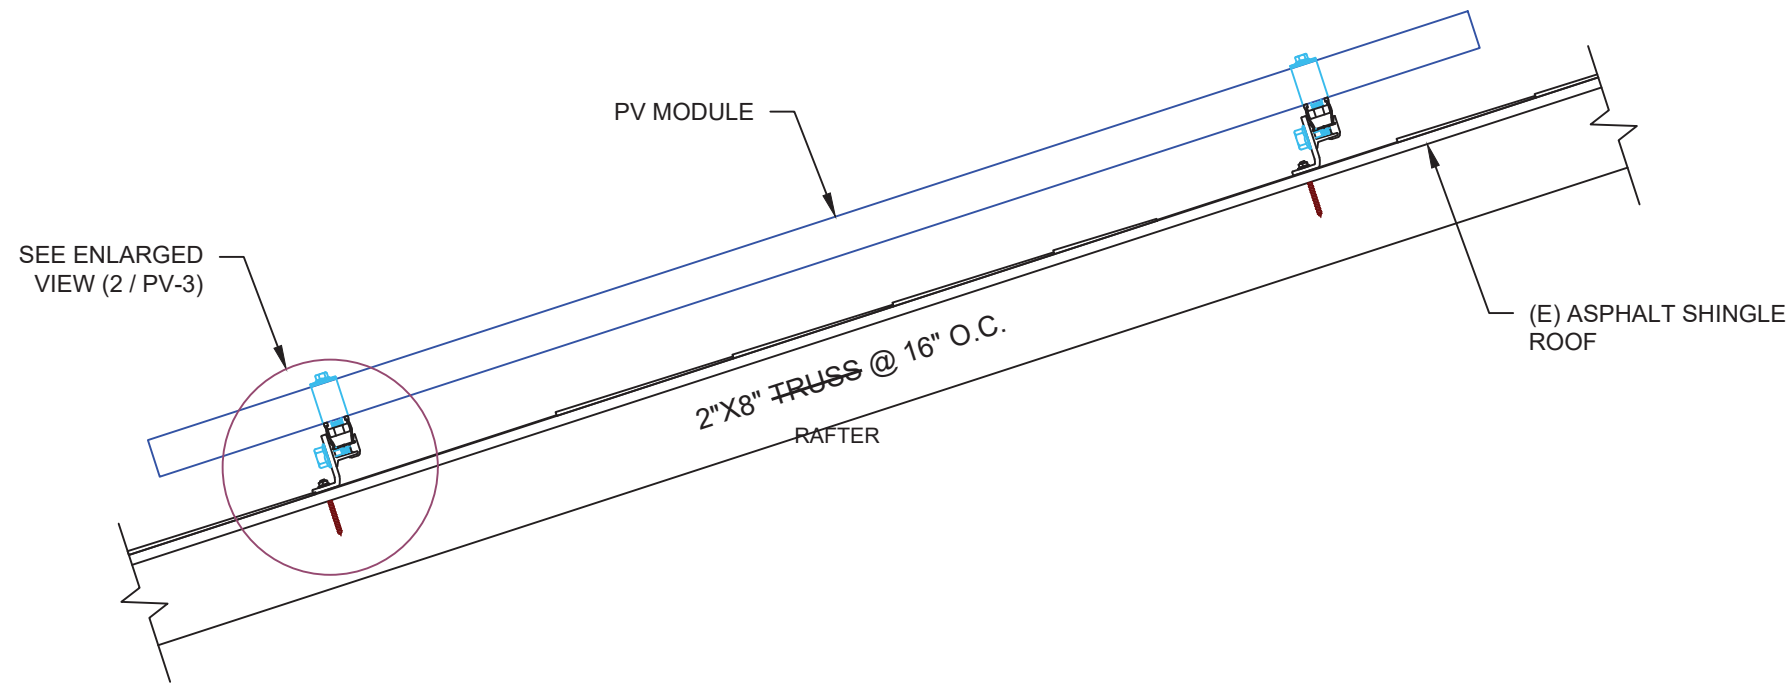

1 ATTACHMENT DETAIL

PV-3

SCALE: NTS

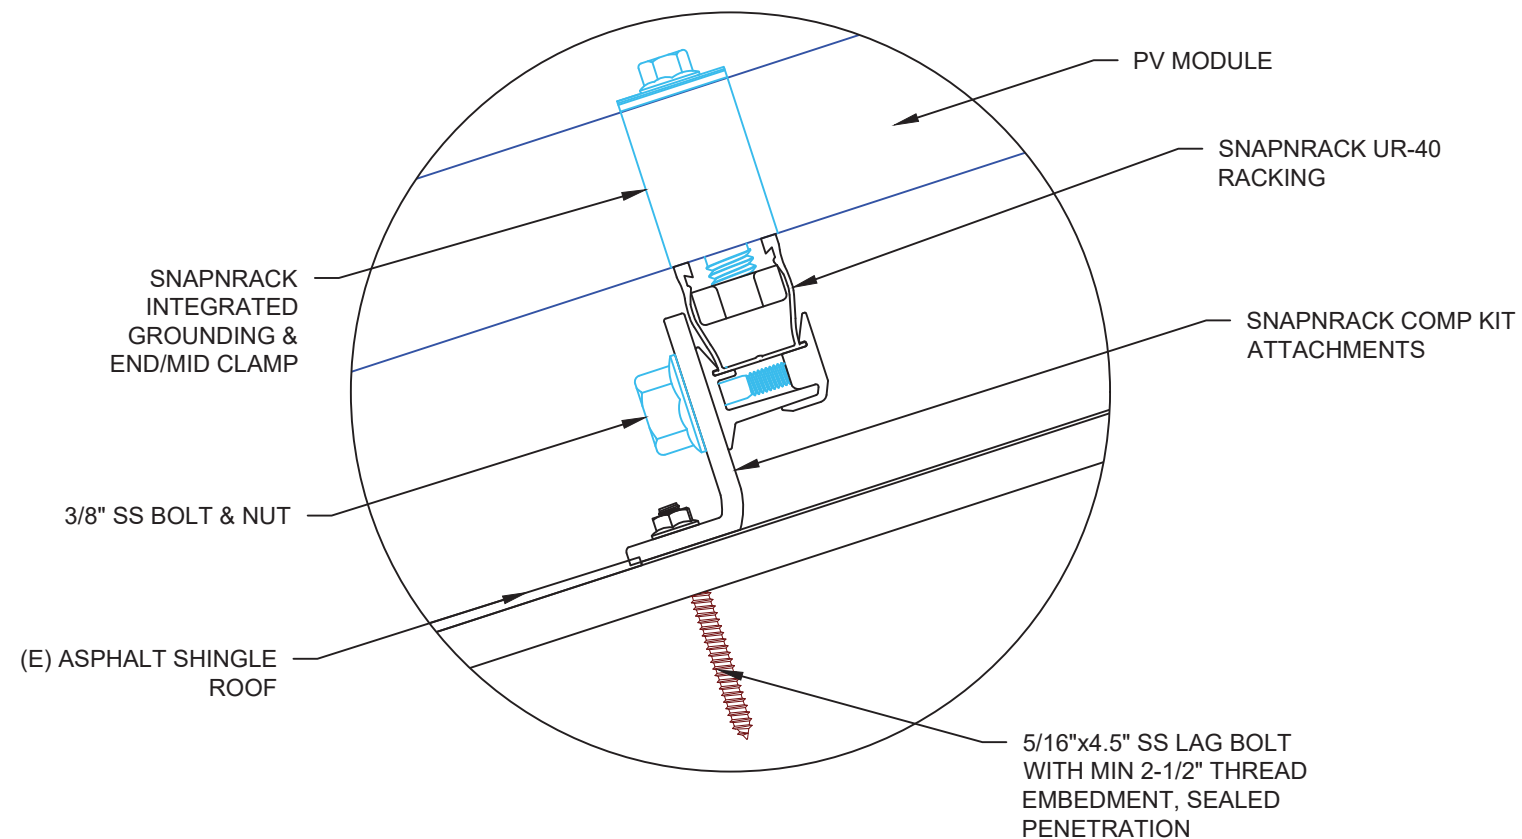


2 ATTACHMENT DETAIL (ENLARGED SECTION VIEW)

PV-3

SCALE: NTS

DC SYSTEM SIZE- 12.410 KW
 AC SYSTEM SIZE- 10.000 KW
 (34) REC SOLAR REC365NP2 BLACK (365W) MODULES
 (34) SOLAREEDGE S440 POWER OPTIMIZERS
 (01) SOLAREEDGE SE10000H-US (10000W / 10.000 KW) INVERTER
 (01) CIRCUIT OF 12 MODULES
 (02) CIRCUIT OF 11 MODULES

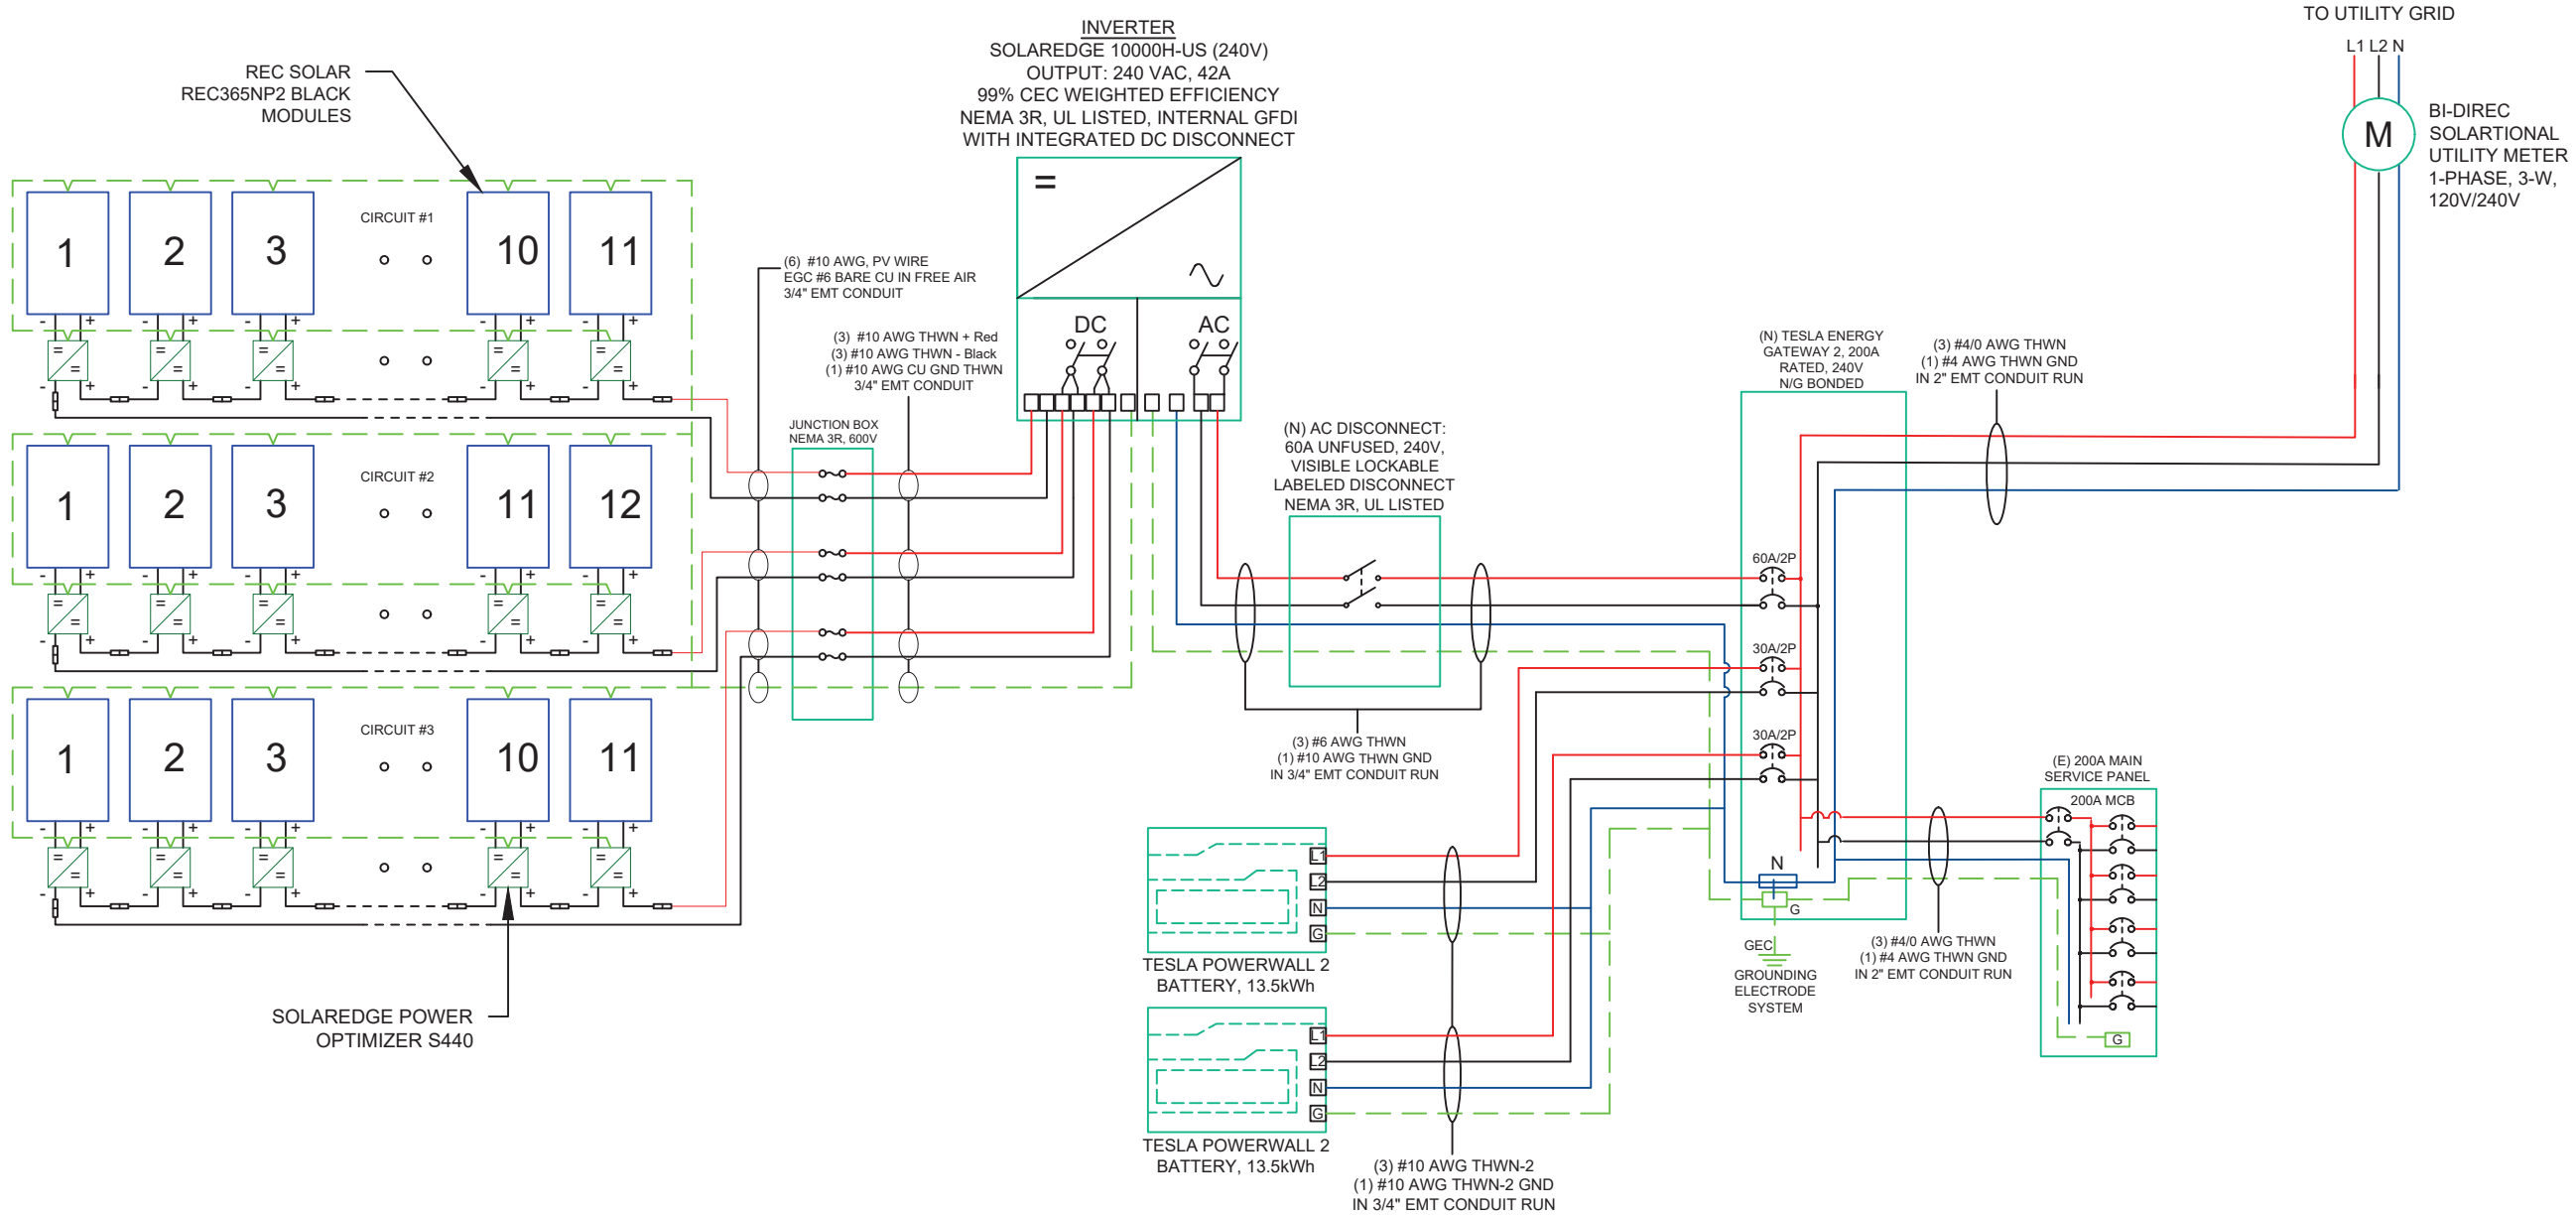

YES SOLAR SOLUTIONS

202 N. DIXON AVE.
 CARY, NC 27513
 LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

**FLOCKE
 RESIDENCE**
 256 ROLLING PINES DR
 SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
 AC SIZE: 10.000 KW

SHEET NAME
**ELECTRICAL
 LINE DIAGRAM**

SHEET SIZE

ANSI B
 11" X 17"

SHEET NUMBER

PV-4

1

ELECTRICAL LINE DIAGRAM

PV-4

SCALE: NTS

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL #	REC SOLAR REC365NP2 BLACK (365W) MODULES
VMP	34.3V
IMP	10.65A
VOC	40.9V
ISC	11.36A
MODULE DIMENSION	69.1"L x 40.94"W x 1.20"D (In Inch)

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL #	SOLAREEDGE SE10000H-US INVERTER
NOMINAL AC POWER	10.0 kW
NOMINAL OUTPUT VOLTAGE	240 VAC
NOMINAL OUTPUT CURRENT	42A

AMBIENT TEMPERATURE SPECS	
REC SOLARORD LOW TEMP	-10°
AMBIENT TEMP (HIGH TEMP 2%)	36°
CONDUIT HEIGHT	0.5"
ROOF TOP TEMP	58°
CONDUCTOR TEMPERATURE RATE	90°
MODULE TEMPERATURE COEFFICIENT OF Voc	-0.26%/°C

DC CONDUCTOR AMPACITY CALCULATIONS: ARRAY TO JUNCTION BOX :

EXPECTED WIRE TEMP (In Celsius)	36°
TEMP. CORREC SOLARTION PER TABLE (310.15)(B)(2)(a)	0.91
NO. OF CURRENT CARRYING CONDUCTORS	6
CONDUIT FILL CORREC SOLARTION PER NEC 310.15(B)(3)(a)	0.80
CIRCUIT CONDUCTOR SIZE	10 AWG
CIRCUIT CONDUCTOR AMPACITY	40A
REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(A&B)	18.75A
1.25 X MAX DC OUTPUT CURRENT	
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC (310.15)(B)(2)(a)	29.12A
TEMP. CORREC SOLARTION PER TABLE (310.15)(B)(2)(a) X CONDUIT FILL CORREC SOLARTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	
Result should be greater than (18.75A) otherwise less the entry for circuit conductor size and ampacity	

DC CONDUCTOR AMPACITY CALCULATIONS: FROM JUNCTION BOX TO INVERTER:

AMBIENT TEMPERATURE ADJUSTMENT FOR EXPOSED CONDUIT PER NEC 310.15(B)(2)(c)	+22°
EXPECTED WIRE TEMP (In Celsius)	36°+22° = 58°
TEMP. CORREC SOLARTION PER TABLE (310.15)(B)(2)(a)	0.71
NO. OF CURRENT CARRYING CONDUCTORS	6
CONDUIT FILL CORREC SOLARTION PER NEC 310.15(B)(3)(a)	0.80
CIRCUIT CONDUCTOR SIZE	10AWG
CIRCUIT CONDUCTOR AMPACITY	40A
REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(A&B)	18.75A
1.28 X MAX DC OUTPUT CURRENT	
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC (310.15)(B)(2)(a)	22.72A
TEMP. CORREC SOLARTION PER TABLE (310.15)(B)(2)(a) X CONDUIT FILL CORREC SOLARTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	
Result should be greater than (18.75A) otherwise less the entry for circuit conductor size and ampacity	

AC CONDUCTOR AMPACITY CALCULATIONS: FROM INVERTER TO POI :

No. OF INVERTER	1
EXPECTED WIRE TEMP (In Celsius)	34°
TEMP. CORREC SOLARTION PER TABLE (310.15)(B)(2)(a)	0.91
NO. OF CURRENT CARRYING CONDUCTORS	3
CONDUIT FILL CORREC SOLARTION PER NEC 310.15(B)(3)(a)	1
CIRCUIT CONDUCTOR SIZE	6AWG
CIRCUIT CONDUCTOR AMPACITY	75A
REQUIRED CIRCUIT CONDUCTOR AMPACITY PER NEC 690.8(B)	52.50A
1.28 X MAX INVERTER OUTPUT CURRENT	
DERATED AMPACITY OF CIRCUIT CONDUCTOR PER NEC (310.15)(B)(2)(a)	68.25A
TEMP. CORREC SOLARTION PER TABLE (310.15)(B)(2)(a) X CONDUIT FILL CORREC SOLARTION PER NEC 310.15(B)(3)(a) X CIRCUIT CONDUCTOR AMPACITY	
Result should be greater than (52.50A) otherwise less the entry for circuit conductor size and ampacity	



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

**FLOCKE
RESIDENCE**

256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
**WIRING
CALCULATIONS**

SHEET SIZE

**ANSI B
11" X 17"**

SHEET NUMBER

PV-5

ELECTRICAL NOTES

- 1.) ALL EQUIPMENT SHALL BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- 2.) ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90°C WET ENVIRONMENT.
- 3.) WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIREC SOLARTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- 4.) WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- 5.) DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEM. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS , AND ACCESSORIES TO MEET APPLICABLE CODES AND STANDARDS.
- 6.) WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- 7.) ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND ACCESSIBLE.
- 8.) INSTALL MODULE AND RACKING GROUNDING HARDWARE PER MANUFACTURER'S INSTRUCTION.

⚠ WARNING
ELECTRIC SHOCK HAZARD
 IF A GROUND FAULT IS INDICATED NORMALLY GROUNDED CONDUCTORS MAY BE UNGROUNDED AND ENERGIZED

LABEL LOCATION:
 DC DISCONNECT, INVERTER
 (PER CODE: CEC 690.35(F))
 [To be used when inverter is ungrounded]

⚠ WARNING
ELECTRIC SHOCK HAZARD
 THE DC CONDUCTORS OF THIS PHOTOVOLTAIC SYSTEM ARE UNGROUNDED AND MAY BE ENERGIZED

LABEL LOCATION:
 DC DISCONNECT, INVERTER
 (PER CODE: CEC 690.35(F))
 [To be used when inverter is ungrounded]

⚠ WARNING
ELECTRIC SHOCK HAZARD
 DO NOT TOUCH TERMINALS TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT

LABEL LOCATION:
 AC DISCONNECT, POINT OF INTERCONNECTION
 (PER CODE: CEC 690.17(E))

⚠ WARNING
ELECTRIC SHOCK HAZARD
 DO NOT TOUCH TERMINALS TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION:
 AC DISCONNECT, POINT OF INTERCONNECTION
 PER CODE: CEC 690.17(E), CB

⚡ WARNING - Electric Shock Hazard
 No user serviceable parts inside
 Contact authorized service provider for assistance

LABEL LOCATION:
 INVERTER, JUNCTION BOXES (ROOF), AC DISCONNECT
 (PER CODE: CEC690.13.G.3 & CEC 690.13.G.4)

WARNING: PHOTOVOLTAIC POWER SOURCE

LABEL LOCATION:
 CONDUIT, COMBINER BOX
 (PER CODE: CEC690.31(G)(3)(4) & CEC 690.13(G)(4))

- ADHESIVE FASTENED SIGNS:
- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
 - WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING].
 - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]

PHOTOVOLTAIC SYSTEM AC DISCONNECT
 RATED AC OPERATING CURRENT 42 AMPS
 AC NOMINAL OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION:
 AC DISCONNECT, POINT OF INTERCONNECTION
 (PER CODE: CEC690.54)

WARNING
 INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION:
 POINT OF INTERCONNECTION
 (PER CODE: CEC 705.12(D)(7))
 [Not required if panelboard is rated not less than sum of ampere ratings of all overcurrent devices supplying it]

CAUTION: SOLAR CIRCUIT

LABEL LOCATION:
 MARKINGS PLACED ON ALL INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, AND CABLE ASSEMBLIES AT LEAST EVERY 10 FT, AT TURNS AND ABOVE/BELOW PENETRATIONS AND ALL COMBINER/JUNCTION BOXES. (PER CODE: IFC605.11.1.4)

SOLAR DISCONNECT

LABEL LOCATION:
 DISCONNECT, POINT OF INTERCONNECTION
 (PER CODE: CEC690.13(B))

⚠ WARNING DUAL POWER SOURCE
 SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION:
 POINT OF INTERCONNECTION
 (PER CODE: CEC 705.12(D)(4))

CAUTION: SOLAR ELECTRIC SYSTEM CONNECTED

LABEL LOCATION:
 WEATHER RESISTANT MATERIAL, DURABLE ADHESIVE, UL969 AS STANDARD TO WEATHER RATING (UL LISTING OF MARKINGS NOT REQUIRED), MIN 3/16" LETTER HEIGHT ARIAL OR SIMILAR FONT NON-BOLD, PLACED WITHIN THE MAIN SERVICE DISCONNECT, PLACED ON THE OUTSIDE OF THE COVER WHEN DISCONNECT IS OPERABLE WITH SERVICE PANEL CLOSED.
 (PER CODE: CEC690.15, 690.13(B))

INVERTER

PHOTOVOLTAIC DC DISCONNECT

MAXIMUM SYSTEM VOLTAGE:	480	VDC
MAXIMUM CIRCUIT CURRENT:	45	ADC
MAX RATED OUTPUT CURRENT OF THE CHARGE CONTROLLER OR DC-TO-DC CONVERTER (IF INSTALLED):		ADC


LABEL LOCATION:
 INVERTER(S), DC DISCONNECT(S).
 PER CODE(S): NEC 2017: 690.53, NEC 2014: 690.53, NEC 2011: 690.53

WARNING
 DUAL POWER SOURCE
 NOMINAL AC OUTPUT CURRENT 42 AMPS
 NOMINAL AC OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION:
 POINT OF INTERCONNECTION
 (PER CODE: NEC 705.12(b)(2)(3)(c))

TURN OFF PHOTOVOLTAIC AC DISCONNECT PRIOR TO WORKING INSIDE PANEL

LABEL LOCATION:
 POINT OF INTERCONNECTION
 (PER CODE: Osha 1910.145)

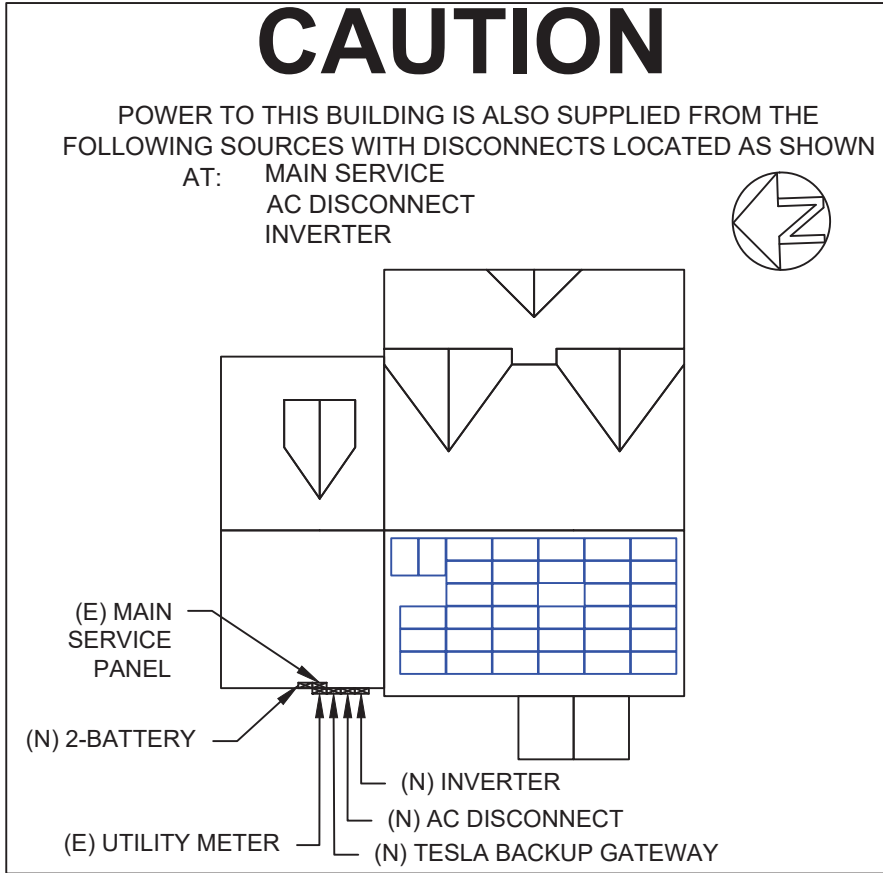

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY.

LABEL LOCATION:
 ON OR NO MORE THAT 1 M (3 FT) FROM THE SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED.
 PER CODE(S): NEC 2017: 690.56(C)(1)(a)

YES SOLAR SOLUTIONS
 YES SOLAR SOLUTIONS
 202 N. DIXON AVE.
 CARY, NC 27513
 LICENSE #: 67356

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS


FLOCKE RESIDENCE
 256 ROLLING PINES DR
 SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
 AC SIZE: 10.000 KW

SHEET NAME
 PLACARDS

SHEET SIZE
 ANSI B
 11" X 17"

SHEET NUMBER
 PV-6



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS


**FLOCKE
RESIDENCE**
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
**OPTIMIZER
CHART**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-7

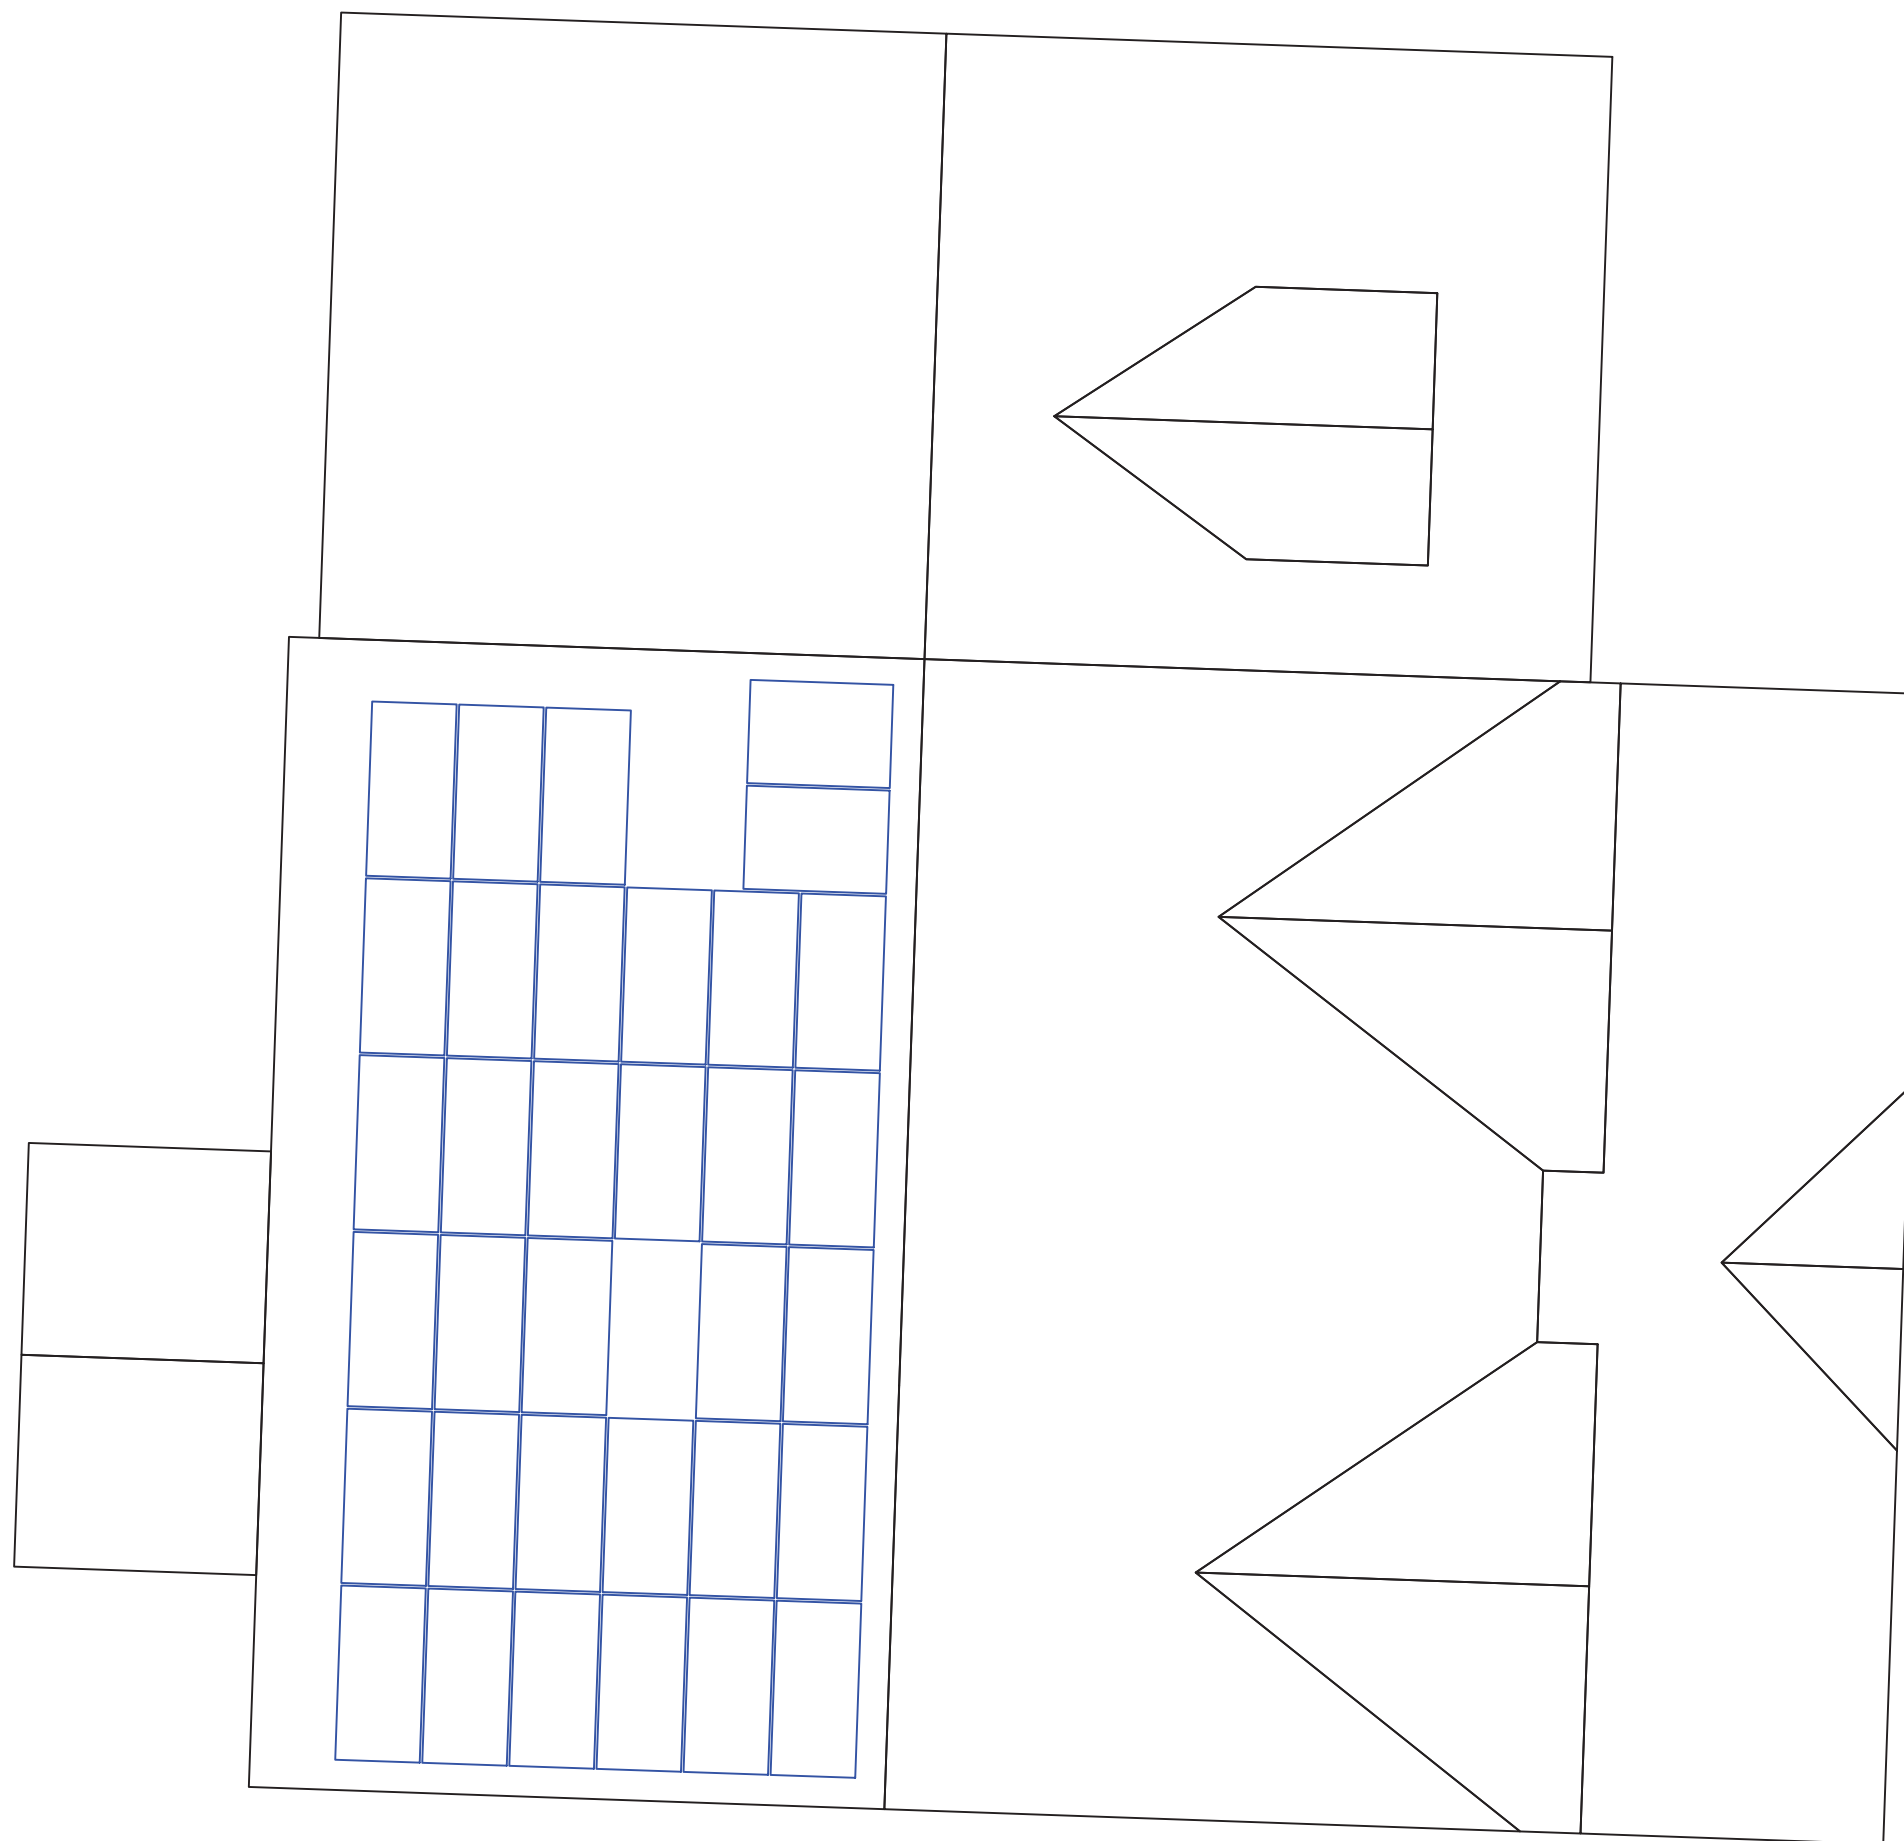


SOLAR'S MOST TRUSTED



REC N-PEAK 2 BLACK SERIES

PREMIUM FULL BLACK MONO N-TYPE SOLAR PANELS



MONO N-TYPE: THE MOST EFFICIENT C-SI TECHNOLOGY



NO LIGHT INDUCED DEGRADATION



SUPER-STRONG FRAME UP TO 7000 PA SNOW LOAD



FLEXIBLE INSTALLATION OPTIONS




FEATURING REC'S PIONEERING TWIN DESIGN




HIGH POWER FOR 25 YEARS

370 WP POWER

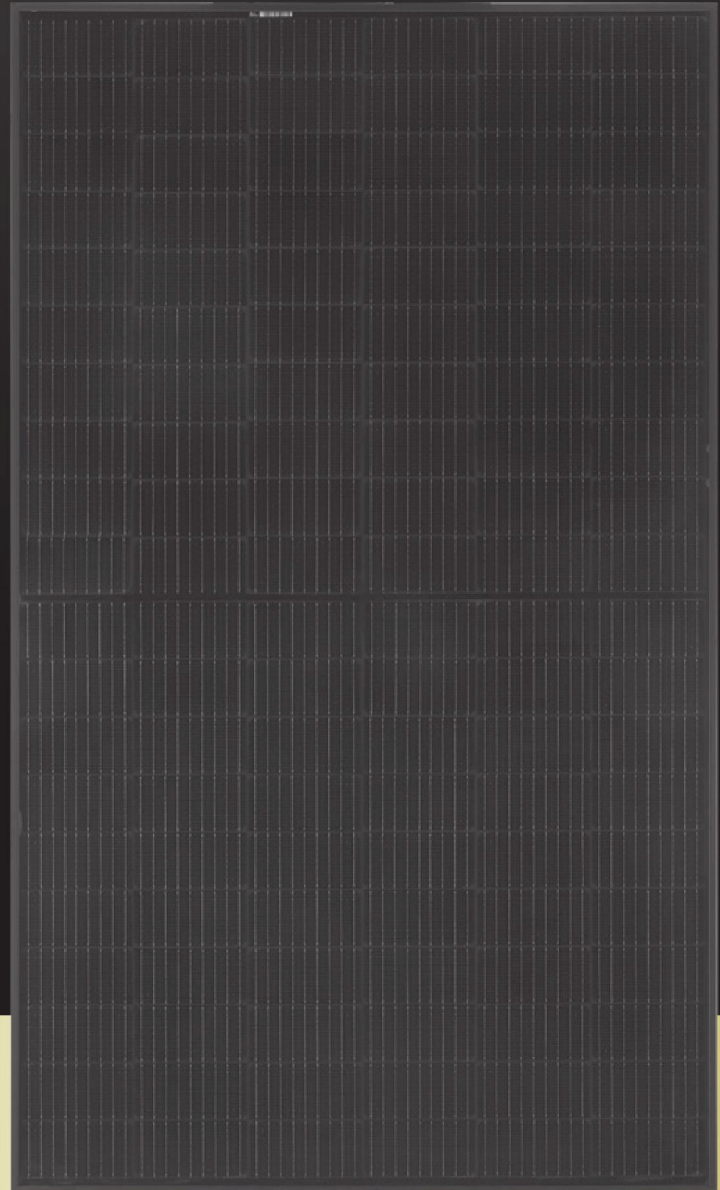

REC N-PEAK 2 BLACK SERIES

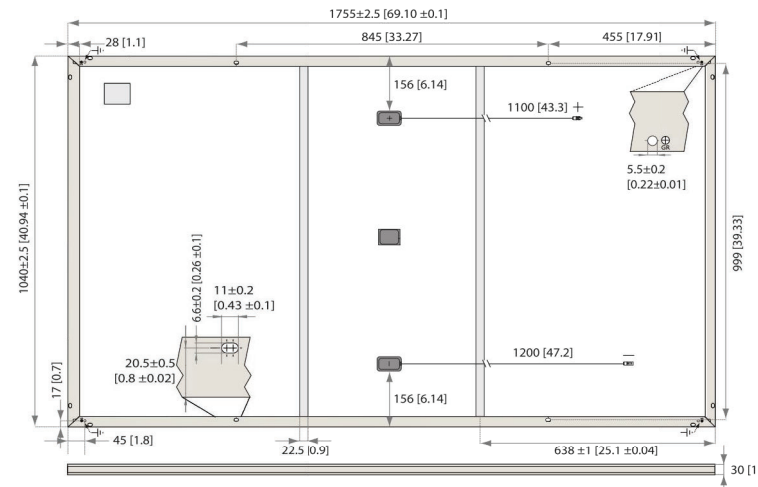

Measurements in mm [in]

ELECTRICAL DATA @ STC		Product code*: RECxxxNP2 Black			
Nominal Power - P _{MAX} (Wp)		355	360	365	370
Watt Class Sorting - (W)		0/+5	0/+5	0/+5	0/+5
Nominal Power Voltage - V _{MPP} (V)		33.5	33.9	34.3	34.7
Nominal Power Current - I _{MPP} (A)		10.60	10.62	10.65	10.68
Open Circuit Voltage - V _{OC} (V)		40.7	40.8	40.9	41.1
Short Circuit Current - I _{SC} (A)		11.27	11.31	11.36	11.41
Panel Efficiency (%)		19.4	19.7	20.0	20.3

Values at standard test conditions (STC: air mass AM1.5, irradiance 1000 W/m², temperature 25°C), based on a production spread with a tolerance of P_{MAX}, V_{OC}, & I_{SC} ±3% within one watt class. *Where xxx indicates the nominal power class (P_{MAX}) at STC above.

ELECTRICAL DATA @ NOCT		Product code*: RECxxxNP2 Black			
Nominal Power - P _{MAX} (Wp)		268	272	276	280
Nominal Power Voltage - V _{MPP} (V)		31.3	31.7	32.1	32.5
Nominal Power Current - I _{MPP} (A)		8.56	8.58	8.60	8.63
Open Circuit Voltage - V _{OC} (V)		38.1	38.2	38.2	38.4
Short Circuit Current - I _{SC} (A)		9.10	9.13	9.18	9.22

Nominal operating cell temperature (NOCT: air mass AM1.5, irradiance 800 W/m², temperature 20°C, windspeed 1 m/s). *Where xxx indicates the nominal power class (P_{MAX}) at STC above.

CERTIFICATIONS	
IEC 61215:2016, IEC 61730:2016, UL 61730 (Pending)	
ISO 14001:2004, ISO 9001:2015, OHSAS 18001:2007, IEC 62941	



	WARRANTY	
	Standard	REC ProTrust
Installed by an REC Certified Solar Professional	No	Yes
System size	any	<25 kW 25-500 kW
Product Warranty (yrs)	20	25
Power Warranty (yrs)	25	25
Labor Warranty (yrs)	0	25
Power in Year 1	98%	98%
Annual Degradation	0.25%	0.25%
Power in Year 25	92%	92%

See warranty documents for details. Some conditions apply.

GENERAL DATA

Cell type:	120 half-cut mono c-Si n-type cells 6 strings of 20 cells in series
Glass:	0.13" (3.2 mm) solar glass with anti-reflection surface treatment
Backsheet:	Highly resistant polymeric construction (black)
Frame:	Anodized aluminum (black)
Junction box:	3-part, 3 bypass diodes, IP68 rated in accordance with IEC 62790
Cable:	12 AWG (4 mm ²) PV wire, 43+47" (1.1m+1.2 m) in accordance with EN 50618
Connectors:	Stäubli MC4 PV-KBT4/KST4, 12 AWG (4 mm ²) in accordance with IEC 62852 IP68 only when connected
Origin:	Made in Singapore

MECHANICAL DATA

Dimensions:	69.1 x 40.94 x 1.2 in (1755 x 1040 x 30 mm)
Area:	19.70 sq ft (1.83 m ²)
Weight:	44.0 lbs (20.0 kg)

MAXIMUM RATINGS

Operational temperature:	-40 ... +85°C
Maximum system voltage:	1000 V
Maximum test load (front):	+7000 Pa (146 psf)*
Maximum test load (rear):	-4000 Pa (83.5 psf)*
Max series fuse rating:	25 A
Max reverse current:	25 A

* See installation manual for mounting instructions. Design load = Test load / 1.5 (safety factor)


TEMPERATURE RATINGS*

Nominal Operating Cell Temperature:	44.3°C (±2°C)
Temperature coefficient of P _{MAX} :	-0.34 %/°C
Temperature coefficient of V _{OC} :	-0.26 %/°C
Temperature coefficient of I _{SC} :	0.04 %/°C

*The temperature coefficients stated are linear values

LOW LIGHT BEHAVIOUR

Typical low irradiance performance of module at STC.

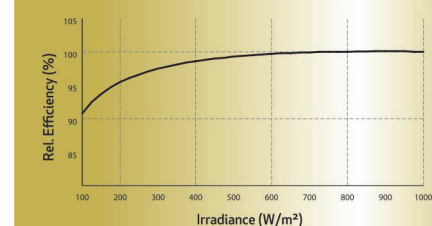

Specifications subject to change without notice.

Ref: PM-DS-11-05-Rev-A 07.21

Founded in 1996, REC Group is an international pioneering solar energy company dedicated to empowering consumers with clean, affordable solar power. As Solar's Most Trusted, REC is committed to high quality, innovation, and a low carbon footprint in the solar materials and solar panels it manufactures. Headquartered in Norway with operational headquarters in Singapore, REC also has regional hubs in North America, Europe, and Asia-Pacific.



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

FLOCKE RESIDENCE

256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
EQUIPMENT SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-8

Power Optimizer For Residential Installations

S440, S500



POWER OPTIMIZER


/ Power Optimizer For Residential Installations S440, S500

	S440	S500	UNIT
Rated Input DC Power ⁽¹⁾	440	500	W
Absolute Maximum Input Voltage (Voc)		60	Vdc
MPPT Operating Range		8 - 60	Vdc
Maximum Short Circuit Current (Isc) of Connected PV Module	14.5	15	Adc
Maximum Efficiency		99.5	%
Weighted Efficiency		98.6	%
Overtoltage Category		II	
OUTPUT DURING OPERATION			
Maximum Output Current		15	Adc
Maximum Output Voltage		60	Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM INVERTER OR INVERTER OFF)			
Safety Output Voltage per Power Optimizer		1	Vdc
STANDARD COMPLIANCE			
EMC	FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3, CISPR11, EN-55011		
Safety	IEC62109-1 (class II safety), UL1741		
Material	UL94 V-0, UV Resistant		
RoHS	Yes		
Fire Safety	VDE-AR-E 2100-712:2013-05		
INSTALLATION SPECIFICATIONS			
Maximum Allowed System Voltage		1000	Vdc
Dimensions (W x L x H)		129 x 155 x 30	mm
Weight (including cables)		655 / 1.5	gr / lb
Input Connector	MC4 ⁽²⁾		
Input Wire Length		0.1	m
Output Connector	MC4		
Output Wire Length		(+) 2.3, (-) 0.10	m
Operating Temperature Range ⁽³⁾		-40 to +85	°C
Protection Rating		IP68 / NEMA6P	
Relative Humidity		0 - 100	%

(1) Rated power of the module at STC will not exceed the Power Optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed.
 (2) For other connector types please contact SolarEdge.
 (3) For ambient temperature above +70°C / +158°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details.

PV System Design Using a SolarEdge Inverter		Single Phase HD-Wave	Three Phase	Three Phase for 277/480V Grid	
Minimum String Length (Power Optimizers)	S440, S500	8	16	18	
Maximum String Length (Power Optimizers)		25	50		
Maximum Nominal Power per String ⁽⁴⁾		5700	11250 ⁽⁵⁾	12750 ⁽⁶⁾	W
Parallel Strings of Different Lengths or Orientations			Yes		

(4) If the inverters rated AC power ≤ maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power. Refer to: <https://www.solaredge.com/sites/default/files/se-power-optimizer-single-string-design-application-note.pdf>
 (5) For the 230/400V grid: it is allowed to install up to 13,500W per string when the maximum power difference between each string is 2,000W
 (6) For the 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W
 (7) It is not allowed to mix S-series and P-series Power Optimizers in new installations

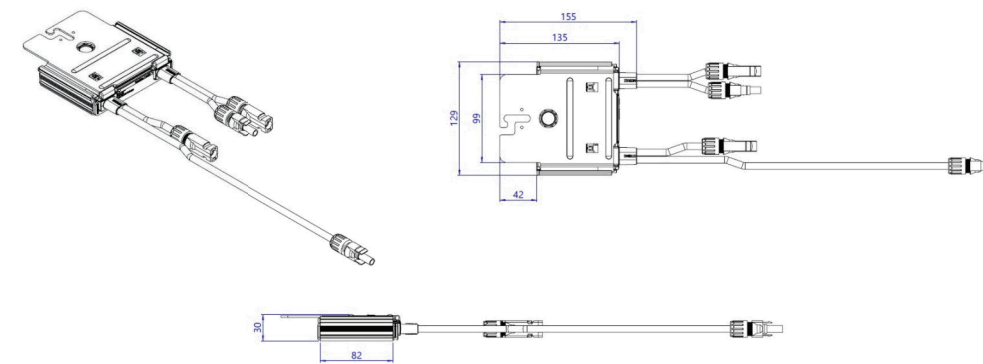

Enabling PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Detects abnormal PV connector behavior, preventing potential safety issues*
- Faster installations with simplified cable management and easy assembly using a single bolt
- Module-level voltage shutdown for installer and firefighter safety
- Flexible system design for maximum space utilization
- Superior efficiency (99.5%)
- Compatible with bifacial PV modules

* Functionality subject to inverter model and firmware version

solaredge.com



© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/2021 DS-000091-1.2-ENG. Subject to change without notice.

CE RoHS



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

FLOCKE
RESIDENCE
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-9

Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US



12-25
YEAR
WARRANTY

INVERTERS

Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking efficiency
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014 and 2017, per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Extremely small
- Built-in module-level monitoring
- Outdoor and indoor installation
- Optional: Revenue grade data, ANSI C12.20 Class 0.5 (0.5% accuracy)

solaredge.com

Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US		
OUTPUT									
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac	
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac	
AC Frequency (Nominal)	59.3 - 60 - 60.5 ¹⁾							Hz	
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A	
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A	
GFDI Threshold	1							A	
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes								
INPUT									
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W	
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W	
Transformer-less, Ungrounded	Yes								
Maximum Input Voltage	480							Vdc	
Nominal DC Input Voltage	380			400				Vdc	
Maximum Input Current @240V ²⁾	8.5	10.5	13.5	16.5	20	27	30.5	Adc	
Maximum Input Current @208V ²⁾	-	9	-	13.5	-	-	27	Adc	
Max. Input Short Circuit Current	45							Adc	
Reverse-Polarity Protection	Yes								
Ground-Fault Isolation Detection	600k α Sensitivity								
Maximum Inverter Efficiency	99	99.2						%	
CEC Weighted Efficiency	99						99 @ 240V 98.5 @ 208V	%	
Nighttime Power Consumption	< 2.5							W	
ADDITIONAL FEATURES									
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)								
Revenue Grade Data, ANSI C12.20	Optional ³⁾								
Rapid Shutdown - NEC 2014 and 2017 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect								
STANDARD COMPLIANCE									
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.I.L. M-07								
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (HI)								
Emissions	FCC Part 15 Class B								
INSTALLATION SPECIFICATIONS									
AC Output Conduit Size / AWG Range	1" Maximum / 14-6 AWG				1" Maximum /14-4 AWG				
DC Input Conduit Size / # of Strings / AWG Range	1" Maximum / 1-2 strings / 14-6 AWG				1" Maximum / 1-3 strings / 14-6 AWG				
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 6.8 / 450 x 370 x 174				21.3 x 14.6 x 7.3 / 540 x 370 x 185				in / mm
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.9	38.8 / 17.6				lb / kg	
Noise	< 25				<50				dBA
Cooling	Natural Convection								
Operating Temperature Range	-13 to +140 / -25 to +60 ⁴⁾ (-40 ⁴⁾ / -40 ⁴⁾ option ⁵⁾							°F / °C	
Protection Rating	NEMA 4X (Inverter with Safety Switch)								

¹⁾ For other regional settings please contact SolarEdge support

²⁾ A higher current source may be used; the inverter will limit its input current to the values stated

³⁾ Revenue grade inverter P/N: SExxxx-1-US000NNC2

⁴⁾ For power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>

⁵⁾ -40 version P/N: SExxxxH-US000NNU4

© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 03/2019/V01/ENG NAM. Subject to change without notice.

RoHS

YES SOLAR SOLUTIONS

YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

FLOCKE
RESIDENCE
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-10

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

FLOCKE RESIDENCE
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
EQUIPMENT SPECIFICATION

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-11

POWERWALL

Backup Gateway 2

The Backup Gateway 2 for Tesla Powerwall provides energy management and monitoring for solar self-consumption, time-based control, and backup.

The Backup Gateway 2 controls connection to the grid, automatically detecting outages and providing a seamless transition to backup power. When equipped with a main circuit breaker, the Backup Gateway 2 can be installed at the service entrance. When the optional internal panelboard is installed, the Backup Gateway 2 can also function as a load center.

The Backup Gateway 2 communicates directly with Powerwall, allowing you to monitor energy use and manage backup energy reserves from any mobile device with the Tesla app.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Input Short Circuit Current	10 kA ¹
Overcurrent Protection Device	100-200A; Service Entrance Rated ¹
Overvoltage Category	Category IV
AC Meter	Revenue accurate (+/- 0.2 %)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) ²
User Interface	Tesla App
Operating Modes	Support for solar self-consumption, time-based control, and backup
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200A 6-space / 12 circuit Eaton BR Circuit Breakers
Warranty	10 years

¹ When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.


² The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

COMPLIANCE INFORMATION

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 149 mm (26 in x 16 in x 6 in)
Weight	20.4 kg (45 lb)
Mounting options	Wall mount Semi-flush mount

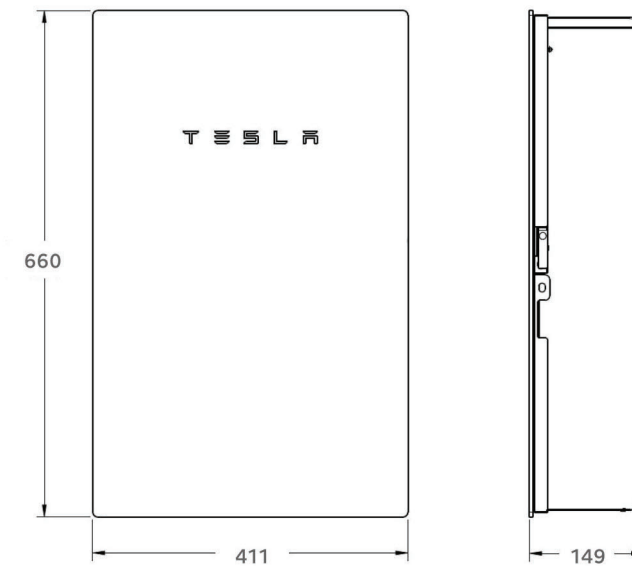

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

POWERWALL

Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, time-based control, and backup.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240 V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Total Energy	14 kWh
Usable Energy	13.5 kWh
Real Power, max continuous	5 kW (charge and discharge)
Real Power, peak (10 s, off-grid/backup)	7 kW (charge and discharge)
Apparent Power, max continuous	5.8 kVA (charge and discharge)
Apparent Power, peak (10 s, off-grid/backup)	7.2 kVA (charge and discharge)
Maximum Supply Fault Current	10 kA
Maximum Output Fault Current	32 A
Overcurrent Protection Device	30 A
Imbalance for Split-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor Range (full-rated power)	+/- 0.85
Internal Battery DC Voltage	50 V
Round Trip Efficiency ^{1,3}	90%
Warranty	10 years

¹Values provided for 25°C (77°F), 3.3 kW charge/discharge power.
²In Backup mode, grid charge power is limited to 3.3 kW.
³AC to battery to AC, at beginning of life.


COMPLIANCE INFORMATION

Certifications	UL 1642, UL 1741, UL 1973, UL 9540, IEEE 1547, UN 38.3
Grid Connection	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)

MECHANICAL SPECIFICATIONS

Dimensions ¹	1150 mm x 755 mm x 147 mm (45.3 in x 29.6 in x 5.75 in)
Weight ¹	114 kg (251.3 lbs)
Mounting options	Floor or wall mount

¹Dimensions and weight differ slightly if manufactured before March 2019. Contact Tesla for additional information.

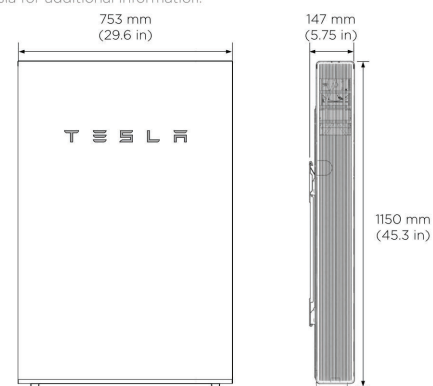


ENVIRONMENTAL SPECIFICATIONS


Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Recommended Temperature	0°C to 30°C (32°F to 86°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Conditions	-20°C to 30°C (-4°F to 86°F) Up to 95% RH, non-condensing State of Energy (SoE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP56 (Wiring Compartment)
Wet Location Rating	Yes
Noise Level @ 1m	< 40 dBA at 30°C (86°F)

TYPICAL SYSTEM LAYOUTS

WHOLE HOME BACKUP

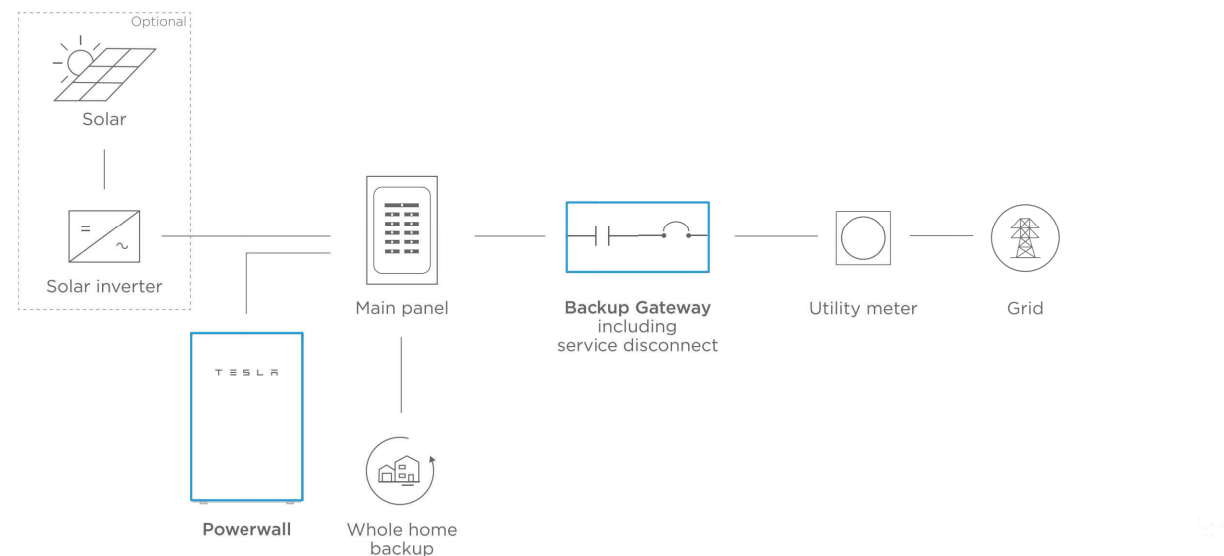

PARTIAL HOME BACKUP

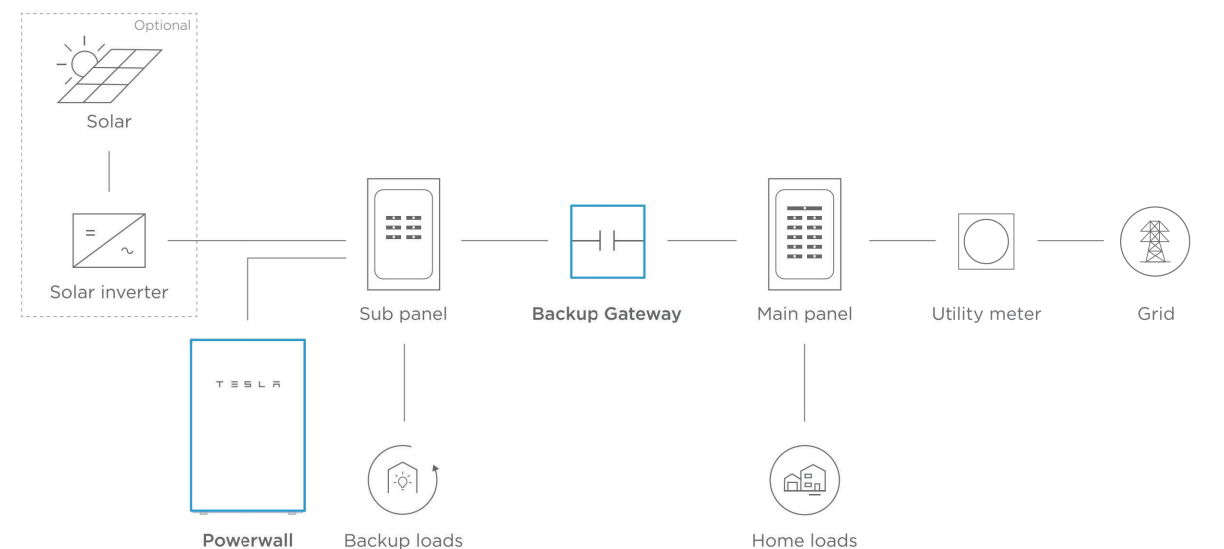

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

FLOCKE RESIDENCE
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
EQUIPMENT SPECIFICATION


SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-12

DESCRIPTION: SNAPNRACK, ULTRA RAIL COMP KIT	DRAWN BY: mwatkins	
PART NUMBER(S): SEE BELOW	REVISION: B	

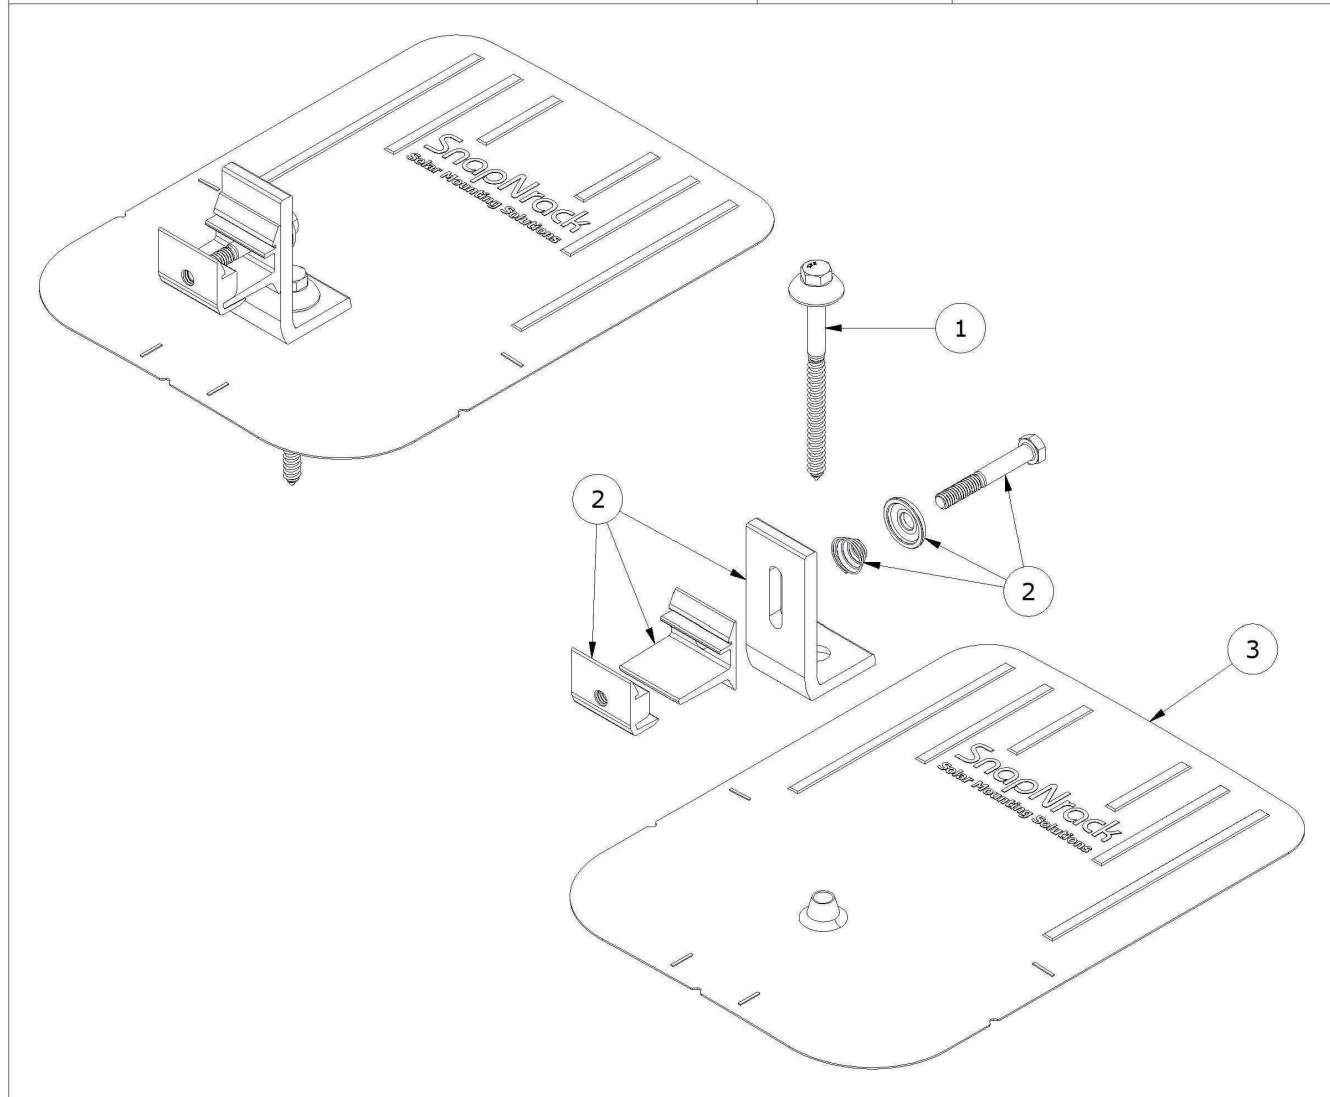

PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	242-92266	SNAPNRACK, UMBRELLA LAG, TYPE 3, 4IN, SS
2	1	242-01219, 242-01220	SNAPNRACK, ULTRA FOOT FOR U FLASHING, SILVER / BLACK
3	1	232-01375, 232-01376	SNAPNRACK, COMP FLASHING, 9IN X 12IN, SILVER / BLACK ALUM

MATERIALS:	6000 SERIES ALUMINUM, STAINLESS STEEL, RUBBER
DESIGN LOAD (LBS):	802 UP, 1333 DOWN, 356 SIDE
ULTIMATE LOAD (LBS):	2005 UP, 4000 DOWN, 1070 SIDE
TORQUE SPECIFICATION:	12 LB-FT
CERTIFICATION:	UL 2703, FILE E359313; WIND-DRIVEN RAIN TEST FROM UL SUBJECT 2582
WEIGHT (LBS):	0.80

DESCRIPTION: SNAPNRACK, ULTRA RAIL COMP KIT	DRAWN BY: mwatkins	
PART NUMBER(S): SEE BELOW	REVISION: B	

UMBRELLA L FOOT PROPERTIES	
SKU	DESCRIPTION
242-01219	ULTRA RAIL UMBRELLA L FOOT, SILVER
242-01220	ULTRA RAIL UMBRELLA L FOOT, BLACK

COMP FLASHING PROPERTIES	
SKU	DESCRIPTION
232-01375	COMP FLASHING, 9" X 12", BLACK ALUM
232-01376	COMP FLASHING, 9" X 12", SILVER ALUM

ALL DIMENSIONS IN INCHES



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

**FLOCKE
RESIDENCE**
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW


SHEET NAME
**EQUIPMENT
SPECIFICATION**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-13

DESCRIPTION: SNAPNRACK, UR-60 RAIL	DRAWN BY: mwatkins	 595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 580-6900 • FAX (415) 580-6902 <small>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</small>
PART NUMBER(S): 232-02481, 232-02482, 232-02483	REVISION: A	

UR-60 RAIL PROPERTIES	
SKU	FINISH
232-02481	MILL
232-02482	CLEAR
232-02483	BLACK

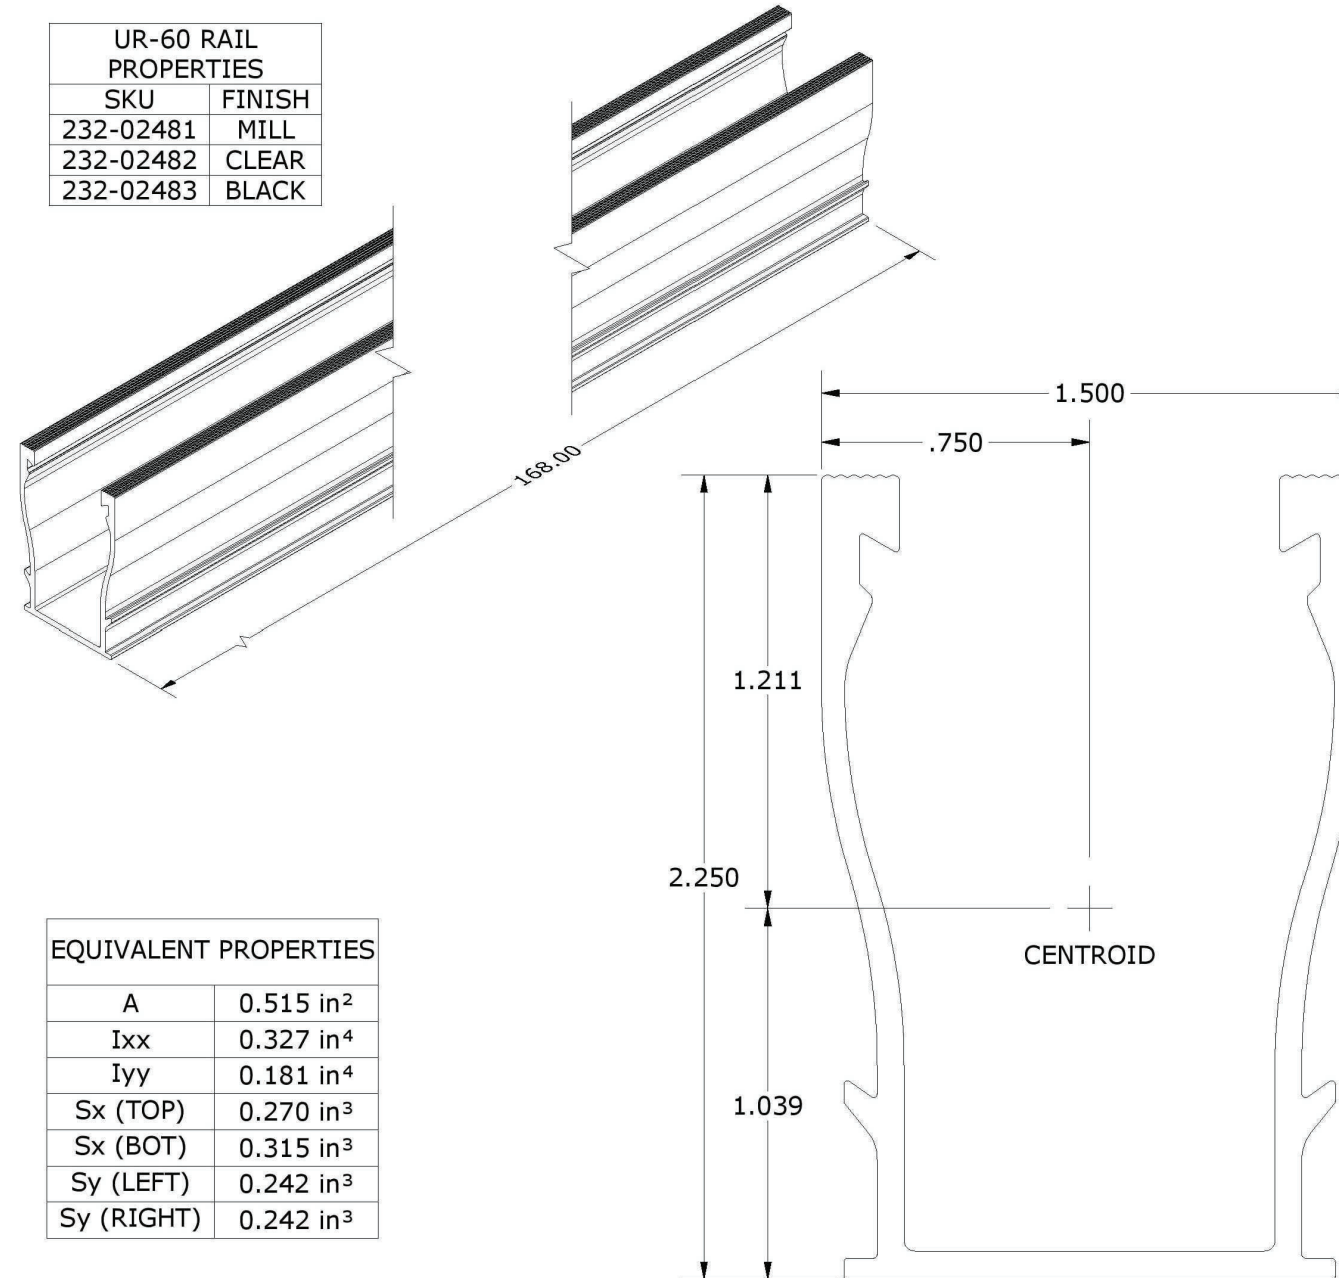

EQUIVALENT PROPERTIES	
A	0.515 in ²
I _{xx}	0.327 in ⁴
I _{yy}	0.181 in ⁴
S _x (TOP)	0.270 in ³
S _x (BOT)	0.315 in ³
S _y (LEFT)	0.242 in ³
S _y (RIGHT)	0.242 in ³

ALL DIMENSIONS IN INCHES		
MATERIALS:	6000 SERIES ALUMINUM	OPTIONS:
DESIGN LOAD (LBS):	N/A	CLEAR / BLACK ANODIZED
ULTIMATE LOAD (LBS):	N/A	MILL FINISH
TORQUE SPECIFICATION:	N/A LB-FT	BUNDLES OF 120
CERTIFICATION:	UL 2703, FILE E359313	BOXES OF 8
WEIGHT (LBS):	8.46	



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
CARY, NC 27513
LICENSE #: 67356

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

**FLOCKE
RESIDENCE**
256 ROLLING PINES DR
SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
AC SIZE: 10.000 KW

SHEET NAME
**EQUIPMENT
SPECIFICATION**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-14

CERTIFICATE OF COMPLIANCE

Certificate Number 20190404-E359313
Report Reference E359313-20171106
Issue Date 2019-APRIL-04

Issued to: SUNRUN SOUTH LLC, DBA SNAPNRACK
 775 Fiero Ln
 Suite 200
 San Luis Obispo CA 93401

This certificate confirms that representative samples of MOUNTING SYSTEMS, MOUNTING DEVICES, CLAMPING DEVICES AND GROUND LUGS FOR USE WITH PHOTOVOLTAIC MODULES AND PANELS
 See Addendum Page

Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.

Standard(s) for Safety: ANSI/UL 2703 - Mounting Systems, Mounting Devices, Clamping/Retention Devices, And Ground Lugs for use with Flat-Plate Photovoltaic Modules and Panels.

Additional Information: See the UL Online Certifications Directory at <https://iq.ulprospector.com> for additional information.

This *Certificate of Compliance* does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.


 Bruce Mahrenholz, Director North American Certification Program
 UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



CERTIFICATE OF COMPLIANCE

Certificate Number 20190404-E359313
Report Reference E359313-20171106
Issue Date 2019-APRIL-04

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Ultra Rail Mounting Systems

UR-40 Mounting and Bonding Systems for use with Photovoltaic Modules, consisting of the following components: UR-40 Rail, Mid Clamp, X End Clamp, Universal End Clamp, UR-40 Splice, Composition Mount Kits, Standard Standoff, Four Hole Standoff, Heavy Duty Standoff, Metal Roof Base Standoff, Corrugated Block, Standard Base Seam Clamp, Wide Base Seam Clamp, Universal Tile Hook, Flat Tile Hook, Tile Hook F, Tile Hook WS, Flat Tile Replacement Kit, S Tile Replacement Kit, W Tile Replacement Kit, Hanger Bolt Clamp, Ground Lugs, Skirt Assembly, MLPE Frame Attachment Kit, MLPE Rail Attachment Kit, Smart Clips, Tilt Kits.

UR-60 Mounting and Bonding Systems for use with Photovoltaic Modules, consisting of the same components as UR-40, except for UR-60 Rail and UR-60 Splice.


 Bruce Mahrenholz, Director North American Certification Program
 UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



YES SOLAR SOLUTIONS

202 N. DIXON AVE.
 CARY, NC 27513
 LICENSE #: 67356

REVISIONS

DESCRIPTION	DATE	REV
INITIAL	05/03/2022	A

Signature with Seal

PROJECT NAME & ADDRESS

FLOCKE
 RESIDENCE
 256 ROLLING PINES DR
 SPRING LAKE, NC 28390

DC SIZE: 12.410 KW
 AC SIZE: 10.000 KW

SHEET NAME
 EQUIPMENT SPECIFICATION

SHEET SIZE

ANSI B
 11" X 17"

SHEET NUMBER

PV-15