



December 8, 2021

BES Project Number: 5078 Somer Jordan

Power Home Solar, LLC
919 N Main St.
Mooresville, NC 28115

**Project Location: Somer Jordan: 132 Crutchfield Dr., Cameron, NC 28326
Solar Array Installation**

To Whom It May Concern:

Per your request, BES has reviewed the existing structure at the above referenced location. The purpose of this review was to determine the adequacy of the existing structure to support the proposed installation of solar panels on the roof as shown on the attached panel layout plan.

Based upon our review, we certify that existing roof structure will adequately support with the following: Racking and attachment mounting connection: (1) 5/16" lag screw w/ min. 2.5" embedment into framing at max 48" o/c along rails (2) rails per row of panels, evenly spaced; panel length perpendicular to the rails not to exceed 67 in. Solar module mounting hardware design is by the manufacturer.

Limitations: Installation of the solar panels must be performed in accordance with manufacturer recommendations. All work performed must be in accordance with accepted industry-wide methods and applicable safety standards. The contractor must notify BES should any damage, deterioration or discrepancies between the as-built condition of the structure and the condition described in this letter be found. Connections to existing roof framing must be staggered, except at array ends, so as to not overload any existing structural member. The design of the solar panel racking (mounts, rails, etc.) is the responsibility of the manufacturer. Waterproofing around the roof penetrations is the responsibility of others. BES assumes no responsibility for improper installation of the solar array. Existing structure meets or exceeds standard building practices with current building code with assumed single layer asphalt shingles.

Sincerely,



Jerme Bowers M.E., P.E.
Principal Engineer

Bowers Engineering Services
121 S. Main ST
Auburn, IN
(260) 333-0900


Structural Analysis

Location

132 Crutchfield Dr
Cameron, NC 28326

Roof Mount Solar

12/8/2021

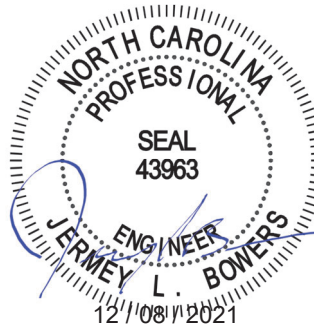

Project: 5078

Rev: -

| | | | |
|---|-----------------------------|-----------------|-------------|
| BES 121 South Main ST Auburn, IN | | Date: 12/8/2021 | Connections |
| Cust. Name: | Bowers Engineering Services | Subject: | Roof Mount |
| Job Number: | 5078 | Originator: | 0 |
| <u>STRUCTURAL SUMMARY</u> | | | |
| <u>CODE SPEC</u> | | | |
| WIND | | | |
| IBC 2015 | | Speed: | 118 MPH |
| ASCE 7-10 | | Exp.: | C |
| Risk Cat: | II | | |

Wind Load - uplift

| | | Max lb |
|----------|------------|------------|
| Zone 1 | -25.07 psf | -168.47 lb |
| Zone 2 | -46.96 psf | -315.58 lb |
| Zone 3 | -72.03 psf | -484.05 lb |
| Max trib | 11.20 ft2 | |

Max loading at connection

Negative -484.05 lb/fastener

Connection (Pull Out)

| | | | |
|------------------------|-------------------|---|-------------------------|
| Lag screw | 5/16 in | | |
| Cd | 1.60 Table 2.3.2 | | |
| embedment | 2.5 in | | |
| Nominal CapacityPrying | 205.00 lbs G=0.42 | | |
| Max capacity (lbs) | 533.00 | > | 484.05 OK |

Note:


* Lag screws to be diameter 5/16x2.5inches long.

* All fasteners need to be placed at roof rafters.

| | | | |
|--|-----------------------------|-------------------------------|------------|
| BES 121 South Main ST Auburn, IN | | WIND LOADING Per ASCE 7-10 | |
| Cust Name: | Bowers Engineering Services | Subject: | Roof Mount |
| Job Number: | 5078 | Originator: | 0 |
| | | Checker: | |

Input Data:

| | | |
|------------------------|---------|---------------------------------------|
| Wind Speed, V = | 118 | mph (Wind Map, Figure 26.5-1A-C) |
| Bldg. Classification = | II | (Table 1-1 Occupancy Category) |
| Exposure Category = | C | (Sect. 26.7) |
| Ridge Height, hr = | 24.89 | ft. (hr >= he) |
| Eave Height, he = | 20.00 | ft. (he <= hr) |
| Building Width = | 29.33 | ft. (Normal to Building Ridge) |
| Building Length = | 58.75 | ft. (Parallel to Building Ridge) |
| Roof Type = | Gable | (Gable or Monoslope) |
| Topo. Factor, Kzt = | 1.00 | (Sect. 26.8 & Figure 26.8-1) |
| Direct. Factor, Kd = | 0.85 | (Table 26.6) |
| Enclosed? (Y/N) | Y | (Sect. 28.6-1 & Figure 26.11-1) |
| Hurricane Region? | N | |
| Component Name = | Decking | (Purlin, Joist, Decking, or Fastener) |
| Effective Area, Ae = | 11.1 | ft.^2 (Area Tributary to C&C) |
| Overhangs? (Y/N) | N | (if used, overhangs on all sides) |

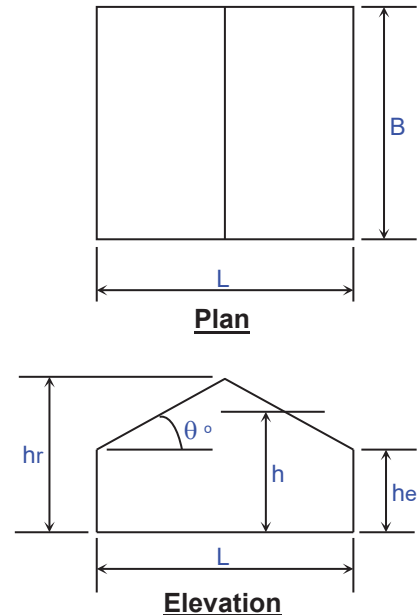

Resulting Parameters and Coefficients:

| | | |
|------------------------|-------|--|
| Roof Angle, θ = | 18.43 | deg. |
| Mean Roof Ht., h = | 22.44 | ft. (h = (hr+he)/2, for roof angle >10 deg.) |

Roof External Pressure Coefficients, GCp:

| | | |
|---------------------|-------|--------------------------------------|
| GCp Zone 1-3 Pos. = | 0.49 | (Fig. 30.4-2A, 30.4-2B, and 30.4-2C) |
| GCp Zone 1 Neg. = | -0.90 | (Fig. 30.4-2A, 30.4-2B, and 30.4-2C) |
| GCp Zone 2 Neg. = | -1.68 | (Fig. 30.4-2A, 30.4-2B, and 30.4-2C) |
| GCp Zone 3 Neg. = | -2.57 | (Fig. 30.4-2A, 30.4-2B, and 30.4-2C) |

Positive & Negative Internal Pressure Coefficients, GCpi (Figure 26.11-1):

| | | |
|---------------|------|------------------------------|
| +GCpi Coef. = | 0.00 | (positive internal pressure) |
| -GCpi Coef. = | 0.00 | (negative internal pressure) |

If $z \leq 15$ then: $K_z = 2.01 \cdot (15/z_g)^{2/\alpha}$, If $z > 15$ then: $K_z = 2.01 \cdot (z/z_g)^{2/\alpha}$ (Table 30.3-1)

| | | |
|------------|------|--------------------------------------|
| α = | 9.50 | (Table 26.9-1) |
| z_g = | 900 | (Table 26.9-1) |
| K_h = | 0.92 | ($K_h = K_z$ evaluated at $z = h$) |

Velocity Pressure: $q_z = 0.00256 \cdot K_z \cdot K_{zt} \cdot K_d \cdot V^2$ (Sect. 30.3.2, Eq. 30.3-1)

| | | | |
|---------|-------|-----|---|
| q_h = | 28.00 | psf | $q_h = 0.00256 \cdot K_h \cdot K_{zt} \cdot K_d \cdot V^2$ (q_z evaluated at $z = h$) |
|---------|-------|-----|---|

Design Net External Wind Pressures (Sect. 30.4 & 30.6):

For $h \leq 60$ ft.: $p = q_h \cdot ((GCp) - (+/-GCpi))$ (psf)

For $h > 60$ ft.: $p = q \cdot ((GCp) - qi \cdot (+/-GCpi))$ (psf)

where: $q = q_h$ for roof

$qi = q_h$ for roof (conservatively assumed per Sect. 30.6)

| Wind Load Tabulation for Roof Components & Cladding | | | | | | | | |
|---|--------------------------|----------------|-------------------------|--------------------------------|------------|------------|------------|--------|
| Component | z (ft.) | K _h | q _h (psf) | p = Net Design Pressures (psf) | | | | |
| | | | | Zone 1,2,3 (+) | Zone 1 (-) | Zone 2 (-) | Zone 3 (-) | |
| Decking | 0 | 0.92 | 28.00 | 13.74 | -25.07 | -46.96 | -72.03 | |
| | 15.00 | 0.92 | 28.00 | 13.74 | -25.07 | -46.96 | -72.03 | |
| | 20.00 | 0.92 | 28.00 | 13.74 | -25.07 | -46.96 | -72.03 | |
| | For z = h _r : | 24.89 | 0.92 | 28.00 | 13.74 | -25.07 | -46.96 | -72.03 |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| For z = h _e : | 20.00 | 0.92 | 28.00 | 13.74 | -25.07 | -46.96 | -72.03 | |
| For z = h: | 22.44 | 0.92 | 28.00 | 13.74 | -25.07 | -46.96 | -72.03 | |

- Notes: 1. (+) and (-) signs signify wind pressures acting toward & away from respective surfaces.
2. Width of Zone 2 (edge), 'a' =


| |
|------|
| 3.00 |
|------|

 ft.
3. Width of Zone 3 (corner), 'a' =


| |
|------|
| 3.00 |
|------|

 ft.
4. For monoslope roofs with $\theta \leq 3$ degrees, use Fig. 30.4-2A for 'G_{Cp}' values with 'q_h'.
5. For buildings with h > 60' and $\theta > 10$ degrees, use Fig. 30.6-1 for 'G_{Cpi}' values with 'q_h'.
6. For all buildings with overhangs, use Fig. 30.4-2B for 'G_{Cp}' values per Sect. 30.10.
7. If a parapet $\geq 3'$ in height is provided around perimeter of roof with $\theta \leq 10$ degrees, Zone 3 shall be treated as Zone 2.
8. **Per Code Section 30.2.2, the minimum wind load for C&C shall not be less than 16 psf.**
9. References : a. ASCE 7-02, "Minimum Design Loads for Buildings and Other Structures".
 b. "Guide to the Use of the Wind Load Provisions of ASCE 7-02"
 by: Kishor C. Mehta and James M. Delahay (2004).

Roof Components and Cladding:

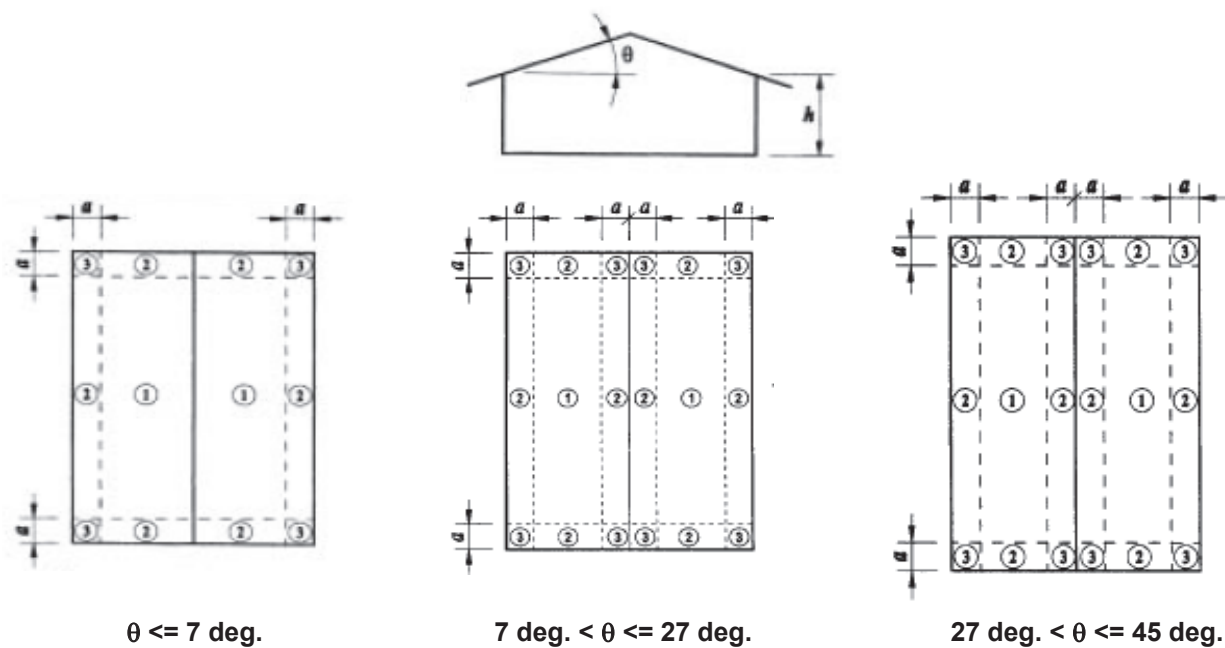

Roof Zones for Buildings with $h \leq 60$ ft.
 (for Gable Roofs $\leq 45^\circ$ and Monoslope Roofs $\leq 3^\circ$)

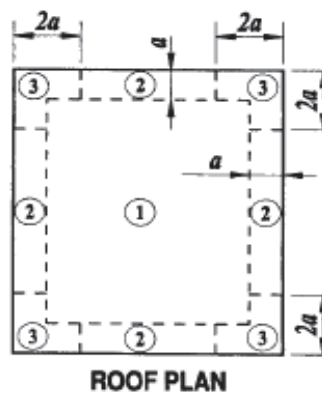

Roof Zones for Buildings with $h > 60$ ft.
 (for Gable Roofs $\leq 10^\circ$ and Monoslope Roofs $\leq 3^\circ$)

| Frame Design | | General Info | |
|--------------|-----------------------------|--------------|------------|
| Cust. Name: | Bowers Engineering Services | Subject: | Roof Mount |
| Job Number: | 5078 | Originator: | Checker: |
| Date: | 12/8/21 | Rev: | - |
| Address: | 132 Crutchfield Dr | | |
| City, State: | Cameron, NC 28326 | | |

Roof Rafter

| | | |
|----------------|--------|--------|
| Rafter Size= | 2x8 | SYP #1 |
| Trib. Area= | 1.33 | ft |
| Rafter length= | 14 | ft |
| w= | 40.57 | plf |
| M= | 993.84 | lb-ft |

Dead Load Roof Materials

| | | |
|-------------------|------|-----|
| Sheathing= | 2 | psf |
| Asphalt Shingles= | 3 | psf |
| Insulation= | 0.50 | psf |
| Solar Panels= | 2.50 | psf |

Assume Light-frame wood roof

$$fb = \frac{M * 12}{S_x}$$

$$F'b = Fb * Cd * Cr * Cf * Cm * Cl$$

Roof Loads

| | | |
|------------|------|-----|
| Dead Load= | 8.00 | psf |
| Live Load= | 20 | psf |
| Snow Load= | 10 | psf |

Load Combination

$$D+0.75L+0.75S = 30.5 \text{ psf}$$

| | | |
|------------------|-----------|-------|
| EI= | 7.6E+07 | ib-in |
| Sx = | 13.140625 | |
| C _M = | 1.0 | |
| C _r = | 1.2 | |
| C _D = | 1.15 | |
| C _F = | 1.3 | |
| C _L = | 1.0 | |
| F _b = | 1500 | psi |

| | | |
|------|---------|---------------|
| fb= | 907.58 | psi |
| F'b= | 2578.88 | psi OK |

$$\frac{5wl^4}{384EI}$$

| | | |
|-------|------|----|
| ΔL= | 0.30 | in |
| ΔS= | 0.15 | in |
| ΔD+L= | 0.42 | in |

| | | | | | |
|-------------------------|------|---|--------------|------|-----------|
| Δ _{allow in} = | 0.42 | < | <u>1/120</u> | 1.40 | OK |
| Δ _{allow in} = | 0.30 | < | <u>1/180</u> | 0.93 | OK |

| | | | |
|-----|---|----------|-----------|
| 2x8 | @ | 1.33 o/c | OK |
|-----|---|----------|-----------|

Assume rafters are fully braced