

**SCOPE OF WORK:**

TO INSTALL A ROOF MOUNTED SOLAR PHOTOVOLTAIC SYSTEM AT THE OWNER RESIDENCE LOCATED AT 171 W STEWART ST COATS, NC 27521. THE POWER GENERATED BY THE PV SYSTEM WILL BE INTERCONNECTED WITH THE UTILITY GRID THROUGH THE EXISTING ELECTRICAL SERVICE EQUIPMENT. THE PV SYSTEM DOES NOT INCLUDE STORAGE BATTERIES

**EQUIPMENT SUMMARY**

15 Q CEEL Q PEAK DUO BLK ML-G10+395 MODULES  
01 SOLAREEDGE SE5000H-US INVERTER  
15 SOLAREEDGE POWER OPTIMIZER P401

REV/DATE: 06/07/2022

**GENERAL NOTES:**

- THESE CONSTRUCTION DOCUMENTS HAVE BEEN BASED ON FIELD INSPECTIONS AND OTHER INFORMATION AVAILABLE AT THE TIME. ACTUAL FIELD CONDITIONS MAY REQUIRE MODIFICATIONS IN CONSTRUCTION DETAILS.
- ARCHITECT HAS NOT BEEN RETAINED TO SUPERVISE ANY CONSTRUCTION OR INSTALLATION OF ANY EQUIPMENT AT SITE.
- CONTRACTOR SHALL FURNISH ALL LABOR, MATERIAL, EQUIPMENT, TOOLS, OBTAINS ALL PERMITS, LICENSES AND PAY ALL REQUIRED FEES AND COMPLETE INSTALLATION.
- CONTRACTOR HAS THE FULL RESPONSIBILITY TO CHECK AND VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. ANY WORK STARTED BEFORE CONSULTATION AND ACCEPTANCE BY THE ENGINEER SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE SUBJECT TO CORRECTION BY THEM WITHOUT ADDITIONAL COMPENSATION.
- DAMAGE CAUSED TO THE EXISTING STRUCTURE, PIPES, DUCTS, WINDOWS, WALL, FLOORS, ETC. SHALL BE REPAIRED TO THE ORIGINAL CONDITION OR REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST.
- THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR THE PROPER INSTALLATION AND COMPLETION OF THE WORK WITH APPROVED MATERIALS.
- NO CHANGES ARE TO BE MADE WITHOUT THE CONSULTATION AND APPROVAL OF THE ARCHITECT.
- CONTRACTOR SHALL OBTAIN BUILDING PERMIT. NO WORK TO START UNLESS BUILDING PERMIT IS PROPERLY DISPLAYED.
- ALL WORKMANSHIP AND MATERIALS SHALL BE OF FIRST QUALITY AND IN COMPLIANCE WITH THE REQUIREMENTS OF THE NC BUILDING CODE, THE DEPARTMENT OF ENVIRONMENTAL PROTECTION AND ALL PERTINENT AGENCIES.
- IT IS ESSENTIAL THAT ALL WORK PROCEED WITH THE MAXIMUM COOPERATION OF ALL PARTIES AND WITH MINIMUM INTERFERENCE TO THE OCCUPANTS WITHIN THE BUILDING. THE OWNER'S DIRECTIONS IN THIS REGARD SHALL BE FULLY COMPLIED WITH.
- ALL EXPOSED PLUMBING, HVAC, ELECTRICAL DUCTWORK, PIPING AND CONDUITS ARE TO BE PAINTED BY GENERAL CONTRACTOR.
- THE CONTRACTOR SHALL PERFORM THE WORK IN STRICT CONFORMANCE WITH THE LOCAL LAWS, REGULATIONS AND THE NATIONAL ELECTRIC CODE.
- THE CONTRACTOR SHALL OBTAIN ALL PERMITS, APPROVALS, AFFIDAVITS, CERTIFICATIONS, ETC. AND PAY ALL FEES AS REQUIRED BY THE LOCAL AUTHORITIES.
- CONTRACTORS SHALL OBTAIN FIRE CERTIF. UPON COMPLETION OF WORK.

**ELECTRICAL NOTES:**

- THE EQUIPMENT AND ALL ASSOCIATED WIRING AND INTERCONNECTION SHALL BE INSTALLED ONLY BY QUALIFIED PEOPLE. A QUALIFIED PERSON IS ONE WHO HAS SKILLS AND KNOWLEDGE RELATED TO THE CONSTRUCTION AND OPERATION OF THE ELECTRICAL EQUIPMENT AND INSTALLATIONS AND HAS RECEIVED SAFETY TRAINING TO RECOGNIZE AND AVOID THE HAZARDS INVOLVED. (NEC 690.4(E) AND 705.6)
- LOCAL UTILITY PROVIDER SHALL BE NOTIFIED PRIOR TO USE AND ACTIVATION OF ANY SOLAR PHOTOVOLTAIC INSTALLATION. FOR A LINE SIDE TAP CONNECTION, UTILITY NEEDS TO BE NOTIFIED WELL IN ADVANCE TO COORDINATE BUILDING ELECTRICAL SHUT OFF.
- NEW CONDUIT ROUTING SHOWN IS ESSENTIALLY SCHEMATIC. SUBCONTRACTOR SHALL LAY OUT RUNS TO SUIT FIELD CONDITIONS AND THE COORDINATION REQUIREMENTS OF OTHER TRADES.
- ARRAY WIRING SHOULD NOT BE READILY ACCESSIBLE EXCEPT TO QUALIFIED PERSONNEL.
- ALL EXTERIOR CONDUIT, FITTINGS, AND BOXES SHALL BE WATERTIGHT AND APPROVED FOR USE IN WET LOCATIONS. (NEC 314.15A).
- WIRING METHODS FOR PV SYSTEM CONDUCTORS AREN'T PERMITTED WITHIN 10 IN. OF THE ROOF DECKING OR SHEATHING EXCEPT WHERE LOCATED DIRECTLY BELOW THE ROOF SURFACE THAT'S COVERED BY PV MODULES AND ASSOCIATED EQUIPMENT WIRING
- BACK-FED BREAKER MUST BE AT THE OPPOSITE END OF BUS BAR FROM THE MAIN BREAKER OR MAIN LUG SUPPLYING CURRENT FROM THE UTILITIES.
- ALL CONDUCTORS AND WIRE TIES EXPOSED TO SUNLIGHT ARE LISTED AS UV RESISTANT.
- CONTRACTOR SHALL FOLLOW ALL ELECTRICAL EQUIPMENT LABELING REQUIREMENTS IN NEC 690 AND IFC 2018
- MEASURE THE LINE-TO-LINE AND LINE-TO-NEUTRAL VOLTAGE OF ALL SERVICE ENTRANCE CONDUCTORS PRIOR TO INSTALLING ANY SOLAR EQUIPMENT. THE VOLTAGES FOR THE 240VAC RATED.

**GOVERNING CODES**

2017 NPFA-70 NATIONAL ELECTRICAL CODE  
2018 INTERNATIONAL FIRE CODE  
2018 INTERNATIONAL BUILDING CODE  
2018 INTERNATIONAL RESIDENTIAL CODE  
2018 INTERNATIONAL ENERGY CONSERVATION CODE  
2018 INTERNATIONAL EXISTING BUILDING CODE  
2018 INTERNATIONAL SWIMMING POOL AND SPA CODE  
2018 UNIFORM MECHANICAL CODE  
2018 UNIFORM PLUMBING CODE

AUTHORITY HAVING JURISDICTION (AHJ): COATS TOWN

**WIRING AND CONDUIT NOTES:**

- ALL CONDUIT SIZES AND TYPES, SHALL BE LISTED FOR ITS PURPOSE AND APPROVED FOR THE SITE APPLICATIONS
- ALL PV CABLES AND HOMERUN WIRES BE #10AWG \*USE-2, PV WIRE, OR PROPRIETARY SOLAR CABLING SPECIFIED BY MFR, OR EQUIVALENT; ROUTED TO SOURCE CIRCUIT COMBINER BOXES AS REQUIRED
- ALL CONDUCTORS AND OCPD SIZES AND TYPES SPECIFIED ACCORDING TO [NEC 690.8 (A)(1) & (B)(1)], [NEC 240] [NEC 690.7] FOR MULTIPLE CONDUCTORS
- ALL PV DC CONDUCTORS IN CONDUIT EXPOSED TO SUNLIGHT SHALL BE DERATED ACCORDING TO [NEC TABLE 310.15 (B)(2)(C)] BLACK ONLY\*\*
- EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP EDGES
- PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 600V PER NEC 2008 OR 1000V PER NEC 2011
- 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS
- ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION
- VOLTAGE DROP LIMITED TO 2% FOR DC CIRCUITS AND 1% FOR AC CIRCUITS
- NEGATIVE GROUNDED SYSTEMS DC CONDUCTORS SHALL BE COLOR CODED AS FOLLOWS: DC POSITIVE - RED (OR MARKED RED), DC NEGATIVE - GREY (OR MARKED GREY)
- POSITIVE GROUNDED SYSTEMS DC CONDUCTORS COLOR CODED: DC POSITIVE - GREY (OR MARKED GREY), DC NEGATIVE - BLACK (OR MARKED BLACK)
- AC CONDUCTORS >4AWG COLOR CODED OR MARKED: PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE, NEUTRAL- WHITE/GRAY

**SYSTEM RATING**

5.925 KWDC

5.0 KWAC


PHOTOVOLTAIC SYSTEM  
FIRE CLASSIFICATION  
LISTING IN ACCORDANCE  
WITH UL1703 STANDARD.

**SHEET INDEX**

|       |                                  |
|-------|----------------------------------|
| PV-0  | COVER PAGE                       |
| PV-1  | SITE PLAN                        |
| PV-2  | ROOF PLAN & MODULES              |
| PV-2A | STRING LAYOUT & BOM              |
| PV-3  | ATTACHMENT DETAIL                |
| PV-3A | ATTACHMENT DETAIL                |
| PV-4  | ELECTRICAL LINE DIAGRAM & CALCS. |
| PV-4A | ELECTRICAL LINE DIAGRAM & CALCS. |
| PV-4B | SPECIFICATIONS & NOTES           |
| PV-5  | SIGNAGE                          |
| PV-6  | JOB SAFETY PLAN                  |
| PV-7+ | EQUIPMENT SPECIFICATIONS         |

**PROJECT SITE**

1 PV-0 HOUSE PHOTO SCALE: NTS

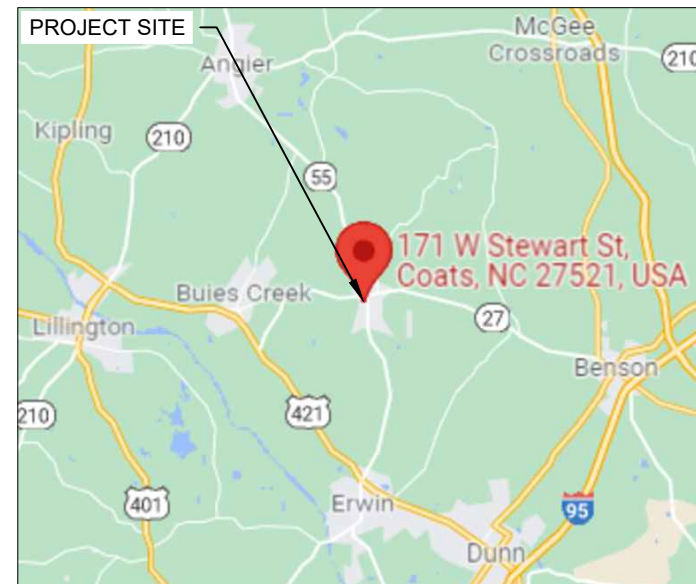

2 PV-0 VICINITY MAP SCALE: NTS



TITAN SOLAR POWER

210 N Sunway Dr,  
Gilbert, AZ 85233

www.titansolarpower.com

ELECTRICAL LIC#: U.33714

**REVISIONS**

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

**PROJECT NAME & ADDRESS**

ROBERT MCEACHIN  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME

COVER PAGE

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER


PV-0

**SITE NOTES**

- A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS AN UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION [NEC 110.26]

REV/DATE: 06/07/2022

- (N) SOLAREEDGE SE5000H-US INVERTER
- (N) FUSED AC DISCONNECT
- (N) NON FUSED AC DISCONNECT
- (E) MAIN SERVICE PANEL
- (E) UTILITY METER
- ROOF #1
- (15) Q CEEL Q PEAK DUO BLK ML-G10+395 MODULES

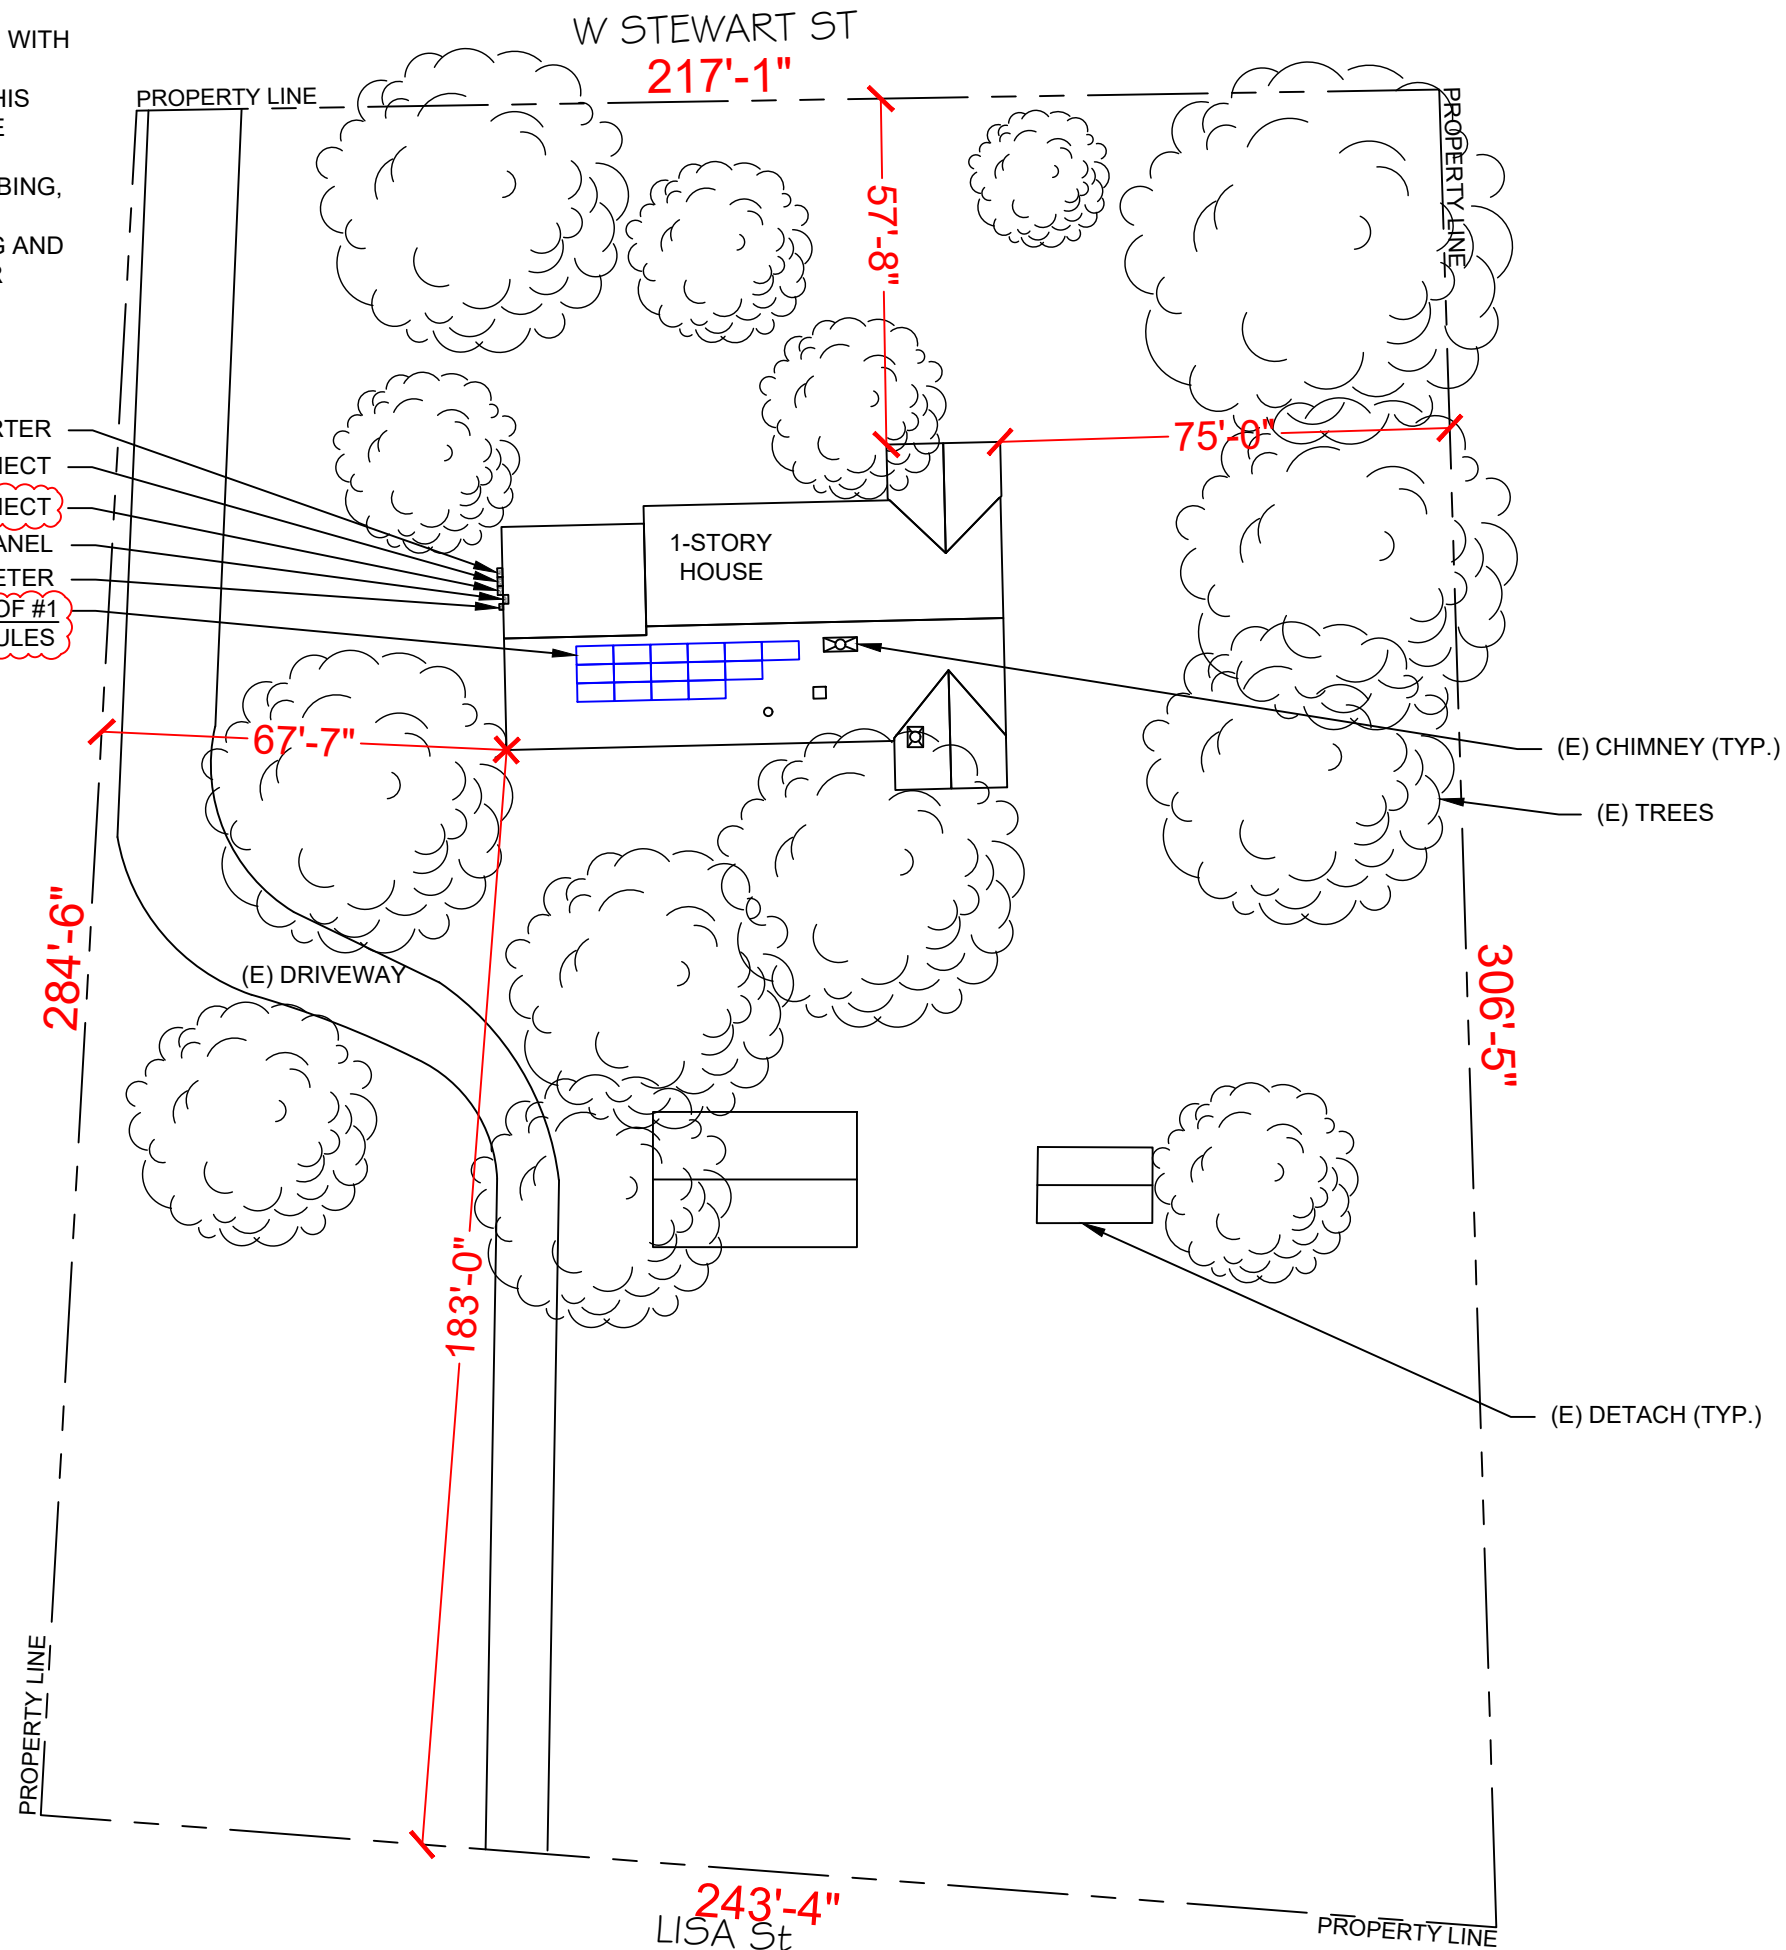

1

**PLOT PLAN WITH ROOF PLAN**

PV-1

SCALE: 1/32" = 1'-0"



**TITAN SOLAR POWER**

210 N Sunway Dr,  
Gilbert, AZ 85233

www.titansolarpower.com

ELECTRICAL LIC#: U.33714

**REVISIONS**

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

**PROJECT NAME & ADDRESS**

**ROBERT MCEACHIN**  
**RESIDENCE**  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME

**SITE PLAN**

SHEET SIZE

**ANSI B**  
**11" X 17"**

SHEET NUMBER

**PV-1**

| DEAD LOAD CALCULATION                         |          |          |                   |
|---|----------|----------|-------------------|
| BOM   | QUANTITY | LBS/UNIT | TOTAL WEIGHT(LBS) |
| MODULES                                       | 15       | 48.50    | 727.50            |
| MID CLAMP                                     | 24       | 0.30     | 7.20              |
| END CLAMP                                     | 12       | 0.31     | 3.72              |
| RAIL LENGTH                                   | 15       | 10.0     | 150.00            |
| SPLICE BAR                                    | 10       | 0.65     | 6.50              |
| SPLICEFOOT X                                  | 54       | 0.9      | 48.60             |
| <b>TOTAL WEIGHT OF THE SYSTEM (LBS)</b>       |          |          | 943.52            |
| <b>TOTAL ARREY AREA ON THE ROOF (SQ. FT.)</b> |          |          | 286.42            |
| <b>WEIGHT PER SQ. FT.(LBS)</b>                |          |          | 943.52            |
| <b>WEIGHT PER PENETRATION (LBS)</b>           |          |          | 17.47             |

| MODULE TYPE, DIMENSIONS & WEIGHT |                                  |
|----------------------------------|----------------------------------|
| NUMBER OF MODULES:               | 15 MODULES                       |
| MODULE TYPE:                     | Q CEEL Q PEAK DUO BLK ML-G10+395 |
| MODULE WEIGHT:                   | 48.5LBS                          |
| MODULE DIMENSIONS:               | 74.0" X 41.1" = 21.12 SF         |
| UNIT WEIGHT OF AREA:             | 2.29 PSF                         |

| DESIGN SPECIFICATION    |             |
|-------------------------|-------------|
| RISK CATEGORY:          | II          |
| CONSTRUCTION:           | SFD         |
| ZONING:                 | RESIDENTIAL |
| SNOW LOAD (ASCE 7-16):  | 15 PSF      |
| EXPOSURE CATEGORY:      | B           |
| WIND SPEED (ASCE 7-16): | 119 MPH     |

| LEGEND |                                      |
|--------|--------------------------------------|
| [JB]   | - JUNCTION BOX                       |
| [INV]  | - INVERTER                           |
| [ACD]  | - AC DISCONNECT                      |
| [SUB]  | - MAIN SERVICE PANEL                 |
| [UM]   | - UTILITY METER                      |
| ○ □    | - VENT, ATTIC FAN (ROOF OBSTRUCTION) |
| ●      | - ROOF ATTACHMENT                    |
| -----  | - CONDUIT                            |


| ROOF DESCRIPTION      |           |         |             |                |               |
|-----------------------|-----------|---------|-------------|----------------|---------------|
| ROOF #                | ROOF TILT | AZIMUTH | RAFTER SIZE | RAFTER SPACING | ROOF MATERIAL |
| #1                    | 24°       | 179°    | 2"X6"       | 16" O.C.       | COMP. SHINGLE |
| PANEL HEIGHT OFF ROOF |           |         |             |                | 4"            |

W STEWART ST  
(E) FRONT OF RESIDENCE


- (N) 3/4" EMT CONDUIT
- (N) SOLAREEDGE SE5000H-US INVERTER
- (N) FUSED AC DISCONNECT
- (N) NON FUSED AC DISCONNECT
- (E) MAIN SERVICE PANEL
- (E) UTILITY METER
- (N) JUNCTION BOX

| ARRAY AREA & ROOF AREA CALC'S                    |              |                      |                           |                                |
|--|--------------|----------------------|---------------------------|--------------------------------|
| ROOF   | # OF MODULES | ARRAY AREA (Sq. Ft.) | TOTAL ROOF AREA (Sq. Ft.) | ROOF AREA COVERED BY ARRAY (%) |
| #1   | 15           | 286.42               | 3598.79                   | 7.96                           |
| <b>TOTAL ROOF AREA COVERED BY ARRAY AREA (%)</b> |              | 286.42               | 3598.79                   | 7.96                           |

REV/DATE: 06/07/2022

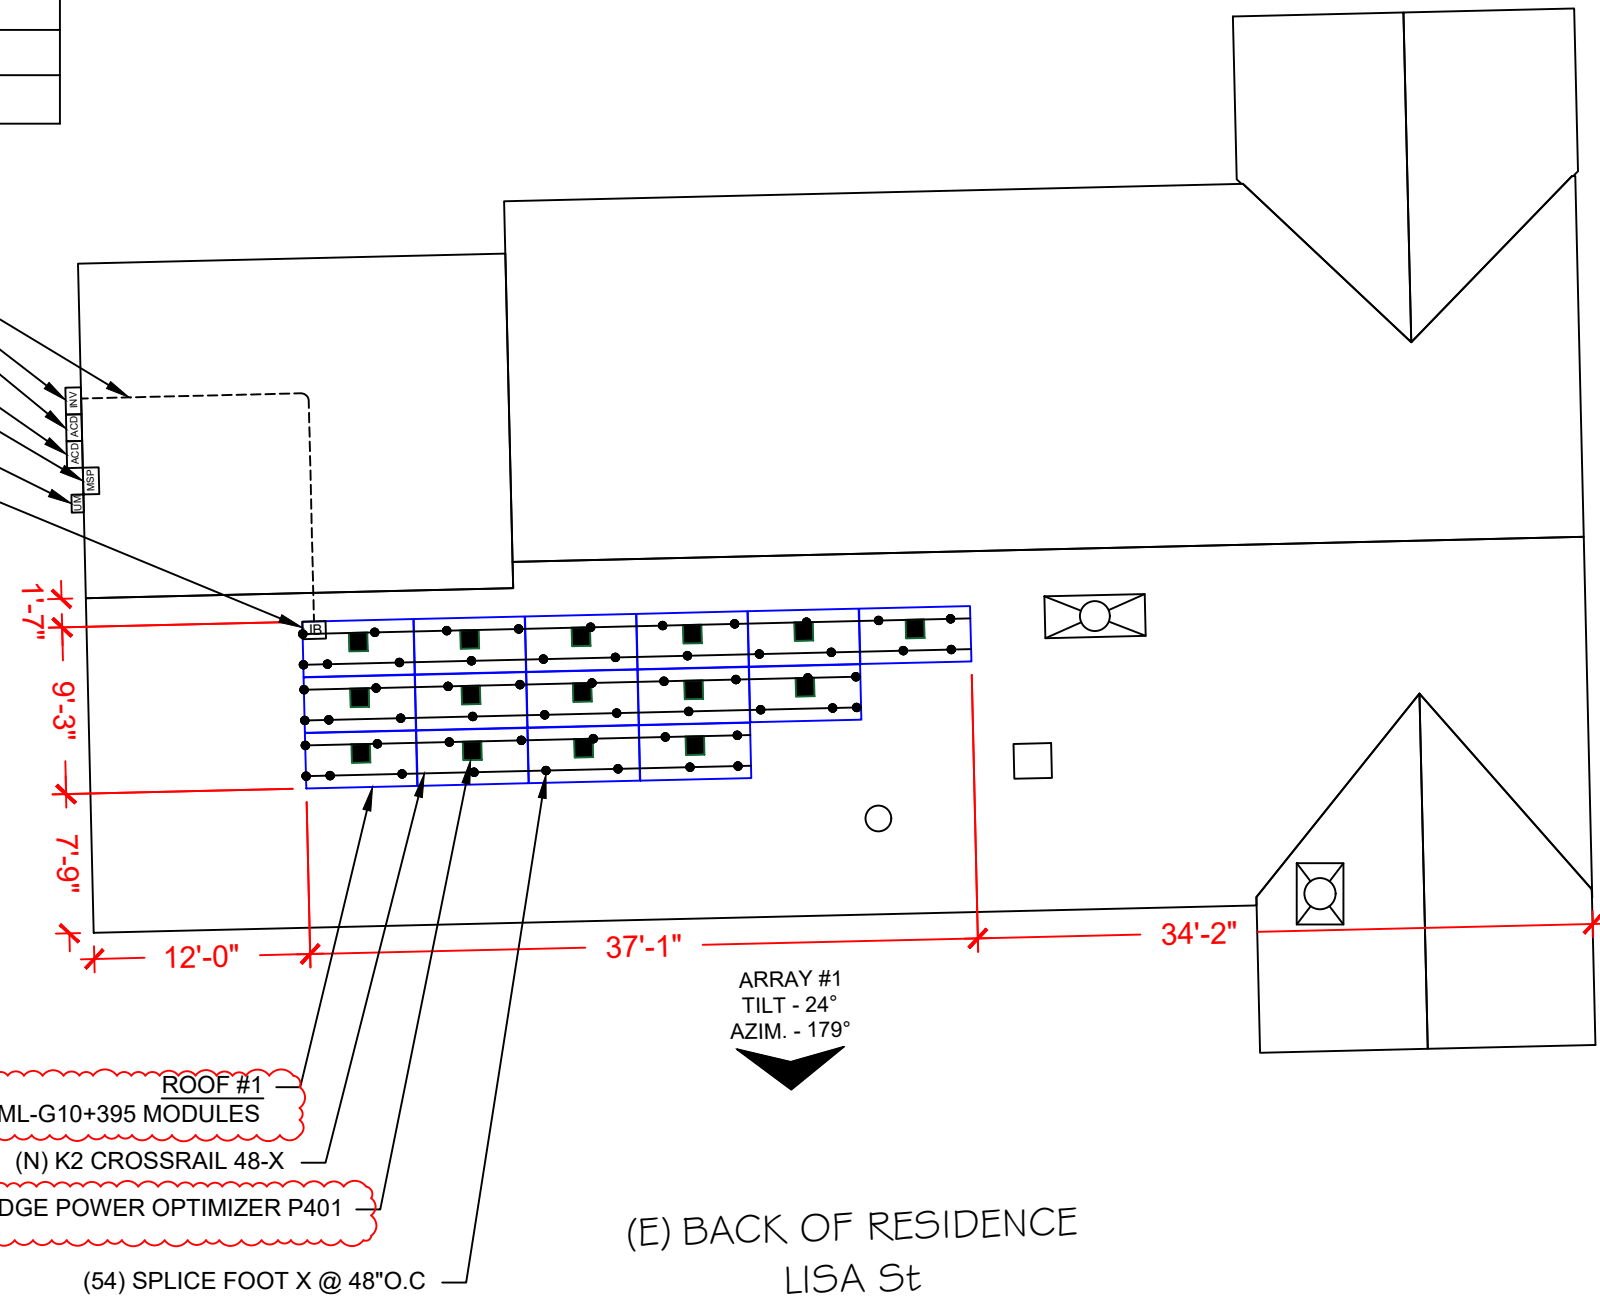

(E) BACK OF RESIDENCE  
LISA St

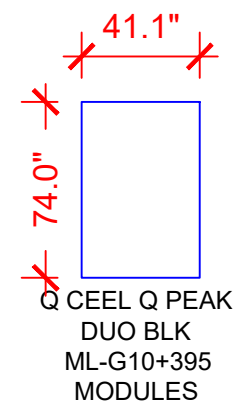

**TITAN SOLAR POWER**  
210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS  
**ROBERT MCEACHIN**  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**ROOF PLAN & MODULES**

SHEET SIZE  
**ANSI B  
11" X 17"**

SHEET NUMBER  
**PV-2**




**BILL OF MATERIALS**

| EQUIPMENT       | QTY | DESCRIPTION   |
|-----------------|-----|---|
| SOLAR PV MODULE | 15  | Q CEEL Q PEAK DUO BLK ML-G10+395  |
| OPTIMIZER       | 15  | SOLAREGE POWER OPTIMIZER P401   |
| INVERTER        | 1   | SOLAREGE SE5000H-US   |
| AC DISCONNECT   | 1   | EATON DG222NRB, PV SYSTEM AC DISCONNECT SWITCH FUSED, 60A W/X FUSES, 120/240V 2P NEMA 3R      |
| AC DISCONNECT   | 1   | EATON DG222URB PV SYSTEM AC DISCONNECT SWITCH NON FUSED VISIBLE OPEN 60A, 120/240V 2P NEMA 3R |
| JUNCTION BOX    | 1   | JUNCTION BOX, NEMA 3R, UL LISTED  |
| ATTACHMENT      | 54  | SPLICE FOOT X   |
| ATTACHMENT      | 54  | K2 SOLAR SEAL BUTYL PAD   |
| ATTACHMENT      | 108 | MS X 60 LAG SCREWS  |
| ATTACHMENT      | 54  | CAP SCREW, HEX HEAD, 5/16"-18" X 1"   |
| RAILS           | 14  | K2 CROSSRAIL 48-X RAIL (166")   |
| BONDED SPLICE   | 10  | SPLICE KIT  |
| CLAMPS          | 36  | MODULES CLAMPS (MID CLAMPS & END CLAMPS)  |
| GROUNDING LUG   | 3   | GROUNDING LUG   |

REV/DATE: 06/07/2022

W STEWART ST  
(E) FRONT OF RESIDENCE

**A - MODULE STRINGING**

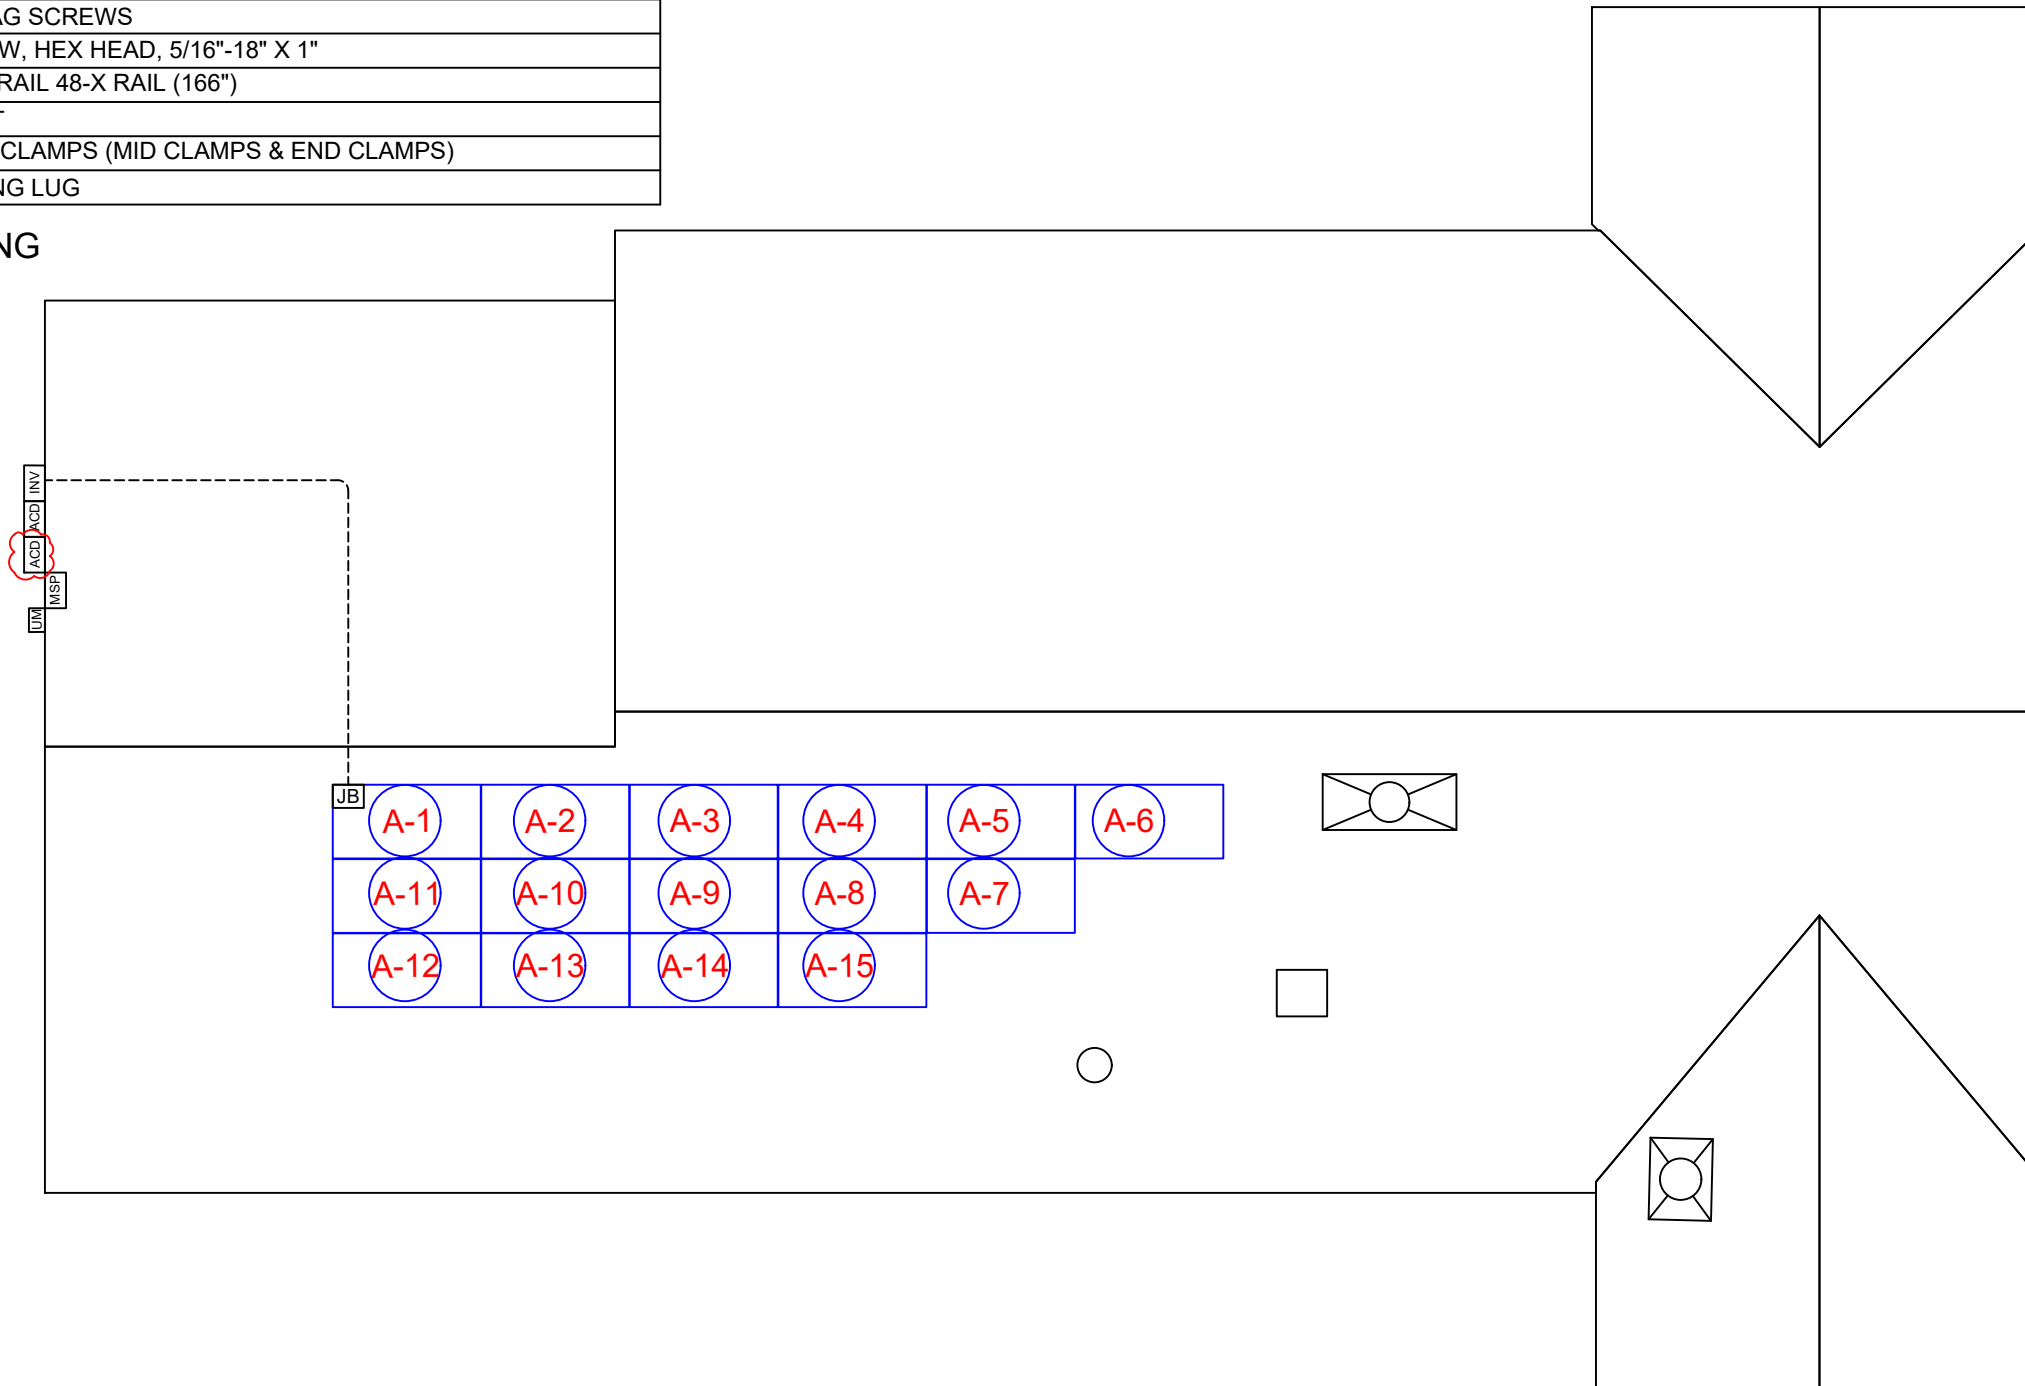

(E) BACK OF RESIDENCE  
LISA St



**TITAN SOLAR POWER**  
210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**STRING LAYOUT & BOM**

SHEET SIZE

**ANSI B  
11" X 17"**

SHEET NUMBER

**PV-2A**




1

**ROOF PLAN WITH STRING LAYOUT & BOM**


PV-2A

SCALE: 1/8" = 1'-0"

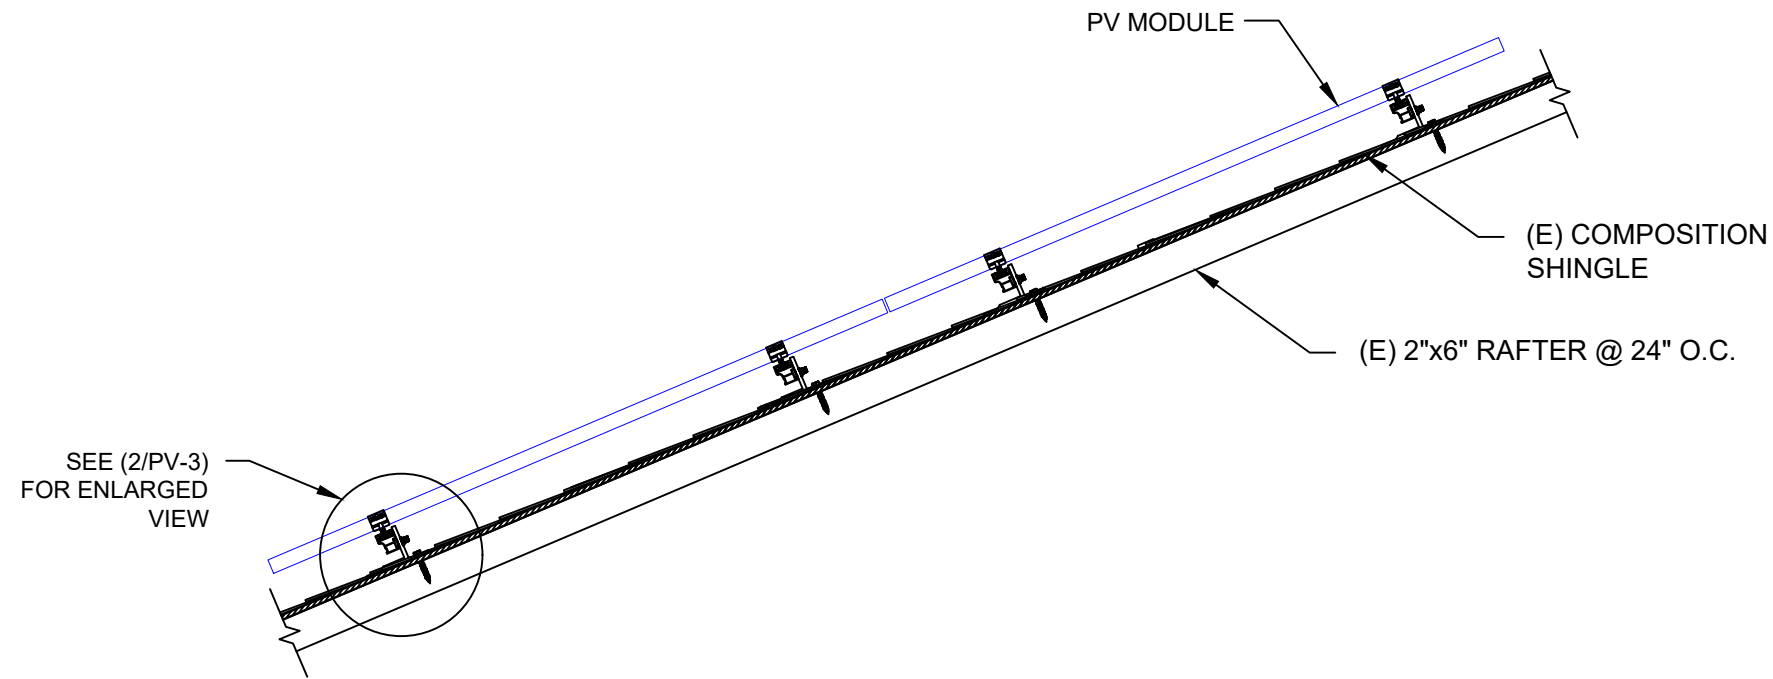

**1 ATTACHMENT DETAILS**

PV-3

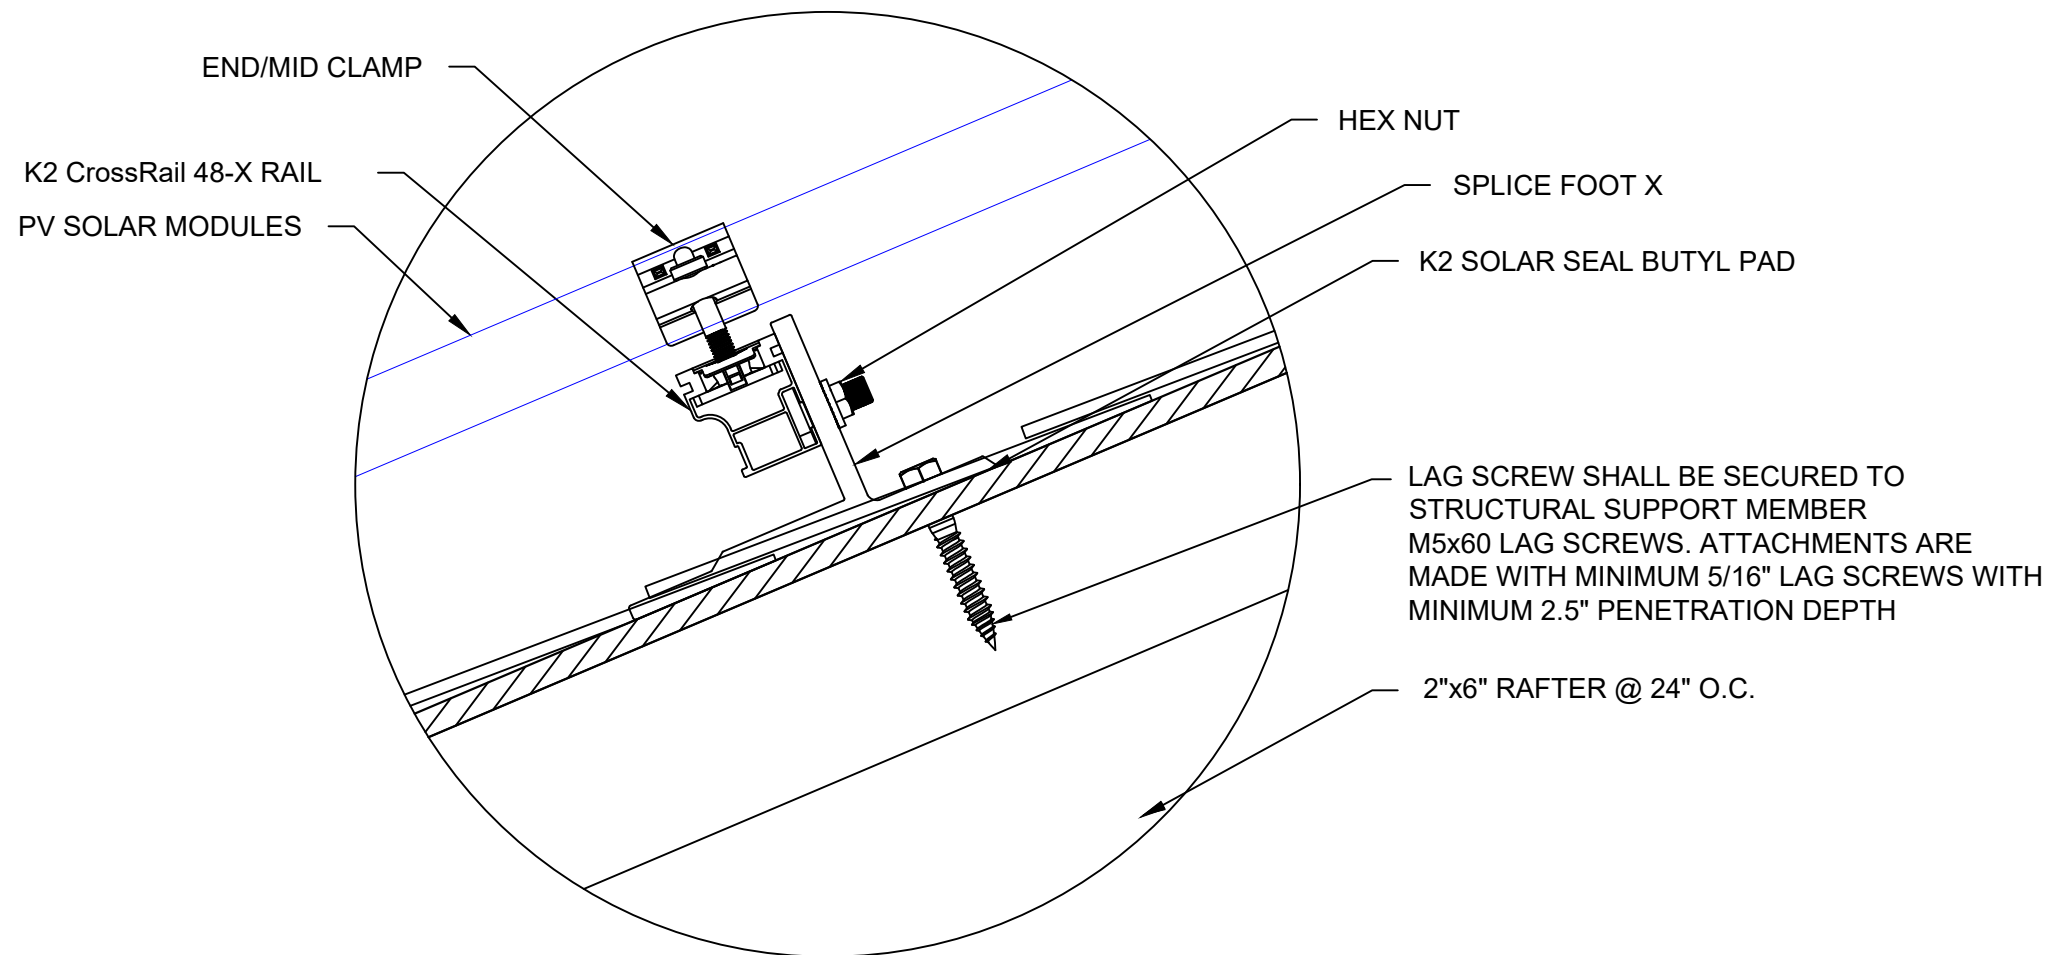

**2 ENLARGED VIEW OF ATTACHMENT**

PV-3

SCALE: NTS



**TITAN SOLAR POWER**

210 N Sunway Dr.  
 Gilbert, AZ 85233  
 www.titansolarpower.com  
 ELECTRICAL LIC#: U.33714

REVISIONS

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
 RESIDENCE  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**ATTACHMENT  
 DETAILS**

SHEET SIZE



**ANSI B  
 11" X 17"**

SHEET NUMBER


**PV-3**

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16


NOTE:  
 PROPRIETARY GEOMETRIES  
 HAVE BEEN REMOVED.  
 GENERAL LENGTH, WIDTH,  
 AND HEIGHT GEOMETRIES  
 WERE NOT ALTERED.

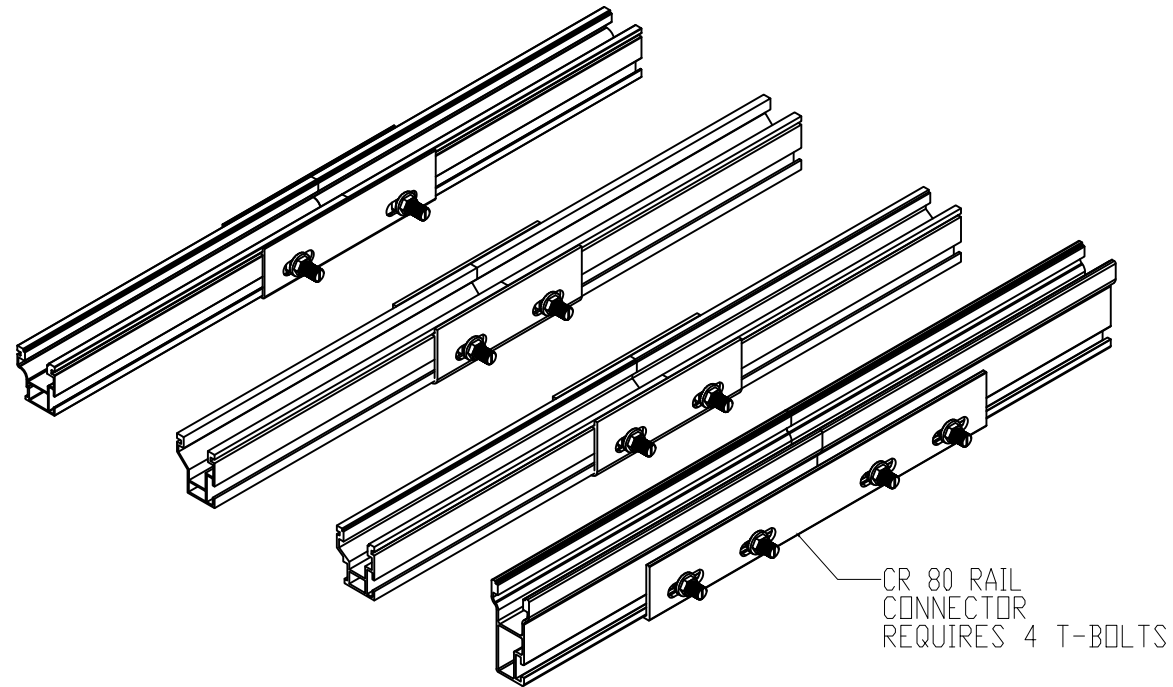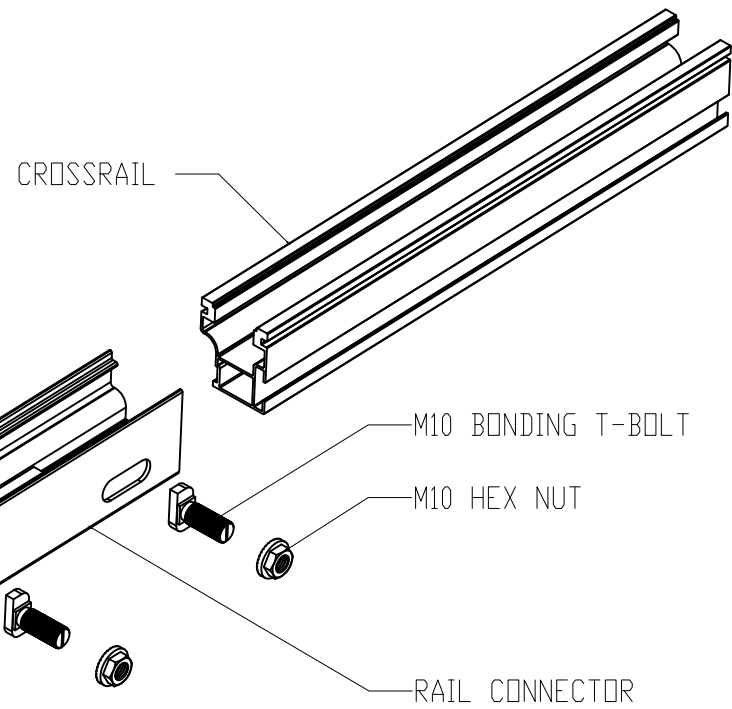


RAIL CONNECTOR ASSEMBLIES




44-X



48-X



48-XL



80



**TITAN SOLAR POWER**  
 210 N Sunway Dr,  
 Gilbert, AZ 85233  
 www.titansolarpower.com  
 ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
 RESIDENCE  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**ATTACHMENT  
 DETAILS**


SHEET SIZE  
**ANSI B  
 11" X 17"**

SHEET NUMBER  
**PV-3A**

REVISION HISTORY

| Revision | Date | Description |
|----------|------|-------------|
| 01       |      |             |
| 02       |      |             |
| 03       |      |             |
| 04       |      |             |
| 05       |      |             |

PROPRIETARY AND CONFIDENTIAL  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF  
 EVEREST SOLAR SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE  
 WITHOUT THE WRITTEN PERMISSION OF EVEREST SOLAR SYSTEMS IS PROHIBITED.



Everest Solar Systems, LLC.  
 a division of K2 Systems International  
 2835 La Mirada Dr Suite A  
 Vista, CA 92081  
 phone 760.301.5300



Title  
**CROSSRAIL RAIL  
 CONNECTOR ASSEMBLIES**

| Name                | Date       |
|---------------------|------------|
| Drawn T. WIGGINS    | 07/29/2020 |
| Checked R. HAGEN    | 08/07/2020 |
| Approved T. WIGGINS | 08/10/2020 |
| Last Revision       |            |

|             |                                       |
|-------------|---------------------------------------|
| Size: B     |                                       |
| Scale: 1:25 | Revision: 00                          |
|             | All Dimensions are mm<br>Sheet 2 of 2 |

This drawing is the sole property of Everest Solar Systems. It is protected by copyright and may only be copied, reproduced or distributed to a third party with explicit permission!

| ID | TYPICAL | INITIAL CONDUCTOR LOCATION | FINAL CONDUCTOR LOCATION | CONDUCTOR |         | CONDUIT | # OF PARALLEL CIRCUITS | CURRENT-CARRYING CONDUCTORS IN CONDUIT | CONDUIT FILL PERCENT | OCPD | EGC   |                | TEMP. CORR. FACTOR |        | CONDUIT FILL FACTOR | CONT. CURRENT | MAX. CURRENT | BASE AMP. | DERATE D AMP. | TERM. TEMP. RATING | LENGT H | VOLTA GE DROP |
|----|---------|----------------------------|--------------------------|-----------|---------|---------|------------------------|--|----------------------|------|-------|----------------|--------------------|--------|---------------------|---------------|--------------|-----------|---------------|--------------------|---------|---------------|
| 1  | 2       | STRING                     | JUNCTION BOX             | 10 AWG    | PV WIRE | COPPER  | 1                      | 2                                      | N/A                  | N/A  | 6 AWG | BARE COPPER    | 0.71               | (57°C) | N/A                 | 15.0A         | 18.8A        | 40A       | 28.4A         | 90°C               | 85FT    | 0.03%         |
| 2  | 1       | JUNCTION BOX               | INVERTER                 | 10 AWG    | THWN-2  | COPPER  | 2                      | 4                                      | 19.09%               | N/A  | 8 AWG | THWN-2, COPPER | 0.96               | (35°C) | 1                   | 15.0A         | 18.8A        | 40A       | 38.4A         | 90°C               | 35FT    | 0.12%         |
| 3  | 1       | INVERTER                   | NON FUSED AC DISCONNECT  | 10 AWG    | THWN-2  | COPPER  | 1                      | 3                                      | 15.27%               | N/A  | 8 AWG | THWN-2, COPPER | 0.96               | (35°C) | 1                   | 21.0A         | 26.3A        | 40A       | 38.4A         | 90°C               | 5FT     | 0.16%         |
| 4  | 1       | NON FUSED AC DISCONNECT    | FUSED AC DISCONNECT      | 10 AWG    | THWN-2  | COPPER  | 1                      | 3                                      | 15.27%               | 60A  | 8 AWG | THWN-2, COPPER | 0.96               | (3°C)  | 1                   | 21.0A         | 26.3A        | 40A       | 38.4A         | 90°C               | 5FT     | 0.16%         |
| 5  | 1       | FUSED AC DISCONNECT        | MSP                      | 6 AWG     | THWN-2  | COPPER  | 1                      | 3                                      | 36.53%               | N/A  | 8 AWG | THWN-2, COPPER | 0.96               | (35°C) | 1                   | 21.0A         | 26.3A        | 75A       | 72.0A         | 90°C               | 5FT     | 0.16%         |



**TITAN SOLAR POWER**  
 210 N Sunway Dr,  
 Gilbert, AZ 85233  
 www.titansolarpower.com  
 ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS


**ROBERT MCEACHIN**  
 RESIDENCE  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeen@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**ELECTRICAL LINE & CALCS.**

SHEET SIZE  
**ANSI B  
 11" X 17"**

SHEET NUMBER  
**PV-4**

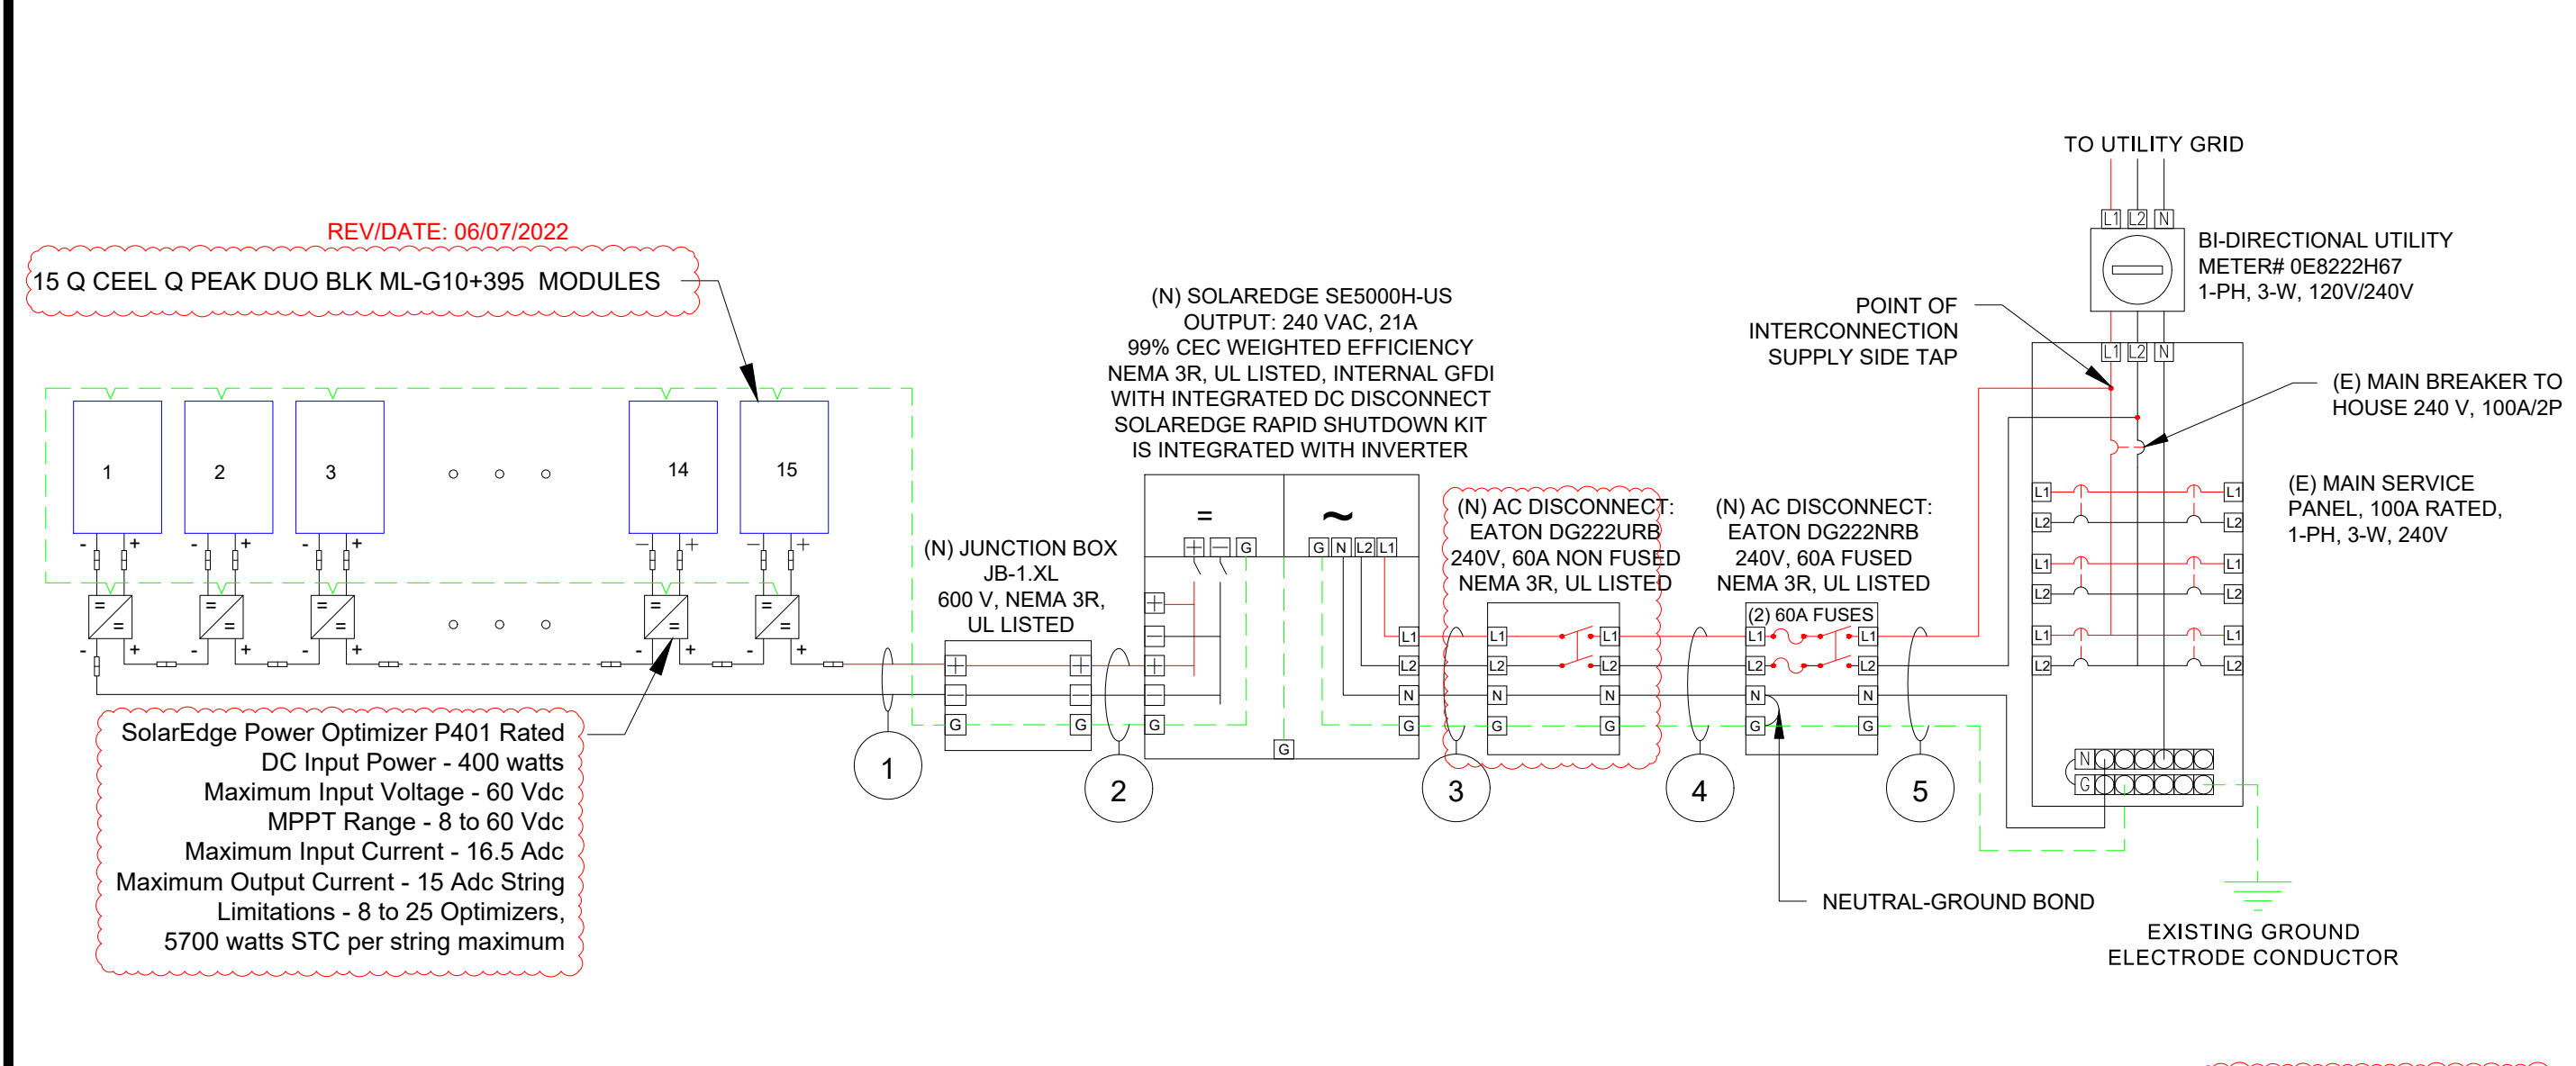

**SYSTEM RATING**  
 5.93 KWDC  
 5.0 KWAC

**SERVICE INFO**  
 UTILITY PROVIDER: DUKE ENERGY  
 MAIN SERVICE VOLTAGE: 240V  
 MAIN PANEL BRAND:  
 MAIN SERVICE PANEL: 100A  
 MAIN CIRCUIT BREAKER RATING: 100A  
 MAIN SERVICE LOCATION: WEST  
 SERVICE FEED SOURCE: OVERHEAD

| ID | TYPICAL | INITIAL CONDUCTOR LOCATION | FINAL CONDUCTOR LOCATION | CONDUCTOR      |         |          | CONDUIT           | # OF PARALLEL CIRCUITS | CURRENT-CARRYING CONDUCTORS IN CONDUIT | CONDUIT FILL PERCENT | OCPD | EGC   |                | TEMP. CORR. FACTOR |        | CONDUIT FILL FACTOR | CONT. CURRENT | MAX. CURRENT | BASE AMP. | DERATED AMP. | TERM. TEMP. RATING | LENGTH | VOLTAGE DROP |
|----|---------|----------------------------|--------------------------|----------------|---------|----------|-------------------|------------------------|--|----------------------|------|-------|----------------|--------------------|--------|---------------------|---------------|--------------|-----------|--------------|--------------------|--------|--------------|
|    |         |                            |                          | 10 AWG PV WIRE | COPPER  | Open Air |                   |                        |  |                      |      | 6 AWG | BARE COPPER    | (57°C)             | N/A    |                     |               |              |           |              |                    |        |              |
| 1  | 2       | STRING                     | JUNCTION BOX             | 10 AWG         | PV WIRE | COPPER   | Open Air          | 1                      | 2                                      | N/A                  | N/A  | 6 AWG | BARE COPPER    | 0.71               | (57°C) | N/A                 | 15.0A         | 18.8A        | 40A       | 28.4A        | 90°C               | 85FT   | 0.03%        |
| 2  | 1       | JUNCTION BOX               | INVERTER                 | 10 AWG         | THWN-2  | COPPER   | MIN 0.75" Dia EMT | 2                      | 4                                      | 19.09%               | N/A  | 8 AWG | THWN-2, COPPER | 0.96               | (35°C) | 1                   | 15.0A         | 18.8A        | 40A       | 38.4A        | 90°C               | 35FT   | 0.12%        |
| 3  | 1       | INVERTER                   | NON FUSED AC DISCONNECT  | 10 AWG         | THWN-2  | COPPER   | MIN 0.75" Dia EMT | 1                      | 3                                      | 15.27%               | N/A  | 8 AWG | THWN-2, COPPER | 0.96               | (35°C) | 1                   | 21.0A         | 26.3A        | 40A       | 38.4A        | 90°C               | 5FT    | 0.16%        |
| 4  | 1       | NON FUSED AC DISCONNECT    | FUSED AC DISCONNECT      | 10 AWG         | THWN-2  | COPPER   | MIN 0.75" Dia EMT | 1                      | 3                                      | 15.27%               | 60A  | 8 AWG | THWN-2, COPPER | 0.96               | (3°C)  | 1                   | 21.0A         | 26.3A        | 40A       | 38.4A        | 90°C               | 5FT    | 0.16%        |
| 5  | 1       | FUSED AC DISCONNECT        | MSP                      | 6 AWG          | THWN-2  | COPPER   | MIN 0.75" Dia EMT | 1                      | 3                                      | 36.53%               | N/A  | 8 AWG | THWN-2, COPPER | 0.96               | (35°C) | 1                   | 21.0A         | 26.3A        | 75A       | 72.0A        | 90°C               | 5FT    | 0.16%        |



**TITAN SOLAR POWER**  
 210 N Sunway Dr,  
 Gilbert, AZ 85233  
 www.titansolarpower.com  
 ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
 RESIDENCE  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022


SHEET NAME  
**ELECTRICAL LINE & CALCS.**

SHEET SIZE

**ANSI B**  
 11" X 17"

SHEET NUMBER

**PV-4A**

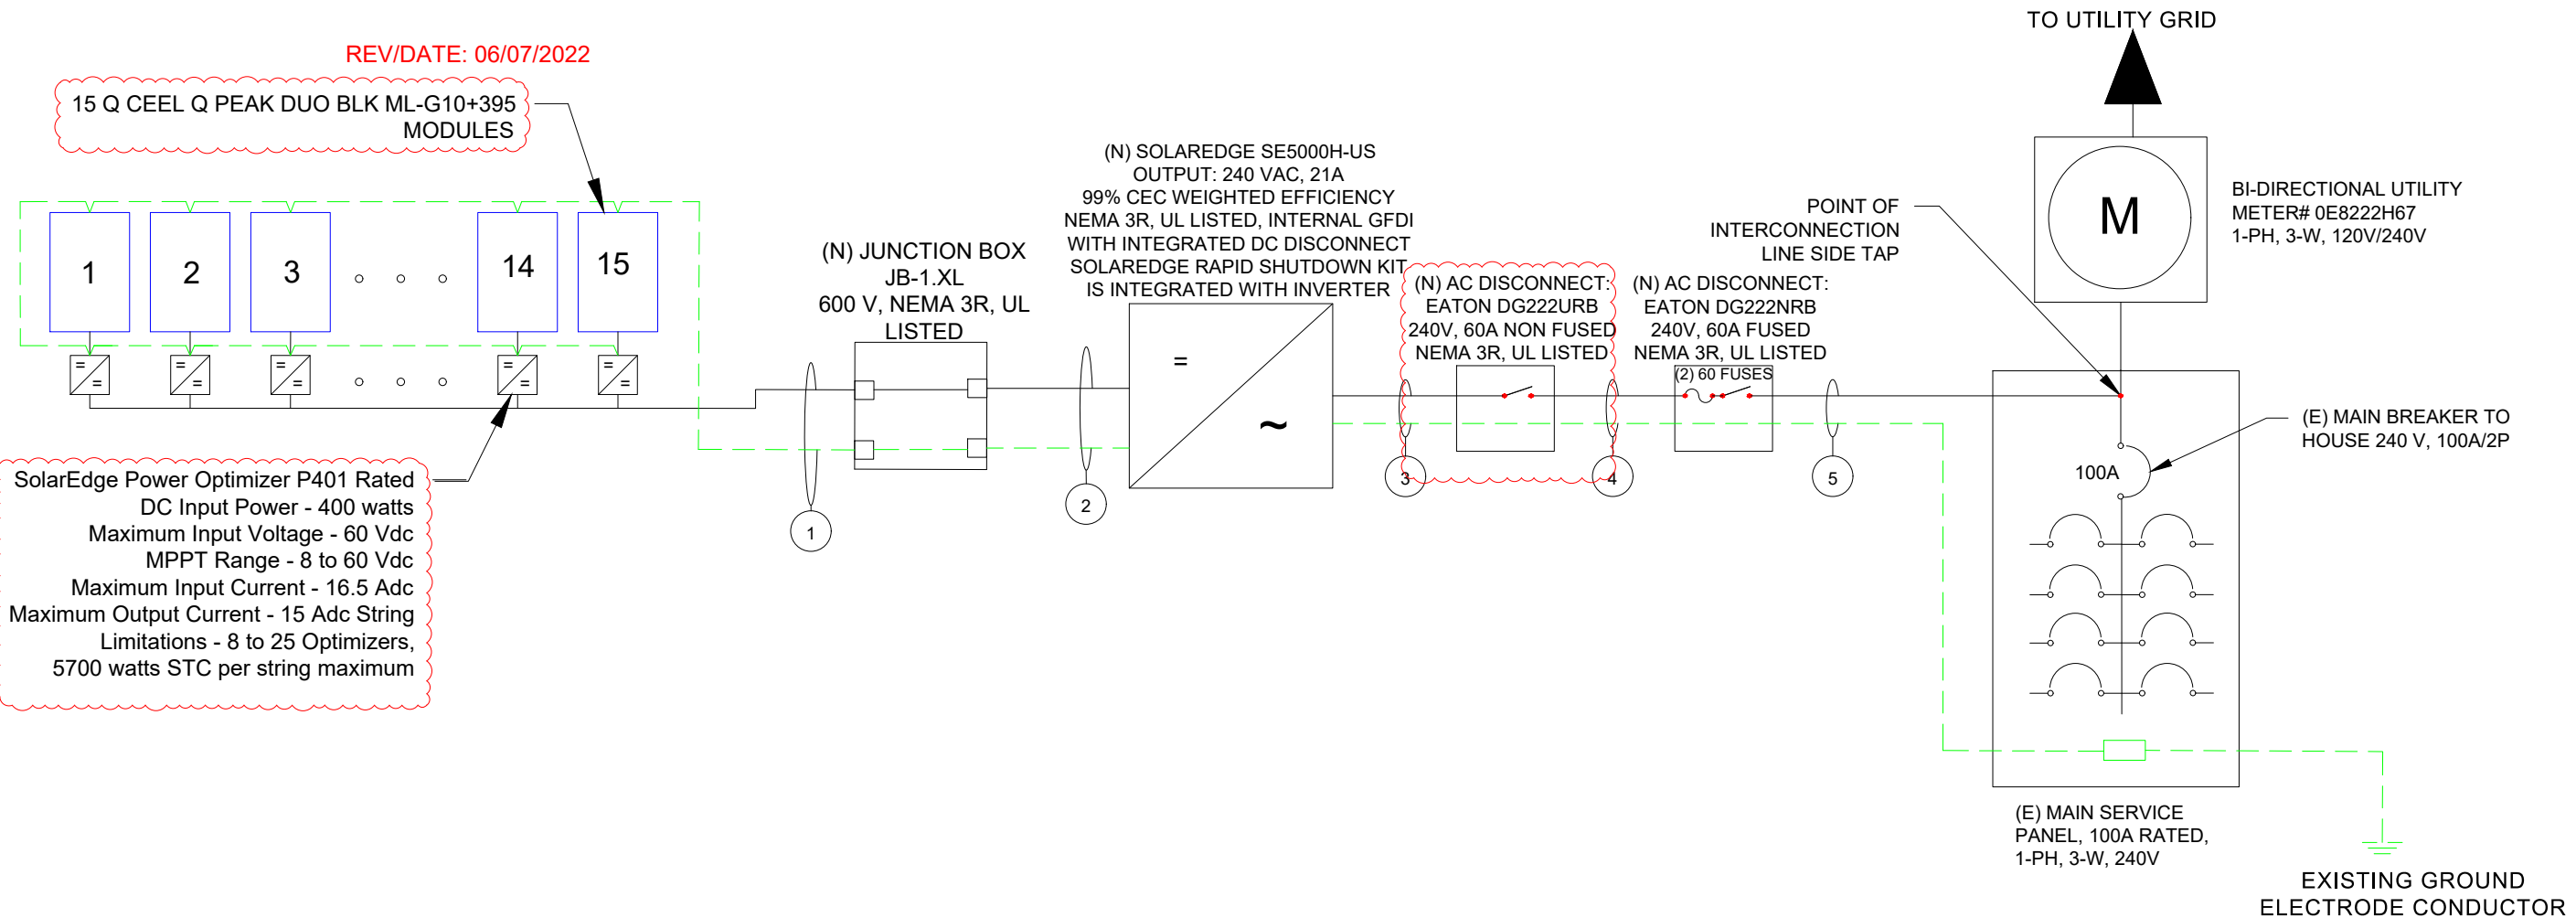

| SYSTEM RATING |
|---------------|
| 5.93 KWDC     |
| 5.0 KWAC      |

| SERVICE INFO                      |
|-----------------------------------|
| UTILITY PROVIDER: DUKE ENERGY     |
| MAIN SERVICE VOLTAGE: 240V        |
| MAIN PANEL BRAND:                 |
| MAIN SERVICE PANEL: 100A          |
| MAIN CIRCUIT BREAKER RATING: 100A |
| MAIN SERVICE LOCATION: WEST       |
| SERVICE FEED SOURCE: OVERHEAD     |



**SOLAR MODULE SPECIFICATIONS**

|                      |                            |
|----------------------|----------------------------|
| MANUFACTURER / MODEL | Q.PEAK DUO BLK ML-G-10+395 |
| VMP                  | 36.88 V                    |
| IMP                  | 10.71 A                    |
| VOC                  | 45.27 V                    |
| ISC                  | 11.10 A                    |
| TEMP. COEFF. VOC     | -0.27%/ K                  |
| PTC RATING           | 371.73 W                   |
| MODULE DIMENSION     | 73.97"(L) x 41.14"(W)      |
| PANEL WATTAGE        | 395W                       |

**INVERTER SPECIFICATION**

|                        |                       |
|------------------------|-----------------------|
| MANUFACTURER / MODEL   | SOLAREEDGE SE5000H-US |
| NOMINAL AC POWER       | 5000 W                |
| NOMINAL OUTPUT VOLTAGE | 240 VAC               |
| NOMINAL OUTPUT CURRENT | 21 A                  |

**POWER OPTIMIZER (SOLAREEDGE P401)**

|                        |           |
|------------------------|-----------|
| MAXIMUM INPUT POWER    | 400 W     |
| MAXIMUM INPUT VOLTAGE  | 60 VDC    |
| MAXIMUM INPUT ISC      | 11.75 ADC |
| MAXIMUM OUTPUT CURRENT | 15 ADC    |
| WEIGHTED EFFICIENCY    | 98.80%    |

REV/DATE: 06/07/2022

**AMBIENT TEMPERATURE SPECS**

|                                       |          |
|---------------------------------------|----------|
| RECORD LOW TEMP                       | -10°C    |
| AMBIENT TEMP (HIGH TEMP 2%)           | 35°C     |
| CONDUIT HEIGHT                        | 0.75"    |
| ROOF TOP TEMP                         | 90°C     |
| CONDUCTOR TEMPERATURE RATE            | 57°C     |
| MODULE TEMPERATURE COEFFICIENT OF VOC | -0.27%/K |

| PERCENT OF VALUES | NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT |
|-------------------|--|
| 0.80              | 4-6  |
| 0.70              | 7-9  |
| 0.50              | 10-20  |



**TITAN SOLAR POWER**

210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

**REVISIONS**

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

**PROJECT NAME & ADDRESS**

**ROBERT MCEACHIN**  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**SPECIFICATIONS & NOTES**

SHEET SIZE

**ANSI B**  
**11" X 17"**

SHEET NUMBER

**PV-4B**

1

**! WARNING**

**ELECTRIC SHOCK HAZARD**

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION:  
 MAIN SERVICE PANEL/AC DISCONNECT/INVERTER/  
 AC COMBINER  
 2017 NEC 690.13(B)

2

**WARNING PHOTOVOLTAIC POWER SOURCE**

LABEL LOCATION:  
 DC CONDUIT  
 EVERY 10' AND ON CONDUIT BODIES WHEN  
 EXPOSED  
 2017 NEC 690.31(G)(D)(3)

3

**PHOTOVOLTAIC AC DISCONNECT**

RATED AC OUTPUT CURRENT 21.0A

NOMINAL OPERATING AC VOLTAGE 240 VAC

LABEL LOCATION:  
 MAIN SERVICE PANEL/AC DISCONNECT  
 2017 NEC 690. 13(B)

4

**RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM**

LABEL LOCATION:  
 INVERTER  
 AT OR WITHIN 3' OF THE DC COMBINER  
 SWITCH  
 2017 NEC 690.56(C)(3)

5

**! CAUTION**


DUAL POWER SOURCE  
 SECOND SOURCE US  
 PHOTOVOLTAIC

LABEL LOCATION:  
 MAIN SERVICE PANEL/AC DISCONNECT/AC COMBINER/  
 REVENUE METER  
 2017 NEC 705.12(B)(3)

6

**WITH RAPID SHUTDOWN**

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



LABEL LOCATION:  
 MAIN SERVICE PANEL  
 IF MSD IS OUTSIDE PLACE IT THERE / IF  
 MSD IS INSIDE PLACE ON THE AC DISCONNECT  
 2017 NEC 690.56(C)(1)(a)

7

MAXIMUM VOLTAGE: 480 VDC

MAXIMUM CIRCUIT CURRENT: 13.5 ADC

MAX. RATED OUTPUT CURRENT OF THE CHARGE CONTROLLER OR DC-TO-DC-CONVERTER (IF INSTALLED) 30 ADC

LABEL LOCATION:  
 INVERTER  
 2017 NEC 690.53

8

**PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH**

LABEL LOCATION:  
 AC DISCONNECT  
 2017 NEC 690.56(C)(3)

9

**SERVICE EQUIPMENT**

**SECTIONNEUR PRINCIPALE**

**SERVICIO DE DESCONEXION**

LABEL LOCATION:  
 AC DISCONNECT  
 2017 NEC 230.66



TITAN SOLAR POWER

210 N Sunway Dr,  
 Gilbert, AZ 85233  
 www.titansolarpower.com  
 ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

ROBERT MCEACHIN  
 RESIDENCE  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**SIGNAGE**

SHEET SIZE  
**ANSI B  
 11" X 17"**

SHEET NUMBER  
**PV-5**


ADHESIVE FASTENED SIGNS:

- ANSI Z535.4-2011 PRODUCT SAFETY SIGNS AND LABELS, PROVIDES GUIDELINES FOR SUITABLE FONT SIZES, WORDS, COLORS, SYMBOLS, AND LOCATION REQUIREMENTS FOR LABELS. NEC 110.21(B)(1)
- THE LABEL SHALL BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED. NEC 110.21(B)(3)
- ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT.



# CAUTION

**POWER TO THIS BUILDING IS SUPPLIED FROM  
THE FOLLOWING SOURCES WITH DISCONNECTS  
LOCATED AS SHOWN**

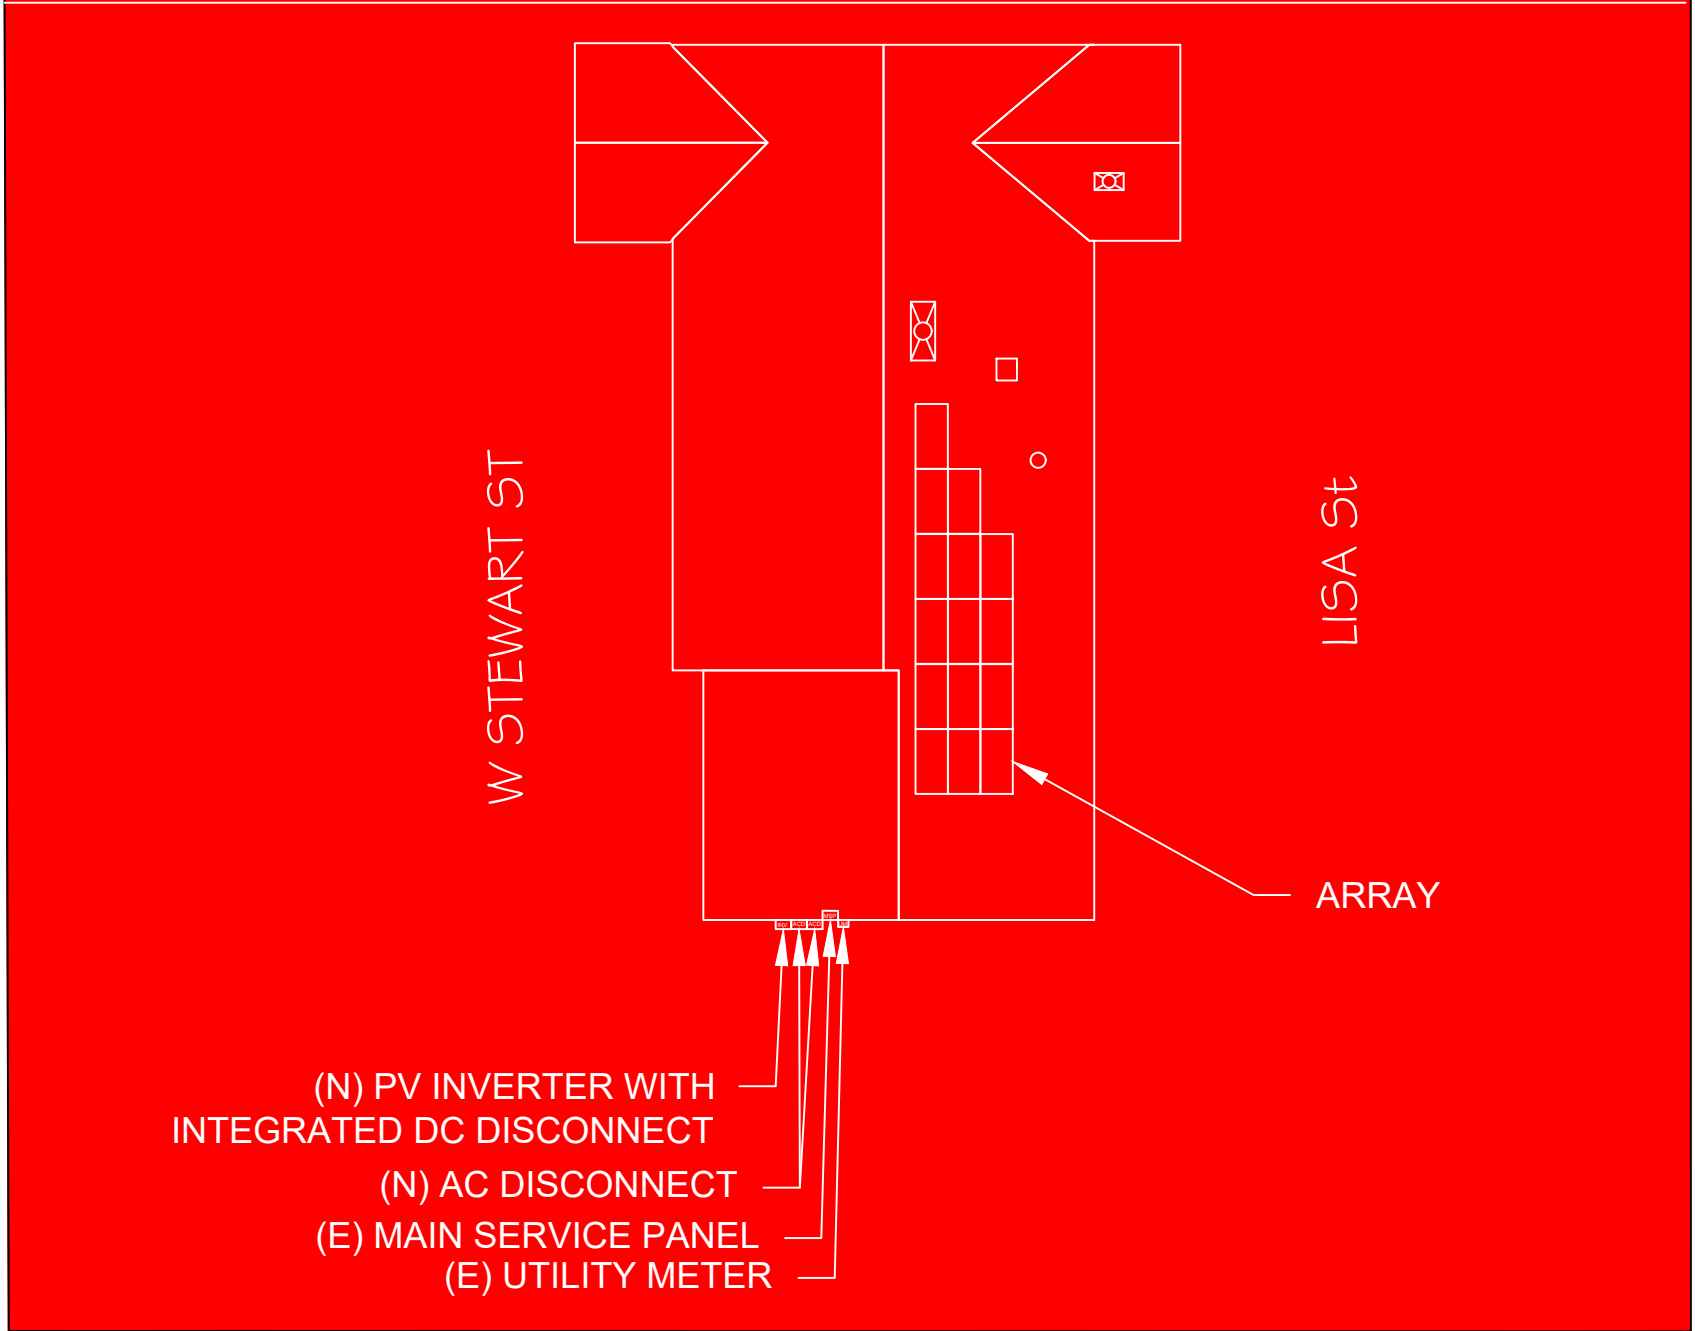

**LABEL LOCATION:**  
EACH SERVICE EQUIPMENT LOCATION AND AT THE LOCATION(S) OF THE SYSTEM DISCONNECT(S)  
FOR ALL ELECTRIC POWER PRODUCTION SOURCES CAPABLE OF BEING INTERCONNECTED  
(PER CODE: NEC 705.10)

REV/DATE: 06/07/2022



**TITAN SOLAR POWER**  
210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS  
**ROBERT MCEACHIN**  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**SIGNAGE**

SHEET SIZE  
**ANSI B  
11" X 17"**

SHEET NUMBER  
**PV-6**





# TITAN SOLAR PANEL



## Q PEAK DUO BLK ML-G10+ 395-400

ENDURING HIGH PERFORMANCE

THE IDEAL SOLUTION FOR:  
Rooftop arrays on residential buildings

**BREAKING THE 20% EFFICIENCY BARRIER**  
QANTUM DUO Z Technology with zero gap cell layout boosts module efficiency up to 20.9%.

**INDUSTRY'S MOST THOROUGH TESTING**  
Q CELLS is the first solar module manufacturer to pass the most comprehensive quality programme in the industry.  
The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.

**ENDURING HIGH PERFORMANCE**  
Long-term yield security with Anti LID Technology, Anti PID Technology<sup>1</sup>, Hot-Spot Protect and Traceable Quality Tra.Q<sup>2</sup>.

**EXTREME WEATHER RATING**  
High-tech aluminum alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).


**A RELIABLE INVESTMENT**  
Inclusive 25-year product warranty and 25-year linear performance warranty<sup>2</sup>.

**INNOVATIVE ALL-WEATHER TECHNOLOGY**  
Optimal yields, whatever the weather with excellent low-light and temperature behavior.

<sup>1</sup> APT test conditions according to IEC / TS 62804-1:2015, method A (-1500 V, 96 h)  
<sup>2</sup> See data sheet on rear for further information.

### MECHANICAL SPECIFICATION

|              |   |
|--------------|---|
| FORMAT       | 74.0 in × 41.1 in × 1.26 in (including frame)<br>(1879 mm × 1045 mm × 32 mm)                              |
| WEIGHT       | 48.5 lbs (22.0 kg)  |
| FRONT COVER  | 0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology                             |
| BACK COVER   | Composite film  |
| FRAME        | Black anodized aluminum   |
| CELL         | 6 × 22 monocrystalline Q <sub>ANTUM</sub> solar half cells  |
| JUNCTION BOX | 2.09-3.98 in × 1.26-2.36 in × 0.59-0.71 in<br>(53-101 mm × 32-60 mm × 15-18 mm), IP67, with bypass diodes |
| CABLE        | 4mm <sup>2</sup> Solar cable; (+) ≥ 49.2 in (1250 mm), (-) ≥ 49.2 in (1250 mm)                            |
| CONNECTOR    | Stäubli MC4; IP68   |

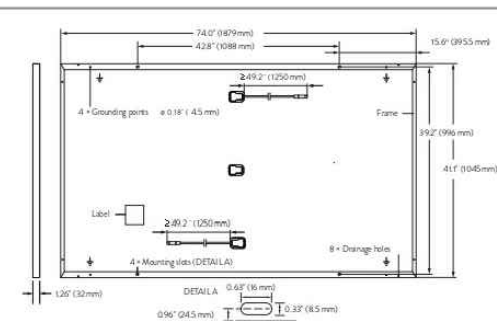


### ELECTRICAL CHARACTERISTICS

| POWER CLASS  |                      | 385   | 390   | 395   | 400   | 405   |
|--|----------------------|-------|-------|-------|-------|-------|
| <b>MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC</b> <sup>1</sup> (POWER TOLERANCE +5% W / -0% W) |                      |       |       |       |       |       |
| POWER AT MPP   | P <sub>MPP</sub> [W] | 385   | 390   | 395   | 400   | 405   |
| SHORT CIRCUIT CURRENT  | I <sub>SC</sub> [A]  | 11.04 | 11.07 | 11.10 | 11.14 | 11.17 |
| OPEN CIRCUIT VOLTAGE   | V <sub>OC</sub> [V]  | 45.19 | 45.23 | 45.27 | 45.30 | 45.34 |
| CURRENT AT MPP   | I <sub>MPP</sub> [A] | 10.59 | 10.65 | 10.71 | 10.77 | 10.83 |
| VOLTAGE AT MPP   | V <sub>MPP</sub> [V] | 36.36 | 36.62 | 36.88 | 37.13 | 37.39 |
| <b>EFFICIENCY</b>  | η [%]                | ≥19.6 | ≥19.9 | ≥20.1 | ≥20.4 | ≥20.6 |
| <b>MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT</b> <sup>2</sup>                             |                      |       |       |       |       |       |
| POWER AT MPP   | P <sub>MPP</sub> [W] | 288.8 | 292.6 | 296.3 | 300.1 | 303.8 |
| SHORT CIRCUIT CURRENT  | I <sub>SC</sub> [A]  | 8.90  | 8.92  | 8.95  | 8.97  | 9.00  |
| OPEN CIRCUIT VOLTAGE   | V <sub>OC</sub> [V]  | 42.62 | 42.65 | 42.69 | 42.72 | 42.76 |
| CURRENT AT MPP   | I <sub>MPP</sub> [A] | 8.35  | 8.41  | 8.46  | 8.51  | 8.57  |
| VOLTAGE AT MPP   | V <sub>MPP</sub> [V] | 34.59 | 34.81 | 35.03 | 35.25 | 35.46 |

<sup>1</sup> Measurement tolerances P<sub>MPP</sub> ±3%; I<sub>SC</sub>, V<sub>OC</sub> ±5% at STC: 1000W/m<sup>2</sup>, 25±2°C, AM 1.5 according to IEC 60904-3 • 800 W/m<sup>2</sup>, NMOT, spectrum AM 1.5


### Q CELLS PERFORMANCE WARRANTY

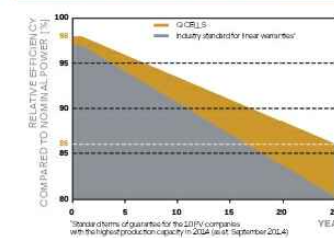

At least 98% of nominal power during first year. Thereafter max. 0.5% degradation per year. At least 93.5% of nominal power up to 10 years. At least 86% of nominal power up to 25 years.

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Q CELLS sales organisation of your respective country.

### PERFORMANCE AT LOW IRRADIANCE

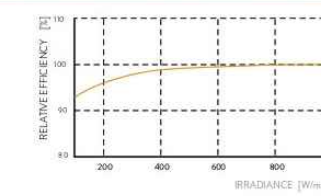

Typical module performance under low irradiance conditions in comparison to STC conditions (25 °C, 1000 W/m<sup>2</sup>)

### TEMPERATURE COEFFICIENTS

|   |   |       |       |  |      |       |                       |
|---|---|-------|-------|--|------|-------|-----------------------|
| TEMPERATURE COEFFICIENT OF I <sub>SC</sub>  | α | [%/K] | +0.04 | TEMPERATURE COEFFICIENT OF V <sub>OC</sub> | β    | [%/K] | -0.27                 |
| TEMPERATURE COEFFICIENT OF P <sub>MPP</sub> | γ | [%/K] | -0.34 | NOMINAL MODULE OPERATING TEMPERATURE       | NMOT | [°F]  | 109 ± 5.4 (43 ± 3 °C) |

### PROPERTIES FOR SYSTEM DESIGN

|   |                          |   |   |
|---|--------------------------|---|---|
| Maximum System Voltage V <sub>sys</sub> [V]                       | 1000 (IEC)/1000 (UL)     | PV module classification                        | Class II                                  |
| Maximum Series Fuse Rating [ADC]                                  | 20                       | Fire Rating based on ANSI / UL 61730            | TYPE 2                                    |
| Max. Design Load, Push / Pull <sup>2</sup> [lbs/ft <sup>2</sup> ] | 75 (3600Pa)/55 (2660Pa)  | Permitted Module Temperature on Continuous Duty | -40°F up to +185°F<br>(-40°C up to +85°C) |
| Max. Test Load, Push / Pull <sup>2</sup> [lbs/ft <sup>2</sup> ]   | 113 (5400Pa)/84 (4000Pa) |   |   |

<sup>2</sup> See Installation Manual

### QUALIFICATIONS AND CERTIFICATES

UL 61730, CE-compliant, Quality Controlled PV - TÜV Rheinland, IEC 61215:2016, IEC 61730:2016, U.S. Patent No. 9,893,215 (solar cells), QCPV Certification ongoing.



### PACKAGING INFORMATION

|                      |                    |                    |                    |                    |            |            |            |
|----------------------|--------------------|--------------------|--------------------|--------------------|------------|------------|------------|
| Horizontal packaging | 76.4 in<br>1940 mm | 43.3 in<br>1100 mm | 48.0 in<br>1220 mm | 1656 lbs<br>751 kg | 24 pallets | 24 pallets | 32 modules |
|----------------------|--------------------|--------------------|--------------------|--------------------|------------|------------|------------|

Note: Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product.



400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA  
TEL: +1 949 748 5996  
EMAIL: sales@q-cells.com



525 W Baseline Rd., Mesa, AZ, 85210  
TEL: 855.SAY.SOLAR  
EMAIL: info@titansolarpower.com



Specifications subject to technical changes © Q CELLS © PEAK DUO BLK ML-G10+ 385-405 2021-05 Rev01\_NA



### TITAN SOLAR POWER

210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

### REVISIONS

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |

Signature with Seal

### PROJECT NAME & ADDRESS

ROBERT MCEACHIN  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeen@yahoo.com

DATE: 06/07/2022

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-8

REV/DATE: 06/07/2022

# Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

12-25  
YEAR  
WARRANTY



INVERTERS

## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

| MODEL NUMBER  | SE3000H-US                      | SE3800H-US                 | SE5000H-US | SE6000H-US                 | SE7600H-US | SE10000H-US | SE11400H-US                  |     |
|---|---------------------------------|----------------------------|------------|----------------------------|------------|-------------|------------------------------|-----|
| APPLICABLE TO INVERTERS WITH PART NUMBER                                  | SEXXXXH-XXXXXBXX4               |                            |            |                            |            |             |                              |     |
| <b>OUTPUT</b>   |                                 |                            |            |                            |            |             |                              |     |
| Rated AC Power Output   | 3000                            | 3800 @ 240V<br>3300 @ 208V | 5000       | 6000 @ 240V<br>5000 @ 208V | 7600       | 10000       | 11400 @ 240V<br>10000 @ 208V | VA  |
| Maximum AC Power Output   | 3000                            | 3800 @ 240V<br>3300 @ 208V | 5000       | 6000 @ 240V<br>5000 @ 208V | 7600       | 10000       | 11400 @ 240V<br>10000 @ 208V | VA  |
| AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)                        | ✓                               | ✓                          | ✓          | ✓                          | ✓          | ✓           | ✓                            | Vac |
| AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)                        | -                               | ✓                          | -          | ✓                          | -          | -           | ✓                            | Vac |
| AC Frequency (Nominal)  | 59.3 - 60 - 60.5 <sup>(1)</sup> |                            |            |                            |            |             |                              | Hz  |
| Maximum Continuous Output Current @240V                                   | 12.5                            | 16                         | 21         | 25                         | 32         | 42          | 47.5                         | A   |
| Maximum Continuous Output Current @208V                                   | -                               | 16                         | -          | 24                         | -          | -           | 48.5                         | A   |
| Power Factor  | 1, Adjustable - 0.85 to 0.85    |                            |            |                            |            |             |                              |     |
| GFDI Threshold  | 1                               |                            |            |                            |            |             |                              | A   |
| Utility Monitoring, Islanding Protection, Country Configurable Thresholds | Yes                             |                            |            |                            |            |             |                              |     |
| <b>INPUT</b>  |                                 |                            |            |                            |            |             |                              |     |
| Maximum DC Power @240V  | 4650                            | 5900                       | 7750       | 9300                       | 11800      | 15500       | 17650                        | W   |
| Maximum DC Power @208V  | -                               | 5100                       | -          | 7750                       | -          | -           | 15500                        | W   |
| Transformer-less, Ungrounded  | Yes                             |                            |            |                            |            |             |                              |     |
| Maximum Input Voltage   | 480                             |                            |            |                            |            |             |                              | Vdc |
| Nominal DC Input Voltage  | 380                             |                            |            | 400                        |            |             |                              | Vdc |
| Maximum Input Current @240V <sup>(2)</sup>                                | 8.5                             | 10.5                       | 13.5       | 16.5                       | 20         | 27          | 30.5                         | Adc |
| Maximum Input Current @208V <sup>(2)</sup>                                | -                               | 9                          | -          | 13.5                       | -          | -           | 27                           | Adc |
| Max. Input Short Circuit Current  | 45                              |                            |            |                            |            |             |                              | Adc |
| Reverse-Polarity Protection   | Yes                             |                            |            |                            |            |             |                              |     |
| Ground-Fault Isolation Detection  | 600ka Sensitivity               |                            |            |                            |            |             |                              |     |
| Maximum Inverter Efficiency   | 99                              | 99.2                       |            |                            |            |             |                              | %   |
| CEC Weighted Efficiency   | 99                              |                            |            |                            |            |             | 99 @ 240V<br>98.5 @ 208V     | %   |
| Nighttime Power Consumption   | < 2.5                           |                            |            |                            |            |             |                              | W   |

(1) For other regional settings please contact SolarEdge support  
 (2) A higher current source may be used; the inverter will limit its input current to the values stated



TITAN SOLAR POWER

210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

ROBERT MCEACHIN  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeen@yahoo.com

DATE: 06/07/2022

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-9

# / Single Phase Inverter with HD-Wave Technology for North America


SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US/  
SE7600H-US / SE10000H-US / SE11400H-US

| MODEL NUMBER   | SE3000H-US  | SE3800H-US  | SE5000H-US  | SE6000H-US                          | SE7600H-US | SE10000H-US | SE11400H-US |
|--|---|-------------|-------------|-------------------------------------|------------|-------------|-------------|
| <b>ADDITIONAL FEATURES</b>                               |   |             |             |                                     |            |             |             |
| Supported Communication Interfaces                       | RS485, Ethernet, ZigBee (optional), Cellular (optional)                                   |             |             |                                     |            |             |             |
| Revenue Grade Metering, ANSI C12.20                      | Optional <sup>(3)</sup>   |             |             |                                     |            |             |             |
| Consumption metering                                     | Optional <sup>(3)</sup>   |             |             |                                     |            |             |             |
| Inverter Commissioning                                   | With the SetApp mobile application using Built-in Wi-Fi Access Point for Local Connection |             |             |                                     |            |             |             |
| Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12 | Automatic Rapid Shutdown upon AC Grid Disconnect  |             |             |                                     |            |             |             |
| <b>STANDARD COMPLIANCE</b>                               |   |             |             |                                     |            |             |             |
| Safety   | UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.I.L. M-07             |             |             |                                     |            |             |             |
| Grid Connection Standards                                | IEEE1547, Rule 21, Rule 14 (HI)   |             |             |                                     |            |             |             |
| Emissions  | FCC Part 15 Class B   |             |             |                                     |            |             |             |
| <b>INSTALLATION SPECIFICATIONS</b>                       |   |             |             |                                     |            |             |             |
| AC Output Conduit Size / AWG Range                       | 1" Maximum / 14-6 AWG   |             |             | 1" Maximum / 14-4 AWG               |            |             |             |
| DC Input Conduit Size / # of Strings / AWG Range         | 1" Maximum / 1-2 strings / 14-6 AWG   |             |             | 1" Maximum / 1-3 strings / 14-6 AWG |            |             |             |
| Dimensions with Safety Switch (HxWxD)                    | 17.7 x 14.6 x 6.8 / 450 x 370 x 174   |             |             | 21.3 x 14.6 x 7.3 / 540 x 370 x 185 |            |             |             |
| Weight with Safety Switch                                | 22 / 10   | 25.1 / 11.4 | 26.2 / 11.9 | 38.8 / 17.6                         |            |             |             |
| Noise  | < 25  |             |             | < 50                                |            |             |             |
| Cooling  | Natural Convection  |             |             |                                     |            |             |             |
| Operating Temperature Range                              | -40 to +140 / -40 to +60 <sup>(4)</sup>   |             |             |                                     |            |             |             |
| Protection Rating  | NEMA 4X (Inverter with Safety Switch)   |             |             |                                     |            |             |             |

(3) Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BN14. For consumption metering, current transformers should be ordered separately: SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box  
(4) Full power up to at least 50°C / 122°F; for power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>

## How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

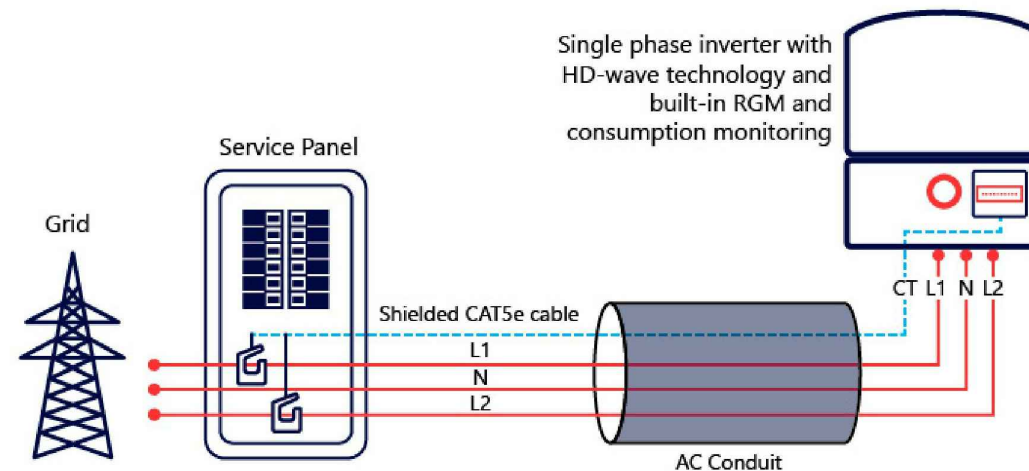

TITAN SOLAR POWER

210 N Sunway Dr.  
Gilbert, AZ 85233

[www.titansolarpower.com](http://www.titansolarpower.com)

ELECTRICAL LIC#: U.33714

### REVISIONS

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

### PROJECT NAME & ADDRESS

ROBERT MCEACHIN  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-9A

# Power Optimizer

For North America

P370 / P400 / P401 / P485 / P505



POWER OPTIMIZER

## PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

solaredge.com



# Power Optimizer For North America

P370 / P400 / P401 / P485 / P505

| Optimizer model<br>(typical module compatibility)   | P370<br>(for higher-power 60<br>and 72-cell modules) | P400<br>(for 72 & 96-<br>cell modules) | P401<br>(for high power 60<br>and 72 cell modules) | P485<br>(for high-voltage<br>modules) | P505<br>(for higher<br>current modules) |            |
|---|--|--|--|---------------------------------------|---|------------|
| <b>INPUT</b>  |  |  |  |                                       |   |            |
| Rated Input DC Power <sup>(1)</sup>   | 370  | 400                                    |  | 485                                   | 505                                     | W          |
| Absolute Maximum Input Voltage<br>(Voc at lowest temperature)   | 60   | 80                                     | 60   | 125 <sup>(2)</sup>                    | 83 <sup>(2)</sup>                       | Vdc        |
| MPPT Operating Range  | 8 - 60   | 8 - 80                                 | 8-60   | 12.5 - 105                            | 12.5 - 83                               | Vdc        |
| Maximum Short Circuit Current (Isc)   | 11   | 10.1                                   | 11.75  | 11                                    | 14                                      | Adc        |
| Maximum DC Input Current  | 13.75  | 12.5                                   | 14.65  | 12.5                                  | 17.5                                    |            |
| Maximum Efficiency  |  |  |  | 99.5                                  |   | %          |
| Weighted Efficiency   |  |  |  | 98.8                                  |   | %          |
| Overvoltage Category  |  |  |  | II                                    |   |            |
| <b>OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREEDGE INVERTER)</b>                     |  |  |  |                                       |   |            |
| Maximum Output Current  |  |  |  | 15                                    |   | Adc        |
| Maximum Output Voltage  | 60   |  | 80   |                                       |   | Vdc        |
| <b>OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREEDGE INVERTER OR SOLAREEDGE INVERTER OFF)</b> |  |  |  |                                       |   |            |
| Safety Output Voltage per Power Optimizer   |  |  |  | 1 ± 0.1                               |   | Vdc        |
| <b>STANDARD COMPLIANCE</b>  |  |  |  |                                       |   |            |
| EMC   | FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3      |  |  |                                       |   |            |
| Safety  | IEC62109-1 (class II safety), UL1741, NEC/PVRSS      |  |  |                                       |   |            |
| Material  | UL94 V-0, UV Resistant                               |  |  |                                       |   |            |
| RoHS  | Yes  |  |  |                                       |   |            |
| <b>INSTALLATION SPECIFICATIONS</b>  |  |  |  |                                       |   |            |
| Maximum Allowed System Voltage  | 1000   |  |  |                                       |   | Vdc        |
| Compatible inverters  | All SolarEdge Single Phase and Three Phase inverters |  |  |                                       |   |            |
| Dimensions (W x L x H)  | 129 x 153 x 27.5 /<br>5.1 x 6 x 1.1                  | 129 x 153 x 33.5 /<br>5.1 x 6 x 1.3    | 129 x 153 x 29.5 /<br>5.1 x 6 x 1.16               | 129 x 159 x 49.5 /<br>5.1 x 6.3 x 1.9 | 129 x 162 x 59 /<br>5.1 x 6.4 x 2.3     | mm<br>/ in |
| Weight (including cables)   | 630 / 1.4  | 750 / 1.7                              | 655 / 1.5  | 845 / 1.9                             | 1064 / 2.3                              | gr / lb    |
| Input Connector   | MC4 <sup>(3)</sup>                                   |  |  | MC4 <sup>(3)</sup>                    | MC4 <sup>(3)</sup>                      |            |
| Input Wire Length   |  |  |  | 0.16 / 0.5                            |   | m / ft     |
| Output Wire Type / Connector  | Double Insulated / MC4                               |  |  |                                       |   |            |
| Output Wire Length  |  |  |  | 1.2 / 3.9                             |   | m / ft     |
| Operating Temperature Range <sup>(4)</sup>  |  |  |  | -40 to +85 / -40 to +185              |   | °C / °F    |
| Protection Rating   |  |  |  | IP68 / Type6B                         |   |            |
| Relative Humidity   |  |  |  | 0 - 100                               |   | %          |

(1) Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed  
 (2) NEC 2017 requires max input voltage be not more than 80V  
 (3) For other connector types please contact SolarEdge  
 (4) Longer inputs wire lengths are available for use. For 0.9m input wire length order P401-xxxLxxx  
 (5) For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details: <https://www.solaredge.com/sites/default/files/temperature-derating-note-na.pdf>

| PV System Design Using a SolarEdge Inverter <sup>(6)(7)</sup> | Single Phase HD-Wave                                   | Single phase | Three Phase for 208V grid | Three Phase for 277/480V grid |                         |
|---|--|--------------|---------------------------|-------------------------------|-------------------------|
| Minimum String Length (Power Optimizers)                      | P370, P400, P401<br>P485, P505                         | 8<br>6       | 10<br>8                   | 18<br>14                      |                         |
| Maximum String Length (Power Optimizers)                      | 25   |              | 25                        | 50                            |                         |
| Maximum Power per String                                      | 5700 <sup>(8)</sup> (6000 with SE7600-US - SE11400-US) |              | 5250 <sup>(8)</sup>       | 6000 <sup>(9)</sup>           | 12750 <sup>(10)</sup> W |
| Parallel Strings of Different Lengths or Orientations         | Yes  |              |                           |                               |                         |

(6) For detailed string sizing information refer to: [http://www.solaredge.com/sites/default/files/string\\_sizing\\_na.pdf](http://www.solaredge.com/sites/default/files/string_sizing_na.pdf)  
 (7) It is not allowed to mix P485/P505 with P370/P400/P401 in one string  
 (8) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement  
 (9) For 208V grid: it is allowed to install up to 6,500W per string when the maximum power difference between each string is 1,000W  
 (10) For 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W

© SolarEdge Technologies Ltd. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/1/2022-NA. Subject to change without notice.



REV/DATE: 06/07/2022



TITAN SOLAR POWER

210 N Sunway Dr,  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

### REVISIONS

| DESCRIPTION | DATE       | REV |
|-------------|------------|-----|
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

### PROJECT NAME & ADDRESS

ROBERT MCEACHIN  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeen@yahoo.com

DATE: 06/07/2022

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE


ANSI B  
11" X 17"

SHEET NUMBER

PV-10



We support PV systems  
Formerly Everest Solar Systems

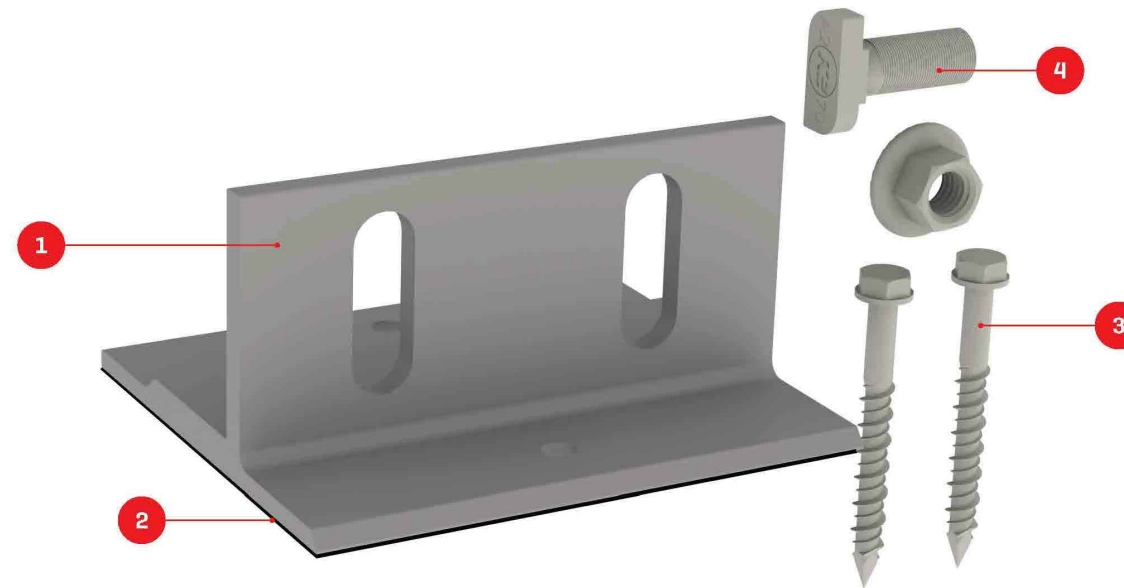

# Splice Foot X

## TECHNICAL SHEET

| Item Number | Description             | Part Number                       |
|-------------|-------------------------|-----------------------------------|
| 1           | Splice Foot X           | 4000113   Splice Foot X Kit, Mill |
| 2           | K2 Solar Seal Butyl Pad |                                   |
| 3           | M5 x 60 lag screws      |                                   |
| 4           | T-Bolt & Hex Nut Set    |                                   |

### Technical Data

| Splice Foot X   |  |
|-----------------|--|
| Roof Type       | Composition shingle                    |
| Material        | Aluminum with stainless steel hardware |
| Finish          | Mill                                   |
| Roof Connection | M5 x 60 lag screws                     |
| Code Compliance | UL 2703                                |
| Compatibility   | CrossRail 44-X, 48-X, 48-XL, 80        |

k2-systems.com



**TITAN SOLAR POWER**  
210 N Sunway Dr.  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

### PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**EQUIPMENT SPECIFICATION**


SHEET SIZE  
**ANSI B  
11" X 17"**

SHEET NUMBER  
**PV-11**

We support PV systems  
Formerly Everest Solar Systems



# CROSSRAIL 48-X



## Mechanical Properties

| CrossRail 48-X            |                          |
|---------------------------|--------------------------|
| Material                  | 6000 Series Aluminum     |
| Ultimate Tensile Strength | 37.7 ksi [260 MPa]       |
| Yield Strength            | 34.8 ksi [240 MPa]       |
| Weight                    | 0.56 lbs/ft [0.833 kg/m] |
| Finish                    | Mill or Dark Anodized    |

## Sectional Properties

| CrossRail 48-X |   |
|----------------|---|
| S <sub>x</sub> | 0.1980 in <sup>3</sup> [3.245 cm <sup>3</sup> ] |
| S <sub>y</sub> | 0.1510 in <sup>3</sup> [2.474 cm <sup>3</sup> ] |
| A [X-Section]  | 0.4650 in <sup>2</sup> [2.999 cm <sup>2</sup> ] |

Units: [mm] in



Notes:

- ▶ Structural values and span charts determined in accordance with Aluminum Design Manual and ASCE 7-16
- ▶ UL2703 Listed System for Fire and Bonding



**TITAN SOLAR POWER**  
210 N Sunway Dr.  
Gilbert, AZ 85233  
www.titansolarpower.com  
ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
RESIDENCE  
171 W STEWART ST  
COATS, NC 27521  
PH NO. (910) 658-9005  
EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**EQUIPMENT SPECIFICATION**

SHEET SIZE  
**ANSI B  
11" X 17"**

SHEET NUMBER  
**PV-12**

## A. System Specifications and Ratings

- Maximum Voltage: 1,000 Volts
- Maximum Current: 120 Amps
- Allowable Wire: 14 AWG – 6 AWG
- Spacing: Please maintain a spacing of at least ½” between uninsulated live parts and fittings for conduit, armored cable, and uninsulated live parts of opposite polarity.
- Enclosure Rating: Type 3R
- Roof Slope Range: 2.5 – 12:12
- Max Side Wall Fitting Size: 1”
- Max Floor Pass-Through Fitting Size: 1”
- Ambient Operating Conditions: (-35°C) - (+75°C)
- Compliance:
  - JB-1.XL: UL1741
  - Approved wire connectors: must conform to UL1741
- System Marking: **Interek Symbol and File #5019942**
- Periodic Re-inspections: If re-inspections yield loose components, loose fasteners, or any corrosion between components, components that are found to be affected are to be replaced immediately.

**Table 1: Typical Wire Size, Torque Loads and Ratings**

|   | 1 Conductor | 2 Conductor | Torque  |         |            |         |         |
|---|-------------|-------------|---------|---------|------------|---------|---------|
|   |             |             | Type    | NM      | Inch Lbs   | Voltage | Current |
| ABB ZS6 terminal block                    | 10-24 awg   | 16-24 awg   | Sol/Str | 0.5-0.7 | 6.2-8.85   | 600V    | 30 amp  |
| ABB ZS10 terminal block                   | 6-24 awg    | 12-20 awg   | Sol/Str | 1.0-1.6 | 8.85-14.16 | 600V    | 40 amp  |
| ABB ZS16 terminal block                   | 4-24 awg    | 10-20 awg   | Sol/Str | 1.6-2.4 | 14.6-21.24 | 600V    | 60 amp  |
| ABB M6/8 terminal block                   | 8-22 awg    |             | Sol/Str | .08-1   | 8.85       | 600V    | 50 amp  |
| Ideal 452 Red WING-NUT Wire Connector     | 8-18 awg    |             | Sol/Str |         |            | 600V    |         |
| Ideal 451 Yellow WING-NUT Wire Connector  | 10-18 awg   |             | Sol/Str |         |            | 600V    |         |
| Ideal, In-Sure Push-In Connector Part #39 | 10-14 awg   |             | Sol/Str |         |            | 600V    |         |
| WAGO, 221-612                             | 10-14 awg   |             | Sol/Str |         |            | 600V    |         |
| International Hydraulics 2S2/0            | 10-14 awg   |             | Sol/Str | 4       | 35         |         |         |
|   | 8 awg       |             | Sol/Str | 4.5     | 40         |         |         |
| Brumall 4-5,3                             | 4-6 awg     |             | Sol/Str |         | 45         | 2000V   |         |
|   | 10-14 awg   |             | Sol/Str |         | 35         |         |         |
| Blackburn LL414                           | 4-14 awg    |             | Sol/Str |         |            |         |         |

**Table 2: Minimum wire-bending space for conductors through a wall opposite terminals in mm (inches)**

| Wire size, AWG or | Wires per terminal (pole) |           |           |           |
|-------------------|---------------------------|-----------|-----------|-----------|
|                   | 1                         | 2         | 3         | 4 or More |
| kcmil (mm2)       | mm (inch)                 | mm (inch) | mm (inch) | mm (inch) |
| 14-10 (2.1-5.3)   | Not specified             | -         | -         | -         |
| 8 (8.4)           | 38.1 (1-1/2)              | -         | -         | -         |
| 6 (13.3)          | 50.8 (2)                  | -         | -         | -         |



**TITAN SOLAR POWER**  
 210 N Sunway Dr.  
 Gilbert, AZ 85233  
 www.titansolarpower.com  
 ELECTRICAL LIC#: U.33714

| REVISIONS   |            |     |
|-------------|------------|-----|
| DESCRIPTION | DATE       | REV |
| REVISION    | 06/07/2022 | A   |
|             |            |     |
|             |            |     |
|             |            |     |
|             |            |     |

Signature with Seal

PROJECT NAME & ADDRESS

**ROBERT MCEACHIN**  
**RESIDENCE**  
 171 W STEWART ST  
 COATS, NC 27521  
 PH NO. (910) 658-9005  
 EMAIL ID: firstpurplequeenme@yahoo.com

DATE: 06/07/2022

SHEET NAME  
**EQUIPMENT SPECIFICATION**

SHEET SIZE  
**ANSI B  
 11" X 17"**

SHEET NUMBER  
**PV-13**