

BURCH RESIDENCE

PHOTOVOLTAIC SYSTEM
 2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501

05-21-2022

SYSTEM SIZE: 4.00 kW-DC | 3.00 kW-AC
MODULE: (10) Q PEAK DUO BLK ML-G10+ 400 (400W)
INVERTER: (1) SOLAREEDGE SE3000H-US

GOVERNING CODES

- ALL MATERIALS, EQUIPMENT, INSTALLATION AND WORK SHALL COMPLY WITH THE FOLLOWING APPLICABLE CODES:
- 2020 NATIONAL ELECTRIC CODE
 - 2015 INTERNATIONAL BUILDING CODE
 - 2015 INTERNATIONAL RESIDENTIAL CODE
 - 2015 INTERNATIONAL PLUMBING CODE
 - 2015 INTERNATIONAL FIRE CODE
 - 2015 INTERNATIONAL MECHANICAL CODE
 - IEEE STANDARD 929
 - OSHA 29 CFR 1910.269
 - WHERE APPLICABLE, RULES OF THE PUBLIC UTILITIES COMMISSION REGARDING SAFETY AND RELIABILITY
 - THE AUTHORITY HAVING JURISDICTION
 - MANUFACTURERS' LISTINGS AND INSTALLATION INSTRUCTIONS
 - ANY OTHER LOCAL AMENDMENTS



VICINITY MAP



AERIAL MAP

GENERAL

1. UTILITY SHALL BE NOTIFIED BEFORE ACTIVATION OF PHOTOVOLTAIC SYSTEM.
2. 110.2 APPROVAL: ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION
3. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS PRIOR TO INITIATING CONSTRUCTION.
4. CONTRACTOR SHALL REVIEW ALL MANUFACTURER INSTALLATION DOCUMENTS PRIOR TO INITIATING CONSTRUCTION.
5. ALL EQUIPMENT AND ASSOCIATED CONNECTIONS, ETC, AND ALL ASSOCIATED WIRING AND INTERCONNECTIONS SHALL BE INSTALLED ONLY BY QUALIFIED PERSONNEL.
6. THE CONTRACTOR OR OWNER MUST PROVIDE ROOF ACCESS (LADDER TO ROOF) FOR ALL THE REQUIRED INSPECTIONS. LADDERS MUST BE OSHA APPROVED, MINIMUM TYPE I WITH A 250LB. RATING, IN GOOD CONDITION AND DESIGNED FOR ITS INTENDED USE.
7. CONTRACTOR SHALL VERIFY THAT THE ROOF STRUCTURE WILL WITHSTAND THE ADDITIONAL LOADS.
8. LAG SCREWS SHALL PENETRATE A MINIMUM 2" INTO SOLID SAWN STRUCTURAL MEMBERS AND SHALL NOT EXCEED MANUFACTURER RECOMMENDATIONS FOR FASTENERS INTO ENGINEERED STRUCTURAL MEMBERS.
9. AN ACCESS POINT SHALL BE PROVIDED THAT DOES NOT PLACE THE GROUND LADDER OVER OPENINGS SUCH AS WINDOWS OR DOORS ARE LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION AND IN LOCATIONS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREE LIMBS, WIRES, OR SIGNS.
10. WHERE DC CONDUCTORS ARE RUN INSIDE BUILDING, THEY SHALL BE CONTAINED IN A METAL RACEWAY; THEY SHALL NOT BE INSTALLED WITHIN 10" OF THE ROOF DECKING OR SHEATHING EXCEPT WHERE COVERED BY THE PV MODULES AND EQUIPMENT.

11. PLUMBING AND MECHANICAL VENTS THROUGH THE ROOF SHALL NOT BE COVERED BY SOLAR MODULES- - NO BUILDING, PLUMBING OR MECHANICAL VENTS TO BE COVERED, CONSTRUCTED OR ROUTED AROUND SOLAR MODULES.
12. ALL FIELD -INSTALLED JUNCTION, PULL AND OUTLET BOXES LOCATED BEHIND MODULES SHALL BE ACCESSIBLE DIRECTLY OR BY DISPLACEMENT OF A MODULE SECURED BY REMOVABLE FASTENERS.

ELECTRICAL

1. WIRING MATERIALS SHALL COMPLY WITH MAXIMUM CONTINUOUS CURRENT OUTPUT AT 25°C AND MAXIMUM VOLTAGE AT 600V; WIRE SHALL BE WET RATED AT 90°C.
2. EXPOSED PHOTOVOLTAIC SYSTEM CONDUCTORS ON THE ROOF WILL BE USE 2 OR PV-TYPE WIRE.
3. PHOTOVOLTAIC SYSTEM CONDUCTORS SHALL BE IDENTIFIED AND GROUPED. THE MEANS OF IDENTIFICATION SHALL BE PERMITTED BY SEPARATE COLOR-CODING, MARKING TAPE, TAGGING OR OTHER APPROVED MEANS.
4. ALL EXTERIOR CONDUIT, FITTINGS, AND BOXES SHALL BE RAIN-TIGHT AND APPROVED FOR USE IN WET LOCATIONS.
5. ALL METALLIC RACEWAYS AND EQUIPMENT SHALL BE BONDED AND ELECTRICALLY CONTINUOUS.
6. WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, CONTRACTOR SHALL SIZE THEM ACCORDING TO APPLICABLE CODES.
7. REMOVAL OF A UTILITY-INTERACTIVE INVERTER OR OTHER EQUIPMENT SHALL NOT DISCONNECT THE BUILDING CONNECTION BETWEEN THE GROUNDING ELECTRODE CONDUCTOR AND THE PV SOURCE AND/OR OUTPUT CIRCUIT GROUNDED CONDUCTOR.
8. FOR GROUNDED SYSTEMS, THE PHOTOVOLTAIC SOURCE AND OUTPUT CIRCUITS SHALL BE PROVIDED WITH A GROUND-FAULT PROTECTION DEVICE OR SYSTEM THAT DETECTS A GROUND FAULT, INDICATES THAT FAULT HAS OCCURED AND AUTOMATICALLY DISCONNECTS ALL CONDUCTORS OR CAUSES THE INVERTER TO AUTOMATICALLY CEASE SUPPLYING POWER TO OUTPUT CIRCUITS.

9. FOR UNGROUNDED SYSTEMS, THE INVERTER IS EQUIPPED WITH GROUND FAULT PROTECTION AND A GFI FUSE PORT FOR GROUND FAULT INDICATION.
10. PV MODULE FRAMES SHALL BE BONDED TO RACKING RAIL OR BARE COPPER GEC/GEC PER THE MODULE MANUFACTURER'S LISTED INSTRUCTION SHEET.
11. PV MODULE RACKING RAIL SHALL BE BONDED TO BARE COPPER GEC VIA WEEB LUG, ILSCO GBL-4DBT LAY-IN LUG, OR EQUIVALENT LISTED LUG.
12. THE PHOTOVOLTAIC INVERTER WILL BE LISTED AS UL 1741 COMPLIANT.
13. RACKING AND BONDING SYSTEM TO BE UL2703 RATED.
14. ANY REQUIRED GROUNDING ELECTRODE CONDUCTOR WILL BE CONTINUOUS, EXCEPT FOR SPLICES OR JOINTS AS BUS BARS WITHIN LISTED EQUIPMENT.
15. WHEN BACKFED BREAKER IS THE METHOD OF UTILITY INTERCONNECTION, THE BREAKERS SHALL NOT READ "LINE AND LOAD".
16. WHEN APPLYING THE 120% RULE, THE SOLAR BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUS BAR FROM THE MAIN BREAKER.
17. THE WORKING CLEARANCE AROUND THE EXISTING ELECTRICAL EQUIPMENT AS WELL AS THE NEW ELECTRICAL EQUIPMENT WILL BE MAINTAINED.

SHEET INDEX:

- PV-1 - COVER PAGE
- PV-2 - PROPERTY PLAN
- PV-3 - SITE PLAN
- PV-3.1 - ROOF PLAN
- PV-4 - 1-LINE DIAGRAM & CALCULATIONS
- PV-5 - LABELS
- PV-6 - ELECTRICAL PHOTOS
- PV-7 - OPTIMIZER MAP
- PV-8 - SITE SAFETY PLAN
- PV-9 - DATASHEETS
- PLACARD

BURCH , DANIEL

2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501
 (919) 906-5453

LICENSE # U.33714





TITAN SOLAR POWER
 10815 JOHN PRICE RD.,
 CHARLOTTE, NC 28273
 WWW.TITANSOLARPOWER.COM

COVER PAGE

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

REV #1:
 REV #2:
 REV #3:

PV-1

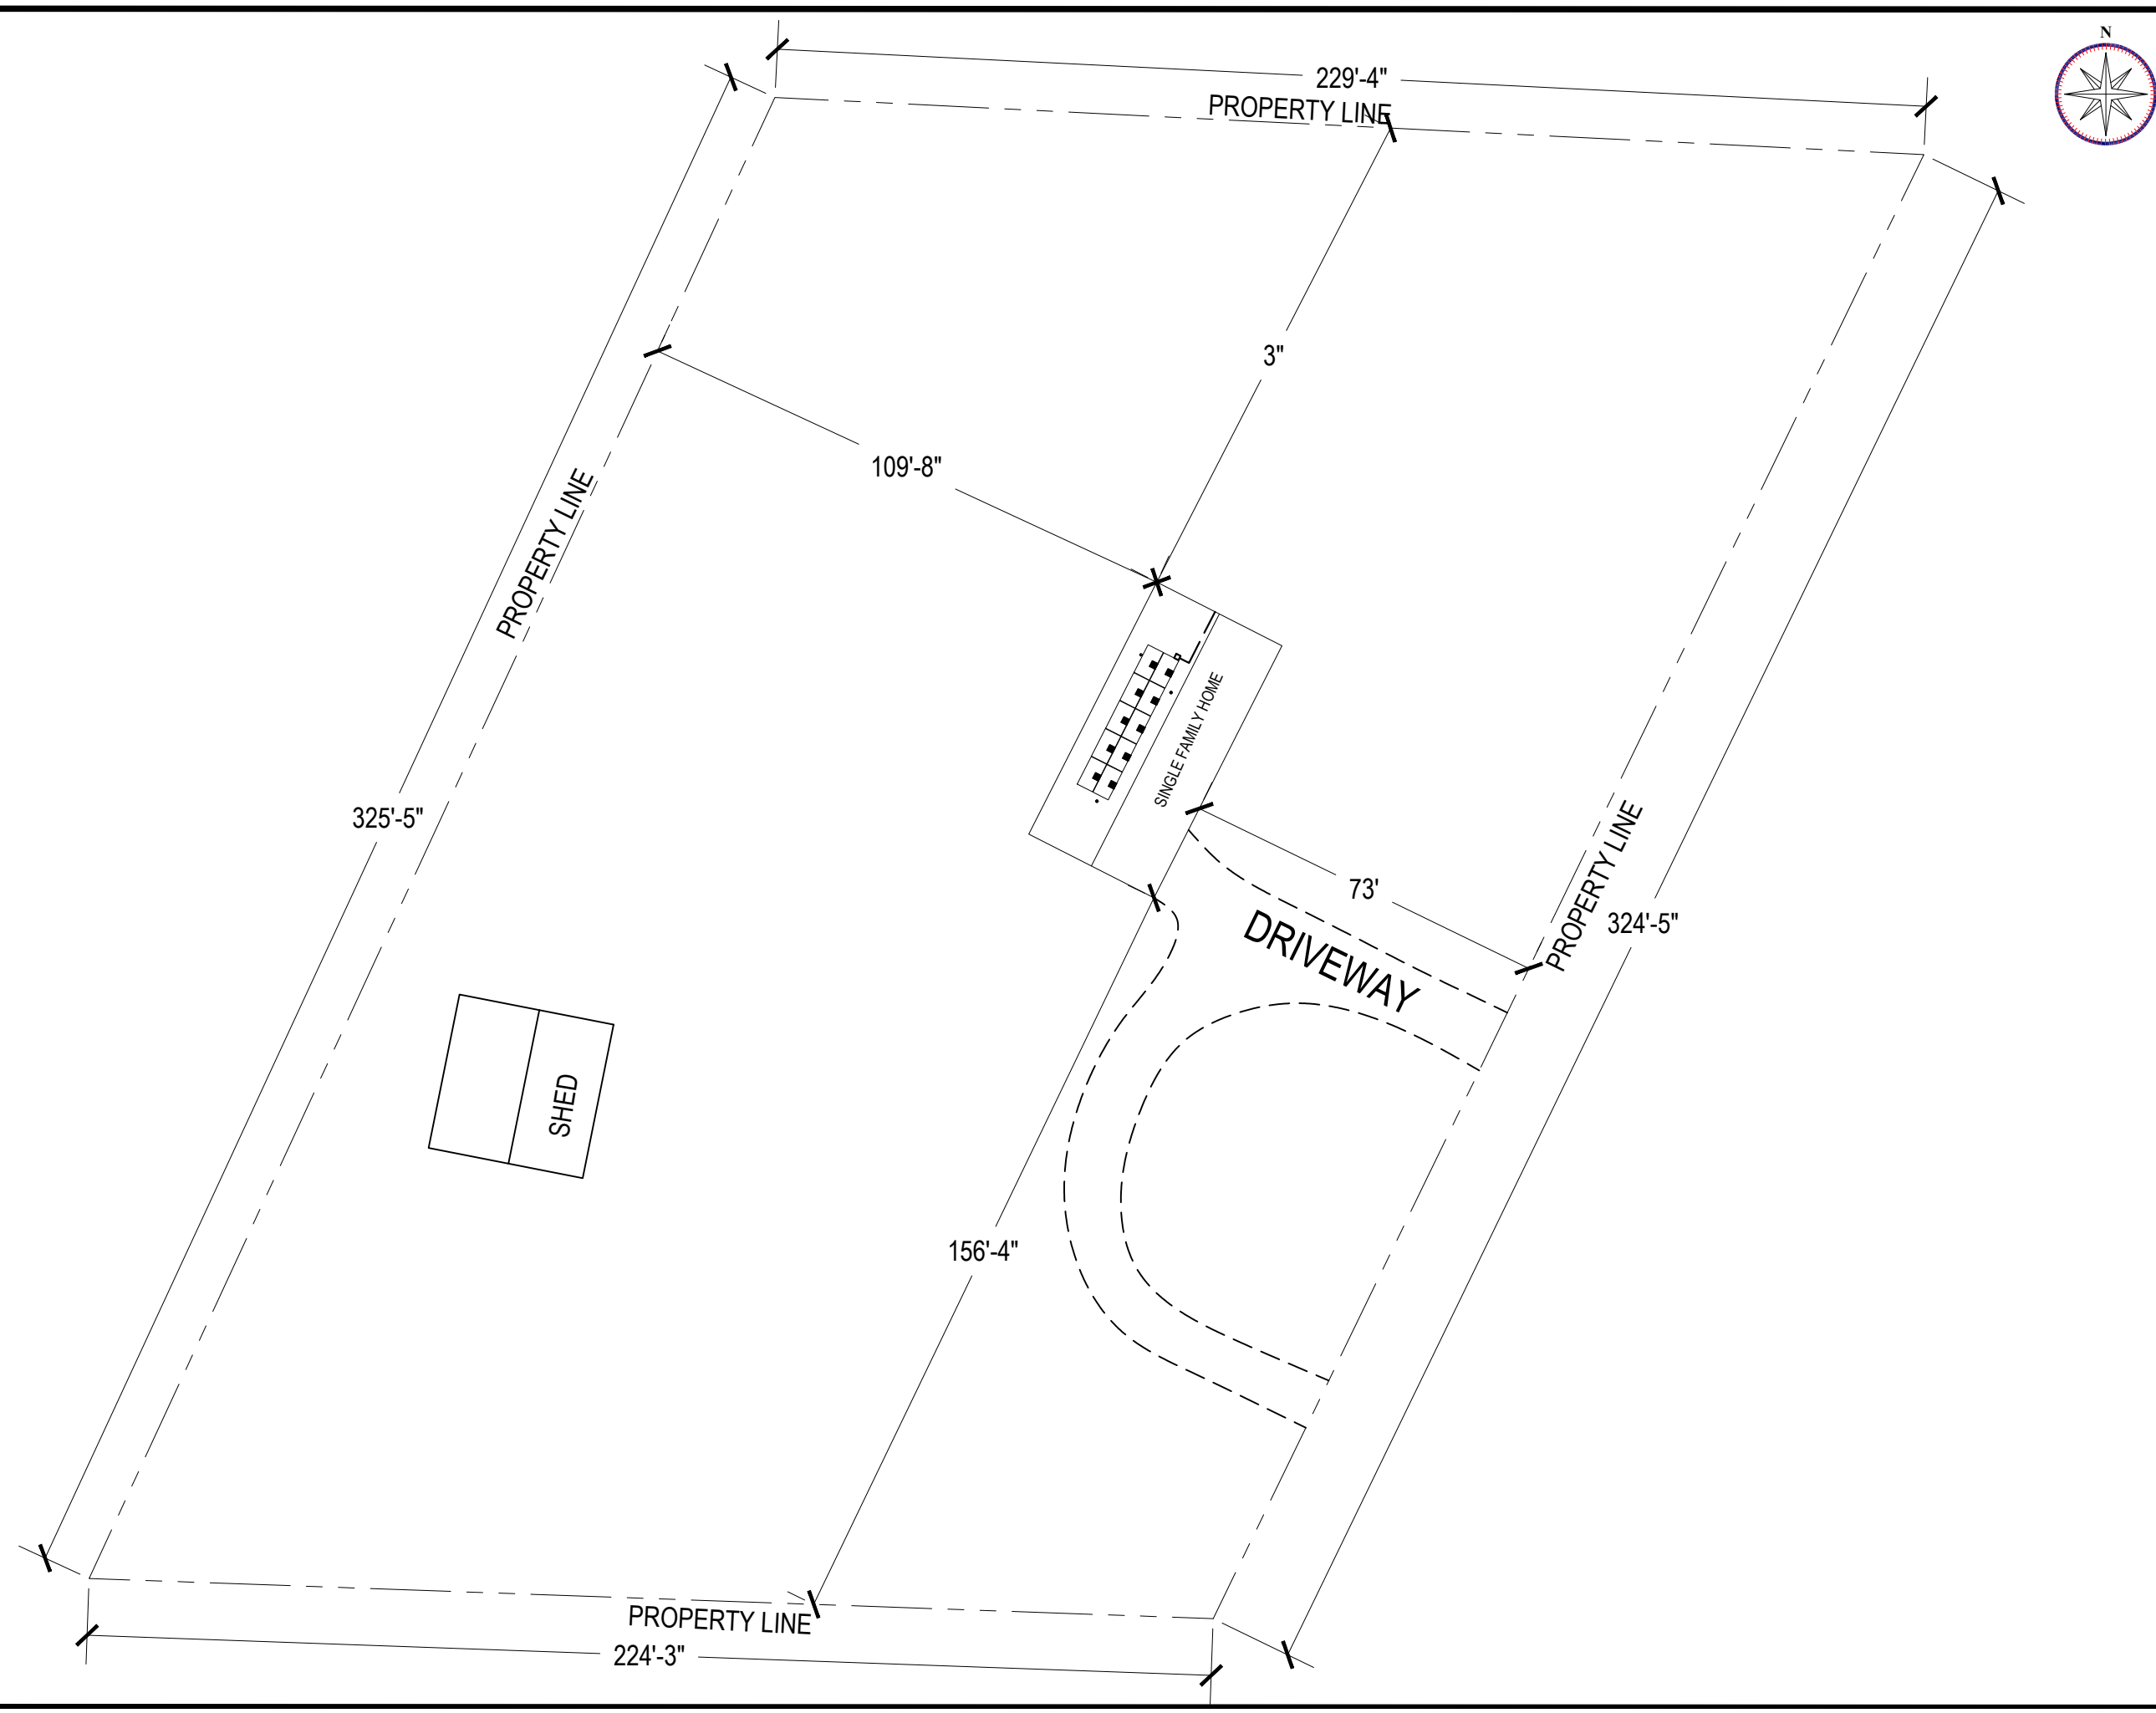

LEGEND:

- PROPERTY LINE:
- DRIVEWAY:
- APN: 0406720067

SCALE: 1/32" = 1'-0"

BURCH, DANIEL
 2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501
 (919) 906-5453

LICENSE # U.33714





PROPERTY PLAN

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-2

ROOF DETAIL	STRING DETAIL
ROOF TYPE: ASPHALT SHINGLE	SOLAREDEGE STRINGS
ROOF SECTION 1: 10 MODULES AZIMUTH: 297° PITCH: 26°	STRING # 1: 10 MODULES

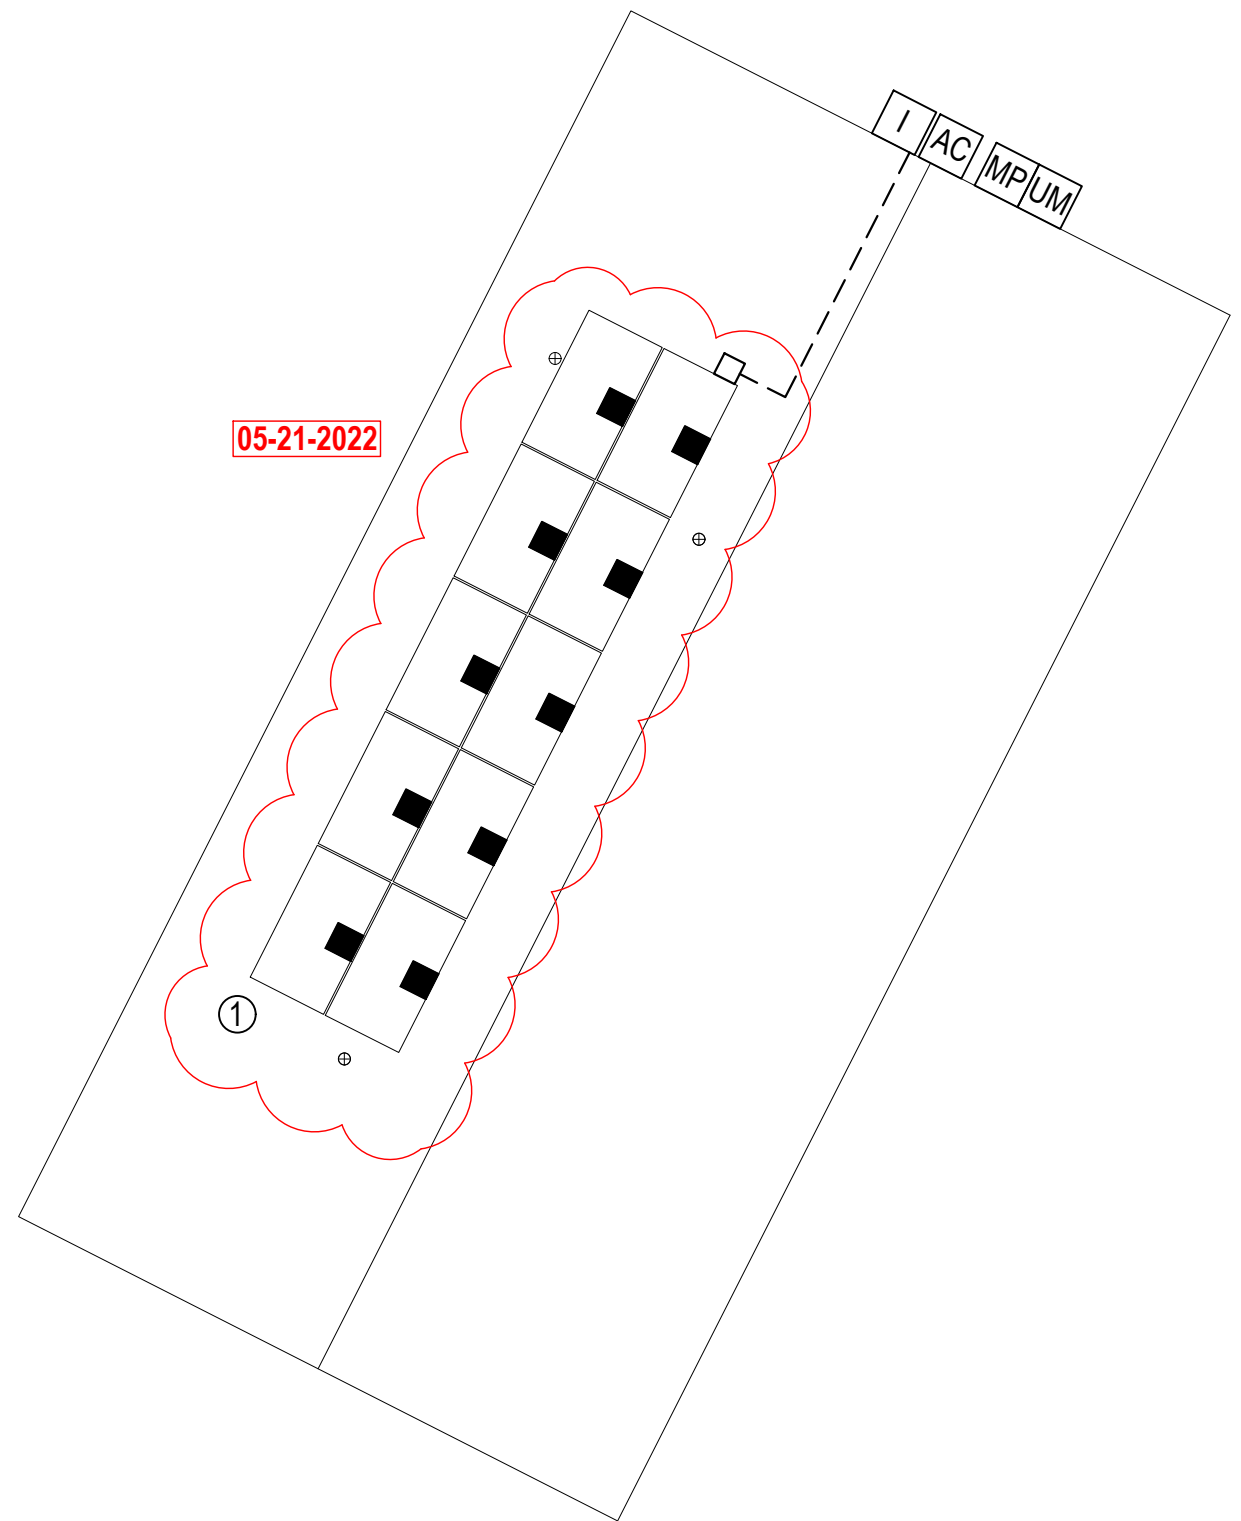

05-21-2022

SYSTEM LEGEND

PHOTOVOLTAIC SYSTEM:
DC SYSTEM SIZE: 4.00 kW
AC SYSTEM SIZE: 3.00 kW

- UM MAIN SERVICE METER AND SERVICE POINT
- MP MAIN SERVICE PANEL
- AC UTILITY AC DISCONNECT
- I (1) SOLAREDEGE SE3000H-US INVERTER WITH INTEGRATED DC DISCONNECT
- (10) Q PEAK DUO BLK ML-G10+ 400 (400W) WITH SOLAREDEGE S440 OPTIMIZERS MOUNTED UNDER EACH MODULE.
- ⊕ JUNCTION BOX AND CONDUIT

--- CONDUIT RUN ---
CONDUIT TO BE RUN IN ATTIC IF POSSIBLE, OTHERWISE CONDUIT BLOCKS MIN. 1"/MAX 6" ABOVE ROOF SURFACE, CLOSE TO RIDGE LINES, AND UNDER EAVES; TO BE PAINTED TO MATCH EXTERIOR/EXISTING BACKGROUND COLOR OF ITS LOCATION; TO BE LABELED AT MAX 10' INTERVALS. CONDUIT RUNS ARE APPROXIMATE AND ARE TO BE DETERMINED IN THE BY THE INSTALLERS

SCALE: 1/8" = 1'-0"

BURCH, DANIEL
2021 OLD BUIES CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453

LICENSE # U.33714





SITE PLAN

JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA

PV-3

ROOF DETAIL	STRING DETAIL
ROOF TYPE: ASPHALT SHINGLE	SOLAREGE STRINGS
ROOF SECTION 1: 10 MODULES AZIMUTH: 297° PITCH: 26°	STRING # 1: 10 MODULES

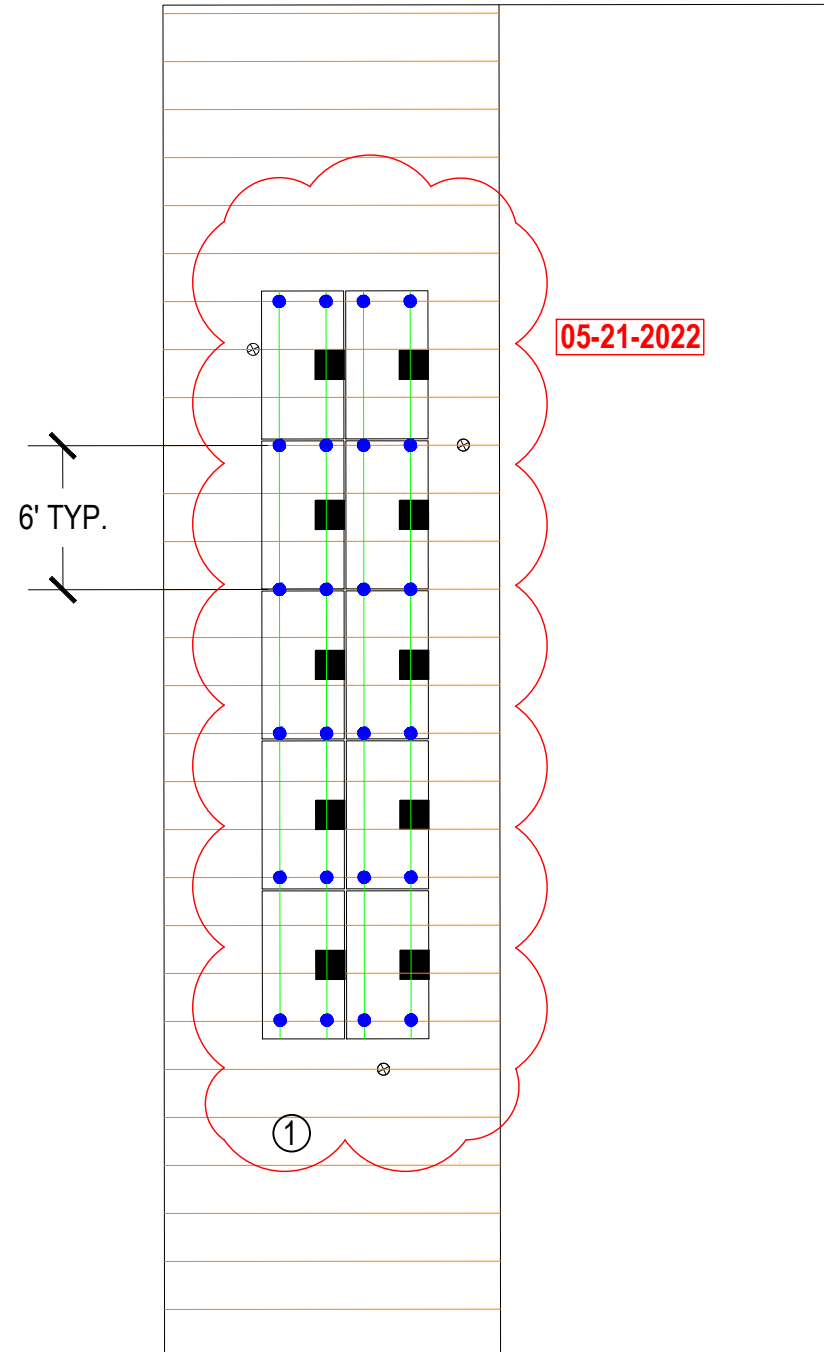

SYSTEM LEGEND	
PHOTOVOLTAIC SYSTEM:	
DC SYSTEM SIZE: 4.00 kW	
AC SYSTEM SIZE: 3.00 kW	
	ROOF ATTACHMENT POINT
	ROOF FRAMING (RAFTER/TRUSS)
	RACKING

NOTE:- 2" LAG EMBEDMENT

MODULE MECHANICAL SPECIFICATIONS	
DESIGN WIND SPEED	130 MPH
DESIGN SNOW LOAD	15 PSF
# OF STORIES	1
ROOF PITCH	26°
TOTAL ARRAY AREA (SQ. FT)	210.60
TOTAL ROOF AREA (SQ. FT)	1568
ARRAY SQ. FT / TOTAL ROOF SQ. FT	13.43%

WIND UPLIFT AT ATTACHMENT POINTS IS PROVIDED WITH THE ENGINEERING LETTER.
SUPPORT LOCATIONS HAVE BEEN OPTIMIZED TO WITHSTAND UPLIFT

SCALE: 1/8" = 1'-0"

BURCH, DANIEL
2021 OLD BUIES CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453


LICENSE # U.33714



ROOF PLAN


JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA

PV-3.1

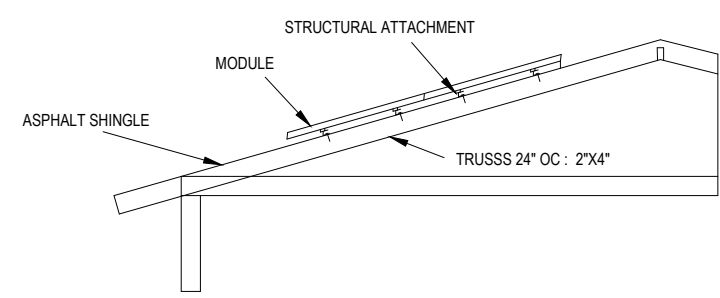

ELEVATION DETAIL

NTS

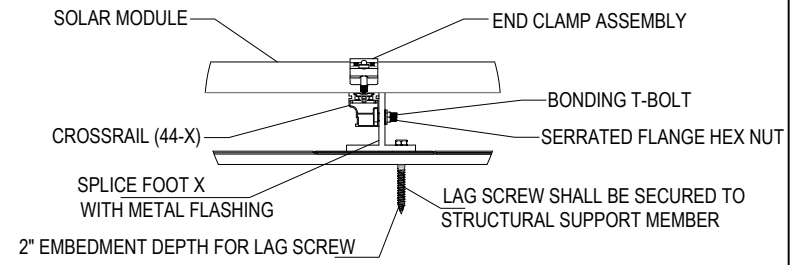


ATTACHMENT DETAIL

NTS

CONDUCTOR AND CONDUIT SCHEDULE					
TAG	WIRE TYPE	WIRE SIZE	# OF CONDUCTORS	CONDUIT TYPE	MIN. CONDUIT SIZE
1	PV WIRE	#10	2- L1 L2	FREE AIR	N/A
1	BARE COPPER	#6	1 - BARE	FREE AIR	N/A
2	THWN-2	#10	2 - L1 L2	EMT	3/4"
2	THWN-2 EGC	#8	1 - GND	EMT	3/4"
3	THWN-2	#10	3 - L1 L2 N	EMT	3/4"
3	THWN-2 EGC	#8	1 - GND	EMT	3/4"

PHOTOVOLTAIC SYSTEM:
 DC SYSTEM SIZE: 4.000 kW
 AC SYSTEM SIZE: 3.000 kW
 INVERTER: (1) SOLAREEDGE SE3000H-US
 MODULE: (10) Q PEAK DUO BLK ML-G10+ 400 (400W)

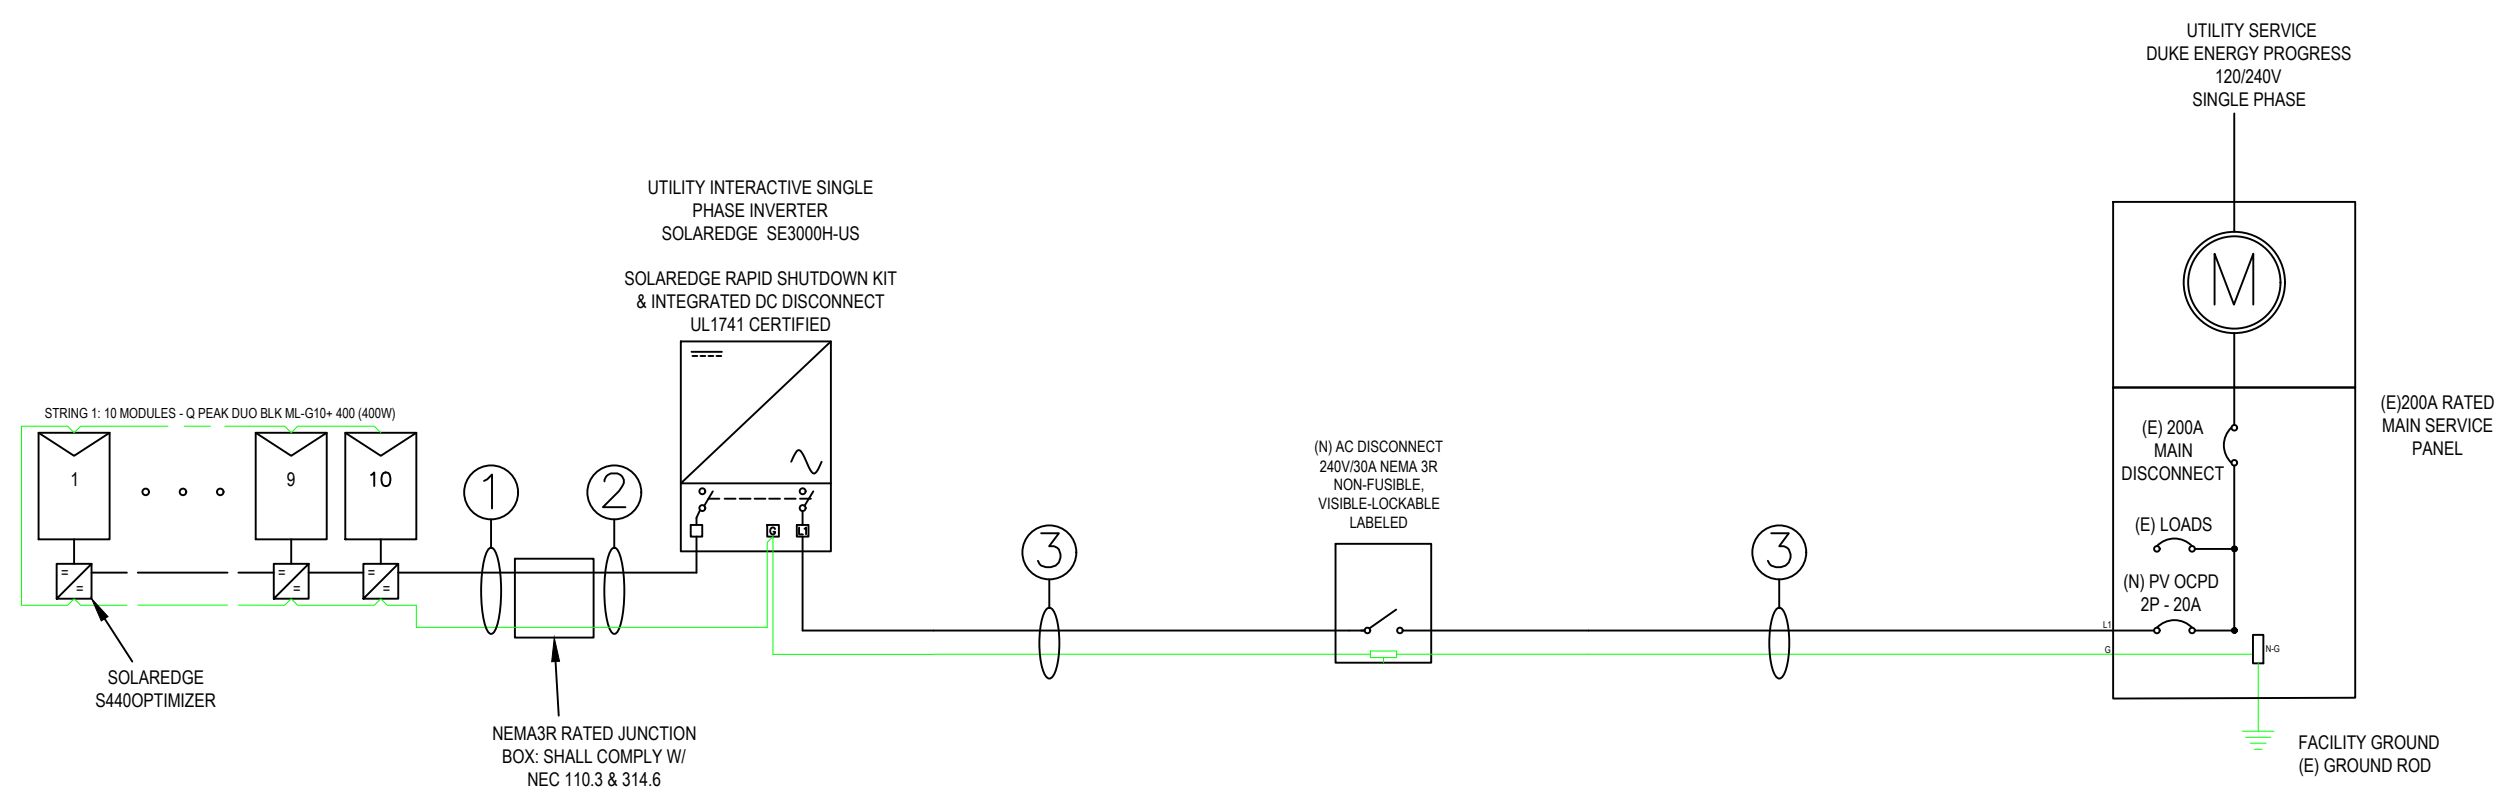

- NOTES:**
1. MODULES ARE BONDED TO RAIL USING UL 2703 RATED BONDING SYSTEM - INTEGRATED BONDING MID-CLAMPS + DIRECT-BURIAL LAY-IN-LUGS; SEE ATTACHED FOR SPECIFICATIONS IF APPLICABLE
 2. PV DC SYSTEM IS UNGROUNDED
 3. PV ARRAY WILL HAVE A GROUNDING ELECTRODE SYSTEM IN COMPLIANCE WITH CEC 250.58 AND 690.47(A)
 4. PV SOURCE, OUTPUT, AND INVERTER INPUT CIRCUIT WIRING METHODS SHALL COMPLY WITH CEC 690.1(G)
 5. BACKFED PV BREAKER WILL BE INSTALLED AT OPPOSITE END OF THE BUS BAR FROM THE MAIN BREAKER. A PERMANENT WARNING LABEL TO BE INSTALLED PER SYSTEM SIGNAGE, PAGE
 6. BARE COPPER IS TRANSITIONED TO THWN-2 VIA IRREVERSIBLE CRIMP; WHEN PRESENT, THE GEC TO BE CONTINUOUS
 7. INVERTER(S) TO BE COMPLIANT WITH UL 1741 SUPPLEMENT A
 8. CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS
 9. CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UPSIZING AS REQUIRED BY FIELD CONDITIONS.

BURCH, DANIEL
 2021 OLD BUIES CREEK, ROAD,
 ANGLER, NC 27501
 (919) 906-5453

LICENSE # U.33714



1-LINE DIAGRAM & CALCULATIONS

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-4

05-21-2022


05-21-2022

PV MODULE ELECTRICAL SPECIFICATIONS		INVERTER ELECTRICAL SPECIFICATIONS		POWER OPTIMIZER ELECTRICAL SPECIFICATIONS		OVER-CURRENT PROTECTION DEVICE (OCPD) CALCULATIONS		BUSBAR CALCULATIONS - PV BREAKER - 120% RULE	
MODULE TYPE	Q PEAK DUO BLK ML-G10+ 400	INVERTER TYPE	SOLAREEDGE SE3000H-US	OPTIMIZER TYPE	SOLAREEDGE S440	INVERTER TYPE	SOLAREEDGE 3000H-US	MAIN BUS RATING	200
POWER MAX (P _{MAX})	400W	MAX INPUT DC VOLTAGE	480V	RATED INPUT DC POWER	440W	# OF INVERTERS	1	MAIN DISCONNECT RATING	200
OPEN CIRCUIT VOLTAGE (V _{OC})	45.30V	MAX INPUT CURRENT	8.5A	MAXIMUM INPUT VOLTAGE (V _{OC})	60V	MAX CONTINUOUS OUTPUT CURRENT	12.5A	PV BREAKER RATING	20
SHORT CIRCUIT CURRENT (I _{SC})	11.14A	NOMINAL DC INPUT VOLTAGE	380V	MAXIMUM SHORT CIRCUIT CURRENT (I _{SC})	14.5A	# OF INVERTERS) X (MAX CONT. OUTPUT CURRENT) X 125% <= OCPD RATING	(1 x 12.5A x 1.25) = 15.63A <= 20A, OK	(MAIN BUS RATING x 1.2) - MAIN DISCONNECT RATING >= OCPD RATING	(200A x 1.2) - 200A >= 20A, OK
MAX POWER-POINT VOLTAGE (V _{MP})	37.13V	MAXIMUM OUTPUT POWER	3000W	MAXIMUM OUTPUT CURRENT	15A				
MAX POWER-POINT CURRENT (I _{MP})	10.77A	NOMINAL AC OUTPUT VOLTAGE	240V	MAXIMUM OUTPUT VOLTAGE	60V				
SERIES FUSE RATING	20A	MAXIMUM CONT. OUTPUT CURRENT	12.5A	MINIMUM STRING LENGTH	8				
		CEC EFFICIENCY	99%	MAXIMUM POWER PER STRING	5700W (6000W WITH SE7600- SE11400)				

CONDUCTOR AND CONDUIT SCHEDULE					
TAG	WIRE TYPE	WIRE SIZE	# OF CONDUCTORS	CONDUIT TYPE	MIN. CONDUIT SIZE
1	PV WIRE	#10	2 - L1 L2	FREE AIR	N/A
1	BARE COPPER	#6	1 - BARE	FREE AIR	N/A
2	THWN-2	#10	2 - L1 L2	EMT	3/4"
2	THWN-2 EGC	#8	1 - GND	EMT	3/4"
3	THWN-2	#10	3 - L1 L2 N	EMT	3/4"
3	THWN-2 EGC	#8	1 - GND	EMT	3/4"

PHOTOVOLTAIC SYSTEM:
 DC SYSTEM SIZE: 4.000 kW
 AC SYSTEM SIZE: 3.000 kW
 INVERTER: (1) SOLAREEDGE SE3000H-US
 MODULE: (10) Q PEAK DUO BLK ML-G10+ 400 (400W)

- NOTES:**
1. MODULES ARE BONDED TO RAIL USING UL 2703 RATED BONDING SYSTEM - INTEGRATED BONDING MID-CLAMPS + DIRECT-BURIAL LAY-IN-LUGS; SEE ATTACHED FOR SPECIFICATIONS IF APPLICABLE
 2. PV DC SYSTEM IS UNGROUNDED
 3. PV ARRAY WILL HAVE A GROUNDING ELECTRODE SYSTEM IN COMPLIANCE WITH CEC 250.58 AND 690.47(A)
 4. PV SOURCE, OUTPUT, AND INVERTER INPUT CIRCUIT WIRING METHODS SHALL COMPLY WITH CEC 690.1(G)
 5. BACKFED PV BREAKER WILL BE INSTALLED AT OPPOSITE END OF THE BUS BAR FROM THE MAIN BREAKER. A PERMANENT WARNING LABEL TO BE INSTALLED PER SYSTEM SIGNAGE, PAGE
 6. BARE COPPER IS TRANSITIONED TO THWN-2 VIA IRREVERSIBLE CRIMP; WHEN PRESENT, THE GEC TO BE CONTINUOUS
 7. INVERTER(S) TO BE COMPLIANT WITH UL 1741 SUPPLEMENT A
 8. CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS
 9. CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UPSIZING AS REQUIRED BY FIELD CONDITIONS.

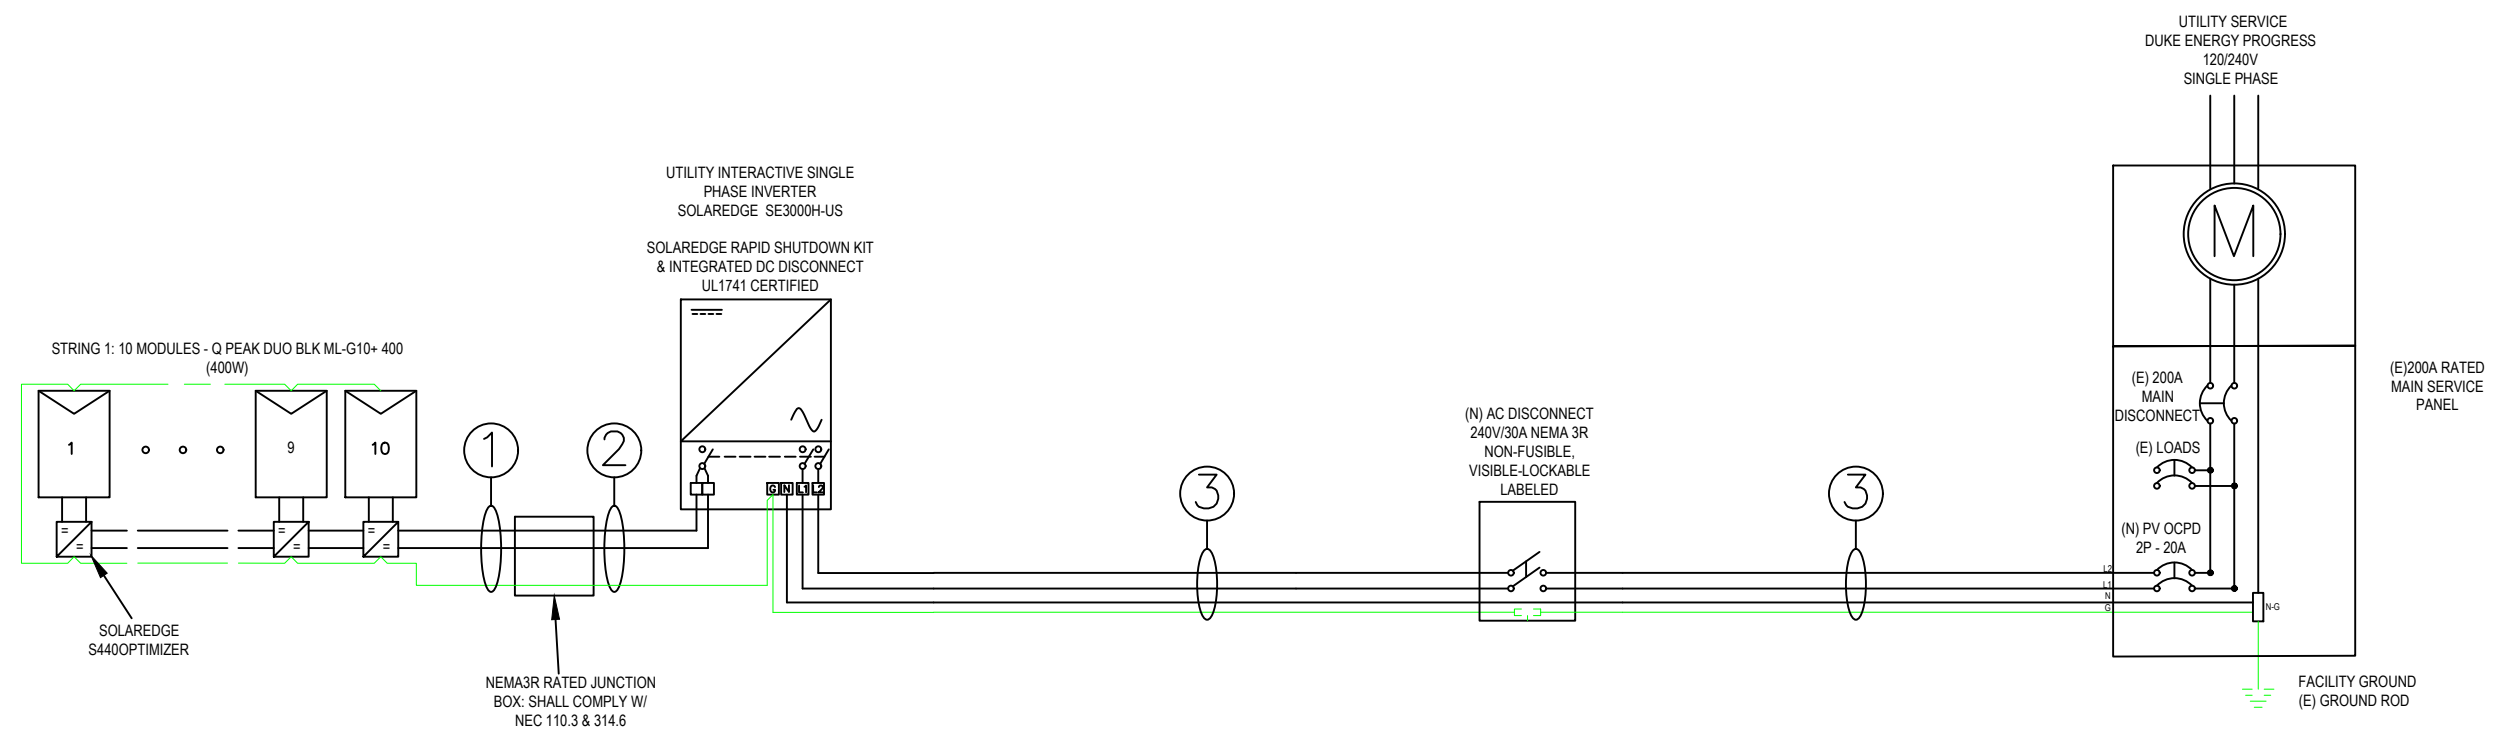

05-21-2022

05-21-2022

PV MODULE ELECTRICAL SPECIFICATIONS		INVERTER ELECTRICAL SPECIFICATIONS		POWER OPTIMIZER ELECTRICAL SPECIFICATIONS		OVER-CURRENT PROTECTION DEVICE (OCPD) CALCULATIONS		BUSBAR CALCULATIONS - PV BREAKER - 120% RULE	
MODULE TYPE	Q PEAK DUO BLK ML-G10+ 400	INVERTER TYPE	SOLAREEDGE SE3000H-US	OPTIMIZER TYPE	SOLAREEDGE S440	INVERTER TYPE	SOLAREEDGE 3000H-US	MAIN BUS RATING	200
POWER MAX (P _{MAX})	400W	MAX INPUT DC VOLTAGE	480V	RATED INPUT DC POWER	440W	# OF INVERTERS	1	MAIN DISCONNECT RATING	200
OPEN CIRCUIT VOLTAGE (V _{OC})	45.30V	MAX INPUT CURRENT	8.5A	MAXIMUM INPUT VOLTAGE (V _{OC})	60V	MAX CONTINUOUS OUTPUT CURRENT	12.5A	PV BREAKER RATING	20
SHORT CIRCUIT CURRENT (I _{SC})	11.14A	NOMINAL DC INPUT VOLTAGE	380V	MAXIMUM SHORT CIRCUIT CURRENT (I _{SC})	14.5A	# OF INVERTERS) X (MAX CONT. OUTPUT CURRENT) X 125% <= OCPD RATING	(1 x 12.5A x 1.25) = 15.63A <= 20A, OK	(MAIN BUS RATING x 1.2) - MAIN DISCONNECT RATING >= OCPD RATING	(200A x 1.2) - 200A >= 20A, OK
MAX POWER-POINT VOLTAGE (V _{MP})	37.13V	MAXIMUM OUTPUT POWER	3000W	MAXIMUM OUTPUT CURRENT	15A				
MAX POWER-POINT CURRENT (I _{MP})	10.77A	NOMINAL AC OUTPUT VOLTAGE	240V	MAXIMUM OUTPUT VOLTAGE	60V				
SERIES FUSE RATING	20A	MAXIMUM CONT. OUTPUT CURRENT	12.5A	MINIMUM STRING LENGTH	8				
		CEC EFFICIENCY	99%	MAXIMUM POWER PER STRING	5700W (6000W WITH SE7600- SE11400)				

BURCH, DANIEL
 2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501
 (919) 906-5453

LICENSE # U.33714



3-LINE DIAGRAM & CALCULATIONS

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-4.1

1 **CAUTION**
PHOTOVOLTAIC SYSTEM
CIRCUIT IS BACKFED
LOCATION: BACKFEED BREAKER
CODE REF: NEC 705.12(4)

2 **WARNING**
POWER SOURCE OUTPUT CONNECTION:
DO NOT RELOCATE THIS
OVERCURRENT DEVICE
LOCATION: BACKFEED BREAKER
CODE REF: 2017 NEC 705.12(2)(3)(B)

3 **WARNING**
A GENERATION SOURCE IS CONNECTED TO THE SUPPLY
(UTILITY) SIDE OF THE MAIN SERVICE DISCONNECT. FOLLOW
THE PROPER LOCK-OUT/TAG-OUT PROCEDURES TO ENSURE
THE PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH IS
OPENED PRIOR TO PERFORMING WORK ON THIS DEVICE
LOCATION: (IF APPLICABLE)
SUPPLY SIDE TAP
LOAD PANEL
CODE REF: UTILITY

4 **PHOTOVOLTAIC AC DISCONNECT**
RATED AC OPERATING CURRENT: 12.5A AC
NOMINAL OPERATING AC VOLTAGE: 240V AC
LOCATION: MAIN PANEL
AC DISCONNECT(S)
CODE REF: NEC 690.54

5 **RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM**
LOCATION: MAIN PANEL (EXTERIOR)
PV BREAKER (INTERIOR)
CODE REF: NEC 690.56(C)(3)
REFLECTIVE STICKER

6 **WARNING**
ELECTRIC SHOCK HAZARD
TERMINALS ON BOTH LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION.
LOCATION: COMBINER PANEL
AC DISCONNECT
JUNCTION BOX
INVERTER(S)
CODE REF: NEC 690.13(B)


7 **PHOTOVOLTAIC
SYSTEM METER**
LOCATION: DEDICATED KWH METER
CODE REF: UTILITY

8 **WARNING**
PHOTOVOLTAIC SYSTEM
COMBINER PANEL
DO NOT ADD LOADS
LOCATION: AC COMBINER PANEL
CODE REF: NEC 690.13(B)

9 **WARNING**
MAXIMUM VOLTAGE: 480 VDC
MAXIMUM CIRCUIT CURRENT: 8.5 ADC
MAX RATED OUTPUT CURRENT OF
THE CHARGE CONTROLLER
OR DC-TO-DC CONVERTER
(IF INSTALLED): 8.5 ADC
LOCATION: DC DISCONNECT
INVERTER
CODE REF: NEC 690.53

10 **WARNING**
ELECTRIC SHOCK HAZARD
TERMINALS ON BOTH LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION.
DC VOLTAGE IS ALWAYS PRESENT
WHEN SOLAR MODULES ARE
EXPOSED TO SUNLIGHT
LOCATION: DC DISCONNECT,
COMBINER BOX
CODE REF: NEC 690.13(B)

11 **SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN**
TURN RAPID SHUTDOWN
SWITCH TO THE "OFF"
POSITION TO SHUTDOWN
PV SYSTEM AND REDUCE
SHOCK HAZARD IN ARRAY
LOCATION: MAIN SERVICE
CODE REF: NEC 690.12
NEC 690.56(C)(1)(a)
YELLOW STICKER



12 **WARNING: PHOTOVOLTAIC POWER SOURCE**
LOCATION: DC CONDUIT
JUNCTION BOX
NO MORE THAN 10FT
CODE REF: NEC 690.31(G)(3)(4)
REFLECTIVE AND WEATHER RESISTANT.

13 **CAUTION**
DUAL POWER SOURCE
SECOND SOURCE IS
PHOTOVOLTAIC
LOCATION: SERVICE METER
MAIN PANEL
CODE REF: UTILITY

14 **WARNING**
INVERTER OUTPUT CONNECTION
DO NOT RELOCATE THIS
OVERCURRENT DEVICE
LOCATION: (IF APPLICABLE)
SERVICE PANEL
CODE REF: 705.12(D)(7)

15 **PHOTOVOLTAIC SYSTEM
UTILITY DISCONNECT SYSTEM**
LOCATION: AC DISCONNECT
CODE REF: UTILITY
REFLECTIVE STICKER

16 **PV SOLAR BREAKER**
DO NOT RELOCATE THIS
OVERCURRENT DEVICE
LOCATION: MAIN PANEL (EXTERIOR)
PV BREAKER (INTERIOR)
CODE REF: NEC 705.12(B)(2)(3)(B)

Label requires capitalized letters minimum height 3/8 inch white letters on red background. Labels shall be placed on interior and exterior DC conduit, raceways, enclosures and cable assemblies every 10 feet, within 1 foot of turns or bends and within 1 foot above and below penetrations of roof/ceiling assemblies, walls or barriers.

ALL SIGNAGE MUST BE PERMANENTLY ATTACHED AND BE WEATHER RESISTANT/SUNLIGHT RESISTANT AND CANNOT BE HAND-WRITTEN PER NEC 110.21(B)

PERMANENT PLAQUE OR DIRECTORY PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS IF NOT IN THE SAME LOCATION [NEC 690.56(B)]

WHERE THE PV SYSTEMS ARE REMOTELY LOCATED FROM EACH OTHER, A DIRECTORY IN ACCORDANCE WITH 705.10 SHALL BE PROVIDED AT EACH PV SYSTEM DISCONNECTING MEANS. PV SYSTEM EQUIPMENT AND DISCONNECTING MEANS SHALL NOT BE INSTALLED IN BATHROOMS [NEC 690.4(D),(E)]

LABELING NOTES

- 1.1 LABELING REQUIREMENTS BASED ON THE 2020 NATIONAL ELECTRICAL CODE, INTERNATIONAL FIRE CODE 605.11, OSHA STANDARD 1910.145, ANSI Z535
- 1.2 MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
- 1.3 LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.
- 1.4 LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8" AND PERMANENTLY AFFIXED.
- 1.5 ALERTING WORDS TO BE COLOR CODED. "DANGER" WILL HAVE RED BACKGROUND; "WARNING" WILL HAVE ORANGE BACKGROUND; "CAUTION" WILL HAVE YELLOW BACKGROUND. [ANSI Z535]

LABELS ARE NOT DRAWN TO SCALE

BURCH, DANIEL
2021 OLD BUIES CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453


LICENSE # U.33714

TITAN
SOLAR POWER
TITAN SOLAR POWER
10815 JOHN PRICE RD.,
CHARLOTTE, NC 28273
WWW.TITANSOLARPOWER.COM

ELECTRICAL LABELS

JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA

PV-5

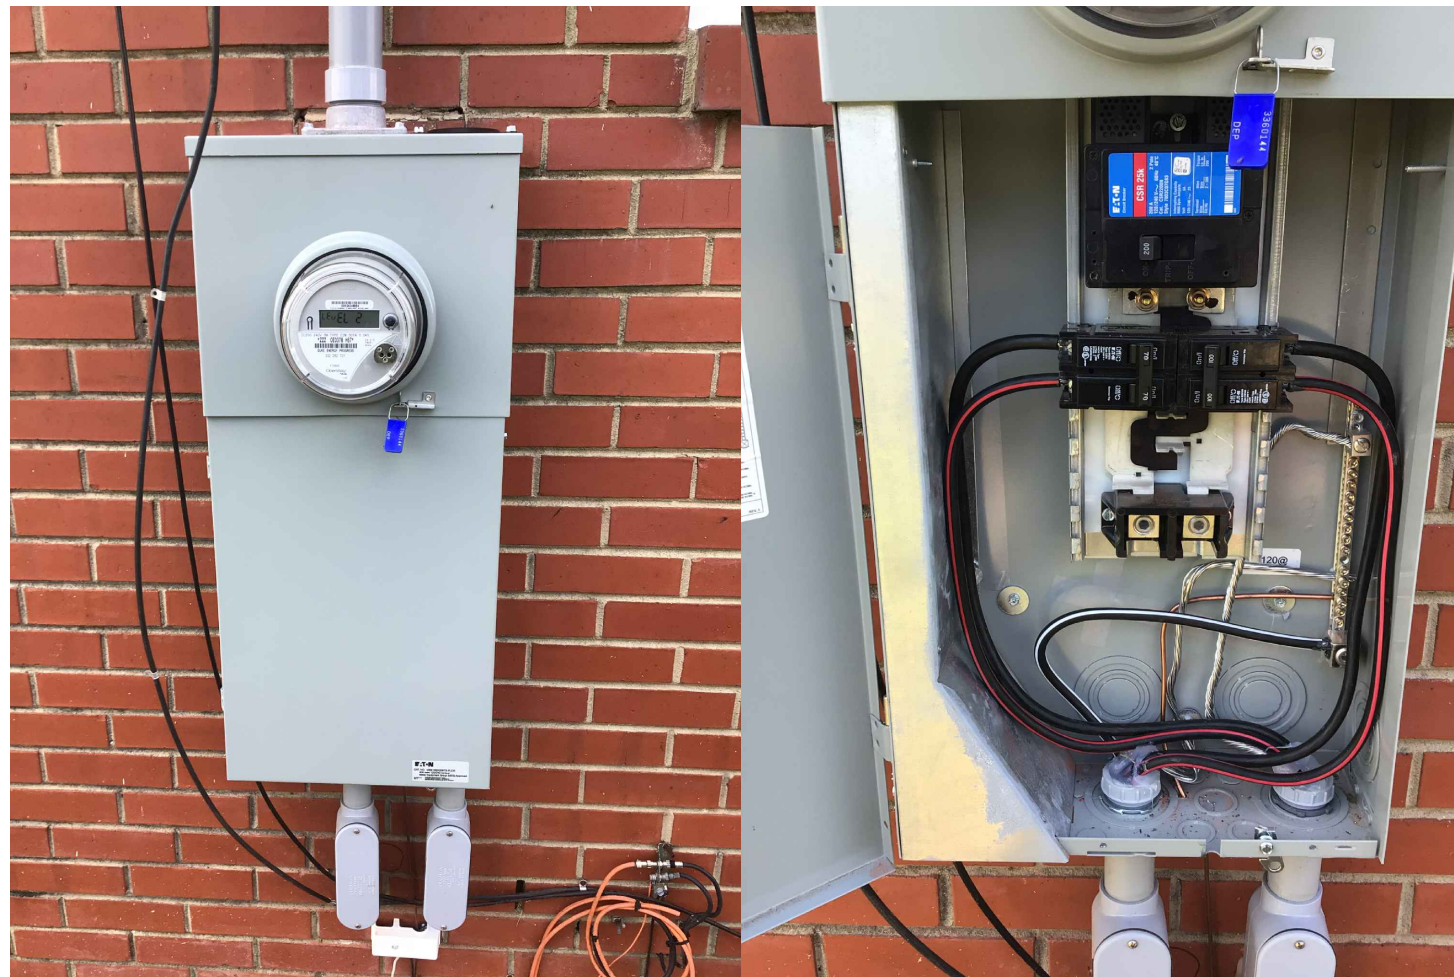

BURCH, DANIEL
 2021 OLD BUIES CREEK ROAD,
 ANGIER, NC 27501
 (919) 906-5453


LICENSE # U.33714

TITAN
 SOLAR POWER
 TITAN SOLAR POWER
 10815 JOHN PRICE RD.,
 CHARLOTTE, NC 28273
 WWW.TITANSOLARPOWER.COM

ELECTRICAL PHOTOS

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-6

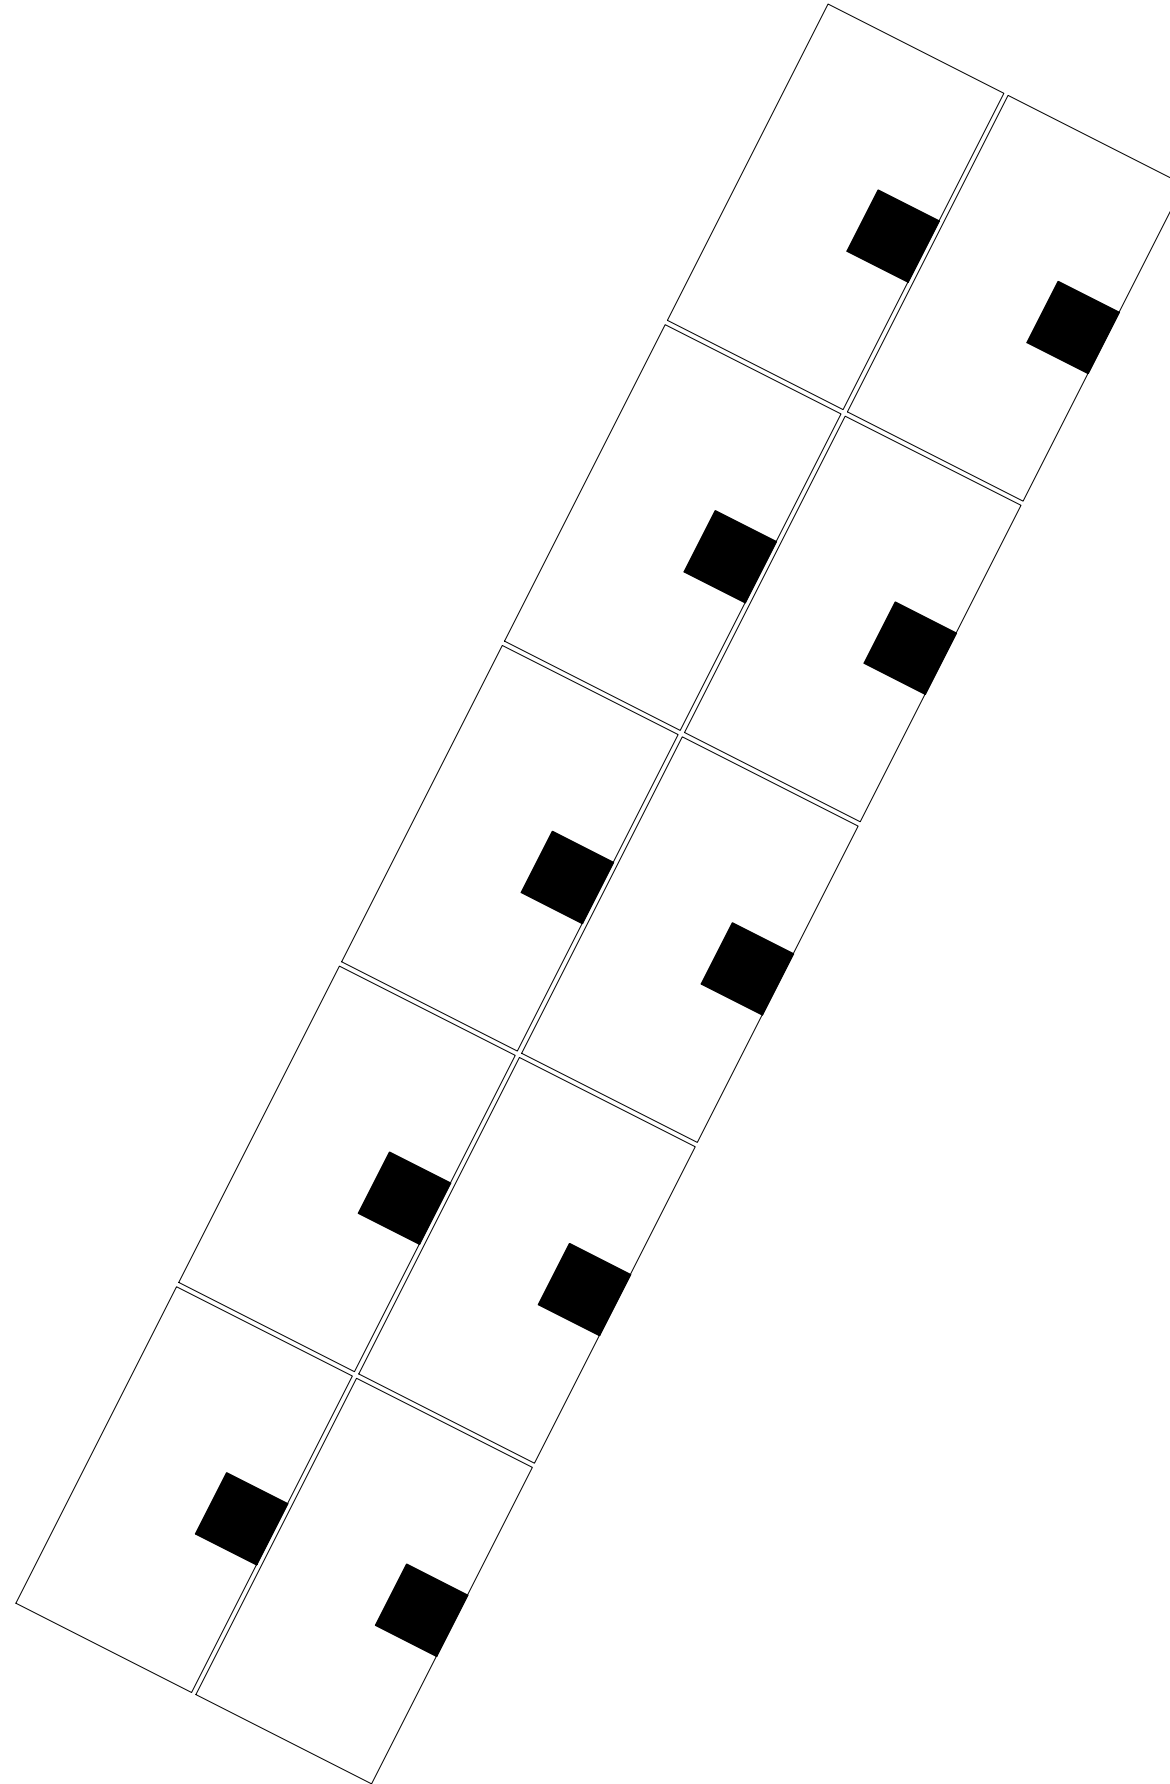

FOR INSTALLER USE ONLY

BURCH , DANIEL
2021 OLD BUIES CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453


LICENSE # U.33714

**TITAN**
SOLAR POWER
TITAN SOLAR POWER
10815 JOHN PRICE RD.,
CHARLOTTE, NC 28273
WWW.TITANSOLARPOWER.COM

OPTIMIZER MAP

JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA


PV-7



SITE SAFETY CHECKLIST:

1. LADDER LOCATION	
2. RAZ ZONE	
3. TRUCK	
4. ANCHORS	
5. EGRESS ANCHOR (FPU)	
6. WATER LOCATION	
7. ENTRY POINTS TO HOME	
8. ROOF FALL HAZARDS	
9. EMERGENCY GATHERING POINT	

NOTE: INSTALL CREW TO MARK LOCATIONS ON DAY OF CONSTRUCTION

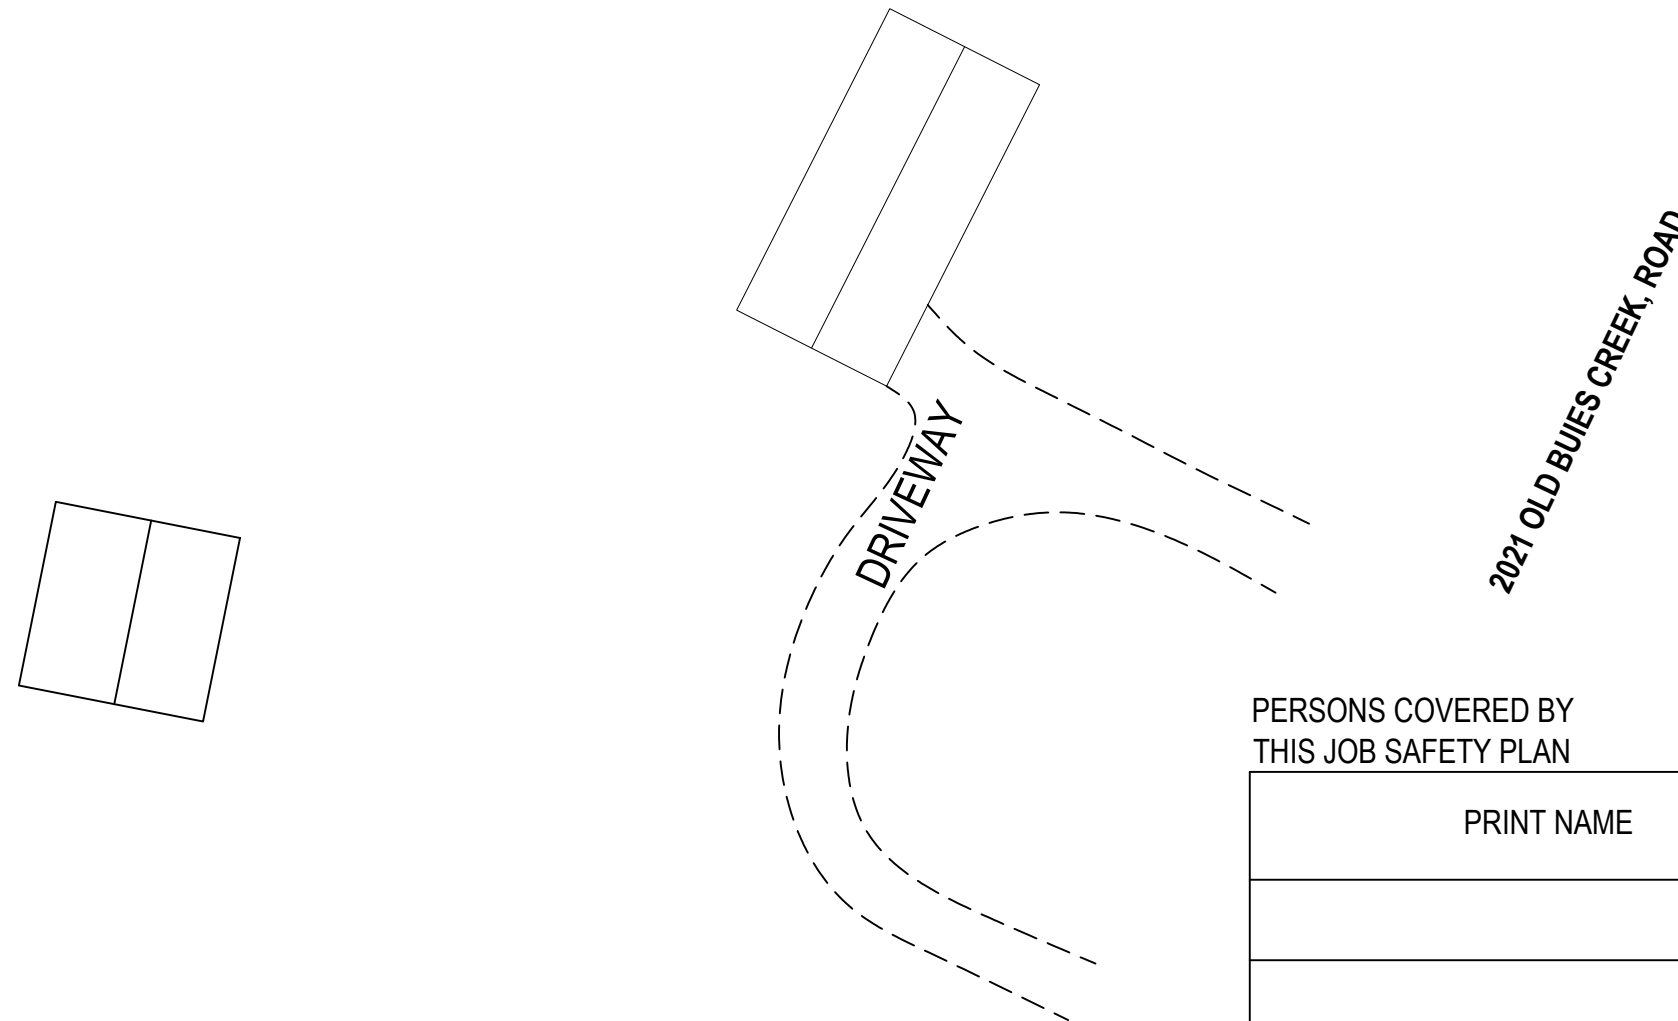

PERSONS COVERED BY THIS JOB SAFETY PLAN

INJURED AT WORK TODAY? INITIAL YES OR NO

PRINT NAME	INITIAL	YES	NO

SCALE: 1/32" = 1'-0"

BURCH, DANIEL
2021 OLD BUIESS CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453

LICENSE # U.33714



SITE SAFETY PLAN

JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA

PV-8

FOR INSTALLER USE ONLY




CAUTION



POWER TO THIS BUILDING IS SUPPLIED FROM THE FOLLOWING
SOURCES WITH DISCONNECTS LOCATED AS SHOWN

SERVICE 1 OF 1

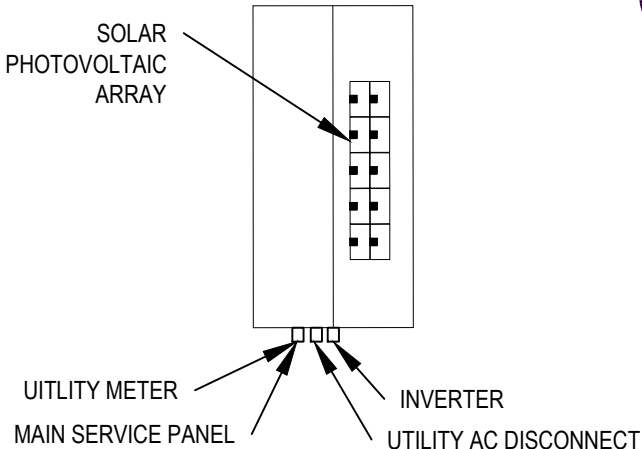

2021 OLD BUIES CREEK, ROAD, ANGIER, NC 27501

05-21-2022



TITAN SOLAR PANEL



Q CELLS



BREAKING THE 20% EFFICIENCY BARRIER
Q.ANTUM DUO Z Technology with zero gap cell layout boosts module efficiency up to 20.9 %.



INDUSTRY'S MOST THOROUGH TESTING
Q CELLS is the first solar module manufacturer to pass the most comprehensive quality programme in the industry:
The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.



ENDURING HIGH PERFORMANCE
Long-term yield security with Anti LID Technology, Anti PID Technology¹, Hot-Spot Protect and Traceable Quality Tra.Q™.



EXTREME WEATHER RATING
High-tech aluminum alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).



A RELIABLE INVESTMENT
Inclusive 25-year product warranty and 25-year linear performance warranty².



INNOVATIVE ALL-WEATHER TECHNOLOGY
Optimal yields, whatever the weather with excellent low-light and temperature behavior.


¹ APT test conditions according to IEC / TS 62804-1:2015, method A (-1500 V, 96 h)
² See data sheet on rear for further information.

Q PEAK DUO BLK ML-G10+
395-400 ENDURING HIGH PERFORMANCE

THE IDEAL SOLUTION FOR:
Rooftop arrays on residential buildings

MECHANICAL SPECIFICATION

FORMAT	74.0 in × 41.1 in × 1.26 in (including frame) (1879 mm × 1045 mm × 32 mm)
WEIGHT	48.5 lbs (22.0 kg)
FRONT COVER	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
BACK COVER	Composite film
FRAME	Black anodized aluminum
CELL	6 × 22 monocrystalline Q.ANTUM solar half cells
JUNCTION BOX	2.09-3.98 in × 1.26-2.36 in × 0.59-0.71 in (53-101 mm × 32-60 mm × 15-18 mm), IP67, with bypass diodes
CABLE	4 mm ² Solar cable; (+) ≥ 49.2 in (1250 mm), (-) ≥ 49.2 in (1250 mm)
CONNECTOR	Stäubli MC4; IP68

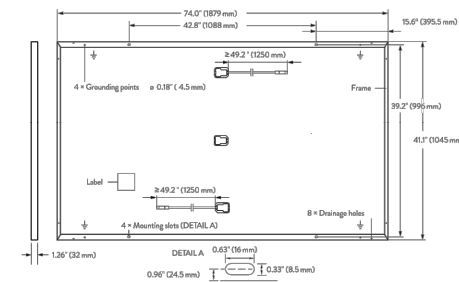


ELECTRICAL CHARACTERISTICS

POWER CLASS		385	390	395	400	405
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC ¹ (POWER TOLERANCE +5% W / -0% W)						
POWER AT MPP	P _{MPP} [W]	385	390	395	400	405
SHORT CIRCUIT CURRENT	I _{SC} [A]	11.04	11.07	11.10	11.14	11.17
OPEN CIRCUIT VOLTAGE	V _{OC} [V]	45.19	45.23	45.27	45.30	45.34
CURRENT AT MPP	I _{MPP} [A]	10.59	10.65	10.71	10.77	10.83
VOLTAGE AT MPP	V _{MPP} [V]	36.36	36.62	36.88	37.13	37.39
EFFICIENCY	η [%]	≥19.6	≥19.9	≥20.1	≥20.4	≥20.6
MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT ²						
POWER AT MPP	P _{MPP} [W]	288.8	292.6	296.3	300.1	303.8
SHORT CIRCUIT CURRENT	I _{SC} [A]	8.90	8.92	8.95	8.97	9.00
OPEN CIRCUIT VOLTAGE	V _{OC} [V]	42.62	42.65	42.69	42.72	42.76
CURRENT AT MPP	I _{MPP} [A]	8.35	8.41	8.46	8.51	8.57
VOLTAGE AT MPP	V _{MPP} [V]	34.59	34.81	35.03	35.25	35.46

¹ Measurement tolerances P_{MPP} ±3%; I_{SC}, V_{OC} ±5% at STC: 1000 W/m², 25 ±2 °C, AM 1.5 according to IEC 60904-3 • 800 W/m², NMOT, spectrum AM 1.5


Q CELLS PERFORMANCE WARRANTY

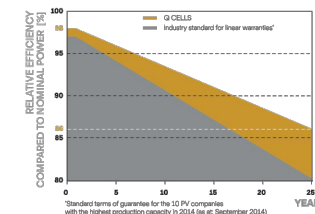

At least 98 % of nominal power during first year. Thereafter max. 0.5% degradation per year. At least 93.5% of nominal power up to 10 years. At least 86 % of nominal power up to 25 years.

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Q CELLS sales organisation of your respective country.

PERFORMANCE AT LOW IRRADIANCE

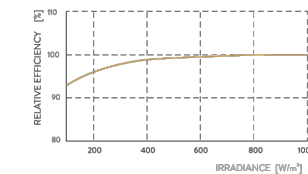

Typical module performance under low irradiance conditions in comparison to STC conditions (25 °C, 1000 W/m²)

TEMPERATURE COEFFICIENTS

TEMPERATURE COEFFICIENT OF I _{SC}	α [%/K]	+0.04	TEMPERATURE COEFFICIENT OF V _{OC}	β [%/K]	-0.27
TEMPERATURE COEFFICIENT OF P _{MPP}	γ [%/K]	-0.34	NOMINAL MODULE OPERATING TEMPERATURE	NMOT [°F]	109 ± 5.4 (43 ± 3 °C)

PROPERTIES FOR SYSTEM DESIGN

Maximum System Voltage V _{sys} [V]	1000 (IEC) / 1000 (UL)	PV module classification	Class II
Maximum Series Fuse Rating [A DC]	20	Fire Rating based on ANSI / UL 61730	TYPE 2
Max. Design Load, Push / Pull ³ [(lbs/ft ²)]	75 (3600 Pa) / 55 (2660 Pa)	Permitted Module Temperature on Continuous Duty	-40 °F up to +185 °F (-40 °C up to +85 °C)
Max. Test Load, Push / Pull ³ [(lbs/ft ²)]	113 (5400 Pa) / 84 (4000 Pa)		

³ See Installation Manual

QUALIFICATIONS AND CERTIFICATES

UL 61730, CE-compliant, Quality Controlled PV - TÜV Rheinland, IEC 61215:2016, IEC 61730:2016, U.S. Patent No. 9,893,215 (solar cells), QCPV Certification ongoing.



PACKAGING INFORMATION

Horizontal packaging	78.4 in 1940 mm	43.3 in 1100 mm	48.0 in 1220 mm	1656 lbs 751 kg	24 pallets	24 pallets	32 modules
----------------------	--------------------	--------------------	--------------------	--------------------	------------	------------	------------

Note: Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product.



400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA
TEL: +1 949 748 5996
EMAIL: sales@q-cells.com.



525 W Baseline Rd., Mesa, AZ, 85210
TEL: 855.SAY.SOLAR
EMAIL: info@titansolarpower.com



Specifications subject to technical changes © Q CELLS Q PEAK DUO BLK ML-G10+ 385-405 2021-05 Rev.01_NA

BURCH, DANIEL
2021 OLD BUIES CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453

LICENSE # U.33714

TITAN SOLAR POWER
TITAN SOLAR POWER
10815 JOHN PRICE RD.,
CHARLOTTE, NC 28273
WWW.TITANSOLARPOWER.COM

MODULES DATASHEET

JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA

PV-9.1

Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US



INVERTERS

/ Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
APPLICABLE TO INVERTERS WITH PART NUMBER	SEXXXXH-XXXXXBXX4							
OUTPUT								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac
AC Frequency (Nominal)	59.3 - 60 - 60.5 ⁽¹⁾							Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A
Power Factor	1, Adjustable - 0.85 to 0.85							
GFDI Threshold	1							A
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes							
INPUT								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded	Yes							
Maximum Input Voltage	480							Vdc
Nominal DC Input Voltage	380							Vdc
Maximum Input Current @240V ⁽²⁾	8.5	10.5	13.5	16.5	20	27	30.5	Adc
Maximum Input Current @208V ⁽²⁾	-	9	-	13.5	-	-	27	Adc
Max. Input Short Circuit Current	45							Adc
Reverse-Polarity Protection	Yes							
Ground-Fault Isolation Detection	600ko Sensitivity							
Maximum Inverter Efficiency	99	99.2						%
CEC Weighted Efficiency	99						99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption	< 2.5							W

(1) For other regional settings please contact SolarEdge support
 (2) A higher current source may be used; the inverter will limit its input current to the values stated

Optimized installation with HD-Wave technology

- / Specifically designed to work with power optimizers
- / Record-breaking 99% weighted efficiency
- / Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- / Fixed voltage inverter for longer strings
- / Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12
- / UL1741 SA certified, for CPUC Rule 21 grid compliance
- / Small, lightweight, and easy to install both outdoors or indoors
- / Built-in module-level monitoring
- / Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



BURCH, DANIEL
 2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501
 (919) 906-5453

LICENSE # U.33714



INVERTER DATASHEET

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-9.2

Power Optimizer For North America

S440, S500



POWER OPTIMIZER

PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detects abnormal PV connector behavior, preventing potential safety issues*
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Faster installations with simplified cable management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)

* Functionality subject to inverter model and firmware version

solaredge.com



Power Optimizer For North America


S440, S500

	S440	S500	Unit
INPUT			
Rated Input DC Power ⁽¹⁾	440	500	W
Absolute Maximum Input Voltage (Voc)	60		Vdc
MPPT Operating Range	8 - 60		Vdc
Maximum Short Circuit Current (Isc) of Connected PV Module	14.5	15	Adc
Maximum Efficiency	99.5		%
Weighted Efficiency	98.6		%
Overvoltage Category	II		
OUTPUT DURING OPERATION			
Maximum Output Current	15		Adc
Maximum Output Voltage	60		Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM INVERTER OR INVERTER OFF)			
Safety Output Voltage per Power Optimizer	1		Vdc
STANDARD COMPLIANCE			
Photovoltaic Rapid Shutdown System	NEC 2014, 2017 & 2020		
EMC	FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3		
Safety	IEC62109-1 (class II safety), UL1741		
Material	UL94 V-0, UV Resistant		
RoHS	Yes		
Fire Safety	VDE-AR-E 2100-712:2013-05		
INSTALLATION SPECIFICATIONS			
Maximum Allowed System Voltage	1000		Vdc
Dimensions (W x L x H)	129 x 155 x 30 / 5.07 x 6.10 x 1.18		mm / in
Weight (including cables)	655 / 1.5		gr / lb
Input Connector	MC4 ⁽²⁾		
Input Wire Length	0.1 / 0.32		m / ft
Output Connector	MC4		
Output Wire Length	(+) 2.3, (-) 0.10 / (+) 7.54, (-) 0.32		m / ft
Operating Temperature Range ⁽³⁾	-40 to +85		°C
Protection Rating	IP68 / NEMA6P		
Relative Humidity	0 - 100		%

(1) Rated power of the module at STC will not exceed the Power Optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed
 (2) For other connector types please contact SolarEdge
 (3) For ambient temperature above +70°C / +158°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details

PV System Design Using a SolarEdge Inverter	Single Phase HD-Wave	Three Phase 208V Grid	Three Phase for 277/480V Grid	
Minimum String Length (Power Optimizers)	S440, S500	8	10	18
Maximum String Length (Power Optimizers)	25			50 ⁽⁴⁾
Maximum Nominal Power per String ⁽⁵⁾	5700 (6000 with SE7600-US - SE11400-US)	6000 ⁽⁶⁾	12750 ⁽⁷⁾	W
Parallel Strings of Different Lengths or Orientations	Yes			

(4) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement
 (5) If the inverters rated AC power ≤ maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power. Refer to: <https://www.solaredge.com/sites/default/files/se-power-optimizer-single-string-design-application-note.pdf>
 (6) For the 208V grid: it is allowed to install up to 7,800W per string, two minimum string count are required and up to 7,200W without minimum string count. The maximum power difference between each string is 1,000W
 (7) For the 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W
 (8) It is not allowed to mix S-series and P-series Power Optimizers in new installations

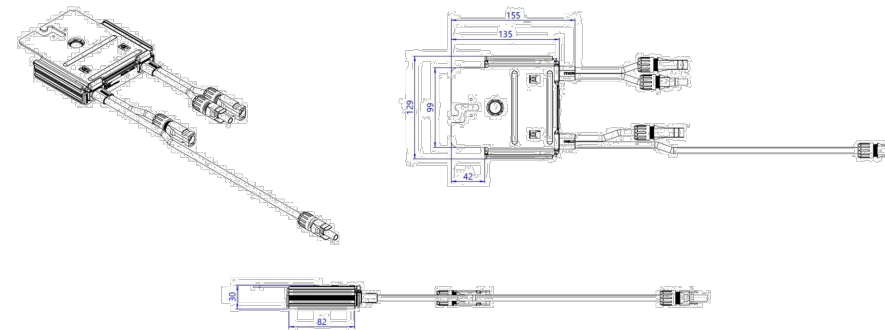

© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12-Dec-2021 DS-000018-NA. Subject to change without notice.



BURCH, DANIEL
 2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501
 (919) 906-5453

LICENSE # U.33714

TITAN
 SOLAR POWER
 TITAN SOLAR POWER
 10815 JOHN PRICE RD.,
 CHARLOTTE, NC 28273
 WWW.TITANSOLARPOWER.COM


OPTIMIZER DATASHEET

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-9.3



NEW!

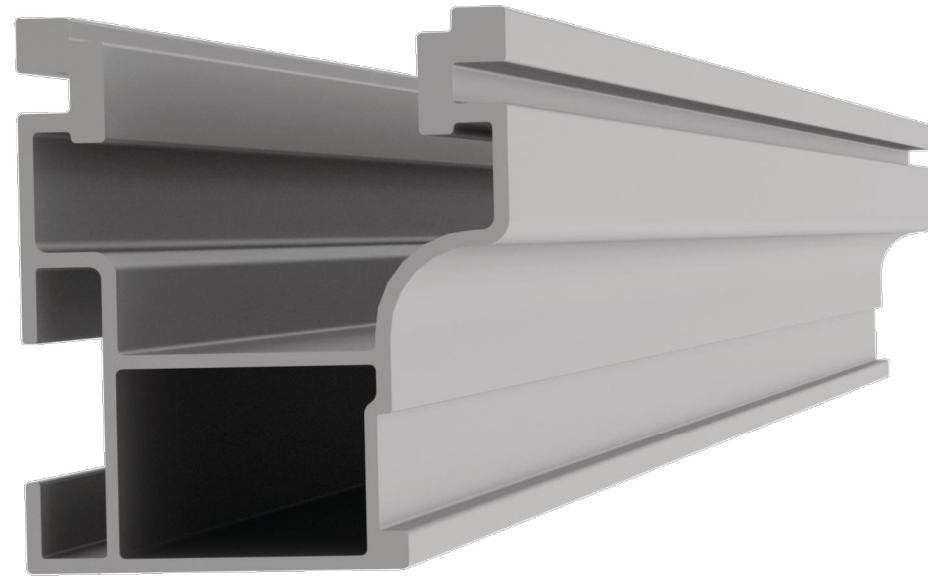


NEW PRODUCT

CrossRail 44-X

- ▶ Optimized rail profile
- ▶ One rail for all markets
- ▶ Built-in wire management
- ▶ Maintains same structural integrity as 48-X
- ▶ Tested up to 200 mph winds
- ▶ Tested up to 100 PSF snow loads



Part Number	Description
4000019	CrossRail 44-X 166", Mill
4000020	CrossRail 44-X 166", Dark
4000021	CrossRail 44-X 180", Mill
4000022	CrossRail 44-X 180", Dark
4000051	RailConn Set, CR 44-X, Mill
4000052	RailConn Set, CR 44-X, Dark
4000067	End Cap, Black, CR 44-X

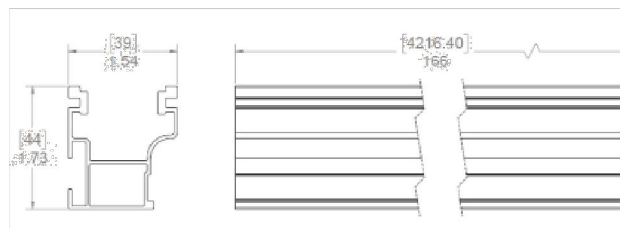

BURCH, DANIEL
 2021 OLD BUIES CREEK, ROAD,
 ANGIER, NC 27501
 (919) 906-5453

LICENSE # U.33714


TITAN
 SOLAR POWER
 TITAN SOLAR POWER
 10815 JOHN PRICE RD.,
 CHARLOTTE, NC 28273
 WWW.TITANSOLARPOWER.COM

RACKING DATASHEET

JOB #: TSP103269
 DATE: 5/21/2022
 DRAWN BY: DA

PV-9.4

We support PV systems
Formerly Everest Solar Systems

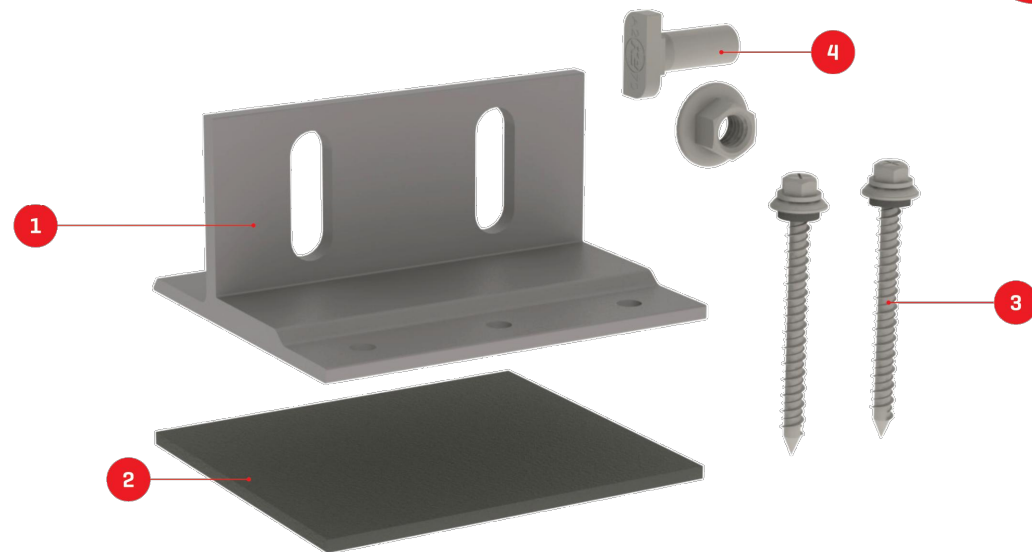

Splice Foot X

Patent Pending

TECHNICAL SHEET

Item Number	Description	Part Number
1	Splice Foot X	4000113 Splice Foot X Kit, Mill
2	K2 FlexFlash Butyl	
3	M5 x 60 lag screws	
4	T-Bolt & Hex Nut Set	

Technical Data





	Splice Foot X
Roof Type	Composition shingle
Material	Aluminum with stainless steel hardware
Finish	Mill
Roof Connection	M5 x 60 lag screws
Code Compliance	UL 2703
Compatibility	CrossRail 44-X, 48-X, 48-XL, 80

k2-systems.com

We support PV systems
Formerly Everest Solar Systems



Units: [in] mm

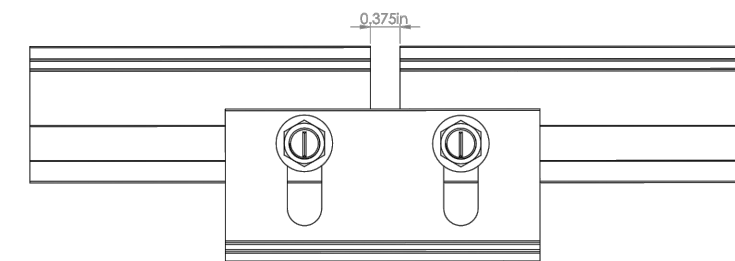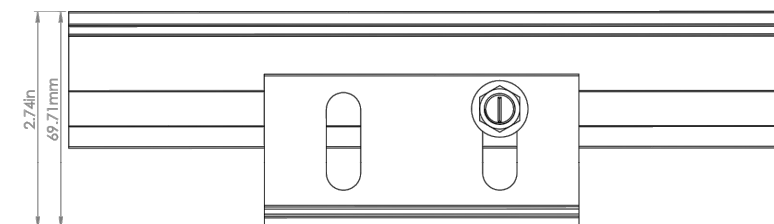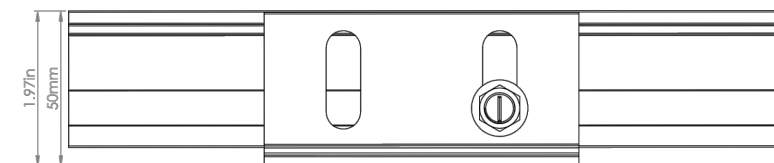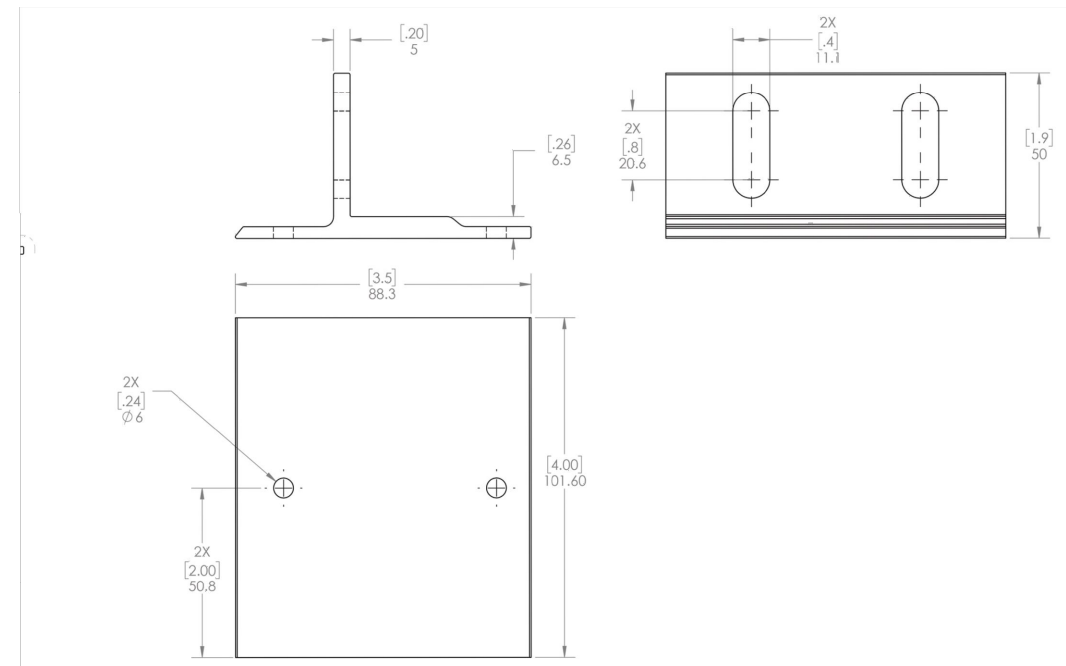

k2-systems.com

BURCH, DANIEL
2021 OLD BUIES CREEK, ROAD,
ANGIER, NC 27501
(919) 906-5453

LICENSE # U.33714

TITAN
SOLAR POWER
TITAN SOLAR POWER
10815 JOHN PRICE RD.,
CHARLOTTE, NC 28273
WWW.TITANSOLARPOWER.COM

MOUNTING DATASHEET

JOB #: TSP103269
DATE: 5/21/2022
DRAWN BY: DA

PV-9.5