


WARNING
TURN OFF PHOTOVOLTAIC AC DISCONNECT PRIOR TO WORKING INSIDE PANEL

Location: Combiner box

**PV SOLAR BEAKER
DO NOT RELOCATE THIS
OVERCURRENT DEVICE**
705.12 (B)(2)(3)(b)
Location: PV Breakers

**WARNING:
PHOTOVOLTAIC POWER SOURCE**
690.31(G)(3)
Location: Conduit

**SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN**
TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



690.56 (c)(1)(a)
Location: Disconnect


**RAPID SHUTDOWN PV
ARRAY**
690.56 (c)(3)
Location: Disconnect

WARNING
DUAL POWER SUPPLY
SOURCES: UTILITY GRID AND
PV SOLAR ELECTIC SYSTEM
705.10
Location: MDP

PHOTOVOLTAIC SYSTEM AC DISCONNECT
RATED AC OPERATING CURRENT 34.4375 AMPS AC
AC NOMINAL OPERATING VOLTAGE 240 VAC
690.54
Location: Disco

**PHOTOVOLTAIC SYSTEM
COMBINER PANEL
DO NOT ADD LOADS**
705.12
Location: Combiner box

SOLAR DISCONNECT
690.13 (B)
Location: Disconnect

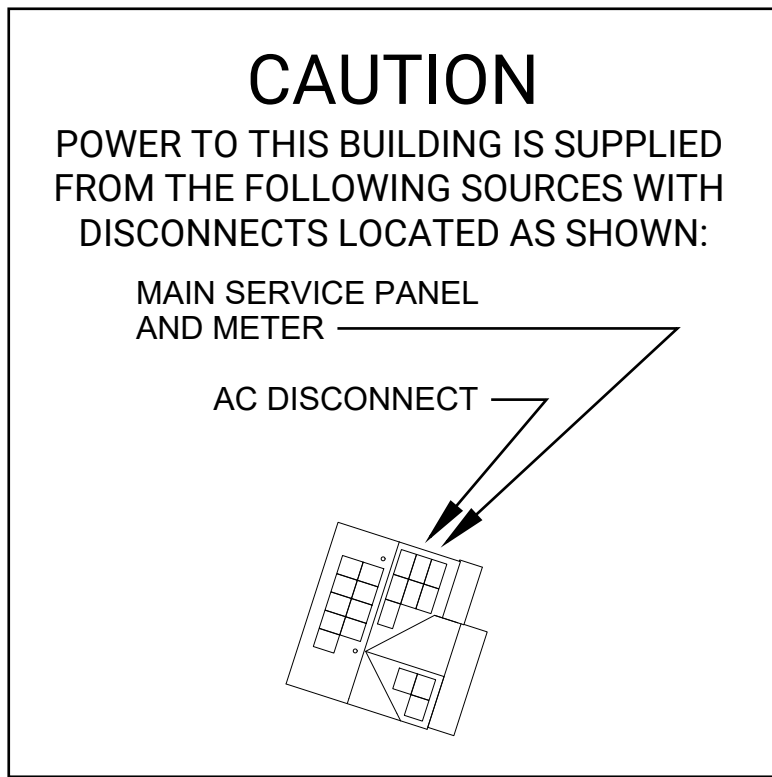

**AC JUNCTION BOX FOR
PHOTOVOLTAIC**
690.19
Location: Junction boxes



7.6KW PV SYSTEM
RUFFIER RESIDENCE
157 Blue Bay Ln, Cameron, NC 28326

STICKERS

REVISION LIST ⚠

#	REV. DATE	DESC.

DATE: July 6, 2022
DRAWN BY: ZJP

Sheet No.
E-02