

PROJECT DETAILS

PV Modules	32 x SOLARIA POWERX-400R
Optimizers	32 x P505
Inverter	1 x SE10000H-US (RGM)
Roof Type	Asphalt Shingles
Racking	PSR-B84 Rails (Black)
Mounting Type	CompMount Flashing (Black)
DC SIZE	12.8 kW
AC SIZE	10.0 kVA

DRAWING INDEX

Item	Drawing #	Rev	Description
1	22240JJ00-0	A	Drawing Index
2	22240JJ00-1	A	Site Layout
3	22240JJ00-2	A	String Mapping
4	22240JJ00-3	A	Electrical One Line Diagram
5	22240JJ00-4	A	Detailed Electrical Wiring Schematic
6	22240JJ00-5	A	PV Labels
7	22240JJ00-6	A	Bill of Materials

TOP VIEW OF BUILDING



1600 Heritage Commerce Ct Ste 104,
Wake Forest NC 27587
O: 919.948.6474
E: info@8msolar.com

Jeremiah W Joines
200 Waterford Dr
Angier NC 27501

PHOTOVOLTIC NOTES

1. THE INSTALLATION OF SOLAR ARRAYS AND PHOTOVOLTAIC POWER SYSTEMS SHALL COMPLY WITH THE FOLLOWING CODES:

- 2020 NATIONAL ELECTRICAL CODE
- 2018 NORTH CAROLINA RESIDENTIAL CODE
- 2018 NORTH CAROLINA BUILDING CODE
- AS ADOPTED BY THE STATE OF NORTH CAROLINA
- ALL OTHER ORDINANCE ADOPTED BY THE LOCAL GOVERNING AGENCIES

2. ROOFTOP MOUNTED PHOTOVOLTAIC PANELS AND MODULES SHALL BE TESTED, LISTED AND IDENTIFIED BY RECOGNIZED ELECTRICAL TESTING LABORATORY.

3. SOLAR SYSTEM SHALL NOT COVER ANY PLUMBING OR MECHANICAL VENTS

4. MODULES AND SUPPORT STRUCTURES SHALL BE GROUNDED

5. SOLAR INVERTER SHALL BE LISTED TO UL1741

6. ALL CONDUCTORS SHALL BE COPPER AND SHOULD BE 75 AND 90 DEG RATED

7. REMOVAL OF AN INTERACTIVE INVERTER OR OTHER EQUIPMENT SHALL NOT DISCONNECT THE BONDING CONNECTION BETWEEN THE GROUNDING ELECTRODE CONDUCTOR AND THE PHOTOVOLTAIC SOURCE AND/OR OUTPUT CIRCUIT GROUNDED CONDUCTORS.

8. LIVE PARTS OF PV SOURCE CIRCUITS AND PV OUTPUT CIRCUITS OVER 150V TO GROUND SHALL NOT BE ACCESSIBLE TO OTHER THAN QUALIFIED PERSONS WHILE ENERGIZED.

9. ALL PV MODULES AND ASSOCIATED EQUIPMENT AND WIRING SHALL BE PROTECTED FROM PHYSICAL DAMAGE.



A 07/01/2022 _____

Customer's Signature

JOB NUMBER
22-240-JJ00

PROJECT STATUS
PERMITTING


SHEET
DRAWING INDEX

JJ
22240JJ00-0


There is one layer of shingles
Roofing material is asphalt shingles

The roof is located in 117mph wind zone

Utility
Meter

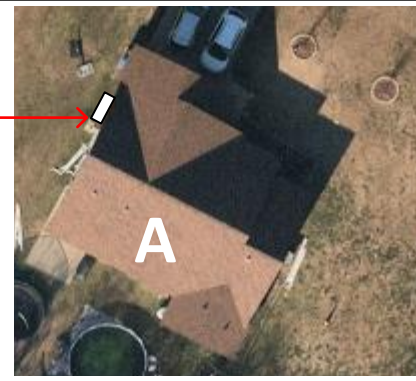

Module
Dimension



Roofs	Pitch	Azimuth
A	33°	207°




1600 Heritage Commerce Ct Ste 104,
Wake Forest NC 27587
O: 919.948.6474
E: info@8msolar.com

SYSTEM DETAILS

NUMBER OF PANELS : 32
PANELS MODEL : Solaria PowerX-400R
DC SIZE : 12.8 kW
AC SIZE : 10.0 kVA

Roof A
32 Modules

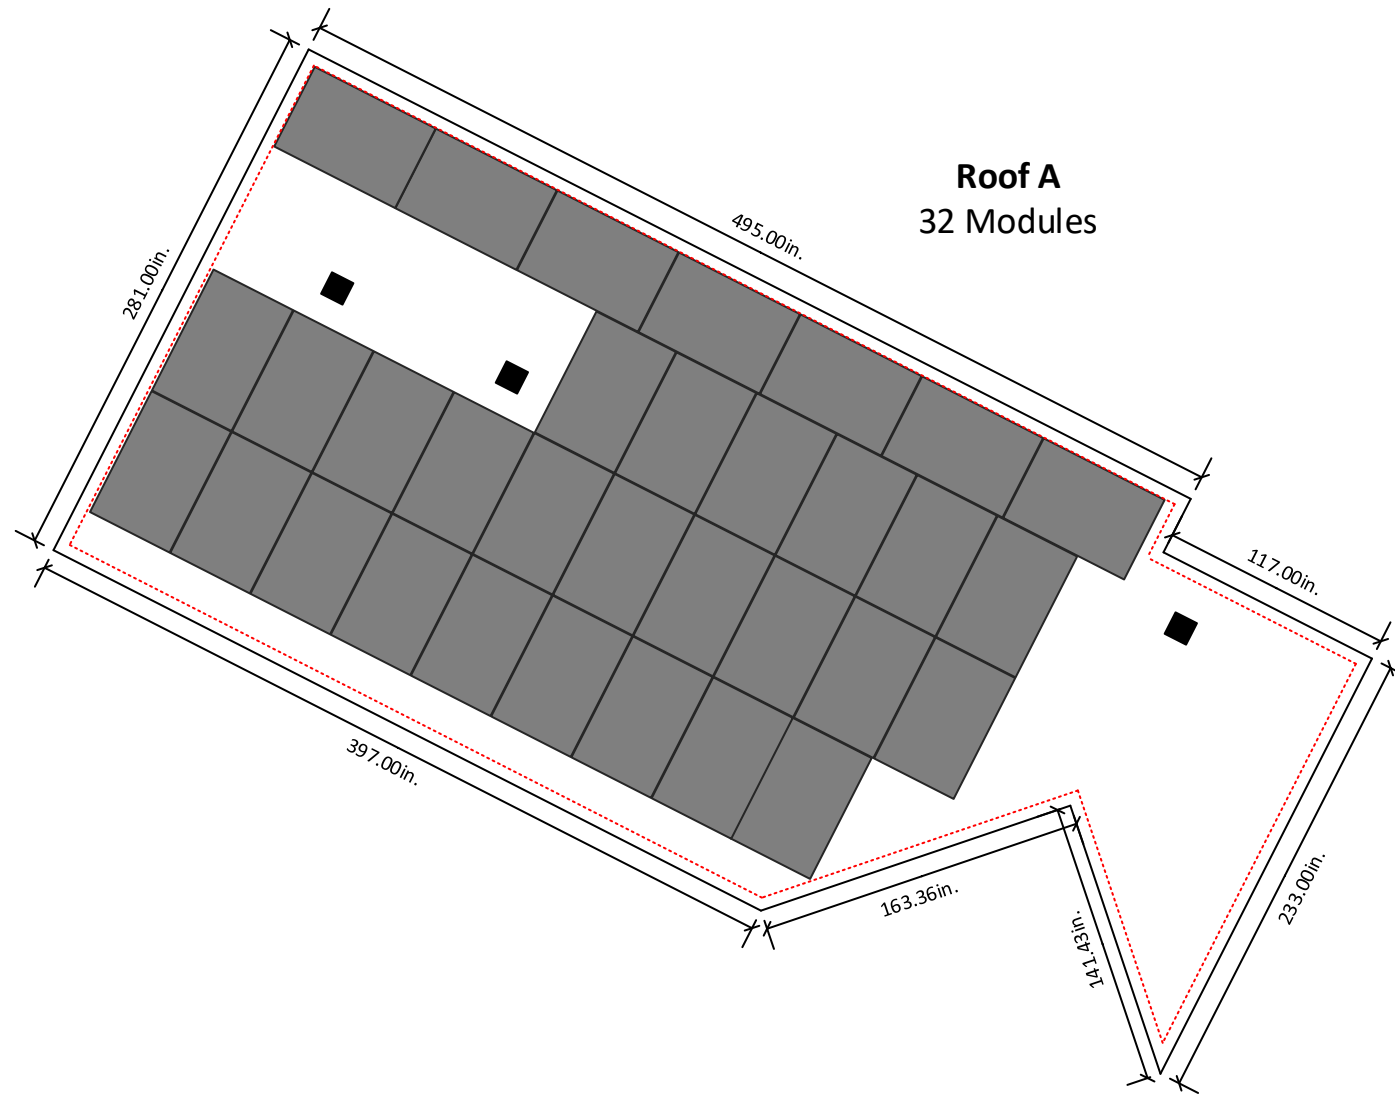

6" clearance
from each side
of the roof

SITE LAYOUT
SCALE: 1/8" - 1' 0"



Jeremiah W Joines
200 Waterford Dr
Angier NC 27501



A 07/01/2022

Customer's Signature

JOB NUMBER
22-240-JJ00


PROJECT STATUS
PERMITTING

SHEET
SITE LAYOUT

JJ
22240JJ00-1

String Layout					
Inverter-SE10000H-US (RGM)					
Strings #	No. of Modules	Color Code	Strings #	No. of Modules	Color Code
String 1	11				
String 2	11				
String 3	10				

Utility Meter

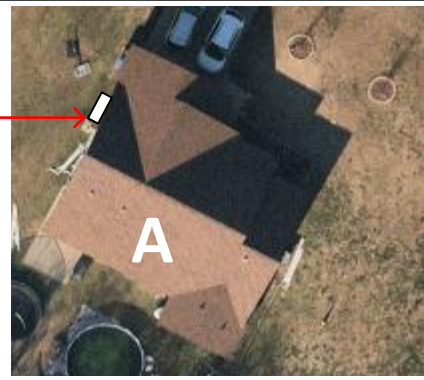


Module Dimension		
	Pitch	Azimuth
Roofs		
A	33°	207°



1600 Heritage Commerce Ct Ste 104,
Wake Forest NC 27587
O: 919.948.6474
E: info@8msolar.com

SYSTEM DETAILS

NUMBER OF PANELS : 32
 PANELS MODEL : Solaria PowerX-400R
 DC SIZE : 12.8 kW
 AC SIZE : 10.0 kVA

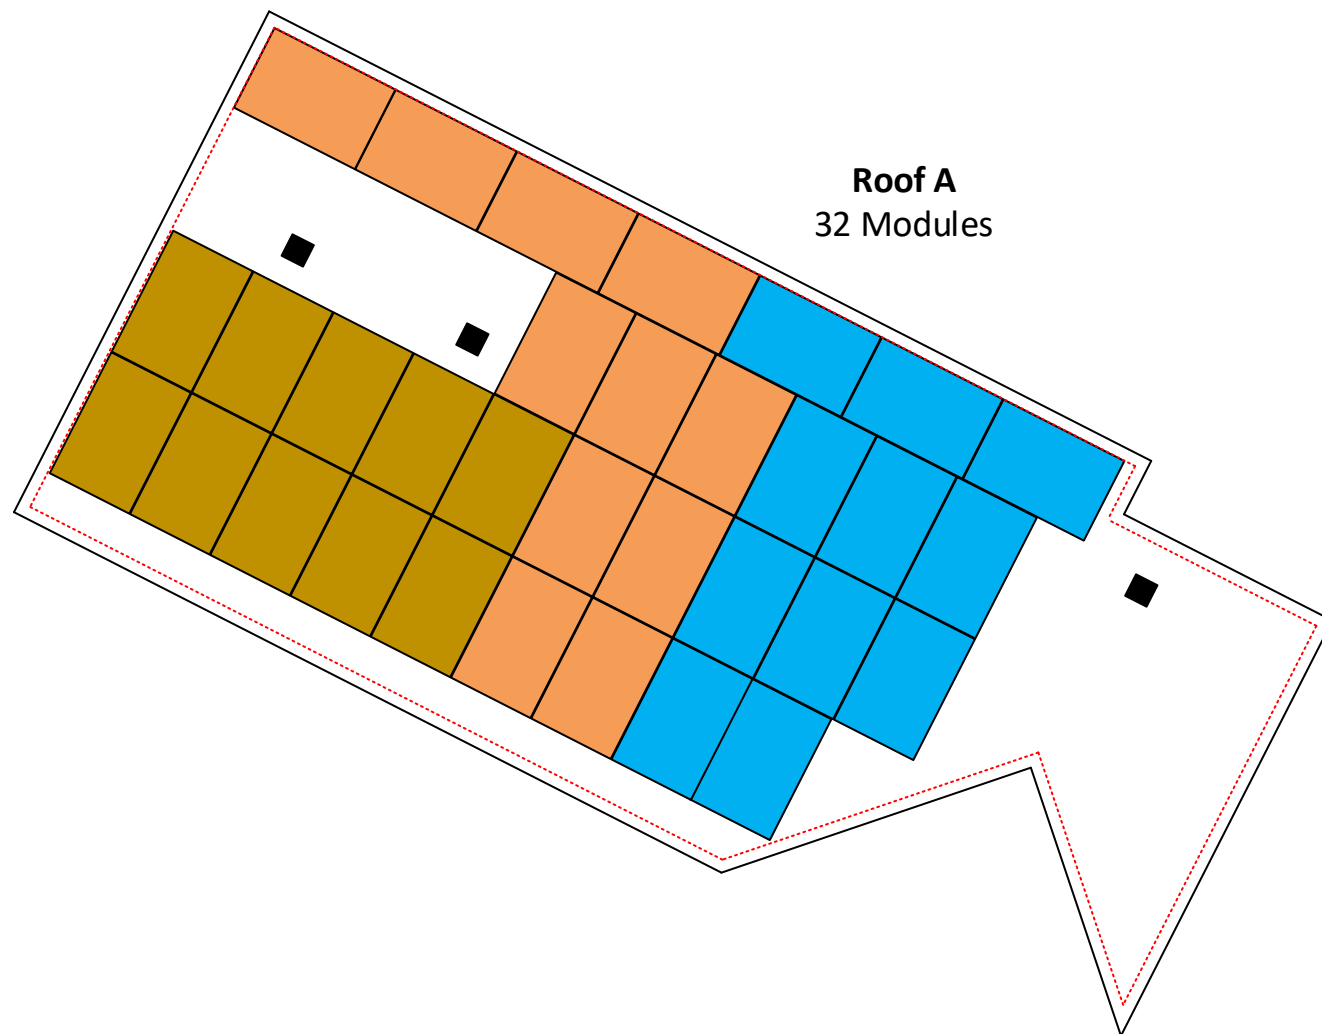

Roof A
32 Modules

6" clearance
from each side
of the roof

Jeremiah W Joines
200 Waterford Dr
Angier NC 27501




A 07/01/2022

Customer's Signature

JOB NUMBER
22-240-JJ00

PROJECT STATUS
PERMITTING

SHEET
STRING MAPPING

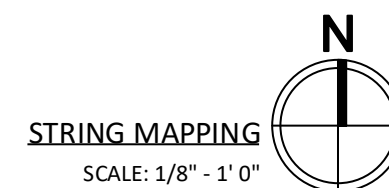

JJ
22240JJ00-2

Jeremiah W Joines
200 Waterford Dr
Angier NC 27501



PV Installation
Professional

Ali Buttar
PVIP #031310-32

A 07/01/2022

Customer's Signature

JOB NUMBER

22-240-JJ00

PROJECT STATUS


PERMITTING

SHEET

ELECTRICAL ONE LINE DIAGRAM

JJ

22240JJ00-3

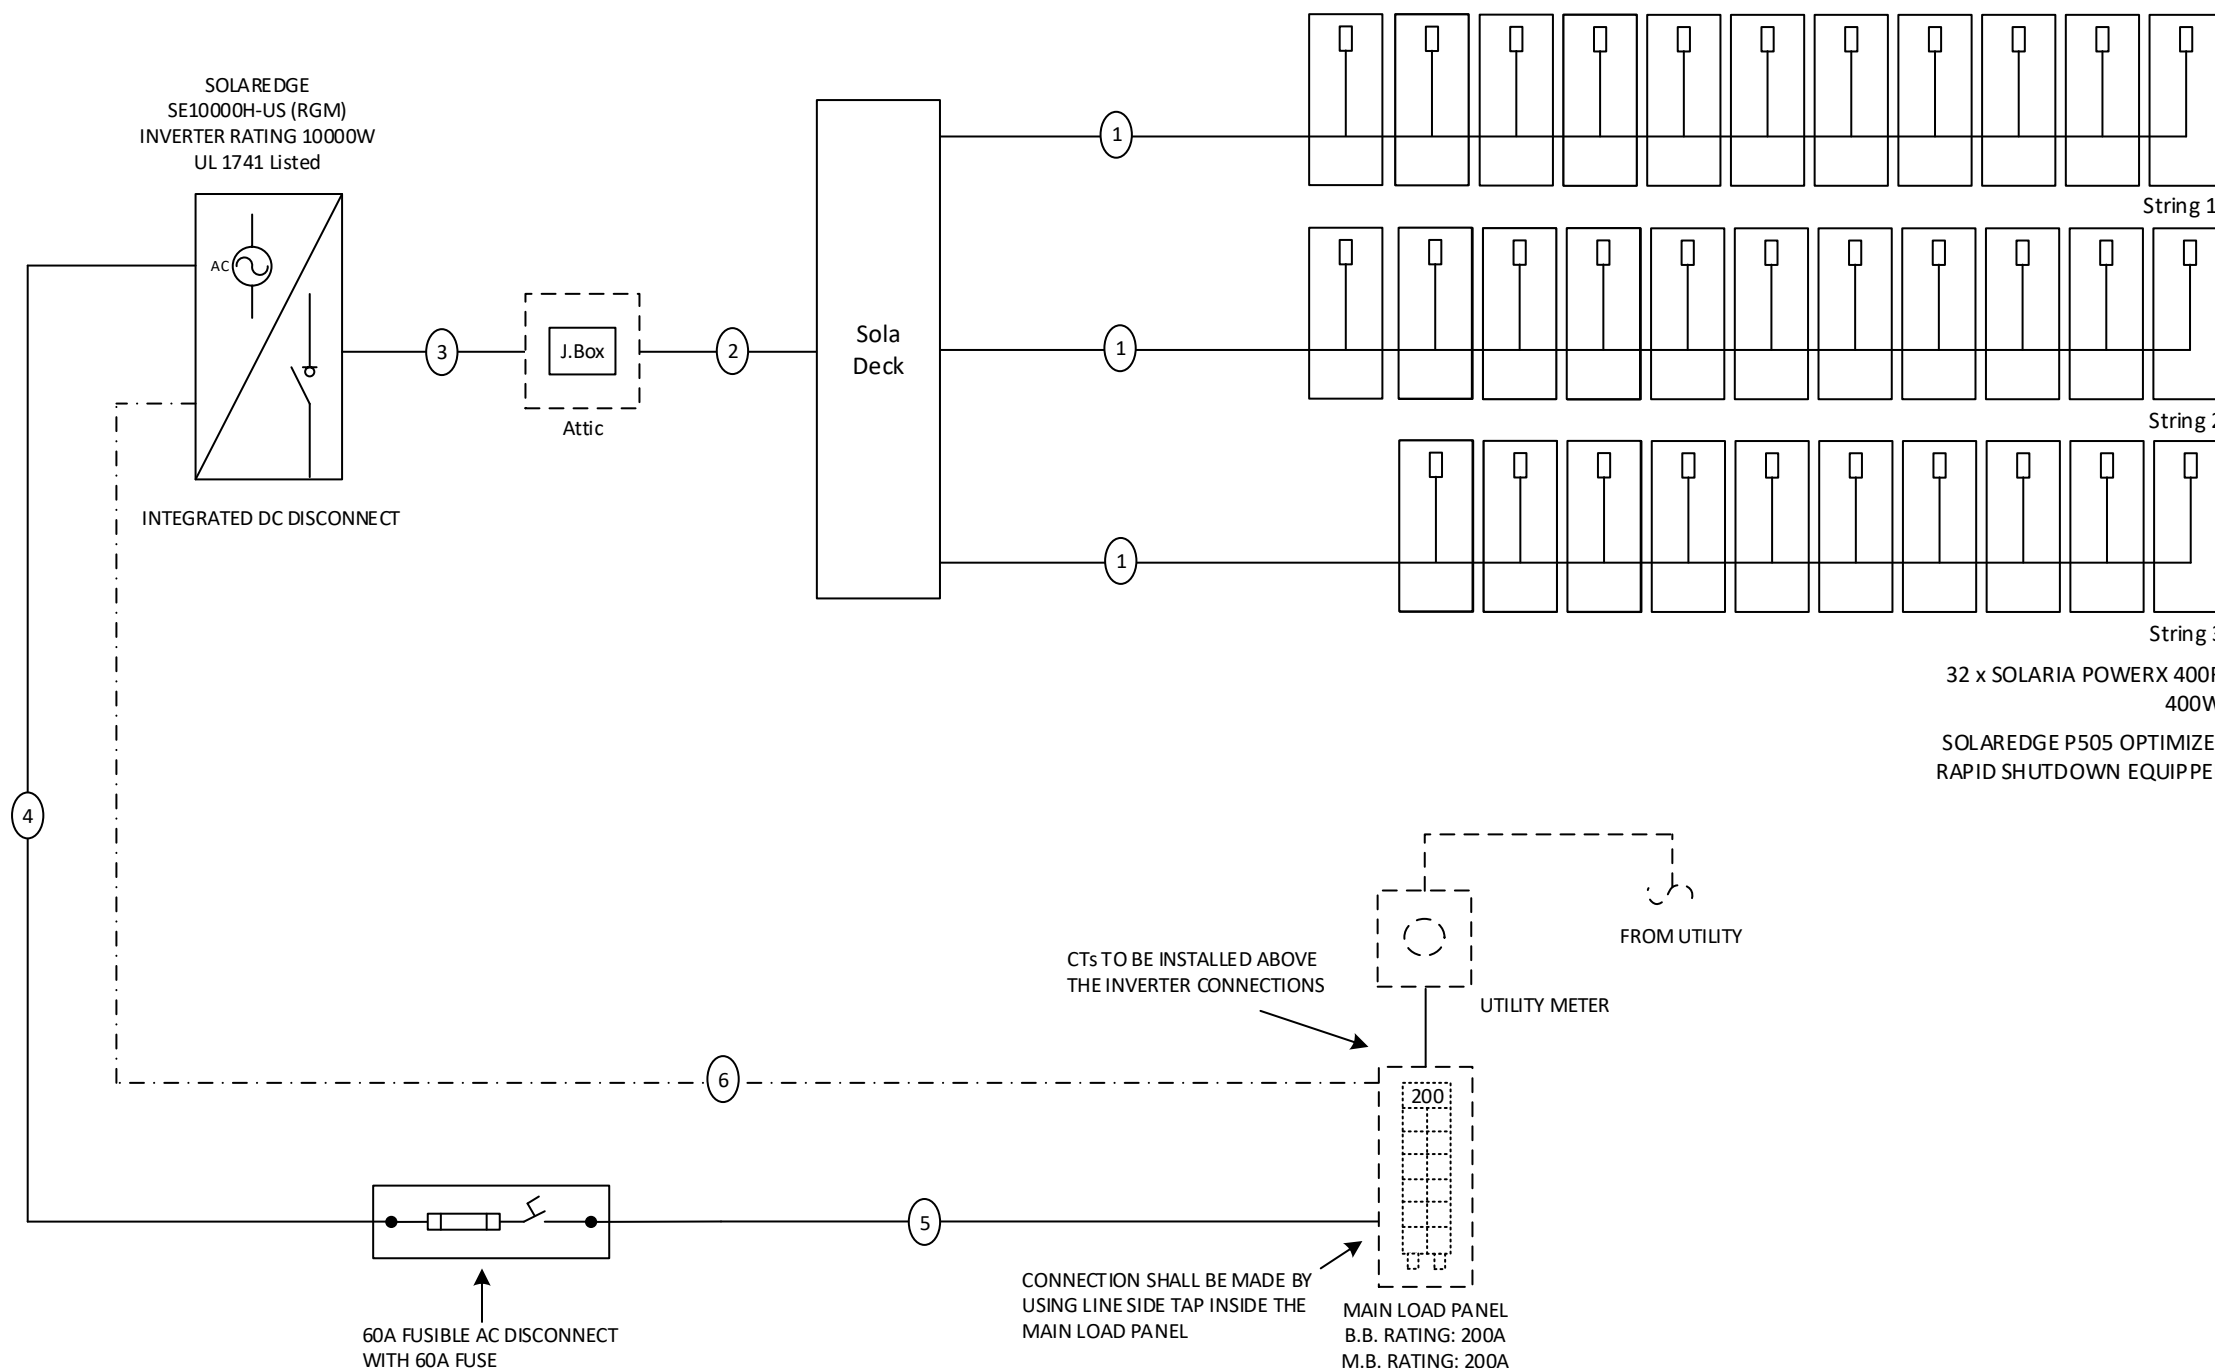

ELECTRICAL NOTES


- System Size: 12,800W DC
- (32) SOLARIA POWERX-400R
- (32) SOLAREEDGE P505 OPTIMIZERS
- (01) SOLAREEDGE SE10000H-US (RGM)
- Inverter Output: 42A max @ 240 VAC
- 10.0 kVA AC output max

- Grounding will be done via Pegasus grounding mid-clamps and NS bonding jumpers to ensure the rail and panels are continuously grounded.
- Rapid Shutdown is included in the Inverter, refer to inverter & optimizer attached datasheets.
- The load center / disconnect will be visible, lockable accessible to utility linesmen and will be properly labelled as per NEC requirements. It will be located on the exterior wall of the building, next to the utility meter.

STRING 1&2:
11 x 400W = 4,400W ea
I_{mpp} = 11 Adc
I_{max} = 23.4 Adc
V_{mpp} = 400 Vdc
V_{oc} = 11 Vdc

STRING 3:
10 x 400W = 4,000W ea
I_{mpp} = 10 Adc
I_{max} = 23.4 Adc
V_{mpp} = 400 Vdc
V_{oc} = 10 Vdc

Sr.No	#Wire	Conduit Size	Ground Wire	Amperage
1	2 x #10 PV		#10 Bare CU	23.4A
2	3 x #10 MC Cable			
3	6 x #10 THHN Cu	3/4" EMT	#10 Green	52.5A
4	3 x #6 THHN Cu	3/4" EMT	#8 Green	
5	3 x #6 THHN Cu	3/4" EMT		52.5A
6	Shielded CAT5e			

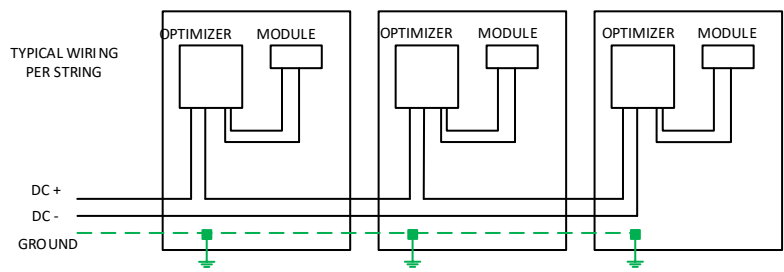


Line 1	
Line 2	
Neutral	
Ground	

DIP SWITCH CONFIGURATION

<input checked="" type="checkbox"/>	0	OFF
<input type="checkbox"/>	1	ON

- Note**
- The arrow on the 225A CTs should face the grid.
- Note**
- Dip switch settings are factory set to address 1

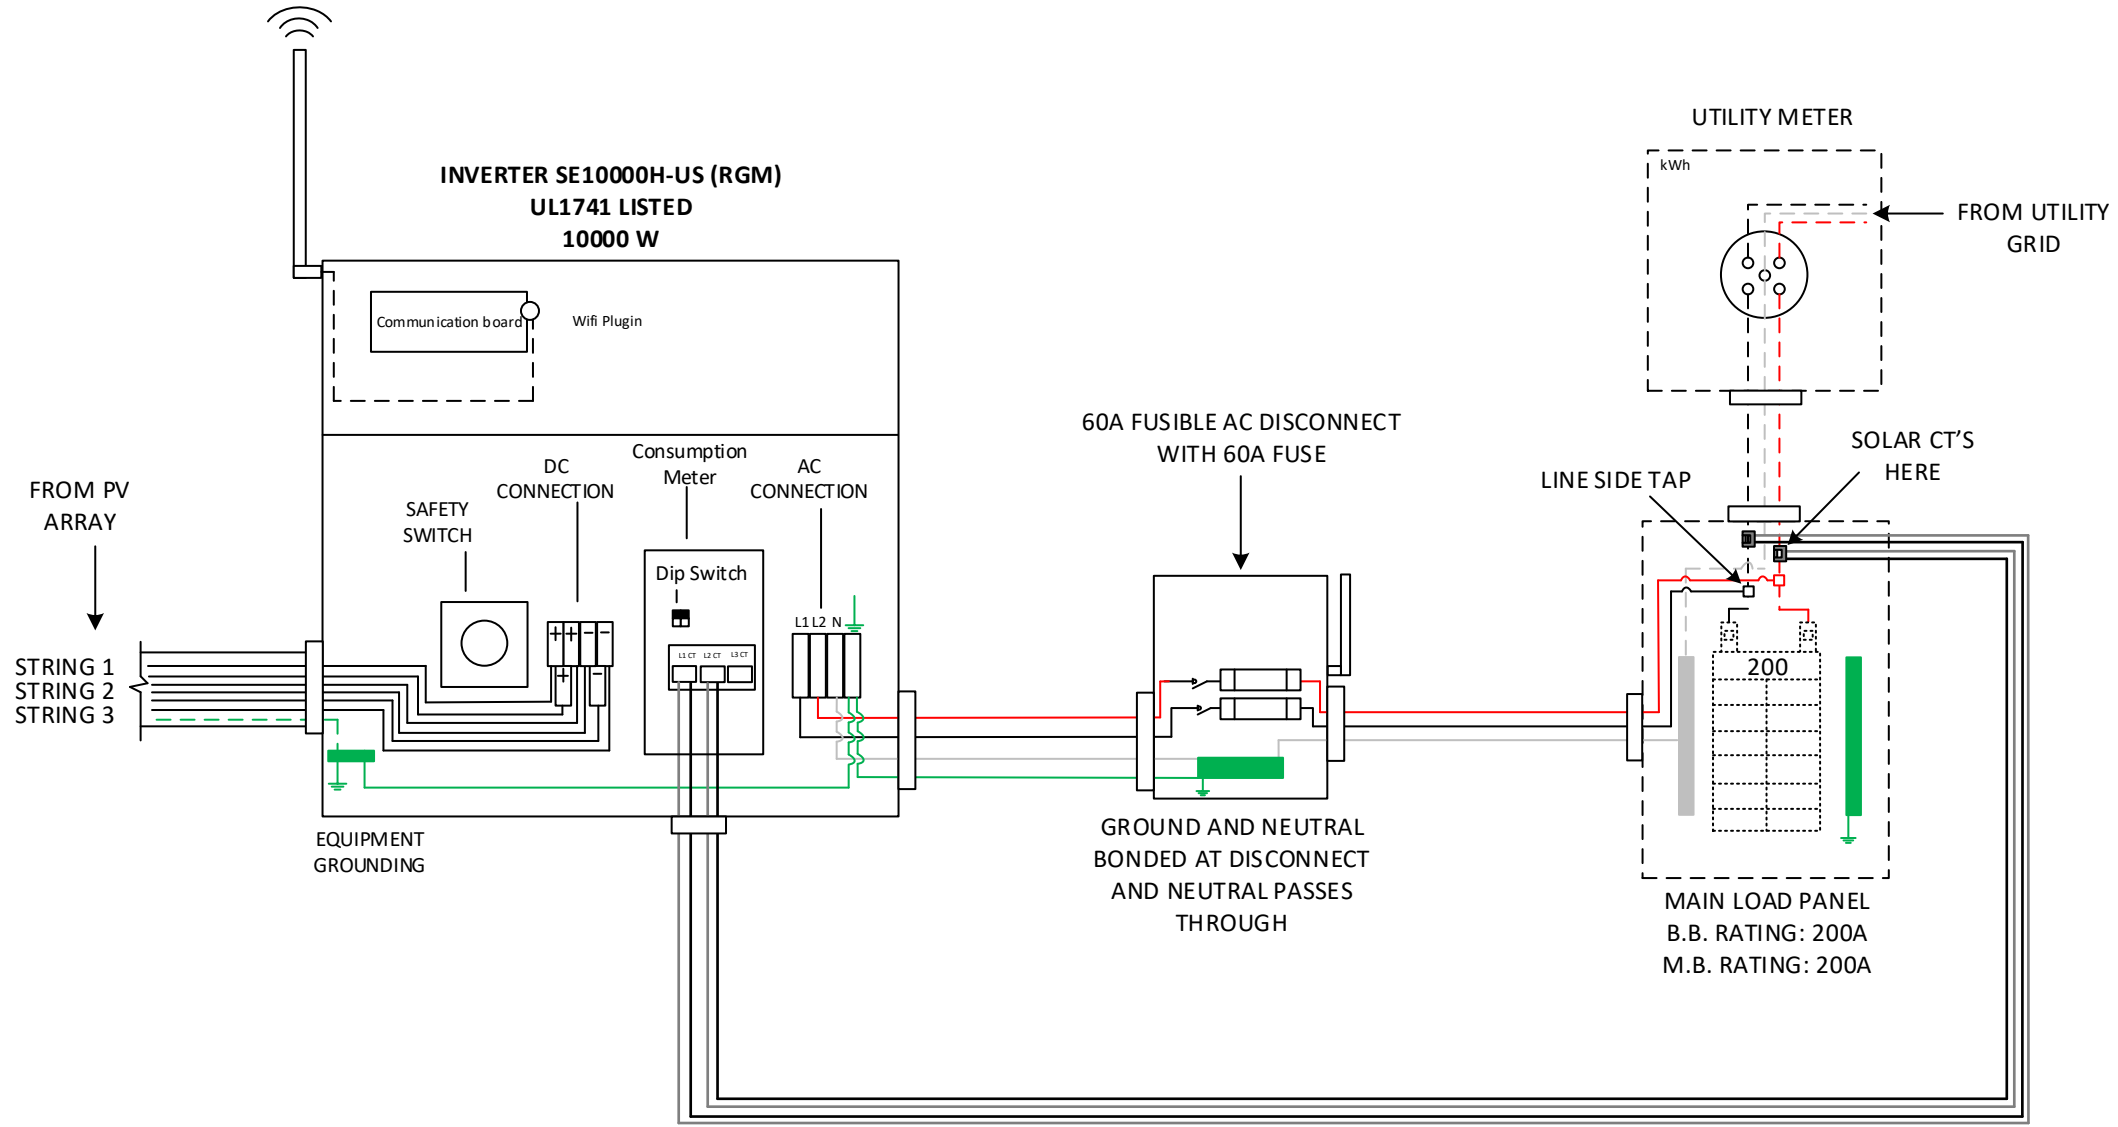

1600 Heritage Commerce Ct Ste 104,
Wake Forest NC 27587
O: 919.948.6474
E: info@8msolar.com

Jeremiah W Joines
200 Waterford Dr
Angier NC 27501



A 07/01/2022


Customer's Signature

JOB NUMBER
22-240-JJ00

PROJECT STATUS
PERMITTING

SHEET
DETAILED ELECTRICAL DIAGRAM

JJ
22240JJ00-4

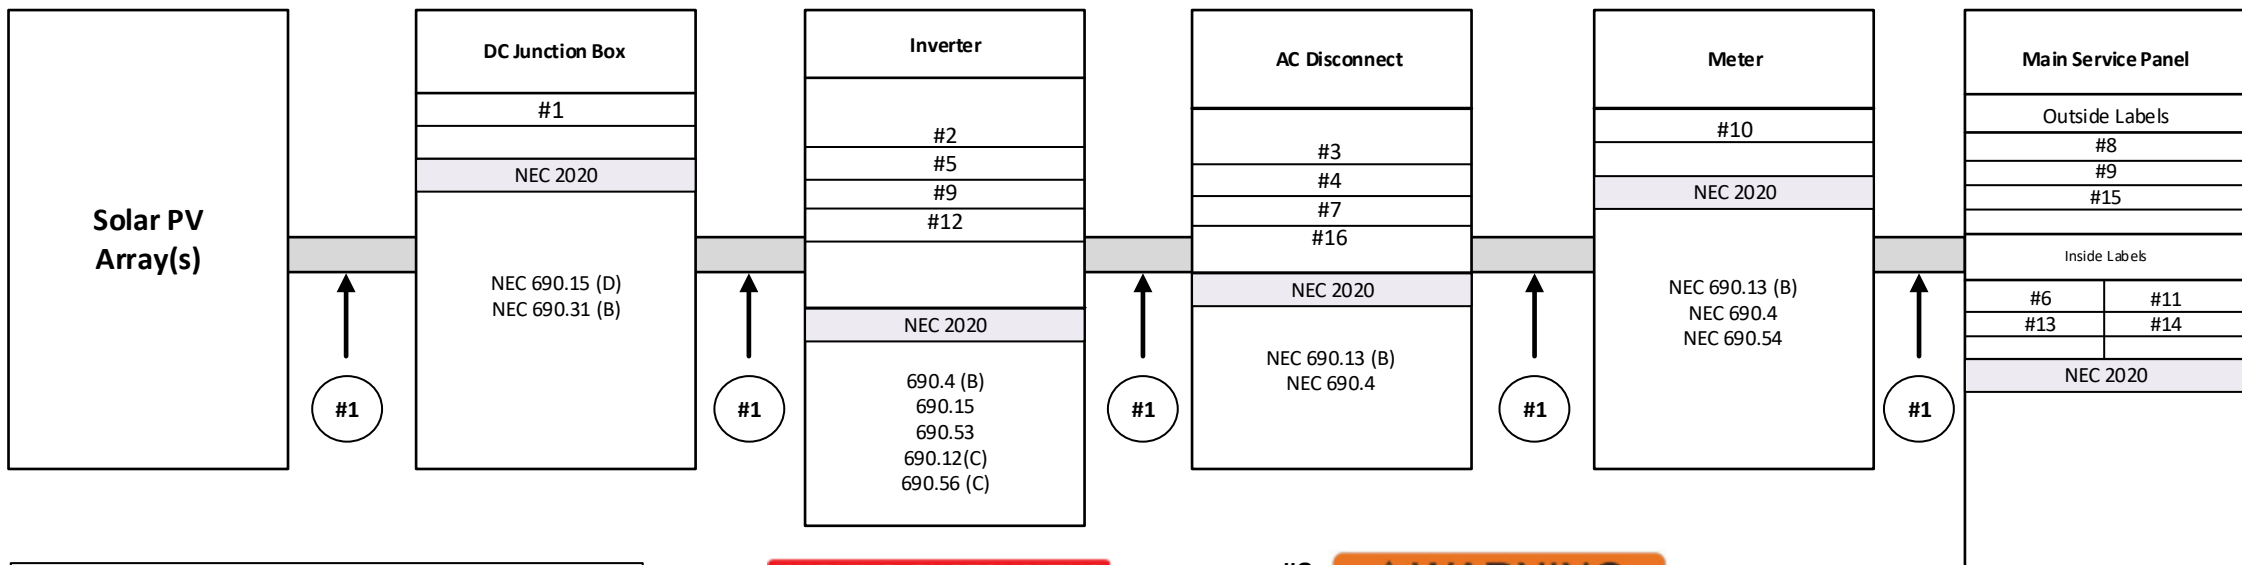

LABELING AND WARNING SIGNS

A. PURPOSE
PROVIDE EMERGENCY RESPONDERS WITH APPROPRIATE WARNING AND GUIDANCE WITH RESPECT TO ISOLATING THE SOLAR ELECTRIC SYSTEM. THIS CAN FACILITATE IDENTIFYING ENERGIZED ELECTRICAL LINES THAT CONNECT THE SOLAR PANELS TO THE INVERTER, AS SHOULD NOT BE CUT WHEN VENTING FOR SMOKE REMOVAL.

B. MAIN SERVICE DISCONNECT:

1. RESIDENTIAL BUILDINGS- THE MARKING MAY BE PLACED WITHIN THE MAIN SERVICE DISCONNECT. THE MARKING SHALL BE PLACED ON THE OUTSIDE COVER IF THE MAIN SERVICE DISCONNECT IS OPERABLE WITH THE SERVICE PANEL CLOSED.
2. COMMERCIAL BUILDINGS- THE MARKINGS SHALL BE PLACED ADJACENT TO THE MAIN SERVICE DISCONNECT CLEARLY VISIBLE FROM THE LOCATION WHERE THE LEVER IS OPERATED
3. MARKINGS, VERBIAGE, FOR MAT AND TYPE OF MATERIAL
 - a. VERBIAGE: CAUTION ; SOLAR ELECTRIC SYSTEM CONNECTED
 - b. FOR MAT:
 - (1) WHITE LETTERING ON A RED BACKGROUND
 - (2) MINIMUM 3/8 INCH LETTER HEIGHT
 - (3) ALL LETTERS SHALL BE CAPITALIZED
 - (4) ARIAL OR SIMILAR FONT, NON-BOLD
 - c. MATERIAL:
 - (1) REFLECTIVE, WEATHER RESISTANT MATERIAL SUITABLE FOR THE ENVIRONMENT (USE UL-969) AS STANDARD FOR WEATHER RATING); DURABLE ADHESIVE MATERIALS MEET THIS REQUIREMENT.

C. MARKING REQUIREMENTS ON DC CONDUIT, RACEWAYS, ENCLOSURES, CABLE ASSEMBLIES, DC COMBINERS AND JUNCTION BOXES;

1. MARKING: PLACEMENT, VERBIAGE, FOR MAT AND TYPE OF MATERIAL.
 - a. PLACEMENT: MARKINGS SHALL BE PLACED EVERY 10 (TEN) FEET ON ALL INTERIOR AND EXTERIOR DC CONDUITS, RACEWAYS, ENCLOSURES AND CABLE ASSEMBLIES, AT TURNS ABOVE AND/OR BELOW PENETRATIONS, ALL DC COMBINERS AND JUNCTION BOXES.
 - b. VERBIAGE: CAUTION SOLAR CIRCUIT
 - c. THE FOR MAT AND TYPE OF MATERIAL SHALL ADHERE TO SECTION B-3.B & C ABOVE

D. INVERTERS ARE NOT REQUIRED TO HAVE CAUTION MARKINGS

#1 WARNING: PHOTOVOLTAIC POWER SOURCE

#2 PHOTOVOLTAIC DC DISCONNECT

#3 PHOTOVOLTAIC AC DISCONNECT

#4 RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

#5 MAXIMUM VOLTAGE []
MAXIMUM CIRCUIT CURRENT []
MAX. RATED OUTPUT CURRENT OF THE CHARGE CONTROLLER OR DC-TO-DC CONVERTER (IF INSTALLED) []

#6 PHOTOVOLTAIC POWER SOURCE
OPERATING AC VOLTAGE [] V
MAXIMUM OPERATING AC OUTPUT CURRENT [] A

#7 AC DISCONNECT PHOTOVOLTAIC SYSTEM POWER SOURCE
RATED AC OUTPUT CURRENT [] AMPS
NOMINAL OPERATING AC VOLTAGE [] VOLTS

#8 WARNING
ELECTRIC SHOCK HAZARD
TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

#9 WARNING
DUAL POWER SUPPLY
SOURCES: UTILITY GRID AND PV SOLAR ELECTRIC SYSTEM

#10 WARNING
THIS SERVICE METER IS ALSO SERVED BY A PHOTOVOLTAIC SYSTEM

#11 WARNING
TURN OFF PHOTOVOLTAIC AC DISCONNECT PRIOR TO WORKING INSIDE PANEL

#12 WARNING
BIPOLAR PHOTOVOLTAIC ARRAY
DISCONNECTION OF NEUTRAL GROUNDED CONDUCTORS MAY RESULT IN OVERVOLTAGE ON ARRAY OR INVERTER

#13 WARNING
THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.

#14 SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN
TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY

#15 SOLAR AC DISCONNECT LOCATED AT NORTH-WEST SIDE WALL OF THE HOUSE BESIDE THE UTILITY METER

#16 SERVICE DISCONNECT LOCATED IN MAIN LOAD PANEL



1600 Heritage Commerce Ct Ste 104,
Wake Forest NC 27587
O: 919.948.6474
E: info@8msolar.com

Jeremiah W Joines
200 Waterford Dr
Angier NC 27501



A 07/01/2022

Customer's Signature _____


JOB NUMBER 22-240-JJ00

PROJECT STATUS PERMITTING

SHEET PV LABELS

Rails and Splices : PSR-B84 (BLACK)	Roof Attachment : Pegasus Comp Mount
Rafter Spacing : 24 in	There is one layer of shingles Roofing material is asphalt shingles
Attachment Span: 4ft	The roof is located in 117mph wind zone

Utility Meter

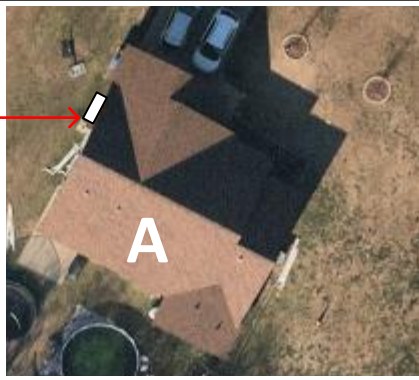


Module Dimension			
	Roofs	Pitch	Azimuth
A	33°	207°	



1600 Heritage Commerce Ct Ste 104,
Wake Forest NC 27587
O: 919.948.6474
E: info@8msolar.com

Jeremiah W Joines
200 Waterford Dr
Angier NC 27501

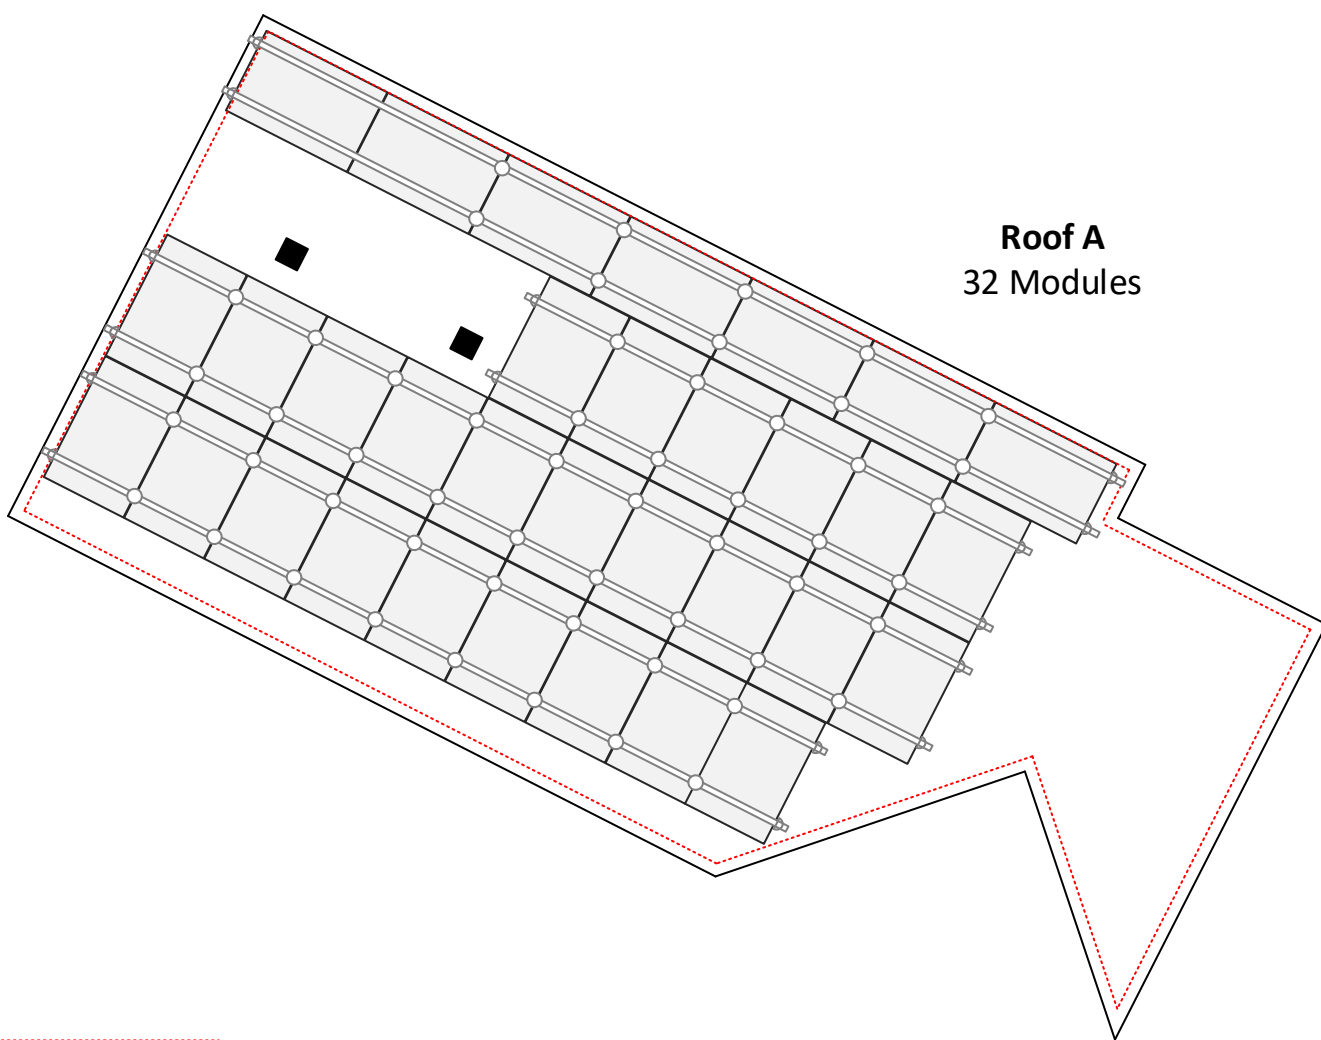

6" clearance
from each side
of the roof

PV LABELS		
Sr No	Code	Qty
01	02-314	11
02	03-301	01
03	03-302	01
04	02-316	01
05	03-308	01
06	03-390	01
07	03-306	01
08	05-215	01
09	05-211	02
10	07-359	01
11	05-372	01
12	05-103	01
13	05-108	01
14	07-111	01
15	8M-001	01
16	8M-002	01

- 42 x PSR-B84: Pegasus Rail, Black, 84" (7 Feet)
- 34 x PSR-SPL: Pegasus - Bonded, Structural Splice
- 56 x PSR-MCB: Pegasus - Multiclamp, Mid/End, 30 to 40 mm, Black
- 16 x PSR-HEC: Pegasus - Hidden End Clamp
- 32 x PSR-MLP: Pegasus - MLPE Mount
- 04 x PSR-LUG: Pegasus - Grounding Lug
- 04 x PSR-NSJ: Pegasus - N-S Bonding Jumper
- 48 x PSR-WMC: Pegasus - Wire Management Clip
- 06 x PSR-CBG: Pegasus - Cable Grip
- 16 x PSR-CAP: Pegasus - End Cap
- 70 x PSCR-UBBD T: Pegasus Comp Mount - Open Slot, Black L Foot, Black Flashing, Dovetail 3/8" T-Bolt
- 64 x Heyco Wire Clips

- SOLAR MODULES**
- 32 x SOLARIA POWERX-400R
- INVERTER & SUPPORTING ITEMS**
- 01 x Solar Edge SE10000H-US US000BNI4 (RGM)
 - 32 x SolarEdge Power Optimizer P505
 - 01 x SE-WFGW-B-S1-NA with Antenna kit
 - 02 x 225A SolarEdge CTs
- WIRE**
- 500 ft x #10 PV WIRE BLK (Cu)

BILL OF MATERIAL
SCALE: 1/8" - 1' 0"

A 07/01/2022

Customer's Signature

JOB NUMBER
22-240-JJ00

PROJECT STATUS
PERMITTING

SHEET
BILL OF MATERIAL

JJ
22240JJ00-6