GENERAL NOTES

1.1.1 PROJECT NOTES:

- 1.1.2 THIS PHOTOVOLTAIC (PV) SYSTEM SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE (NEC) ARTICLE 690, ALL MANUFACTURERS'S LISTING AND INSTALLATION INSTRUCTIONS, AND THE RELEVANT CODES AS SPECIFIED BY THE AUTHORITY HAVING JURISDICTION'S (AHJ) APPLICABLE CODES.
- 1.1.3 THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION
- 1.1.4 ALL PV SYSTEM COMPONENTS; MODULES, UTILITY-INTERACTIVE INVERTERS, AND SOURCE CIRCUIT COMBINER BOXES ARE IDENTIFIED AND LISTED FOR USE IN PHOTOVOLTAIC SYSTEMS AS REQUIRED BY NEC 690.4: PV MODULES: UL1703, IEC61730, AND IEC61215, AND NFPA 70 CLASS C FIRE INVERTERS: UL 1741 CERTIFIED, IEEE 1547, 929, 519 COMBINER BOX(ES): UL 1703 OR III. 1741 ACCESSORY
- 1.1.5 MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC. IF UNAVAILABLE, MAX DC VOLTAGE CALCULATED ACCORDING TO NEC 690.7.
- 1.1.6 ALL INVERTERS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AND SOURCE CIRCUIT COMBINERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (D). SHALL BE INSTALLED ACCORDING TO ANY INSTRUCTIONS FROM LISTING OR LABELING INEC 110.3].
- 1.1.7 ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.

1.2.1 SCOPE OF WORK:

1.2.2 PRIME CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE GRID-TIED PHOTOVOLTAIC SYSTEM RETROFIT. PRIME CONTRACTOR WILL BE RESPONSIBLE FOR COLLECTING EXISTING ONSITE REQUIREMENTS TO DESIGN, SPECIFY, AND INSTALL THE EXTERIOR ROOF-MOUNTED PORTION OF THE PHOTOVOLTAIC SYSTEMS DETAILED IN THIS DOCUMENT.

1.3.1 WORK INCLUDES:

- 1.3.2 PV ROOF ATTACHMENTS SNAPRACK UR 40 RAIL
- 1.3.3 PV RACKING SYSTEM INSTALLATION SNAPNRACK
- 1.3.4 PV MODULE AND INVERTER INSTALLATION REC SOLAR REC 365 NP2 BLK / ENPHASEIQ7+ MICROINVERTER
- 1.3.5 PV EQUIPMENT GROUNDING
- 1.3.6 PV SYSTEM WIRING TO A ROOF-MOUNTED JUNCTION BOX
- 1.3.7 PV LOAD CENTERS (IF INCLUDED)
- 1.3.8 PV METERING/MONITORING (IF INCLUDED)
- 1.3.9 PV DISCONNECTS
- 1.3.10 PV FINAL COMMISSIONING
- 1.3.11 (E) ELECTRICAL EQUIPMENT RETROFIT FOR PV
- 1.3.12 SIGNAGE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE

SCOPE OF WORK

SYSTEM SIZE: STC 25 X 365 = 9.13 kW

PTC: 25 X 343.7 = 8.59 kW DC

(25) REC SOLAR REC 365NP2 BLACK (25) ENPHASE IQ7PLUS-72-2-US

ATTACHMENT TYPE: SNAPRACK UR 40 RAIL


MSP UPGRADE: NO

NEW PV SYSTEM: 9.13 kWp DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 ASSESSOR'S #: 1500011889









| SHEET LI | ST TABLE |
|--------------|-------------|
| SHEET NUMBER | SHEET TITLE |
| T-001 | COVER PAGE |

| G-001 | NOTES |
|----------|-----------------------|
| A-101 | SITE PLAN |
| A-102 | ELECTRICAL PLAN |
| A-103 | SOLAR ATTACHMENT PLAN |
| E-601 | LINE DIAGRAM |
| E-602 | DESIGN TABLES |
| E-603 | PLACARDS |
| S-501 | ASSEMBLY DETAILS |
| R-001 | RESOURCE DOCUMENT |
| R-002 | RESOURCE DOCUMENT |
| R-003 | RESOURCE DOCUMENT |
| R-004 | RESOURCE DOCUMENT |
| <u> </u> | · |

PROJECT INFORMATION

DJ DAMANTI

704-525-6767

704-525-6767

HARNETT COUNTY

HARNETT COUNTY

DUKE ENERGY CAROLINAS

SINGLE-FAMILY

RESIDENTIAL

115 MPH

AUTHORITIES HAVING JURISDICTION

ANDREW O'DONNELL

RENU ENERGY SOLUTIONS, LLC

R-005

OWNER NAME:

NAME:

NAME:

PHONE:

BUILDING:

OCCUPANCY:

WIND SPEED:

CONSTRUCTION:

WIND EXPOSURE:

ZONING:

UTILITY:

ZONING:

PHONE:

CONTRACTOR

PROJECT MANAGER

RESOURCE DOCUMENT

TR

CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100 CHARLOTTE, NC 28217

LIC. NO.: 76615 HIC. NO.: ELE. NO.: 20334U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

COVER PAGE

DATE: 10/03/2022

DRAFTED BY: L.J.

CHECKED BY: H.E. & D.B.

REVISIONS:

APPLICABLE CODES & STANDARDS

BUILDING: 2015 IBC ELECTRICAL: 2017 NEC FIRE: 2015 IFC

DESIGN SPECIFICATIONS

GROUND SNOW LOAD: 15 PSF

T-001.00

(SHEET 1

| l , | Α | B C m | | D <u> </u> |
|-----|---|---|---|---|
| | 2.1.1 2.1.2 | SITE NOTES: A LADDER WILL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS. | 2.4.9 | THE GROUNDING ELECTRODE SYSTEM COMPLIES WITH NEC 690.47 AND NEC 250.50 THROUGH 250.106. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM PROVIDED ACCORDING TO NEC 250, NEC 690.47 2.7 |
| 1 | 2.1.3 2.1.4 | THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES. THE SOLAR PV INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR | 2.4.10 | AND AHJ. DC PV ARRAYS SHALL BE PROVIDED WITH DC GROUND-FAULT PROTECTION MEETING THE REQUIREMENTS OF 690.41(B)(1) AND (2) TO REDUCE FIRE HAZARDS |
| | 2.1.5 | BUILDING ROOF VENTS. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION NEC 110.26. | 2.5.1 2.5.2 | INTERCONNECTION NOTES: LOAD-SIDE INTERCONNECTION SHALL BE IN ACCORDANCE WITH [NEC 705.12 |
| | 2.1.6 | ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SERVES TO PROTECT THE BUILDING OR STRUCTURE. | 2.5.3 | (B)] THE SUM OF THE UTILITY OCPD AND INVERTER CONTINUOUS OUTPUT MAY NOT EXCEED 120% OF BUSBAR RATING [NEC 705.12(B)(2)(3)]. |
| 2 | 2.2.1 2.2.2 2.2.3 2.2.3 2.2.4 2.2.5 2.2.6 | EQUIPMENT LOCATIONS: ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS AS REQUIRED BY NEC 110.26. WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC 690.31 (A),(C) AND NEC TABLES 310.15 (B)(2)(A) AND 310.15 (B)(3)(C). JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES ACCORDING TO NEC 690.34. ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT. ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE. | 2.5.4 2.5.5 2.5.6 2.5.7 2.5.8 | THE SUM OF 125 PERCENT OF THE POWER SOURCE(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR, PV DEDICATED BACKFEED BREAKERS MUST BE LOCATED OPPOSITE END OF THE BUS FROM THE UTILITY SOURCE OCPD [NEC 705.12(B)(2)(3)]. AT MULTIPLE ELECTRIC POWER SOURCES OUTPUT COMBINER PANEL, TOTAL RATING OF ALL OVERCURRENT DEVICES SHALL NOT EXCEED AMPACITY OF BUSBAR. HOWEVER, THE COMBINED OVERCURRENT DEVICE MAY BE EXCLUDED ACCORDING TO NEC 705.12 (B)(2)(3)(C). FEEDER TAP INTERCONECTION (LOAD SIDE) ACCORDING TO NEC 705.12 (B)(2)(1) SUPPLY SIDE TAP INTERCONNECTION ACCORDING TO NEC 705.12 (A) WITH SERVICE ENTRANCE CONDUCTORS IN ACCORDANCE WITH NEC 230.42 BACKFEEDING BREAKER FOR ELECTRIC POWER SOURCES OUTPUT IS EXEMPT |
| | 2.3.1 2.3.2 | STRUCTURAL NOTES: RACKING SYSTEM & PV ARRAY WILL BE INSTALLED ACCORDING TO CODE-COMPLIANT INSTALLATION MANUAL. TOP CLAMPS REQUIRE A DESIGNATED SPACE BETWEEN MODULES, AND RAILS MUST ALSO EXTEND A MINIMUM DISTANCE BEYOND EITHER EDGE OF THE ARRAY/SUBARRAY. | 2.6.1 2.6.2 | FROM ADDITIONAL FASTENING [NEC 705.12 (B)(5)]. DISCONNECTION AND OVER-CURRENT PROTECTION NOTES: DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING ENERGIZED ARE CONNECTED TO |
| 3 | 2.3.3 | ACCORDING TO RAIL MANUFACTURER'S INSTRUCTIONS. JUNCTION BOX WILL BE INSTALLED PER MANUFACTURERS' SPECIFICATIONS. IF ROOF-PENETRATING TYPE, IT SHALL BE FLASHED & SEALED PER LOCAL REQUIREMENTS. ROOFTOP PENETRATIONS FOR PV RACEWAY WILL BE COMPLETED AND | 2.6.3 2.6.4 | THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS). DISCONNECTS TO BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH. BOTH POSITIVE AND NEGATIVE PV CONDUCTORS ARE UNGROUNDED. THEREFORE BOTH MUST OPEN WHERE A DISCONNECT IS REQUIRED, |
| | | SEALED W/ APPROVED CHEMICAL SEALANT PER CODE BY A LICENSED CONTRACTOR. | 2.6.5 | ACCORDING TO NEC 690.13. ISOLATING DEVICES OR EQUIPMENT DISCONNECTING MEANS SHALL BE INSTALLED IN CIRCUITS CONNECTED TO EQUIPMENT AT A LOCATION WITHIN |
| • | 2.3.5 | ALL PV RELATED ROOF ATTACHMENTS TO BE SPACED NO GREATER THAN THE SPAN DISTANCE SPECIFIED BY THE RACKING MANUFACTURER. WHEN POSSIBLE, ALL PV RELATED RACKING ATTACHMENTS WILL BE STAGGERED AMONGST THE ROOF FRAMING MEMBERS. | : | THE EQUIPMENT, OR WITHIN SIGHT AND WITHIN 10 FT OF THE EQUIPMENT. AN EQUIPMENT DISCONNECTING MEANS SHALL BE PERMITTED TO BE REMOTE FROM THE EQUIPMENT WHERE THE EQUIPMENT DISCONNECTING MEANS CAN BE REMOTELY OPERATED FROM WITHIN 10 FT OF THE EQUIPMENT, |
| | 2.4.1 2.4.2 | GROUNDING NOTES: GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVISES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR SUCH USE. | 2.6.6 | ACCORDING TO NEC 690.15 (A). PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION TO REDUCE SHOCK HAZARD FOR EMERGENCY RESPONDERS IN ACCORDANCE WITH 690.12(A) THROUGH (D) |
| 4 | 2.4.3 | PV SYSTEMS REQUIRE AN EQUIPMENT GROUNDING CONDUCTOR. ALL METAL ELECTRICAL EQUIPMENT AND STRUCTURAL COMPONENTS BONDED TO GROUND, IN ACCORDANCE WITH 250.134 OR 250.136(A). ONLY THE DC CONDUCTORS ARE UNGROUNDED. | 2.6.7 2.6.8 | ALL OCPD RATINGS AND TYPES SPECIFIED ACCORDING TO NEC 690.8, 690.9, AND 240. BOTH POSITIVE AND NEGATIVE PV CONDUCTORS ARE UNGROUNDED, THEREFORE BOTH REQUIRE OVER-CURRENT PROTECTION, ACCORDING TO |
| | 2.4.4 | PV EQUIPMENT SHALL BE GROUNDED ACCORDING TO NEC 690.43 AND MINIMUM NEC TABLE 250.122. | 2.6.9 | NEC 240.21. (SEE EXCEPTION IN NEC 690.9) IF REQUIRED BY AHJ, SYSTEM WILL INCLUDE ARC-FAULT CIRCUIT PROTECTION |
| | 2.4.5 2.4.6 | METAL PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURE CONSIDERED GROUNDED IN ACCORD WITH 250.134 AND 250.136(A). EACH MODULE WILL BE GROUNDED USING WEEB GROUNDING CLIPS AS SHOWN IN MANUEACTURED DOCUMENTATION AND ADDROVED BY THE ALL LEWISERS ARE | 2.7.1 | ACCORDING TO NEC 690.11 AND UL1699B. WIRING & CONDUIT NOTES: |
| | | MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ. IF WEEBS ARE NOT USED, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE SPECIFIED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS. | 2.7.2 | ALL CONDUIT AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING. |
| | 2.4.7 | THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE. | 2.7.3 2.7.4 | ALL CONDUCTORS SIZED ACCORDING TO NEC 690.8, NEC 690.7. EXPOSED PV SOURCE CIRCUITS AND OUTPUT CIRCUITS SHALL USE WIRE LISTED AND IDENTIFIED AS PHOTOVOLTAIC (PV) WIRE [690.7] (C)]. PV |
| 5 | 2.4.8 | GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLORED GREEN OR MARKED GREEN IF #4 AWG OR LARGER [NEC 250.119] | | MODULES WIRE LEADS SHALL BE LISTED FOR USE ON PV ARRAYS, ACCORDING TO NEC 690.31 (A). |
| | | | | |

PV WIRE BLACK WIRE MAY BE FIELD-MARKED WHITE [NEC 200.6 (A)(6)]. MODULE WIRING SHALL BE LOCATED AND SECURED UNDER THE ARRAY. ACCORDING TO NEC 200.7, UNGROUNDED SYSTEMS DC CONDUCTORS COLORED OR MARKED AS FOLLOWS:

DC POSITIVE- RED, OR OTHER COLOR EXCLUDING WHITE, GREY AND GREEN

DC NEGATIVE- BLACK, OR OTHER COLOR EXCLUDING WHITE, GREY AND GREEN

AC CONDUCTORS COLORED OR MARKED AS FOLLOWS:

PHASE A OR L1- BLACK

2.7.5 2.7.6

PHASE B OR L2- RED, OR OTHER CONVENTION IF THREE PHASE PHASE C OR L3- BLUE, YELLOW, ORANGE*, OR OTHER CONVENTION NEUTRAL- WHITE OR GREY

* IN 4-WIRE DELTA CONNECTED SYSTEMS THE PHASE WITH HIGHER VOLTAGE TO BE MARKED ORANGE [NEC 110.15].



CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100

CHARLOTTE, NC 28217

LIC. NO.: 76615 HIC. NO.: ELE. NO.: 20334U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

NOTES

DATE: 10/03/2022


DRAFTED BY: L.J.


CHECKED BY: H.E. & D.B.


REVISIONS:

G-001.00

(SHEET 2)

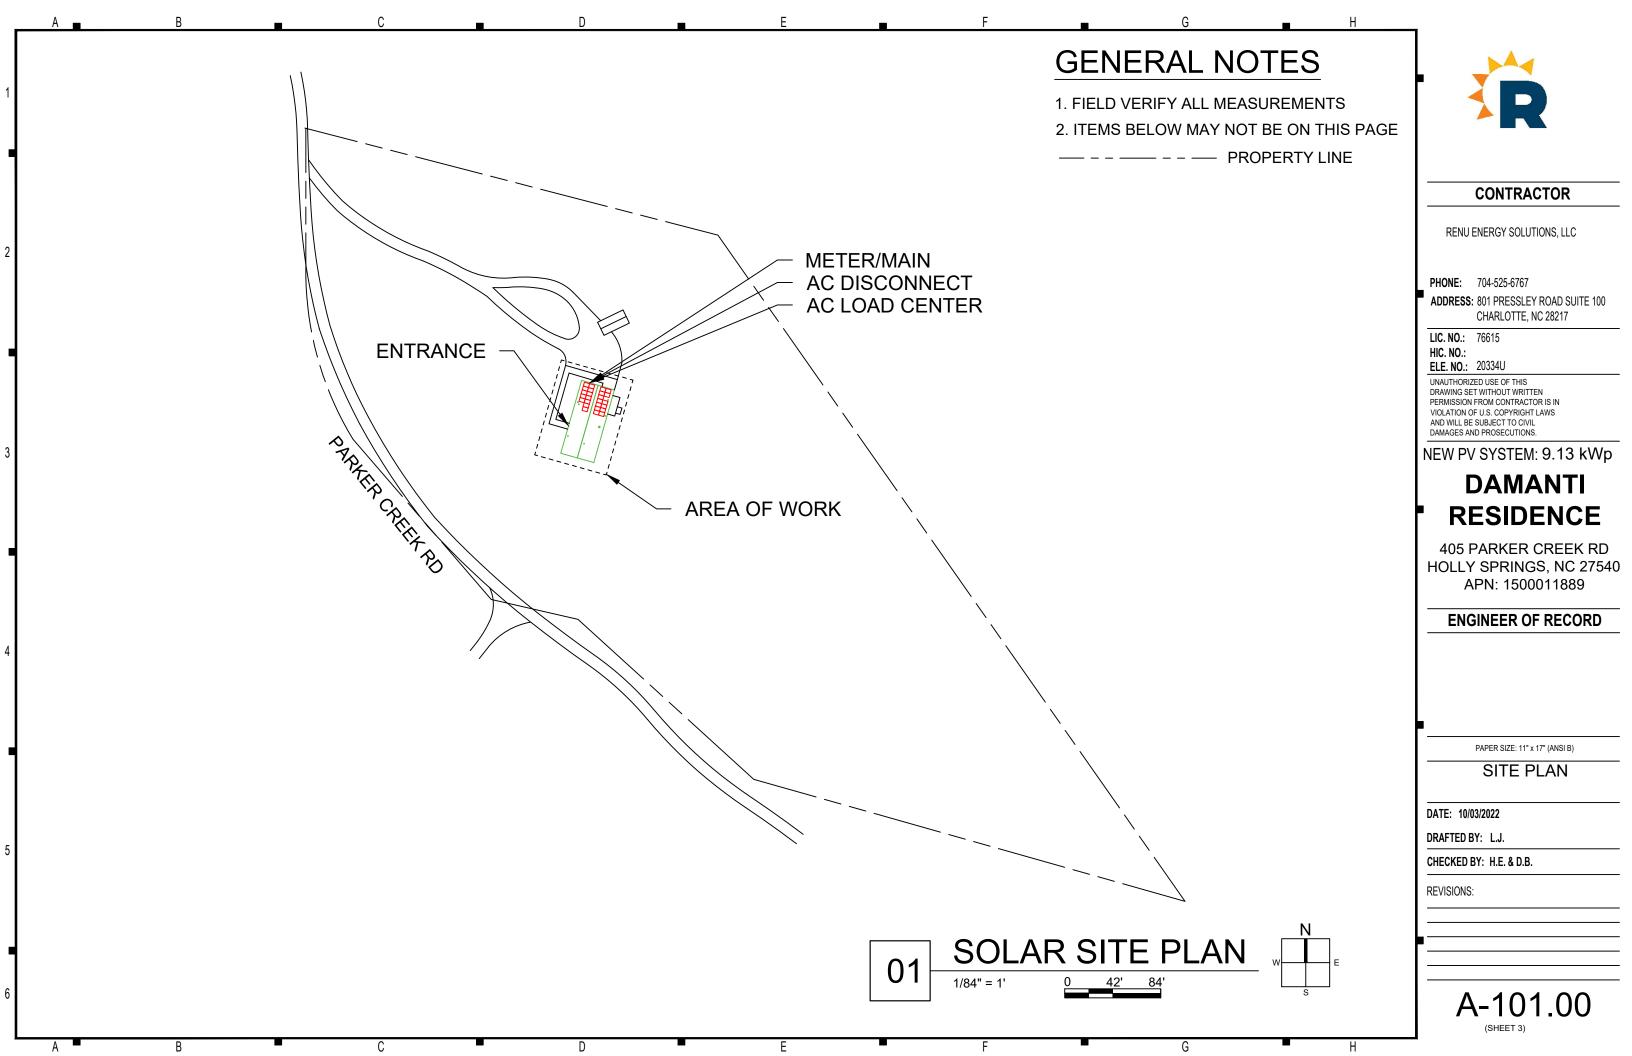

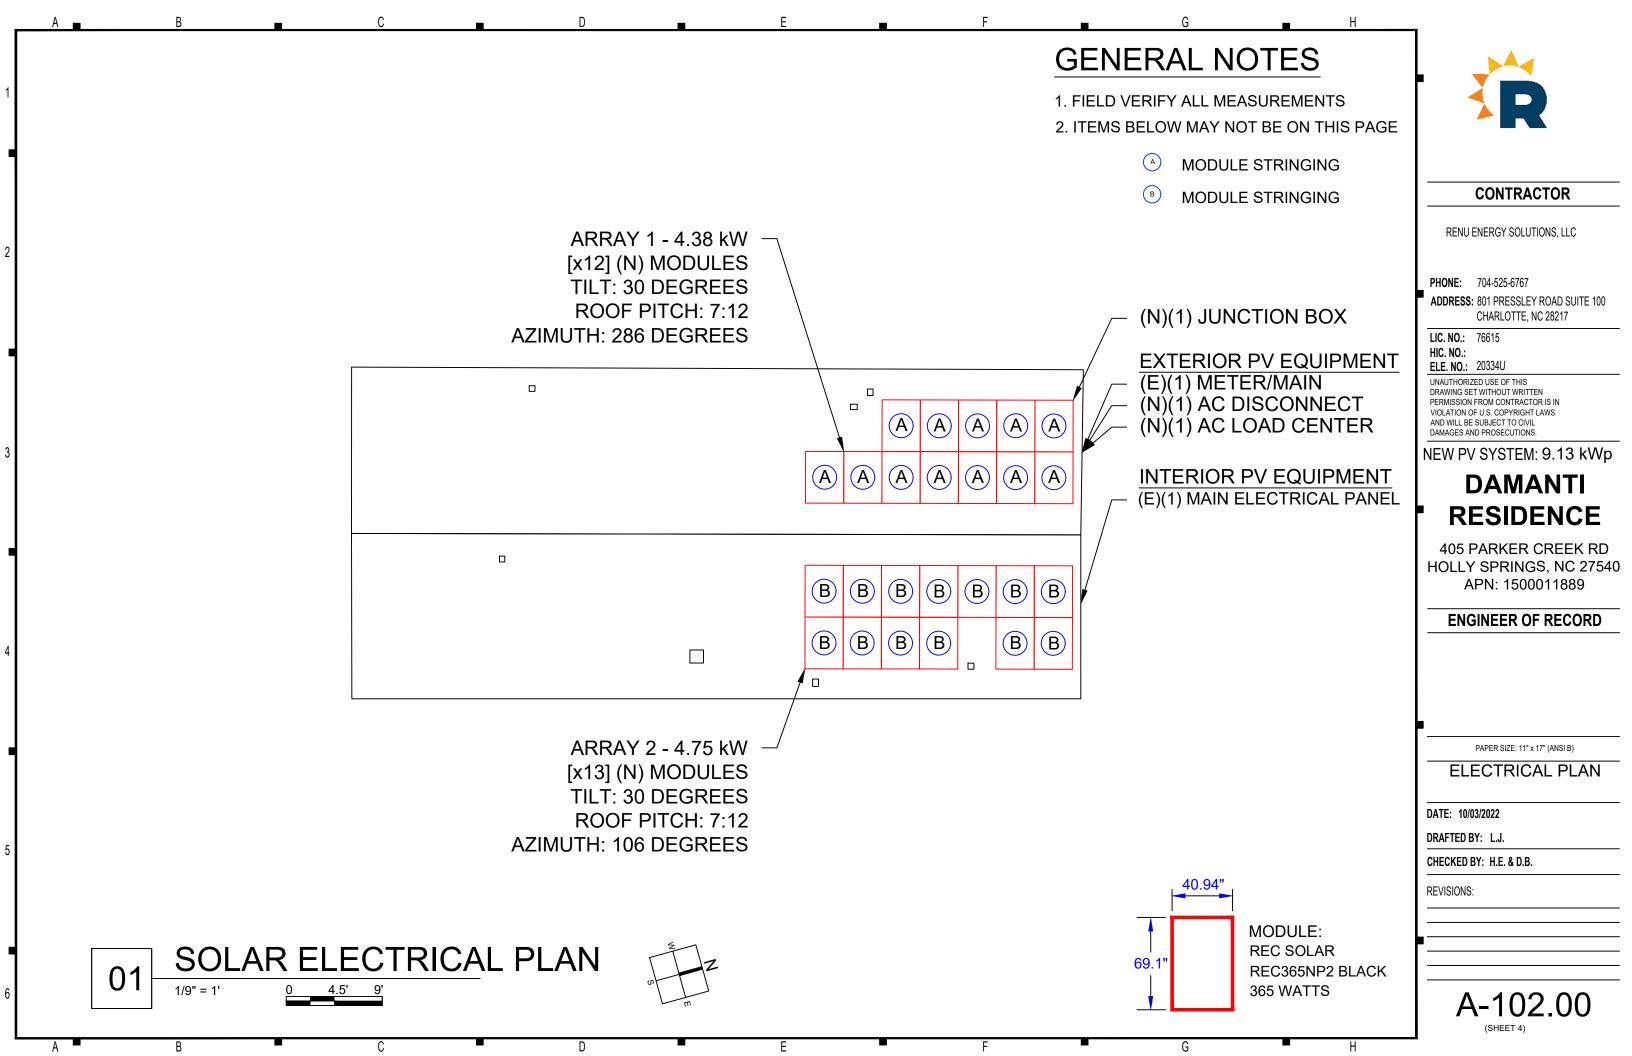

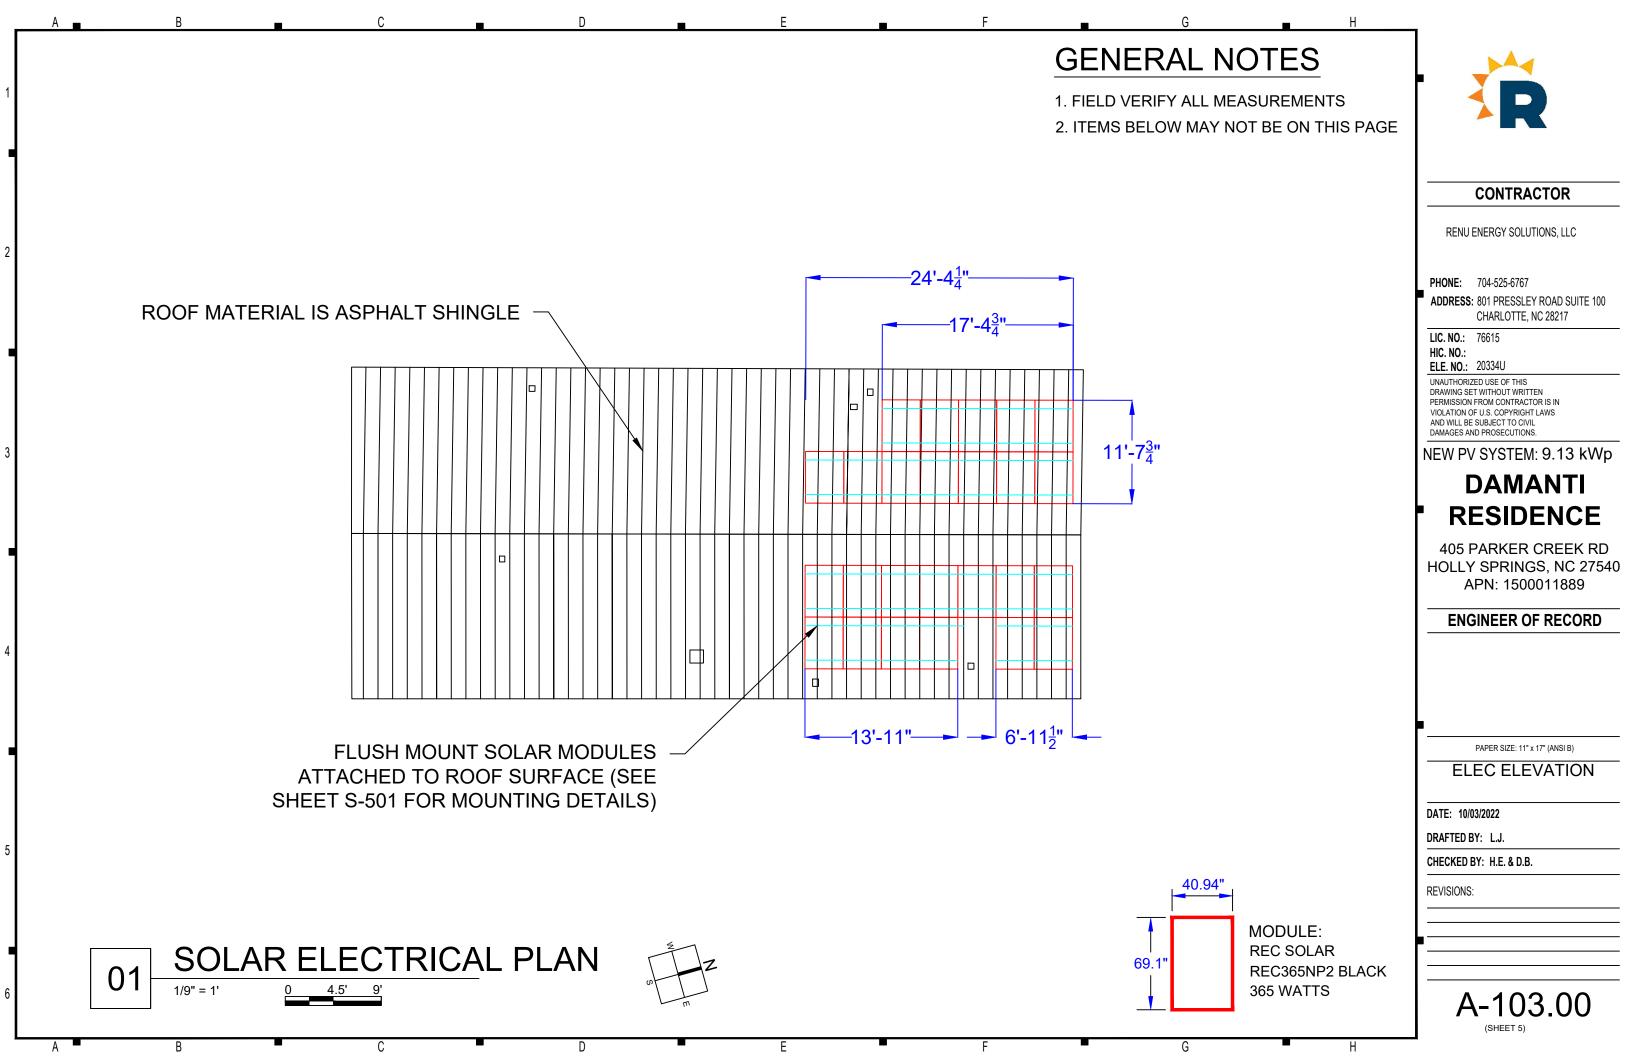

| _ | Α 🗖 | В | • | С | | D | _ E | | _ | F | | | G | | Н | |
|---|----------|---|--|---|------------|---------------------------------------|---|----------------------------------|------------------------|--------------------------------|-------------------------------|-------------------------|------------------|--------------------------|-----------------|---|
| | | | | | CO | NDUCTOR AND CONDUIT | SCHEDULE W/ELECT | RICAL CALCU | LATIONS | _ | | | | | | |
| 1 | TYPICAL | CONDUCTOR | CONDUIT | CURRENT-CARRYING CONDUCTORS IN CONDUIT | OCPD | NEUTRAL | EGC | TEMP. CORR. FACTOR | CONDUIT FILL FACTOR | CONT. CURRENT | MAX. CURRENT (125%) | BASE AMP. | DERATED AMP. | TERM. TEMP. RATING | AMP. @ TERMINAL | |
| | <u> </u> | 12 AWG PV WIRE | FREE AIR | N/A | N/A | - | 6 AWG BARE, COPPER | 0.91 (35.1 °C) | 1 | 14.52A | 18.15A | 30A | 27.3A | 75°C | 25A | |
| H | 2 1 | 10 AWG THWN-2, COPPER 8 AWG THWN-2, COPPER | 0.75" DIA 0.75" DIA | 2 | 20A 40A | - 8 AWG THWN-2, COPPER | 10 AWG THWN-2, COPPER 6 AWG THWN-2, COPPER | 0.91 (35.1 °C) 0.91 (35.1 °C) | 0.8 | 14.52A 29.04A | 18.15A 36.3A | 40A 55A | 29.12A 50.05A | 75°C 75°C | 35A 50A | |
| ╅ | 1 1 | 8 AWG THWN-2, COPPER | 0.75" DIA | 2 | N/A | 8 AWG THWN-2, COPPER | 6 AWG THWN-2, COPPER | 0.91 (35.1 °C) | 1 | 29.04A | 36.3A | 55A | 50.05A | 75°C | 50A | 1 |
| | 5 1 | 1 AWG THWN-2, COPPER | 1.25" DIA | 2 | N/A | 1 AWG THWN-2, COPPER | 1 AWG THWN-2, COPPER | 0.91 (35.1 °C) | 1 | 78.47A | 98.09A | 145A | 131.95A | 60°C | 110A |] |
| | A M | ODULE STRINGING | | | | | | JRCE CIRCUITS | | | | | | | | CONTRACTOR |
| 2 | B M | ODULE STRINGING | | | | | OR METAL | TO BE INSTALL ENCLOSURES | S PER NEC 69 | | | | | | | RENU ENERGY SOLUTIONS, LLC |
| | | | | | | | | EM EQUIPPED SHUTDOWN | WITH | | | | TO UTI | LITY | | BUONE 704 FOE 6767 |
| | | | [x25] SOLAR MODULES | [X25] MICROINVERTER | | | DISCON | INECT PER NE | | | | | GRID (| | | PHONE: 704-525-6767 ADDRESS: 801 PRESSLEY ROAD SUITE 100 |
| | | | MAKE: REC SOLAR MODEL: REC365NP2 BLACI RATED POWER: 365W | MAKE:ENPHASE K MODEL:IQ7PLUS-72-2-US | | | 2.SYSTEM NEC 690 | COMPLIANT W | VITH | | | | ^ ^ | | | CHARLOTTE, NC 28217 |
| | | A | | | | DV411 OAD O | | 0.10 | | | | | | | | LIC. NO.: 76615 |
| 4 | | 12 IN BRANCH | | ••• | II INIC | [X1] LOAD C CTION BOX 120/240V, 16 | | | | | | N - | 1 | | | HIC. NO.: |
| | | IN BRAINCH | 11 111 11 | II II | 1 | 125A BUSS | | | | | | | .1 | | | ELE. NO.: 20334U |
| | | В | | | | 2 | 0A CB1 | | | | | | | | | UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL |
| | | 13 IN BRANCH | | ••• | ٧ | V L_T | 0A CB2 | | | | | | | | | DAMAGES AND PROSECUTIONS. |
| 3 | | 2.0 0.00. | | | G | | UTILITY REQUIRED | ` ' | P GATEWAY 2 | | | | GR | ROUND | | NEW PV SYSTEM: 9.13 kWp |
| | | | ` \ | | T | | DISCONNECT SWIT AC DISCONNECT, (| | 1Ø, 3W 200A S ATS | | | (E) UTILITY METER | , RC | D | | DAMANTI |
| | | | | 1 | I | | | ^ | | | | | (E)G | ROUNDING | | RESIDENCE |
| ╛ | | | | i | | ENPHASE | 5A (3) (SW1) (| 4 CB1 45A | ı | | | N | | ECTRODE | | 405 PARKER CREEK RD |
| 1 | | | | l I | l I | MONITORING CB3 | | | | | | | | | | HOLLY SPRINGS, NC 27540 |
| | | | | į | i | G | | √ | | 5 | N O | (N) | TO (E) |) | | APN: 1500011889 |
| | | | | | l I | | _ | | \$0 II | | L2 | | LOADO | , | | ENGINEER OF RECORD |
| 4 | | | | L | | L J | | | Ģ- | V | (E) MAIN/MAIN | <u> </u> | 7_ | | | |
| | | | | | | | | | | | 240/120 V 1Ø, MAIN BUSS: 2 | | SACKFED E | NECTION TYPE: SREAKER | | |
| | | | | | | | | | | QUIPMENT LEFT NE IS (N) NEW | OF EQUIPMENT RIG | GHT OF | | | | |
| | | | | | | | | | | (11) 14611 | UNLESS OTHER NOTED. | RWISE | | | | • |
| 4 | | | | | | | | | | | | | | | | PAPER SIZE: 11" x 17" (ANSI B) |
| | | | | | | | | | | | | | | | | LINE DIAGRAM |
| | | | | | | | | | | | | | | | | DATE: 10/03/2022 |
| | | | | | | | | (5) | | | | | | | | DRAFTED BY: L.J. |
| | | | | | | | | | N G | | | | | | | CHECKED BY: H.E. & D.B. |
| | | | | | | | | | | | | | | | | REVISIONS: |
| | | | | | | | | | | TO (E) | | | | | | |
| ┛ | | | | | | | | | | TO (E) LOAD | | | | | | <u> </u> |
| 1 | | | | | | | | | 111 | | | | | | | |
| | | | | | | | | (N) PF | ROTECTED L | ー OADS PANE | :L | | | | | |
| | | | | | | | | 240/1 | 20V 1Ø, 3W | | | | | | | E-601.00 |
| | | | | | | | | MAIN | BUSS: 125A | | | | | | | (SHEET 6) |
| _ | | | | • | _ | | - | | | | | | ^ | | | 4 |

| SYSTEM SUMMARY | | | | | | | | | |
|------------------------|-----------|-----------|--|--|--|--|--|--|--|
| | BRANCH #1 | BRANCH #2 | | | | | | | |
| INVERTERS PER BRANCH | 12 | 13 | | | | | | | |
| MAX AC CURRENT | 14.5A | 15.7A | | | | | | | |
| MAX AC OUTPUT POWER | 3,480W | 3,770W | | | | | | | |
| ARRAY STC POWER | 9,12 | 25W | | | | | | | |
| ARRAY PTC POWER | 8,59 | 93W | | | | | | | |
| MAX AC CURRENT | 30 | .2A | | | | | | | |
| MAX AC POWER | 7,250W | | | | | | | | |
| DERATED (CEC) AC POWER | 7,25 | 50W | | | | | | | |

DESIGN TEMPERATURES

ASHRAE EXTREME LOW
ASHRAE 2% HIGH

-12°C (10.4°F), SOURCE: RALEIGH DURHAM INTERNATIONAL

34°C (93.2°F), SOURCE: RALEIGH DURHAM INTERNATIONAL

| | _ |
|----|---|
| | |
| ١. | |
| | |
| | _ |
| | |
| | ⊢ |

| MODULES | | | | | | | | | | |
|---------|------|---------------------------|------|--------|--------|--------|-------|-------|------------------------|-------------|
| REF. | QTY. | MAKE AND MODEL | PMAX | PTC | ISC | IMP | VOC | VMP | TEMP. COEFF. OF VOC | FUSE RATING |
| PM1-25 | 25 | REC SOLAR REC365NP2 BLACK | 365W | 343.7W | 11.36A | 10.65A | 40.9V | 34.3V | -0.106V/°C (-0.26%/°C) | 25A |

| | INVERTERS | | | | | | | | | |
|-------|-----------|-------------------------|---------------|----------|----------------|------|-----------------------|----------------------|----------------------|-------------------------|
| REF. | QTY. | MAKE AND MODEL | AC VOLTAGE | GROUND | OCPD RATING | | MAX OUTPUT CURRENT | MAX INPUT CURRENT | MAX INPUT VOLTAGE | CEC WEIGHTED EFFICIENCY |
| I1-25 | 25 | ENPHASE IQ7PLUS-72-2-US | 240V | FLOATING | 20A | 290W | 1.21A | 15A | 60V | 97.0% |

| | | DISCONNECT | ΓS | |
|------|------|--------------------------|---------------|-------------------|
| REF. | QTY. | MAKE AND MODEL | RATED CURRENT | MAX RATED VOLTAGE |
| SW1 | 1 | EATON DG22XXRB OR EQUIV. | 60A | 240VAC |

| | | OCPDS | |
|-------|------|---------------|-------------|
| REF. | QTY. | RATED CURRENT | MAX VOLTAGE |
| CB1-2 | 2 | 20A | 240VAC |
| CB3 | 1 | 15A | 240VAC |
| CB4 | 1 | 125A | 240VAC |



CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100 CHARLOTTE, NC 28217

LIC. NO.: 76615 HIC. NO.: ELE. NO.: 20334U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

DESIGN TABLES

DATE: 10/03/2022

DRAFTED BY: L.J.

CHECKED BY: H.E. & D.B.

REVISIONS:

(SHEET 7)

A B C D E F G

LABELING NOTES

1.1 LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRICAL CODE, INTERNATIONAL FIRE CODE 605.11, OSHA STANDARD 1910.145, ANSI Z535 1.2 MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.

1.3 LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.

1.4 LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8" AND PERMANENTLY AFFIXED. 1.5 ALERTING WORDS TO BE COLOR CODED. "DANGER" WILL HAVE RED BACKGROUND; "WARNING" WILL HAVE ORANGE BACKGROUND; "CAUTION" WILL HAVE YELLOW BACKGROUND. [ANSI Z535]

↑ WARNING

ELECTRICAL SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

AT EACH DISCONNECTING MEANS FOR PHOTOVOLTAIC EQUIPMENT (2" X 4"). [NEC 690.13].

⚠ WARNING

POWER SOURCE OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL 2

AT POINT OF INTERCONNECTION OVERCURRENT DEVICE (2" X 4"). [NEC 705.12(B)(2)(3)(B)].

PHOTOVOLTAIC SYSTEM AC DISCONNECT

RATED AC OUTPUT CURRENT 30.2 A
NOMINAL OPERATING AC VOLTAGE 240 V

AT POINT OF INTERCONNECTION, MARKED AT DISCONNECTING MEANS (4" X 2"). [NEC 690.54]

PHOTOVOLTAIC SOLAR AC DISCONNECT

LABEL 4

AT EACH AC DISCONNECTING MEANS (4" X 1"). [NEC 690.13(B)].

LABEL 7

AT POINT OF INTERCONNECTION (2 3/4" X 1 5/8"). [NEC 705.12(B)(3)]

AND PV SOLAR


ELECTRIC SYSTEM

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

LABEL 5

AT RAPID SHUTDOWN DISCONNECT SWITCH (5 1/4" X 2"). [NEC 690.56(C)(3)].

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN



TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN ARRAY

LABEL 6

AT RAPID SHUTDOWN SYSTEM (3 3/4" X 5 1/4"). [NEC 690.56(C)(1)(A)].

MWARNING DUAL POWER SUPPLY

⚠ WARNING SOURCES: UTILITY GRID SOLAR ELECTRIC **CIRCUIT BREAKER** IS BACKFED

LABEL 8

AT POINT OF INTERCONNECTION [NEC 705.12(B)(3)]

INTERACTIVE PHOTOVOLTAIC SYSTEM CONNECTED PHOTOVOLTAIC SYSTEM DISCONNECT LOCATED WEST SIDE OF THE HOUSE

DIRECTORY

PERMANENT PLAQUE OR DIRECTORY PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS IF NOT IN THE SAME LOCATION (5 3/4" X 1 1/8"). [NEC 690.56(B)]

WHERE THE PV SYSTEMS ARE REMOTELY LOCATED FROM EACH OTHER, A DIRECTORY IN ACCORDANCE WITH 705.10 SHALL BE PROVIDED AT EACH PV SYSTEM DISCONNECTING MEANS.

PV SYSTEM EQUIPMENT AND DISCONNECTING MEANS SHALL NOT BE INSTALLED IN **BATHROOMS** [NEC 690.4(D),(E)]

WARNING: PHOTOVOLTAIC **POWER SOURCE**

LABEL 9

AT EXPOSED RACEWAYS, CABLE TRAYS, AND OTHER WIRING METHODS: SPACED AT MAXIMUM 10 FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS (5 3/4" X 1 1/8"). [NEC 690.31(G)] LETTERS AT LEAST 3/8 INCH; WHITE ON RED BACKGROUND; REFLECTIVE [IFC 605.11.1.1]

A CAUTION

SOLAR ELECTRIC SYSTEM CONNECTED

AT UTILITY METER (5 3/4" X 1 1/8") [NEC 690.56(B)]



CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100 CHARLOTTE, NC 28217

LIC. NO.: 76615

HIC. NO.: ELE. NO.: 20334U UNAUTHORIZED USE OF THIS

DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)


PLACARDS

DRAFTED BY: L.J.

DATE: 10/03/2022


CHECKED BY: H.E. & D.B.

REVISIONS:

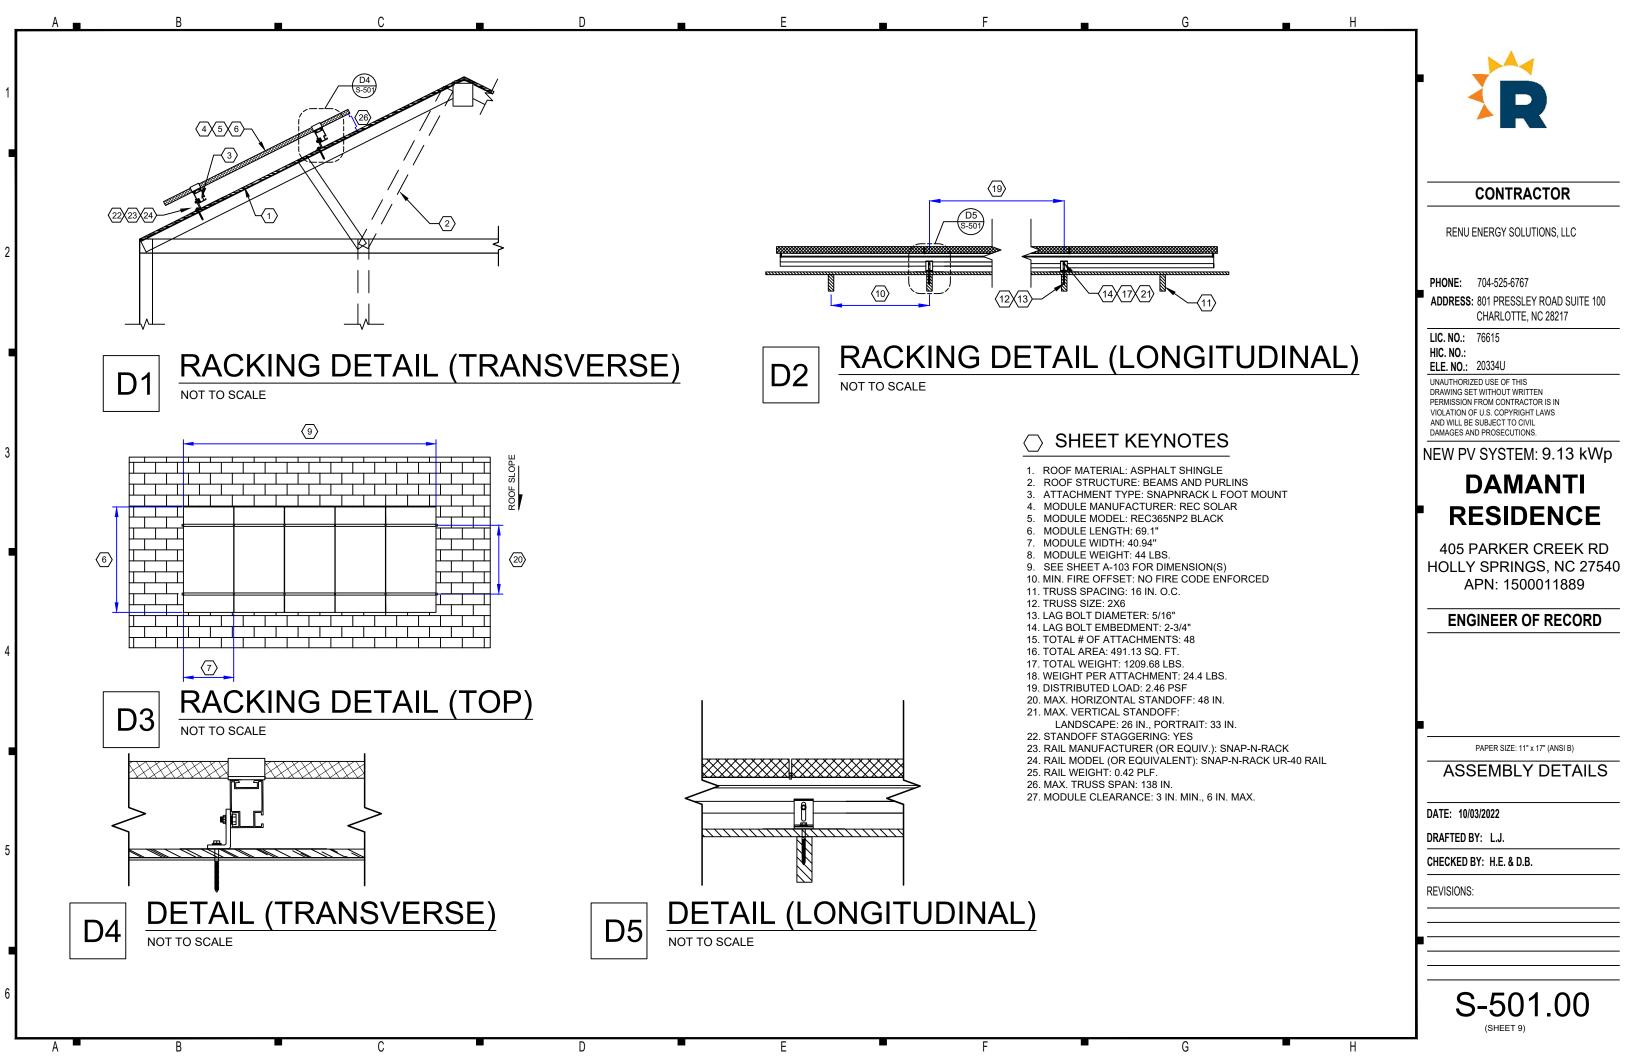



REC N-PEAK 2 BLACK SERIES

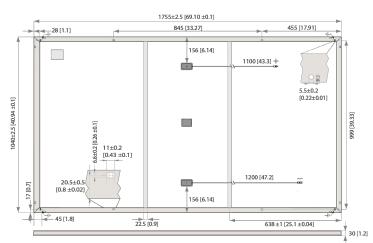

Measurements in mm [in]

| ELECTRICAL DATA @ STC | Product code*: REC | Product code*: RECxxxNP2 Black | | | | | | |
|--|--------------------|--------------------------------|-------|-------|--|--|--|--|
| Nominal Power - P _{MAX} (Wp) | 355 | 360 | 365 | 370 | | | | |
| Watt Class Sorting-(W) | 0/+5 | 0/+5 | 0/+5 | 0/+5 | | | | |
| Nominal Power Voltage - V _{MPP} (V) | 33.5 | 33.9 | 34.3 | 34.7 | | | | |
| Nominal Power Current-I _{MPP} (A) | 10.60 | 10.62 | 10.65 | 10.68 | | | | |
| Open Circuit Voltage - V _{oc} (V) | 40.7 | 40.8 | 40.9 | 41.1 | | | | |
| Short Circuit Current-I _{sc} (A) | 11.27 | 11.31 | 11.36 | 11.41 | | | | |
| Panel Efficiency (%) | 19.4 | 19.7 | 20.0 | 20.3 | | | | |

Values at standard test conditions (STC: air mass AM 1.5, irradiance $1000\,\text{W/m}^2$, temperature 25°C), based on a production spread with a tolerance of P_{MWV} V_{CC} &L $_{\text{SC}}$ 23% within one watt class. *Where xxx indicates the nominal power class (P_{MWV} at STC above.

| ELECTRICAL DATA @ NOCT | Product code*: REC | Product code*: RECxxxNP2 Black | | | | | |
|---|--|--------------------------------|-------------|------|--|--|--|
| Nominal Power - P _{MAX} (Wp) | 268 | 272 | 276 | 280 | | | |
| Nominal Power Voltage - V _{MPP} (V) | 31.3 | 31.7 | 32.1 | 32.5 | | | |
| Nominal Power Current - I _{MPP} (A) | 8.56 | 8.58 | 8.60 | 8.63 | | | |
| OpenCircuitVoltage-V _{oc} (V) | 38.1 | 38.2 | 38.2 | 38.4 | | | |
| Short Circuit Current-I _{sc} (A) | 9.10 | 9.13 | 9.18 | 9.22 | | | |
| Nominal operating cell temperature (NOCT: air mass *Where xxx indicates the nominal power class (P _{MAX}) at \$ | s AM 1.5, irradiance 800 W/m², temperati STC above. | ıre 20°C, windsp | eed 1 m/s). | | | | |

IEC 61215:2016, IEC 61730:2016, UL 61730 (Pending) ISO 14001:2004, ISO 9001:2015, OHSAS 18001:2007, IEC 62941



| | Standard | REC ProTrust | | |
|--|----------|--------------|-----------|--|
| Installed by an REC Certified Solar Professional | No | Yes | Yes | |
| System size | any | ≤25 kW | 25-500 kW | |
| Product Warranty (yrs) | 20 | 25 | 25 | |
| Power Warranty (yrs) | 25 | 25 | 25 | |
| Labor Warranty (yrs) | 0 | 25 | 10 | |
| Power in Year 1 | 98% | 98% | 98% | |
| Annual Degradation | 0.25% | 0.25% | 0.25% | |
| Power in Year 25 | 92% | 92% | 92% | |
| | | | | |

ypical low irradiance performance of module at STC.

Founded in 1996, REC Group is an international pioneering solar energy company dedicated to empowering consumers with clean, affordable solar power. As Solar's Most Trusted, REC is committed to high quality, innovation, and a low carbon footprint in the solar materials and solar panels it manufactures. Headquartered in Norway with operational headquarters in Singapore, REC also has regional hubs in North America, Europe, and Asia-Pacific.



Irradiance (W/m²)

120 half-cut mono c-Si n-type cells

anti-reflection surface treatment

3-part, 3 bypass diodes, IP68 rated

12 AWG (4 mm²) PV wire, 43 + 47" (1.1 m + 1.2 m)

69.1 x 40.94 x 1.2 in (1755 x 1040 x 30 mm)

See installation manual for mounting instructions.

Design load = Test load / 1.5 (safety factor)

Connectors: Stäubli MC4 PV-KBT4/KST4, 12 AWG(4 mm²)

Backsheet

Maximum system voltage

Maximum test load (front)

Maximum test load (rear): Max series fuse rating:

Temperature coefficient of P_{MAX}

Temperature coefficient of Voc: Temperature coefficient of I_{sc}:

Max reverse current:

6 strings of 20 cells in series 0.13" (3.2 mm) solar glass with

> Highly resistant polymeric construction (black)

Anodized aluminum (black)

n accordance with IEC 62790

in accordance with IEC 62852

Made in Singapore

19.70 sq ft (1.83 m²)

44.0 lbs (20.0 kg)

+7000 Pa (146 psf)*

-4000 Pa (83.5 psf)*

-40 ... +85°C

44.3°C (±2°C)

-0.34 %/°C -0.26 %/°C

0.04 %/°C

1000 V

25 A 25 A

CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100

CHARLOTTE, NC 28217 LIC. NO.: 76615 HIC. NO.:

ELE. NO.: 20334U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10/03/2022

DRAFTED BY: L.J.

CHECKED BY: H.E. & D.B.

REVISIONS:

Enphase Microinverters Region: AMERICAS

Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready Enphase IQ 7 Micro™ and Enphase IQ 7+ Micro™ dramatically simplify the installation process while

achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate with the Enphase IQ Envoy™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.



To learn more about Enphase offerings, visit enphase.com

Easy to Install

- · Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

Productive and Reliable

- Optimized for high powered 60-cell/120 half-cell and 72cell/144 half-cell* modules
- · More than a million hours of testing
- · Class II double-insulated enclosure
- UL listed

Smart Grid Ready

- · Complies with advanced grid support, voltage and frequency ride-through requirements
- · Remotely updates to respond to changing grid requirements
- · Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)
- * The IQ 7+ Micro is required to support 72-cell/144 half-cell modules.



Enphase IQ 7 and IQ 7+ Microinverters

| INPUT DATA (DC) | IQ7-60-2-US | | IQ7PLUS-72-2 | -US | |
|--|--|----------------------|--|----------------------|----|
| Commonly used module pairings ¹ | 235 W - 350 W + | | 235 W - 440 W - | 235 W - 440 W + | |
| Module compatibility | 60-cell/120 half-cell PV modules only | | 60-cell/120 half-cell and 72- cell/144 half-cell PV modules | | |
| Maximum input DC voltage | 48 V | | 60 V | | |
| Peak power tracking voltage | 27 V - 37 V | | 27 V - 45 V | | |
| Operating range | 16 V - 48 V | | 16 V - 60 V | | |
| Min/Max start voltage | 22 V / 48 V | | 22 V / 60 V | | |
| Max DC short circuit current (module Isc) | 15 A | | 15 A | | |
| Overvoltage class DC port | II | | II | | |
| DC port backfeed current | 0 A | | 0 A | | |
| PV array configuration | 1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit | | | | |
| OUTPUT DATA (AC) | IQ 7 Microinve | erter | IQ 7+ Microin | verter | |
| Peak output power | 250 VA | | 295 VA | | |
| Maximum continuous output power | 240 VA | | 290 VA | | |
| Nominal (L-L) voltage/range ² | 240 V / 211-264 V | 208 V / 183-229 V | 240 V / 211-264 V | 208 V / 183-229 V | |
| Maximum continuous output current | 1.0 A (240 V) | 1.15 A (208 V) | 1.21 A (240 V) | 1.39 A (208 \ | /) |
| Nominal frequency | 60 Hz | | 60 Hz | | |
| Extended frequency range | 47 - 68 Hz | | 47 - 68 Hz | | |
| AC short circuit fault current over 3 cycles | 5.8 Arms | | 5.8 Arms | | |
| Maximum units per 20 A (L-L) branch circuit ³ | 16 (240 VAC) | 13 (208 VAC) | 13 (240 VAC) | 11 (208 VAC) |) |
| Overvoltage class AC port | III | | III | | |
| AC port backfeed current | 18 mA | | 18 mA | | |
| Power factor setting | 1.0 | | 1.0 | | |
| Power factor (adjustable) | 0.85 leading | 0.85 lagging | 0.85 leading (| 0.85 lagging | |
| EFFICIENCY | @240 V | @208 V | @240 V | @208 V | |
| Peak efficiency | 97.6 % | 97.6 % | 97.5 % | 97.3 % | |
| CEC weighted efficiency | 97.0 % | 97.0 % | 97.0 % | 97.0 % | |
| MECHANICAL DATA | | | | | |
| Ambient temperature range | -40°C to +65°C | | | | |
| Relative humidity range | 4% to 100% (condensing) | | | | |
| Connector type | MC4 (or Amphenol H4 UTX with additional Q-DCC-5 adapter) | | | | |
| Dimensions (HxWxD) | 212 mm x 175 mm x 30.2 mm (without bracket) | | | | |
| Weight | 1.08 kg (2.38 lbs) | | | | |
| Cooling | Natural convection - No fans | | | | |
| Approved for wet locations | Yes | | | | |
| Pollution degree | PD3 | | | | |
| Enclosure | Class II double-insulated, corrosion resistant polymeric enclosure | | | | |
| Environmental category / UV exposure rating | NEMA Type 6 / outdoor | | | | |
| FEATURES | | | | | |
| Communication | Power Line Con | nmunication (PLC) | | | |
| Monitoring | Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy. | | | | |
| Disconnecting means | The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690. | | | | |
| Compliance | CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 1071-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems for AC and DC conductors, when installed according manufacturer's instructions. | | | | |

- 1. No enforced DC/AC ratio. See the compatibility calculator at https://enphase.com/en-us/support/module-compatibility
- Nominal voltage range can be extended beyond nominal if required by the utility.
 Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

ENPHASE. To learn more about Enphase offerings, visit enphase.com © 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enphase IQ 7, Enphase IQ 7+, Enphase IQ Battery,

Enphase Enlighten, Enphase IQ Envoy, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2020-08-12



CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100

CHARLOTTE, NC 28217

LIC. NO.: 76615 HIC. NO.: ELE. NO.: 20334U

UNAUTHORIZED USE OF THIS DRAWING SET WITHOUT WRITTEN PERMISSION FROM CONTRACTOR IS IN VIOLATION OF U.S. COPYRIGHT LAWS AND WILL BE SUBJECT TO CIVIL DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD **HOLLY SPRINGS, NC 27540** APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10/03/2022 DRAFTED BY: L.J.

CHECKED BY: H.E. & D.B.

REVISIONS:

A B C D E E G H

Data Sheet Enphase Networking

X-IQ-AM1-240-4C

Enphase IQ Combiner 4/4C X-IQ-AM1-240-4



The Enphase IQ Combiner 4/4C with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- · Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Centered mounting brackets support single stud mounting
- · Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC
- plug-in breakers (not included)

 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- · Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- III lietor

ENPHASE.

Enphase IQ Combiner 4/4C

| IQ Combiner 4 (X-IQ-AM1-240-4) | IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (AN | | | |
|---|--|--|--|--|
| IQ CONTIBILIES 4 (X-1Q-AMTI-240-4) | (Q. Combiner 4 with Enphase (Q. Gateway printed circuit board for integrated revenue grade PV production metering (A. C12.20 +/-0.5%) and consumption monitoring (+/-2.5%). Includes a silver solar shield to match the IQ Battery system (Q. System Controller 2 and to deflect heat. | | | |
| IQ Combiner 4C (X-IQ-AM1-240-4C) | IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/-0.5%) and consumption monitoring (+/-2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect he | | | |
| ACCESSORIES AND REPLACEMENT PARTS | (not included, order separately) | | | |
| Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05 | - Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan for Ensemble sites - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan | | | |
| Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B | Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 20A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support | | | |
| EPLC-01 | Power line carrier (communication bridge pair), quantity - one pair | | | |
| XA-SOLARSHIELD-ES | Replacement solar shield for IQ Combiner 4/4C | | | |
| XA-PLUG-120-3 | Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01) | | | |
| XA-ENV-PCBA-3 | Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C | | | |
| X-IQ-NA-HD-125A | Hold down kit for Eaton circuit breaker with screws. | | | |
| ELECTRICAL SPECIFICATIONS | | | | |
| Rating | Continuous duty | | | |
| System voltage | 120/240 VAC, 60 Hz | | | |
| Eaton BR series busbar rating | 125 A | | | |
| Max. continuous current rating | 65 A | | | |
| Max. continuous current rating (input from PV/storage) | 64 A | | | |
| Max. fuse/circuit rating (output) | 90 A | | | |
| Branch circuits (solar and/or storage) | Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included) | | | |
| Max. total branch circuit breaker rating (input) | 80A of distributed generation / 95A with IQ Gateway breaker included | | | |
| Production metering CT | 200 A solid core pre-installed and wired to IQ Gateway | | | |
| Consumption monitoring CT (CT-200-SPLIT) | A pair of 200 A split core current transformers | | | |
| MECHANICAL DATA | | | | |
| Dimensions (WxHxD) | 37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with mounting brackets. | | | |
| Weight | 7.5 kg (16.5 lbs) | | | |
| Ambient temperature range | -40° C to +46° C (-40° to 115° F) | | | |
| Cooling | Natural convection, plus heat shield | | | |
| Enclosure environmental rating | Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction | | | |
| Wire sizes | 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors 60 A breaker branch input: 4 to 1/0 AWG copper conductors Main lug combined output: 10 to 2/0 AWG copper conductors Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing. | | | |
| Altitude | To 2000 meters (6,560 feet) | | | |
| INTERNET CONNECTION OPTIONS | | | | |
| Integrated Wi-Fi | 802.11b/g/n | | | |
| Cellular | CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations. | | | |
| Ethernet | Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included) | | | |
| COMPLIANCE | | | | |
| | UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 | | | |
| Compliance, IQ Combiner | Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5 | | | |



© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 10-21-2021



CONTRACTOR

RENU ENERGY SOLUTIONS, LLC

PHONE: 704-525-6767

ADDRESS: 801 PRESSLEY ROAD SUITE 100

CHARLOTTE, NC 28217

LIC. NO.: 76615 HIC. NO.: ELE. NO.: 20334U

UNAUTHORIZED USE OF THIS
DRAWING SET WITHOUT WRITTEN
PERMISSION FROM CONTRACTOR IS IN
VIOLATION OF U.S. COPYRIGHT LAWS
AND WILL BE SUBJECT TO CIVIL
DAMAGES AND PROSECUTIONS.

NEW PV SYSTEM: 9.13 kWp

DAMANTI RESIDENCE

405 PARKER CREEK RD HOLLY SPRINGS, NC 27540 APN: 1500011889

ENGINEER OF RECORD

PAPER SIZE: 11" x 17" (ANSI B)

RESOURCE DOCUMENT

DATE: 10/03/2022 DRAFTED BY: L.J.

CHECKED BY: H.E. & D.B.

REVISIONS:

R-003.00

ENPHASE

B C D E F

