


© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.



PV MATERIAL SUMMARY: DISTRIBUTOR

|                        |    |
|------------------------|----|
| REC405AA PURE          | 33 |
| IQ7A-72-2-US           | 33 |
| X-IQ-AM1-240-3-ES      | 1  |
| Q-12-10-240            | 33 |
| Q-12-17-240            | 15 |
| Q-SEAL-10              | 15 |
| Q-TERM-10              | 5  |
| XR-10-168B             | 21 |
| XR-10-204B             | 4  |
| XR10-BOSS-01-M1        | 14 |
| UFO-CL-01-B1           | 86 |
| UFO-STP-30MM-B1        | 40 |
| XR-LUG-03-A1           | 10 |
| 4 IN QB1               | 74 |
| MI-BHW                 | 33 |
| GC66803 Geocel Sealant | 5  |
| SOLADECK 0799-5B       | 4  |

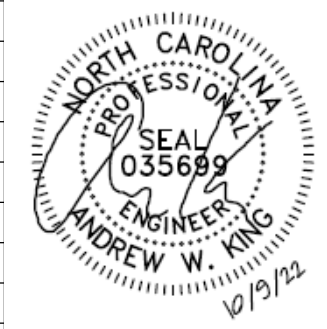

**CLIENT INFO**  
 JULIE BARAJAS  
 491 OLD FIELD LOOP  
 SANFORD, NC 27332

**PROJECT INFO**  
 DC INPUT: 13.365 kW  
 AC EXPORT: 11.517 kW  
 DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**  
 NATION ELECTRICAL CODE v. 2017  
 NC FIRE PROTECTION CODE v. 2018  
 NC BUILDING CODE v. 2018  
 NC RESIDENTIAL CODE v. 2018  
 ACSE v. 7-10

**SITE CONDITIONS**  
 WIND SPEED: 116 MPH  
 RISK CATEGORY: II  
 EXPOSURE: B  
 SNOW: 10 PSF

**SHEET INDEX**  
 PV-1: COVER SHEET  
 PV-2: PV STRUCTURAL  
 PV-3: PV ELECTRICAL  
 PV-4: PV EQUIPMENT LABELS  
 PV-5: PV INSTALL GUIDE


**DESIGNER INFO**  
 DESIGNER: MCP  
 ENGINEER: AWK  
 DATE: 10/4/2022  
 VERSION: P1

PV SYSTEM COVER PAGE

PV-1.1



© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

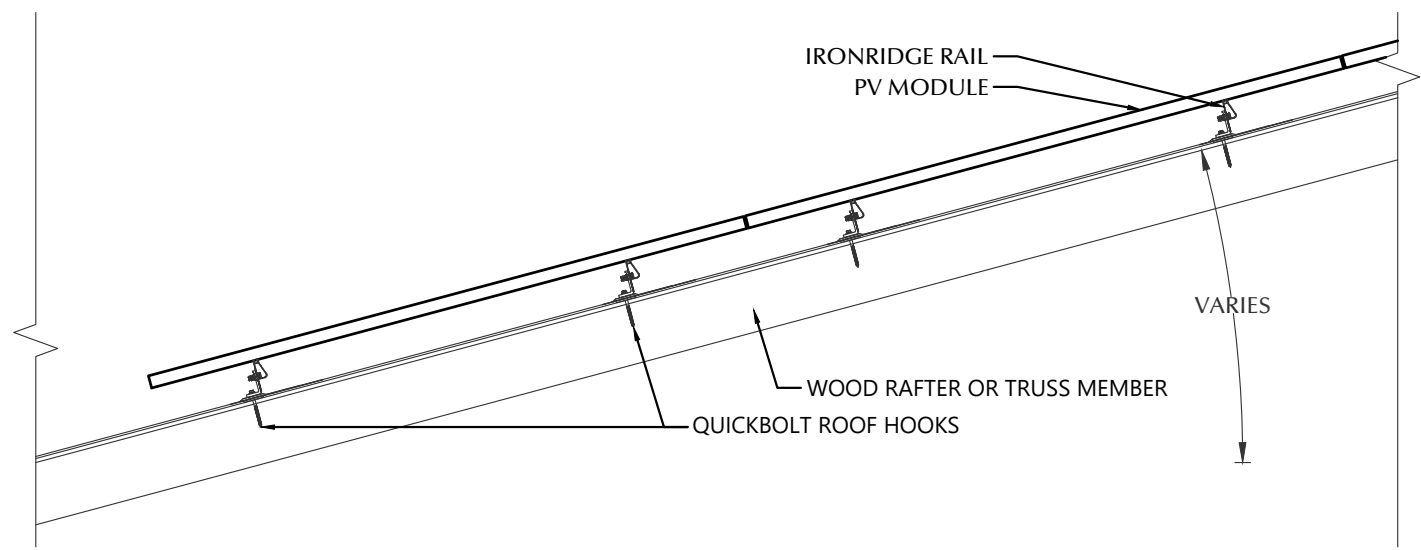


**STATEMENT OF STRUCTURAL COMPLIANCE**

THE EXISTING ROOF STRUCTURE HAS BEEN DESIGNED TO SUPPORT THE ADDITIONAL LOADS OF THE PROPOSED PV SYSTEM. IN ADDITION, THE RACKING AND FASTENING SYSTEM SHALL BE CAPABLE OF SECURING THE SYSTEM TO THE STRUCTURE UNDER DESIGN CONDITIONS WHEN INSTALLED PROPERLY AND IN ACCORDANCE WITH THE RACKING AND FASTENING ARRANGEMENT DETAILED WITHIN THESE DRAWINGS.

NAME: ANDREW W. KING, PE  
 SIGNED: *Andrew W. King*

| PV MODULES   |               |
|--------------|---------------|
| MAKE         | REC           |
| MODEL        | REC405AA PURE |
| WIDTH        | 40.00 IN      |
| LENGTH       | 71.70 IN      |
| THICKNESS    | 30 MM         |
| WEIGHT       | 45.00 LBS.    |
| ARRAY AREA   | 139 SQFT.     |
| ARRAY WEIGHT | 349 LBS.      |

| ROOF SUMMARY   |                  |
|----------------|------------------|
| STRUCTURE:     |                  |
| TYPE           | TRUSSES          |
| MATERIAL       | SOUTHERN PINE #2 |
| SIZE           | 2 X 4            |
| SPACING        | 24 IN O.C.       |
| ALLOWABLE SPAN | 88 IN            |
| PITCH          | 8/12             |
| DENSITY        | 30 LBS./CU.FT.   |
| DECKING:       |                  |
| TYPE           | OSB              |
| MATERIAL       | COMPOSITE        |
| THICKNESS      | 7/16 IN          |
| WEIGHT         | 1.60 LBS./SQFT   |
| ROOFING:       |                  |
| TYPE           | ASPHALT SHINGLE  |
| MATERIAL       | ASPHALT          |
| WEIGHT         | 2.30 LBS./SQFT.  |

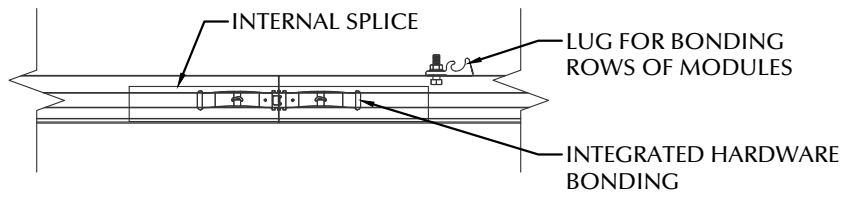


| ROOF MOUNT SUMMARY |                 |               |
|--------------------|-----------------|---------------|
| MAXIMUM (IN)       | MOUNT SPACING   | RAIL OVERHANG |
| WIND ZONE 1        | PORT 72 LAND 72 | 19 IN         |
| WIND ZONE 2        | PORT 48 LAND 48 | 19 IN         |
| WIND ZONE 3        | PORT 48 LAND 48 | 19 IN         |

| ROOF LOADING      |                  |
|-------------------|------------------|
| GROUND SNOW LOAD: | 15 LBS./SQFT.    |
| LIVE LOAD         | 20 LBS./SQFT.    |
| DEAD LOAD         |                  |
| ROOFING           | 3.9 LBS./SQFT.   |
| PV ARRAY          | 2.5 LBS./SQFT.   |
| TOTAL             | 6.4 LBS./SQFT.   |
| WIND LOAD:        |                  |
| UPLIFT ZONE 1     | -24.6 LBS./SQFT. |
| UPLIFT ZONE 2     | -29.0 LBS./SQFT. |
| UPLIFT ZONE 3     | -29.0 LBS./SQFT. |
| DOWNWARD          | 23.0 LBS./SQFT.  |
| FASTENER LOAD:    |                  |
| UPLIFT ZONE 1     | -358 LBS.        |
| UPLIFT ZONE 2     | -281 LBS.        |
| UPLIFT ZONE 3     | -281 LBS.        |
| DOWNWARD          | 335 LBS.         |

| ROOF MOUNT & FASTENER |                  |
|-----------------------|------------------|
| ROOF MOUNT:           |                  |
| MAKE                  | QUICKBOLT        |
| MODEL                 | 4 IN QB1         |
| MATERIAL              | STAINLESS / EPDM |
| FASTENER:             |                  |
| MAKE                  | QUICK SCREWS     |
| MODEL                 | HANGER BOLT      |
| MATERIAL              | 304 SS           |
| SIZE                  | 5/16-18 X 5-1/4" |
| GENERAL:              |                  |
| WEIGHT                | 0.56 LBS.        |
| FASTENERS PER MOUNT   | 1                |
| MAX. PULL-OUT FORCE   | 960.0 LBS.       |
| SAFETY FACTOR         | 2                |
| DESIGN PULL-OUT FORCE | 480.0 LBS.       |

| MOUNTING RAILS |              |
|----------------|--------------|
| MAKE           | IRONRIDGE    |
| MODEL          | XR10         |
| MATERIAL       | ALUMINUM     |
| WEIGHT         | 0.425 LBS/IN |
| SPACING        | 36 IN        |

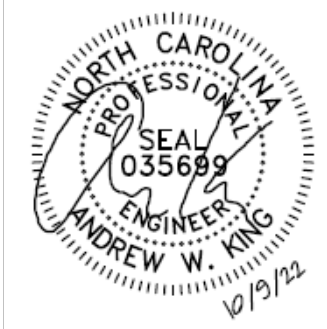

**CLIENT INFO**  
 JULIE BARAJAS  
 491 OLD FIELD LOOP  
 SANFORD, NC 27332

**PROJECT INFO**  
 DC INPUT: 13.365 kW  
 AC EXPORT: 11.517 kW  
 DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**  
 NATION ELECTRICAL CODE v. 2017  
 NC FIRE PROTECTION CODE v. 2018  
 NC BUILDING CODE v. 2018  
 NC RESIDENTIAL CODE v. 2018  
 ACSE v. 7-10





**SITE CONDITIONS**  
 WIND SPEED: 116 MPH  
 RISK CATEGORY: II  
 EXPOSURE: B  
 SNOW: 10 PSF

**SHEET INDEX**  
 PV-1: COVER SHEET  
 PV-2: PV STRUCTURAL  
 PV-3: PV ELECTRICAL  
 PV-4: PV EQUIPMENT LABELS  
 PV-5: PV INSTALL GUIDE


**DESIGNER INFO**  
 DESIGNER: MCP  
 ENGINEER: AWK  
 DATE: 10/4/2022  
 VERSION: P1

**PV SYSTEM STRUCTURAL**

**PV-2.1**

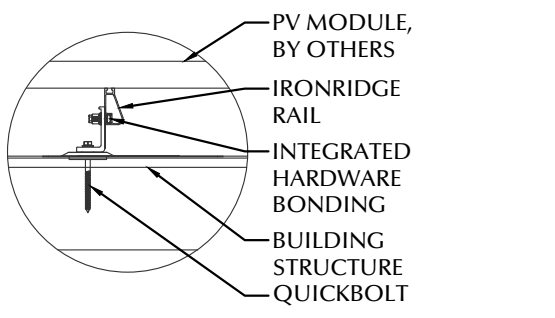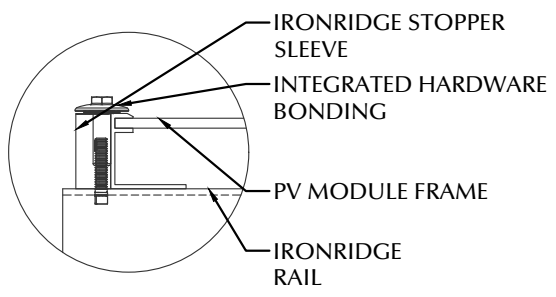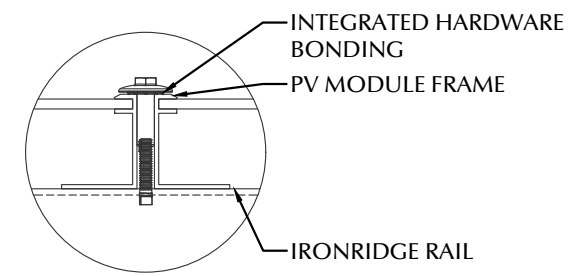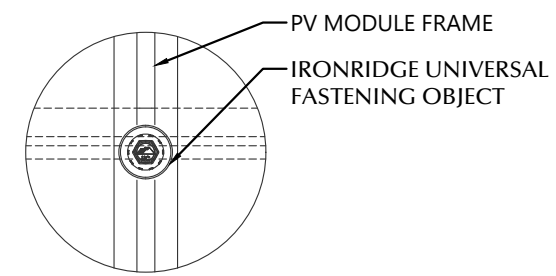


**1 ROOF FASTENER DETAIL**  
 NOT TO SCALE

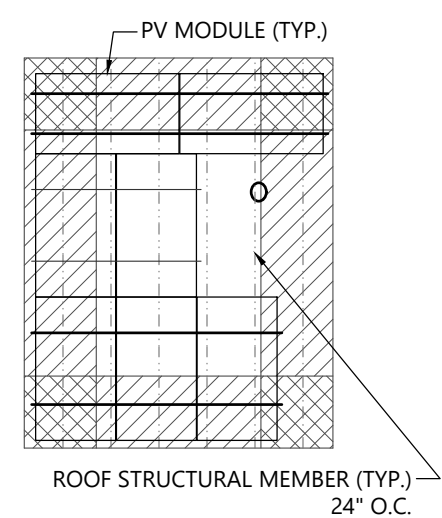

**2 ROOF A ARRAY LAYOUT**  
 1/8" = 1'-0"


© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

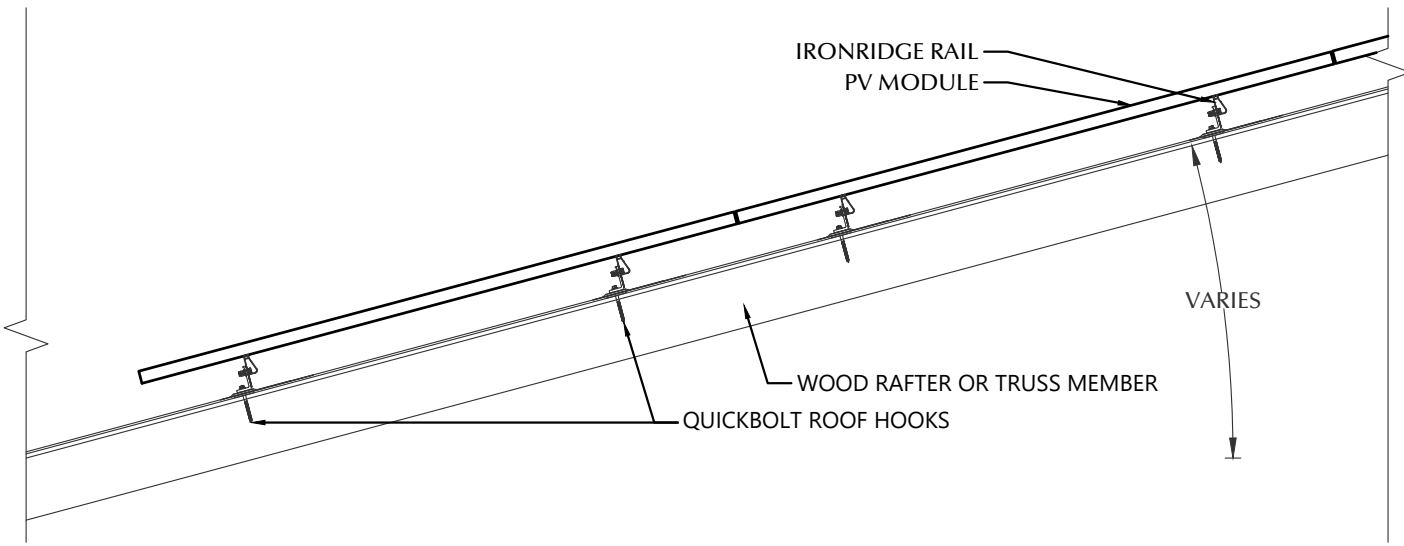

**STATEMENT OF STRUCTURAL COMPLIANCE**

THE EXISTING ROOF STRUCTURE HAS BEEN DESIGNED TO SUPPORT THE ADDITIONAL LOADS OF THE PROPOSED PV SYSTEM. IN ADDITION, THE RACKING AND FASTENING SYSTEM SHALL BE CAPABLE OF SECURING THE SYSTEM TO THE STRUCTURE UNDER DESIGN CONDITIONS WHEN INSTALLED PROPERLY AND IN ACCORDANCE WITH THE RACKING AND FASTENING ARRANGEMENT DETAILED WITHIN THESE DRAWINGS.

NAME: ANDREW W. KING, PE  
 SIGNED: *Andrew W. King*

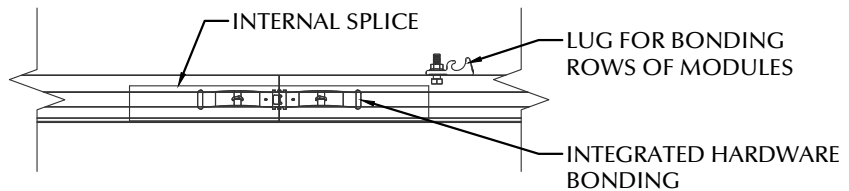

| PV MODULES   |               |
|--------------|---------------|
| MAKE         | REC           |
| MODEL        | REC405AA PURE |
| WIDTH        | 40.00 IN      |
| LENGTH       | 71.70 IN      |
| THICKNESS    | 30 MM         |
| WEIGHT       | 45.00 LBS.    |
| ARRAY AREA   | 279 SQFT.     |
| ARRAY WEIGHT | 697 LBS.      |

| ROOF SUMMARY   |                  |
|----------------|------------------|
| STRUCTURE:     |                  |
| TYPE           | TRUSSES          |
| MATERIAL       | SOUTHERN PINE #2 |
| SIZE           | 2 X 4            |
| SPACING        | 24 IN O.C.       |
| ALLOWABLE SPAN | 88 IN            |
| PITCH          | 8/12             |
| DENSITY        | 30 LBS./CU.FT.   |
| DECKING:       |                  |
| TYPE           | OSB              |
| MATERIAL       | COMPOSITE        |
| THICKNESS      | 7/16 IN          |
| WEIGHT         | 1.60 LBS./SQFT   |
| ROOFING:       |                  |
| TYPE           | ASPHALT SHINGLE  |
| MATERIAL       | ASPHALT          |
| WEIGHT         | 2.30 LBS./SQFT.  |

| ROOF MOUNT SUMMARY |                 |               |
|--------------------|-----------------|---------------|
| MAXIMUM (IN)       | MOUNT SPACING   | RAIL OVERHANG |
| WIND ZONE 1        | PORT 72 LAND 72 | 19 IN         |
| WIND ZONE 2        | PORT 48 LAND 48 | 19 IN         |
| WIND ZONE 3        | PORT 48 LAND 48 | 19 IN         |

| ROOF LOADING      |                  |
|-------------------|------------------|
| GROUND SNOW LOAD: | 15 LBS./SQFT.    |
| LIVE LOAD         | 20 LBS./SQFT.    |
| DEAD LOAD         |                  |
| ROOFING           | 3.9 LBS./SQFT.   |
| PV ARRAY          | 2.5 LBS./SQFT.   |
| TOTAL             | 6.4 LBS./SQFT.   |
| WIND LOAD:        |                  |
| UPLIFT ZONE 1     | -24.6 LBS./SQFT. |
| UPLIFT ZONE 2     | -29.0 LBS./SQFT. |
| UPLIFT ZONE 3     | -29.0 LBS./SQFT. |
| DOWNWARD          | 23.0 LBS./SQFT.  |
| FASTENER LOAD:    |                  |
| UPLIFT ZONE 1     | -291 LBS.        |
| UPLIFT ZONE 2     | -229 LBS.        |
| UPLIFT ZONE 3     | -229 LBS.        |
| DOWNWARD          | 272 LBS.         |

| ROOF MOUNT & FASTENER |                  |
|-----------------------|------------------|
| ROOF MOUNT:           |                  |
| MAKE                  | QUICKBOLT        |
| MODEL                 | 4 IN QB1         |
| MATERIAL              | STAINLESS / EPDM |
| FASTENER:             |                  |
| MAKE                  | QUICK SCREWS     |
| MODEL                 | HANGER BOLT      |
| MATERIAL              | 304 SS           |
| SIZE                  | 5/16-18 X 5-1/4" |
| GENERAL:              |                  |
| WEIGHT                | 0.56 LBS.        |
| FASTENERS PER MOUNT   | 1                |
| MAX. PULL-OUT FORCE   | 960.0 LBS.       |
| SAFETY FACTOR         | 2                |
| DESIGN PULL-OUT FORCE | 480.0 LBS.       |

| MOUNTING RAILS |              |
|----------------|--------------|
| MAKE           | IRONRIDGE    |
| MODEL          | XR10         |
| MATERIAL       | ALUMINUM     |
| WEIGHT         | 0.425 LBS/IN |
| SPACING        | 20 IN        |



**CLIENT INFO**  
 JULIE BARAJAS  
 491 OLD FIELD LOOP  
 SANFORD, NC 27332

**PROJECT INFO**  
 DC INPUT: 13.365 kW  
 AC EXPORT: 11.517 kW  
 DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**  
 NATION ELECTRICAL CODE v. 2017  
 NC FIRE PROTECTION CODE v. 2018  
 NC BUILDING CODE v. 2018  
 NC RESIDENTIAL CODE v. 2018  
 ACSE v. 7-10





**SITE CONDITIONS**  
 WIND SPEED: 116 MPH  
 RISK CATEGORY: II  
 EXPOSURE: B  
 SNOW: 10 PSF

**SHEET INDEX**  
 PV-1: COVER SHEET  
 PV-2: PV STRUCTURAL  
 PV-3: PV ELECTRICAL  
 PV-4: PV EQUIPMENT LABELS  
 PV-5: PV INSTALL GUIDE


**DESIGNER INFO**  
 DESIGNER: MCP  
 ENGINEER: AWK  
 DATE: 10/4/2022  
 VERSION: P1

**PV SYSTEM STRUCTURAL**

**PV-2.2**

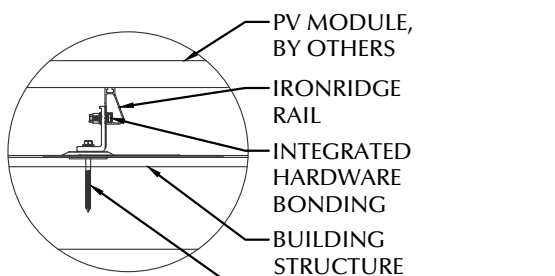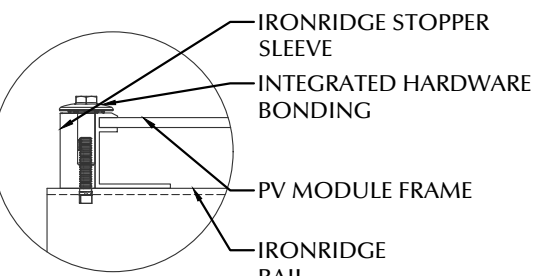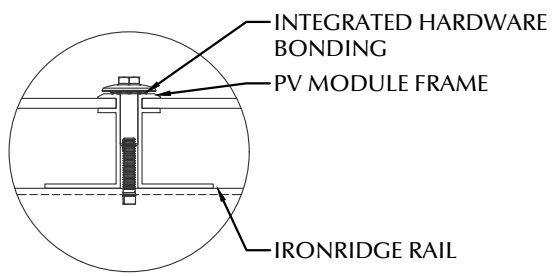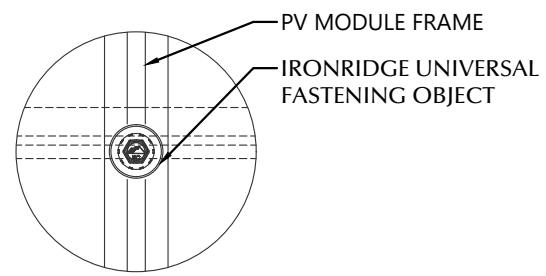


**1 ROOF FASTENER DETAIL**  
 NOT TO SCALE

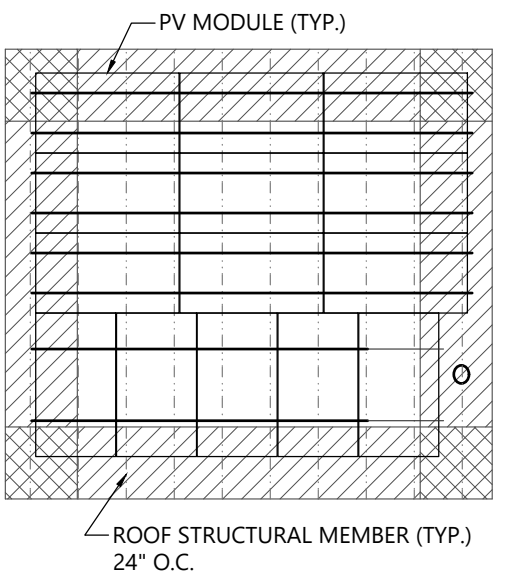

**2 ROOF B ARRAY LAYOUT**  
 1/8" = 1'-0"


© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

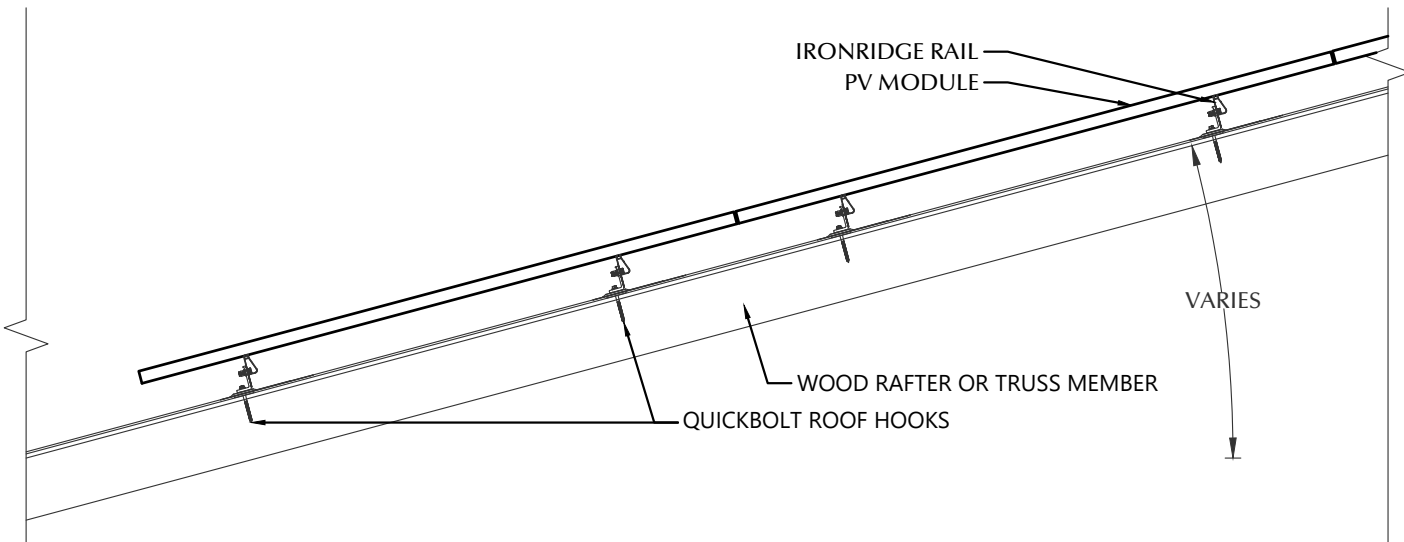

**STATEMENT OF STRUCTURAL COMPLIANCE**

THE EXISTING ROOF STRUCTURE HAS BEEN DESIGNED TO SUPPORT THE ADDITIONAL LOADS OF THE PROPOSED PV SYSTEM. IN ADDITION, THE RACKING AND FASTENING SYSTEM SHALL BE CAPABLE OF SECURING THE SYSTEM TO THE STRUCTURE UNDER DESIGN CONDITIONS WHEN INSTALLED PROPERLY AND IN ACCORDANCE WITH THE RACKING AND FASTENING ARRANGEMENT DETAILED WITHIN THESE DRAWINGS.

NAME: ANDREW W. KING, PE  
 SIGNED: *Andrew W. King*

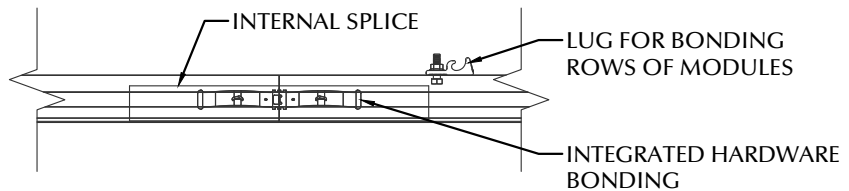

| PV MODULES   |               |
|--------------|---------------|
| MAKE         | REC           |
| MODEL        | REC405AA PURE |
| WIDTH        | 40.00 IN      |
| LENGTH       | 71.70 IN      |
| THICKNESS    | 30 MM         |
| WEIGHT       | 45.00 LBS.    |
| ARRAY AREA   | 179 SQFT.     |
| ARRAY WEIGHT | 448 LBS.      |


| ROOF SUMMARY   |                  |
|----------------|------------------|
| STRUCTURE:     |                  |
| TYPE           | RAFTERS          |
| MATERIAL       | SOUTHERN PINE #2 |
| SIZE           | 2 X 6            |
| SPACING        | 16 IN O.C.       |
| EFFECTIVE SPAN | 80 IN            |
| PITCH          | 8/12             |
| DENSITY        | 30 LBS./CU.FT.   |
| DECKING:       |                  |
| TYPE           | OSB              |
| MATERIAL       | COMPOSITE        |
| THICKNESS      | 7/16 IN          |
| WEIGHT         | 1.60 LBS./SQFT   |
| ROOFING:       |                  |
| TYPE           | ASPHALT SHINGLE  |
| MATERIAL       | ASPHALT          |
| WEIGHT         | 2.30 LBS./SQFT.  |

| ROOF MOUNT SUMMARY |                 |               |
|--------------------|-----------------|---------------|
| MAXIMUM (IN)       | MOUNT SPACING   | RAIL OVERHANG |
| WIND ZONE 1        | PORT 64 LAND 64 | 19 IN         |
| WIND ZONE 2        | PORT 64 LAND 64 | 19 IN         |
| WIND ZONE 3        | PORT 48 LAND 64 | 19 IN         |

| ROOF LOADING      |                  |
|-------------------|------------------|
| GROUND SNOW LOAD: | 15 LBS./SQFT.    |
| LIVE LOAD         | 20 LBS./SQFT.    |
| DEAD LOAD         |                  |
| ROOFING           | 3.9 LBS./SQFT.   |
| PV ARRAY          | 2.5 LBS./SQFT.   |
| TOTAL             | 6.4 LBS./SQFT.   |
| WIND LOAD:        |                  |
| UPLIFT ZONE 1     | -24.6 LBS./SQFT. |
| UPLIFT ZONE 2     | -29.0 LBS./SQFT. |
| UPLIFT ZONE 3     | -29.0 LBS./SQFT. |
| DOWNWARD          | 23.0 LBS./SQFT.  |
| FASTENER LOAD:    |                  |
| UPLIFT ZONE 1     | -308 LBS.        |
| UPLIFT ZONE 2     | -363 LBS.        |
| UPLIFT ZONE 3     | -273 LBS.        |
| DOWNWARD          | 288 LBS.         |

| ROOF MOUNT & FASTENER |                  |
|-----------------------|------------------|
| ROOF MOUNT:           |                  |
| MAKE                  | QUICKBOLT        |
| MODEL                 | 4 IN QB1         |
| MATERIAL              | STAINLESS / EPDM |
| FASTENER:             |                  |
| MAKE                  | QUICK SCREWS     |
| MODEL                 | HANGER BOLT      |
| MATERIAL              | 304 SS           |
| SIZE                  | 5/16-18 X 5-1/4" |
| GENERAL:              |                  |
| WEIGHT                | 0.56 LBS.        |
| FASTENERS PER MOUNT   | 1                |
| MAX. PULL-OUT FORCE   | 960.0 LBS.       |
| SAFETY FACTOR         | 2                |
| DESIGN PULL-OUT FORCE | 480.0 LBS.       |

| MOUNTING RAILS |              |
|----------------|--------------|
| MAKE           | IRONRIDGE    |
| MODEL          | XR10         |
| MATERIAL       | ALUMINUM     |
| WEIGHT         | 0.425 LBS/IN |
| SPACING        | 36 IN        |

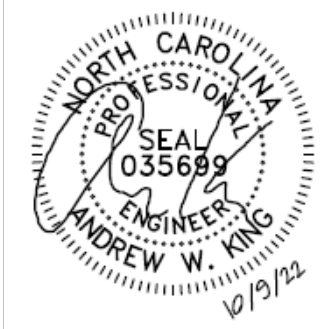

**CLIENT INFO**  
 JULIE BARAJAS  
 491 OLD FIELD LOOP  
 SANFORD, NC 27332

**PROJECT INFO**  
 DC INPUT: 13.365 kW  
 AC EXPORT: 11.517 kW  
 DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**  
 NATION ELECTRICAL CODE v. 2017  
 NC FIRE PROTECTION CODE v. 2018  
 NC BUILDING CODE v. 2018  
 NC RESIDENTIAL CODE v. 2018  
 ACSE v. 7-10





**SITE CONDITIONS**  
 WIND SPEED: 116 MPH  
 RISK CATEGORY: II  
 EXPOSURE: B  
 SNOW: 10 PSF

**SHEET INDEX**  
 PV-1: COVER SHEET  
 PV-2: PV STRUCTURAL  
 PV-3: PV ELECTRICAL  
 PV-4: PV EQUIPMENT LABELS  
 PV-5: PV INSTALL GUIDE


**DESIGNER INFO**  
 DESIGNER: MCP  
 ENGINEER: AWK  
 DATE: 10/4/2022  
 VERSION: P1

**PV SYSTEM STRUCTURAL**

**PV-2.3**

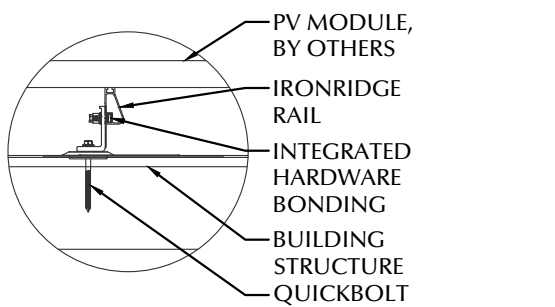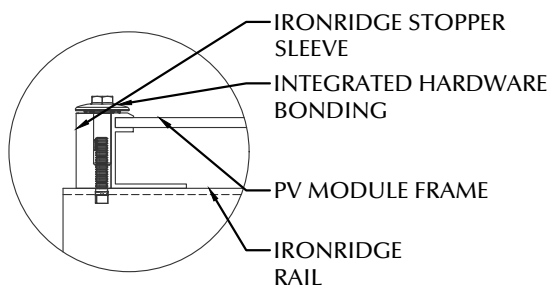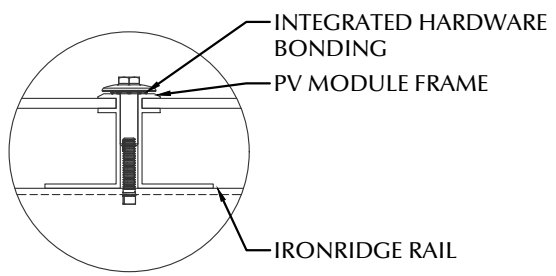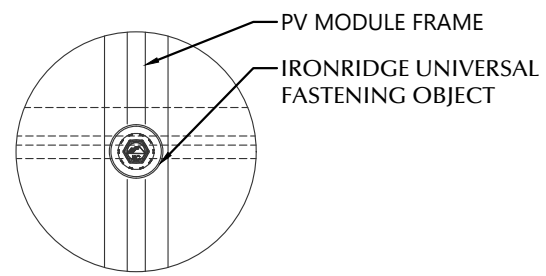


**1 ROOF FASTENER DETAIL**  
 NOT TO SCALE

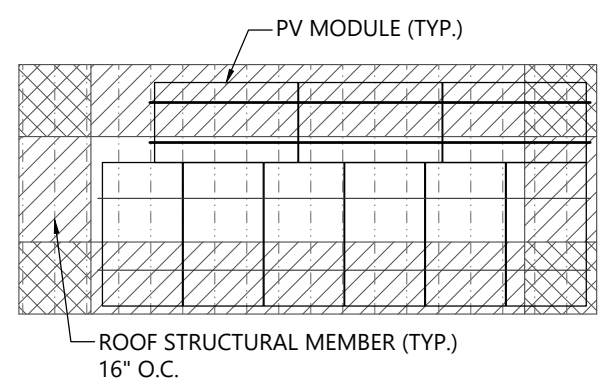

**2 ROOF C ARRAY LAYOUT**  
 1/8" = 1'-0"

© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

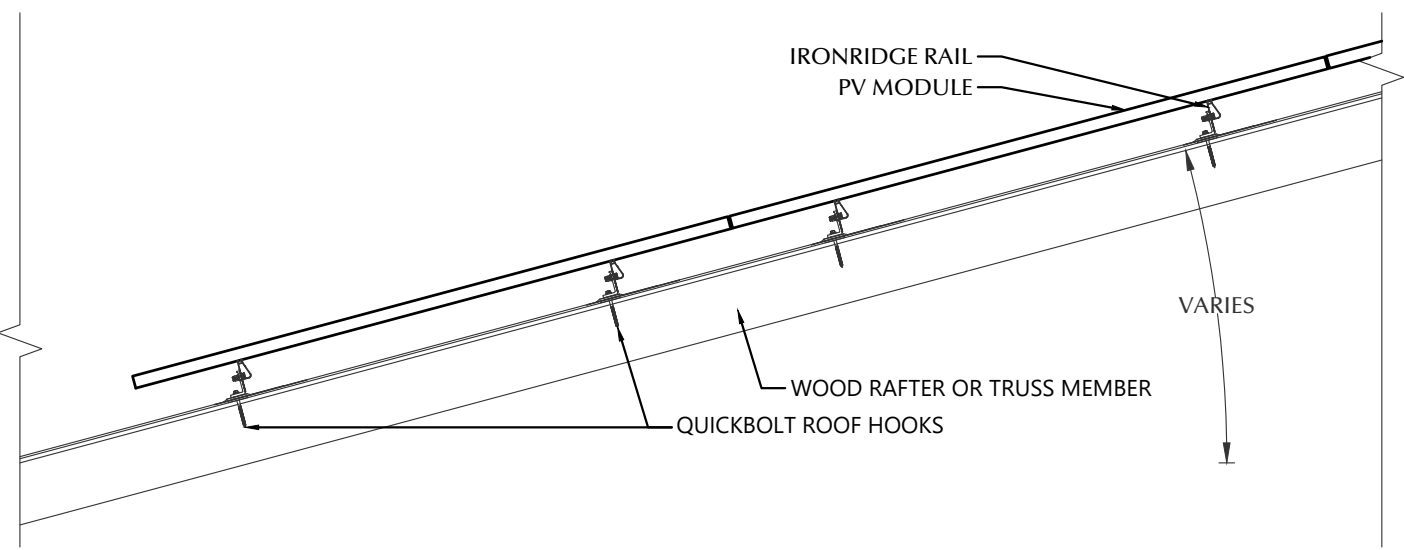

**STATEMENT OF STRUCTURAL COMPLIANCE**






THE EXISTING ROOF STRUCTURE HAS BEEN DESIGNED TO SUPPORT THE ADDITIONAL LOADS OF THE PROPOSED PV SYSTEM. IN ADDITION, THE RACKING AND FASTENING SYSTEM SHALL BE CAPABLE OF SECURING THE SYSTEM TO THE STRUCTURE UNDER DESIGN CONDITIONS WHEN INSTALLED PROPERLY AND IN ACCORDANCE WITH THE RACKING AND FASTENING ARRANGEMENT DETAILED WITHIN THESE DRAWINGS.

NAME: ANDREW W. KING, PE

SIGNED: *Andrew W. King*

| PV MODULES   |               |
|--------------|---------------|
| MAKE         | REC           |
| MODEL        | REC405AA PURE |
| WIDTH        | 40.00 IN      |
| LENGTH       | 71.70 IN      |
| THICKNESS    | 30 MM         |
| WEIGHT       | 45.00 LBS.    |
| ARRAY AREA   | 60 SQFT.      |
| ARRAY WEIGHT | 149 LBS.      |


| ROOF SUMMARY   |                  |
|----------------|------------------|
| STRUCTURE:     |                  |
| TYPE           | TRUSSES          |
| MATERIAL       | SOUTHERN PINE #2 |
| SIZE           | 2 X 4            |
| SPACING        | 24 IN O.C.       |
| ALLOWABLE SPAN | 88 IN            |
| PITCH          | 8/12             |
| DENSITY        | 30 LBS./CU.FT.   |
| DECKING:       |                  |
| TYPE           | OSB              |
| MATERIAL       | COMPOSITE        |
| THICKNESS      | 7/16 IN          |
| WEIGHT         | 1.60 LBS./SQFT   |
| ROOFING:       |                  |
| TYPE           | ASPHALT SHINGLE  |
| MATERIAL       | ASPHALT          |
| WEIGHT         | 2.30 LBS./SQFT.  |

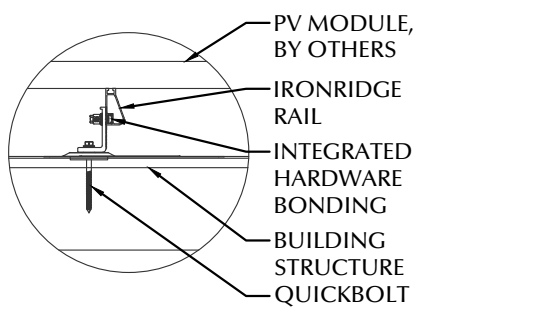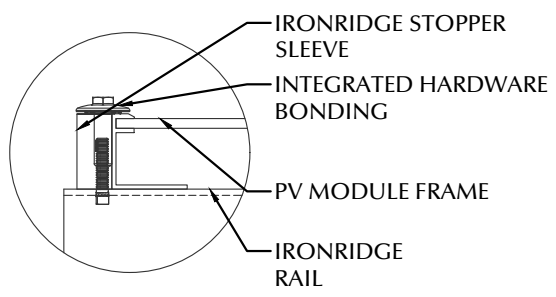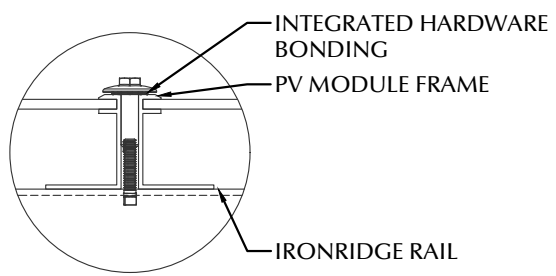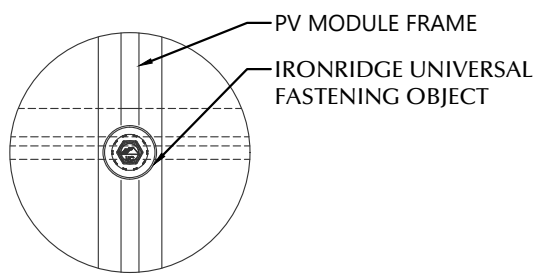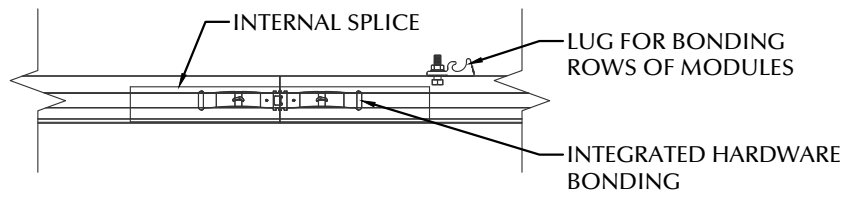

| ROOF MOUNT SUMMARY |               |               |
|--------------------|---------------|---------------|
| MAXIMUM (IN)       | MOUNT SPACING | RAIL OVERHANG |
| WIND ZONE 1        | 72 IN         | 19 IN         |
| WIND ZONE 2        | 48 IN         | 19 IN         |
| WIND ZONE 3        | 48 IN         | 19 IN         |

| ROOF LOADING      |                  |
|-------------------|------------------|
| GROUND SNOW LOAD: | 15 LBS./SQFT.    |
| LIVE LOAD         | 20 LBS./SQFT.    |
| DEAD LOAD         |                  |
| ROOFING           | 3.9 LBS./SQFT.   |
| PV ARRAY          | 2.5 LBS./SQFT.   |
| TOTAL             | 6.4 LBS./SQFT.   |
| WIND LOAD:        |                  |
| UPLIFT ZONE 1     | -24.6 LBS./SQFT. |
| UPLIFT ZONE 2     | -29.0 LBS./SQFT. |
| UPLIFT ZONE 3     | -29.0 LBS./SQFT. |
| DOWNWARD          | 23.0 LBS./SQFT.  |
| FASTENER LOAD:    |                  |
| UPLIFT ZONE 1     | -245 LBS.        |
| UPLIFT ZONE 2     | -193 LBS.        |
| UPLIFT ZONE 3     | -193 LBS.        |
| DOWNWARD          | 229 LBS.         |

**1 ROOF FASTENER DETAIL**  
NOT TO SCALE

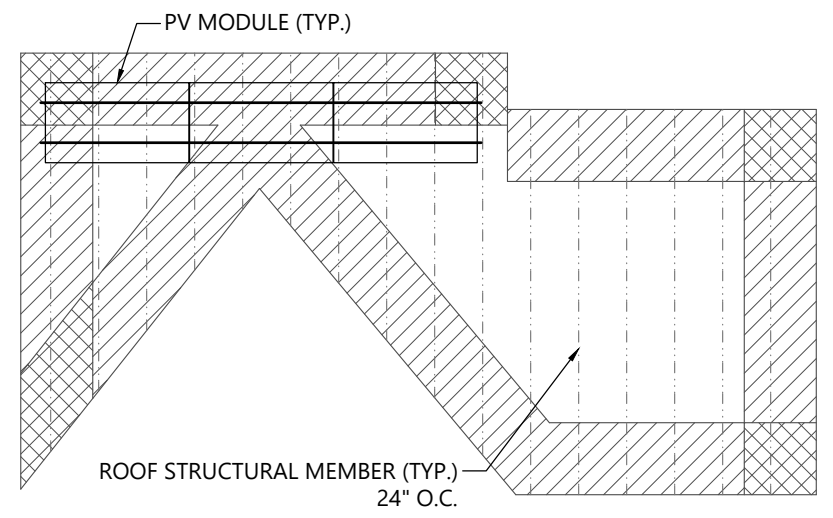

**2 ROOF D ARRAY LAYOUT**  
1/8" = 1'-0"

| ROOF MOUNT & FASTENER |                  |
|-----------------------|------------------|
| ROOF MOUNT:           |                  |
| MAKE                  | QUICKBOLT        |
| MODEL                 | 4 IN QB1         |
| MATERIAL              | STAINLESS / EPDM |
| FASTENER:             |                  |
| MAKE                  | QUICK SCREWS     |
| MODEL                 | HANGER BOLT      |
| MATERIAL              | 304 SS           |
| SIZE                  | 5/16-18 X 5-1/4" |
| GENERAL:              |                  |
| WEIGHT                | 0.56 LBS.        |
| FASTENERS PER MOUNT   | 1                |
| MAX. PULL-OUT FORCE   | 960.0 LBS.       |
| SAFETY FACTOR         | 2                |
| DESIGN PULL-OUT FORCE | 480.0 LBS.       |

| MOUNTING RAILS |              |
|----------------|--------------|
| MAKE           | IRONRIDGE    |
| MODEL          | XR10         |
| MATERIAL       | ALUMINUM     |
| WEIGHT         | 0.425 LBS/IN |
| SPACING        | 20 IN        |



**CLIENT INFO**  
JULIE BARAJAS  
491 OLD FIELD LOOP  
SANFORD, NC 27332

**PROJECT INFO**  
DC INPUT: 13.365 kW  
AC EXPORT: 11.517 kW  
DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**  
NATION ELECTRICAL CODE v. 2017  
NC FIRE PROTECTION CODE v. 2018  
NC BUILDING CODE v. 2018  
NC RESIDENTIAL CODE v. 2018  
ACSE v. 7-10

**SITE CONDITIONS**  
WIND SPEED: 116 MPH  
RISK CATEGORY: II  
EXPOSURE: B  
SNOW: 10 PSF

**SHEET INDEX**  
PV-1: COVER SHEET  
PV-2: PV STRUCTURAL  
PV-3: PV ELECTRICAL  
PV-4: PV EQUIPMENT LABELS  
PV-5: PV INSTALL GUIDE

**DESIGNER INFO**  
DESIGNER: MCP  
ENGINEER: AWK  
DATE: 10/4/2022  
VERSION: P1

**PV SYSTEM STRUCTURAL**

**PV-2.4**

© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

### CONDUCTOR SCHEDULE

| TAG | CURRENT CARRYING CONDUCTORS |        |            | GROUNDING CONDUCTORS |        |            | CONDUIT/RACEWAY |      |          | NOTES |
|-----|-----------------------------|--------|------------|----------------------|--------|------------|-----------------|------|----------|-------|
|     | QTY.                        | SIZE   | INSULATION | QTY.                 | SIZE   | INSULATION | QTY.            | SIZE | LOCATION |       |
| C1  | 8                           | 12 AWG | DG CABLE   | 1                    | 6 AWG  | BARE       | -               | -    | FREE AIR | 1     |
| C2  | 8                           | 10 AWG | THWN-2     | 1                    | 10 AWG | THWN-2     | 2               | 3/4" | EXT/INT  | 2,4   |
| C3  | 3                           | 6 AWG  | THWN       | 1                    | 10 AWG | THWN       | 1               | 3/4" | EXTERIOR | 2,4   |
| C4  | 3                           | 6 AWG  | THWN       | -                    | -      | -          | 1               | 3/4" | EXTERIOR | 2,4   |
| XC  | -                           | -      | -          | -                    | -      | -          | -               | -    | -        | 3     |

**NOTES:**

1. MANUFACTURER PROVIDED, UL LISTED WIRING HARNESS FOR USE ON EXPOSED ROOFS
2. CONDUIT SIZE SHOWN IS CODE MINIMUM. LARGER SIZES ARE ALLOWED.
3. EXISTING CONDUCTORS, FIELD VERIFY
4. EQUIPMENT TERMINAL RATING SHALL BE A MINIMUM OF 75°C AT BOTH END OF CONDUCTOR

### PV MODULE

| MAKE               | REC           |
|--------------------|---------------|
| MODEL              | REC405AA PURE |
| NOM. POWER (PNOM)  | 405 WATTS     |
| NOM. VOLT. (VMPP)  | 42.4 VOLTS    |
| O.C. VOLT (VOC)    | 48.9 VOLTS    |
| MAX. SYS. VOLT.    | 1000 VOLTS    |
| NOM. CURR. (IMPP)  | 9.6 AMPS      |
| S.C. CURR. (ISC)   | 10.3 AMPS     |
| TEMP. COEF. (PMPP) | -0.26 %/C     |
| TEMP. COEF. (Voc)  | -0.24 %/C     |
| MAX SERIES FUSE    | 25 AMPS       |
| UL COMPLIANT (Y/N) | YES           |

### PV COMBINER PANEL

| MAKE                | ENPHASE           |
|---------------------|-------------------|
| MODEL               | X-IQ-AM1-240-3-ES |
| INPUT:              |                   |
| MAX BRANCH CIRCUITS | 4 TOTAL           |
| BRANCH CIRCUIT OCPD | 50 AMPS           |
| OUTPUT:             |                   |
| MAX POWER           | 15600 WATTS       |
| NOM. VOLTAGE        | 240 VOLTS         |
| BUS RATING          | 125 AMPS          |
| MAIN BREAKER Y/N    | NO                |
| ENCL. RATING        | NEMA TYPE 3R      |
| UL LIST. (Y/N)      | YES               |

### DC / AC INVERTER

| MAKE                  | ENPHASE           |
|-----------------------|-------------------|
| MODEL                 | IQ7A-72-2-US      |
| DC INPUT:             |                   |
| POWER RANGE (WATTS)   | 295-460           |
| MIN/MAX START VOLT.   | 33 / 58           |
| OPERATING VOLT. RANGE | 18-58             |
| MAX. CURRENT          | 15 AMPS           |
| MODULE COMPATIBILITY  | 60, 66, & 72 CELL |
| AC OUTPUT:            |                   |
| MAX. POWER            | 366 WATTS         |
| NOM. POWER            | 349 WATTS         |
| NOM. VOLT.            | 211-240-264       |
| MAX. CURR.            | 1.45 AMPS         |
| DC DISC. (Y/N)        | NO                |
| RAPID SHUTDOWN (Y/N)  | YES               |
| PROTECT. RATING       | NEMA TYPE 6       |
| UL LIST. (Y/N)        | YES               |
| MAX BRANCH CIRCUIT    | 11                |

### JUNCTION BOX

| MAKE            | SOLADECK     |
|-----------------|--------------|
| PROTECT. RATING | NEMA TYPE 3R |
| UL LIST. (Y/N)  | YES          |

### MD PANEL (EXISTING)


| MAKE                | SIEMENS     |
|---------------------|-------------|
| MODEL               | N/A         |
| ENCL. RATING        | NEMA TYPE 1 |
| VOLT. RATING        | 240         |
| BUS RATING          | 200 AMPS    |
| UL LIST. (Y/N)      | YES         |
| MAIN BREAKER (Y/N)  | YES         |
| MAIN BREAKER RATING | 200 AMPS    |

### AC DISCONNECT

| MAKE           | GENERIC   |
|----------------|-----------|
| MODEL          | NA        |
| ENCL. RATING   | NEMA 3R   |
| VOLT. RATING   | 240 VOLTS |
| AMP RATING     | 60 AMPS   |
| UL LIST. (Y/N) | YES       |
| FUSED (Y/N)    | YES       |
| FUSE RATING    | 60 A      |

- BACK-FEED SOLAR OUTPUT VIA SUPPLY SIDE TAP INSIDE OF MD PANEL

- LOAD-BREAK RATED
- VISIBLE OPEN
- LOCKABLE IN OPEN POSITION
- INSTALL ADJACENT TO METER
- DISCONNECT TO BE READILY ACCESSIBLE TO UTILITY COMPANY PERSONNEL AT ALL TIMES
- SERVICE RATED
- PROVIDE NEUTRAL/GROUND BONDING JUMPER

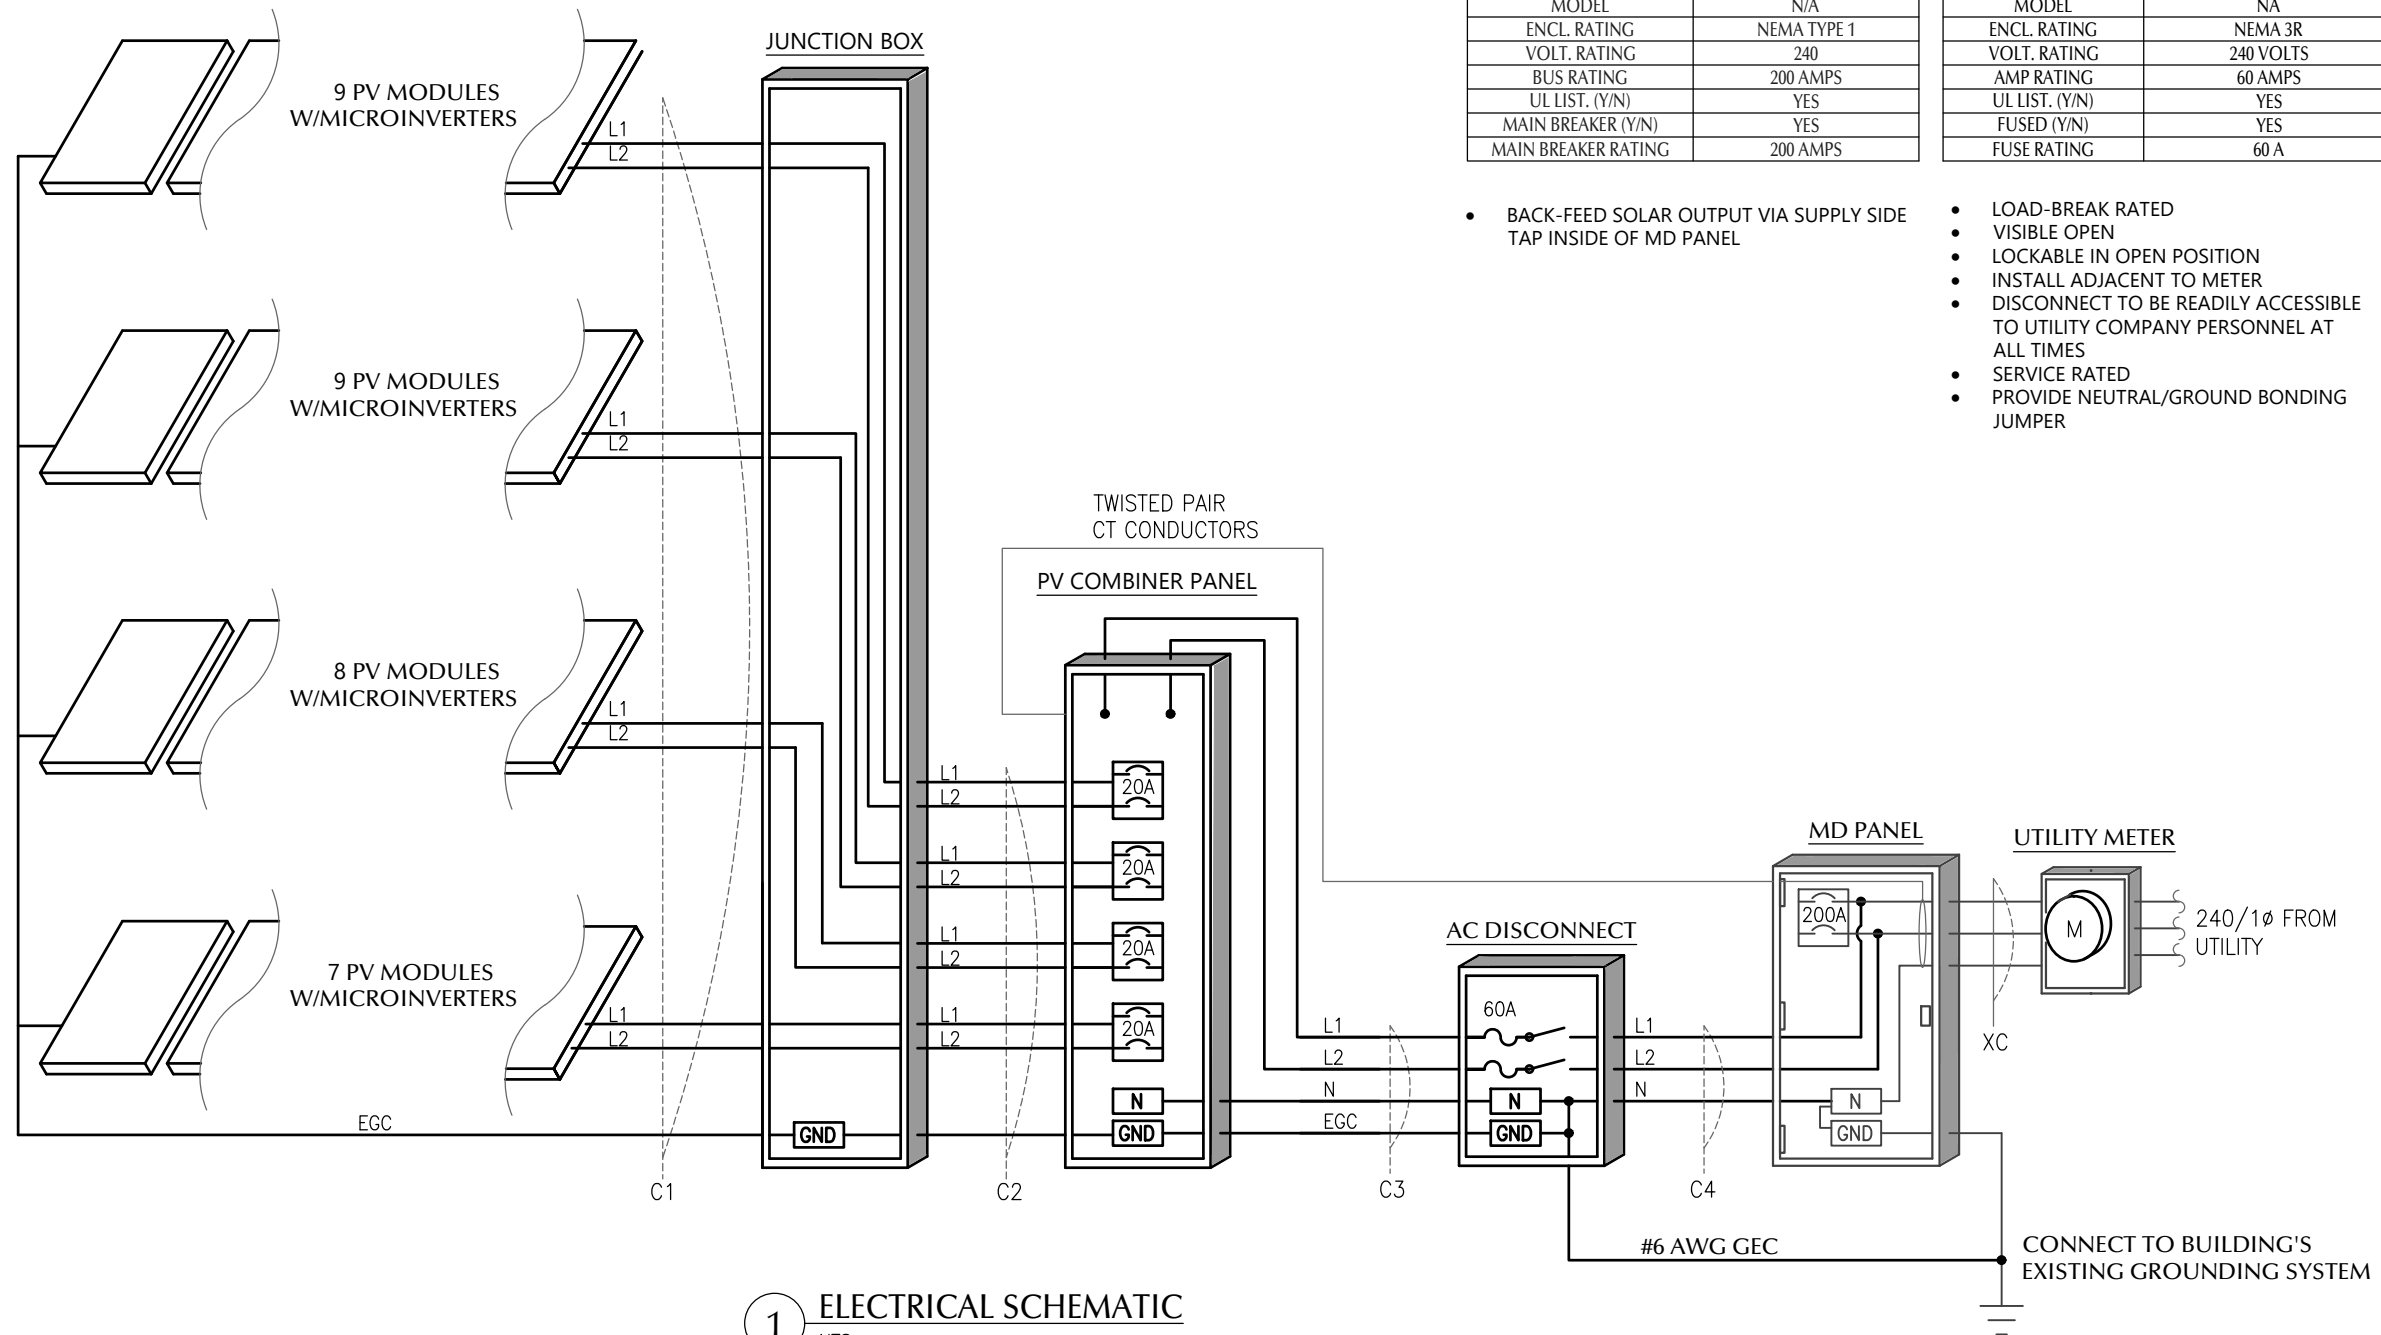

1 ELECTRICAL SCHEMATIC  
NTS



### CLIENT INFO

JULIE BARAJAS  
491 OLD FIELD LOOP  
SANFORD, NC 27332

### PROJECT INFO

DC INPUT: 13.365 kW  
AC EXPORT: 11.517 kW  
DOI INSPT. METHOD: OPTION 2

### CODE REFERENCES

NATION ELECTRICAL CODE v. 2017  
NC FIRE PROTECTION CODE v. 2018  
NC BUILDING CODE v. 2018  
NC RESIDENTIAL CODE v. 2018  
ACSE v. 7-10

### SITE CONDITIONS

WIND SPEED: 116 MPH  
RISK CATEGORY: II  
EXPOSURE: B  
SNOW: 10 PSF

### SHEET INDEX

PV-1: COVER SHEET  
PV-2: PV STRUCTURAL  
PV-3: PV ELECTRICAL  
PV-4: PV EQUIPMENT LABELS  
PV-5: PV INSTALL GUIDE

### DESIGNER INFO

DESIGNER: MCP  
ENGINEER: AWK  
DATE: 10/4/2022  
VERSION: P1

### PV SYSTEM ELECTRICAL

# PV-3.1

© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

**⚠ WARNING**  
**ELECTRIC SHOCK HAZARD**  
 TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

NEC 690.13 (B)  
 PLACE ON PV SYSTEM DISCONNECTING MEANS.

**⚠ WARNING**  
**POWER SOURCE OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE**

NEC 705.12 (B)(2)(3)(b)  
 PLACE ADJACENT TO BACK-FED BREAKER

**⚠ WARNING**  
**DUAL POWER SUPPLY**  
 SOURCES: UTILITY GRID AND PV SOLAR ELECTRIC SYSTEM

NEC 705.12 (B)(3)  
 PLACE ON ALL EQUIPMENT THAT IS SUPPLIED BY BOTH POWER SOURCES


**WARNING: PHOTOVOLTAIC POWER SOURCE**

NEC 690.31 (G)(3)&(4)  
 PLACE ON ALL JUNCTION BOXES, EXPOSED RACEWAYS, AND OTHER WIRING METHODS EVERY 10' AND ON EVERY SECTION SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS.

**RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM**

NEC 690.56 (C)(3)  
 PLACE ON RAPID SHUTDOWN SWITCH OR EQUIPMENT WITH INTEGRATED RAPID SHUTDOWN \*REFLECTIVE\*

**SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN**

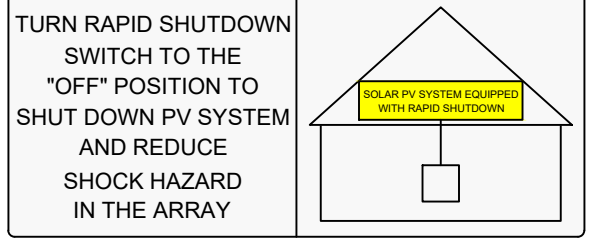

NEC 690.56 (C)(1)(a)  
 PLACE WITHIN 3FT OF SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATIONS OF RAPID SHUTDOWN SWITCHES

**PV SYSTEM DISCONNECT**

NEC 690.13 (B)  
 PLACE ON PV SYSTEM DISCONNECTING MEANS.

**PHOTOVOLTAIC POWER SOURCE**  
 OPERATING AC VOLTAGE 240 V  
 MAXIMUM OPERATING AC OUTPUT CURRENT 47.85 A

NEC 690.54  
 PLACE ON INTERCONNECTION DISCONNECTING MEANS

**⚠ WARNING**  
 THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE SHALL NOT EXCEED AMPACITY OF BUSBAR.

NEC 705.12 (B)(2)(3)(c)  
 PLACE ON PV COMBINER PANEL.

SERVICE DISCONNECT LOCATED:  
 EAST SIDE OF HOUSE

---

PV DISCONNECT LOCATED:  
 EAST SIDE OF HOUSE

NEC 705.10  
 PLACE AT SERVICE EQUIPMENT AND PV SYSTEM DISCONNECTING MEANS. FIELD VERIFY EQUIPMENT LOCATIONS AND LABEL ACCORDINGLY.

**LABEL NOTES**

1. LABELS SHOWN ARE HALF THEIR ACTUAL REQUIRED SIZE.
2. LABEL MATERIAL SHALL BE SUITABLE FOR THE EQUIPMENT ENVIRONMENT.
3. DC CONDUIT SHALL BE MARKED WITH REQUIRED LABEL EVERY 10 FEET.
4. LABELS WILL BE APPLIED IN ACCORDANCE WITH THE NEC. SOME LABELS MAY NOT BE NECESSARY.

**DC WIRING NOTES**

1. CONDUCTORS SHALL BE COPPER, RATED AT NOT LESS THAN 600 VOLTS FOR RESIDENTIAL CONSTRUCTION AND NOT LESS THAN 1000 VOLTS FOR COMMERCIAL CONSTRUCTION.
2. MINIMUM SIZE SHALL BE #10 AWG UNLESS OTHERWISE NOTED ON THE DRAWINGS.
3. EXPOSED WIRING CONDUCTOR INSULATION SHALL BE TYPE PV WIRE, USE-2, OR RHW-2 WHERE THE OUTER LAYER OF THE INSULATION IS UV, SUNLIGHT, AND MOISTURE RESISTANT.
6. EXTERIOR WIRING CONDUCTOR INSULATION SHALL BE TYPE THWN-2 AND INSTALLED IN ELECTRICAL METALLIC TUBING(EMT) OR RIGID POLYVINYL CHLORIDE CONDUIT(PVC). ALTERNATIVELY, METAL CLAD CABLE(MC) CAN BE USED AS WELL WHEN RATED FOR USE IN WET LOCATIONS.
7. INTERIOR WIRING CONDUCTOR INSULATION SHALL BE TYPE THHN-2 AND INSTALLED IN ELECTRICAL METALLIC TUBING(EMT), FLEXIBLE METAL CONDUIT(FMC), OR METAL CLAD CABLE(MC).
6. USE SCHEDULE 40 PVC OUTDOORS WHERE NOT SUBJECT TO PHYSICAL DAMAGE OR BELOW FLOOR SLAB. USE SCHEDULE 80 PVC OUTDOORS WHERE SUBJECT TO PHYSICAL DAMMAGE
7. MINIMUM CONDUIT SIZE TO BE 1/2".
8. WIRING METHODS TO CONFORM TO ARTICLES 330, 334, 348, 350, 352, 356, AND 358 OF THE 2017 NEC.

**AC WIRING NOTES**

1. CONDUCTORS SHALL BE COPPER RATED AT NOT LESS THAN 600 VOLTS.
2. MINIMUM SIZE SHALL BE #14 AWG UNLESS OTHERWISE NOTED ON THE DRAWINGS.
3. EXTERIOR WIRING CONDUCTOR INSULATION SHALL BE TYPE THWN AND INSTALLED IN ELECTRICAL METALLIC TUBING(EMT), RIGID POLYVINYL CHLORIDE CONDUIT(PVC), LIQUID-TIGHT FLEXIBLE METAL CONDUIT(LFMC), OR LIQUID-TIGHT FLEXIBLE NON-METALLIC CONDUIT(LFNC) . ALTERNATIVELY, METAL CLAD CABLE(MC) CAN BE USED AS WELL WHEN RATED FOR USE IN WET LOCATIONS.
4. INTERIOR WIRING CONDUCTOR INSULATION SHALL BE TYPE THHN AND INSTALLED IN ELECTRICAL METALLIC TUBING(EMT), FLEXIBLE METAL CONDUIT(FMC), METAL CLAD CABLE(MC), OR ROMEX.
5. USE SCHEDULE 40 PVC OUTDOORS WHERE NOT SUBJECT TO PHYSICAL DAMAGE OR BELOW FLOOR SLAB. USE SCHEDULE 80 PVC OUTDOORS WHERE SUBJECT TO PHYSICAL DAMMAGE
6. MINIMUM CONDUIT SIZE TO BE 1/2".
7. WIRING METHODS TO CONFORM TO ARTICLES 330, 334, 348, 350, 352, 356, AND 358 OF THE 2017 NEC.

**CONSTRUCTION NOTES**

1. ALL WORK IS TO BE PERFORMED IN ACCORDANCE WITH THE NEC, STATE, AND LOCAL APPLICABLE CODES.
2. FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS, BEST PRACTICES, AND SPECIFICATIONS.
3. ENSURE REQUIRED MAINTENANCE ACCESS AND CLEARANCES ARE MAINTAINED.
4. WIRES SHALL BE RATED AND LABELED "SUNLIGHT RESISTANT" WHERE EXPOSED TO AMBIENT CONDITIONS.
5. FUSES 0 - 600 AMPS SHALL BE UL CLASS "RK-1" LOW PEAK DUAL ELEMENT TIME DELAY WITH 200,000 AMPERE INTERRUPTING RATING AS MANUFACTURED BY BUSSMANN, UNLESS NOTED OTHERWISE.
6. ALL TERMINALS/LUGS SHALL BE 75° RATED. ALL TERMINALS, SPlicing CONNECTORS, LUGS, ETC SHALL BE IDENTIFIED FOR USE WITH THE MATERIAL (CU/AL) OF THE CONDUCTOR AND SHALL BE PROPERLY INSTALLED.
7. PROVIDE A PULLWIRE IN ALL EMPTY CONDUITS.
8. ALL PENETRATIONS THROUGH EXTERIOR ROOFS SHALL BE FLASHED IN A WATERPROOF MANNER.
9. ALL PENETRATIONS THROUGH ATTIC FIRE BARRIERS SHALL BE SEALED WITH FIRE-BARRIER SEALANT CAULK.
10. SUPPORT ALL CONDUIT AND EQUIPMENT IN ACCORDANCE W/ NEC. ANY SUSPENDED MATERIALS SHALL BE DIRECTLY SUPPORTED BY THE BUILDING STRUCTURE.
11. METAL CONDUIT COUPLINGS CAN BE COMPRESSION TYPE, THREADED, OR BE SET-SCREW TYPE. PLASTIC CONDUIT COUPLINGS TO BE SOCKET GLUED TYPE.
12. A COMPLETE GROUNDING SYSTEM SHALL BE PRESENT OR PROVIDED AND INSTALLED IN ACCORDANCE WITH ARTICLE 250 OF THE NEC, AND AS SHOWN ON THE DRAWINGS.
13. EACH ELECTRICAL APPLIANCE SHALL BE PROVIDED WITH A NAMEPLATE GIVING THE IDENTIFYING NAME AND THE RATING IN VOLTS AND AMPERES, OR VOLTS AND WATTS. IF THE APPLIANCE IS TO BE USED ON A SPECIFIC FREQUENCY OR FREQUENCIES, IT SHALL BE SO MARKED. WHERE MOTOR OVERLOAD PROTECTION EXTERNAL TO THE APPLIANCES IS REQUIRED, THE APPLIANCE SHALL BE SO MARKED.
14. WHERE APPLICABLE, GROUNDING ELECTRODE CONDUCTOR TO BE CONTINUOUS. GROUNDING CRIMPS TO BE IRREVERSIBLE.
15. PHOTOVOLTAIC SYSTEMS SHALL BE PERMANENTLY MARKED AT VARIOUS EQUIPMENT LOCATIONS TO IDENTIFY THAT A PHOTOVOLTAIC SYSTEM IS INSTALLED AND THAT VARIOUS DANGERS ARE PRESENT.
16. EACH PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS SHALL BE PERMANENTLY MARKED TO IDENTIFY IT AS A PHOTOVOLTAIC SYSTEM DISCONNECT.
17. WHERE ALL TERMINALS OF A DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION, A WARNING SIGN SHALL BE MOUNTED ON OR ADJACENT TO THE DISCONNECT.
18. A PERMANENT LABEL FOR THE DIRECT-CURRENT PHOTOVOLTAIC POWER SOURCE SHALL BE PROVIDED AT THE DC DISCONNECT MEANS.
19. A PERMANENT PLAQUE OR DIRECTORY, DENOTING ALL ELECTRIC POWER SOURCES SERVING THE PREMISES, SHALL BE INSTALLED AT EACH SERVICE EQUIPMENT LOCATION AND AT LOCATIONS OF ALL POWER PRODUCTION SOURCES.
20. ALL MODULE GROUND CONNECTIONS SHALL BE MADE IN ACCORDANCE WITH NEC SECTION 690.4 (C)
21. A NORTH CAROLINA REGISTERED DESIGN PROFESSIONAL WILL BE REQUIRED TO SEAL THE STRUCTURAL DESIGN AT THE TIME OF PERMIT APPLICATION IF ANY OF THE FOLLOWING EXIST AND ARE ATTESTED TO BY THE APPLICANT:
  - I. THE WEIGHT OF THE PV SYSTEM EXCEEDS THREE (3) POUNDS PER SQUARE FOOT(PSF)
  - II. THE ROOF POSSESSES MORE THAN ONE (1) LAYER OF ASPHALT SHINGLES
  - III. THE ROOFING MATERIAL CONSISTS OF A TYPE OTHER THAN ASPHALT SHINGLES OR METAL
  - IV. THE ROOF IS LOCATED IN A 140 MPH OR GREATER WIND ZONE



**CLIENT INFO**

JULIE BARAJAS  
 491 OLD FIELD LOOP  
 SANFORD, NC 27332

**PROJECT INFO**

DC INPUT: 13.365 kW  
 AC EXPORT: 11.517 kW  
 DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**

NATION ELECTRICAL CODE v. 2017  
 NC FIRE PROTECTION CODE v. 2018  
 NC BUILDING CODE v. 2018  
 NC RESIDENTIAL CODE v. 2018  
 ACSE v. 7-10

**SITE CONDITIONS**

WIND SPEED: 116 MPH  
 RISK CATEGORY: II  
 EXPOSURE: B  
 SNOW: 10 PSF

**SHEET INDEX**

PV-1: COVER SHEET  
 PV-2: PV STRUCTURAL  
 PV-3: PV ELECTRICAL  
 PV-4: PV EQUIPMENT LABELS  
 PV-5: PV INSTALL GUIDE


**DESIGNER INFO**

DESIGNER MCP  
 ENGINEER AWK  
 DATE 10/4/2022  
 VERSION P1

**PV SYSTEM EQUIPMENT LABELS**

**PV-4.1**

© 2019 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

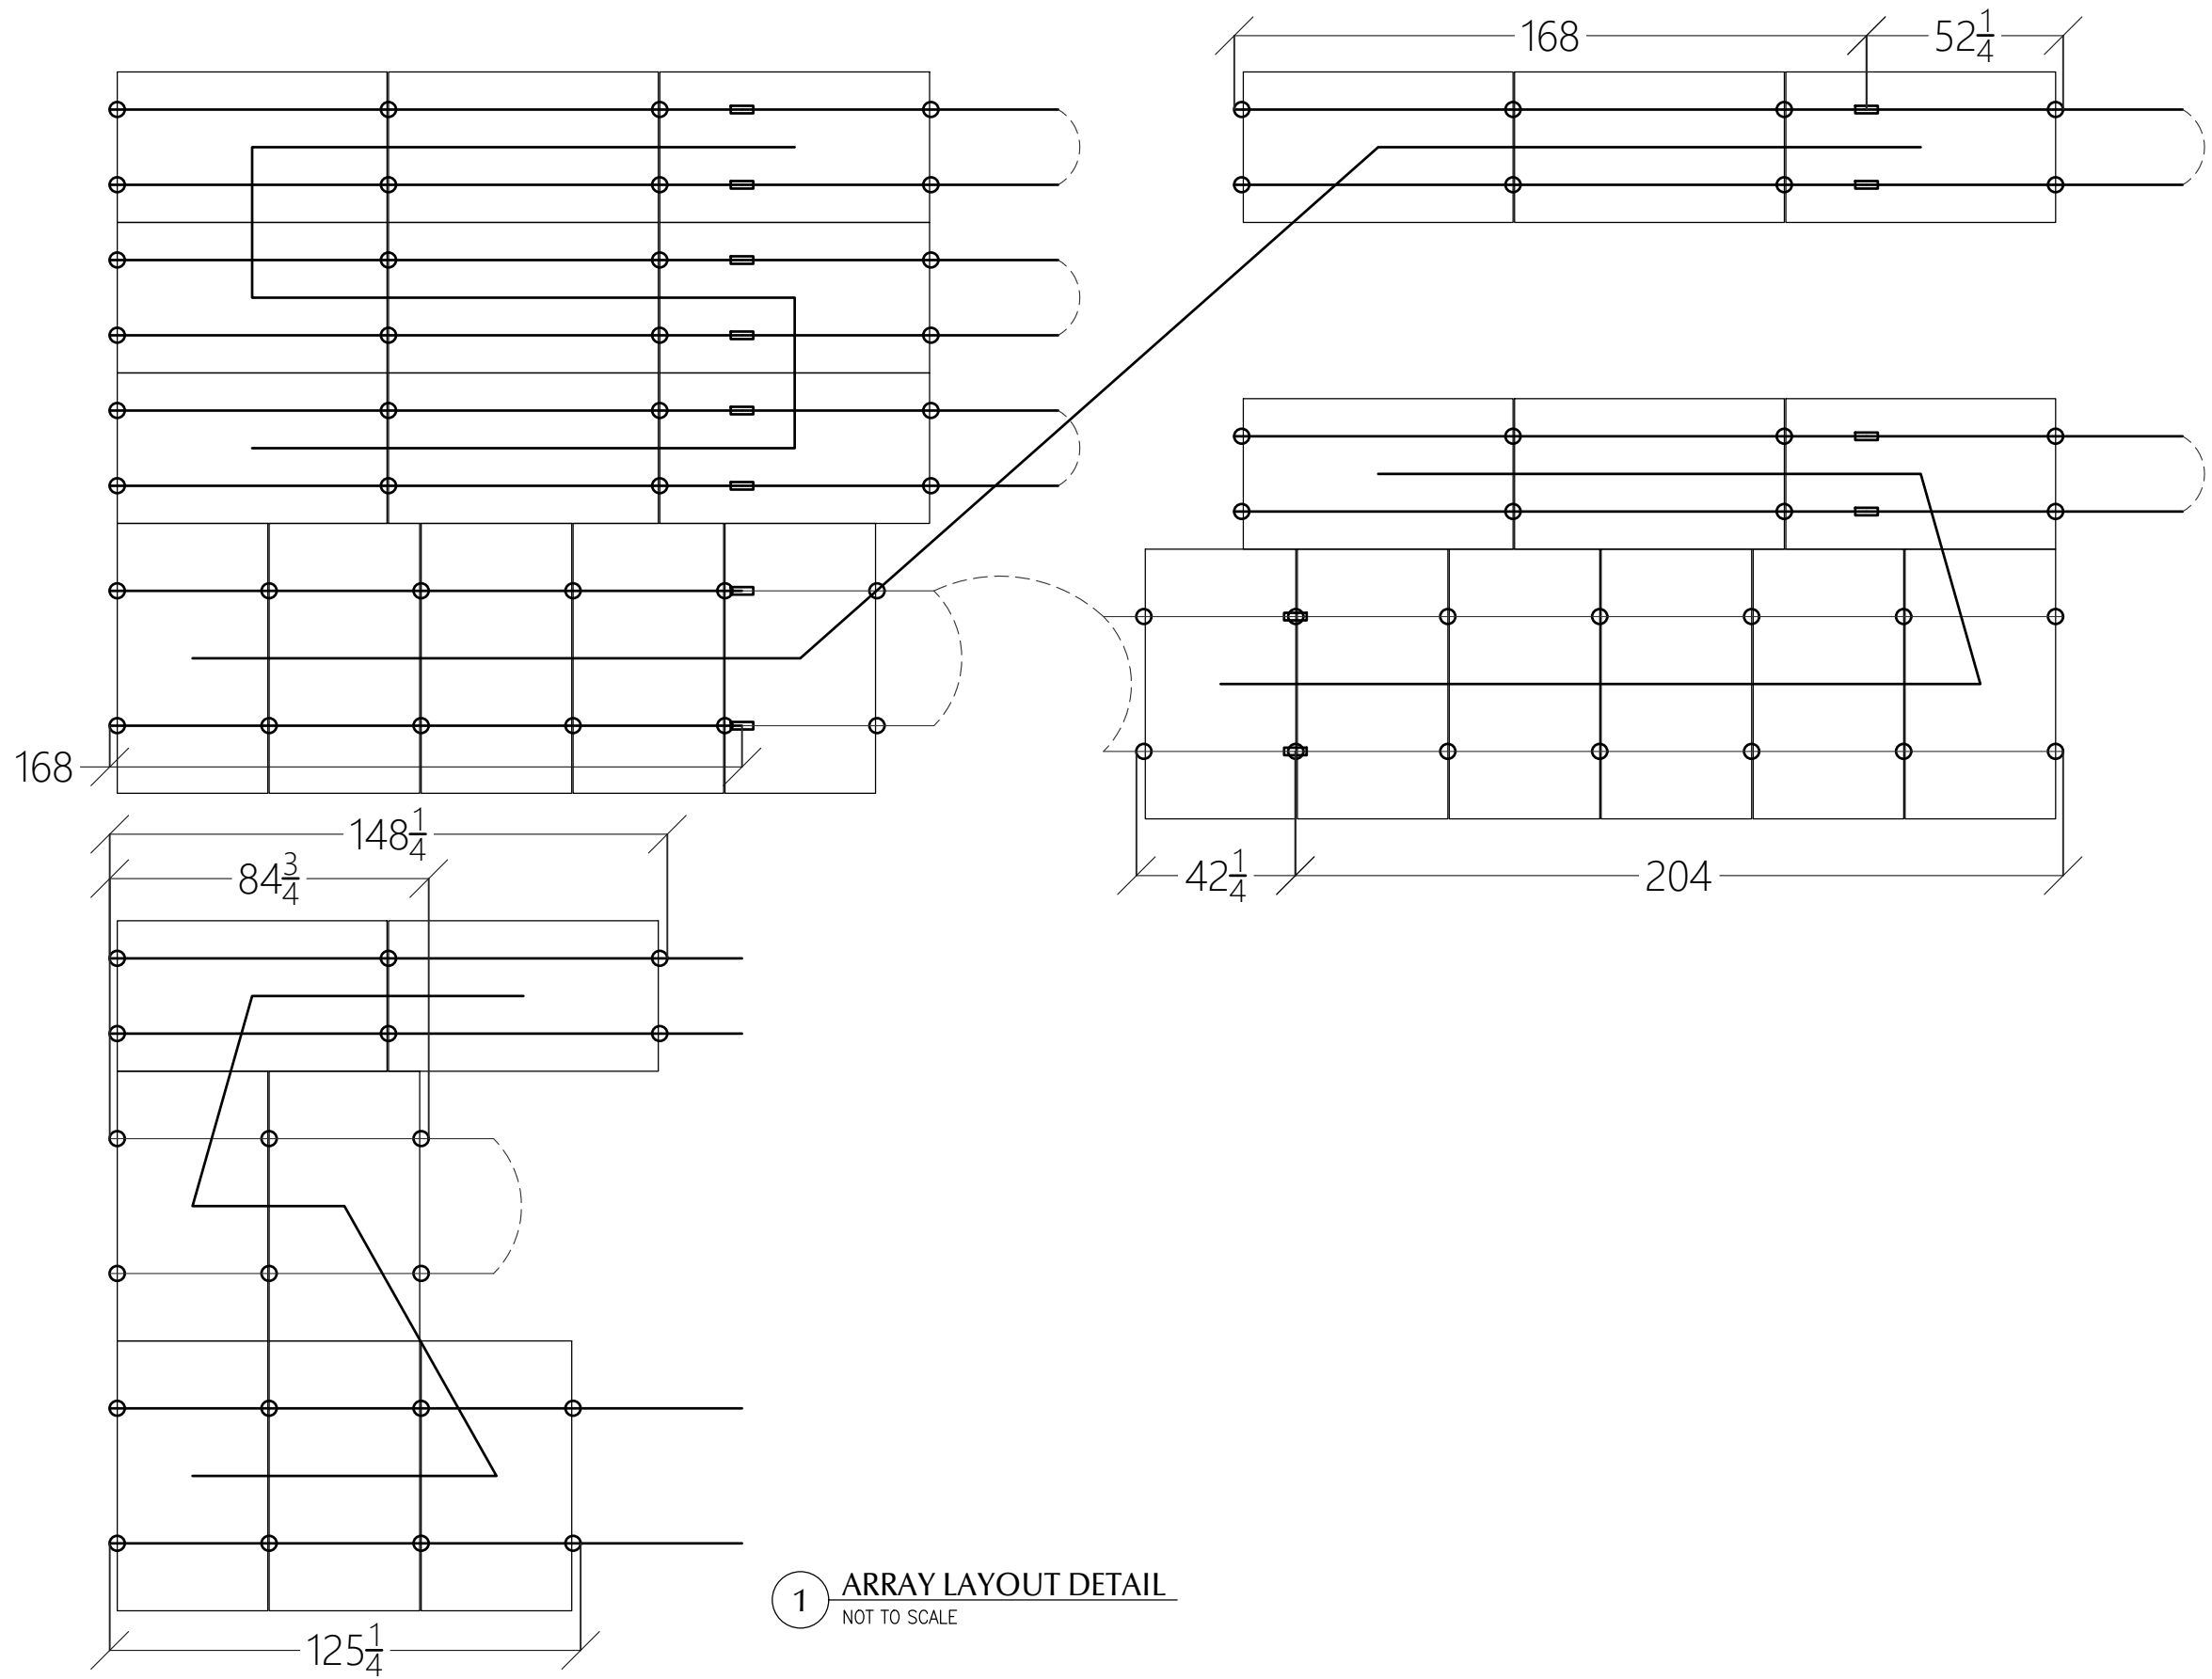

1 ARRAY LAYOUT DETAIL  
NOT TO SCALE



**CLIENT INFO**

JULIE BARAJAS  
491 OLD FIELD LOOP  
SANFORD, NC 27332

**PROJECT INFO**

DC INPUT: 13.365 kW  
AC EXPORT: 11.517 kW  
DOI INSPT. METHOD: OPTION 2

**CODE REFERENCES**

NATION ELECTRICAL CODE v. 2017  
NC FIRE PROTECTION CODE v. 2018  
NC BUILDING CODE v. 2018  
NC RESIDENTIAL CODE v. 2018  
ACSE v. 7-10

**SITE CONDITIONS**

WIND SPEED: 116 MPH  
RISK CATEGORY: II  
EXPOSURE: B  
SNOW: 10 PSF

**SHEET INDEX**

PV-1: COVER SHEET  
PV-2: PV STRUCTURAL  
PV-3: PV ELECTRICAL  
PV-4: PV EQUIPMENT LABELS  
PV-5: PV INSTALL GUIDE

**DESIGNER INFO**

DESIGNER: MCP  
ENGINEER: AWK  
DATE: 10/4/2022  
VERSION: P1

**PV SYSTEM INSTALL GUIDE**

**PV-5.1**