PHOTOVOLTAIC SYSTEM

CODES:

THIS PROJECT COMPLIES WITH THE FOLLOWING: 2018 INTERNATIONAL BUILDING CODE (IBC)

2018 INTERNATIONAL RESIDENTIAL CODE (IRC)

2018 INTERNATIONAL MECHANICAL CODE (IMC)

2018 INTERNATIONAL PLUMBING CODE (IPC)

2018 INTERNATIONAL FUEL GAS CODE (IFGC)

2018 INTERNATIONAL ENERGY CONSERVATION CODE (IECC)

2018 INTERNATIONAL EXISTING BUILDING CODE (IEBC)

2018 INTERNATIONAL SWIMMING POOL AND SPA CODE (ISPSC)

2020 NATIONAL ELECTRICAL CODE (NEC)

AS ADOPTED BY LEE COUNTY (NC)/CITY OF SANFORD (NC)

VICINITY MAP:



TABLE OF CONTENTS:

PV-1	SITE LOCATION
PV-2	SITE PLAN
PV-2A	ROOF PLAN WITH MODULES LAYOUT
PV-2B	STRUCTURAL CALCULATIONS
PV-3	MOUNTING DETAILS
PV-4	THREE LINE DIAGRAM
PV-5	CONDUCTOR CALCULATIONS
PV-6	EQUIPMENT & SERVICE LIST
PV-7	LABELS
PV-7A	SITE PLACARD
PV-8	OPTIMIZER CHART
PV-9	SAFETY PLAN
PV-10	SAFETY PLAN
APPENDIX	MANUFACTURER SPECIFICATION SHEETS

CONSTRUCTION NOTES:

CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.

ALL SOLAR ENERGY SYSTEM EQUIPMENT SHALL BE SCREENED TO THE MAXIMUM EXTENT POSSIBLE AND SHALL BE PAINTED A COLOR SIMILAR TO THE SURFACE UPON WHICH THEY ARE MOUNTED.

MODULES SHALL BE TESTED, LISTED AND INDENTIFIED WITH FIRE CLASSIFICATION IN ACCORDANCE WITH UL 2703. SMOKE AND CARBON MONOXIDE ALARMS ARE REQUIRED PER SECTION R314 AND 315 TO BE VERIFIED AND INSPECTED BY INSPECTOR IN THE FIELD.

DIG ALERT (811) TO BE CONTACTED AND COMPLIANCE WITH EXCAVATION SAFETY PRIOR TO ANY **EXCAVATION TAKING PLACE**

PHOTOVOLTAIC SYSTEM GROUND WILL BE TIED INTO EXISTING GROUND AT MAIN SERVICE FROM DC DISCONNECT/INVERTER AS PER 2020 NEC SEC 250.166(A).

SOLAR PHOTOVOLTAIC SYSTEM EQUIPMENT WILL BE INSTALLED IN ACCORDANCE WITH REQUIREMENTS OF ART. 690 OF THE 2020 NEC

THE MAIN SERVICE PANEL WILL BE EQUIPPED WITH A GROUND ROD OR UFER

UTILITY COMPANY WILL BE NOTIFIED PRIOR TO ACTIVATION OF THE SOLAR PV SYSTEM

SOLAREDGE OPTIMIZERS ARE LISTED TO IEC 62109-1 (CLASS II SAFETY) AND UL 1741 STANDARDS

INSTALL CREW TO VERIFY ROOF STRUCTURE PRIOR TO COMMENCING WORK. EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNT.

THIS SYSTEM IS DESIGNED FOR WIND SPEED: 120 MPH **CATEGORY B EXPOSURE**



PETRI BRAND 111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD **UTILITY: "CENTRAL ELECTRIC** COOPERATIVE, INC. (OR)" PHONE: 7018185587

<u>SYSTEM:</u> SYSTEM SIZE (DC): 28 X 400 = 11.200 kW SYSTEM SIZE (AC): 7.600 kW @ 240V MODULES: 28 X HANWHA QCELL: Q.PEAK DUO BLK ML-G10+ 400 OPTIMIZERS: 28 X SOLAREDGE S440 INVERTER: SOLAREDGE SE7600H-US [SI1]

REVISIONS	
REVISED BY	DATE
-	-
-	-
-	-



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075


GREG ALBRIGHT


CONTRACTOR LICENSE:

SITE	LOCATION

JOB NO: DATE: DESIGNED BY: 247668 7/21/2022

SHEET:

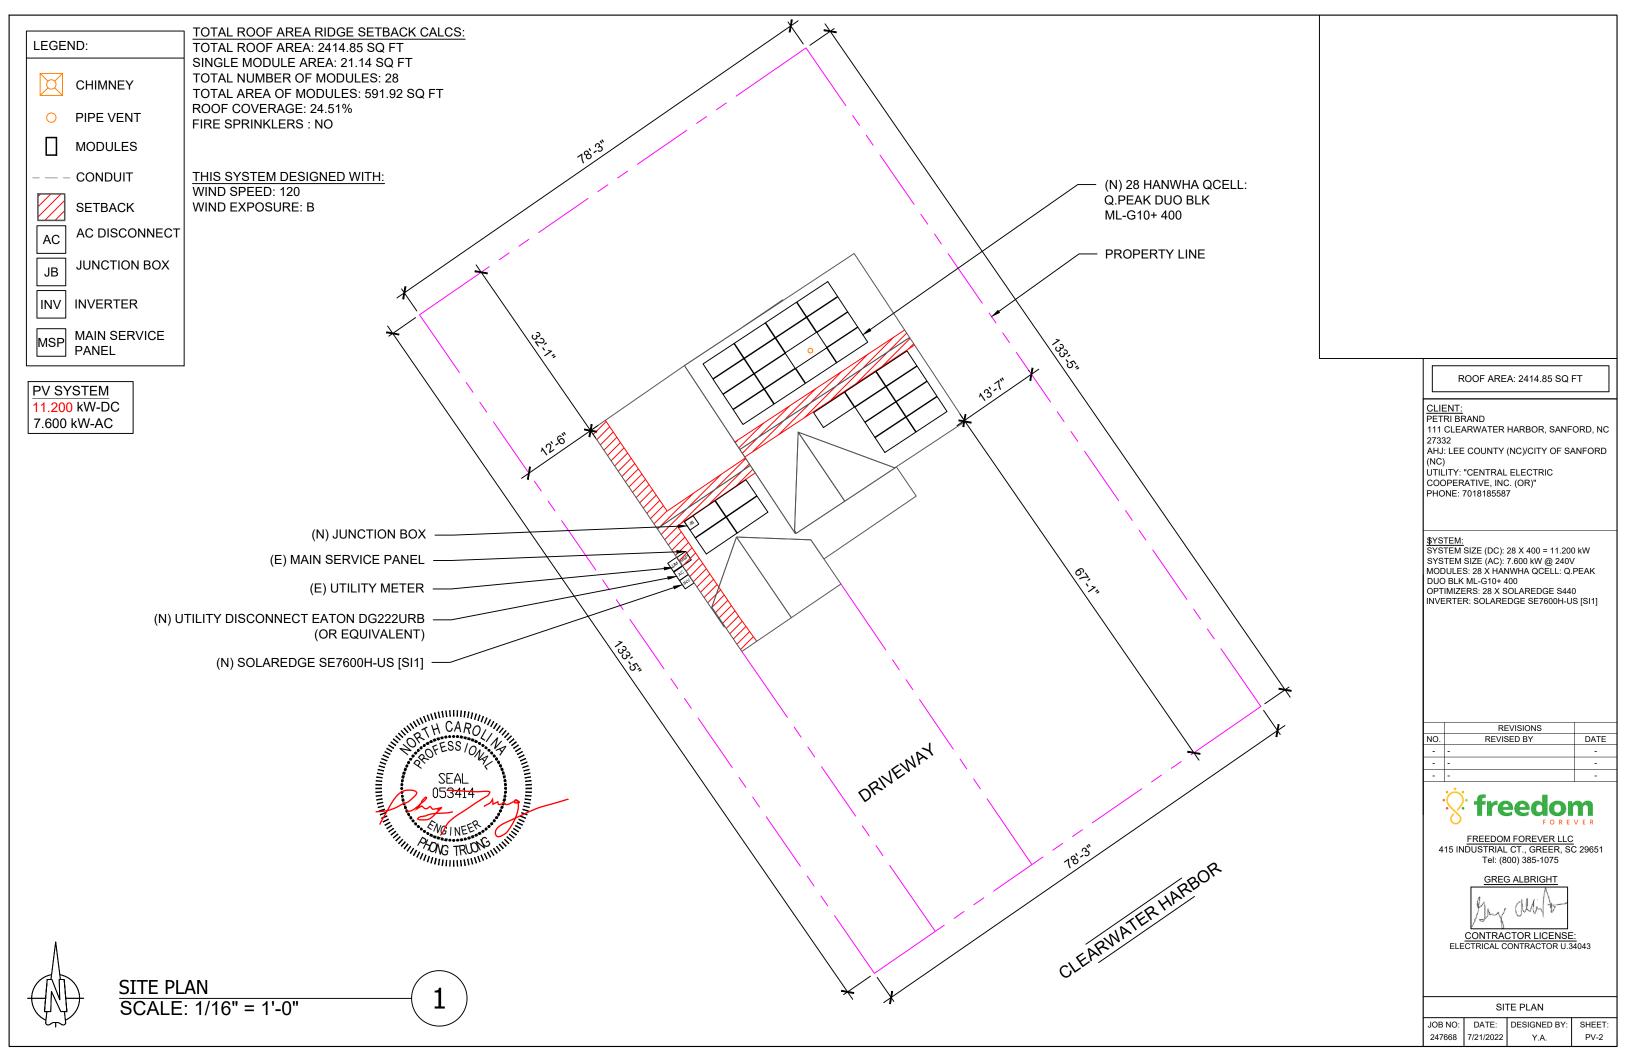

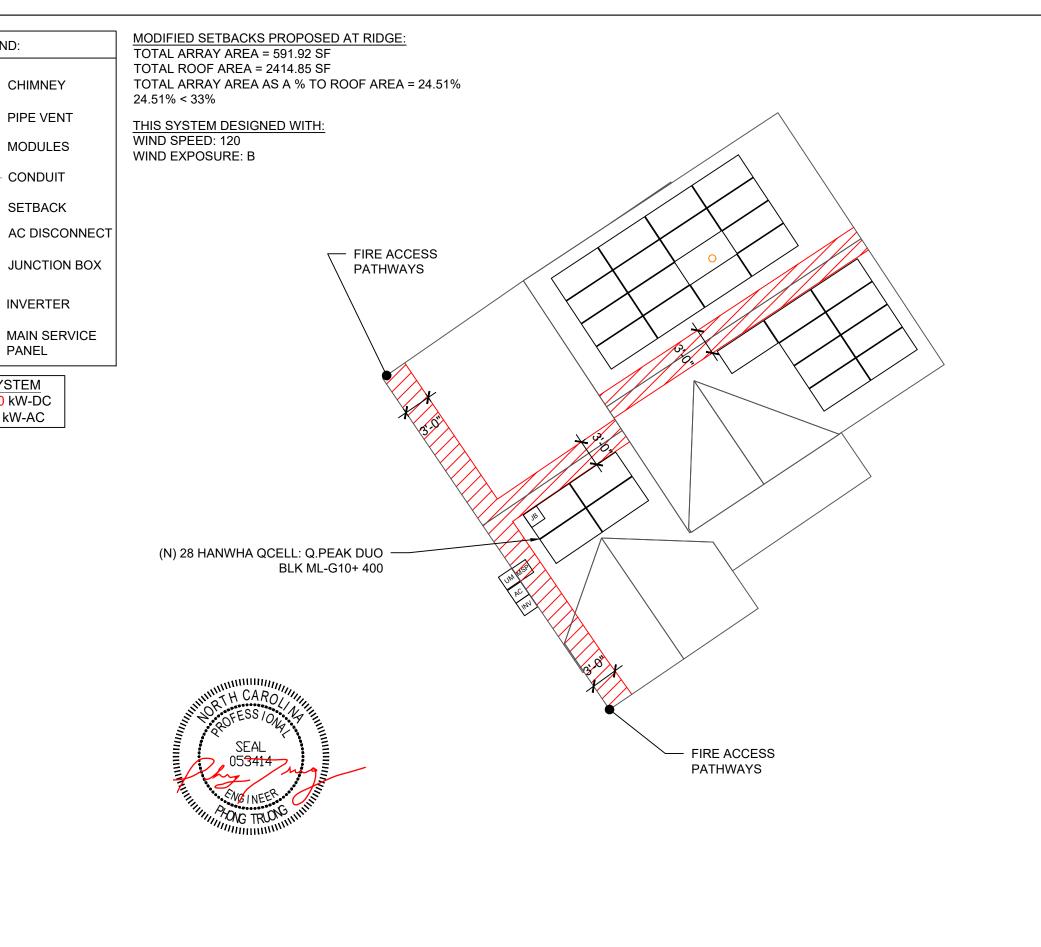

ROOF AREA: 2414.85 SQ FT

111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD

UTILITY: "CENTRAL ELECTRIC COOPERATIVE, INC. (OR)" PHONE: 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK DUO BLK ML-G10+ 400 OPTIMIZERS: 28 X SOLAREDGE S440 INVERTER: SOLAREDGE SE7600H-US [SI1]

REVISIONS



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075

CONTRACTOR LICENSE: ELECTRICAL CONTRACTOR U.34043

ROOF PLAN WITH MODULES LAYOUT

247668 7/21/2022

ROOF PLAN SCALE: 3/32" = 1'-0"

LEGEND:

CHIMNEY

- — - CONDUIT

PANEL

AC

JB

|INV|

MSP

PV SYSTEM 11.200 kW-DC 7.600 kW-AC

EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNTS

ATTACHED CLAMPS AT 25% FROM THE EDGE AND 50% FROM THE CENTER OF THE MODULES

JUNCTION BOX IS MOUNTED TO THE RAIL.

ROOF DETAILS:

TOTAL ROOF AREA: 2414.85 SQ FT ARRAY COVERAGE: 24.51%

SYSTEM DISTRIBUTED WEIGHT: 2.29 LBS

SFM INFINITY \ ROCKIT MICRORAIL POINT-LOAD: 12.94 LBS

	ROOF AREA STATEMENT								
ROOF	MODULE QUANTITY	ROOF PITCH	ARRAY PITCH	AZIMUTH	ROOF AREA	ARRAY AREA			
1	15	30°	30°	327°	317 SQ FT	317.1 SQ FT			
2	9	30°	30°	147°	190 SQ FT	190.26 SQ FT			
3	4	20°	20°	146°	84 SQ FT	84.56 SQ FT			



CLIENT: PETRI BRAND 111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD UTILITY: "CENTRAL ELECTRIC COOPERATIVE, INC. (OR)" PHONE: 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK
DUO BLK ML-G10+ 400
OPTIMIZERS: 28 X SOLAREDGE S440
INVERTER: SOLAREDGE SE7600H-US [SI1]

	REVISIONS		
NO.	REVISED BY	DATE	
-	i	-	
-	-	-	
-	i	-	



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075 GREG ALBRIGHT

CONTRACTOR LICENSE: ELECTRICAL CONTRACTOR U.34043


ROOI	F DE	TAIL	S

JOB NO: DATE: DESIGNED BY: SHEET: 247668 7/21/2022



PARTIAL ROOF FRAMING PLAN

Scale: NTS

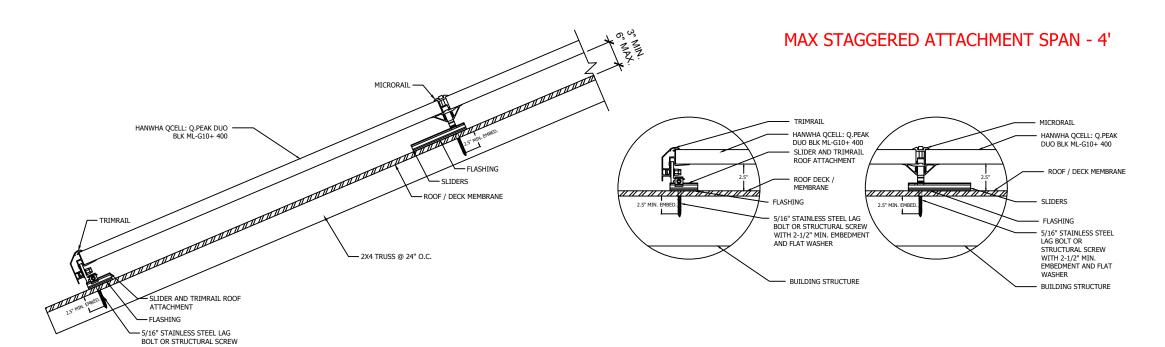

SOLAR PV ARRAY SECTION VIEW

WITH 2-1/2" MIN. EMBEDMENT AND FLAT WASHER

Scale: NTS

ATTACHMENT DETAIL

Scale: NTS

111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD

UTILITY: "CENTRAL ELECTRIC COOPERATIVE, INC. (OR)" PHONE: 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK DUO BLK ML-G10+ 400 OPTIMIZERS: 28 X SOLAREDGE S440 INVERTER: SOLAREDGE SE7600H-US [SI1]

	REVISIONS	
NO.	REVISED BY	DATE
-	i	-
-	-	-
-	-	-




FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075 GREG ALBRIGHT


CONTRACTOR LICENSE: ELECTRICAL CONTRACTOR U.34043

MOUNTING DETAILS

247668 7/21/2022

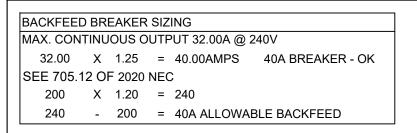

PV SYSTEM 11.200 kW-DC 7.600 kW-AC

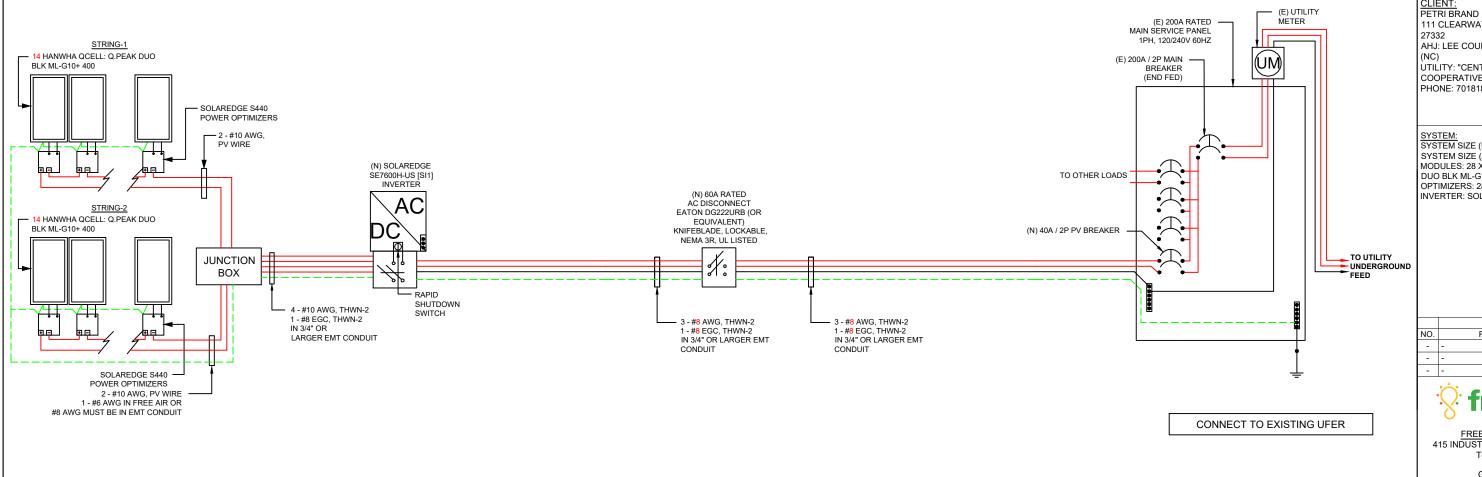

111 CLEARWATER HARBOR, SANFORD, NC
27332
AHJ: LEE COUNTY (NC)/CITY OF SANFORD
(NC)
UTILITY: "CENTRAL ELECTRIC
COOPERATIVE, INC. (OR)"
PHONE: 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK
DUO BLK ML-G10+ 400
OPTIMIZERS: 28 X SOLAREDGE S440
INVERTER: SOLAREDGE SE7600H-US [SI1]



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075

GREG ALBRIGHT

May Whit

CONTRACTOR LICENSE: ELECTRICAL CONTRACTOR U.34043

THREE LINE DIAGRAM

CONDUIT AND CONDUCTORS SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT

TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS

JOB NO: DATE: DESIGNED BY: 247668 7/21/2022 Y.A.

RACEWAY #		EQU	IPMENT		WIRE LOCATION	CONDUCTOR QTY.	AWG WIRE SIZE	STARTING ALLOWABLE AMPACITY @ 90°C 310.15(B)(16)	STARTING CURRENT APPLIED TO CONDUCTORS IN RACEWAY	TEMPERATURE CORRECTION FACTOR 310.15(B)(2)(a)	ADJUSTMENT FACTOR FOR MORE THAN 3 CONDUCTORS 310.15(B)(3)(a)	ADJUSTED CONDUCTOR AMPACITY @ 90°C	MAXIMUM CURRENT APPLIED TO CONDUCTOR IN RACEWAY
1	DC	MODULE	ТО	OPTIMIZER	ROOF / FREE-AIR	2	10	40	13.93	1	1	40.00	17.41
2	DC	OPTIMIZER	ТО	JUNCTION BOX	ROOF / FREE-AIR	2	10	40	15.00	1	1	40.00	18.75
3	DC	JUNCTION BOX	ТО	INVERTER	EXTERIOR WALL	4	10	40	15.00	1	0.8	32.00	18.75
4	AC	INVERTER	ТО	AC DISCONNECT	EXTERIOR WALL	3	8	55	32.00	1	1	55.00	40.00
5	AC	AC DISCONNECT	ТО	POI	EXTERIOR WALL	3	8	55	32.00	1	1	55.00	40.00

CLIENT:
PETRI BRAND
111 CLEARWATER HARBOR, SANFORD, NC
27332
AHJ: LEE COUNTY (NC)/CITY OF SANFORD
(NC)
UTILITY: "CENTRAL ELECTRIC
COOPERATIVE, INC. (OR)"
PHONE: 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK
DUO BLK ML-G10+ 400
OPTIMIZERS: 28 X SOLAREDGE S440
INVERTER: SOLAREDGE SE7600H-US [SI1]



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075

GREG ALBRIGHT

CONTRACTOR LICENSE

CONTRACTOR LICENSE: ELECTRICAL CONTRACTOR U.34043

CONDUCTOR CALCULATIONS

JOB NO: DATE: DESIGNED BY: SHEE 247668 7/21/2022 Y.A. PV-

CONDUCTOR AMPACITY CALCULATIONS IN ACCORDANCE WITH NEC 690.8.

BREAKER SIZES: 40A PV BREAKER

SERVICE LIST:

	
NONE	

TY.	PART	PART#	DESCRIPTION	
28	MODULES	PV-111-400W-2	HANWHA QCELL: Q.PEAK DUO BLK ML-G10+ 400	
28	OPTIMIZERS	S440	SOLAREDGE S440 POWER OPTIMIZER - FRAME MOUNTED MODULE ADD-ON	
1	JUNCTION BOX	480-276	600VDC NEMA 3R UL LISTED JUNCTION BOX	
2	CONNECTORS	240-300	STAUBLI / MULTI-CONTACT MC4 CONNECTORS (FEMALE)	
2	CONNECTORS	240-301	STAUBLI / MULTI-CONTACT MC4 CONNECTORS (MALE)	
1	INVERTER	120-761	SOLAREDGE SE7600H-US [SI1] 240V INVERTER UL1741 SA CERTIFIED INTEGRATED ARC FAULT PROTECTION AND RAPID SHUTDOWN	
1	AC DISCONNECT	321-060	60A RATED 240VAC NEMA 3R UL LISTED	
105	ROOF ATTACHMENT 1	261-602	SFM INFINITY \ ROCKIT MICRORAIL	
20	SFM TRIM 1	241-253	FLASHKIT SFM / ROCK-IT TRIM COMP DARK	
53	SFM SLIDER 1	261-603	FLASHKIT SFM / ROCK-IT SLIDER COMP DARK	
16	BONDING CLAMP 1	221-100	N/S BONDING CLAMP	
6	BONDING CLAMP 1	241-404	TRIM BONDING CLAMP	
30	MOUNT ASSEMBLY 1	241-405	MLPE MOUNT ASSY	
17	SFM SPLICE 1	261-604	SFM / ROCK-IT SPLICE	
4	SFM ATTACHED SPLICE 1	211-101	ATTACHED SPLICE 8 INCH	
23	TRIMRAIL 1	261-606	TRIMRAIL UNIV CLIP W/ HDW	
7	TRIM SPLICE 1	261-605	TRIM SPLICE DRK	
13	TRIMRAIL 1	211-115	TRIMRAIL UNIV DRK	
28	GROUND LUG 1	260-585	ILSCO GROUND LUG	
28	TRIM END CAPS 1	221-200	UNIRAC SFM / ROCK-IT TRIM END CAPS	
	1			

CLIENT: PETRI BRAND 111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD UTILITY: "CENTRAL ELECTRIC COOPERATIVE, INC. (OR)" PHONE: 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK
DUO BLK ML-G10+ 400
OPTIMIZERS: 28 X SOLAREDGE S440
INVERTER: SOLAREDGE SE7600H-US [SI1]

O. REVISED BY	DATE
	-
- -	-
	-




FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075


GREG ALBRIGHT

CONTRACTOR LICENSE: ELECTRICAL CONTRACTOR U.34043

EQUIPMENT & SERVICE LIST

JOB NO: DATE: DESIGNED BY: 247668 7/21/2022

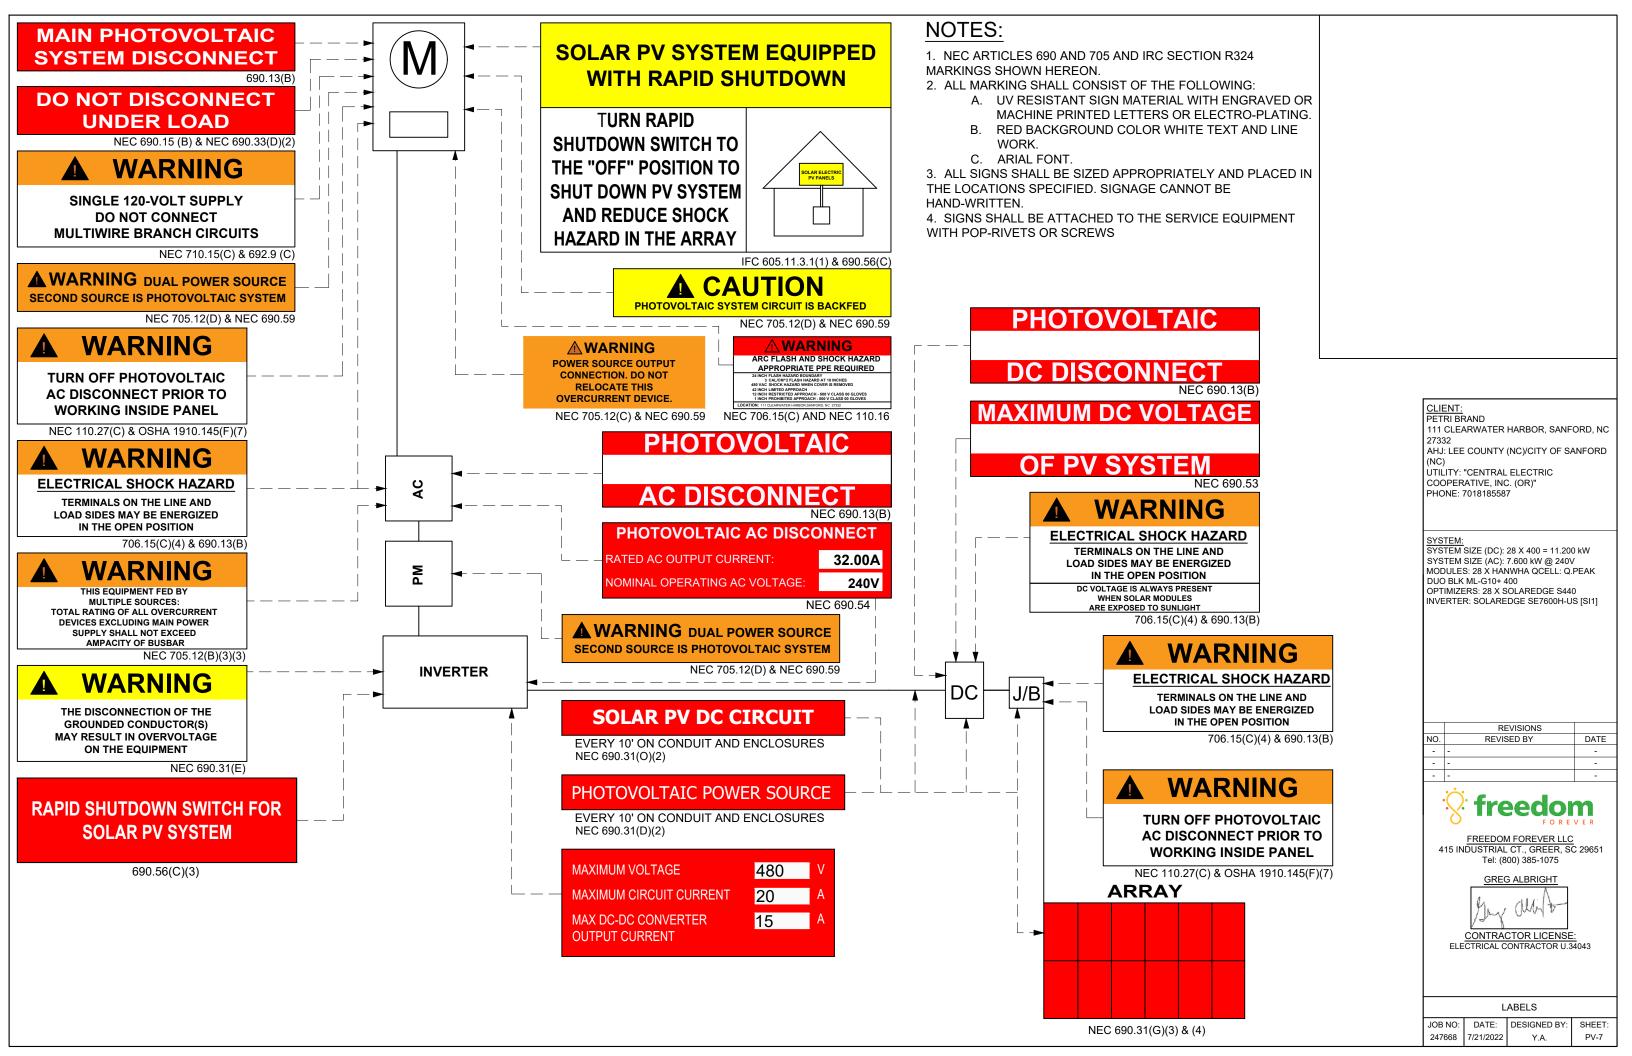

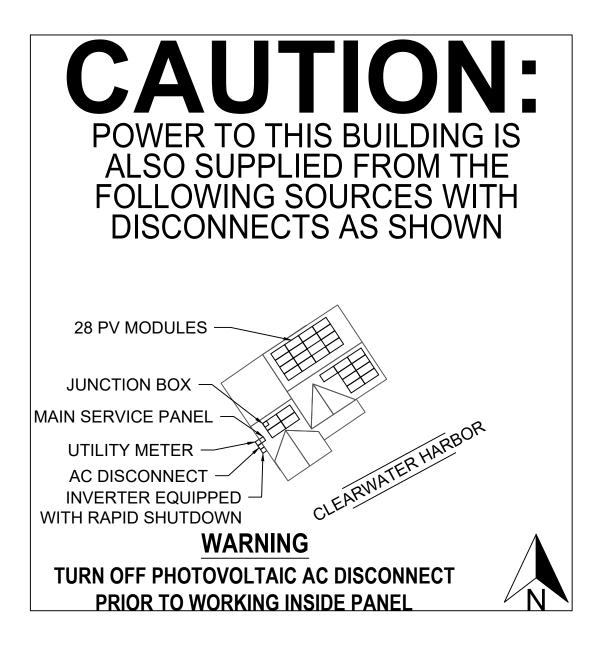

NOTES:

- 1. NEC ARTICLES 690 AND 705 AND IRC SECTION R324 MARKINGS SHOWN HEREON.
- 2. ALL MARKING SHALL CONSIST OF THE FOLLOWING:
 - A. UV RESISTANT SIGN MATERIAL WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PLATING.
 - B. RED BACKGROUND COLOR WHITE TEXT AND LINE WORK.
 - C. AERIAL FONT.
- 3. ALL SIGNS SHALL BE SIZED APPROPRIATELY AND PLACED IN THE LOCATIONS SPECIFIED. SIGNAGE CANNOT BE HAND-WRITTEN.
- 4. SIGNS SHALL BE ATTACHED TO THE SERVICE EQUIPMENT WITH POP-RIVETS OR SCREWS.

PETRI BRAND 111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD

UTILITY: "CENTRAL ELECTRIC COOPERATIVE, INC. (OR)" PHONE: 7018185587

SYSTEM SIZE (DC): 28 X 400 = 11.200 kW SYSTEM SIZE (AC): 7.600 kW @ 240V MODULES: 28 X HANWHA QCELL: Q.PEAK DUO BLK ML-G10+ 400 OPTIMIZERS: 28 X SOLAREDGE S440 INVERTER: SOLAREDGE SE7600H-US [SI1]


	REVISIONS	
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075

SITE PLACARD

247668 7/21/2022

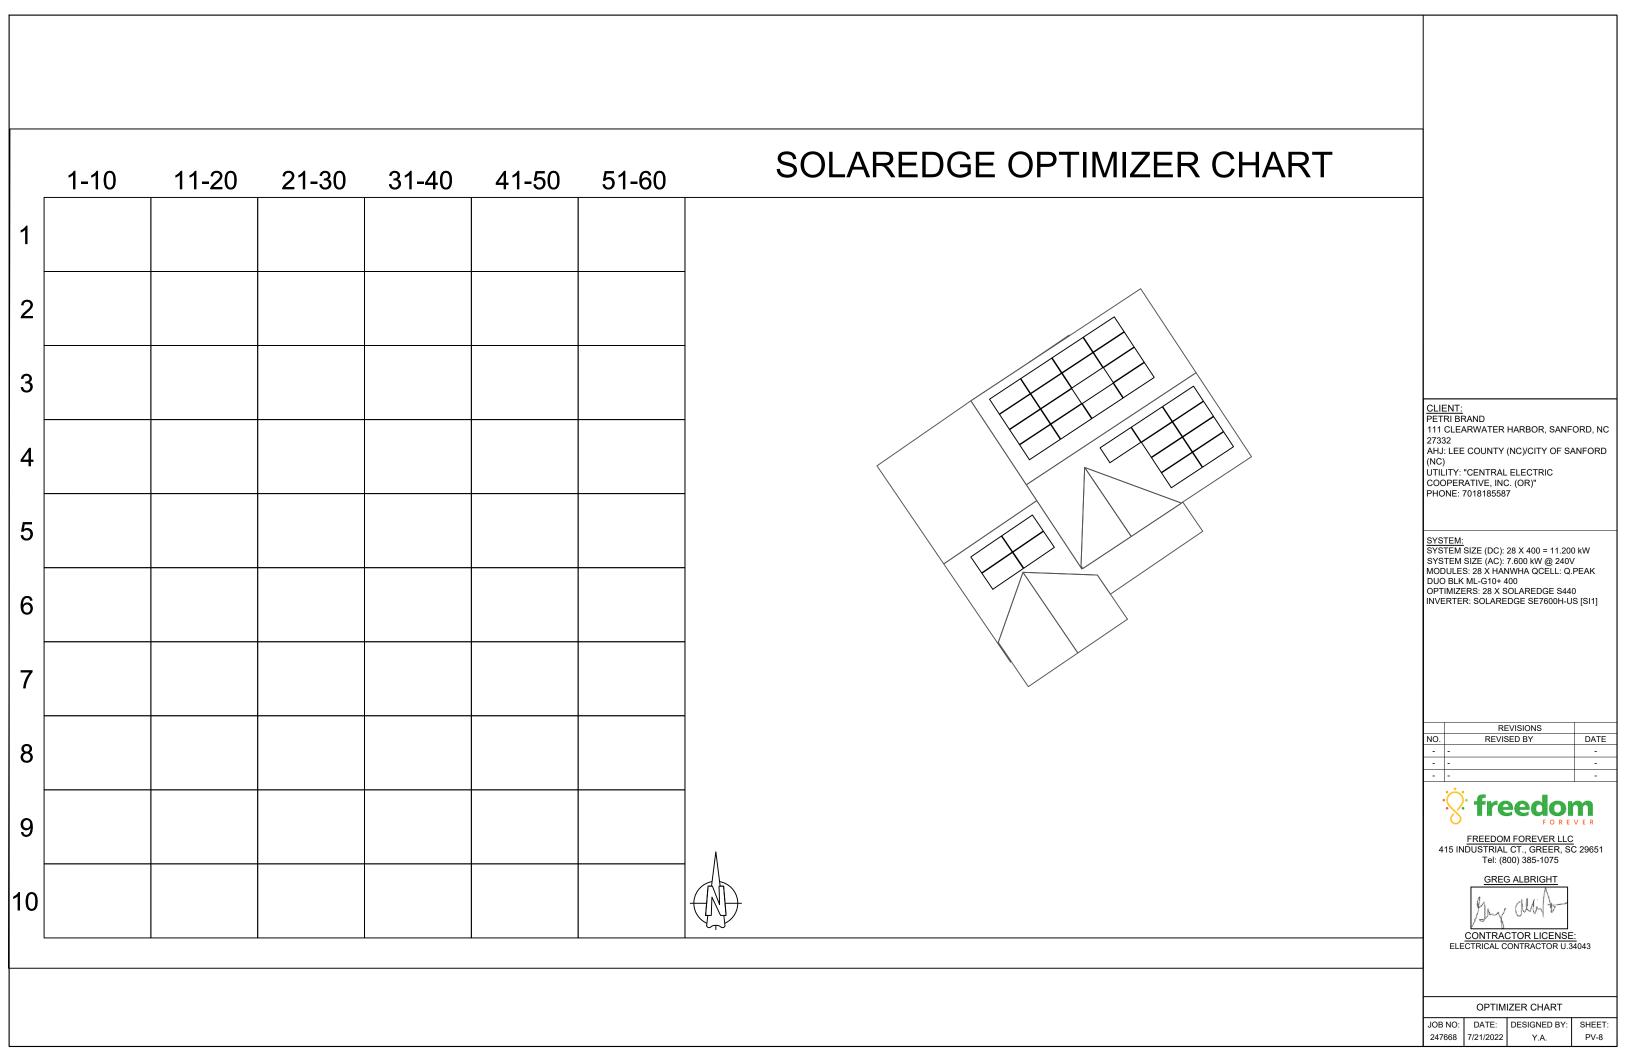

SAFETY PLAN

INSTRUCTIONS:


- USE SYMBOLS IN KEY TO MARK UP THIS SHEET.
- SAFETY PLAN MUST BE MARKED BEFORE JOB STARTS AS PART OF THE PRE-PLAN
- DOCUMENT ALL ADDITIONAL HAZARDS ON THIS PAGE & MAKE NOTES ON THE JHA SHEET

IN CASE OF EMERGENCY

INJURY HOTLINE (855) 400-7233

NEAREST HOSPITAL OR OCCUPATIONAL/INDUSTRIAL CLIN
NAME:
ADDRESS:
SAFETY COACH CONTACT INFORMATION
NAME:
PHONE NUMBER:
ALL EMPLOYEES ON SITE SHALL BE MADE AWARE OF THE SAFETY PLAN AND SIGN INDICATING THAT THEY ARE AWARE OF THE HAZARDS ON-SITE AND THE PLAN FOR WORKING SAFELY.
NAME SIGNATURE

TIME:

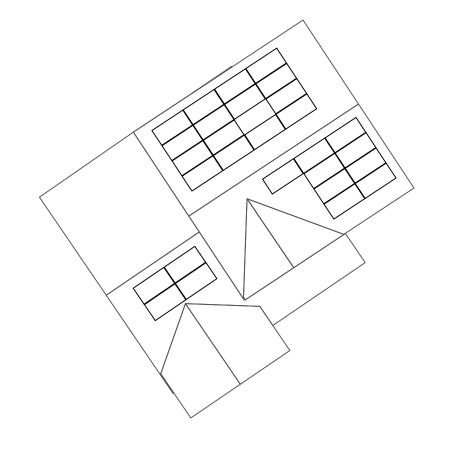

MARK UP KEY

- PERMANENT ANCHOR
- TEMPORARY ANCHOR
- **INSTALLER LADDER**
- JUNCTION / COMBINER BOX В
- S STUB-OUT
- SKYLIGHT
 - NO LADDER ACCESS (STEEP GRADE OR GROUND LEVEL **OBSTRUCTIONS**)
- RESTRICTED ACCESS
 - CONDUIT
 - **GAS SHUT OFF**
 - WATER SHUT OFF
- SERVICE DROP
- **POWER LINES**

CLIENT: PETRI BRAND

111 CLEARWATER HARBOR, SANFORD, NC AHJ: LEE COUNTY (NC)/CITY OF SANFORD

UTILITY: "CENTRAL ELECTRIC

COOPERATIVE, INC. (OR)" PHONE: 7018185587


<u>SYSTEM:</u> SYSTEM SIZE (DC): 28 X 400 = 11.200 kW SYSTEM SIZE (AC): 7.600 kW @ 240V MODULES: 28 X HANWHA QCELL: Q.PEAK DUO BLK ML-G10+ 400

OPTIMIZERS: 28 X SOLAREDGE S440 INVERTER: SOLAREDGE SE7600H-US [SI1]

BREAK AND WATER LOG

THIS LOG IS TO BE FILLED OUT ANY TIME THE TEMP EXCEEDS 90 DEGREES. THE CREW LEAD AND ROOF LEAD ARE RESPONSIBLE FOR ENSURING THIS IS COMPLETED AND UPLOADED AT THE END OF EVERYDAY WHEN TEMPS EXCEED 90 DEGREES

NAME	0800HRS	0900HRS	1000HRS	1100HRS	1200HRS	1300HRS	1400HRS	1500HRS	1600HRS
	i		i	i		i	i		



FREEDOM FOREVER LLC 415 INDUSTRIAL CT., GREER, SC 29651 Tel: (800) 385-1075

CONTRACTOR LICENSE:

SAFETY PLAN

DATE: DESIGNED BY: 247668 7/21/2022

JOB HAZARD ANALYSIS

Crew leader to fill out all sections below, hold a pre-job safety meeting with all personnel, and upload this completed document and the Safety Plan to Site Capture

Ladder Access

- Ladders must be inspected before each use.
- Extension ladders must be set up on a firm and level surface at a 4-to-1 rise to run angle (or 75 degrees) and the top must be secured to the structure. Extension style ladders placed on uneven, loose or slippery surfaces must additionally have the base firmly anchored or lashed so the base will not slip out.
- Extension ladders must be used with walk-through devices or the ladder must extend 36" above the stepping off point.
- A-frame ladders must only be climbed with the ladder spreader bars locked in the open position; A-frame ladders shall not be climbed while in the closed position (ex, closed and used while leaned against a structure).
- Additional notes:

Mobile Equipment

- Only Qualified operators will operate equipment; operators must maintain a certification on their person for the equipment being operated
- Type(s) of mobile equipment (Type/Make/Model):
- Qualified operator(s):

Material Handling and Storage

 Materials will be staged/stored in a way that does not present a hazard to client, personnel or public. Materials stored on the roof will be physically protect from failing or sliding off.

Fall Protection

- A site-specific plan for fall prevention and protection is required prior to starting work and must remain onsite at all times until work is complete; a fall rescue plan must be outlined and discussed among the crew prior to work start.
- First-person-Up (FPU) must install their anchor and connect before any other task, including installing other anchors. The Last-Person-Down (LPD) must be the only person on a roof uninstalling fall protection.
- FPCP (name and title):
- FPU and LPD (name and title):

Electrical Safety

- The Electrical Qualified Person (EQP) is required onsite to perform electrical work.
- All electrical work will be performed with equipment in an electrically safe condition (de-energized) unless approval has been granted prior to work.
 Service drops and overhead electrical hazards will be indentified
- and protected from contact, as neccessary.
- EQP (name and tile):

Public Protection

- The safety of the Client and Public must be maintained at all times.
- The Client and the Public shall be prevented from entering the work zone through the use of barriers and/or signage, as required.
- Company, Client and Public property shall be protected from falling objects.
- Pets (including dogs) shall be secured by their owners prior to work start
- The Client should not leave pets, family members, or others in charge or care of Employees, Contractors, or Temporary Workers.

- Crew leader responsible for communication with the client:
- Client and public is excluded from work area by barricades (N/A, Yes, No):

Training and Pre-Job Safety Briefing

- All employees onsite shall be made aware of the specific hazards
 of this project and review this HJA during a pre-job briefing, and
 their signature indicates awareness of site conditions and the
 plan to eliminate any hazards identified prior to and during the
 project.
- Crew leader (name/title):
- Crew member (name/title):

Airborne Contaminants:

- Asbestos-containing (Transite) piping (ACP) Do not disturb (move, drill, cut fracture, etc.)
- Asbestos-containing thermal insulation (ACI) and Asbestos-containing duct wrapping (ACW) - do not disturb, no attic or crawlspace access is allowed if work to be performed could cause exposure to personnel, client or public.
- If yes, list specific tasks and protection in place:

Weather and Environment

- The site supervisor shall forecast the weather conditions at the job site, prior to crew arrival, in order to mitigate any hazards associated with inclement weather (heat, cold, wind, rain, etc.)
- The site supervisor will utilized a portable wind meter (anemometer) to verify actual onsite wind conditions, by checking at the ground and on any elevated work surface (ex, rooftop) prior to work start, at midday and prior to solar panel staging on a roof.
- Elevated work involving the moving or maneuvering of solar panels shall cease at 25mph (sustained wind) until wind subsides.
- Forecasted weather maximum temp (degrees f):

Heat Related Illness Prevention

- Employees shall have access to potable drinking water that is fresh, pure, and suitably cool. The water shall be located as close as practicable to the areas where employees are working. Water shall be supplied in sufficient quantity at the beginning of the work shift to provide at least one quart per employee per hour for drinking for the entire shift. Employees may begin the shift with smaller quantities of water if they identify the location and have effective means for replenishment during the shift to allow employees to drink on quart or more per hour. The frequent drinking of water shall be encouraged.
- Shade shall be present when temperature exceeds 80 degrees Fahrenheit. When the outdoor temperature in the work exceeds 80 degrees Fahrenheit, employees shall have and maintain one or more areas with shade at all times.
- New employees must be acclimatized. New employees will be monitored by their Crew Leader (site supervisor) for the first two (2) weeks of employment or longer when necessary.
- Employees will be allowed and encouraged to implement scheduled breaks during each shift. Employees must take cool-down breaks in the shade any time they feel the need to do so to protect them from overheating. Supervisors are REQUIRED to allow employees any break period they need during high heat conditions.
- Cool Vests are encouraged for all employees at all times during periods of high heat.
- Identify the location of the closet Occupational/Industrial Clinic or Hospital in case a crew member becomes ill.

What is the specific plan to provide and replenish sufficient water for all employees on site?

- If offsite replenish is necessary, where will you go to replenish water (location/address):
- Who will replenish the drinking water (name):

Restroom facilities

- Employees shall have access to restroom facilities with hand-washing stations. Use of onsite restroom is at the client's discretion (location is annotated below). If client does not give permission, location of suitable restroom facilities with hand-washing stations offsite will be provided. The onsite supervisor will identify location and make arrangements to ensure all employees have access at any point.
- Restroom facilities will be (circle one): Onsite Offsite
- If Offsite, add location name and address:

Incident Reporting Procedure

Contact your Site Supervisor

Name:

Phone:

Contact your Manager

Name:

Phone:

Contact your Site Supervisor

Name:

Phone:

With: Your full name, phone number, office location, brief description of what happen and when.

NOTE ADDITIONAL HAZARDS NOT ADDRESSED ABOVE

(add as many as necessary by using additional sheets)

Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
1	

CLIENT:
PETRI BRAND
111 CLEARWATER HARBOR, SANFORD,
27332
AHJ: LEE COUNTY (NC)/CITY OF SANFOI
(NC)
UTILITY: "CENTRAL ELECTRIC
UTILITY: "CENTRAL ELECTRIC COOPERATIVE, INC. (OR)"
PHONE 7018185587

SYSTEM:
SYSTEM SIZE (DC): 28 X 400 = 11.200 kW
SYSTEM SIZE (AC): 7.600 kW @ 240V
MODULES: 28 X HANWHA QCELL: Q.PEAK
DUO BLK ML-G10+ 400
OPTIMIZERS: 28 X SOLAREDGE S440
INVERTER: SOLAREDGE SE7600H-US [SI1]

	REVISIONS	
Ο.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-





	SAF	ETY PLAN
3 NO:	DATE:	DESIGNED BY:

SHEET:

247668 7/21/2022 Y.A.



Q.PEAK DUO BLK ML-G10+

385-405

ENDURING HIGH PERFORMANCE







BREAKING THE 20% EFFICIENCY BARRIER

Q.ANTUM DUO Z Technology with zero gap cell layout boosts module efficiency up to 20.9%.



THE MOST THOROUGH TESTING PROGRAMME IN THE INDUSTRY

Q CELLS is the first solar module manufacturer to pass the most comprehensive quality programme in the industry: The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.



INNOVATIVE ALL-WEATHER TECHNOLOGY

Optimal yields, whatever the weather with excellent low-light and temperature behavior.



ENDURING HIGH PERFORMANCE

Long-term yield security with Anti LID Technology, Anti PID Technology¹, Hot-Spot Protect and Traceable Quality Tra.Q™.



EXTREME WEATHER RATING

High-tech aluminum alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).



A RELIABLE INVESTMENT

Inclusive 25-year product warranty and 25-year linear performance warranty².



CELL TECHNOLOGY




CELL TECHNOLOGY

Engineered in Germany



MECHANICAL SPECIFICATION

Format	74.0 in \times 41.1 in \times 1.26 in (including frame) (1879 mm \times 1045 mm \times 32 mm)
Weight	48.5 lbs (22.0 kg)
Front Cover	0.13in (3.2mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Black anodized aluminum
Cell	6 × 22 monocrystalline Q.ANTUM solar half cells
Junction Box	$2.09\text{-}3.98\text{in}\times 1.26\text{-}2.36\text{in}\times 0.59\text{-}0.71\text{in}$ (53-101mm × 32-60mm × 15-18mm), IP67, with bypass diodes
Cable	4 mm² Solar cable; (+) ≥49.2 in (1250 mm), (-) ≥49.2 in (1250 mm)
Connector	Stäubli MC4: IP68




ELECTRICAL CHARACTERISTICS

WER CLASS			385	390	395	400	405
IIMUM PERFORMANCE AT STANDAI	RD TEST CONDITIO	NS, STC1 (PO	WER TOLERANCE +	5W/-0W)			
Power at MPP¹	P _{MPP}	[W]	385	390	395	400	405
Short Circuit Current ¹	I _{sc}	[A]	11.04	11.07	11.10	11.14	11.17
Open Circuit Voltage ¹	Voc	[V]	45.19	45.23	45.27	45.30	45.34
Current at MPP	I _{MPP}	[A]	10.59	10.65	10.71	10.77	10.83
Voltage at MPP	V_{MPP}	[V]	36.36	36.62	36.88	37.13	37.39
Efficiency ¹	η	[%]	≥19.6	≥19.9	≥20.1	≥20.4	≥20.6
IIMUM PERFORMANCE AT NORMAL	OPERATING CONE	DITIONS, NMO	DT ²				
Power at MPP	P _{MPP}	[W]	288.8	292.6	296.3	300.1	303.8
Short Circuit Current	I _{sc}	[A]	8.90	8.92	8.95	8.97	9.00
Open Circuit Voltage	V _{oc}	[V]	42.62	42.65	42.69	42.72	42.76
Current at MPP	I _{MPP}	[A]	8.35	8.41	8.46	8.51	8.57
Voltage at MPP	V _{MPP}	[V]	34.59	34.81	35.03	35.25	35.46
	Power at MPP¹ Short Circuit Current¹ Open Circuit Voltage¹ Current at MPP Voltage at MPP Efficiency¹ IIMUM PERFORMANCE AT NORMAL Power at MPP Short Circuit Current Open Circuit Voltage Current at MPP	$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	Note of the property of the	Number Number	Note	Power at MPP¹


¹Measurement tolerances P_{MPP} ±3%; l_{SCi}, V_{OC} ±5% at STC: 1000W/m², 25±2°C, AM 1.5 according to IEC 60904-3 • ²800W/m², NMOT, spectrum AM 1.5

Q CELLS PERFORMANCE WARRANTY



At least 98% of nominal power during first year. Thereafter max. 0.5% degradation per year. At least 93.5% of nominal power up to 10 years. At least 86% of nominal power up to 25 years

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Q CELLS sales organisation of your respective country.



Typical module performance under low irradiance conditions in comparison to STC conditions (25°C, 1000 W/m²)

TEMPERATURE COEFFICIENTS							
Temperature Coefficient of I _{SC}	α	[%/K]	+0.04	Temperature Coefficient of Voc	β	[%/K]	-0.27
Temperature Coefficient of P _{MPP}	γ	[%/K]	-0.34	Nominal Module Operating Temperature	NMOT	[°F]	109±5.4 (43±3°C)

PROPERTIES FOR SYSTEM DESIGN

Maximum System Voltage V _{SYS}	[V]	1000 (IEC)/1000 (UL)	PV module classification	Class II
Maximum Series Fuse Rating	[A DC]	20	Fire Rating based on ANSI/UL 61730	TYPE 2
Max. Design Load, Push / Pull ³	[lbs/ft ²]	75 (3600 Pa) / 55 (2660 Pa)	Permitted Module Temperature	-40°F up to +185°F
Max. Test Load, Push / Pull ³	[lbs/ft ²]	113 (5400 Pa) / 84 (4000 Pa)	on Continuous Duty	(-40°C up to +85°C)

³See Installation Manual

QUALIFICATIONS AND CERTIFICATES

PACKAGING INFORMATION

UL 61730, CE-compliant, Quality Controlled PV - TÛV Rheinland, IEC 61215:2016, IEC 61730:2016, U.S. Patent No. 9,893,215 (solar cells), QCPV Certification ongoing.







				[lb]	[O-O	40'HC	
Horizontal packaging	76.4in 1940mm	43.3 in 1100 mm	48.0 in 1220 mm	1656 lbs 751 kg	24 pallets	24 pallets	32 modules

Note: Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product.

wha Q CELLS America Inc.

 $400\,Spectrum\,Center\,Drive,\,Suite\,1400,\,Irvine,\,CA\,92618,\,USA\,|\,\textbf{TEL}\,+1\,949\,748\,59\,96\,|\,\textbf{EMAIL}\,inquiry@us.q-cells.com\,|\,\textbf{WEB}\,www.q-cells.us$

Specifications subject to technical changes © **Q CELLS** Q.PEAK DUO BLK ML-G10+_385-405_2021-05_Rev01_

 $^{^{\}rm 1}\,\mathrm{APT}$ test conditions according to IEC/TS 62804-1:2015, method A (–1500 V, 96h)

 $^{^{\}rm 2}$ See data sheet on rear for further information.

Power Optimizer For North America

S440, S500



PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detects abnormal PV connector behavior, preventing potential safety issues*
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading

- Faster installations with simplified cable management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)



/ Power Optimizer For North America

S440, S500

	S440	S500	Unit
INPUT			
Rated Input DC Power ⁽¹⁾	440	500	W
Absolute Maximum Input Voltage (Voc)	- 1	60	Vdc
MPPT Operating Range	8	- 60	Vdc
Maximum Short Circuit Current (Isc) of Connected PV Module	14.5	15	Adc
Maximum Efficiency	9	9.5	%
Weighted Efficiency	9	98.6	%
Overvoltage Category		II	
OUTPUT DURING OPERATION			
Maximum Output Current		15	Adc
Maximum Output Voltage	- 1	60	Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISC	ONNECTED FROM INVERTER O	R INVERTER OFF)	'
Safety Output Voltage per Power Optimizer	1+	-/-0.1	Vdc
STANDARD COMPLIANCE			
Photovoltaic Rapid Shutdown System	NEC 2014, 2	2017 & 2020	
EMC	FCC Part 15 Class B, IEC	61000-6-2, IEC61000-6-3	
Safety	IEC62109-1 (clas	s II safety), UL1741	
Material	UL94 V-0,	UV Resistant	
RoHS	Υ	/es	
Fire Safety	VDE-AR-E 21	00-712:2013-05	
INSTALLATION SPECIFICATIONS			
Maximum Allowed System Voltage	10	000	Vdc
Dimensions (W x L x H)	129 x 153 x 30 /	5.07 x 6.02 x 1.18	mm / in
Weight (including cables)	655	5 / 1.5	gr/lb
Input Connector	M	C4 ⁽²⁾	
Input Wire Length	0.1,	/ 0.32	m/ft
Output Connector		1C4	
Output Wire Length	(+) 2.3, (-) 0.10 /	/ (+) 7.54, (-) 0.32	m/ft
Operating Temperature Range ⁽³⁾	-40 t	to +85	°C
Protection Rating	IP68 /	Туре6В	
Relative Humidity	0 -	- 100	%

⁽¹⁾ Rated power of the module at STC will not exceed the power optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed


 $⁽³⁾ For ambient temperature above +70^{\circ}\text{C} / +158^{\circ}\text{F} power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details$

PV System Design Using a SolarEdge Inverter		Single Phase HD-Wave	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	S440, S500	8	14	18	
Maximum String Length (Power Optimizers)		25		50(4)	
Maximum Nominal Power per String		5700 (6000 with SE7600-US-SE11400-U)	6000	12750	W
Maximum Allowed Connected Power per String (5)		Refer to Footnote 5	One String 7200W	15 00014/	
(Permitted only when the difference in connected power between strings is 1,000W or less)		Refer to Foothote 5	Two strings or more 7800W	15,000W	
Parallel Strings of Different Lengths or Orientations			Υ		

⁽⁴⁾ A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement
(5) If the inverters rated AC power s maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power, Refer to: https://www.solaredge.com/sites/default/files/se-power-optimizer-single-string-design-application-note.pdf
(6) It is not allowed to mix S-series and P-series Power Optimizers in new installations





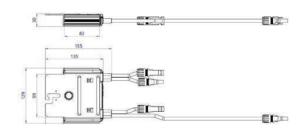

© SolarEdge Technologies, Inc. All rights reserved. SOLAREDGE, the SolarEdge logo, OPTIMIZED BY SOLAREDGE are trademarks or registered trademarks of SolarEdge Technologies Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: February 8, 2022 DS-000018-NA. Subject to change without notice.



solaredge.com

^{*} Expected availability in 2022

Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US





Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12

- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- / Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)



solaredge.com

Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US/ SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US		
APPLICABLE TO INVERTERS WITH PART NUMBER SEXXXXH-XXXXXBXX4									
OUTPUT	'								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
AC Output Voltage MinNomMax. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Va	
AC Output Voltage MinNomMax. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Va	
AC Frequency (Nominal)				59.3 - 60 - 60.5 ⁽¹⁾				Hz	
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	А	
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	А	
Power Factor		1, Adjustable - 0.85 to 0.85							
GFDI Threshold		1							
Utility Monitoring, Islanding Protection, Country Configurable Thresholds		Yes							
INPUT									
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W	
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W	
Transformer-less, Ungrounded				Yes					
Maximum Input Voltage	480 V							Vd	
Nominal DC Input Voltage		380 400						Vdd	
Maximum Input Current @240V ⁽²⁾	8.5	10.5	13.5	16.5	20	27	30.5	Ado	
Maximum Input Current @208V ⁽²⁾	-	9	-	13.5	-	-	27	Ado	
Max. Input Short Circuit Current		45							
Reverse-Polarity Protection	Yes								
Ground-Fault Isolation Detection	600k₂ Sensitivity								
Maximum Inverter Efficiency	99 99.2						%		
CEC Weighted Efficiency						99 @ 240V 98.5 @ 208V	%		
Nighttime Power Consumption	< 2.5					W			

⁽¹⁾ For other regional settings please contact SolarEdge support

⁽²⁾ A higher current source may be used; the inverter will limit its input current to the values stated

/ Single Phase Inverter with HD-Wave Technology for North America


SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US SE3800H-U	S SE5000H-US S	E6000H-US SI	E7600H-US SE10000H-US SE11400H-	JS	
ADDITIONAL FEATURES	,		,	'		
Supported Communication Interfaces		RS485, Ethernet, Zig	Bee (optional), Cellu	lar (optional)		
Revenue Grade Metering, ANSI C12.20						
Consumption metering	Optional ⁽³⁾					
Inverter Commissioning	With the Se	tApp mobile application us	sing Built-in Wi-Fi Acc	cess Point for Local Connection		
Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect					
STANDARD COMPLIANCE						
Safety	UL1741	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.I.L. M-07				
Grid Connection Standards		IEEE1547, Rule 21, Rule 14 (HI)				
Emissions	FCC Part 15 Class B					
INSTALLATION SPECIFICAT	IONS					
AC Output Conduit Size / AWG Range		1" Maximum / 14-6 AWG		1" Maximum /14-4 AWG		
DC Input Conduit Size / # of Strings / AWG Range	1" Maximum / 1-2 strings / 14-6 AWG 1" Maximum / 1-3 strings / 14-6 AW				VG	
Dimensions with Safety Switch (HxWxD)	17.7	17.7 x 14.6 x 6.8 / 450 x 370 x 174 21.3 x 14.6 x 7.3 / 540 x 370 x 185			in/mm	
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.	9 38.8 / 17.6	lb / kg	
Noise	< 25			<50	dBA	
Cooling	Natural Convection					
Operating Temperature Range	-40 to +140 / -40 to +60 ⁽⁴⁾				°F/°C	
Protection Rating	NEMA 4X (Inverter with Safety Switch)					

⁽³⁾ Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BNI4 . For consumption metering, current transformers should be ordered separately. SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box

How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

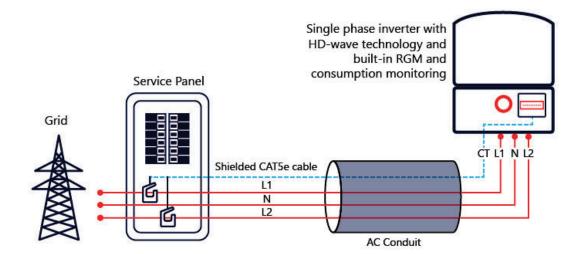



⁽⁴⁾ Full power up to at least 50°C / 122°F; for power de-rating information refer to: https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf

pe.eaton.com

Eaton general duty non-fusible safety switch

DG222URB

UPC:782113144238

Dimensions:

Height: 14.38 INLength: 7.38 INWidth: 8.69 IN

Weight:9 LB

Notes:WARNING! Switch is not approved for service entrance unless a neutral kit is installed.

Warranties:

• Eaton Selling Policy 25-000, one (1) year from the date of installation of the Product or eighteen (18) months from the date of shipment of the Product, whichever occurs first.

Specifications:

• Type: Non-fusible, single-throw

• Amperage Rating: 60A

• Enclosure: NEMA 3R, Rainproof

• Enclosure Material: Painted galvanized steel

• Fuse Configuration: Non-fusible

• Number Of Poles: Two-pole

• Number Of Wires: Two-wire

• Product Category: General duty safety switch

• Voltage Rating: 240V

Supporting documents:

- Eatons Volume 2-Commercial Distribution
- Eaton Specification Sheet DG222URB

Certifications:

UL Listed

Product compliance: No Data



© 2016 Eaton. All rights reserved.

SFM INFINITY



Take your business to the next level with **SFM** INFINITY, UNIRAC's rail-less PV mounting system for flush mount installations on comp shingle and tile roofs. An advanced 3rd generation product platform in use by top solar contractors nationwide, **SFM** INFINITY optimizes your operations on and off the roof, with approximately 40% less labor, 30% logistics savings, and 20% fewer roof attachments than traditional solar racking. Plus, 87% of homeowners prefer **SFM** INFINITY's aesthetics.



Enhance your business with two installs per day and 30% less cost.

Pre-assembled components, 20% fewer roof attachments, and level array in seconds with post height adjustment.

achments, Mor

More than 4 out of 5 homeowners prefer **SFM** INFINITY'S aesthetics over a leading rail brand.

SFM INFINITY


DESIGN GUIDELINES




While you will see advantages simply from switching to **SFM** INFINITY, the following guidelines will help you to maximize its benefits.

DEFAULT TO LANDSCAPE

When possible, design in landscape orientation in order to fit more modules on the roof and minimize roof attachments.





MIX MODULE ORIENTATIONS

SFM INFINITY is easily configured in mixed array shapes and module orientations to maximize array density and to avoid vent pipes and other obstacles. Because mounting locations are not constrained by rails, **SFM** INFINITY has unmatched flexibility to enhance your projects.

CONSULT THE QUICK TIPS VIDEOS

Visit UNIRAC's mobile-friendly library of short, topic-specific videos which answer common questions and demonstrate how simple it is to install **SFM** INFINITY.







DESIGN IN U-BUILDER

Layout your arrays in **U-Builder**, UNIRAC's free solar design software, to optimize **SFM** INFINITY'S capabilities, including mixing module orientations and minimizing roof attachments. Quickly create layouts on Google or Bing Maps and generate project documents.

U-Builder: https://design.unirac.com/

REVOLUTIONIZING ROOFTOP SOLAR

FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR CALL (505) 248-2702

REVOLUTIONIZING ROOFTOP SOLAR

FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR CALL (505) 248-2702








COMPLETE RAIL-LESS RACKING SYSTEM

The RockIt system is the industry's premier rail-less PV racking system for composition shingle, tile, and metal roofs. Designed in conjunction with the needs of installers, RockIt quickly & easily installs with a single tool. Featuring an easy-to-position alignment slide and a top-down leveling system, RockIt is logistically intelligent with no need to ship or transport long rails. Components are available in a black finish that complements both commercial and residential applications. Conforms to UL 2703.

FEATURES & BENEFITS

- Patented watertight technology
- Fully integrated bonding
- · Top-down leveling system
- · North-South adjustability
- Single tool install

STREAMLINED INSTALLATION WITH MINIMAL ROOF PENETRATIONS

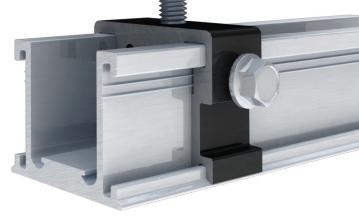



Composition Shingle, Tile, Metal



Rail-Less



Structural-Attach Direct-Attach





ECOFASTENSOLAR.COM



COUPLING

The fast installing RockIt Coupling easily attaches to the module frame to bridge the gaps between modules.

SKIRT

The sleek black Skirt installs first and acts as an alignment guide for the entire array. The Skirt End Cap does double duty as a skirt coupling device and an aesthetically-pleasing finishing touch.



Featuring integrated bonding pins, the Rocklt Mount connects to the Slide and can easily be positioned for fast installation. Features topdown leveling.

ROCKIT SLIDE

Available in three variations, the RockIt Slide allows installation on composition shingle, tile, and metal roofs.

FRAME MLPE MOUNT

Attaches and fully bonds MLPE's (Module Level Power Electronics) to the module frame with a single bolt clip.



 Report No. 102393982LAX-002
 Page 2 of 107
 Issued: 11-Apr-2016

 Unirac, Inc
 Revised: 20-Mar-2019

2.0 Product De	scription
Product	Photovoltaic Mounting System, Sun Frame Microrail - Installed Using Unirac Installation Guide, Rev PUB2019MAR01 with Annex North Row Extension Installation Guide Rev PUB2019FEB20
Brand name	Unirac
Description	The product covered by this report is the Sun Frame Micro Rail roof mounted Photovoltaic Rack Mounting System. This system is designed to provide bonding and grounding to photovoltaic modules. The mounting system employs anodized or mill finish aluminum brackets that are roof mounted using the slider, outlined in section 4 of this report. There are no rails within this product, whereas the 3" Micro Rail, Floating Splice, and 9" Attached Splice electrically bond the modules together forming the path to ground. The Micro Rails are installed onto the module frame by using a stainless steel bolt anodized with black oxide with a stainless type 300 bonding pin, torqued to 20 ft-lbs, retaining the modules to the bracket. The bonding pin of the Micro Rail when bolted and torqued, penetrate the anodized coating of the photovoltaic module frame to contact the metal, creating a bonded connection from module to module.
	The grounding of the entire system is intended to be in accordance with the latest edition of the National Electrical Code, including NEC 250: Grounding and Bonding, and NEC 690: Solar Photovoltaic Systems. Any local electrical codes must be adhered in addition to the national electrical codes. The Grounding Lug is secured to the photovoltaic module, torqued in accordance with the installation manual provided in this document. Other optional grounding includes the use of the Enphase UL2703 certified grounding system, which requires a minimum of 2 micro-inverters mounted to the same rail, and using the same engage cable.
Models	Unirac SFM

 Report No. 102393982LAX-002
 Page 3 of 107
 Issued: 11-Apr-2016

 Unirac, Inc
 Revised: 20-Mar-2019

2.0 Product Des	
Model Similarity	NA
	Fuse Rating: 30A
	Module Orientation: Portrait or Landscape Maximum Module Size: 17.98 ft²
	UL2703 Design Load Rating: 33 PSF Downward, 33 PSF Upward, 10 PSF Down-Slope Tested Loads - 50 psf/2400Pa Downward, 50psf/2400Pa Uplift, 15psf/720Pa Down Slope Trina TSM-255PD05.08 and Sunpower SPR-E20-327 used for Mechanical Loading
	Increased size ML test: Maximum Module Size: 22.3 ft²
	UL2703 Design Load Rating: 113 PSF Downward, 50 PSF Upward, 30 PSF Down-Slope LG355S2W-A5 used for Mechanical Loading test.
	Mounting configuration: Four mountings on each long side of panel with the longest span of 24"
Ratings	UL2703 Design Load Rating: 46.9 PSF Downward, 40 PSF Upward, 10 PSF Down-Slope LG395N2W-A5, LG360S2W-A5 and LG355S2W-A5 used for used for Mechanical Loading test.
	Mounting configuration: Six mountings for two modules used with the maximum span of 74.5"
	Fire Class Resistance Rating: - Class A for Steep Slope Applications when using Type 1 Modules. Can be installed at any interstitial gap. Installations must include Trim Rail.
	- Class A for Steep Slope Applications when using Type 2 Modules. Can be installed at any interstitial gap. Installations must include Trim Rail.
	- Class A Fire Rated for Low Slope applications with Type 1 or 2 listed photovoltaic modules. This system was evaluated with a 5" gap between the bottom of the module and the roof's surface
	See section 7.0 illustraction # 1 and 1a for a complete list of PV modules evaluated with these racking systems
Other Ratings	NA

ED 16.3.15 (20-Apr-17) Mandatory



Address:

Country:

AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Applicant: Unirac, Inc Manufacturer: Cixi Emeka Aluminum Co. Ltd

> No. 688 ChaoSheng Road 1411 Broadway Blvd NE

Address: Cixi City Albuquerque, NM 87102 Zhejiang Province 315311

Country:

USA China

Klaus Nicolaedis Jia Liu Contact: Contact: Tom Young Robin Luo

505-462-2190 +86-15267030962 Phone: Phone: 505-843-1418 +86-13621785753

FAX: FAX: klaus.nicolaedis@unirac.com

jia.liu@cxymj.com Email: toddg@unirac.com Email: buwan.luo@cxymj.com

Party Authorized To Apply Mark: Same as Manufacturer **Report Issuing Office:** Lake Forest, CA U.S.A.

Control Number: *5003705* Authorized by:



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

> Intertek Testing Services NA Inc. 545 East Algonquin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Standard(s): Plate Photovoltaic Modules and Panels [UL 2703: 2015 Ed.1] Photovoltaic Mounting System, Sun Frame Microrail - Installed Using Unirac Installation Guide, Rev **Product:** PUB2019MAR01 with Annex North Row Extension Installation Guide Rev PUB2019FEB20 Brand Name: Unirac Unirac SFM Models:

Page 1 of 1

ATM for Report 102393982LAX-002

ATM Issued: 9-Apr-2019 ED 16.3.15 (20-Apr-17) Mandatory



January 14, 2021

Unirac 1411 Broadway Blvd. NE Albuquerque, NM 87102

Attn.: Unirac - Engineering Department

Re: Engineering Certification for the Unirac Sunframe Microrail, SFM Infinity U-builder Software Version 1.0

PZSE, Inc. - Structural Engineers has reviewed the Unirac's Sunframe Microrail, proprietary mounting system constructed from modular parts which is intended for rooftop installation of solar photovoltaic (PV) panels; and has reviewed the U-builder Online tool. This U-Builder software includes analysis for the 2" Microrail, 8" Attached Splice, 6" splice, and front trimrail. All information, data and analysis contained within are based on, and comply with the following codes and typical specifications:

- 1. Minimum Design Loads for Buildings and other Structures, ASCE/SEI 7-05, ASCE/SEI 7-10, ASCE/SEI 7-16
- 2. 2006-2018 International Building Code, by International Code Council, Inc. w/ Provisions from SEAOC PV-2 2017.
- 3. 2006-2018 International Residential Code, by International Code Council, Inc. w/ Provisions from SEAOC PV-2 2017.
- 4. AC428, Acceptance Criteria for Modular Framing Systems Used to Support Photovoltaic (PV) Panels, November 1, 2012 by ICC-ES.

Following are typical specifications to meet the above code requirements:

Design Criteria: Ground Snow Load = 0 - 100 (psf)

Basic Wind Speed = 90 - 180 (mph) Roof Mean Height = 0 - 60 (ft) Roof Pitch = 0 - 45 (degrees) Exposure Category = B, C & D

Attachment Spacing: Per U-builder Engineering report.

Cantilever: Maximum cantilever length is L/3, where "L" is the span noted in the U-Builder online

tool.

Clearance: 2" to 10" clear from top of roof to top of PV panel.

Tolerance(s): 1.0" tolerance for any specified dimension in this report is allowed for installation.

Installation Orientation: See SFM Installation Guide.

Landscape - PV Panel long dimension is parallel to ridge/eave line of roof and the PV

panel is mounted on the long side.

Portrait - PV Panel short dimension is parallel to ridge/eave line of roof and the PV panel

is mounted on the short side.

Attachment shall be staggered where ground snow load exceeds 10 PSF.



Testing: Values were based on UTR-299 testing provided by Unirac.

Components and Cladding Roof Zones:

The Components and Cladding Roof Zones shall be determined based on ASCE 7-05, ASCE 7-10 & 7-16 Component and Cladding design.

Notes:

- 1) U-builder Online tool analysis is only for Unirac SFM Sunframe Microrail system only and do not include roof capacity check.
- 2) Risk Category II per ASCE 7-16.
- 3) Topographic factor, kzt is 1.0.
- 4) Array Edge Factor $Y_E = 1.5$
- 5) Average parapet height is 0.0 ft.
- 6) Wind speeds are LRFD values.
- 7) Attachment spacing(s) apply to a seismic design category E or less.

Design Responsibility:

The U-Builder design software is intended to be used under the responsible charge of a registered design professional where required by the authority having jurisdiction. In all cases, this U-builder software should be used under the direction of a design professional with sufficient structural engineering knowledge and experience to be able to:

- Evaluate whether the U-Builder Software is applicable to the project, and
- Understand and determine the appropriate values for all input parameters of the U-Builder software.

This letter certifies that the Unirac SFM Sunframe Microrail, when installed according to the U-Builder engineering report and the manufacture specifications, is in compliance with the above codes and loading criteria.

This certification excludes evaluation of the following components:

- 1) The structure to support the loads imposed on the building by the array; including, but not limited to: strength and deflection of structural framing members, fastening and/or strength of roofing materials, and/or the effects of snow accumulation on the structure.
- 2) The attachment of the SFM 2" Microrail or 8" Attached Splice to the existing structure.
- 3) The capacity of the solar module frame to resist the loads.

This requires additional knowledge of the building and is outside the scope of the certification of this racking system.

If you have any questions on the above, do not hesitate to call.

Prepared by:

PZSE, Inc. – Structural Engineers Roseville, CA **DIGITAL SIGNATURE**