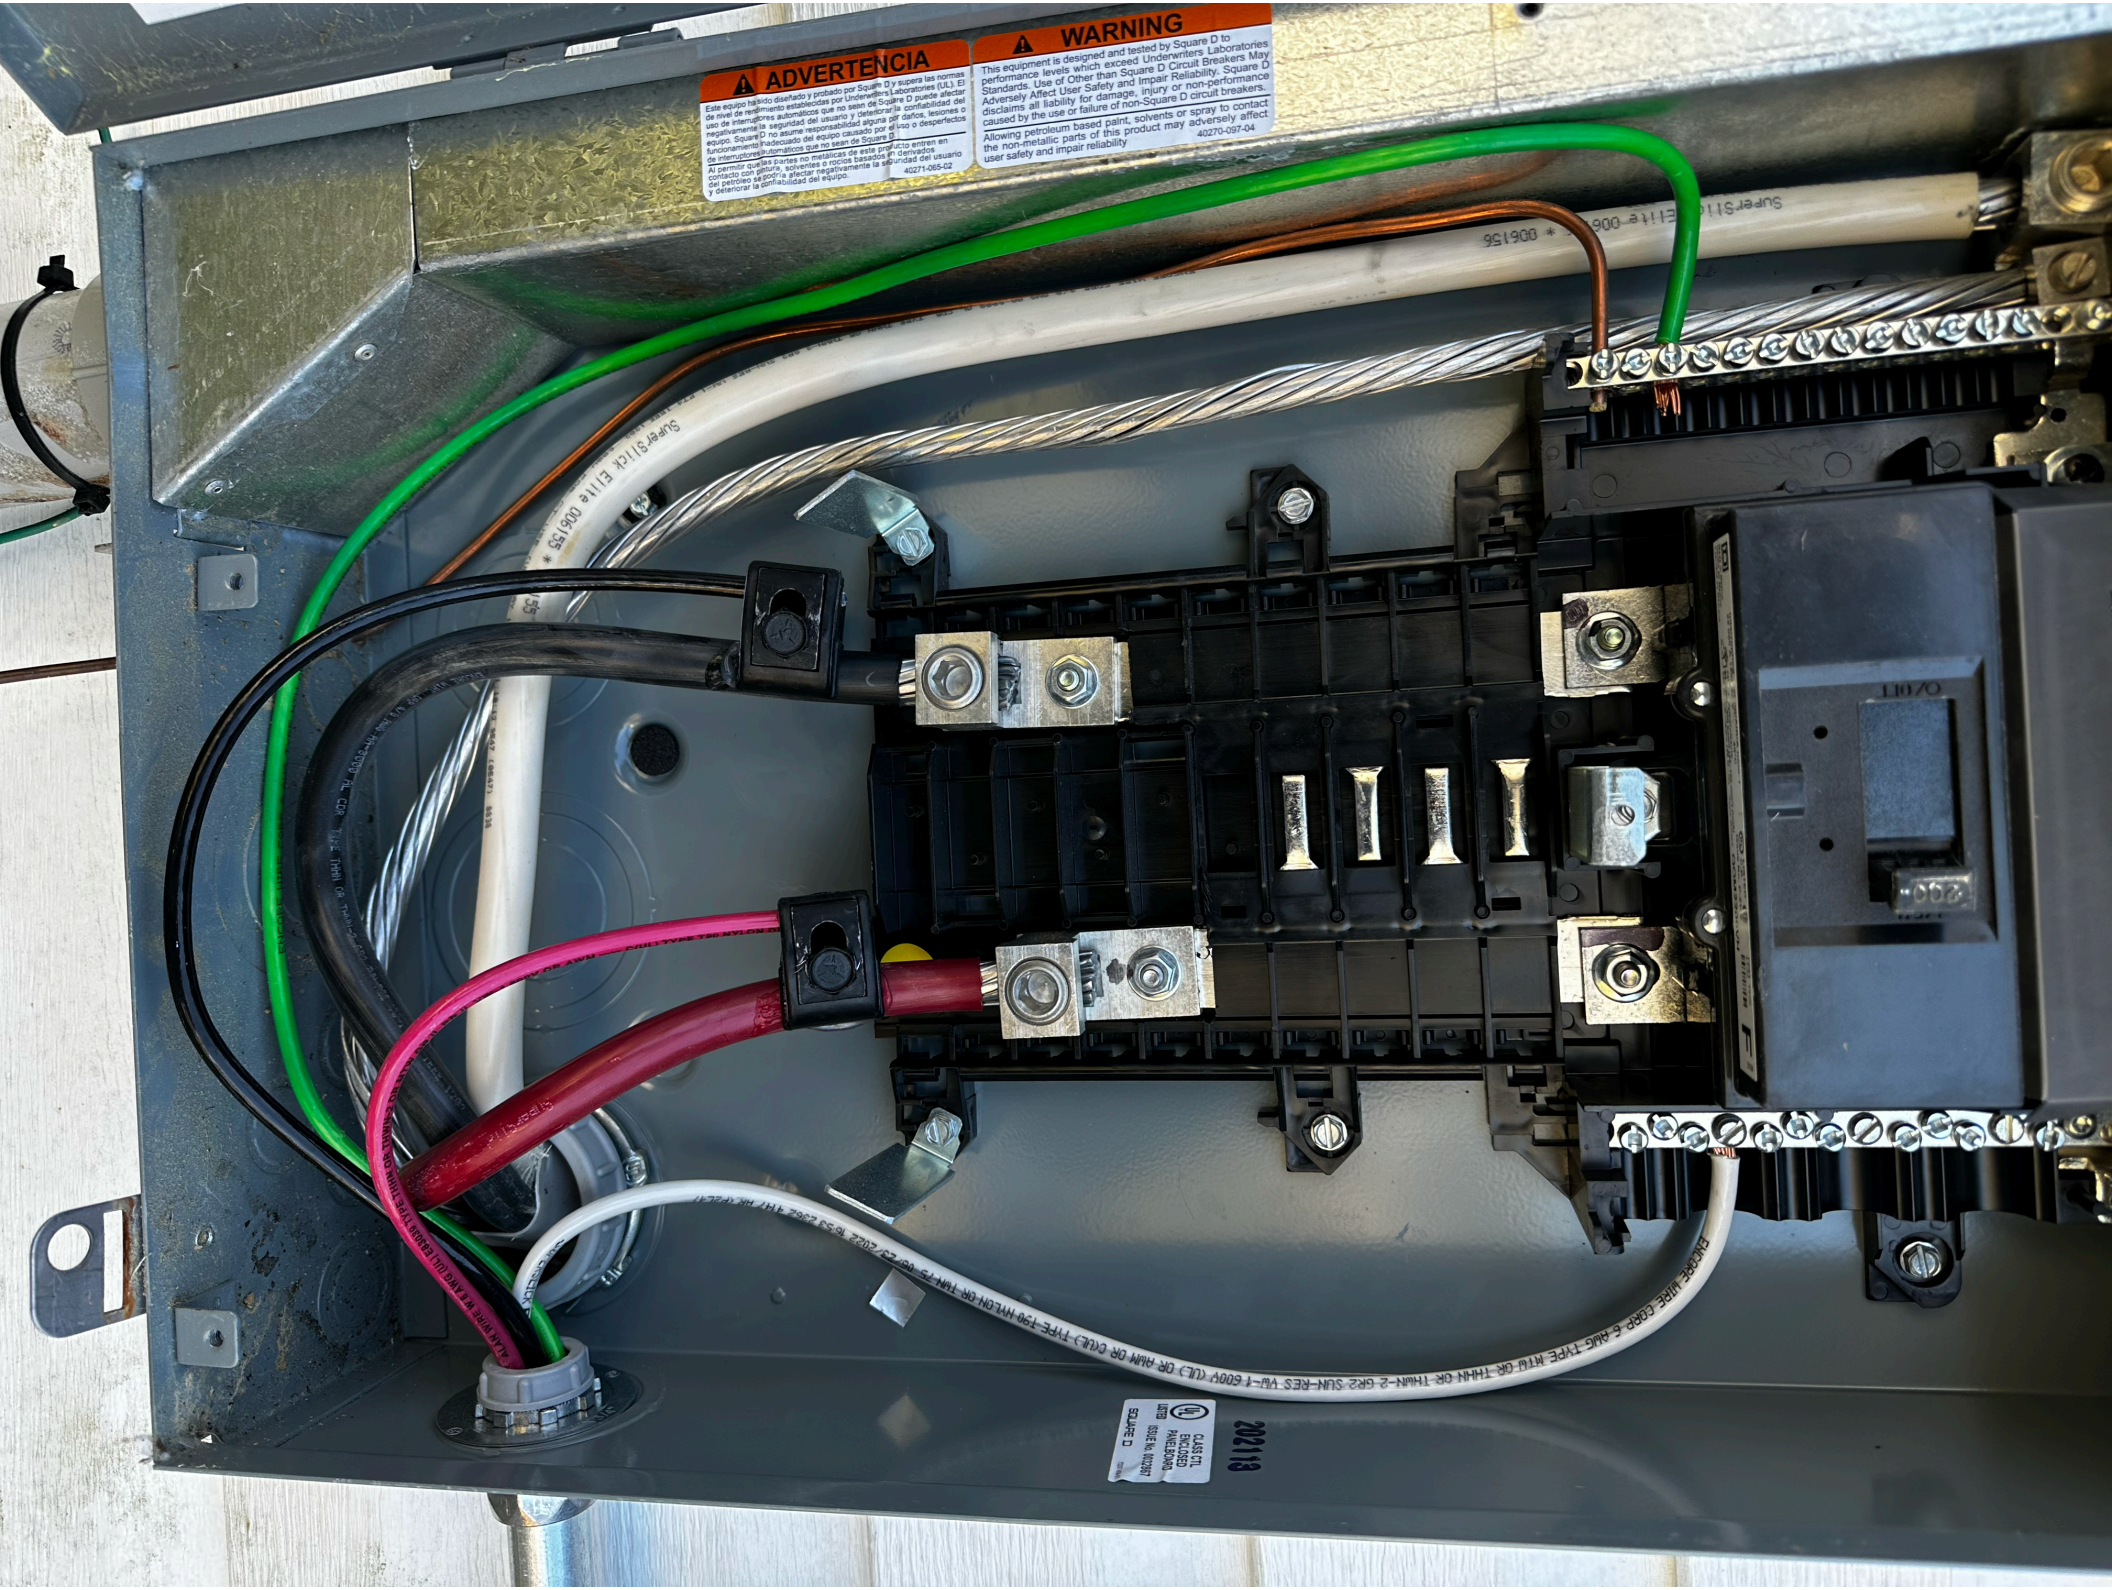
ADVERTENCIA
Este equipo ha sido diseñado y probado por Square D y supera las normas de nivel de rendimiento establecidas por Underwriters Laboratories (UL). El uso de interruptores automáticos que no sean de Square D puede afectar negativamente la seguridad del usuario y deteriorar la confiabilidad del equipo. Square D no asume responsabilidad alguna por daños, lesiones o funcionamiento inadecuado del equipo causado por el uso o desperfectos de interruptores automáticos que no sean de Square D.
Al permitir que las partes no metálicas de este producto entren en contacto con pintura, solventes o rocíos basados en derivados del petróleo se podría afectar negativamente la seguridad del usuario y deteriorar la confiabilidad del equipo.
40271-065-02
WARNING
This equipment is designed and tested by Square D to performance levels which exceed Underwriters Laboratories Standards. Use of Other than Square D Circuit Breakers May Adversely Affect User Safety and Impair Reliability. Square D disclaims all liability for damage, injury or non-performance caused by the use or failure of non-Square D circuit breakers.
Allowing petroleum based paint, solvents or spray to contact the non-metallic parts of this product may adversely affect user safety and impair reliability
40270-097-04
202113
CLASS CTL
ENCLOSED
PANELBOARD
ISSUE No. 002967
SQUARE D