






▲ WARNING / ADVERTENCIA



▲ DANGER

READ ALL INSTRUCTIONS CAREFULLY BEFORE USING THIS EQUIPMENT. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN SERIOUS INJURY OR DEATH. ALWAYS UNPLUG THE EQUIPMENT FROM THE WALL OUTLET BEFORE ATTEMPTING TO SERVICER. ALWAYS WEAR PROTECTIVE EYEWEAR WHEN SERVICING THIS EQUIPMENT. ALWAYS USE THE PROPER TOOLS AND TECHNIQUES TO SERVICER THIS EQUIPMENT. ALWAYS USE THE PROPER SAFETY PROCEDURES TO SERVICER THIS EQUIPMENT. ALWAYS USE THE PROPER SAFETY PROCEDURES TO SERVICER THIS EQUIPMENT.

HOMELINE® LOAD CENTER COVER / CUBIERTA DEL CENTRO DE CARGA HOMELINES®
 CAT. NO. HOMC40JC
 SERIES 51
 TYPE I ENCLOSURE

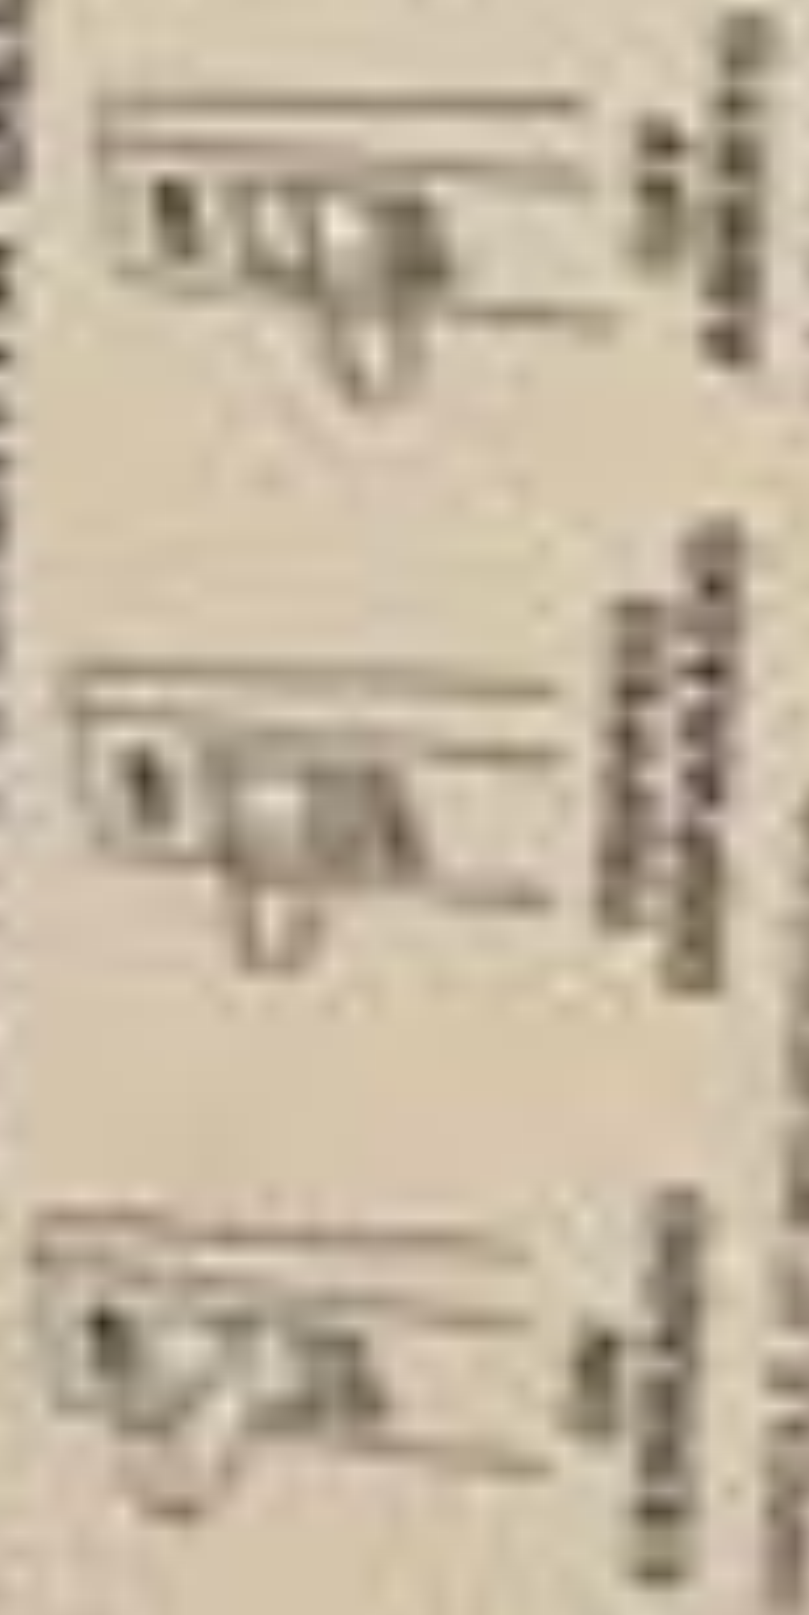

TOP COVER

REMOVE SCREWS FROM TOP COVER

REMOVE TOP COVER



Underwriters Laboratories Inc.

LISTED FOR USE WITH THE FOLLOWING DEVICES:
 1. 20 AMPERE CIRCUIT BREAKERS
 2. 20 AMPERE FUSES

FOR INFORMATION ONLY:
 CONNECTIONS FROM THE SUPPLY CONDUCTORS TO THE LOADS SHOULD BE MADE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND THE LOCAL ELECTRICAL CODES.

MAIN RATING: 200 AMPERE
 CAPACITANCE: 1.1 μF
 TYPE: A

SCHEMATIC COMPANY

MADE IN U.S.A. 15 40385-031-01

1	LIGHTS	
3	Refrigerator	
5	Washer	
7	Water heater	
9	Vacuums	
11	Garment steamer	
13	TV	
15	W.P.	
		2
		4
		6
		8
		10
		12

PARA SERVICIOS DE REPARACION, LEYER EL MANUAL DE INSTRUCCIONES QUE SE ENCUENTRA EN LA PARTE TRASERA DEL EQUIPO.

AL SERVICIAR ESTE EQUIPO, SIEMPRE USE OJOS PROTECTORES. SIEMPRE USE LAS HERRAMIENTAS CORRECTAS PARA SERVICIAR ESTE EQUIPO. SIEMPRE USE LOS PROCEDIMIENTOS DE SEGURIDAD CORRECTOS PARA SERVICIAR ESTE EQUIPO.

REMOVE SCREWS FROM TOP COVER. REMOVE TOP COVER. ALWAYS USE THE PROPER SAFETY PROCEDURES TO SERVICER THIS EQUIPMENT.

REMOVED FROM THE ORIGINAL LISTING FOR USE WITH THE FOLLOWING DEVICES:
 1. 20 AMPERE CIRCUIT BREAKERS
 2. 20 AMPERE FUSES

REMOVE SCREWS FROM TOP COVER. REMOVE TOP COVER. ALWAYS USE THE PROPER SAFETY PROCEDURES TO SERVICER THIS EQUIPMENT.

MAIN RATING: 200 AMPERE
 CAPACITANCE: 1.1 μF
 TYPE: A

SCHEMATIC COMPANY

MADE IN U.S.A. 15 40385-031-01

REMOVED FROM THE ORIGINAL LISTING FOR USE WITH THE FOLLOWING DEVICES:
 1. 20 AMPERE CIRCUIT BREAKERS
 2. 20 AMPERE FUSES



E22010

GUL

250 KCMIL

GOMI

C ALLOY









