























Cedric Namon

Dr. Tripoli Dr. Cameron, MD

2 stops

2 stops



























| | | |
|--|--|--|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |


















PLEASE RECYCLE

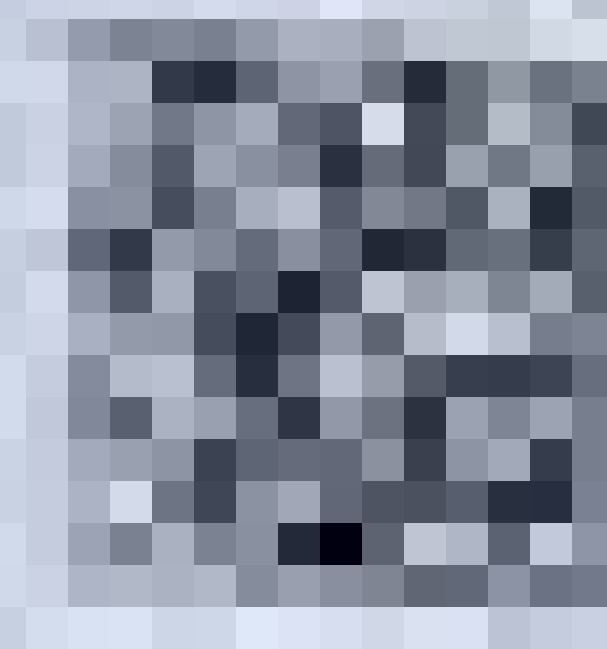

CLASS B DIGITAL DEVICE

FCC

STATE ELECTRONICS TECHNOLOGY
TECHNOLOGY CORPORATION

FOR INFORMATION ONLY
THIS DEVICE DOES NOT EXCEED THE
FEDERAL COMMUNICATIONS COMMISSION'S (FCC) CLASS B DIGITAL DEVICE
LIMITS FOR RADIO INTERFERENCE.

CAUTION

DO NOT OPERATE THIS DEVICE FROM
ANY LOCATION OTHER THAN THE
LOCATION LISTED ON THE LABEL. TO
PREVENT FIRE OR ELECTRIC SHOCK,
DO NOT EXPOSE TO RAIN OR
MOISTURE. COVER THE DEVICE WITH
A PROTECTIVE COVER WHEN NOT IN
USE. THIS DEVICE IS NOT TO BE
OPERATED IN THE VICINITY OF
FLAMMABLE ANESTHETICS OR
FLAMMABLE GASES.

WARNING

DO NOT OPERATE THIS DEVICE FROM
ANY LOCATION OTHER THAN THE
LOCATION LISTED ON THE LABEL. TO
PREVENT FIRE OR ELECTRIC SHOCK,
DO NOT EXPOSE TO RAIN OR
MOISTURE. COVER THE DEVICE WITH
A PROTECTIVE COVER WHEN NOT IN
USE. THIS DEVICE IS NOT TO BE
OPERATED IN THE VICINITY OF
FLAMMABLE ANESTHETICS OR
FLAMMABLE GASES.





























-0.15

COM

VΩ









North - West

South - East























OFF


2000 Counts
1000 Hz Digital Frequency Meter

-0.15

MODE

FUNCTION

UNIT

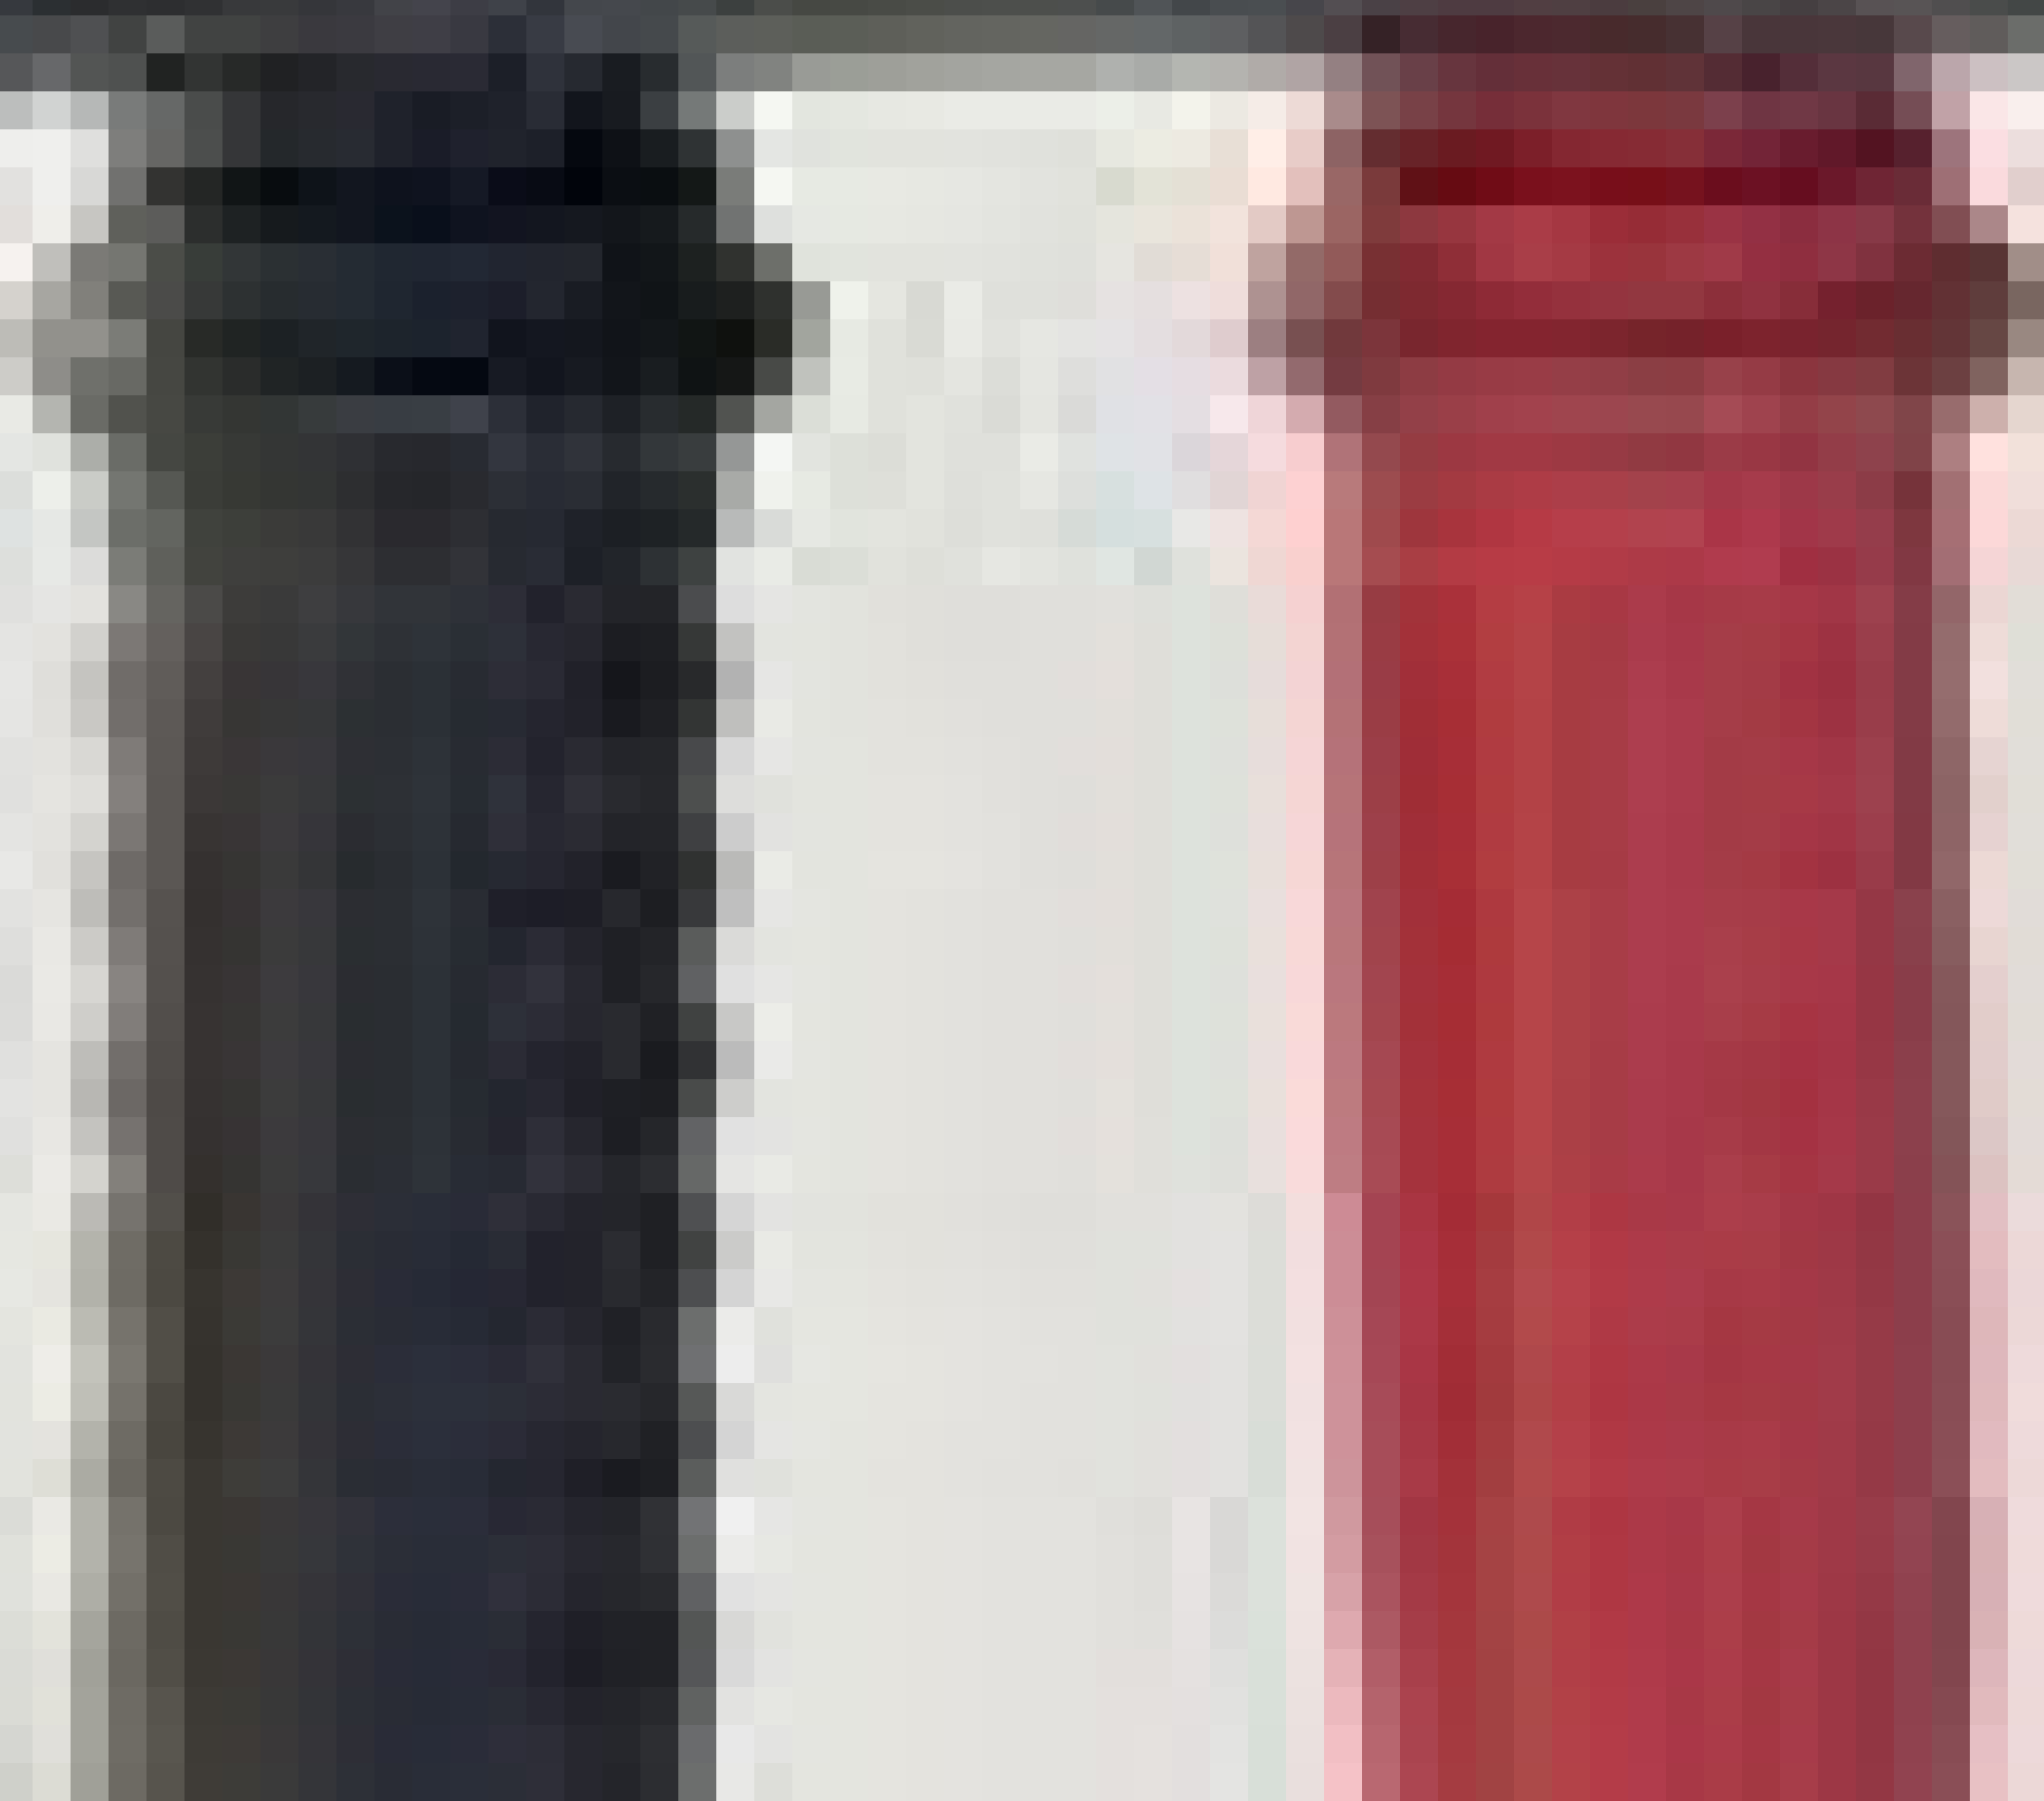





































| | | | | | | | | | | |
|--|--|--|--|--|--|--|--|--|--|--|
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |

2001
2002
2003
2004
2005





























21
22

20th - 21st

22





