

SCOPE OF WORK

TO INSTALL A ROOF MOUNTED SOLAR PHOTOVOLTAIC SYSTEM AT THE OWNER RESIDENCE LOCATED AT 185 SHERWOOD HILLS CT, CAMERON, NC 28326, USA. THE POWER GENERATED BY THE PV SYSTEM WILL BE INTERCONNECTED WITH THE UTILITY GRID THROUGH THE EXISTING ELECTRICAL SERVICE EQUIPMENT. THE PV SYSTEM DOES NOT INCLUDE STORAGE BATTERIES.

EQUIPMENT SUMMARY

- 15 HYPERION SOLAR HY-DH108P8 (400W) MODULES
- 1 SOLAREEDGE SE5000H-US [240V] INVERTER
- 15 SOLAREEDGE POWER OPTIMIZER P505

GENERAL NOTES

- THESE CONSTRUCTION DOCUMENTS HAVE BEEN BASED ON FIELD INSPECTIONS AND OTHER INFORMATION AVAILABLE AT THE TIME. ACTUAL FIELD CONDITIONS MAY REQUIRE MODIFICATIONS IN CONSTRUCTION DETAILS.
- ARCHITECT HAS NOT BEEN RETAINED TO SUPERVISE ANY CONSTRUCTION OR INSTALLATION OF ANY EQUIPMENT AT SITE.
- CONTRACTOR SHALL FURNISH ALL LABOR, MATERIAL, EQUIPMENT, TOOLS, OBTAINS ALL PERMITS, LICENSES AND PAY ALL REQUIRED FEES AND COMPLETE INSTALLATION.
- CONTRACTOR HAS THE FULL RESPONSIBILITY TO CHECK AND VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. ANY WORK STARTED BEFORE CONSULTATION AND ACCEPTANCE BY THE ENGINEER SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE SUBJECT TO CORRECTION BY THEM WITHOUT ADDITIONAL COMPENSATION.
- DAMAGE CAUSED TO THE EXISTING STRUCTURE, PIPES, DUCTS, WINDOWS, WALL, FLOORS, ETC. SHALL BE REPAIRED TO THE ORIGINAL CONDITION OR REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST.
- THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR THE PROPER INSTALLATION AND COMPLETION OF THE WORK WITH APPROVED MATERIALS.
- NO CHANGES ARE TO BE MADE WITHOUT THE CONSULTATION AND APPROVAL OF THE ARCHITECT.
- CONTRACTOR SHALL OBTAIN BULDING PERMIT. NO WORK TO START UNLESS BUILDING PERMIT IS PROPERLY DISPLAYED.
- ALL WORKMANSHIP AND MATERIALS SHALL BE OF FIRST QUALITY AND IN COMPLIANCE WITH THE REQUIREMENTS OF THE NATIONAL BUILDING CODE, THE DEPARTMENT OF ENVIRONMENTAL PROTECTION AND ALL PERTINENT AGENCIES.
- IT IS ESSENTIAL THAT ALL WORK PROCEED WITH THE MAXIMUM COOPERATION OF ALL PARTIES AND WITH MINIMUM INTERFERENCE TO THE OCCUPANTS WITHIN THE BUILDING. THE OWNER'S DIRECTIONS IN THIS REGARD SHALL BE FULLY COMPLIED WITH.
- ALL EXPOSED PLUMBING, HVAC, ELECTRICAL DUCTWORK, PIPING AND CONDUITS ARE TO BE PAINTED BY GENERAL CONTRACTOR.
- THE CONTRACTOR SHALL PERFORM THE WORK IN STRICT CONFORMANCE WITH THE LOCAL LAWS, REGULATIONS AND THE NATIONAL ELECTRIC CODE.
- THE CONTRACTOR SHALL OBTAIN ALL PERMITS, APPROVALS, AFFIDAVITS, CERTIFICATIONS, ETC. AND PAY ALL FEES AS REQUIRED BY THE LOCAL AUTHORITIES.
- CONTRACTORS SHALL OBTAIN FIRE CERTIF. UPON COMPLETION OF WORK.

ELECTRICAL NOTES

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT.
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURERS INSTRUCTION.
- MODULE SUPPORT RAIL SHALL BE BONDED TO THE MODULE

GOVERNING CODES

- 2018 NORTH CAROLINA FIRE CODE
- 2018 NORTH CAROLINA BUILDING CODE
- 2018 NORTH CAROLINA RESIDENTIAL CODE
- 2018 NORTH CAROLINA ENERGY CONSERVATION CODE
- 2018 NORTH CAROLINA EXISTING BUILDING CODE
- 2018 NORTH CAROLINA SWIMMING POOL AND SPA CODE
- 2017 NORTH CAROLINA ELECTRICAL CODE

AHJ NAME : HARNETT COUNTY

WIRING AND CONDUIT NOTES

- ALL CONDUIT SIZES AND TYPES SHALL BE LISTED FOR ITS PURPOSE AND APPROVAL FOR THE SITE APPLICATIONS
- ALL PV CABLES AND HOMERUN WIRES BE #10AWG *USE-2, PV WIRE, OR PROPRIETARY SOLAR CABLING SPECIFIED BY MFR, OR EQUIVALENT; ROUTED TO SOURCE CIRCUIT COMBINER BOXES AS REQUIRED
- ALL PV DC CONDUCTORS IN CONDUIT EXPOSED TO SUNLIGHT SHALL BE DERATED ACCORDING TO AS PER LATEST NEC CODE.
- EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP EDGES
- PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 1000V AS PER APPLICABLE NEC
- 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS
- ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION
- VOLTAGE DROP LIMITED TO 2%
- AC CONDUCTORS >4AWG COLOR CODED OR MARKED: PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE, NEUTRAL- WHITE/GRAY

SYSTEM RATING
6.000 kWDC
5.000 kWAC


PHOTOVOLTAIC SYSTEM FIRE CLASSIFICATION LISTING IN ACCORDANCE WITH UL 1703 STANDARD.

SHEET INDEX	
PV1	COVER PAGE
PV2	SITE PLAN
PV3	ROOF PLAN
PV4	STRING LAYOUT & BOM
PV5-PV6	ATTACHMENT DETAILS
PV7-PV8	ELECTRICAL LINE & CALCS.
PV9	SPECIFICATIONS & NOTES
PV10-PV11	SIGNAGE
PV12	JOB SAFETY PLAN
PV13-PV19	EQUIPMENT SPECIFICATIONS



HOUSE PHOTO

SCALE: NTS

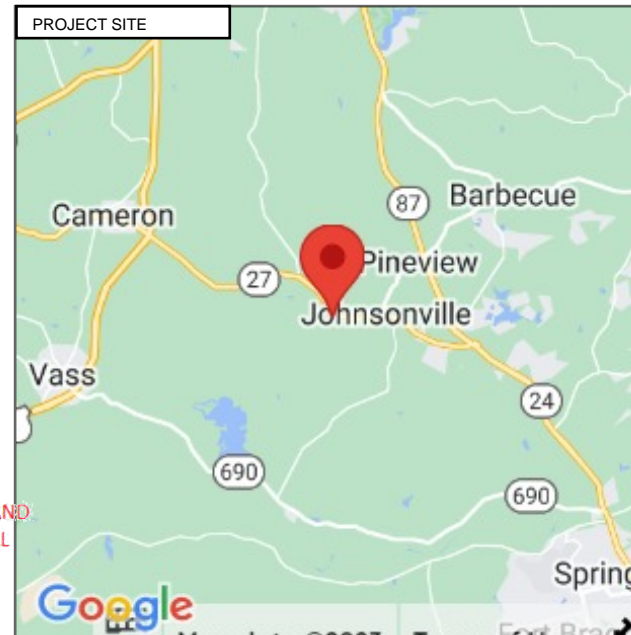

VICINITY MAP

SCALE: NTS



Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
North Carolina COA # P-2308
Signed 4/10/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

NOTICE TO CONTRACTOR
All construction must comply with current NC Building Codes and is subject to field inspection and verification.

APPROVED
Limited building only review
Permit holder responsible for full compliance with the code

04/17/2023



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR HY-DH108P8 (400W)

(1) SOLAREEDGE SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
COVER PAGE

SHEET SIZE
ANSI B
11" X 17"


SHEET NUMBER
PV-1

SITE NOTES

- A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS AN UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION [NEC 110.26]

LEGEND

- JB (N) JUNCTION BOX
- UM (E) UTILITY METER
- MSP (E) MAIN SERVICE PANEL
- AC (N) NON FUSED AC DISCONNECT
- VENT, ATTIC FAN (ROOF OBSTRUCTION)
- ROOF ATTACHMENT
- CONDUIT
- P505 OPTIMIZER
- INV SOLAREEDGE SE5000H-US [240V] INVERTER
- HYPERION SOLAR HY-DH108P8 (400W) MODULES
- K2 CROSSRAIL 44-X
- TRENCH

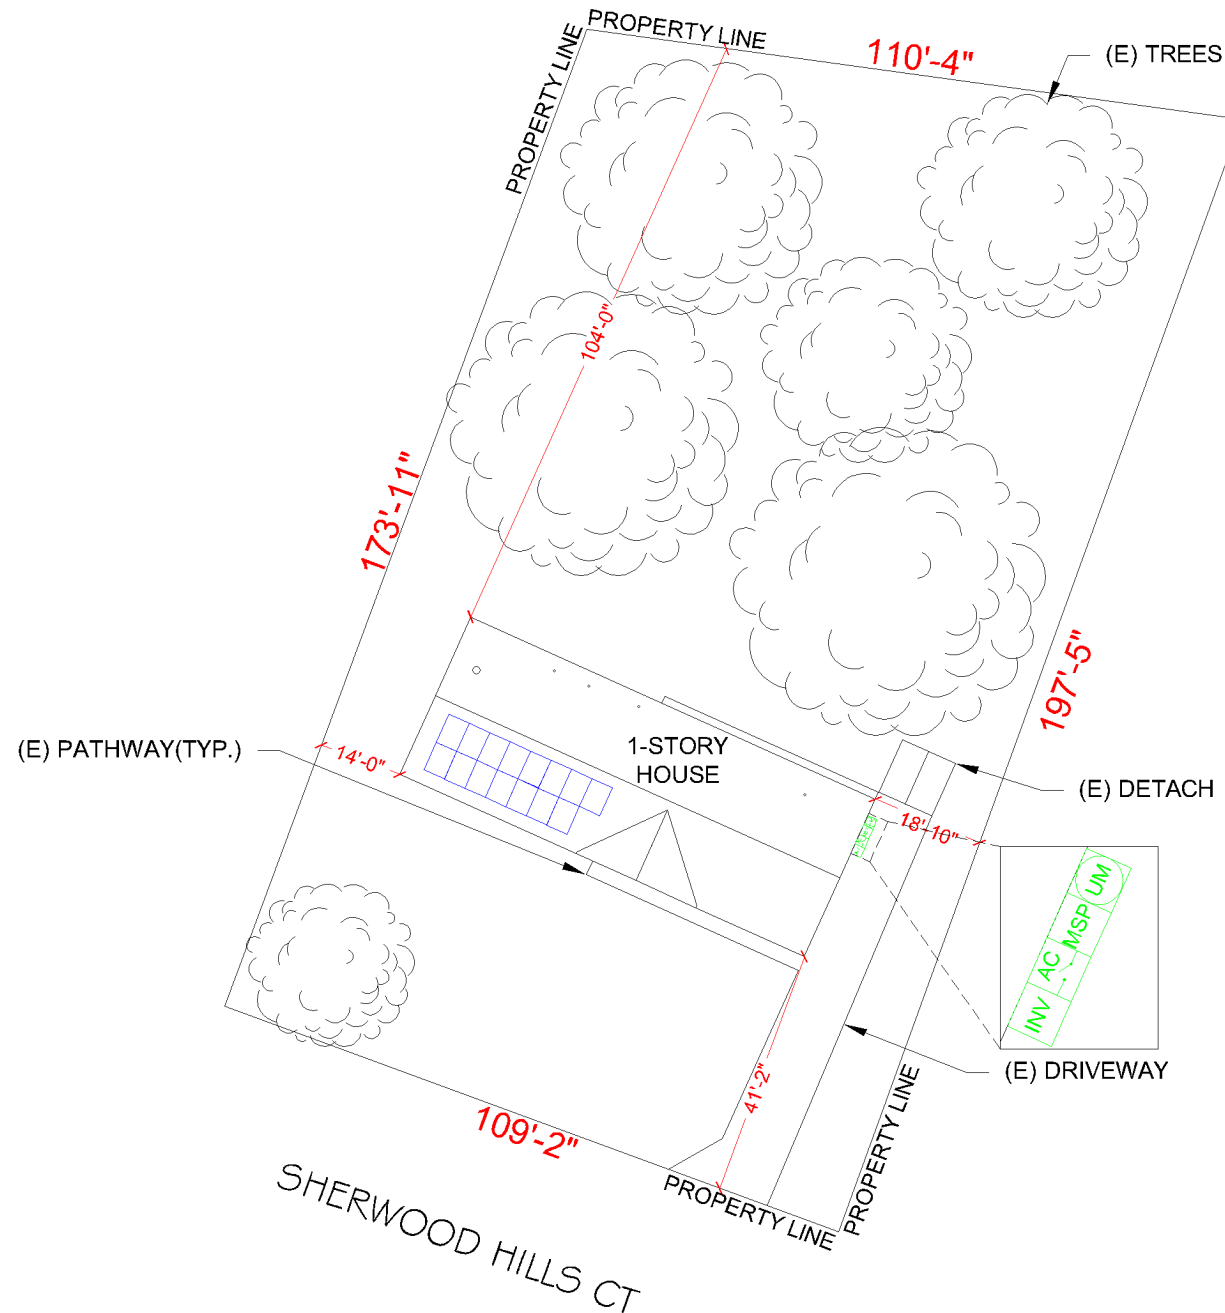

Wyssling Consulting, PLLC
 76 N Meadowbrook Drive Alpine UT 84004
 North Carolina COA # P-2308
 Signed 4/10/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO

- (15) HYPERION SOLAR HY-DH108P8 (400W)
- (1) SOLAREEDGE SE5000H-US [240V]
- DC SYSTEM SIZE: 6.000 kWDC
- AC SYSTEM SIZE: 5.000 kWAC
- METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
SITE PLAN

SHEET SIZE
**ANSI B
 11" X 17"**

SHEET NUMBER
PV-2

METER NO#: 162 809 049



SCALE: 1/32" = 1'-0

DESIGN SPECIFICATION	
RISK CATEGORY:	II
CONSTRUCTION:	SFD
ZONING:	RESIDENTIAL
SNOW LOAD (ASCE7-10):	15 PSF
EXPOSURE CATEGORY:	C
WIND SPEED (ASCE7-10):	119 MPH

MODULE TYPE, DIMENSIONS & WEIGHT	
NUMBER OF MODULES:	15 MODULES
MODULE TYPE:	HYPERION SOLAR HY-DH108P8 (400W)
MODULE WEIGHT:	55.5 LBS
MODULE DIMENSIONS:	67.08" X 44.65" = 20.80 SF
UNIT WEIGHT OF AREA:	2.67 PSF

ROOF DESCRIPTION					
ROOF	ROOF TILT	AZIMUTH	RAFTER SIZE	RAFTER SPACING	ROOF MATERIAL
#1	26°	204°	2" x 6"	24" o.c.	COMP SHINGLE


ARRAY AREA & ROOF AREA CALC'S		
ROOF #	# OF MODULES	ARRAY AREA (Sq. Ft.)
#1	15	312
(TOTAL ARRAY AREA/TOTAL ROOF AREA) X 100%		
= (312/2380) X 100% = 13.11%		

LEGEND

- JB (N) JUNCTION BOX
- UM (E) UTILITY METER
- MSP (E) MAIN SERVICE PANEL
- AC (N) NON FUSED AC DISCONNECT
- VENT, ATTIC FAN (ROOF OBSTRUCTION)
- ROOF ATTACHMENT
- CONDUIT
- P505 OPTIMIZER
- INV SOLAREEDGE SE5000H-US [240V] INVERTER
- HYPERION SOLAR HY-DH108P8 (400W) MODULES
- K2 CROSSRAIL 44-X
- TRENCH

PANEL HEIGHT OFF ROOF 8"

DEAD LOAD CALCULATION			
EQUIPMENT'S DESCRIPTIONS	QTY	LBS/UNIT	TOTAL WEIGHT
MODULES	15	55.5	832.5
MID CLAMP	26	0.3	7.8
END CLAMP	8	0.31	2.48
K2 CROSSRAIL 44-X	9	10	90.00
SPLICE BAR	6	0.65	3.91
SPLICE FOOT X	32	0.9	28.80
K2 SOLAR SEAL BUTYL PAD	32	0.42	13.44
M5 X 60 LAG SCREWS	64	0.08	5.12
T BOLT AND HEX NUT SET	32	0.05	1.60
TOTAL WEIGHT OF THE SYSTEM (LBS)			985.65
TOTAL ARRAY AREA ON THE ROOF (SQ. FT.)			312
WEIGHT PER SQ. FT. (LBS)			3.16
WEIGHT PER PENETRATION (LBS)			6.17

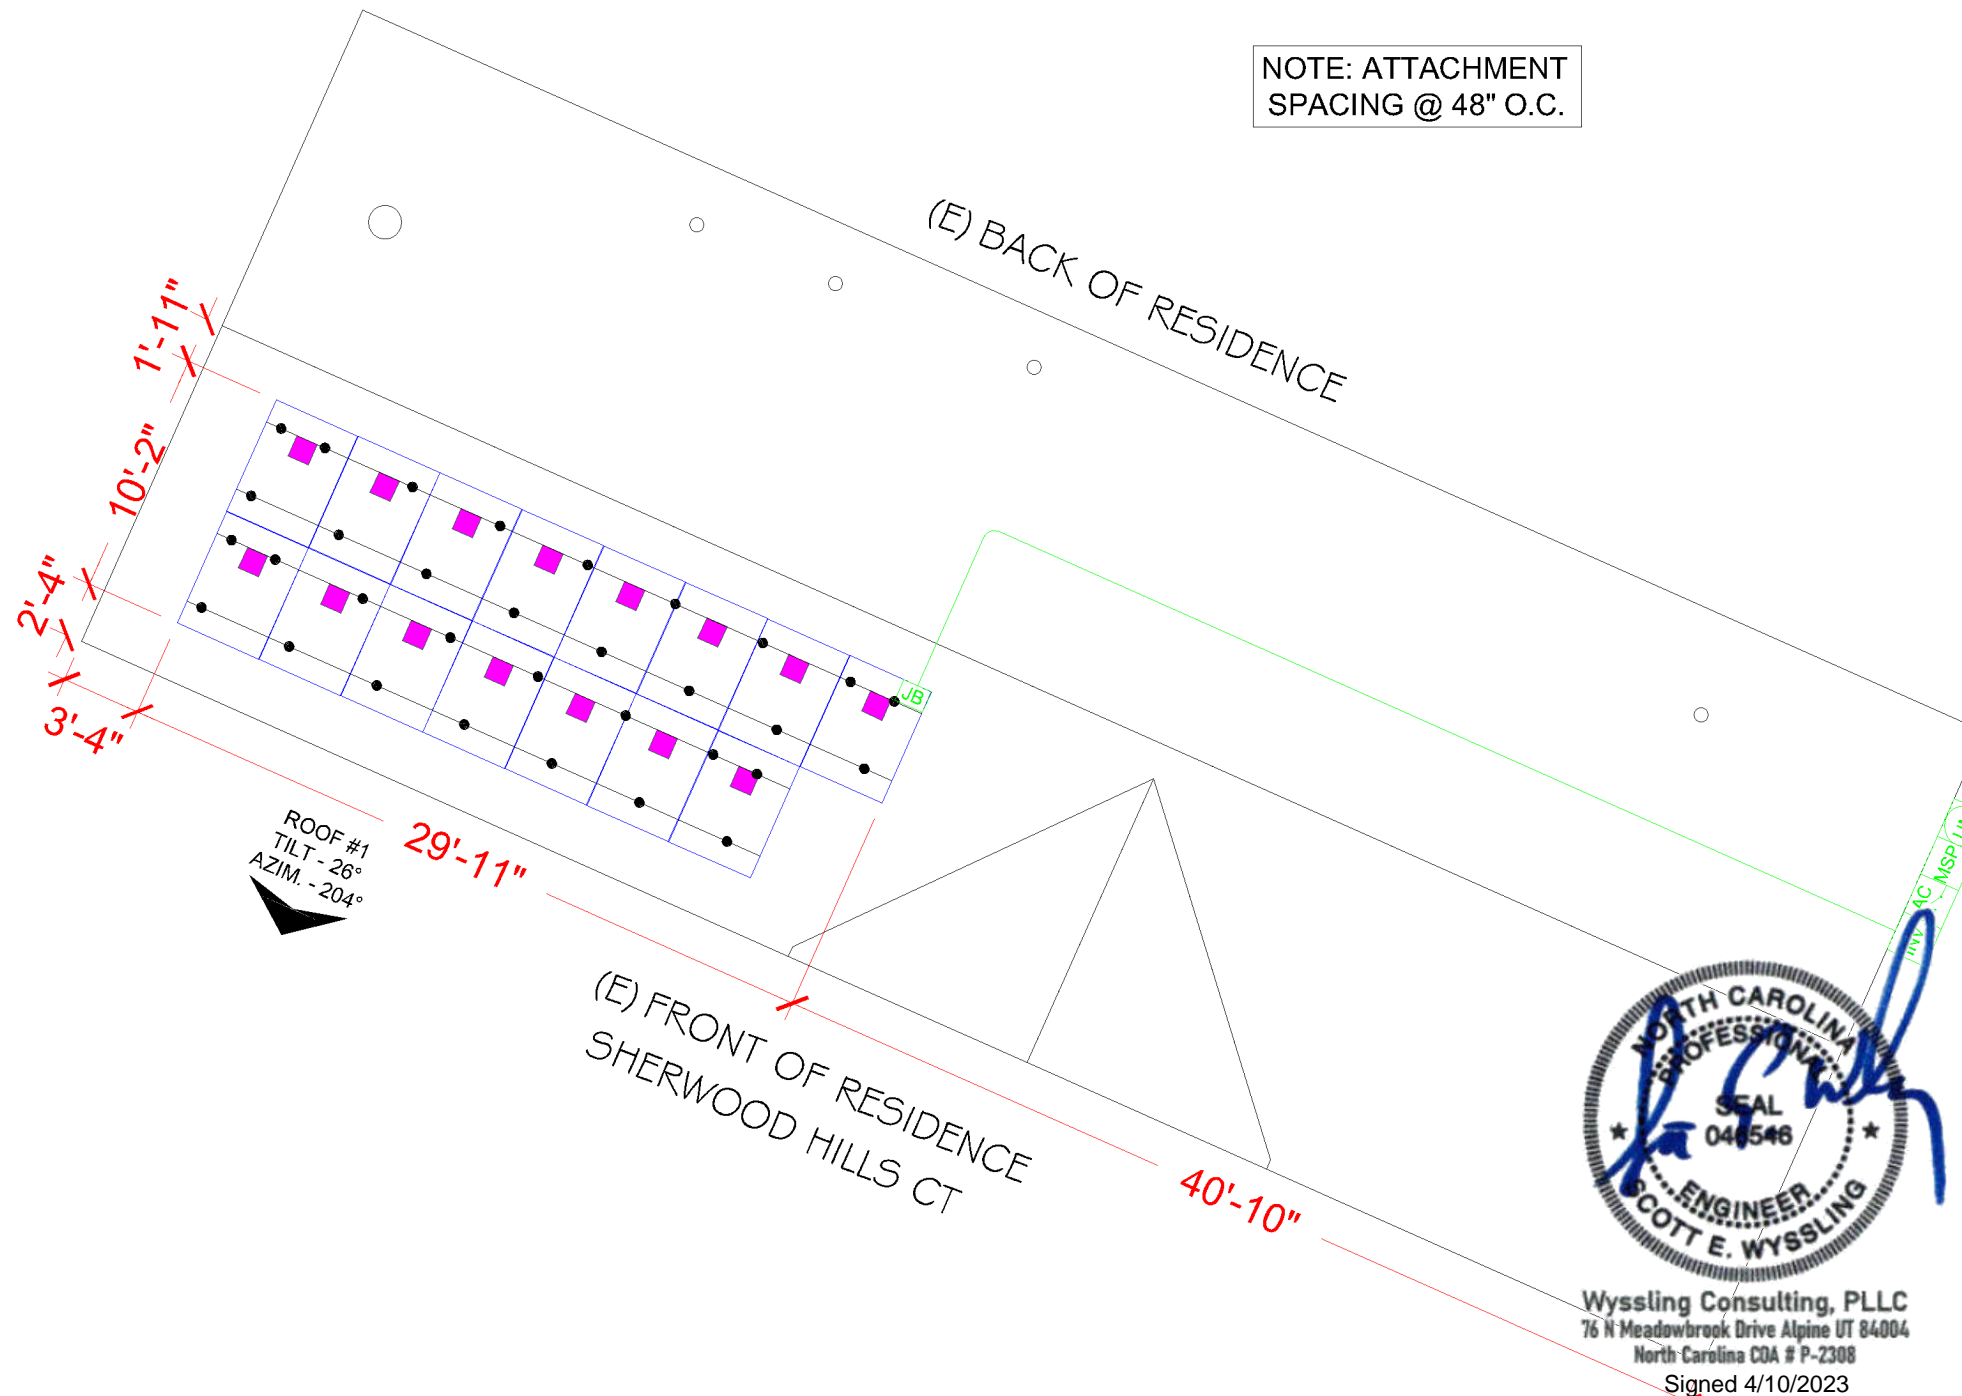

NOTE: ATTACHMENT SPACING @ 48" O.C.



Wysling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
North Carolina COA # P-2308
Signed 4/10/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



SCALE: 1/8" = 1'-0"

METER NO#: 162 809 049



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO
(15) HYPERION SOLAR HY-DH108P8 (400W)
(1) SOLAREEDGE SE5000H-US [240V]
DC SYSTEM SIZE: 6.000 KWDC
AC SYSTEM SIZE: 5.000 KWAC
METER: 162 809 049

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023
SHEET NAME ROOF PLAN
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-3

BILL OF MATERIALS

EQUIPMENT	QTY	DESCRIPTION
SOLAR PV MODULE	15	HYPERION SOLAR HY-DH108P8 (400W)
INVERTER	1	SOLAREEDGE SE5000H-US [240V]
OPTIMIZER	15	SOLAREEDGE POWER OPTIMIZER P505
JUNCTION BOX	1	JB-1.XL, JUNCTION BOX, NEMA 3R, UL LISTED
NON FUSED AC DISCONNECT	1	EATON DG221URB PV SYSTEM AC DISCONNECT SWITCH NON FUSED VISIBLE OPEN 30A, 120/240V 2P NEMA 3R
ATTACHMENT	32	SPLICE FOOT X
ATTACHMENT	32	K2 SOLAR SEAL BUTYL PAD
ATTACHMENT	64	M5 X 60 LAG SCREWS
ATTACHMENT	32	T BOLT AND HEX NUT SET
RAILS	9	K2 CROSSRAIL 44-X
BONDED SPLICE	6	SPLICE KIT
MID CLAMP	26	MID CLAMPS
END CLAMP	8	END CLAMPS
GROUNDING LUG	2	GROUNDING LUG



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
 HY-DH108P8 (400W)

(1) SOLAREEDGE
 SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 KWDC

AC SYSTEM SIZE: 5.000 KWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME

**STRING LAYOUT
 & BOM**


SHEET SIZE

**ANSI B
 11" X 17"**

SHEET NUMBER

PV-4

(E) BACK OF RESIDENCE

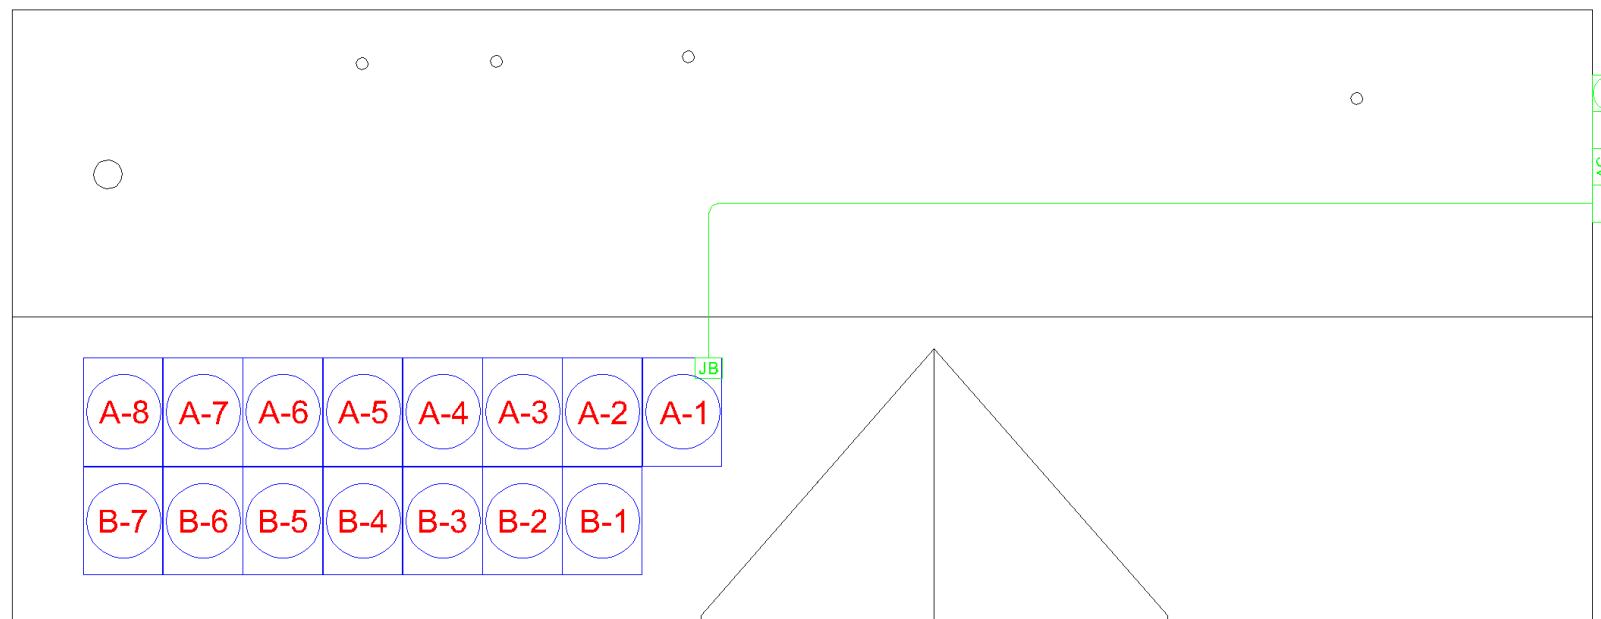

(E) FRONT OF RESIDENCE
 SHERWOOD HILLS CT





SCALE: 1/16" = 1'-0"



- MODULE STRINGING



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

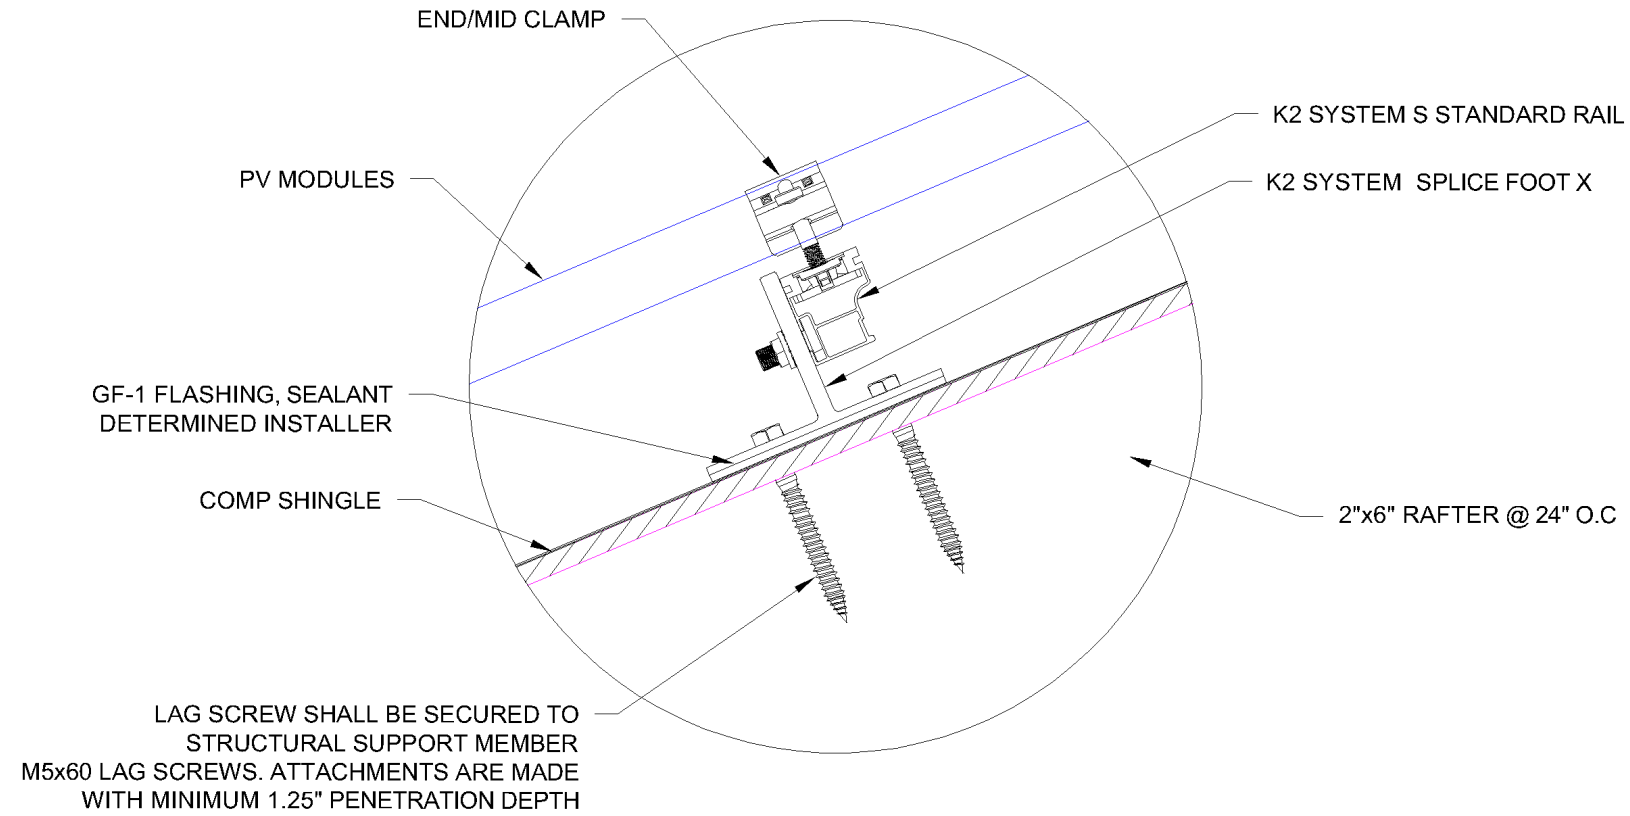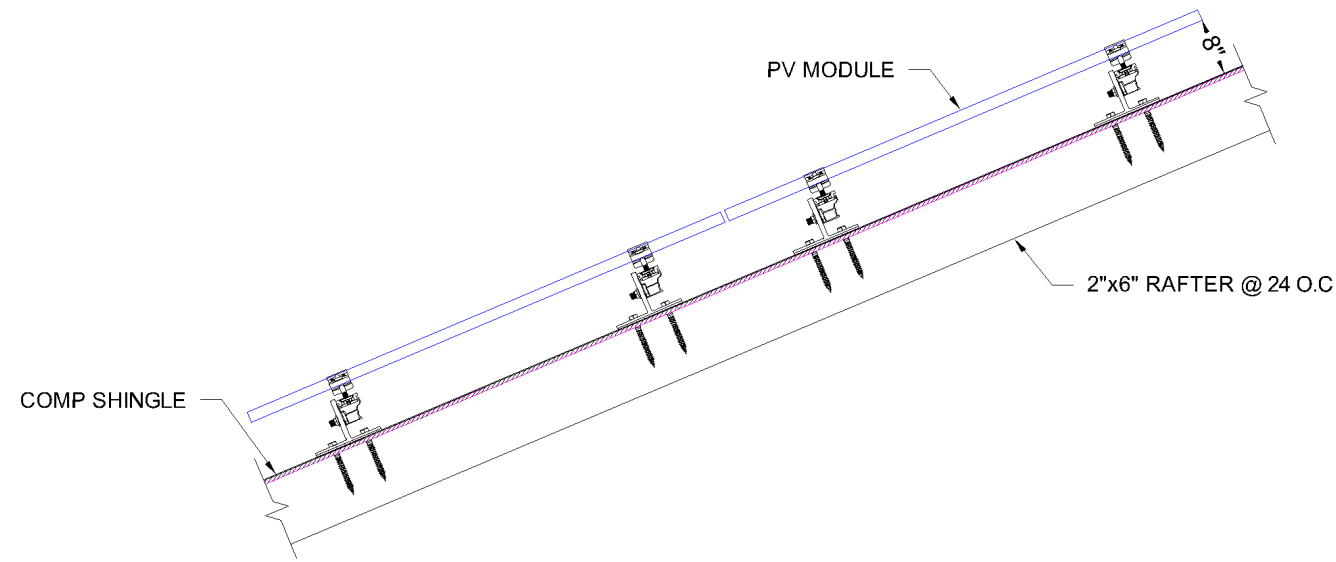

Wyssling Consulting, PLLC
 76 N Meadowbrook Drive Alpine UT 84004
 North Carolina COA # P-2308
 Signed 4/10/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SYSTEM INFO

(15) HYPERION SOLAR
 HY-DH108P8 (400W)

(1) SOLAREEDGE
 SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME

ATTACHMENT
 DETAILS

SHEET SIZE

ANSI B
 11" X 17"

SHEET NUMBER

PV-5



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO
(15) HYPERION SOLAR HY-DH108P8 (400W)
(1) SOLAREGE SE5000H-US (240V)
DC SYSTEM SIZE: 6.000 KWDC
AC SYSTEM SIZE: 5.000 KWAC
METER: 162 809 049

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
**ATTACHMENT
DETAILS**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-6

NOTE:
PROPRIETARY GEOMETRIES
HAVE BEEN REMOVED.
GENERAL LENGTH, WIDTH,
AND HEIGHT GEOMETRIES
WERE NOT ALTERED.

CROSSRAIL


M10 BONDING T-BOLT

M10 HEX NUT


RAIL CONNECTOR

CR 80 RAIL
CONNECTOR
REQUIRES 4 T-BOLTS


RAIL CONNECTOR ASSEMBLIES




44-X



48-X



48-XL



80



Wysling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
North Carolina COA # P-2308


Signed 4/10/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND
SEALED BY SCOTT WYSSLING, PE USING A DIGITAL
SIGNATURE AND DATE. PRINTED COPIES OF THIS
DOCUMENT ARE NOT CONSIDERED SIGNED AND
SEALED AND THE SIGNATURE MUST BE VERIFIED
ON ANY ELECTRONIC COPIES

REVISION HISTORY

Revision	Date	Description
01		
02		
03		
04		
05		

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF
EVEREST SOLAR SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE
WITHOUT THE WRITTEN PERMISSION OF EVEREST SOLAR SYSTEMS IS PROHIBITED.



Everest Solar Systems, LLC.
a division of K2 Systems International
2835 La Mirada Dr Suite A
Viso, CA 92081
phone 760.301.5300



	Name	Date
Drawn	I. VIGGINS	07/29/2020
Checked	R. HAGEN	08/07/2020
Approved	I. VIGGINS	08/07/2020
Last Revision		

This drawing is the sole property of Everest Solar Systems. It is protected by copyright and may only be copied, reproduced or distributed to a third party with explicit permission.

CROSSRAIL RAIL
CONNECTOR ASSEMBLIES


Scale: 1:1	Revision: 00	# of Dimensions are in: 0
Sheet 2 of 2		



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

ID	TYPICAL	INITIAL CONDUCTOR LOCATION	FINAL CONDUCTOR LOCATION	CONDUCTOR			CONDUIT	# OF PARALLEL CIRCUITS	CURRENT-CARRYING CONDUCTORS IN CIRCUIT	CONDUIT FILL PERCENT	OC PD	EGC		TEMP. CORR. FACTOR		CONDUIT FILL FACTOR	CONT. CURRENT	MAX. CURRENT	BASE AMP.	DERATED AMP.	TERM. TEMP. RATING	LENGTH	VOTAGE DROP
				6 AWG	BARE COPPER	0.71						(58°C)											
1	2	ARRAY	JUNCTION BOX	10 AWG	PV WIRE	COPPER	OPEN AIR	1	2	N/A	N/A	6 AWG	BARE COPPER	0.71	(58°C)	N/A	15.00A	18.75A	N/A	N/A	75°C	29FT	0.22%
2	1	JUNCTION BOX	INVERTER	10 AWG	THWN 2	COPPER	MIN 0.75" DIA EMT	2	4	21.76%	N/A	8 AWG	THWN-2 COPPER	0.91	(36°C)	0.8	15.00A	18.75A	40A	29.12A	75°C	60FT	0.47%
3	1	INVERTER	NON FUSED AC DISCONNECT	10 AWG	THWN 2	COPPER	MIN 0.75" DIA EMT	1	3	18.01%	N/A	8 AWG	THWN-2 COPPER	0.91	(36°C)	1	21.00A	26.25A	40A	36.40A	75°C	5FT	0.11%
4	1	NON FUSED AC DISCONNECT	MSP	10 AWG	THWN 2	COPPER	MIN 0.75" DIA EMT	1	3	18.01%	30A	8 AWG	THWN-2 COPPER	0.91	(36°C)	1	21.00A	26.25A	40A	36.40A	75°C	5FT	0.11%

15 HYPERION SOLAR HY-DH108P8 (400W) MODULES

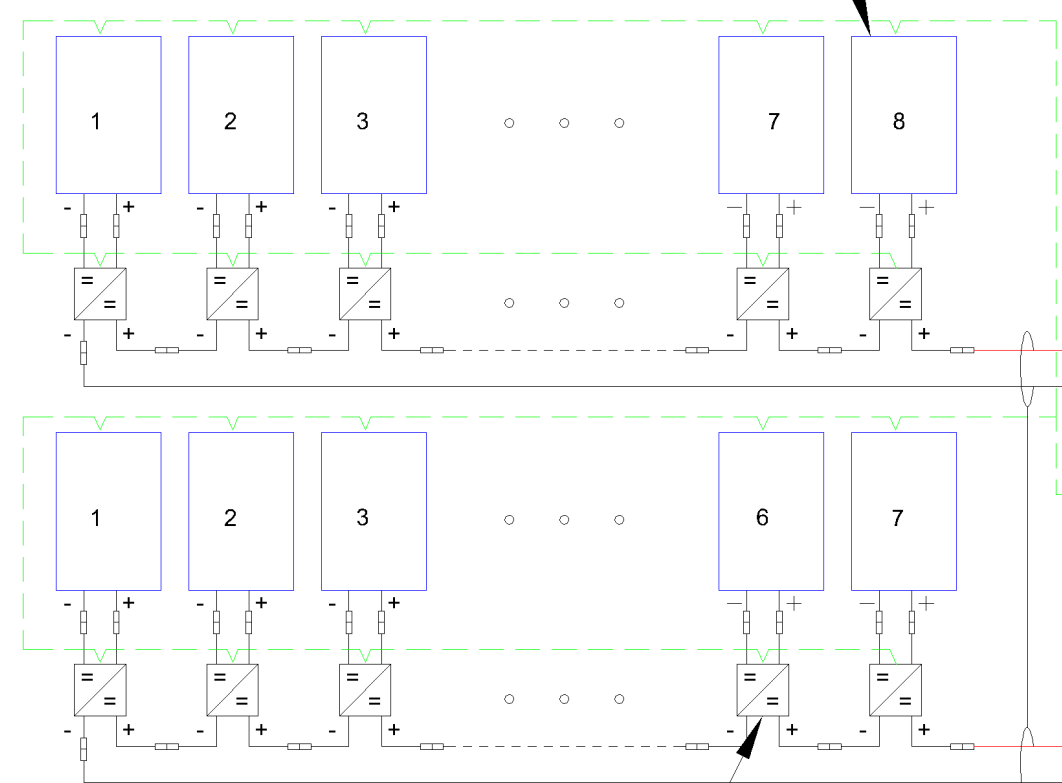

SolarEdge Power Optimizer P505 Rated
DC Input Power - 505 watts
Maximum Input Voltage - 83 Vdc
MPPT Range - 12.5 to 83 Vdc
Maximum Input Current - 14 Adc
Maximum Output Current - 15 Adc String
Limitations - 6 to 25 Optimizers,
5700 watts STC per string maximum

(N) SOLAREEDGE SE5000H-US
OUTPUT: 240 VAC, 21A
99% CEC WEIGHTED EFFICIENCY
NEMA 3R, UL LISTED, INTERNAL GFDI
WITH INTEGRATED DC DISCONNECT
SOLAREEDGE RAPID SHUTDOWN KIT
IS INTEGRATED WITH INVERTER

(N) JUNCTION BOX
600V, NEMA 3R,
UL LISTED

(N) AC DISCONNECT:
EATON DG221URB
240V, 30A NON FUSED
NEMA 3R, UL LISTED

BACK FEED BREAKER AT
THE OPPOSITE END OF
THE MAIN BREAKER

TO UTILITY GRID

BI-DIRECTIONAL UTILITY
METER# 162 809 049
1-PH, 3-W, 120V/240V

(E) MAIN BREAKER TO
HOUSE 240 V, 200A/2P

(E) MAIN SERVICE
PANEL, 200A RATED,
1-PH, 3-W, 240V

EXISTING GROUND
ELECTRODE CONDUCTOR

SYSTEM RATING
6.000 kWDC
5.000 kWAC

SERVICE INFO	
UTILITY PROVIDER:	CENTRAL ELECTRIC MEMBERSHIP CORPORATION
AHJ NAME:	HARNETT COUNTY
MAIN SERVICE VOLTAGE:	240V
MAIN PANEL BRAND:	SQUARE D
MAIN SERVICE PANEL:	200 A
MAIN BREAKER RATING:	200 A
MAIN SERVICE LOCATION:	EAST
SERVICE FEED SOURCE:	UNDERGROUND

INTERCONNECTION 120% RULE - NEC 705.12(B)(2)(3)(b)
UTILITY FEED + SOLAR BACKFEED 200A + 30A = 230A
BUSS RATING X 120% 200A x 120% = 240A

METER NO#: 162 809 049

SCALE: NTS

SYSTEM INFO
(15) HYPERION SOLAR HY-DH108P8 (400W)
(1) SOLAREEDGE SE5000H-US [240V]
DC SYSTEM SIZE: 6.000 kWDC
AC SYSTEM SIZE: 5.000 kWAC
METER: 162 809 049

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
**ELECTRICAL
LINE & CALCS.**


SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-7



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH#: (808) 371-5338
 Electrical LIC#: U.33714

ID	TYPICAL	INITIAL CONDUCTOR LOCATION	FINAL CONDUCTOR LOCATION	CONDUCTOR			CONDUIT	# OF PARALLEL CIRCUITS	CURRENT-CARRYING CONDUCTORS IN CIRCUIT	CONDUIT FILL PERCENT	OCPD	EGC		TEMP. CORR. FACTOR		CONDUIT FILL FACTOR	CONT. CURRENT	MAX. CURRENT	BASE AMP.	DERATED AMP.	TERM. TEMP. RATING	LENGTH	VOTAGE DROP
				6 AWG	BARE COPPER	0.71						(58°C)	N/A	15.00A	18.75A								
1	2	ARRAY	JUNCTION BOX	10 AWG	PV WIRE	COPPER	OPEN AIR	1	2	N/A	N/A	6 AWG	BARE COPPER	0.71	(58°C)	N/A	15.00A	18.75A	N/A	N/A	75°C	29FT	0.22%
2	1	JUNCTION BOX	INVERTER	10 AWG	THWN 2	COPPER	MIN 0.75" DIA EMT	2	4	21.76%	N/A	8 AWG	THWN-2 COPPER	0.91	(36°C)	0.8	15.00A	18.75A	40A	29.12A	75°C	60FT	0.47%
3	1	INVERTER	NON FUSED AC DISCONNECT	10 AWG	THWN 2	COPPER	MIN 0.75" DIA EMT	1	3	18.01%	N/A	8 AWG	THWN-2 COPPER	0.91	(36°C)	1	21.00A	26.25A	40A	36.40A	75°C	5FT	0.11%
4	1	NON FUSED AC DISCONNECT	MSP	10 AWG	THWN 2	COPPER	MIN 0.75" DIA EMT	1	3	18.01%	30A	8 AWG	THWN-2 COPPER	0.91	(36°C)	1	21.00A	26.25A	40A	36.40A	75°C	5FT	0.11%

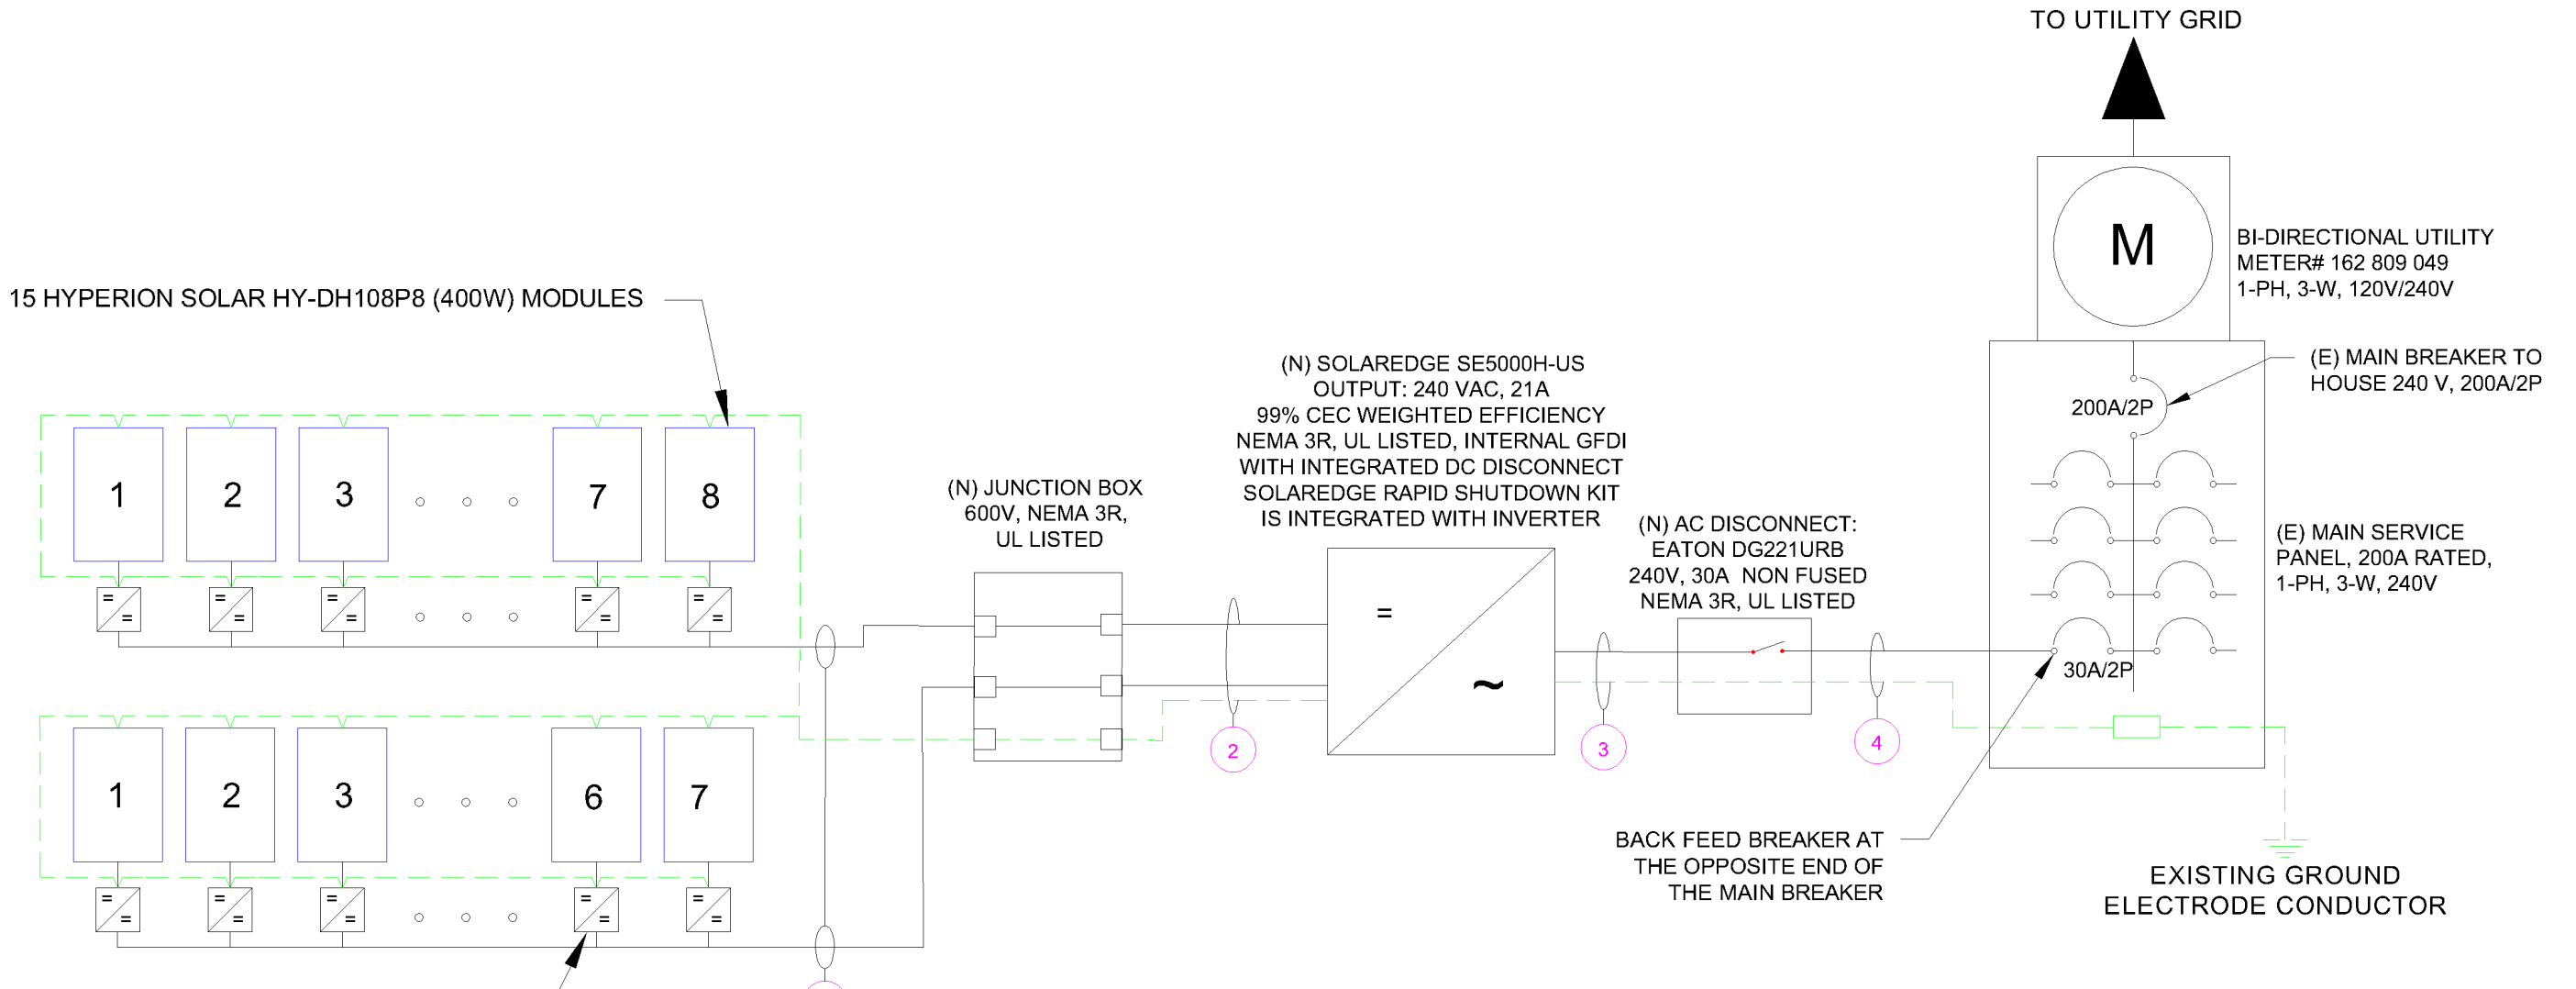

SolarEdge Power Optimizer P505 Rated
 DC Input Power - 505 watts
 Maximum Input Voltage - 83 Vdc
 MPPT Range - 12.5 to 83 Vdc
 Maximum Input Current - 14 Adc
 Maximum Output Current - 15 Adc String
 Limitations - 6 to 25 Optimizers,
 5700 watts STC per string maximum

SYSTEM RATING	
6.000 kWDC	
5.000 kWAC	

SERVICE INFO	
UTILITY PROVIDER:	CENTRAL ELECTRIC MEMBERSHIP CORPORATION
AHJ NAME:	HARNETT COUNTY
MAIN SERVICE VOLTAGE:	240V
MAIN PANEL BRAND:	SQUARE D
MAIN SERVICE PANEL:	200 A
MAIN BREAKER RATING:	200 A
MAIN SERVICE LOCATION:	EAST
SERVICE FEED SOURCE:	UNDERGROUND

INTERCONNECTION 120% RULE - NEC 705.12(B)(2)(3)(b)
UTILITY FEED + SOLAR BACKFEED 200A + 30A = 230A
BUSS RATING X 120% 200A x 120% = 240A

METER NO#: 162 809 049

SCALE: NTS

SYSTEM INFO		
(15) HYPERION SOLAR HY-DH108P8 (400W)		
(1) SOLAREEDGE SE5000H-US [240V]		
DC SYSTEM SIZE: 6.000 kWDC		
AC SYSTEM SIZE: 5.000 kWAC		
METER: 162 809 049		

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS
 LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023
SHEET NAME ELECTRICAL LINE & CALCS.
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-8

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL	Hyperion Solar HY-DH108P8 (400W)
VMP	31.01 V
IMP	12.9 A
VOC	37.07 V
ISC	13.79 A
TEMP. COEFF. VOC	-0.27%/K
PTC RATING	302.5 W
MODULE DIMENSION	67.08"(L) x 44.65"(W)
PANEL WATTAGE	400 W

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL	SOLAREEDGE SE5000H-US [240V]
NOMINAL AC POWER	5000 W
NOMINAL OUTPUT VOLTAGE	240 VAC
NOMINAL OUTPUT CURRENT	21 A

POWER OPTIMIZER (SOLAREEDGE P505)	
MAXIMUM INPUT POWER	505 W
MAXIMUM INPUT VOLTAGE	83 VDC
MAXIMUM INPUT ISC	14 ADC
MAXIMUM OUTPUT CURRENT	15 ADC
WEIGHTED EFFICIENCY	98.6%

AMBIENT TEMPERATURE SPECS	
RECORD LOW TEMP	-10°C
AMBIENT TEMP (HIGH TEMP 2%)	36°C
CONDUIT HEIGHT	7/8"
ROOF TOP TEMP	90°C
CONDUCTOR TEMPERATURE RATE	58°C
MODULE TEMPERATURE COEFFICIENT OF VOC	-0.27%/K

PERCENT OF VALUES	NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT
0.80	4-6
0.70	7-9
0.50	10-20



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO
(15) HYPERION SOLAR HY-DH108P8 (400W)
(1) SOLAREEDGE SE5000H-US [240V]
DC SYSTEM SIZE: 6.000 kWDC
AC SYSTEM SIZE: 5.000 kWAC
METER: 162 809 049

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023
SHEET NAME SPECIFICATIONS & NOTES
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-9

1 **PHOTOVOLTAIC AC DISCONNECT**
 RATED AC OUTPUT CURRENT 21 AMPS
 NOMINAL OPERATING AC VOLTAGE 240 VOLTS

LABEL LOCATION:
 MAIN SERVICE PANEL/MAIN SERVICE DISCONNECT/AC DISCONNECT
 PER CODE: NEC 690.13(B)

2 **RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM**

LABEL LOCATION:
 INVERTER AT OR WITHIN 3' OF THE DC COMBINER SWITCH
 PER CODE: NEC 690.56(C)(3)

3 **WARNING**
ELECTRIC SHOCK HAZARD
 TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION


LABEL LOCATION:
 POINT OF INTERCONNECTION, MAIN SERVICE DISCONNECT, AC DISCONNECT, AC COMBINER, INVERTER
 PER CODE: NEC 690.13(B)

4 **WARNING**
INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION:
 PLACE THIS LABEL AT P.O.C. TO SERVICE DISTRIBUTION EQUIPMENT (I.E. MAIN PANEL (AND SUBPANEL IF APPLICABLE))
 PER CODE: NEC705.12(D)(2)(b)

5 **SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN**

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



LABEL LOCATION:
 MAIN SERVICE DISCONNECT IF MSD IS OUTSIDE PLACE IT THERE / IF MSD IS INSIDE PLACE ON THE AC DISCONNECT
 PER CODE: NEC 690.56(C)(1)(a)

6 **CAUTION : SOLAR CIRCUIT**

LABEL LOCATION:
 MARKINGS PLACED ON ALL INTERIOR AND EXTERIOR CONDUIT, RACEWAYS, ENCLOSURES, AND CABLE ASSEMBLIES AT LEAST EVERY 10 FT, AT TURNS AND ABOVE/BELOW PENETRATIONS AND ALL COMBINER/JUNCTION BOXES
 PER CODE: IFC 606.11.1.4

7 **SERVICE DISCONNECT**
SECTIONNEUR PRINCIPALE
SERVICIO DE DESCONEJION

LABEL LOCATION:
 AC DISCONNECT
 2017 NEC 230.66

8 **MAXIMUM VOLTAGE 480 VDC**
MAXIMUM CIRCUIT CURRENT 13.5 ADC
MAX RATED OUTPUT CURRENT OF THE CHARGE CONTROLLER OR DC-TO-DC-CONVERTER(IF INSTALLED) 30 ADC

LABEL LOCATION:
 DIRECT-CURRENT PHOTOVOLTAIC POWER SOURCE
 PER CODE: 2017 NFPA 70, NEC 690.53

9 **WARNING**
ELECTRIC SHOCK HAZARD
THE DC CONDUCTORS OF THIS PHOTOVOLTAIC SYSTEM ARE UNGROUNDED AND MAY BE ENERGIZED

LABEL LOCATION:
 PLACE THIS LABEL AT EACH JUNCTION BOX, COMBINER BOX, DISCONNECT AND DEVICE WHERE ENERGIZED, UNGROUNDED BE EXPOSED DURING SERVICE:
 PER CODE: NEC 690.35 (F)

10 **CAUTION : SOLAR ELECTRIC SYSTEM CONNECTED**

LABEL LOCATION:
 POINT OF INTERCONNECTION & INVERTER
 PER CODE: NEC 690.15 & 690.13(B)

11 **WARNING - Electric Shock Hazard**
No user serviceable parts inside
 Contact authorized service provider for assistance

LABEL LOCATION:
 INVERTER & JUNCTION BOXES (ROOF)
 PER CODE: NEC 690.13 (G)(3) & 690.13 (G)(4)

12 **WARNING: PHOTOVOLTAIC POWER SOURCE**

LABEL LOCATION:
 CONDUIT
 PER CODE: 2017 NEC 690.31(G)(3)

13 **CAUTION**
DUAL POWER SOURCE SECOND SOURCE IS PHOTOVOLTAIC

LABEL LOCATION:
 MAIN SERVICE DISCONNECT/ AC DISCONNECT/ MAIN SERVICE PANEL/ REVENUE METER/ AC COMBINER
 PER CODE: NEC 705.12(B)(3)

14 **PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH**

LABEL LOCATION:
 AC DISCONNECT
 PER CODE: NEC 690.56(C)(3)



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO	
(15) HYPERION SOLAR HY-DH108P8 (400W)	
(1) SOLAREEDGE SE5000H-US (240V)	
DC SYSTEM SIZE: 6.000 KWDC	
AC SYSTEM SIZE: 5.000 KWAC	
METER: 162 809 049	

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
SIGNAGE

SHEET SIZE
**ANSI B
 11" X 17"**

SHEET NUMBER
PV-10

- ADHESIVE FASTENED SIGNS**
- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
 - WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD APPLIED LABELS, WARNING AND MARKINGS SHOULD COMPLY WITH ANSI 2535.4 [NEC 110.21(B) FIELD MARKING].
 - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
 HY-DH108P8 (400W)

(1) SOLAREEDGE
 SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME


SIGNAGE

SHEET SIZE

ANSI B
 11" X 17"



SHEET NUMBER

PV-11

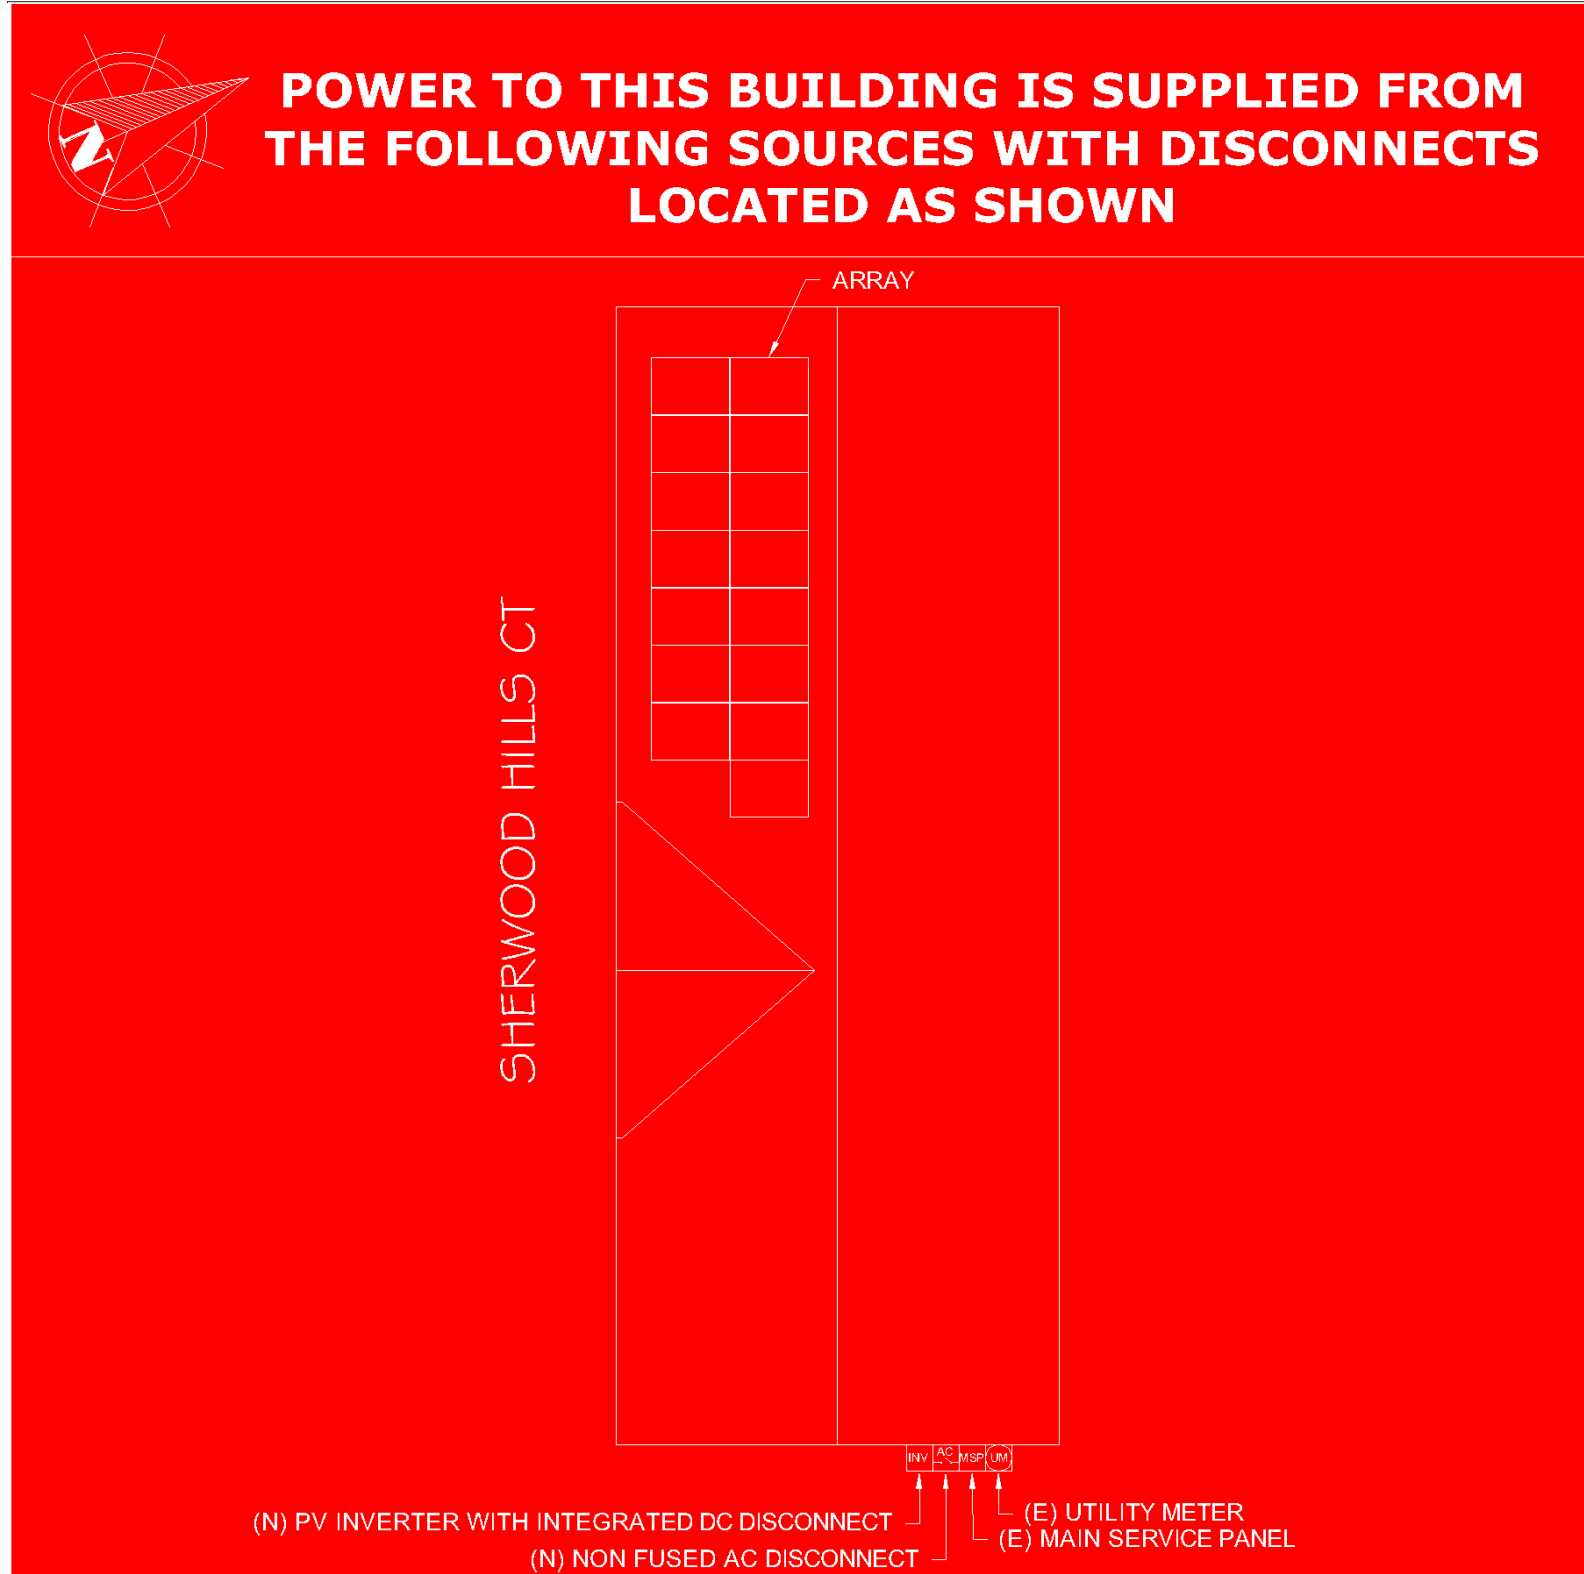

LABEL LOCATION:
 EACH SERVICE EQUIPMENT LOCATION AND AT THE LOCATION(S) OF THE SYSTEM DISCONNECT(S)
 FOR ALL ELECTRIC POWER PRODUCTION SOURCES CAPABLE OF BEING INTERCONNECTED
 (PER CODE: NEC 705.10)

JOB SAFETY PLAN

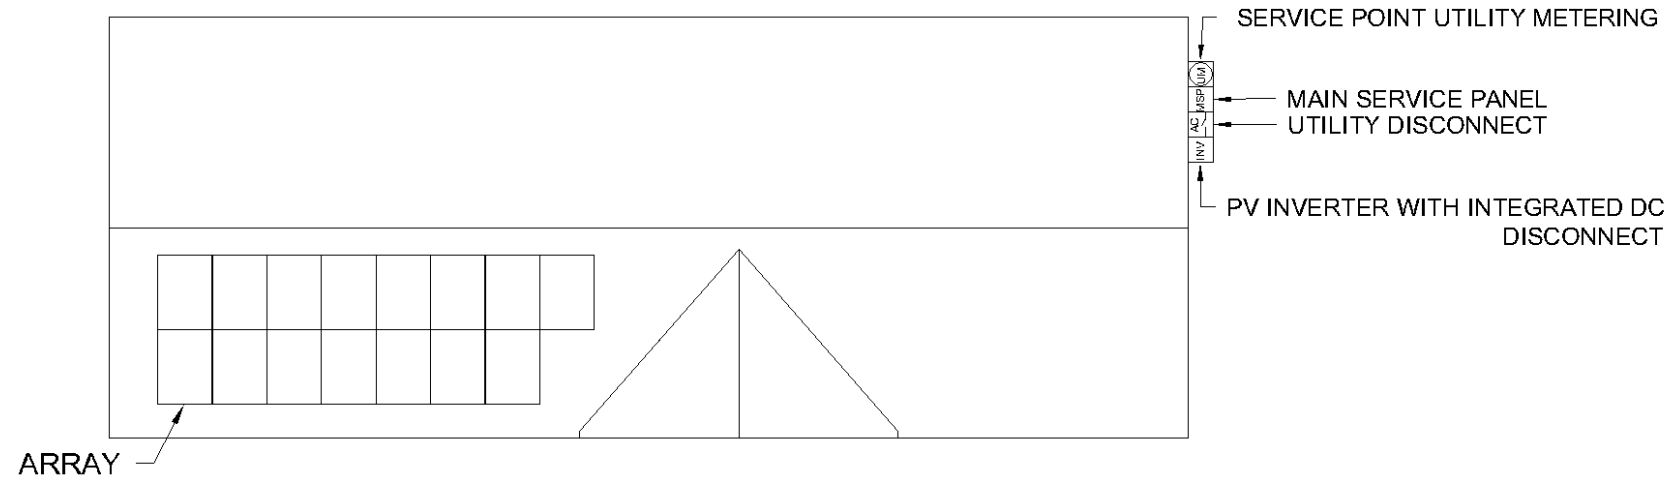

185 SHERWOOD HILLS CT, CAMERON, NC 28326, USA

LOCATION OF NEAREST URGENT CARE FACILITY

- NAME:
- ADDRESS:
- PHONE NUMBER:

NOTES

- INSTALLER SHALL DRAW IN DESIGNED SAFETY AREA AROUND HOME.
- INSTALLER SHALL UPDATE NAME, ADDRESS AND PHONE NUMBER OF NEAREST URGENT CARE FACILITY RELATIVE TO THE JOB SITE BEFORE STARTING WORK.



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
HY-DH108P8 (400W)

(1) SOLAREEDGE
SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

PERSON COVERED BY
THIS JOB SAFETY PLAN

INJURED AT WORK TODAY
? INITIAL YES OR NO

PRINT NAME	INITIAL	YES	NO

DATE: 3/7/2023

SHEET NAME
**JOB SAFETY
PLAN**

SHEET SIZE
**ANSI B
11" X 17"**

SHEET NUMBER
PV-12



BLACK DH108P8

HY-DH108P8-390/410B

TITAN SOLAR POWER
 525 W BASELINE RD
 MESA, AZ 85210
 TEL 855 SAY-SOLAR
 INFO@TITANSOLARPOWER
 TITANSOLARPOWER.COM

390-410W

HIGH CONVERSION EFFICIENCY

Module efficiency up to 21.0% through advanced cell technology and manufacturing process

EXCELLENT WEAK LIGHT PERFORMANCE

More power output in weak light condition, such as cloudy days, morning and sunset


EXTENDED MECHANICAL PERFORMANCE

Module certified to withstand extreme wind (2400 Pa) and snow loading (5400 Pa)

QUALITY GUARANTEE

High module quality ensures long-term reliability

HY-DH108P8 108 HALF-CELL BIFACIAL MODULE

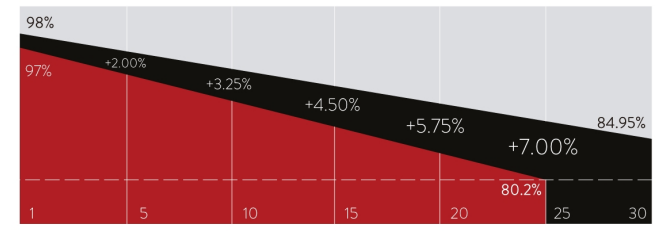

■ Conventional Module ■ Hyperion Performance

25 Years warranty for materials and workmanship

30 Years warranty for extra linear power output



IEC61215 / IEC61730 / UL61730
 IEC61701 / IEC62716
 ISO9001: Quality Management System


Mechanical Parameters

Solar Cell	Mono PERC 182mm
No. of Cells	108 (6 × 18)
Dimensions	1722 × 1134 × 30mm (67.08 × 44.65 × 1.18in.)
Weight	25.2kg (55.55lbs)
Junction Box	IP68 rated (3 bypass diodes)
Output Cables	4mm ² (IEC), 12 AWG (UL) (-/+1200mm (47.24in.) or customized)
Connector	EVO2 or customized
Front Cover	2.0mm (0.079in.) semi-tempered AR glass
Back Cover	2.0mm (0.079in.) semi-tempered glass
Container	36 pcs/Pallet, 792 pcs/40' HC

Operating Parameters

Max. System Voltage	DC 1500V (IEC/UL)
Operating Temperature	-40°C ~ +85°C (-40°F ~ +185°F)
Max. Fuse Rating	30A
Frontside Max. Loading	5400Pa (112lb/ft ²)
Backside Max. Loading	2400Pa (50lb/ft ²)
Bifaciality	70% 10%
Fire Resistance	IEC Class A, UL Type 29

Engineering Drawing

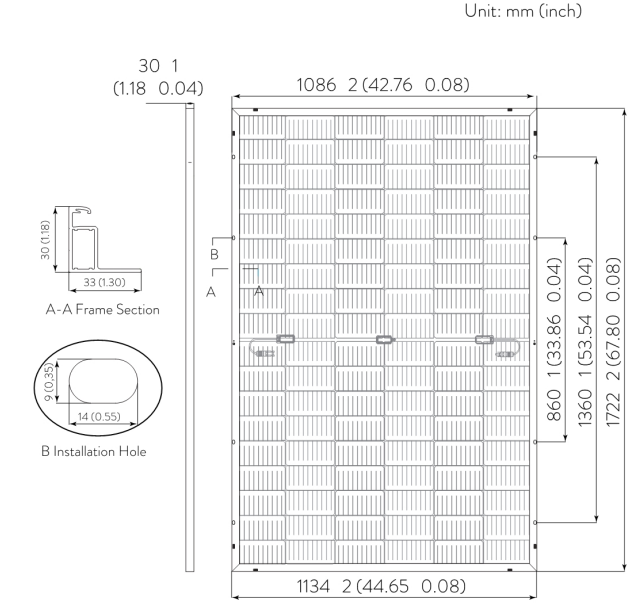

Electrical Characteristics - STC

Irradiance 1000 W/m², ambient temperature 25 °C, AM1.5.

Parameter	410	405	400	395	390
Maximum Power at STC (P _{max} /W)	410	405	400	395	390
Power Tolerance (W)	0 ~ +5				
Optimum Operating Voltage (V _{mp} /V)	31.45	31.21	31.01	30.84	30.64
Optimum Operating Current (I _{mp} /A)	13.04	12.98	12.90	12.81	12.73
Open Circuit Voltage (V _{oc} /V)	37.32	37.23	37.07	36.98	36.85
Short Circuit Current (I _{sc} /A)	13.95	13.87	13.79	13.70	13.61
Module Efficiency	21.0%	20.7%	20.5%	20.2%	20.0%

Electrical Characteristics - NMOT

Irradiance 800 W/m², ambient temperature 20 °C, AM1.5, wind speed 1 m/s.

Parameter	410	405	400	395	390
Maximum Power at NMOT (P _{max} /W)	310.2	306.4	302.5	298.8	295.0
Optimum Operating Voltage (V _{mp} /V)	29.82	29.60	29.41	29.25	29.15
Optimum Operating Current (I _{mp} /A)	10.40	10.35	10.29	10.22	10.15
Open Circuit Voltage (V _{oc} /V)	35.39	35.31	35.15	35.07	34.95
Short Circuit Current (I _{sc} /A)	11.25	11.19	11.13	11.05	10.98


Rearside Power Gain (Reference to 410W Front)

Parameter	5%	15%	25%
Rearside Power Gain	5%	15%	25%
Maximum Power (P _{max} /W)	431.4	472.3	514.8
Optimum Operating Voltage (V _{mp} /V)	31.57	31.57	31.65
Optimum Operating Current (I _{mp} /A)	13.66	14.96	16.27
Open Circuit Voltage (V _{oc} /V)	37.46	37.46	37.46
Short Circuit Current (I _{sc} /A)	14.57	15.96	17.35
Module Efficiency	22.1%	24.2%	26.4%

Temperature Characteristics

Nominal Module Operating Temperature	42 °C
Nominal Cell Operating Temperature	45 °C
Temperature Coefficient of P _{max}	-0.35%/°C
Temperature Coefficient of V _{oc}	-0.27%/°C
Temperature Coefficient of I _{sc}	0.05%/°C

Current-Voltage & Power-Voltage Curve (410W)

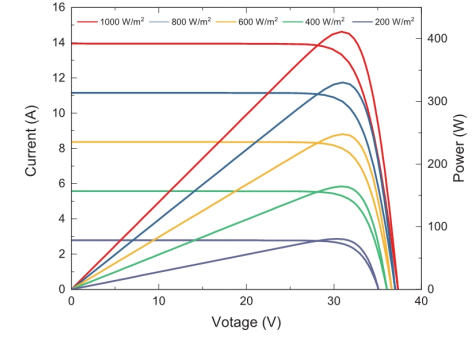

©Copyright 2022 HYPERION
 HY-DH108P8-EN-V1.4 US
 www.hyperion-usa.com



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO
(15) HYPERION SOLAR HY-DH108P8 (400W)
(1) SOLAREEDGE SE5000H-US [240V]
DC SYSTEM SIZE: 6.000 kWDC
AC SYSTEM SIZE: 5.000 kWAC
METER: 162 809 049

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
EQUIPMENT SPECIFICATIONS

SHEET SIZE
**ANSI B
 11" X 17"**

SHEET NUMBER
PV-13

INFO@HYPERION-USA.COM
 7/559 MOO.6, MAPYANGPHON SUBDISTRICT,
 PLUAK DAENG DISTRICT, RAYONG PROVINCE,
 21140, THAILAND

Single Phase Inverter with HD-Wave Technology

for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

12-25
YEAR
WARRANTY



INVERTERS

Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014 and 2017, per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US		
APPLICABLE TO INVERTERS WITH PART NUMBER	SEXXXXH-XXXXXBXX4								
OUTPUT									
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA	
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac	
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac	
AC Frequency (Nominal)	59.3 - 60 - 60.5 [Ⓜ]							Hz	
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A	
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A	
Power Factor	1, Adjustable - 0.85 to 0.85								
GFDI Threshold	1							A	
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes								
INPUT									
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W	
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W	
Transformer-less, Ungrounded	Yes								
Maximum Input Voltage	480							Vdc	
Nominal DC Input Voltage	380							400	Vdc
Maximum Input Current @240V [Ⓜ]	8.5	10.5	13.5	16.5	20	27	30.5	Adc	
Maximum Input Current @208V [Ⓜ]	-	9	-	13.5	-	-	27	Adc	
Max. Input Short Circuit Current	45							Adc	
Reverse-Polarity Protection	Yes								
Ground-Fault Isolation Detection	600k ω Sensitivity								
Maximum Inverter Efficiency	99	99.2						%	
CEC Weighted Efficiency	99						99 @ 240V 98.5 @ 208V	%	
Nighttime Power Consumption	< 2.5							W	

[Ⓜ] For other regional settings please contact SolarEdge support
[Ⓜ] A higher current source may be used; the inverter will limit its input current to the values stated



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR HY-DH108P8 (400W)

(1) SOLAREGE SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 KWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME
EQUIPMENT SPECIFICATIONS

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
PV-14

/ Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US/
SE7600H-US / SE10000H-US / SE11400H-US


MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US
ADDITIONAL FEATURES							
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)						
Revenue Grade Metering, ANSI C12.20	Optional ⁽⁹⁾						
Consumption metering							
Inverter Commissioning	With the SetApp mobile application using Built-in Wi-Fi Access Point for Local Connection						
Rapid Shutdown - NEC 2014 and 2017 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect						
STANDARD COMPLIANCE							
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCl according to T.I.L. M-07						
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (HI)						
Emissions	FCC Part 15 Class B						
INSTALLATION SPECIFICATIONS							
AC Output Conduit Size / AWG Range	1" Maximum / 14-6 AWG			1" Maximum /14-4 AWG			
DC Input Conduit Size / # of Strings / AWG Range	1" Maximum / 1-2 strings / 14-6 AWG			1" Maximum / 1-3 strings / 14-6 AWG			
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 6.8 / 450 x 370 x 174			21.3 x 14.6 x 7.3 / 540 x 370 x 185			in / mm
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.9	38.8 / 17.6		lb / kg	
Noise	< 25			<50			
Cooling	Natural Convection						
Operating Temperature Range	-40 to +140 / -40 to +60 ⁽⁹⁾						
Protection Rating	NEMA 4X (Inverter with Safety Switch)						

⁽⁹⁾ Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BNI4. For consumption metering, current transformers should be ordered separately: SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box

⁽⁹⁾ Full power up to at least 50°C / 122°F; for power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>

How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

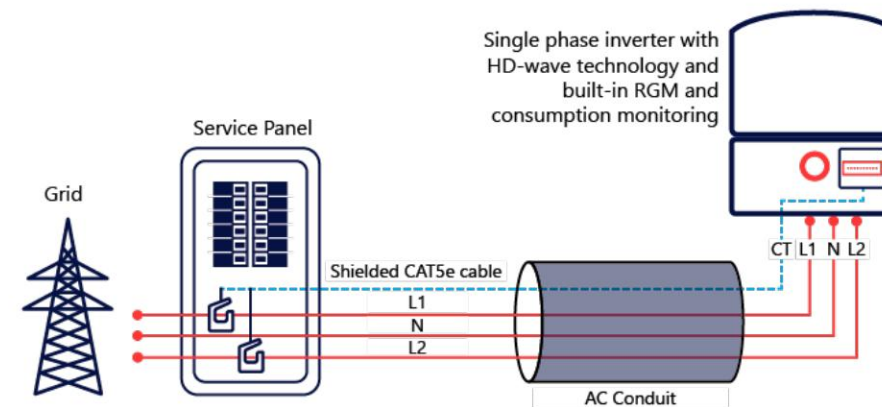

TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
HY-DH108P8 (400W)

(1) SOLAREEDGE
SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME

EQUIPMENT
SPECIFICATIONS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-15

Power Optimizer

For North America

P370 / P400 / P401 / P485 / P505



POWER OPTIMIZER

PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

Power Optimizer

For North America

P370 / P400 / P401 / P485 / P505

Optimizer model (typical module compatibility)	P370 (for higher-power 60 and 72-cell modules)	P400 (for 72 & 96- cell modules)	P401 (for high power 60 and 72 cell modules)	P485 (for high-voltage modules)	P505 (for higher current modules)	
INPUT						
Rated Input DC Power ⁽¹⁾	370	400		485	505	W
Absolute Maximum Input Voltage (Voc at lowest temperature)	60	80	60	125 ⁽²⁾	83 ⁽²⁾	Vdc
MPPT Operating Range	8 - 60	8 - 80	8-60	12.5 - 105	12.5 - 83	Vdc
Maximum Short Circuit Current (Isc)	11	10.1	11.75	11	14	Adc
Maximum DC Input Current	13.75	12.5	14.65	12.5	17.5	
Maximum Efficiency				99.5		%
Weighted Efficiency				98.8		%
Overvoltage Category				II		
OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREEDGE INVERTER)						
Maximum Output Current				15		Adc
Maximum Output Voltage				60	80	Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREEDGE INVERTER OR SOLAREEDGE INVERTER OFF)						
Safety Output Voltage per Power Optimizer				1 ± 0.1		Vdc
STANDARD COMPLIANCE						
EMC	FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3					
Safety	IEC62109-1 (class II safety), UL1741, NEC/PVRSS					
Material	UL94 V-0, UV Resistant					
RoHS	Yes					
INSTALLATION SPECIFICATIONS						
Maximum Allowed System Voltage	1000					Vdc
Compatible inverters	All SolarEdge Single Phase and Three Phase inverters					
Dimensions (W x L x H)	129 x 153 x 27.5 / 5.1 x 6 x 1.1	129 x 153 x 33.5 / 5.1 x 6 x 1.3	129 x 153 x 29.5 / 5.1 x 6 x 1.16	129 x 159 x 49.5 / 5.1 x 6.3 x 1.9	129 x 162 x 59 / 5.1 x 6.4 x 2.3	mm / in
Weight (including cables)	630 / 1.4	750 / 1.7	655 / 1.5	845 / 1.9	1064 / 2.3	gr / lb
Input Connector	MC4 ⁽³⁾			MC4 ⁽³⁾	MC4 ⁽³⁾	
Input Wire Length				0.16 / 0.5		m / ft
Output Wire Type / Connector	Double Insulated / MC4					
Output Wire Length						1.2 / 3.9
Operating Temperature Range ⁽⁴⁾						-40 to +85 / -40 to +185
Protection Rating						IP68 / Type6B
Relative Humidity						0 - 100

(1) Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed.
 (2) NEC 2017 requires max input voltage be not more than 80V
 (3) For other connector types please contact SolarEdge
 (4) Longer inputs wire lengths are available for use. For 0.9m input wire length order P401-xxxLxxx.
 (5) For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>

PV System Design Using a SolarEdge Inverter ^(6/7)	Single Phase HD-Wave	Single phase	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	P370, P400, P401 P485, P505	8 6	10 8	18 14	
Maximum String Length (Power Optimizers)	25		25	50	
Maximum Power per String	5700 ⁽⁸⁾ (6000 with SE7600-US - SE11400-US)	5250 ⁽⁸⁾	6000 ⁽⁹⁾	12750 ⁽¹⁰⁾	W
Parallel Strings of Different Lengths or Orientations	Yes				

(6) For detailed string sizing information refer to: http://www.solaredge.com/sites/default/files/string_sizing_na.pdf
 (7) It is not allowed to mix P485/P505 with P370/P400/P401 in one string
 (8) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement
 (9) For 208V grid: it is allowed to install up to 6,500W per string when the maximum power difference between each string is 1,000W
 (10) For 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W



TITAN SOLAR POWER
 160 N MCQUEEN RD,
 GILBERT, AZ 85233, USA
 PH# : (808) 371-5338
 Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
 HY-DH108P8 (400W)

(1) SOLAREEDGE
 SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 KWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
 RESIDENCE
 185 SHERWOOD HILLS CT, CAMERON, NC 28326,
 USA
 EMAIL ID: LEWI_LOVE2004@YAHOO.COM
 PHONE NO. (919) 579-0977


DATE: 3/7/2023

SHEET NAME
EQUIPMENT SPECIFICATIONS

SHEET SIZE
**ANSI B
 11" X 17"**

SHEET NUMBER
PV-16

We support PV systems
Formerly Everest Solar Systems

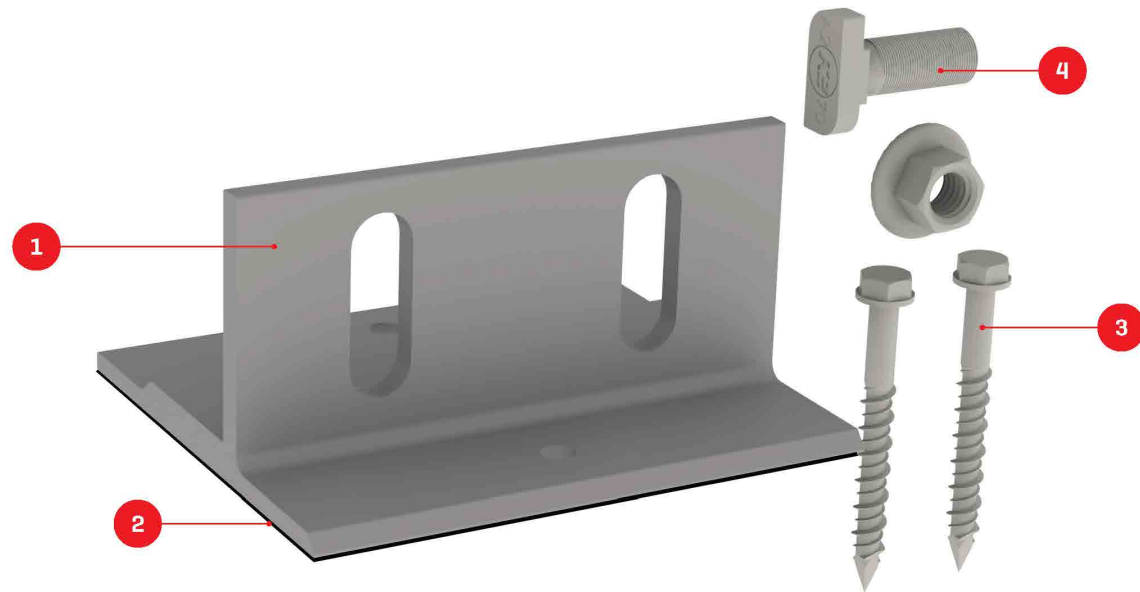

Splice Foot X

TECHNICAL SHEET

Item Number	Description	Part Number
1	Splice Foot X	4000113 Splice Foot X Kit, Mill
2	K2 Solar Seal Butyl Pad	
3	M5 x 60 lag screws	
4	T-Bolt & Hex Nut Set	


Technical Data

	Splice Foot X
Roof Type	Composition shingle
Material	Aluminum with stainless steel hardware
Finish	Mill
Roof Connection	M5 x 60 lag screws
Code Compliance	UL 2703
Compatibility	CrossRail 44-X, 48-X, 48-XL, 80

We support PV systems
Formerly Everest Solar Systems



Units: [in] mm

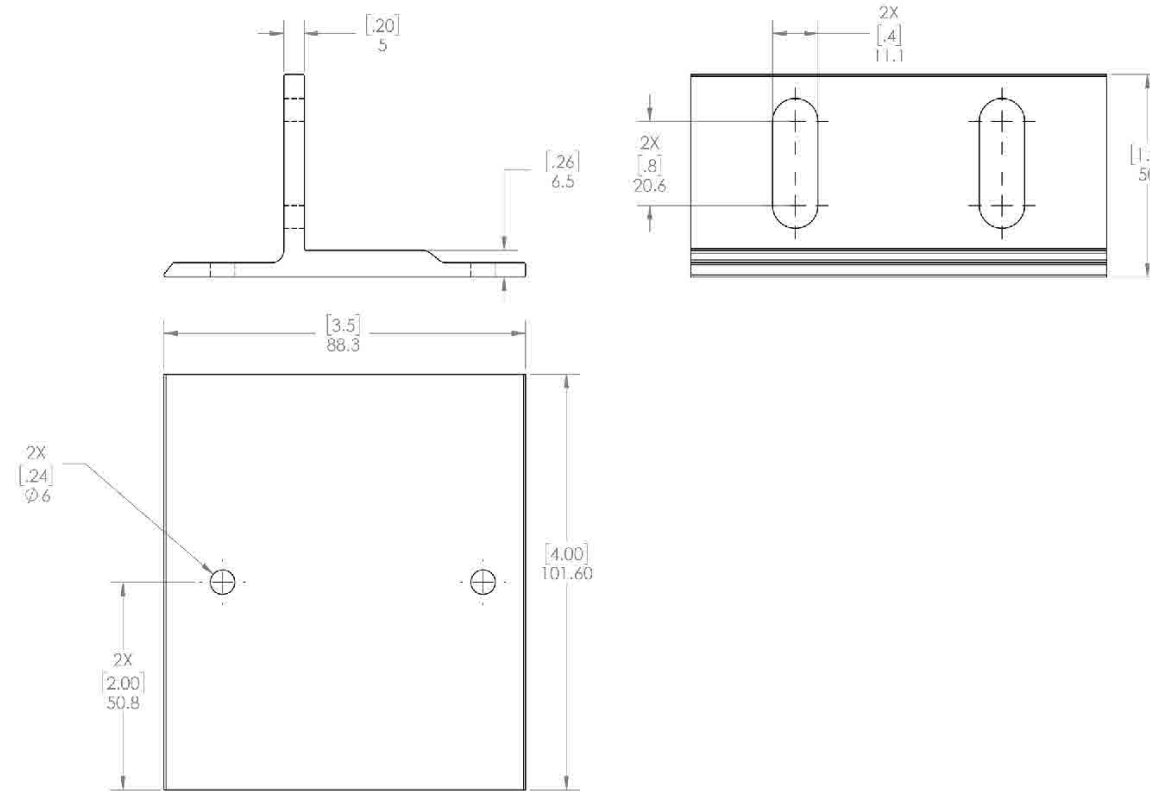

TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
HY-DH108P8 (400W)

(1) SOLAREEDGE
SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC
AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME

EQUIPMENT
SPECIFICATIONS

SHEET SIZE

ANSI B
11" X 17"


SHEET NUMBER

PV-17

We support PV systems
Formerly Everest Solar Systems



CROSSRAIL 44-X




Mechanical Properties

CrossRail 44-X	
Material	6000 Series Aluminum
Ultimate Tensile Strength	37.7 ksi [260 MPa]
Yield Strength	34.8 ksi [240 MPa]
Weight	0.47 lbs/ft [0.699 kg/m]
Finish	Mill or Dark Anodized

Sectional Properties

CrossRail 44-X	
Sx	0.1490 in ³ [0.3785 cm ³]
Sy	0.1450 in ³ [0.3683 cm ³]
A [X-Section]	0.4050 in ² [1.0287 cm ²]

Units: [mm] in

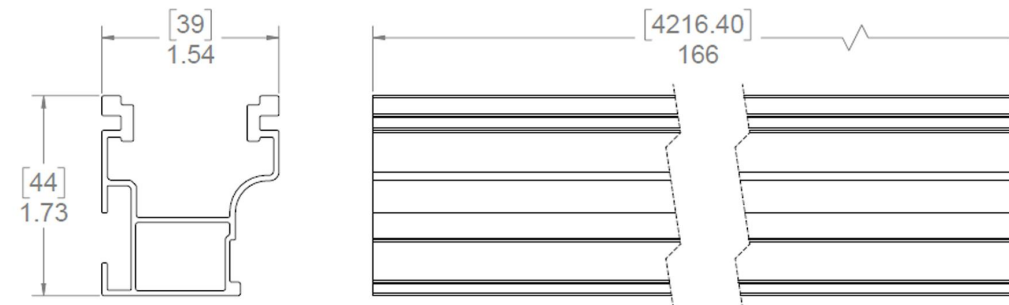

Notes:

- ▶ Structural values and span charts determined in accordance with Aluminum Design Manual and ASCE 7-16
- ▶ UL2703 Listed System for Fire and Bonding



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
HY-DH108P8 (400W)

(1) SOLAREEDGE
SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME

**EQUIPMENT
SPECIFICATIONS**

SHEET SIZE

**ANSI B
11" X 17"**

SHEET NUMBER

PV-18

A. System Specifications and Ratings

- Maximum Voltage: 1,000 Volts
- Maximum Current: 120 Amps
- Allowable Wire: 14 AWG – 6 AWG
- Spacing: Please maintain a spacing of at least ½” between uninsulated live parts and fittings for conduit, armored cable, and uninsulated live parts of opposite polarity.
- Enclosure Rating: Type 3R
- Roof Slope Range: 2.5 – 12:12
- Max Side Wall Fitting Size: 1”
- Max Floor Pass-Through Fitting Size: 1”
- Ambient Operating Conditions: (-35°C) - (+75°C)
- Compliance:
 - JB-1.XL: UL1741
 - Approved wire connectors: must conform to UL1741
- System Marking: **Interek Symbol and File #5019942**
- Periodic Re-inspections: If re-inspections yield loose components, loose fasteners, or any corrosion between components, components that are found to be affected are to be replaced immediately.

Table 1: Typical Wire Size, Torque Loads and Ratings

	1 Conductor	2 Conductor	Torque				
			Type	NM	Inch Lbs	Voltage	Current
ABB ZS6 terminal block	10-24 awg	16-24 awg	Sol/Str	0.5-0.7	6.2-8.85	600V	30 amp
ABB ZS10 terminal block	6-24 awg	12-20 awg	Sol/Str	1.0-1.6	8.85-14.16	600V	40 amp
ABB ZS16 terminal block	4-24 awg	10-20 awg	Sol/Str	1.6-2.4	14.6-21.24	600V	60 amp
ABB M6/8 terminal block	8-22 awg		Sol/Str	.08-1	8.85	600V	50 amp
Ideal 452 Red WING-NUT Wire Connector	8-18 awg		Sol/Str			600V	
Ideal 451 Yellow WING-NUT Wire Connector	10-18 awg		Sol/Str			600V	
Ideal, In-Sure Push-In Connector Part #39	10-14 awg		Sol/Str			600V	
WAGO, 221-612	10-14 awg		Sol/Str			600V	
International Hydraulics 2S2/0	10-14 awg		Sol/Str	4	35		
	8 awg		Sol/Str	4.5	40		
Brumall 4-5,3	4-6 awg		Sol/Str		45	2000V	
	10-14 awg		Sol/Str		35		
Blackburn LL414	4-14 awg		Sol/Str				

Table 2: Minimum wire-bending space for conductors through a wall opposite terminals in mm (inches)

Wire size, AWG or	Wires per terminal (pole)			
	1	2	3	4 or More
kcmil (mm2)	mm (inch)	mm (inch)	mm (inch)	mm (inch)
14-10 (2.1-5.3)	Not specified	-	-	-
8 (8.4)	38.1 (1-1/2)	-	-	-
6 (13.3)	50.8 (2)	-	-	-



TITAN SOLAR POWER
160 N MCQUEEN RD,
GILBERT, AZ 85233, USA
PH# : (808) 371-5338
Electrical LIC# : U.33714

SYSTEM INFO

(15) HYPERION SOLAR
HY-DH108P8 (400W)

(1) SOLAREEDGE
SE5000H-US [240V]

DC SYSTEM SIZE: 6.000 kWDC

AC SYSTEM SIZE: 5.000 kWAC

METER: 162 809 049

REVISIONS

DESCRIPTION	DATE	REV

PROJECT NAME & ADDRESS

LAPREI T LEWIS
RESIDENCE
185 SHERWOOD HILLS CT, CAMERON, NC 28326,
USA
EMAIL ID: LEWI_LOVE2004@YAHOO.COM
PHONE NO. (919) 579-0977

DATE: 3/7/2023

SHEET NAME

**EQUIPMENT
SPECIFICATIONS**

SHEET SIZE

**ANSI B
11" X 17"**

SHEET NUMBER

PV-19