

TESLA

SOLAR AC DISCONNECT LOCATED AT

WEST SIDE WALL OF THE
HOUSE BESIDE THE UTILITY METER


pvl@bels.com 3-615-168368-B

SERVICE DISCONNECT LOCATED IN THE

IN THE TESLA GATEWAY
BESIDE THE MSP

pvl@bels.com 3-615-168368-C



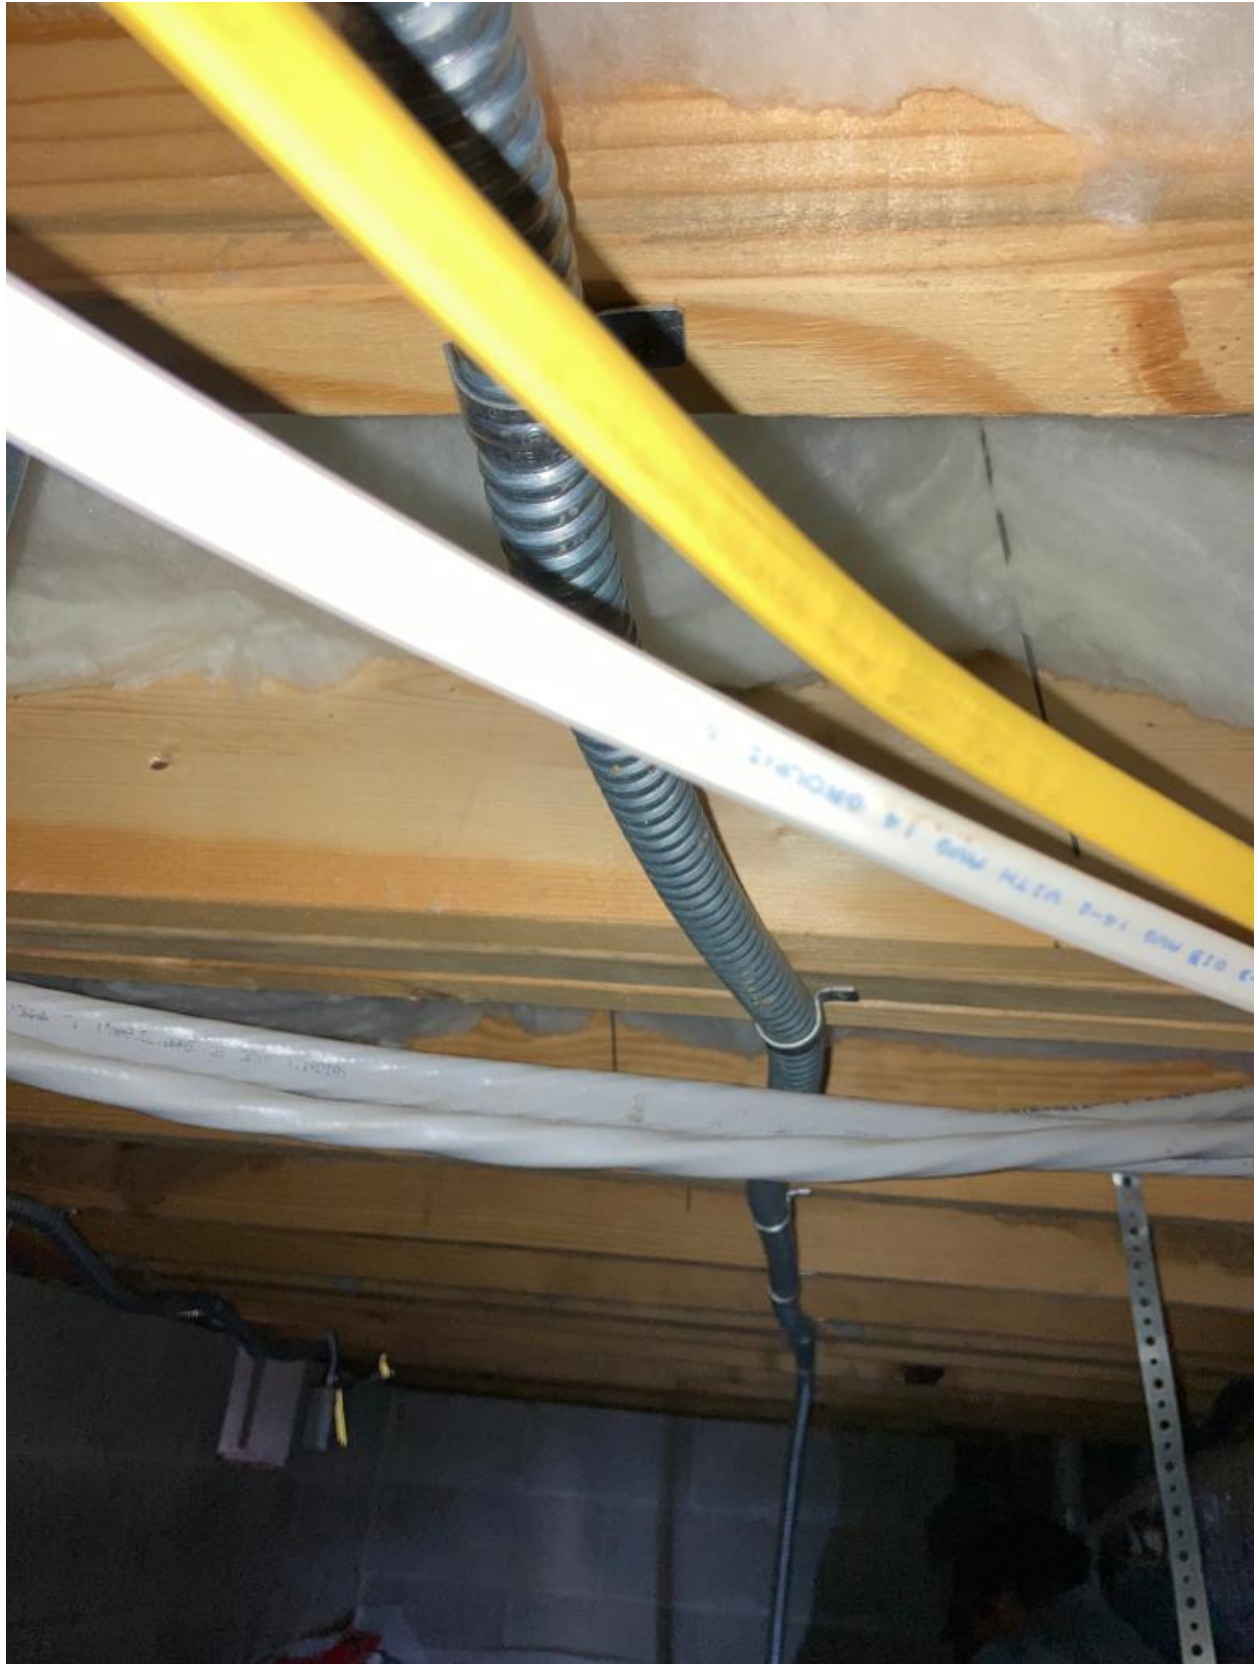



















WARNING
TURN OFF PHOTOVOLTAIC
AC DISCONNECT PRIOR TO
WORKING INSIDE PANEL

WARNING
ELECTRIC SHOCK HAZARD
TERMINALS ON THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION


WARNING
THREE POWER SOURCES
SOURCES: UTILITY GRID, BATTERY
AND PV SOLAR ELECTRIC SYSTEM

SOLAR AC DISCONNECT LOCATED AT
SOUTH WEST SIDE WALL OF THE HOUSE
BESIDE THE UTILITY METER

PHOTOVOLTAIC POWER SOURCE
OPERATING AC VOLTAGE 240 V
MAXIMUM OPERATING
AC OUTPUT CURRENT 47.5 A

WARNING
THIS EQUIPMENT FED BY MULTIPLE
SOURCES. TOTAL RATING OF ALL
OVERCURRENT DEVICES, EXCLUDING
MAIN SUPPLY OVERCURRENT
DEVICE, SHALL NOT EXCEED
CAPACITY OF BUSBAR

**SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN**
TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN THE ARRAY




BATTERY DISCONNECT LOCATED IN THE
IN THE TESLA GATEWAY
BESIDE THE METER

WARNING
POWER SOURCE
OUTPUT CONNECTION
DO NOT RELOCATE THIS
OVERCURRENT DEVICE

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY

pvlabs.com

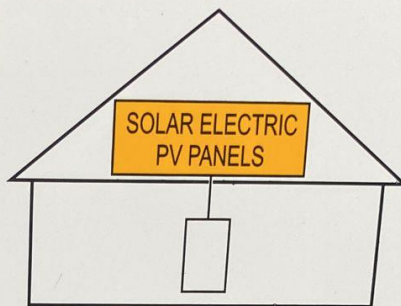

07-111

BATTERY DISCONNECT LOCATED IN THE

IN THE TESLA GATEWAY
BESIDE THE MSP

pvlabs.com 3-615-168368-A

⚠ WARNING

POWER SOURCE
OUTPUT CONNECTION
DO NOT RELOCATE THIS
OVERCURRENT DEVICE

pvlabs.com

05-216