

Project Details			
Name	STEPHEN REGISTER	Date	05/08/2023
Location	3495 Rawls Church Road, Fuquay-Varina, NC 27526	Total modules	22
Module	Mission Solar Energy: MSE395SX9R (40mm)	Total watts	8,690
Dimensions	Dimensions: 75.08" x 41.5" x 1.57" (1907.0mm x 1054.0mm x 40.0mm)	Attachments	50
ASCE	7-10	Rails per row	2



System Weight	
Total system weight	1,221.7 lbs
Weight/attachment	24.4 lbs
Racking weight	154.7 lbs
Distributed weight	2.5 psf

Load Assumptions	
Wind exposure	С
Wind speed	119 mph
Ground snow load	15 psf
Attachment spacing portrait	4.0'
Attachment spacing landscape	4.0'

Roof Information			
Roof Material Family	Comp Shingle	Roof material	Comp Shingle
Building height	15 ft	Roof attachment	Flashfoot2
		Staggered attachments	Yes
Roof slope	42 °	Attachment hardware	Square
Risk category	II		

Reaction Forces XR10 - Portrait

Zone	Max span	Max cantilever	Zone	Uplift (PSF)	Down (lbs)	Uplift (lbs)	Lateral (lbs)		
1	6'	2' 5"	1	15.3	206	177	67		
2	6'	2' 5"	2	18.5	206	216	67		
3	6'	2' 5"	3	18.5	206	216	67		



Span Details XR10 - Landscape

Span Details X	Reaction Fo	Reaction Forces XR10 - Landscape					
Zone	Zone Max span Max cantilever		Zone	Uplift (PSF)	Down (lbs)	Uplift (Ibs)	Lateral (lbs)
1	7' 7"	3'	1	15.3	114	98	37
2	7' 7"	3'	2	18.5	114	120	37
3	7' 7"	3'	3	18.5	114	120	37



Roof Section 1

Details		Weights
Panels: 20	Provided rail: 196' [14 x 168"]	Total weight: 1,103.0 lbs
Rail orientation: East-West	Attachments: 41	Weight/attachment: 26.9 lbs
Panel orientation: Portrait	Splices: 8	Total Area: 439.2 sq ft
Entry type: Graphical	Clamps: 46	Distributed weight: 2.5 psf

Diagram

								• • •		12' 7"
								•		2' 7''
										Ē
38' 6"									+	

Segments

I	Identifier	Columns	Row length	Rail length	Cantilever	Rail	Attachments	Splices	Clamps
	А	9	31' 7"	31' 7"	1' 9"	84' [6 x 168"]	17	4	20
	В	1	3' 8"	3' 8"	0"	28' [2 × 168"]	5	0	4
	С	10	35'	35'	1' 6"	84' [6 x 168"]	19	4	22



Roof Section 2

Details		Weights
Panels: 2	Provided rail: 28' [2 x 168"]	Total weight: 118.8 lbs
Rail orientation: East-West	Attachments: 9	Weight/attachment: 13.2 lbs
Panel orientation: Landscape	Splices: 0	Total Area: 44.0 sq ft
Entry type: Graphical	Clamps: 6	Distributed weight: 2.7 psf

Diagram


	3. 0.
12' 9"	


Segments

Identifier	Columns	Row length	Rail length	Cantilever	Rail	Attachments	Splices	Clamps
А	2	12' 9"	12' 9"	4"	28' [2 x 168"]	9	0	6





Side View (portrait)

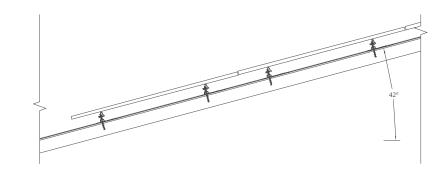

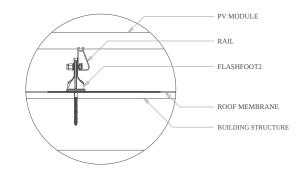


Front View (portrait)









Side View (landscape)

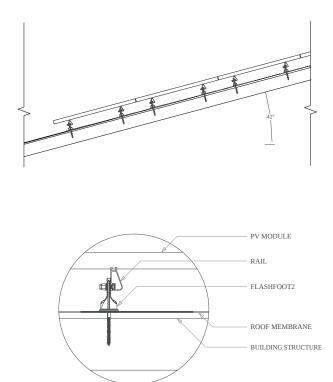


Front View (landscape)









Splice Details

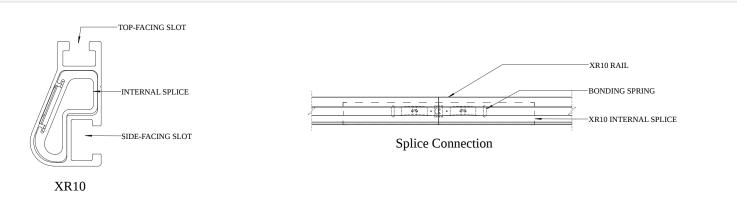

Clamp Detail

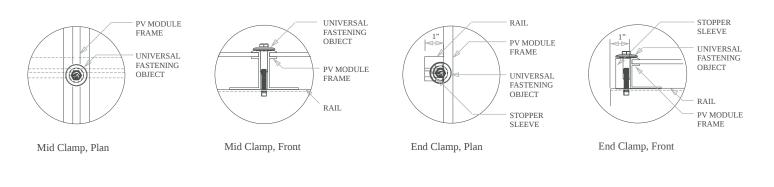

FlashFoot2 Detail

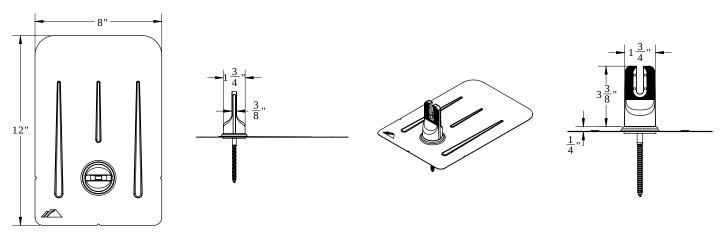

Plan View


 $Side \ View$

Perspective View

Front View



Grounding Diagram

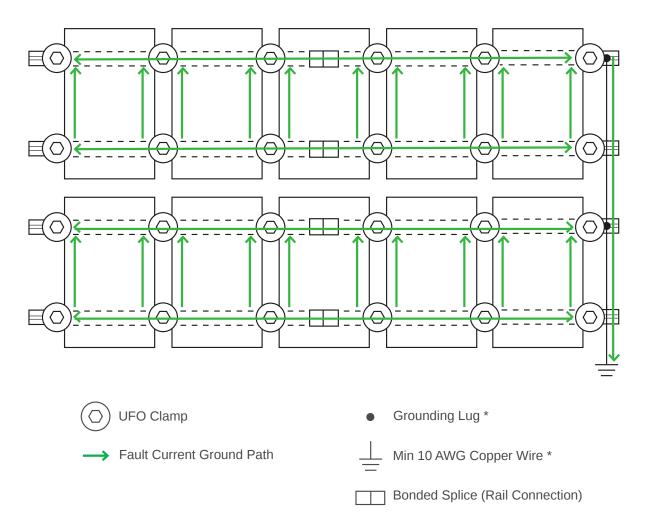

* Grounding Lugs and Wire are not required in systems using Enphase microinverters.



Bill of Materials

Part	Spares	Total Qty
Rails & Splices		
XR-10-168A XR10, Rail 168'' Clear	0	16
XR10-BOSS-01-M1 Bonded Splice, XR10	0	8
Clamps & Grounding		
UFO-CL-01-A1 Universal Module Clamp, Clear	0	52
UFO-STP-40MM-M1 Stopper Sleeve, 40MM, Mill	0	16
XR-LUG-03-A1 Grounding Lug, Low Profile	0	4
Attachments		
FF2-02-M2 FlashFoot2, Mill	0	50
BHW-SQ-02-A1 Square-Bolt Bonding Hardware	0	50

ATTACHMENTS

PRE-INSTALLATION

Verify module compatibility. See Page 21 for info.

TOOLS REQUIRED

Cordless Drill (non-impact)		3/8" Socket
Impact Driver (for lag bolts)		1/8" Drill Bit
Torque Wrench (0-250 in-lbs)		1/4" Drill Bit
7/16" Socket		T30 Bit
1/2" Socket		Channel Lock Pliers
9/16" Socket		#3 Phillips Bit
7/32" Drill Bit		3/16" Hex Bit

BONDING HARDWARE TORQUE VALUES

Please refer to each attachment's individual section for full details on all torque values and instructions.

- 3/8" Bonding Hardware Nuts (7/16" Socket): 250 in-lbs
- All Tile Hook Carriage Bolts (7/16" Socket): 132 in-lbs
- Flat Roof Attachment Nuts (9/16" Socket): 250 in-lbs
- Lynx Set Screw (3/16" Hex Drive): 150 in-Ibs
- Lynx Flange Nut (1/2" Socket): 150 in-lbs


ATTACHMENTS

COMPOSITION SHINGLE






FlashVue




QM L-Mount




TILE

FlashFoot2





HUG (Halo UltraGrip)







Mount



All Tile Hook and Flashing (optional)



QM Tile Conduit

Penetration

QM Quick Hook and QM QBase Tile Flashing (optional)

ADDITIONAL ROOF TYPES



۲

QM Classic Mount Shake



QM Lynx Metal Roof Attachment

LOW SLOPE ROOF

Slate - Metal Shingle



Flat Roof Attachment





> If using previous version of Integrated Grounding Mid Clamps, End Clamps, Expansion Joints and for a list of approved 3rd party components please refer to Alternate Components Addendum (Version 1.9)







COMPONENTS



PRE-INSTALLATION

Verify module compatibility. See Page 21 for info.

TOOLS REQUIRED

Cordless Drill (non-impact)		1/8" Drill bit
Impact Driver (for lag bolts)		1/4" Drill bit
Torque Wrench (0-250 in-lbs)		T30 Torx Bit
7/16" Socket		Channel Lock Pliers
1/2" Socket		#3 Phillips Bit
9/16" Socket		Paddle Bit

7/32" Drill bit

BONDING HARDWARE TORQUE VALUES

Please refer to each attachment's individual section for full details on all torque values and instructions.

- Universal Fastening Object (7/16" Socket): 80 in-Ibs
- Rail Grounding Lug Nut (7/16" Socket): 80 in-lbs
- Module Grounding Lug
 - Grounding Nut (7/16" Socket): 60 in-Ibs
 - Grounding Lug Terminal Screws (7/16" Socket): 20 in-lbs
- Microinverter Kit Nuts (7/16" Socket): 80 in-lbs
- Frameless Module Kit Nuts (7/16" Socket): 80 in-lbs
- 3/8" Bonding Hardware Nuts (7/16" Socket): 250 in-lbs
- Contour Clamp (T-30 Torx Bit): 80 in-lbs




COMPONENTS





Wire Clip



BOSS

Ironridge L-Foot and

QM L-Foot

XR Rail




Sleeve (30-46MM)






Rail Grounding Lug





8" Bonding Jumper Single Use Only



QM Composition **Conduit Penetration**



Frameless Module Kit





Microinverter Kit

End Cap

MBOD

JAYBOX

Frameless

End/Mid Clamp

G


3/8" Bonding Hardware



QM Classic Conduit Comp Mount



QM Tile Conduit Mount



Contour Trim

Contour Clamp

FLUSH MOUNT INSTALLATION MANUAL - 4

© 2022 IRONRIDGE, INC. VERSION 3.8