


Building Codes: 2017 NEC, 2018 NORTH CAROLINA RESIDENTIAL CODE, 2018 NORTH CAROLINA FIRE CODE, 2018 NORTH CAROLINA BUILDING CODE and AHJ Amendments

## VICINITY MAP

SCALE: NTS

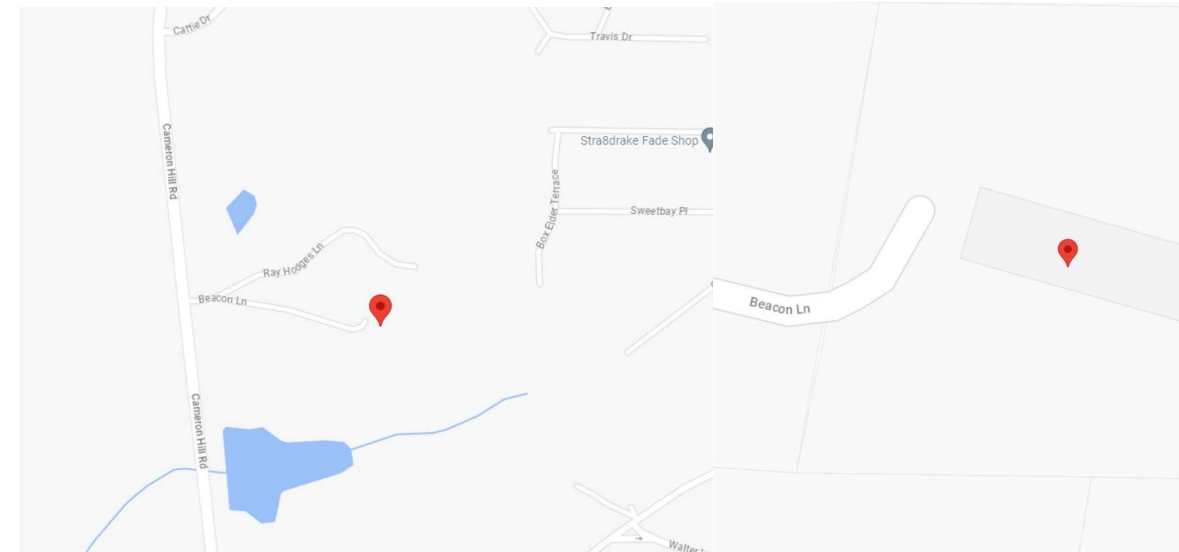

## AERIAL MAP

SCALE: NTS

# NANCE, WILLIAM PV SYSTEM 157 BEACON LANE . CAMERON, NC, 28326 APN: 099565 0036 01 JURISDICTION: HARNETT COUNTY (NC) GENERAL INFORMATION

SYSTEM SIZE:	10.000 kW-DC-STC 7.600 kW-AC
ROOF PITCHED:	25 DEGREES
INVERTER:	(1) SOLAREEDGE SE7600H-US W/ S440 OPTIMIZERS
MODULES:	(25) HY-DH108P8-400B
STRINGS:	(1) x 14 (1) x 11 MODULE SERIES STRINGS
ELECTRICAL SERVICE RATING:	200A
PV SYSTEM OVERCURRENT RATING:	40A
PV SYSTEM DISCONNECT SWITCH:	EATON DG222URB (60A / 2P)
ROOF TYPE:	GROUND H
ROOF FRAMING:	ENGINEERED TRUSS
RACKING/RAILING:	XR1000 / XR1000 RAIL CANTILEVER
ATTACHMENT METHOD:	HELICAL PILE PACKAGE - U.S. HELICAL
ROOF ATTACHMENT :	HELICAL PILE PACKAGE - U.S. HELICAL

## TABLE OF CONTENTS

REQUIRED INFORMATION	SHEET NAME	SHEET NUMBER
SITE INFORMATION	COVER PAGE	PV 1
MODULE AND EQUIPMENT LAYOUT	SITE PLAN	PV 2
LOCATION & QUANTITY OF PACKING & STANDOFFS	PV LAYOUT	PV 3
RACKING LOAD & UPLIFT CALCULATIONS	PV LAYOUT	PV 3
ROOF ATTACHMENT DETAILS	DETAILS	PV 4
ELECTRICAL 1 LINE DIAGRAM	ONE LINE	PV 5
ELECTRICAL 3 LINE DIAGRAM	THREE LINE	PV 6
OCP & WIRE SIZING CALCULATIONS	1 & 3 LINE	PV 5 & 6
ARRAY & INVERTER ELECTRICAL SPECIFICATIONS	1 & 3 LINE	PV 5 & 6
EQUIPMENT SPECIFICATIONS	1 & 3 LINE	PV 5 & 6
LABEL NOTES	LABELS	PV 7
PV EQUIPMENT LABELING DETAIL	LABELS	PV 7
DIRECTORY LABEL	PLACARD	PV 8
JOB SAFETY PLAN	SAFETY PLAN	PV 9
PV EQUIPMENT SPECIFICATIONS	EQUIPMENT SPEC.	PV 10 - 16
DATA SHEETS & ADDITIONAL INFORMATION	SUPPLEMENTAL MATERIAL	

## NOTES

### EQUIPMENT LOCATION



- ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS AS REQUIRED BY NEC 110.26.
- WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC690.31(A),(C) AND NEC TABLES 310.15(B)(2)(A) AND 310.15(B)(3)(C).
- JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES ACCORDING TO NEC 690.34.
- ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT.
- ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES.
- ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

### WIRING & CONDUIT NOTES

- ALL CONDUITS AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.
- CONDUCTORS SIZED ACCORDING TO NEC 690.8, NEC 690.7.
- DC WIRING LIMITED TO MODULE FOOTPRINT. MICRO INVERTER WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY WITH SUITABLE WIRING CLIPS.
- AC CONDUCTORS COLORED OR MARKED AS FOLLOWS: PHASE A OR L1- BLACK, PHASE B OR L-2 RED, OR OTHER CONVENTION IF THREE PHASE, PHASE C OR L3-BLUE, YELLOW, ORANGE, OR OTHER CONVENTION NEUTRAL- WHITE OR GREY IN 4-WIRE DELTA CONNECTED SYSTEMS THE PHASE WITH THE HIGHER VOLTAGE TO BE MARKED ORANGE NEC 110.15.

### GENERAL NOTES

- MODULES ARE LISTED UNDER UL 1703 AND CONFORM TO THE STANDARDS.
- INVERTERS ARE LISTED UNDER UL 1741 AND CONFORM TO THE STANDARDS.
- DRAWINGS ARE DIAGRAMMATIC, INDICATING GENERAL ARRANGEMENT OF THE PV SYSTEM AND THE ACTUAL SITE CONDITION MIGHT VARY.
- WORKING CLEARANCES AROUND THE NEW PV ELECTRICAL EQUIPMENT WILL BE MAINTAINED IN ACCORDANCE WITH NEC 110.26.
- ALL GROUND WIRING CONNECTED TO THE MAIN SERVICE GROUNDING IN MAIN SERVICE PANEL/SERVICE COMPONENT.
- ALL CONDUCTORS SHALL BE 600V, 75° C STANDARD COPPER UNLESS OTHERWISE NOTED.
- WHEN REQUIRED, A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- THE SYSTEM WILL NOT BE INTERCONNECTED BY THE CONTRACTOR UNTIL APPROVAL FROM THE LOCAL JURISDICTION AND/OR THE UTILITY.
- ROOF ACCESS POINT SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREES, WIRES OR SIGNS.
- PV ARRAY COMBINER/JUNCTION BOX PROVIDES TRANSITION FROM ARRAY WIRING TO CONDUIT WIRING.

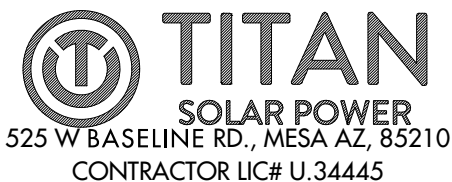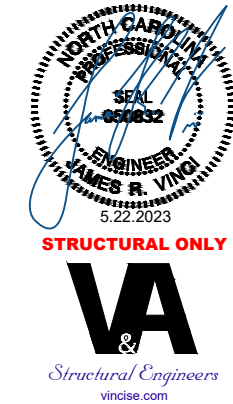


NANCE, WILLIAM RESIDENCE  
157 BEACON LANE , CAMERON, NC, 28326  
LAT:35.272757, LON:-79.099212  
TSP157209

(25) HY-DH108P8-400B  
(1) SOLAREEDGE SE7600H-US  
10.000 kW DC SYSTEM SIZE  
7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
REV:A  
DRAWN BY: CA


SEAL:

COVER PAGE  
PV 1

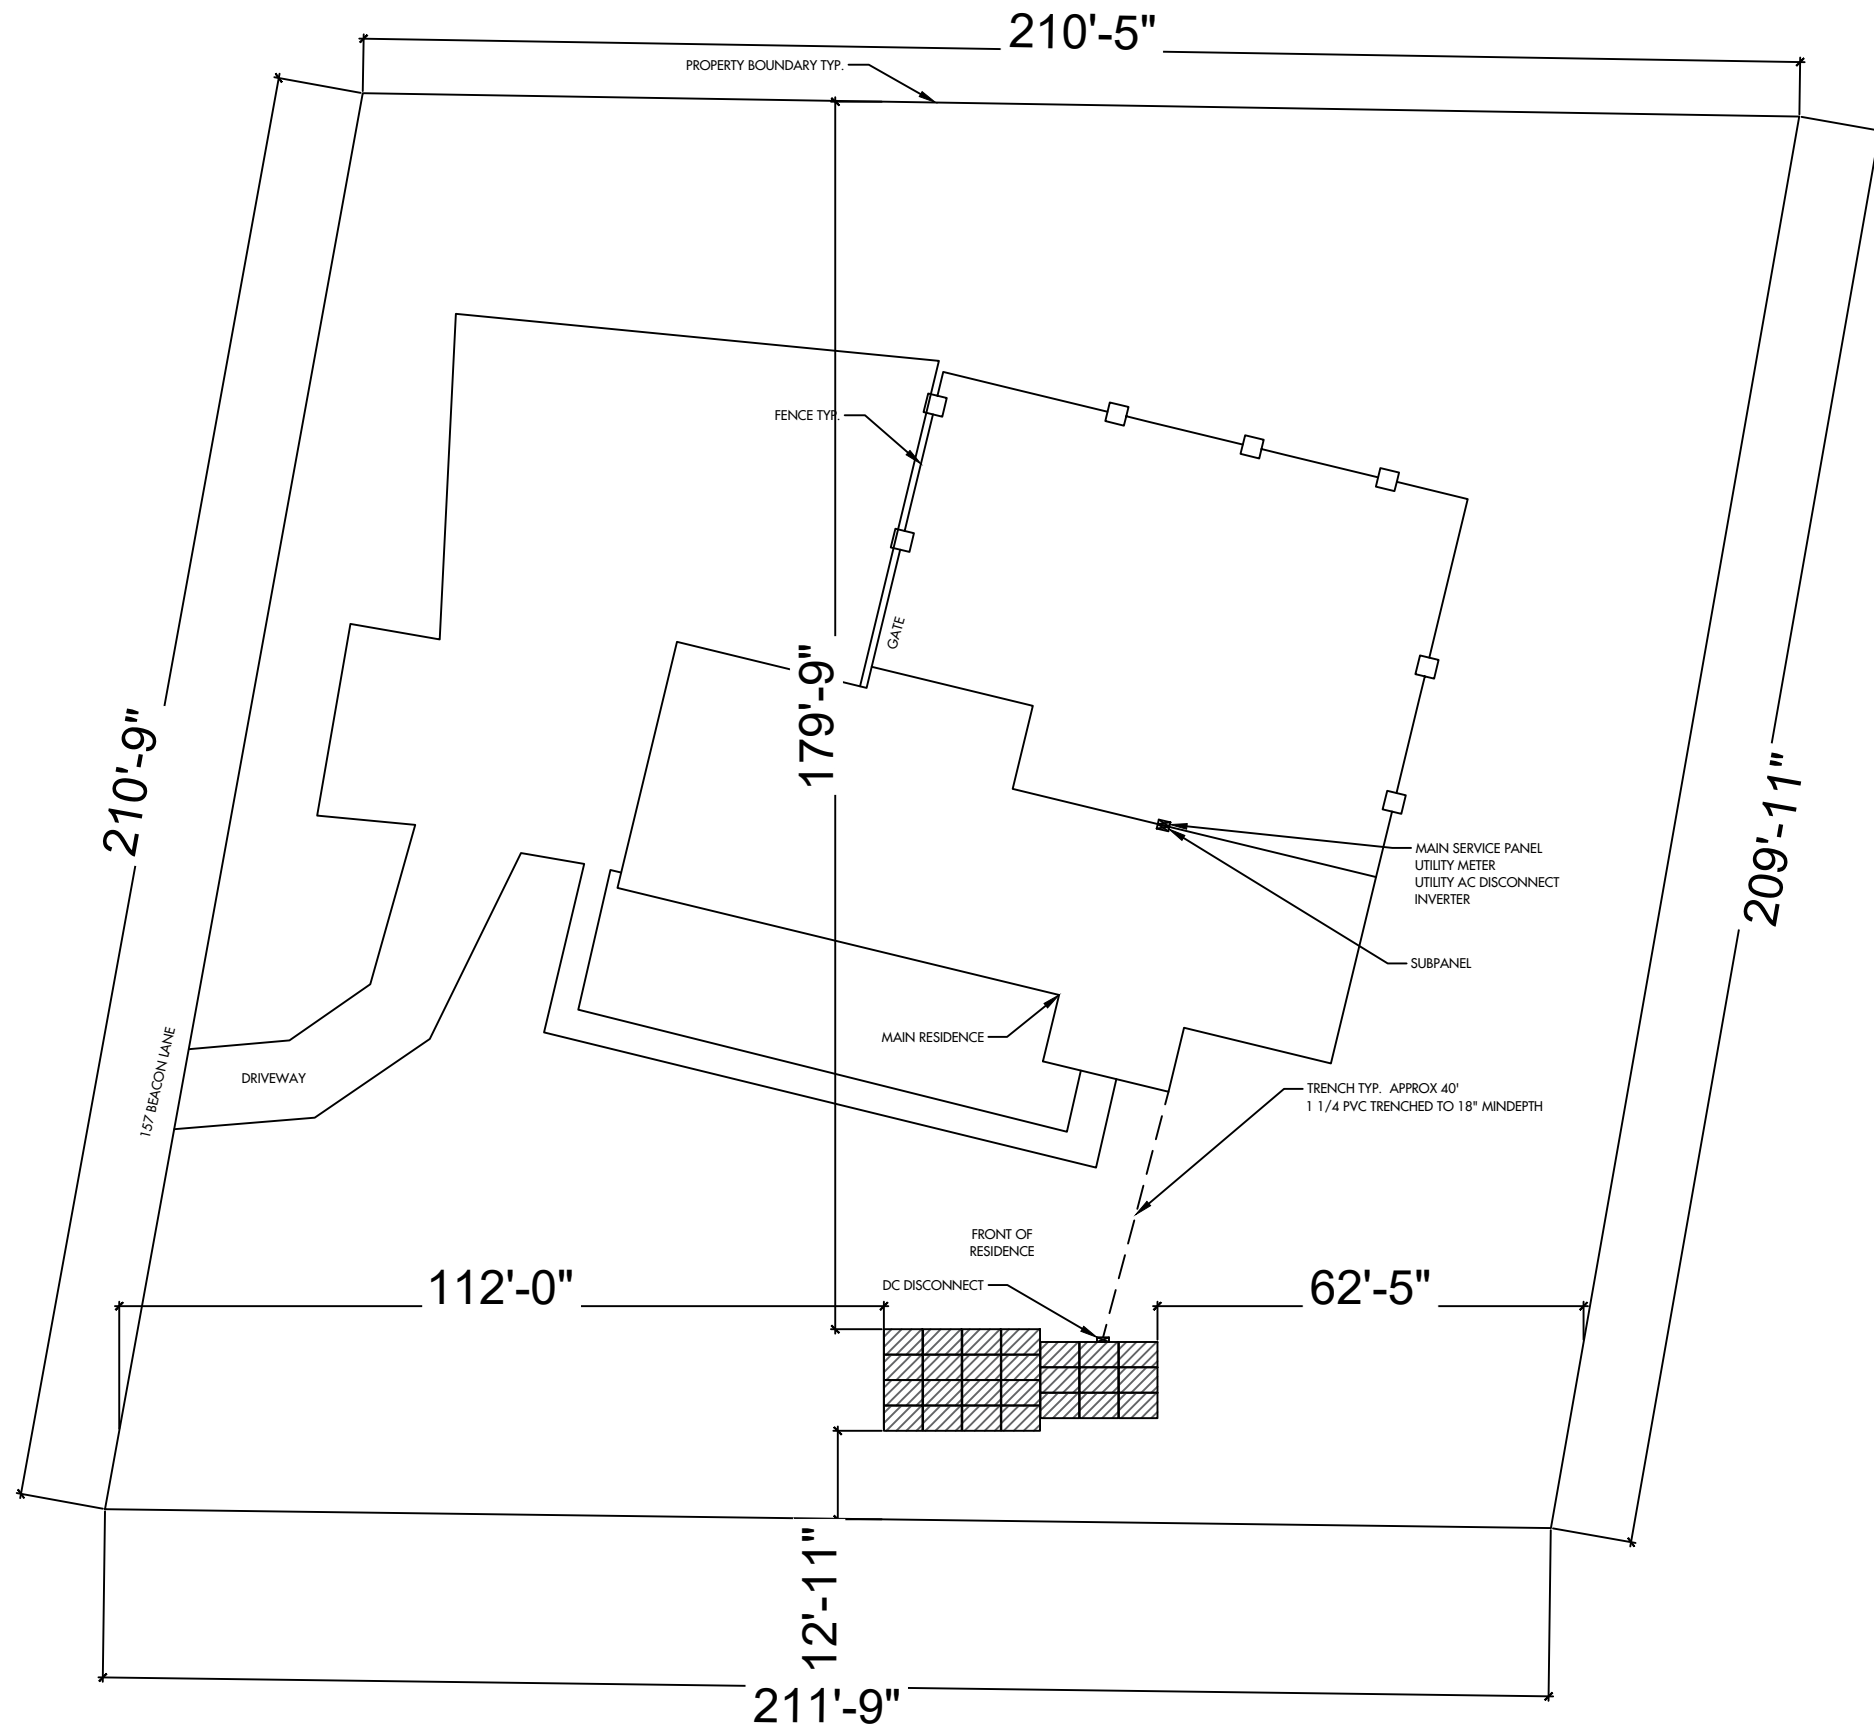

**PROJECT NOTES**

1. UTILITY SHALL HAVE 24HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC COMPONENTS LOCATED AT SES EQUIPMENT
2. NO LOCKED GATES, DOGS, ETC SHALL IMPEDE ACCESS TO SES EQUIPMENT
3. WORKSPACE IN FRONT OF AC ELECTRICAL SYSTEM COMPONENTS SHALL BE IN ACCORDANCE WITH CENTRAL ELECTRIC MEMBERSHIP CORPORATION AND NEC REQUIREMENTS.

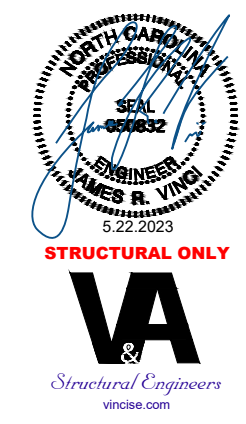

**TITAN**  
**SOLAR POWER**  
 525 W BASELINE RD., MESA AZ, 85210  
 CONTRACTOR LIC# U.34445

NANCE, WILLIAM RESIDENCE  
 157 BEACON LANE , CAMERON, NC, 28326  
 LAT:35.272757, LON:-79.099212  
 TSP157209

(25) HY-DH108P8-400B  
 (1) SOLAREEDGE SE7600H-US  
 10.000 kW DC SYSTEM SIZE  
 7.600 kW AC SYSTEM SIZE

SCALE: 9/256" = 1'-0"  
 DATE: 5/19/2023  
 REV: A  
 DRAWN BY: CA

SEAL:

SITE PLAN  
**PV 2**

ARRAY INFORMATION

AR-01

QUANTITY: 25


MOUNTING TYPE: FLUSH

ARRAY TILT: 25°

AZIMUTH: 180°

ATTACHMENT SPACING: 4'



ROOF TYPE: GROUND H

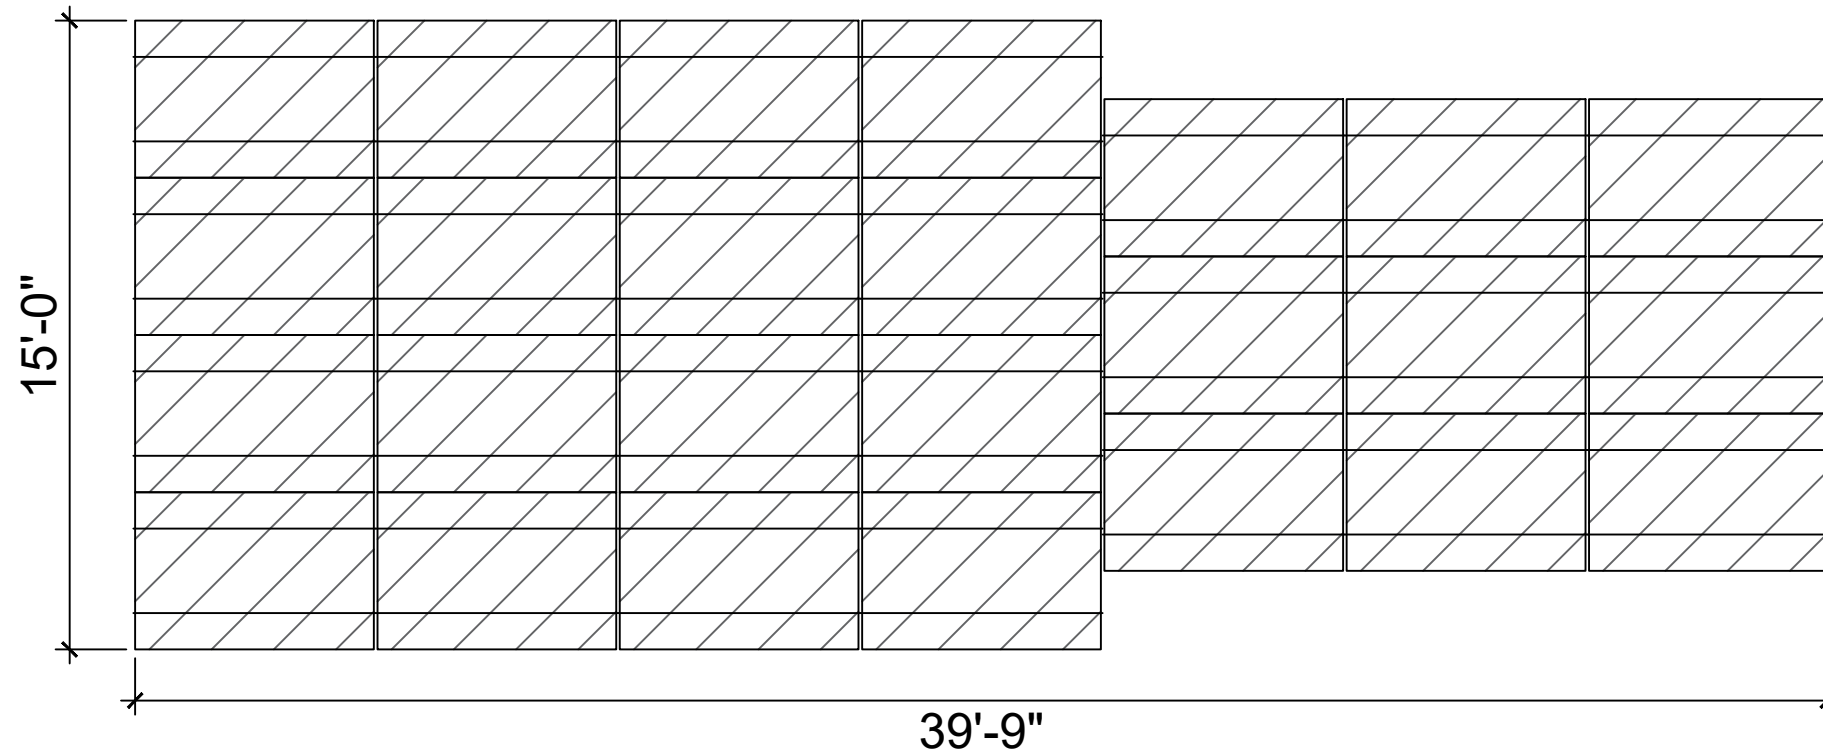

NOTES

- ROOF VENTS, SKYLIGHTS, WILL NOT BE COVERED UPON PV INSTALLATION
- TOTAL ROOF AREA = 3741 SQ-FT
- TOTAL ARRAY AREA = 525.57 SQ-FT
- ARRAY COVERAGE = 14.05%
- GROUND TYPE:C
- LOCATION OF SEPTIC TANK IS UNKNOWN

AR-01  
↓

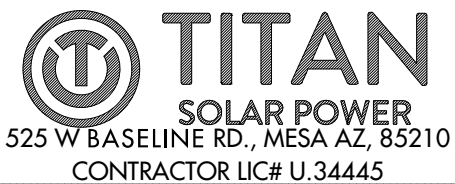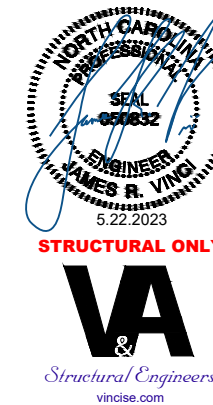

NANCE, WILLIAM RESIDENCE  
 157 BEACON LANE , CAMERON, NC, 28326  
 LAT:35.272757, LON:-79.099212  
 TSP157209

(25) HY-DH108P8-400B  
 (1) SOLAREEDGE SE7600H-US  
 10.000 kW DC SYSTEM SIZE  
 7.600 kW AC SYSTEM SIZE

SCALE: 7/32" = 1'-0"  
 DATE: 5/19/2023  
 REV:A  
 DRAWN BY: CA

SEAL:

PV LAYOUT  
PV 3

**MODULE & RACKING INFORMATION**






MODULE: HY-DH108P8-400B  
 MODULE WEIGHT: 49.80 LBS  
 MODULE DIMENSIONS: 67.8" x 44.65" x 1.5"  
 RACKING/RAIL: XR1000 / XR1000 RAIL CANTILEVER  
 ROOF ATTACHMENT : HELICAL PILE PACKAGE - U.S.

**HELICAL  
 ROOF & FRAMING INFORMATION**  
 MATERIAL: GROUND H  
 RAFTER/TRUSS SIZE: " x "  
 RAFTER/TRUSS SPACING: 2'



**ARRAY 01: 25 MODULES**

UPLIFT = 15767.03 LBS.  
 POINT LOAD = 0.00 LBS. PER MOUNTING POINT  
 PULLOUT STRENGTH = 0.00 LBS.  
 DISTRIBUTED LOAD = 2.54 PSF  
 MODULE & RACKING WEIGHT = 1332.50 LBS

Sub array #1					
Rows	4	Columns	7	# Arrays	1
Area	39' 9" (EW) x 15' 2" (NS)	Rail type	XR1000	Diagonal bracing	no
E/W spacing	12' 10"	Rail cantilever	3' 6"	Pipe cantilever	7"
Piers/array	8	Total south piers	4 (3' 11")	Total north piers	4 (8' 2")
Total cross pipes	2 (39' 9")	Total pipe length	127' 9"	Cut back modules	3
Shear	1,138 lbs	Moment	2,845 ft-lbs	Uplift	-1,382 lbs

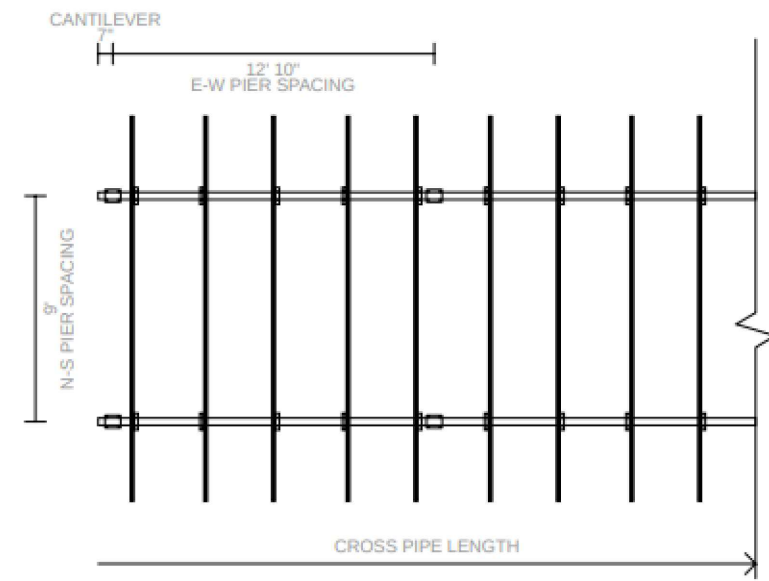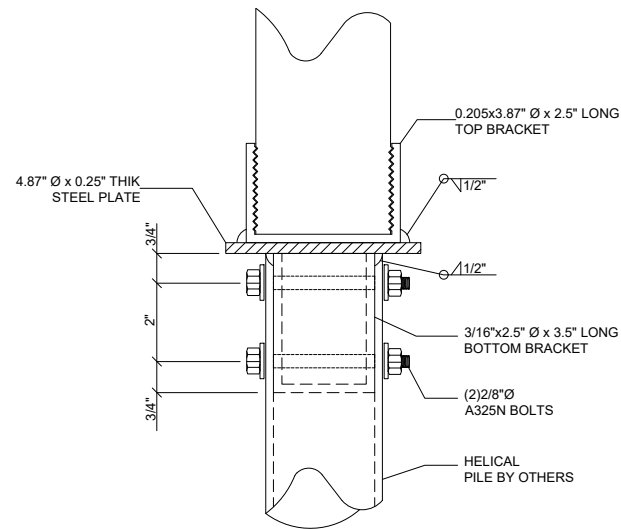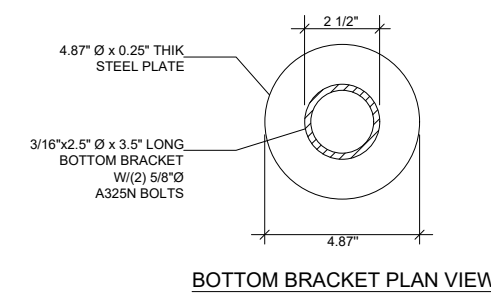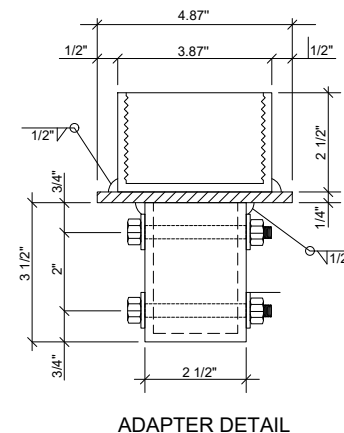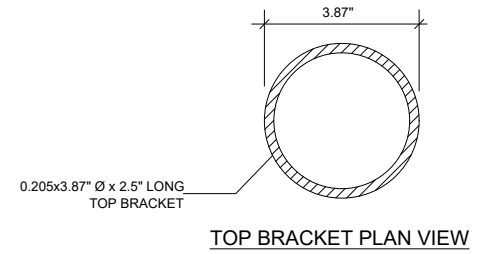

**3" SCHED 40  
 PIPE**

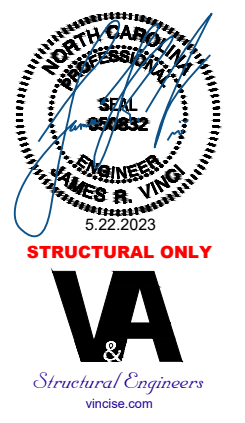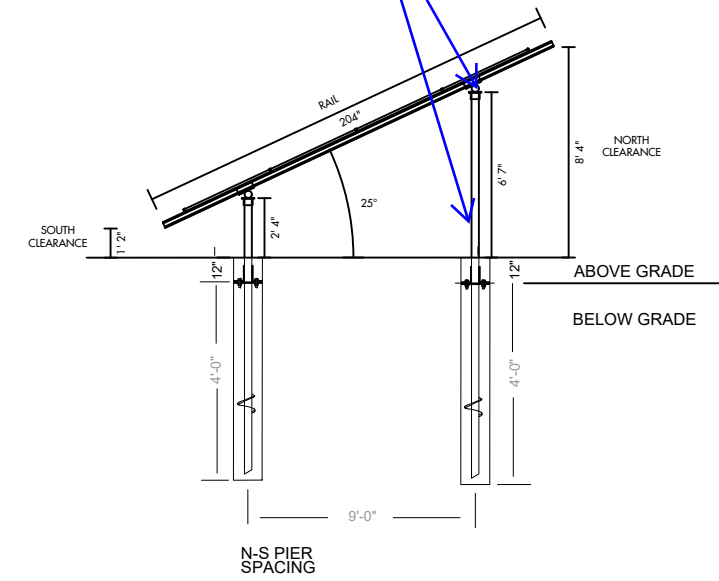

NANCE, WILLIAM RESIDENCE  
 157 BEACON LANE, CAMERON, NC, 28326  
 LAT:35.272757, LON:-79.099212  
 TSP157209

(25) HY-DH108P8-400B  
 (1) SOLAREdge SE7600H-US  
 10.000 kW DC SYSTEM SIZE  
 7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
 REV:A  
 DRAWN BY: CA

SEAL:


DETAILS  
**PV 4**

**PV MODULE**

HY-DH108P8-400B  
 W = 400 W  
 ISC = 13.79 ADC  
 VOC = 37.07 VDC  
 IMP = 12.90 ADC  
 VMP = 31.21 VDC  
 TVOC = -0.304% / °C

**WIRE SCHEDULE**

- A - (4) #10 AWG-CU PV WIRE (HR)  
 (1) #10 AWG-CU BARE COPPER WIRE (GND) IN FREE AIR
- B - (4) #10 AWG-CU THWN-2 WIRE (HR)  
 (1) #10 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT
- C - (3) #8 AWG-CU THWN-2 WIRE (HR)  
 (1) #8 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT
- D- EXISTING WIRING
- E - (4) #10 AWG-CU THWN-2 WIRE (HR)  
 (1) #10 AWG-CU THWN-2 WIRE (GND)  
 1 1/4" PVC TRENCHED TO 18" MINDEPTH

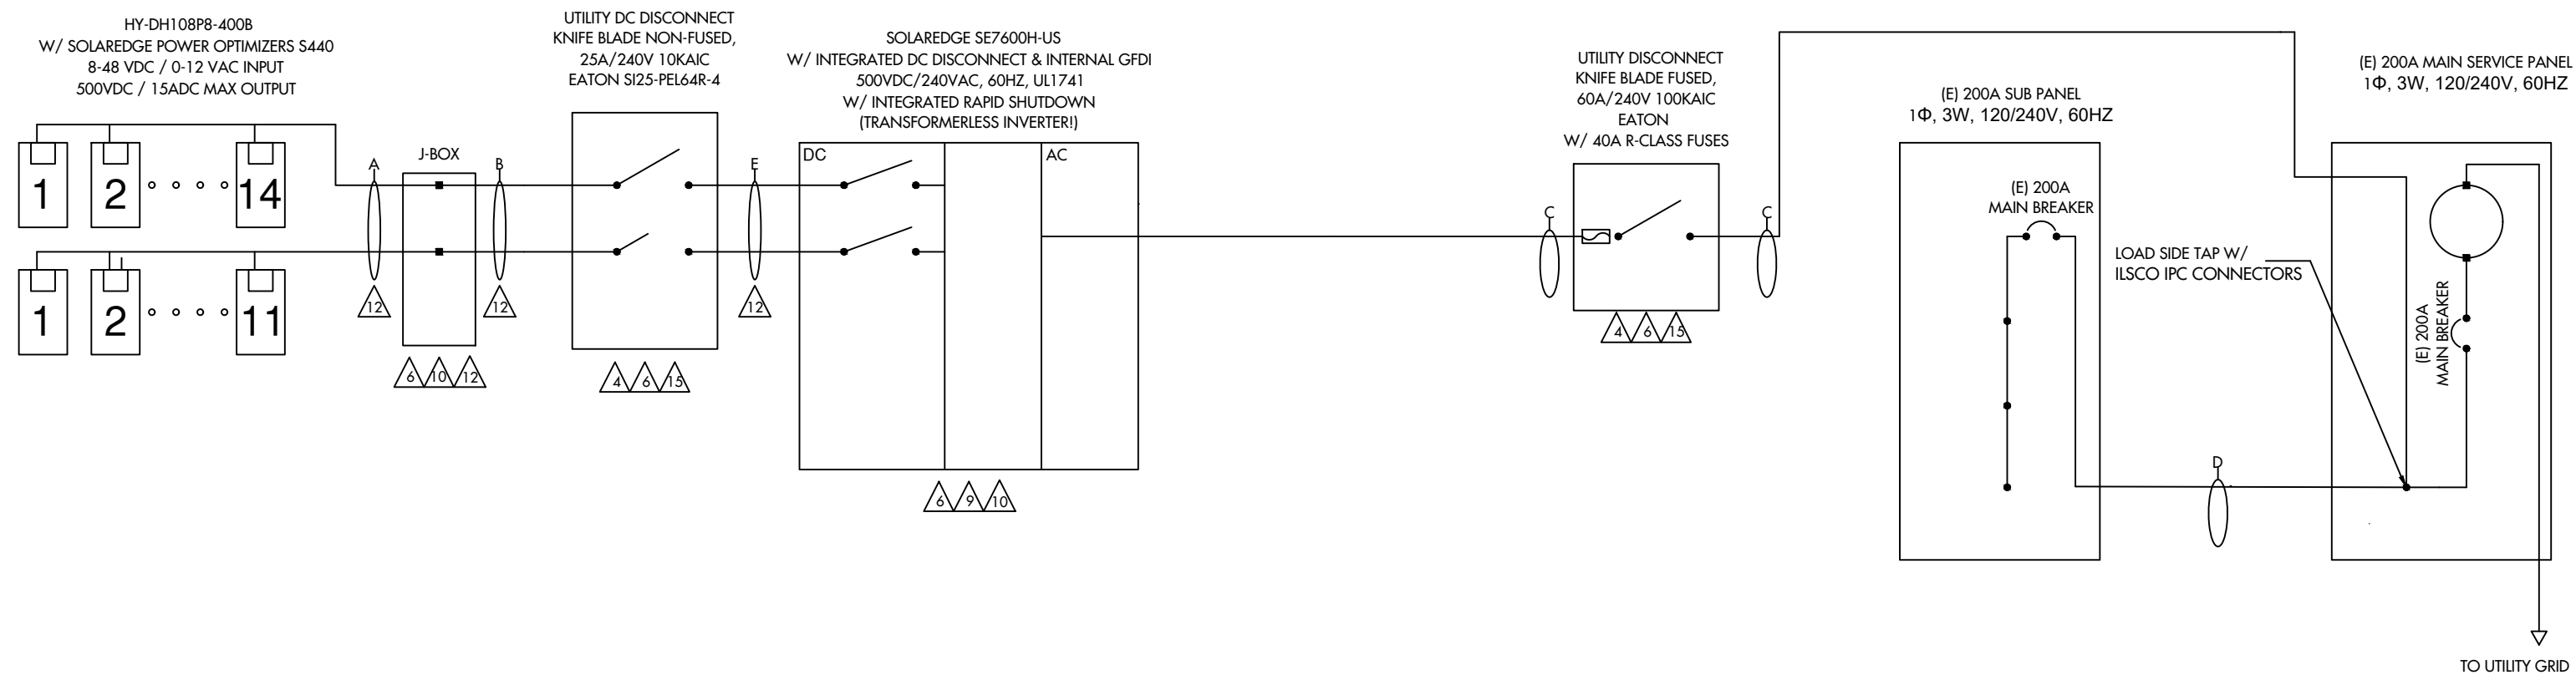


**WIRE SIZE CALCULATIONS**

TEMP CORRECTION FACTOR: 0.87 (43° AMBIENT)  
 ROOFTOP TEMP CORRECTION FACTOR: 1.00 (43° ADJUSTED)  
 (2" ABOVE ROOFTOP / 0° TEMP ADDERS - AS OCCURS)  
 (TEMP DATA TAKEN FROM ASHRAE 2% AVG HIGH TEMP)

**DC WIRING**  
 CONDUIT FILL FACTOR = 0.80  
 OPTIMIZER MAX. CURRENT = 18.75A DC (15.00A X 1 X 1.25)  
 #10- AWG CU. AMPACITY = 47.85A (55A X 0.87)  
 FREE AIR  
 #10 - AWG CU. AMPACITY = 27.84A (40A X 0.87 X 0.80)  
 ROOFTOP CONDUIT

**AC WIRING**  
 CONDUIT FILL FACTOR = 1 (3) CONDUCTORS  
 MAX. INVERTER CURRENT = 32A (PER INVERTER SPECS)  
 MIN. INVERTER OCP = 40A (32A X 1.25)  
 INVERTER OCP = 40A  
 #8 - AWG CU AMPACITY = 47.85A (55A X 1 X 0.87)

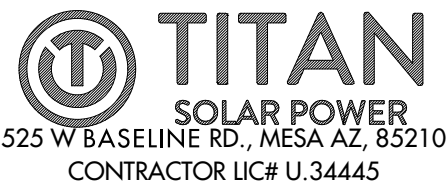

NANCE, WILLIAM RESIDENCE  
 157 BEACON LANE, CAMERON, NC, 28326  
 LAT:35.272757, LON:-79.099212  
 TSP157209

(25) HY-DH108P8-400B  
 (1) SOLAREDGE SE7600H-US  
 10.000 kW DC SYSTEM SIZE  
 7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
 REV:A  
 DRAWN BY: CA

SEAL:


ONE LINE  
**PV 5**

**PV MODULE**

HY-DH108P8-400B  
 W = 400 W  
 ISC = 13.79 ADC  
 VOC = 37.07 VDC  
 IMP = 12.90 ADC  
 VMP = 31.21 VDC  
 TVOC = -0.304% / °C

**WIRE SCHEDULE**

- A - (4) #10 AWG-CU PV WIRE (HR)  
 (1) #10 AWG-CU BARE COPPER WIRE (GND) IN FREE AIR
- B - (4) #10 AWG-CU THWN-2 WIRE (HR)  
 (1) #10 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT
- C - (3) #8 AWG-CU THWN-2 WIRE (HR)  
 (1) #8 AWG-CU THWN-2 WIRE (GND)  
 3/4" EMT
- D - EXISTING WIRING
- E - (4) #10 AWG-CU THWN-2 WIRE (HR)  
 (1) #10 AWG-CU THWN-2 WIRE (GND)  
 1 1/4" PVC TRENCHED TO 18" MINDEPTH

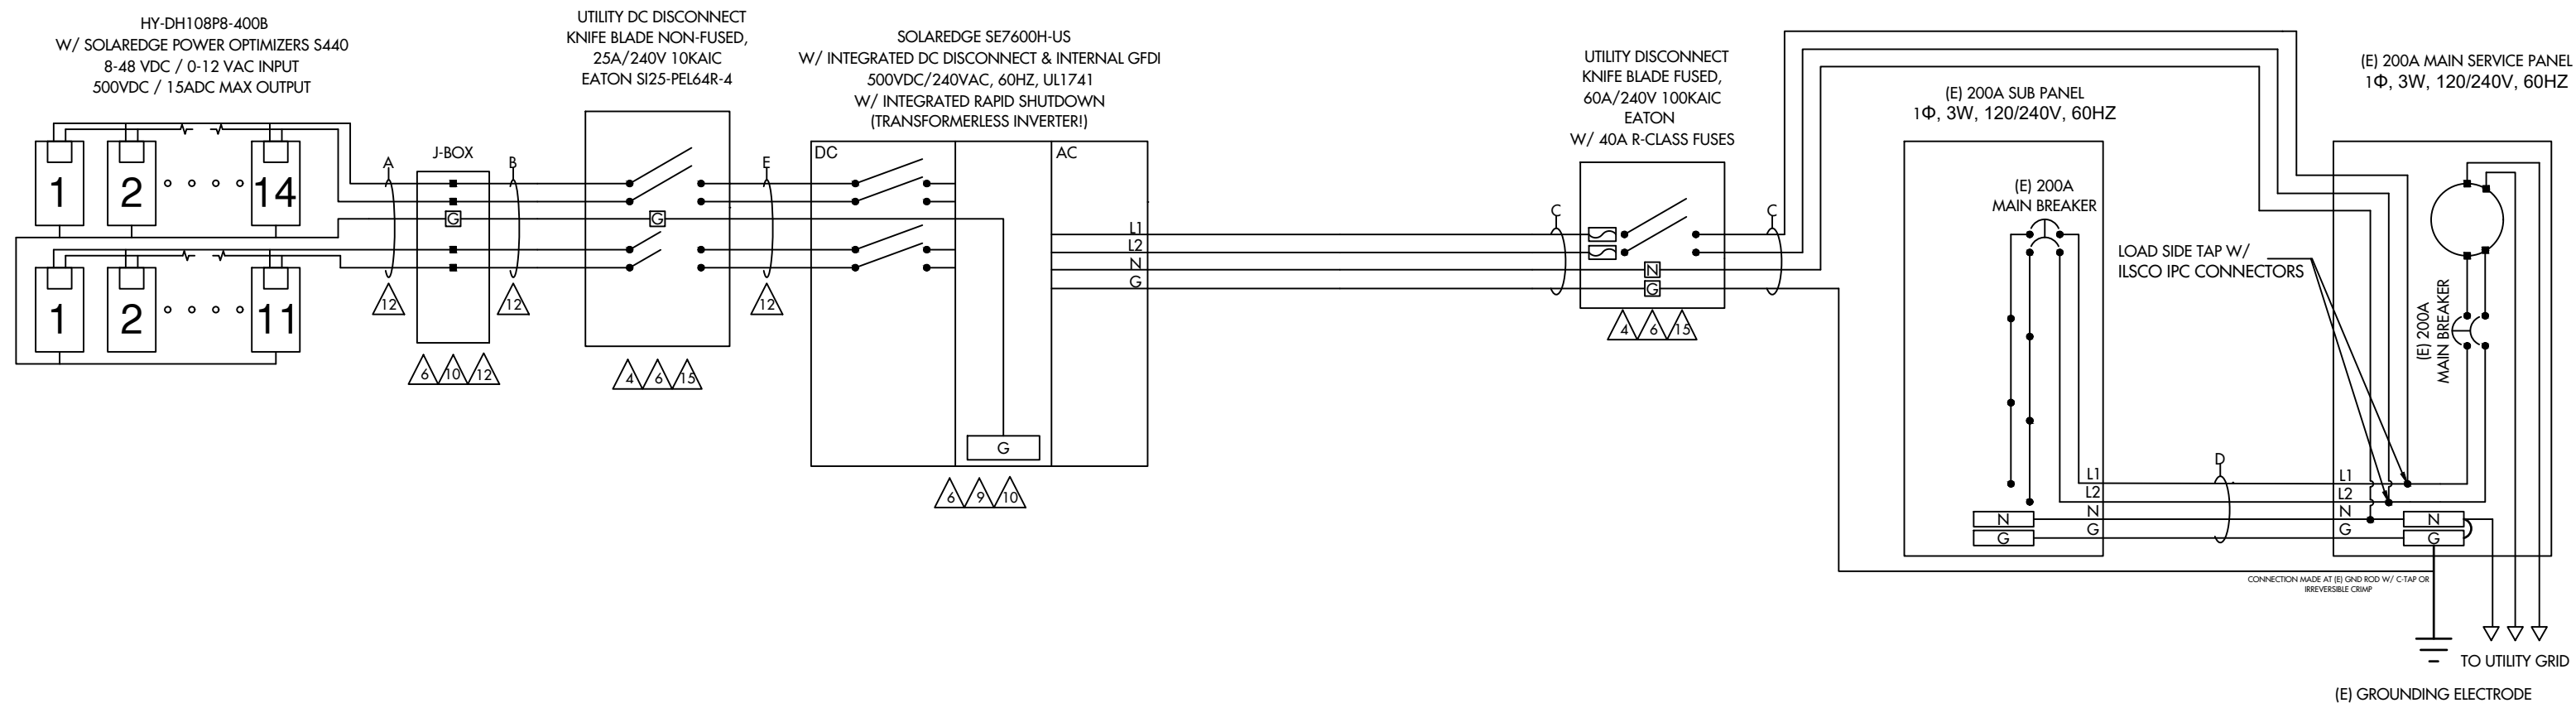


**WIRE SIZE CALCULATIONS**

TEMP CORRECTION FACTOR: 0.87 (43° AMBIENT)  
 ROOFTOP TEMP CORRECTION FACTOR: 1.00 (43° ADJUSTED)  
 (2" ABOVE ROOFTOP / 0° TEMP ADDERS - AS OCCURS)  
 (TEMP DATA TAKEN FROM ASHRAE 2% AVG HIGH TEMP)

**DC WIRING**  
 CONDUIT FILL FACTOR = 0.80  
 OPTIMIZER MAX. CURRENT = 18.75A DC (15.00A X 1 X 1.25)  
 #10- AWG CU. AMPACITY = 47.85A (55A X 0.87)  
 FREE AIR  
 #10 - AWG CU. AMPACITY = 27.84A (40A X 0.87 X 0.80)  
 ROOFTOP CONDUIT

**AC WIRING**  
 CONDUIT FILL FACTOR = 1 (3) CONDUCTORS  
 MAX. INVERTER CURRENT = 32A (PER INVERTER SPECS)  
 MIN. INVERTER OCP = 40A (32A X 1.25)  
 INVERTER OCP = 40A  
 #8 - AWG CU AMPACITY = 47.85A (55A X 1 X 0.87)

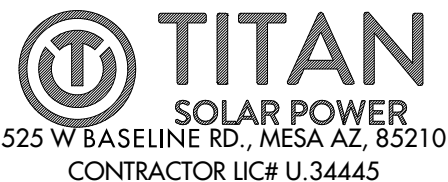

NANCE, WILLIAM RESIDENCE  
 157 BEACON LANE, CAMERON, NC, 28326  
 LAT:35.272757, LON:-79.099212  
 TSP157209

(25) HY-DH108P8-400B  
 (1) SOLAREEDGE SE7600H-US  
 10.000 kW DC SYSTEM SIZE  
 7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
 REV:A  
 DRAWN BY: CA

SEAL:

THREE LINE  
**PV 6**

1 **CAUTION**  
PHOTOVOLTAIC SYSTEM CIRCUIT IS BACKFED  
LOCATION: BACKFED BREAKER  
CODE REF: NEC 705.12(4)

2 **WARNING**  
INVERTER OUTPUT CONNECTION:  
DO NOT RELOCATE THIS  
OVERCURRENT DEVICE  
LOCATION: BACKFED BREAKER  
CODE REF: 2017 NEC 705.12(2)(3)(b)

3 **WARNING**  
A GENERATION SOURCE IS CONNECTED TO THE SUPPLY  
(UTILITY) SIDE OF THE MAIN SERVICE DISCONNECT. FOLLOW  
THE PROPER LOCK-OUT/TAG-OUT PROCEDURES TO ENSURE  
THE PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH IS  
OPENED PRIOR TO PERFORMING WORK ON THIS DEVICE  
LOCATION: (IF APPLICABLE)  
SUPPLY SIDE TAP  
LOAD PANEL  
CODE REF: UTILITY

4 **PHOTOVOLTAIC AC DISCONNECT**  
RATED AC OPERATING CURRENT: 32A AC  
NOMINAL OPERATING AC VOLTAGE: 240VAC  
LOCATION: MAIN PANEL  
AC DISCONNECT(S)  
CODE REF: NEC 690.54

5 **RAPID SHUTDOWN  
SWITCH FOR  
SOLAR PV SYSTEM**  
LOCATION: MAIN PANEL (EXTERIOR)  
PV BREAKER (INTERIOR)  
CODE REF: NEC 690.56(C)(3)

6 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
LOCATION: COMBINER PANEL  
AC DISCONNECT  
JUNCTION BOX  
INVERTER(S)  
CODE REF: NEC 690.13(B)

7 **PHOTOVOLTAIC  
SYSTEM METER**  
LOCATION: DEDICATED KWH METER  
CODE REF: NEC 690.4(B) UTILITY

8 **WARNING**  
PHOTOVOLTAIC SYSTEM  
COMBINER PANEL  
DO NOT ADD LOADS  
LOCATION: AC COMBINER PANEL  
CODE REF: NEC 690.13(B)

9 **PHOTOVOLTAIC SYSTEM DC DISCONNECT**  
MAXIMUM VOLTAGE: 480VDC  
MAXIMUM CIRCUIT CURRENT: 15.0ADC  
MAX. RATED OUTPUT CURRENT OF  
THE CHARGE CONTROLLER OR DC-  
TO-DC- CONVERTER (IF INSTALLED) 15.0ADC  
LOCATION: DC DISCONNECT  
INVERTER  
CODE REF: UTILITY

10 **WARNING**  
ELECTRICAL SHOCK HAZARD  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION  
DC VOLTAGE IS ALWAYS PRESENT  
WHEN SOLAR MODULES ARE  
EXPOSED TO SUNLIGHT  
LOCATION: DC DISCONNECT, COMBINE BOX  
CODE REF: NEC 690.13(B)

11 **SOLAR PV SYSTEM EQUIPPED  
WITH RAPID SHUTDOWN**  
TURN RAPID SHUTDOWN  
SWITCH TO THE "OFF"  
POSITION TO SHUT DOWN  
PV SYSTEM AND REDUCE  
SHOCK HAZARD IN THE  
ARRAY.  
LOCATION: MAIN SERVICE (OUTSIDE COVER)  
CODE REF: NEC 690.12  
NEC 690.56(C)(1)(a)  
YELLOW STICKER

12 **WARNING PHOTOVOLTAIC POWER SOURCE**  
LOCATION: DC CONDUIT  
JUNCTION BOX  
NO MORE THAN 10FT  
CODE REF: NEC 690.31(G)(3)  
NEC 690.31(G)(4)  
REFLECTIVE AND WEATHER RESISTANT

LABEL REQUIRES CAPITALIZED LETTERS WITH A MINIMUM HEIGHT OF 3/8 INCH, WHITE LETTERS ON RED BACKGROUND  
LABELS SHALL BE PLACED ON INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, AND CABLE ASSEMBLIES  
EVERY 10 FEET, WITHIN 1 FOOT OF TURNS OR BENDS AND WITHIN 1 FOOT ABOVE AND BELOW PENETRATIONS OF  
ROOF/CEILING ASSEMBLIES, WALLS OR BARRIERS.

13 **CAUTION**  
DUAL POWER SOURCE  
SECOND SOURCE IS  
PHOTOVOLTAIC  
LOCATION: SERVICE METER  
MAIN PANEL

14 **WARNING**  
INVERTER OUTPUT CONNECTION  
DO NOT RELOCATE THIS  
OVERCURRENT DEVICE  
LOCATION: (IF APPLICABLE)  
SERVICE PANEL  
CODE REF: NEC 705.12(7)

15 **PHOTOVOLTAIC SYSTEM  
UTILITY DISCONNECT SYSTEM**  
LOCATION: AC DISCONNECT  
CODE REF: UTILITY

16 **PV SOLAR BREAKER**  
DO NOT RELOCATE THIS  
OVERCURRENT DEVICE  
LOCATION: MAIN PANEL:(EXTERIOR)  
PV BREAKER: (INTERIOR)  
CODE REF: NEC 705.12(B)(2)(3)(B)



NANCE, WILLIAM RESIDENCE  
157 BEACON LANE , CAMERON, NC, 28326  
LAT:35.272757, LON:-79.099212  
TSP157209

(25) HY-DH108P8-400B  
(1) SOLAREEDGE SE7600H-US  
10.000 kW DC SYSTEM SIZE  
7.600 kW AC SYSTEM SIZE


DATE: 5/19/2023  
REV: A  
DRAWN BY: CA

SEAL:


LABELS  
PV 7

# CAUTION

POWER TO THIS BUILDING IS  
SUPPLIED FROM THE FOLLOWING  
SOURCES WITH DISCONNECTS AS  
SHOWN:

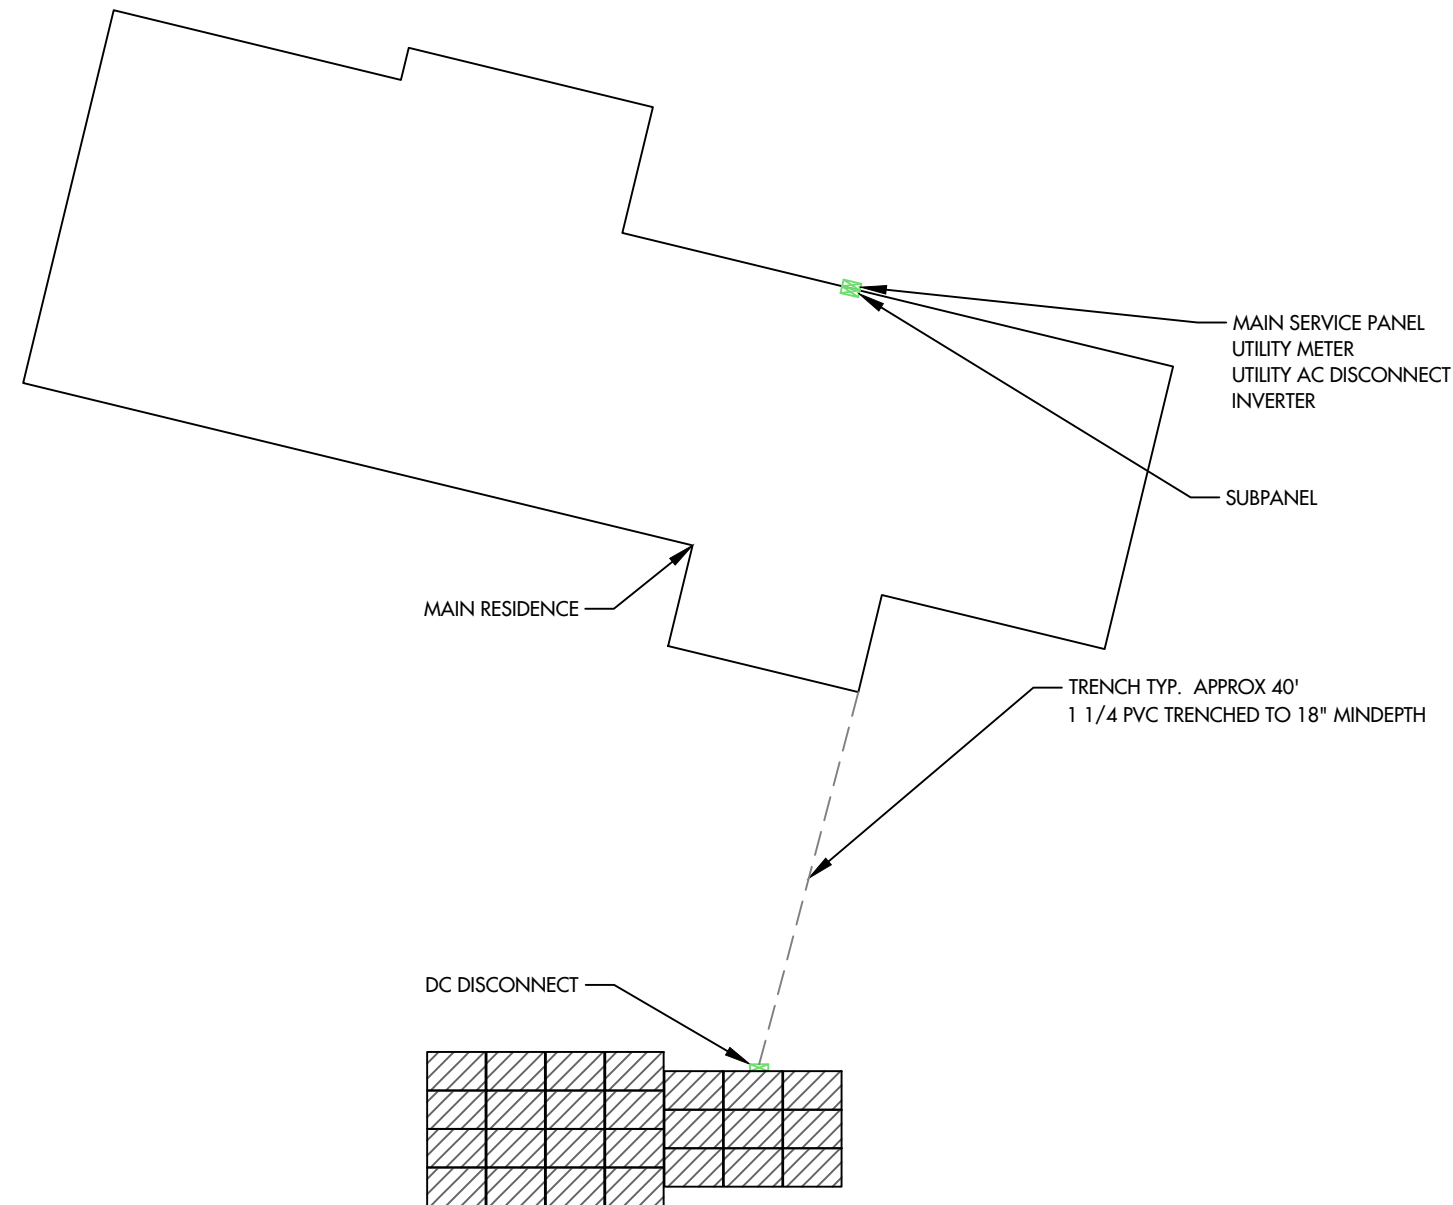

DIRECTORY PLAQUE IN  
ACCORDANCE WITH  
NEC690.56(A)(B), 705.10

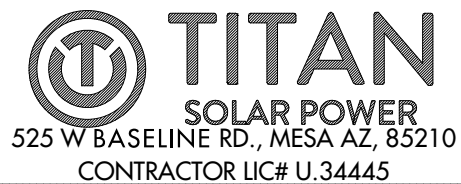

NANCE, WILLIAM RESIDENCE  
157 BEACON LANE , CAMERON, NC, 28326  
LAT:35.272757, LON:-79.099212  
TSP157209

(25) HY-DH108P8-400B  
(1) SOLAREDGE SE7600H-US  
10.000 kW DC SYSTEM SIZE  
7.600 kW AC SYSTEM SIZE




DATE: 5/19/2023  
REV: A  
DRAWN BY: CA

SEAL:

PLACARD  
PV 8



# JOB SAFETY PLAN

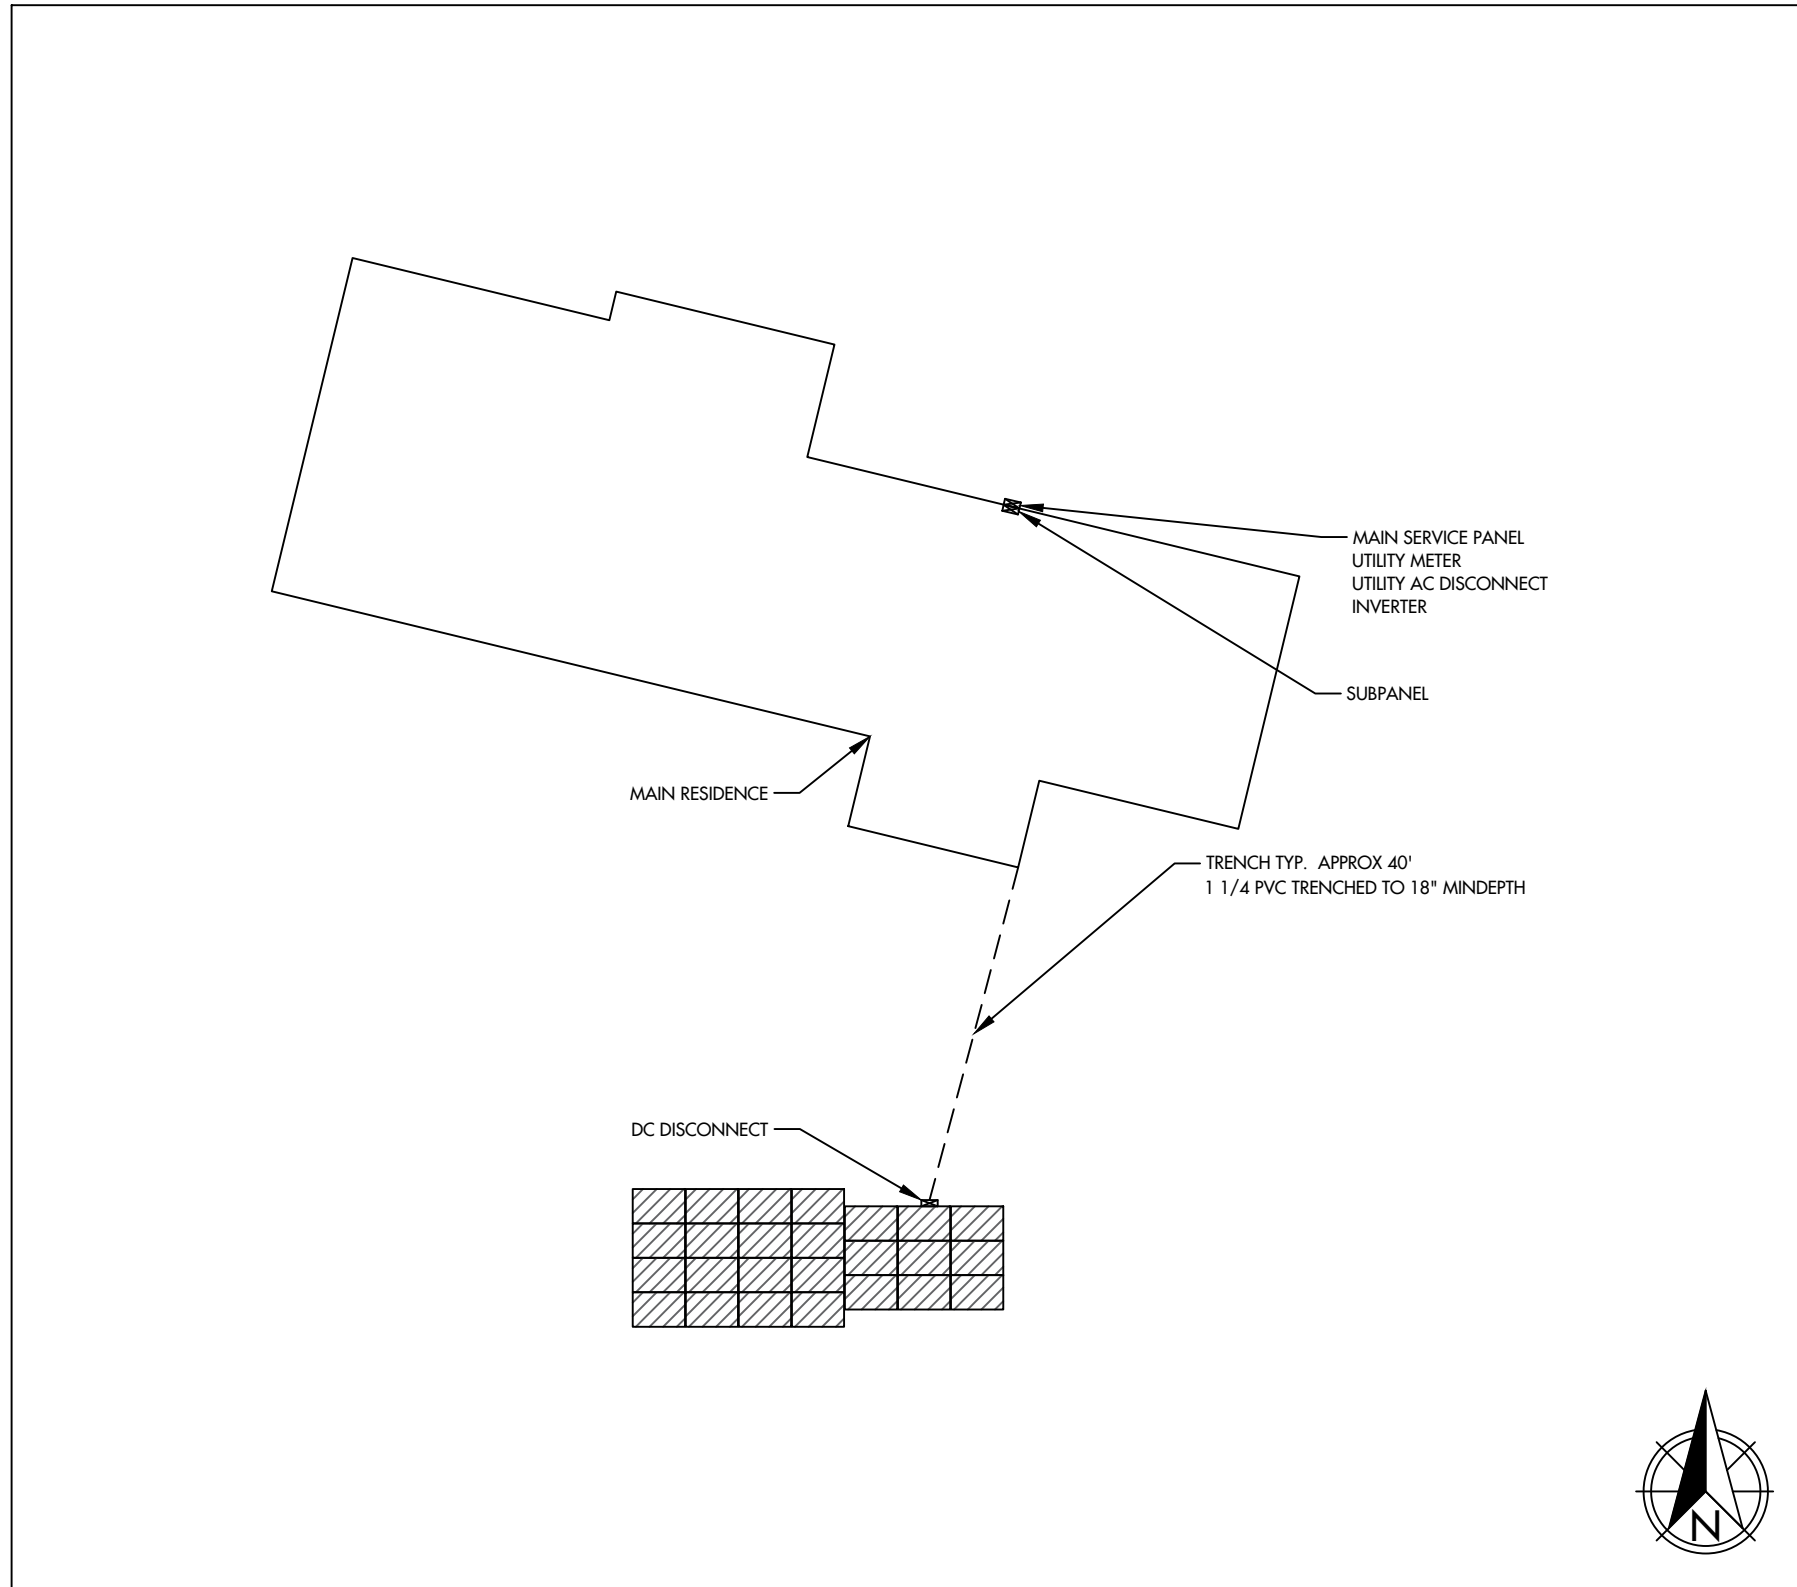

LOCATION OF NEAREST URGENT CARE FACILITY

NAME:

ADDRESS:

PHONE NUMBER:

NOTES:

- INSTALLER SHALL DRAW IN DESIGNATED SAFETY AREA AROUND HOME
- INSTALLER SHALL UPDATE NAME, ADDRESS, AND PHONE NUMBER OF NEAREST URGENT CARE FACILITY RELATIVE TO THE JOB SITE BEFORE STARTING WORK.

PRINT NAME	INITIAL	YES	NO



# Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

INVERTERS

12-25 YEAR WARRANTY



## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
APPLICABLE TO INVERTERS WITH PART NUMBER	SEXXXXH-XXXXXBXX4							
<b>OUTPUT</b>								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac
AC Frequency (Nominal)	59.3 - 60 - 60.5 <sup>(1)</sup>							Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A
Power Factor	1, Adjustable - 0.85 to 0.85							
GFDI Threshold	1							A
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes							
<b>INPUT</b>								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded	Yes							
Maximum Input Voltage	480							Vdc
Nominal DC Input Voltage	380							Vdc
Maximum Input Current @240V <sup>(2)</sup>	8.5	10.5	13.5	16.5	20	27	30.5	A
Maximum Input Current @208V <sup>(2)</sup>	-	9	-	13.5	-	-	27	A
Max. Input Short Circuit Current	45							A
Reverse-Polarity Protection	Yes							
Ground-Fault Isolation Detection	600ka Sensitivity							
Maximum Inverter Efficiency	99	99.2						%
CEC Weighted Efficiency	99 @ 240V 98.5 @ 208V							%
Nighttime Power Consumption	< 2.5							W

(1) For other regional settings please contact SolarEdge support  
(2) A higher current source may be used; the inverter will limit its input current to the values stated

## Single Phase Inverter with HD-Wave Technology for North America


SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US
<b>ADDITIONAL FEATURES</b>							
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)						
Revenue Grade Metering, ANSI C12.20	Optional <sup>(3)</sup>						
Consumption metering	Optional <sup>(3)</sup>						
Inverter Commissioning	With the SetApp mobile application using Built-in Wi-Fi Access Point for Local Connection						
Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect						
<b>STANDARD COMPLIANCE</b>							
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.L.L. M-07						
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (H)						
Emissions	FCC Part 15 Class B						
<b>INSTALLATION SPECIFICATIONS</b>							
AC Output Conduit Size / AWG Range	1" Maximum / 14-6 AWG			1" Maximum / 14-4 AWG			
DC Input Conduit Size / # of Strings / AWG Range	1" Maximum / 1-2 strings / 14-6 AWG			1" Maximum / 1-3 strings / 14-6 AWG			
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 6.8 / 450 x 370 x 174		25.1 / 11.4		26.2 / 11.9		21.3 x 14.6 x 7.3 / 540 x 370 x 185
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.9	38.8 / 17.6	lb / kg		
Noise	< 25			< 50			
Coiling	Natural Convection						
Operating Temperature Range	-40 to +140 / -40 to +60 <sup>(4)</sup>						
Protection Rating	NEMA 4X (Inverter with Safety Switch)						

(3) Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BN4. For consumption metering, current transformers should be ordered separately: SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box  
(4) Full power up to at least 50°C / 122°F; for power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-de-rating-note-na.pdf>

## How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

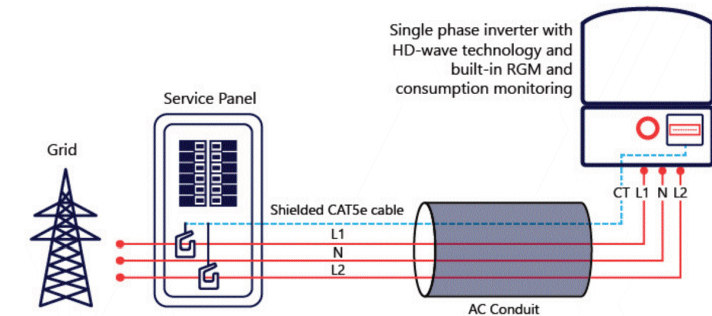

© SolarEdge Technologies, Inc. All rights reserved. SOLAREGE, the SolarEdge logo, OPTIMIZED BY SOLAREGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/2020/V01/ENG NAM. Subject to change without notice.

RoHS

**TITAN**  
SOLAR POWER  
525 W BASELINE RD., MESA AZ, 85210  
CONTRACTOR LIC# U.34445

NANCE, WILLIAM RESIDENCE  
157 BEACON LANE, CAMERON, NC, 28326  
LAT:35.272757, LON:-79.099212  
TSP157209

(25) HY-DH108P8-400B  
(1) SOLAREGE SE7600H-US  
10.000 kW DC SYSTEM SIZE  
7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
REV: A  
DRAWN BY: CA

SEAL:

EQUIPMENT SPECIFICATIONS  
**PV 10**



Intertek  
3933 US Route 11  
Cortland, NY 13045  
Telephone: 607-753-7311  
www.intertek.com

Subject: ETL Evaluation of SolarEdge Products to Rapid Shutdown Requirements

To, whom it may concern

This letter represents the testing results of the below listed products to the requirements contained in the following standards:

The evaluation was done on the PV Rapid Shutdown System (PVRSS), and covers installations consisting of optimizers and inverters with part numbers listed below.

The testing done has verified that controlled conductors are limited to:

- Not more than 30 volts and 240 voltamperes within 30 seconds of rapid shutdown initiation outside the array.
- Not more than 80 volts and 240 voltamperes within 30 seconds of rapid shutdown initiation inside the array.

The rapid shutdown initiation is performed by either disconnecting the AC feed to the inverter, or – if the inverter DC Safety switch is readily accessible – by turning off the DC Safety switch.

**Applicable products:**

- (1) Power optimizers:  
PB followed by 001 to 350; followed by -AOB or -TFI.  
OP followed by 001 to 500; followed by -LV, -MV, -IV or -EV.  
P followed by 001 to 1100.  
SP followed by 001 to 350.  
When optimizers are connected to 2 or more modules in series, the max input voltage may exceed 80V. Following the implementation of the NEC 2017 rapid shutdown value of 80V max inside of the array at the beginning of 2019, modules exceeding this combined input max voltage will be required to use optimizers with parallel inputs. Also meeting NEC 2020 rapid shutdown requirement.
- (2) 1 -PH Inverters  
SE3000A-US / SE3800A-US / SE5000A-US / SE6000A-US / SE7600A-US / SE10000A-US / SE11400A-US / SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US when the following label is labeled on the side of the inverter:

Inverter part number may be followed by a suffix.

- (3) 3 -PH Inverters



Total Quality. Assured.

SE9KUS / SE10KUS / SE14.4KUS / SE16.7kUS / SE17.3KUS / SE20KUS / SE24KUS / SE30KUS / SE33.3KUS / SE40KUS / SE43.2KUS / SE50KUS / SE66.6KUS / SE80KUS / SE85KUS / SE100KUS / SE120KUS; when the following label is labeled on the side of the inverter:

Please note, this Letter Report does not represent authorization for the use of any Intertek certification marks.

**Brand Name(s)** SolarEdge  
**Relevant Standard(s)** UL 1741, UL 1741 CRD for rapid shutdown  
**Verification Issuing Office** National Electric Code, 2020, Section 690.12 requirement for rapid shutdown  
3933 US Route 11, Cortland, NY 13045

NRTL Disclaimer, Different for each NRTL – Example: "This Verification is for the exclusive use of NRTL's Client and is provided pursuant to the agreement between NRTL and its Client. NRTL's responsibility and liability are limited to the terms and conditions of the agreement. NRTL assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Verification. Only the Client is authorized to copy or distribute this Verification. Any use of the NRTL name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by NRTL. The observations and test results referenced from this Verification are relevant only to the sample tested. This Verification by itself does not imply that the material, product, or service is or has ever been under an NRTL certification program."

Signature:


Name: Mukund Rana  
Position: Staff Engineer  
Date: 5/17/2021



Total Quality. Assured.

Intertek  
3933 US Route 11  
Cortland, NY 13045  
Telephone: 607-753-7311  
www.intertek.com

Date	Engineer / Reviewer	Description
5/17/2021 G104683664CRT	Dishant Patel	Added New 3-PH Inverter model SE50KUS, SE80KUS, SE85KUS and SE120KUS.
	Mukund Rana	Updated Power optimizers from "P followed by 001 to 960" to "P followed by 001 to 1100"  Updated NEC standard from "National Electric Code, 2017, Section 690.12 requirement for rapid shutdown" To "National Electric Code, 2020, Section 690.12 requirement for rapid shutdown"

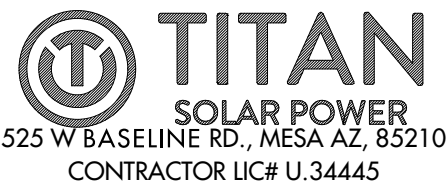

NANCE, WILLIAM RESIDENCE  
157 BEACON LANE , CAMERON, NC, 28326  
LAT:35.272757, LON:-79.099212  
TSP157209

(25) HY-DH108P8-400B  
(1) SOLAREEDGE SE7600H-US  
10.000 kW DC SYSTEM SIZE  
7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
REV: A  
DRAWN BY: CA

SEAL:

EQUIPMENT SPECIFICATIONS  
**PV 11**

# Power Optimizer For Residential Installations

S440 / S500 / S500B



POWER OPTIMIZER

## Enabling PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detects abnormal PV connector behavior, preventing potential safety issues\*
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Faster installations with simplified cable management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules

\*Functionality subject to inverter model and firmware version

[solaredge.com](http://solaredge.com)

**solaredge**

## / Power Optimizer For Residential Installations S440 / S500 / S500B

	S440	S500	S500B	UNIT
<b>INPUT</b>				
Rated Input DC Power <sup>(1)</sup>	440		500	W
Absolute Maximum Input Voltage (Voc)		60	125	Vdc
MPPT Operating Range		8 – 60	12.5 – 105	Vdc
Maximum Short Circuit Current (Isc) of Connected PV Module	14.5		15	Adc
Maximum Efficiency		99.5		%
Weighted Efficiency		98.6		%
Overvoltage Category		II		
<b>OUTPUT DURING OPERATION</b>				
Maximum Output Current		15		Adc
Maximum Output Voltage		60	80	Vdc
<b>OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM INVERTER OR INVERTER OFF)</b>				
Safety Output Voltage per Power Optimizer		1 ± 0.1		Vdc
<b>STANDARD COMPLIANCE<sup>(2)</sup></b>				
EMC	FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3, CISPR11, EN-55011			
Safety	IEC62109-1 (class II safety), UL1741			
Material	UL94 V-0, UV Resistant			
RoHS	Yes			
Fire Safety	VDE-AR-E 2100-712:2018-12			
<b>INSTALLATION SPECIFICATIONS</b>				
Maximum Allowed System Voltage		1000		Vdc
Dimensions (W x L x H)		129 x 155 x 30	129 x 155 x 45	mm
Weight (including cables)		655		gf
Input Connector		MC4 <sup>(3)</sup>		
Input Wire Length		0.1		m
Output Connector		MC4		
Output Wire Length		(+) 2.3, (-) 0.10		m
Operating Temperature Range <sup>(4)</sup>		-40 to +85		°C
Protection Rating		IP68		
Relative Humidity		0 – 100		%

<sup>(1)</sup> Rated power of the module at STC will not exceed the Power Optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed.

<sup>(2)</sup> For details about CE compliance, see [Declaration of Conformity – CE](#).

<sup>(3)</sup> For other connector types please contact SolarEdge.


<sup>(4)</sup> For ambient temperatures above +70°C power de-rating is applied. Refer to [Power Optimizers Temperature De-Rating Technical Note](#) for details.

PV System Design Using a SolarEdge Inverter <sup>(5)</sup>	SolarEdge Home Wave Inverter Single Phase	SolarEdge Home Short String Inverter Three Phase	Three Phase for 230/400V Grid	Three Phase for 277/480V Grid	
Minimum String Length (Power Optimizers)	S440, S500: 8 S500B: 6	9	16	18	
Maximum String Length (Power Optimizers)	25	20	50		
Maximum Continuous Power per String	5700	5625	11250	12750	W
Maximum Allowed Connected Power per String (Permitted only when the power difference between strings is less than 2,000W)	See <sup>(6)</sup>	See <sup>(6)</sup>	13500	15000	W
Parallel Strings of Different Lengths or Orientations			Yes		

<sup>(5)</sup> It is not allowed to mix S-series and P-series Power Optimizers in new installations.

<sup>(6)</sup> If the inverter's rated AC power ≤ maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power.

Refer to [Application Note: Single String Design Guidelines](#).

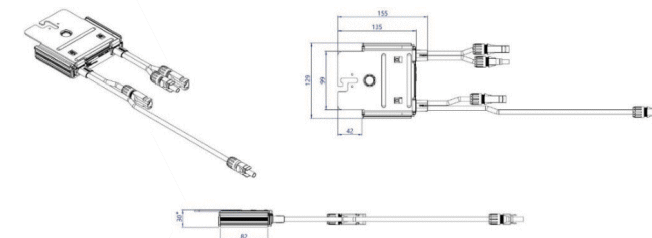

\*45mm for S500B

© SolarEdge Technologies, Ltd. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: November 8, 2022 DS-000091-ENG. Subject to change without notice.

CE RoHS

**TITAN**  
SOLAR POWER  
525 W BASELINE RD., MESA AZ, 85210  
CONTRACTOR LIC# U.34445

NANCE, WILLIAM RESIDENCE  
157 BEACON LANE, CAMERON, NC, 28326  
LAT:35.272757, LON:-79.099212  
TSP157209

(25) HY-DH108P8-400B  
(1) SOLAREEDGE SE7600H-US  
10.000 kW DC SYSTEM SIZE  
7.600 kW AC SYSTEM SIZE

DATE: 5/19/2023  
REV: A  
DRAWN BY: CA

SEAL:

EQUIPMENT  
SPECIFICATIONS  
**PV 12**



**TITAN SOLAR POWER**  
 525 W BASELINE RD  
 MESA, AZ 85210  
 TEL 855 SAY-SOLAR  
 INFO@TITANSOLARPOWER  
 TITANSOLARPOWER.COM

**390-410W**

**HIGH CONVERSION EFFICIENCY**  
 Module efficiency up to 21.0% through advanced cell technology and manufacturing process


**EXCELLENT WEAK LIGHT PERFORMANCE**  
 More power output in weak light condition, such as cloudy days, morning and sunset

**EXTENDED MECHANICAL PERFORMANCE**  
 Module certified to withstand extreme wind (2400 Pa) and snow loading (5400 Pa)

**QUALITY GUARANTEE**  
 High module quality ensures long-term reliability

INFO@HYPERION-USA.COM  
 7/559 MOO.6, MAPYANGPHON SUBDISTRICT,  
 PLUAK DAENG DISTRICT, RAYONG PROVINCE,  
 21140, THAILAND

**HY-DH108P8**  
 108 HALF-CELL BIFACIAL MODULE

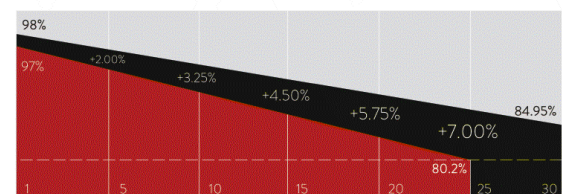

■ Conventional Module ■ Hyperion Performance  
 25 Years warranty for materials and workmanship  
 30 Years warranty for extra linear power output



IEC61215 / IEC61730 / UL61730  
 IEC61701 / IEC62716  
 ISO9001: Quality Management System

12/22

**BLACK DH108P8**

**Mechanical Parameters**


Solar Cell	Mono PERC 182mm
No. of Cells	108 (6 × 18)
Dimensions	1722 × 1134 × 30mm (67.08 × 44.65 × 1.18in.)
Weight	25.2kg (55.55lbs)
Junction Box	IP68 rated (3 bypass diodes)
Output Cables	4mm <sup>2</sup> (IEC), 12 AWG (UL) (-/+1200mm (47.24in.) or customized)
Connector	EVO2 or customized
Front Cover	2.0mm (0.079in.) semi-tempered AR glass
Back Cover	2.0mm (0.079in.) semi-tempered glass
Container	36 pcs/Pallet, 792 pcs/40' HC

**Operating Parameters**

Max. System Voltage	DC 1500V (IEC/UL)
Operating Temperature	-40°C ~ +85°C (-40°F ~ +185°F)
Max. Fuse Rating	30A
Frontside Max. Loading	5400Pa (112lb/ft <sup>2</sup> )
Backside Max. Loading	2400Pa (50lb/ft <sup>2</sup> )
Bifaciality	70%±10%
Fire Resistance	IEC Class A, UL Type 29

**HY-DH108P8-390/410B**

**Engineering Drawing**

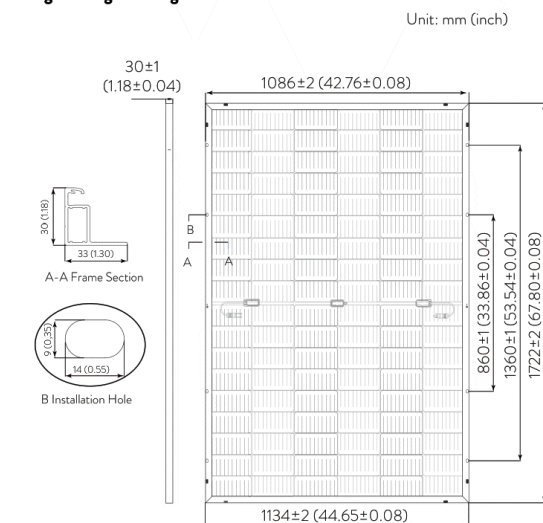

**Electrical Characteristics - STC**

	Irradiance 1000 W/m <sup>2</sup> , ambient temperature 25 °C, AM1.5				
Maximum Power at STC (Pmax/W)	410	405	400	395	390
Power Tolerance (W)	0 ~ +5				
Optimum Operating Voltage (Vmp/V)	31.45	31.21	31.01	30.84	30.64
Optimum Operating Current (Imp/A)	13.04	12.98	12.90	12.81	12.73
Open Circuit Voltage (Voc/V)	37.32	37.23	37.07	36.98	36.85
Short Circuit Current (Isc/A)	13.95	13.87	13.79	13.70	13.61
Module Efficiency	21.0%	20.7%	20.5%	20.2%	20.0%

**Electrical Characteristics - NMOT**


	Irradiance 800 W/m <sup>2</sup> , ambient temperature 20 °C, AM1.5, wind speed 1 m/s.				
Maximum Power at NMOT (Pmax/W)	310.2	306.4	302.5	298.8	295.0
Optimum Operating Voltage (Vmp/V)	29.82	29.60	29.41	29.25	29.15
Optimum Operating Current (Imp/A)	10.40	10.35	10.29	10.22	10.15
Open Circuit Voltage (Voc/V)	35.39	35.31	35.15	35.07	34.95
Short Circuit Current (Isc/A)	11.25	11.19	11.13	11.05	10.98

**Rearside Power Gain (Reference to 410W Front)**

	5%	15%	25%
Rearside Power Gain	5%	15%	25%
Maximum Power (Pmax/W)	431.4	472.3	514.8
Optimum Operating Voltage (Vmp/V)	31.57	31.57	31.65
Optimum Operating Current (Imp/A)	13.66	14.96	16.27
Open Circuit Voltage (Voc/V)	37.46	37.46	37.46
Short Circuit Current (Isc/A)	14.57	15.96	17.35
Module Efficiency	22.1%	24.2%	26.4%

**Temperature Characteristics**

Nominal Module Operating Temperature	42 ± 2 °C
Nominal Cell Operating Temperature	45 ± 2 °C
Temperature Coefficient of Pmax	-0.35%/°C
Temperature Coefficient of Voc	-0.27%/°C
Temperature Coefficient of Isc	0.05%/°C

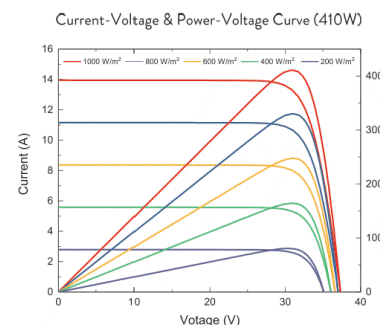

©Copyright 2022 HYPERION  
 HY-DH108P8-EN-V1.4 US  
 www.hyperion-usa.com



NANCE, WILLIAM RESIDENCE  
 157 BEACON LANE, CAMERON, NC, 28326  
 LAT:35.272757, LON:-79.099212  
 TSP157209

(25) HY-DH108P8-400B  
 (1) SOLAREEDGE SE7600H-US  
 10.000 kW DC SYSTEM SIZE  
 7.600 kW AC SYSTEM SIZE




DATE: 5/19/2023  
 REV: A  
 DRAWN BY: CA

SEAL:

EQUIPMENT SPECIFICATIONS  
**PV 13**

Grounding Diagram

Bill of Materials

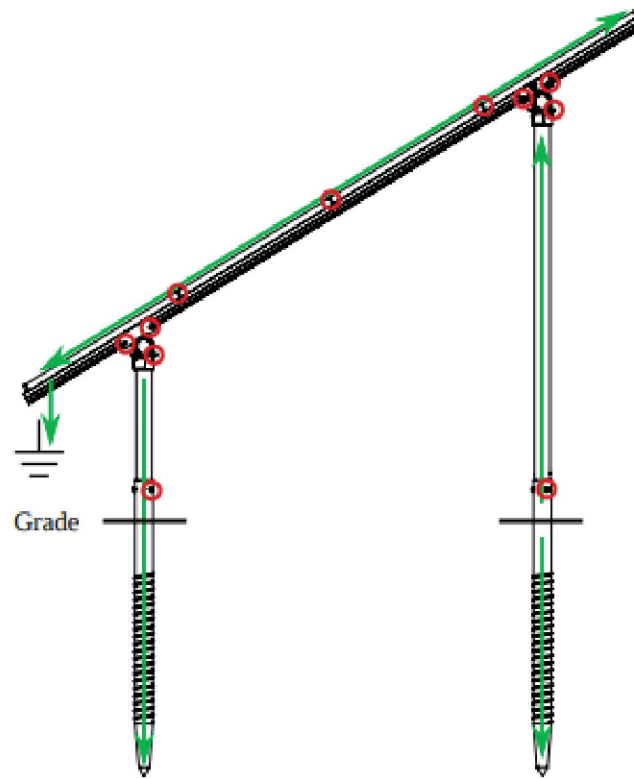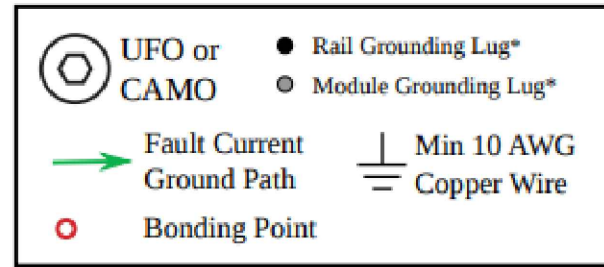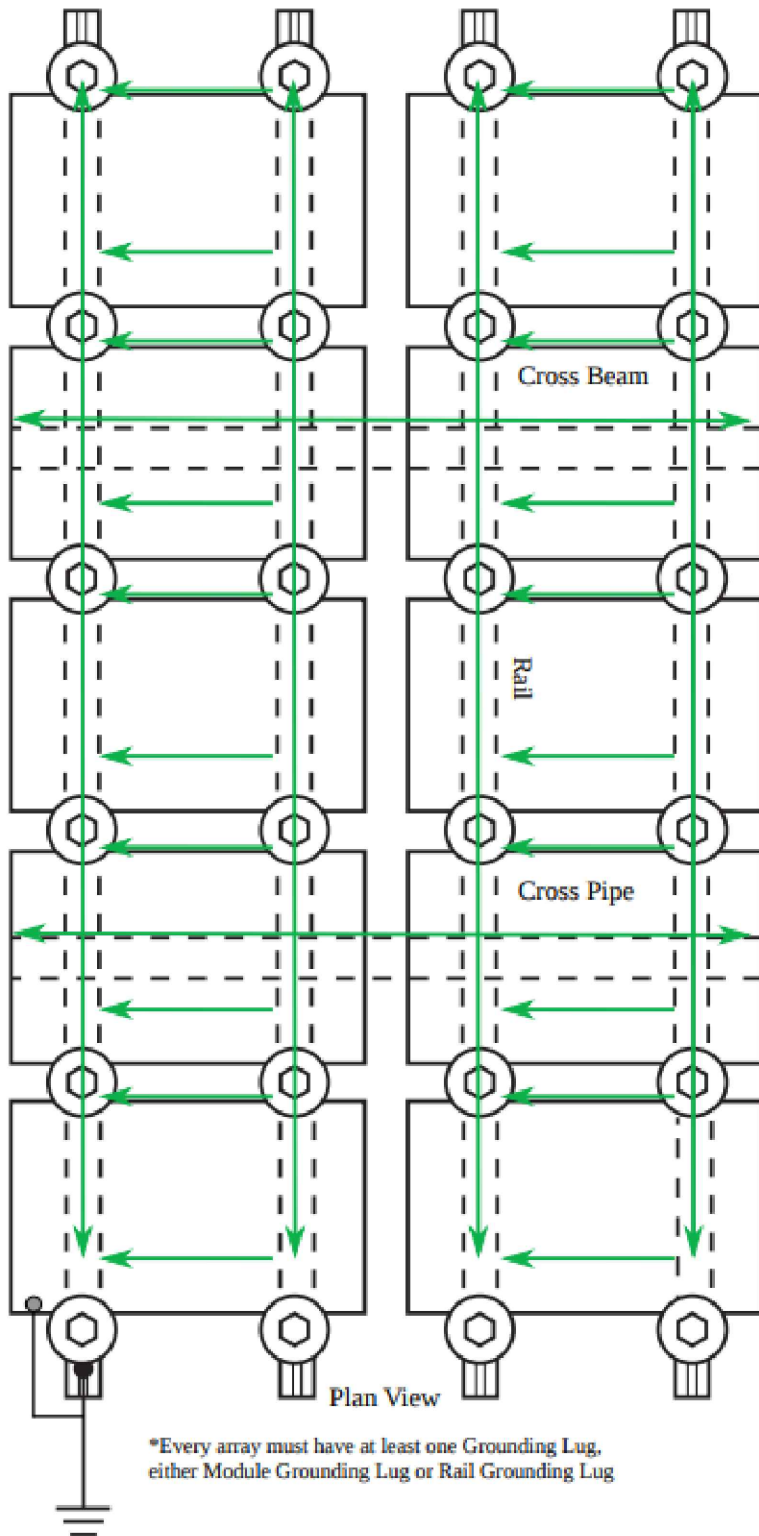

Section View


\*Grounding Lugs and wire are not required in systems using certain Enphase microinverters or certain Sunpower modules. Equipment grounding is achieved with the Engage cable for Enphase or the AC module cable system for Sunpower via their integrated EGC.

\*Every array must have at least one Grounding Lug, either Module Grounding Lug or Rail Grounding Lug


Part	Spares	Total Qty
<b>Rails</b>		
XR-1000-204A XR1000, Rail 204" (17 Feet) Clear	0	14
<b>Clamps &amp; Grounding</b>		
UFO-CL-01-A1 Universal Module Clamp, Clear	0	64
UFO-STP-30MM-M1 Stopper Sleeve, 30MM, Mill	0	28
XR-LUG-03-A1 Grounding Lug, Low Profile	0	1
<b>Substructure</b>		
70-0300-SGA SGA Top Cap at 3"	0	8
GM-BRC3-01-M1 Ground Mount Bonded Rail Connector - 3"	0	28
GM-HSHW-01-M1 Hex Head Set Screw	0	32

Pipe Fitting Detail

XR1000 Rail

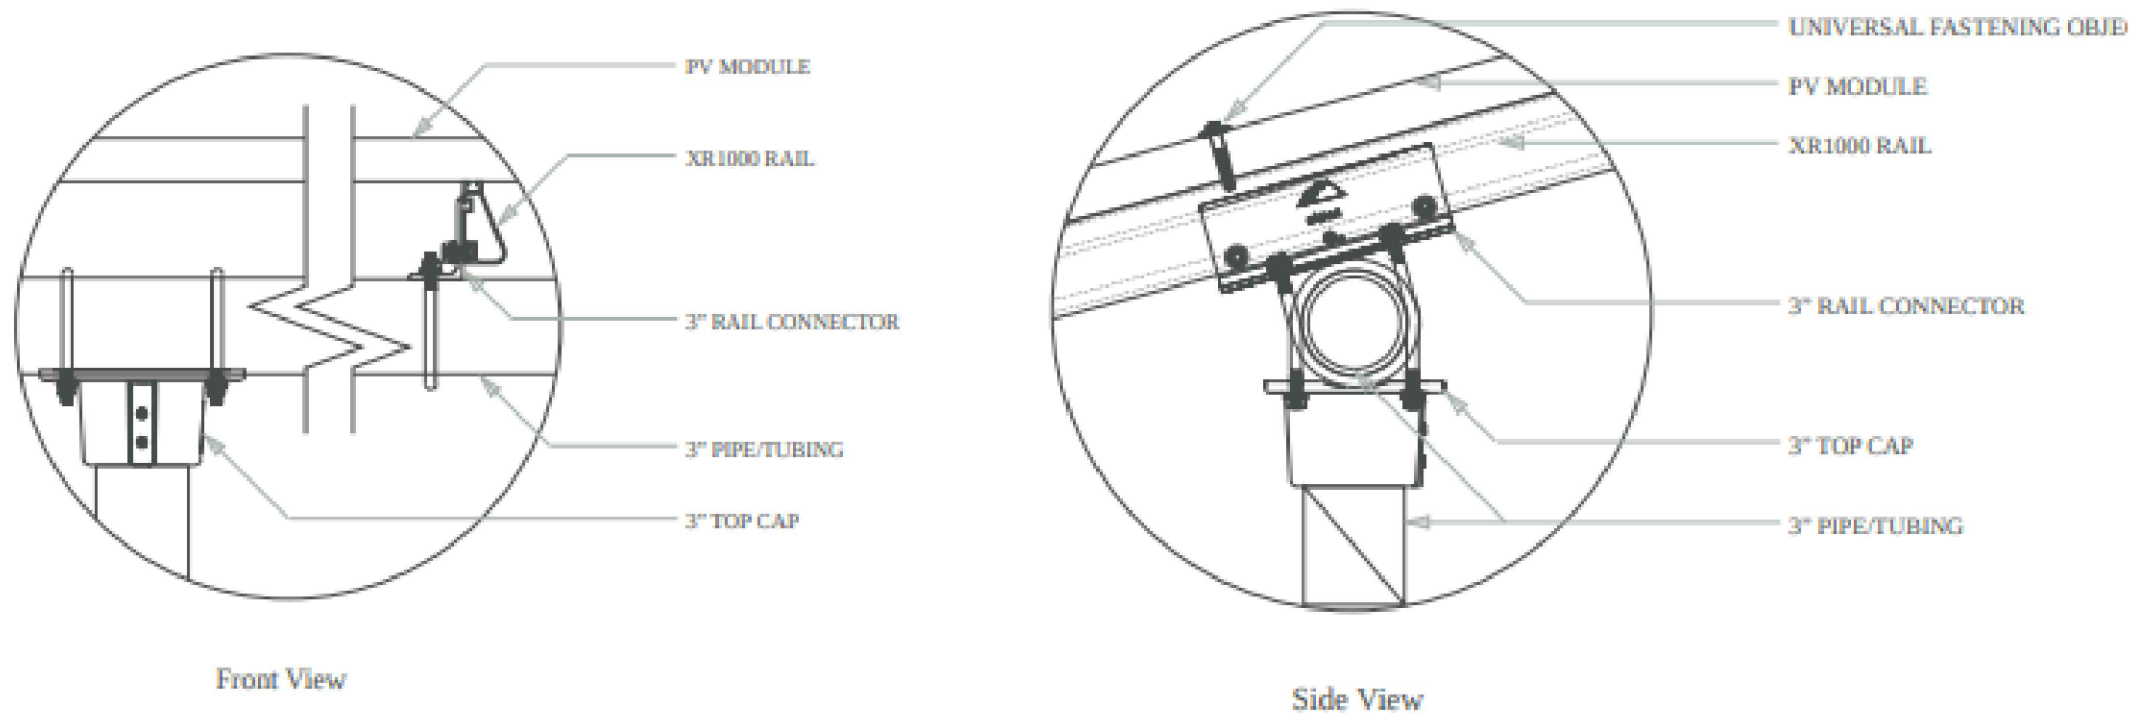

Clamp Detail

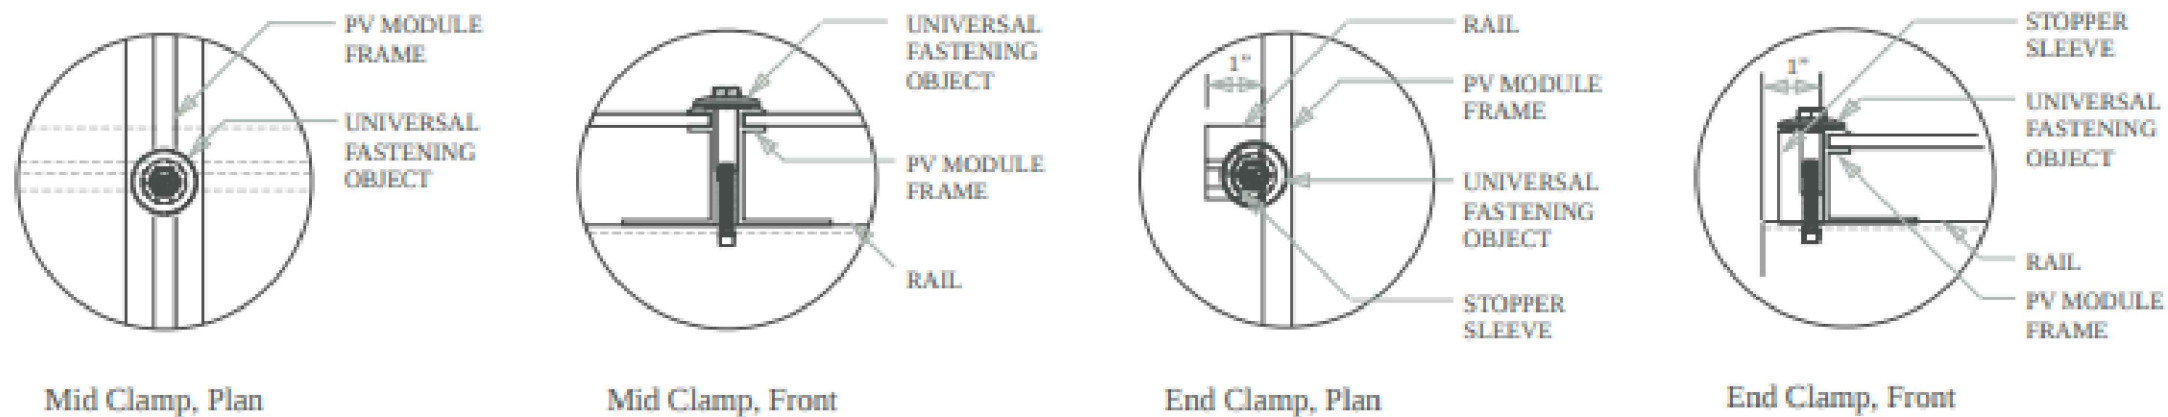

### Recommended OCPD Size per Grid

Inverter	Maximum Output Current (A)	Minimum Fuse Rating (A)	Maximum Fuse Rating (A)
SE3000H-US	12.5	20	50
SE3800H-US	16	20	50
SE5000H-US	24 @ 208V 21 @ 240V	30	50
SE6000H-US	24 @ 208V 25 @ 240V	30 @ 208V 35 @ 240V	50
SE7600H-US	32	40	50
SE10000H-US	42	60	80
SE11400H-US	48.5 @ 208V 47.5 @ 240V	70 @ 208V 60 @ 240V	80

SolarEdge Single Phase Inverter with HD-Wave Technology Installation MAN-01-00541-1.1



# Rotary Actuator Switch - Lockable Off in Plastic Enclosure

- Rotary Actuator Switch
- Lockable Off - Safe-Lock
- Self-Extinguishing Plastic Enclosure
- M25 Cable Gland Entry Option
- NEMA Type 3R
- IP66



DC21A IEC60947-3				UL Ratings UL5081				Poles in series	No. of strings	Weight Kg/pcs	Part Number	Contact configuration
600V	800V	1000V	1500V	350V	500V	600V	1000V					
16A	16A	9A	3A	16A	16A	16A	-	2	1	0.43	SI16 PEL64R2	
25A	20A	11A	4A	20A	20A	20A	-	2	1	0.43	SI25 PEL64R2	
32A	23A	13A	5A	25A	25A	25A	-	2	1	0.43	SI32 PEL64R2	
40A	30A	20A	6A	40A	40A	40A	16A	2	1	1.59	SI40 PEL64R2	
55A	45A	36A*	8A	55A	55A	55A	20A	2	1	1.59	SI55 PEL64R2	
29A	16A	9A	3A	29A	29A	21A	-	2	1	0.49	SI16 PEL64R2H	
45A	20A	11A	4A	45A	38A	23A	-	2	1	0.49	SI25 PEL64R2H	
50A	23A	13A	5A	58A	40A	25A	-	2	1	0.49	SI32 PEL64R2H	
84A	30A	20A	6A	72A	53A	42A	22A	2	1	1.74	SI40 PEL64R2H	
80A	45A	25A	8A	85A	66A	55A	25A	2	1	1.74	SI55 PEL64R2H	
16A	16A	9A	3A	16A	16A	16A	-	2	2	0.46	SI16 PEL64R4	
25A	20A	11A	4A	20A	20A	20A	-	2	2	0.46	SI25 PEL64R4	
32A	23A	13A	5A	25A	25A	25A	-	2	2	0.46	SI32 PEL64R4	
40A	30A	20A	6A	40A	40A	40A	16A	2	2	1.67	SI40 PEL64R4	
55A	45A	36A*	8A	55A	55A	55A	20A	2	2	1.67	SI55 PEL64R4	
16A	16A	16A	16A	16A	16A	16A	-	4	1	0.47	SI16 PEL64R4S	
25A	25A	25A	20A	25A	25A	25A	-	4	1	0.47	SI25 PEL64R4S	
32A	32A	32A	23A	32A	32A	32A	-	4	1	0.47	SI32 PEL64R4S	
40A	40A	40A	30A	40A	40A	40A	40A	4	1	1.70	SI40 PEL64R4S	
55A	55A	55A	40A	55A	55A	55A	55A	4	1	1.70	SI55 PEL64R4S	
16A	16A	9A	3A	16A	16A	16A	-	2	3	1.53	SI16 PEL64R6	
25A	20A	11A	4A	20A	20A	20A	-	2	3	1.53	SI25 PEL64R6	
32A	23A	13A	5A	25A	25A	25A	-	2	3	1.53	SI32 PEL64R6	
16A	16A	9A	3A	16A	16A	16A	-	2	4	1.58	SI16 PEL64R8	
25A	20A	11A	4A	20A	20A	20A	-	2	4	1.58	SI25 PEL64R8	
32A	23A	13A	5A	25A	25A	25A	-	2	4	1.58	SI32 PEL64R8	
29A	29A	29A	16A	29A	29A	29A	-	4	1	1.03	SI16 PEL64R4H	
45A	45A	45A*	20A	45A	45A	45A	-	4	1	1.03	SI25 PEL64R4H	
58A	58A*	58A*	23A	58A	58A	50A	-	4	1	1.03	SI32 PEL64R4H	

4T / 4B configuration also available. For ratings refer to 4S configuration. (See page 17)  
\*DC21B

## Technical Data

Data according to IEC 60947-3, VDE 0660, GB14048.3

Main Contacts	Type	SI16	SI25	SI32	SI40	SI55		
Rated thermal current I <sub>th</sub>	A	16	25	32	40	55		
Rated insulation voltage U <sub>i</sub> <sup>1)</sup>	V	1000	1000	1000	1500	1500		
Rated insulation voltage U <sub>i</sub> <sup>2)</sup>	V	1500	1500	1500	-	-		
Distance of contacts (per pole)	mm	8	8	8	-	-		
Rated operational current I <sub>e</sub>								
1 pole								
300V A		16	23	27	40	55		
400V A		12	14	16	30	40		
500V A		9	11	13	18	25		
600V A		6	8	10	15	20		
700V A		4.5	6	7.5	10	15		
800V A		3	4	5	8	10		
900V A		2.5	3	4	6	8		
1000V A		1.5	2	2.5	4	6		
2 poles in series								
500V A		16	25	32	40	55		
600V A		16	25	32	40	55		
700V A		16	23	27	35	55		
800V A		16	20	23	30	45		
850V A		-	-	25	-	-		
900V A		13	16	20	25	35		
1000V A		9	11	13	20	36		
1200V A		6	8	10	10	15		
1500V A		3	4	5	6	8		
2 poles in series + 2 poles parallel								
500V A		29	45	58	72	85		
600V A		29	45	50	64	80		
700V A		16	23	27	35	55		
800V A		16	20	23	30	45		
900V A		13	16	20	25	35		
1000V A		9	11	13	20	25		
1200V A		6	8	10	10	15		
1500V A		3	4	5	6	8		
3 poles in series + 2 poles parallel								
500V A		29	45	58	-	-		
600V A		29	45	50	-	-		
700V A		29	38	45	-	-		
800V A		29	38	45	-	-		
900V A		29	38	45	-	-		
1000V A		29	38	45	-	-		
1200V A		12	14	16	-	-		
1500V A		9	11	13	-	-		
4 poles in series								
500V A		16	25	32	40	55		
600V A		16	25	32	40	55		
700V A		16	25	32	40	55		
800V A		16	25	32	40	55		
900V A		16	25	32	40	55		
1000V A		16	25	32	40	55		
1200V A		16	20	23	30	40		
1500V A		16	20	23	30	40		
4 poles in series + 2 poles parallel								
500V A		29	45	58	-	-		
600V A		29	45	58	-	-		
700V A		29	45	58	-	-		
800V A		29	45	58	-	-		
900V A		29	45	58	-	-		
1000V A		29	45	58	-	-		
1200V A		29	45	50	-	-		
1500V A		16	20	23	-	-		
Rated operational current I <sub>e</sub>								
AC21B	2, 4	U <sub>i</sub> max. 440V	A	16	25	32	40	55
	2H	U <sub>i</sub> max. 440V	A	29	45	58	72	85

1) Suitable at overvoltage category I to III, pollution degree 3 (standard industry); U<sub>imp</sub> = 8kV.  
2) Suitable at overvoltage category I to III, pollution degree 2 (min. IP55); U<sub>imp</sub> = 8kV.

## Technical Data continued

Data according to IEC 60947-3, VDE 0660, GB14048.3

Main Contacts	Type	SI16	SI25	SI32	SI40	SI55
Rated operational current I <sub>e</sub>						
500V A		1	1.25	1.5	x	2.5
600V A		0.5	0.75	1	x	2
800V A		0.3	0.4	0.5	x	1.5
1000V A		0.15	0.2	0.25	x	1
1200V A		-	-	-	x	x
1500V A		-	-	-	x	x
2 poles in series						
500V A		7	8	9	x	x
600V A		5.5	6	6.5	x	x
800V A		2	2.5	3	x	x
1000V A		1	1.5	2	x	x
1200V A		-	-	-	x	x
1500V A		-	-	-	x	x
4 poles in series						
500V A		16	25	32	x	x
600V A		16	25	27.5	x	x
800V A		11.5	12	12.5	x	x
1000V A		8	9	10	x	x
1200V A		-	-	-	x	x
1500V A		-	-	-	x	x
Rated conditional short-circuit current						
Max. fuse size	gl. (gG)	5	5	5	10	10
Mechanical Life	x10 <sup>3</sup>	10	10	10	10	10
Rated short-time withstand current (1s)	I <sub>sw</sub>	800	900	1000	A2, A4: 1200	A2, A4: 1400
		1300	1500	1700	A2+2: 2000	A2+2: 2400
Short circuit making capacity	I <sub>sm</sub>	800	900	1000	A2, A4: 1200	A2, A4: 1400
		1300	1500	1700	A2+2: 2000	A2+2: 2400
Maximum cable cross sections	(including jumper LSV-B1)					
solid or stranded	mm <sup>2</sup>	4-16	4-16	4-16	2.5-25	2.5-25
flexible	mm <sup>2</sup>	4-10	4-10	4-10	4-16	4-16
flexible (+ multicore cable end)	mm <sup>2</sup>	4-10	4-10	4-10	2.5-16	2.5-16
Size of terminal screw		M4 Pz2	M4 Pz2	M4 Pz2	M5 Pz2	M5 Pz2
Tightening torque	Nm	1.2-1.8	1.2-1.8	1.2-1.8	2.5-2.8	2.5-2.8
2 cables per clamp without jumper LSV-B1 / LSV-B2						
solid or stranded	mm <sup>2</sup>	16+(1.5-2.5)/10+(1.5-6)/6+(1.5-10)/4+(1.5-10)/6+(1.5-10)/4+(1.5-10)/6				
flexible	mm <sup>2</sup>	16+(1.5-2.5)/10+(1.5-4)/6+(1.5-6)/6+(1.5-16)/4+(1.5-16)/6				
stranded	AWG	8+(16-12)/10+(16-10)/12+(16-8)/14+(16-8)/6+(18-10)/4+(18-10)/6+(18-8)/8+(18-8)/6				
solid	AWG	10+(16-12)/12+(16-10)/14+(16-10)/14+(16-10)/12+(16-10)/14+(16-10)/14				
Maximum ambient temperature						
Operation	°C	All types except PEL64R				
	°C	PEL64R type				
Storage	°C	-50 to +70				
Power loss per switch at I <sub>e</sub> max. DC21B						
2	W	0.8	2	3	4	6
4	W	1.6	4	6	8	12
6	W	2.4	6	9	12	18
8	W	3.2	8	12	16	24
2H	W	0.4	1	1.5	2	3
3H	W	0.6	1.5	2.25	3	4.5
4H	W	0.8	2	3	4	6

x - In Test