

# ROOF MOUNT PHOTOVOLTAIC SYSTEM

## CODES:

THIS PROJECT COMPLIES WITH THE FOLLOWING:  
 2018 NORTH CAROLINA BUILDING CODE  
 2018 NORTH CAROLINA RESIDENTIAL CODE  
 2018 NORTH CAROLINA PLUMBING CODE  
 2018 NORTH CAROLINA MECHANICAL CODE  
 2018 NORTH CAROLINA FUEL GAS CODE  
 2017 NATIONAL ELECTRICAL CODE  
 AS ADOPTED BY HARNETT COUNTY (NC)

## CONSTRUCTION NOTES:

CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.

ALL SOLAR ENERGY SYSTEM EQUIPMENT SHALL BE SCREENED TO THE MAXIMUM EXTENT POSSIBLE AND SHALL BE PAINTED A COLOR SIMILAR TO THE SURFACE UPON WHICH THEY ARE MOUNTED.

MODULES SHALL BE TESTED , LISTED AND IDENTIFIED WITH FIRE CLASSIFICATION IN ACCORDANCE WITH UL 2703. SMOKE AND CARBON MONOXIDE ALARMS ARE REQUIRED PER SECTION R314 AND 315 TO BE VERIFIED AND INSPECTED BY INSPECTOR IN THE FIELD.

DIG ALERT (811) TO BE CONTACTED AND COMPLIANCE WITH EXCAVATION SAFETY PRIOR TO ANY EXCAVATION TAKING PLACE

PHOTOVOLTAIC SYSTEM GROUND WILL BE TIED INTO EXISTING GROUND AT MAIN SERVICE FROM DC DISCONNECT/INVERTER AS PER 2017 NEC SEC 250.166(A).

SOLAR PHOTOVOLTAIC SYSTEM EQUIPMENT WILL BE INSTALLED IN ACCORDANCE WITH REQUIREMENTS OF ART. 690 OF THE 2017 NEC


THE MAIN SERVICE PANEL WILL BE EQUIPPED WITH A GROUND ROD OR UFER

UTILITY COMPANY WILL BE NOTIFIED PRIOR TO ACTIVATION OF THE SOLAR PV SYSTEM

SOLAREGE OPTIMIZERS ARE LISTED TO IEC 62109-1 (CLASS II SAFETY) AND UL 1741 STANDARDS

INSTALL CREW TO VERIFY ROOF STRUCTURE PRIOR TO COMMENCING WORK. EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNT.

## VICINITY MAP:

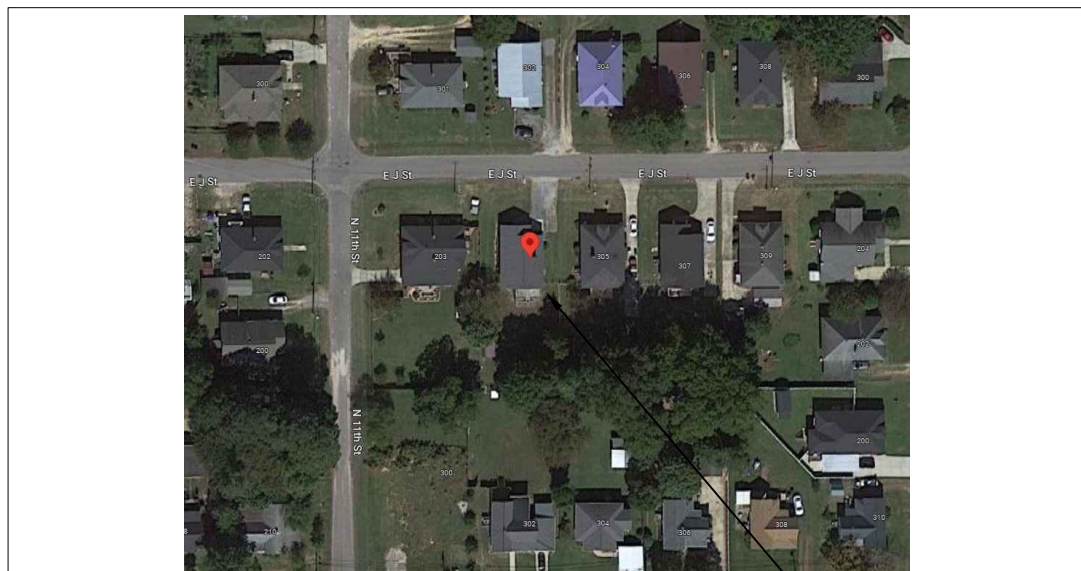

SITE LOCATION


## TABLE OF CONTENTS:

PV-1	SITE LOCATION
PV-2	SITE PLAN
PV-2A	ROOF PLAN WITH MODULES LAYOUT
PV-2B	ROOF AND STRUCTURAL TABLES
PV-3	MOUNTING DETAILS
PV-4	THREE LINE DIAGRAM
PV-5	CONDUCTOR CALCULATIONS
PV-6	EQUIPMENT & SERVICE LIST
PV-7	LABELS
PV-7A	SITE PLACARD
PV-8	OPTIMIZER CHART
PV-9	SAFETY PLAN
PV-10	SAFETY PLAN
APPENDIX	MANUFACTURER SPECIFICATION SHEETS

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA  
 PURE-R  
 OPTIMIZERS: 22 X SOLAREGE P505  
 INVERTER: SOLAREGE SE6000H-USRGM [S11]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-

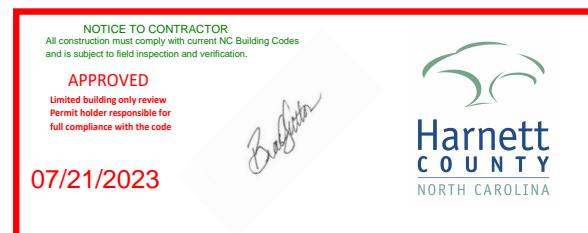











**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075


**GREG ALBRIGHT**

**CONTRACTOR LICENSE:**  
 ELECTRICAL CONTRACTOR U.34043

SITE LOCATION			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-1

**LEGEND:**

-  CHIMNEY
-  PIPE VENT
-  MODULES
-  CONDUIT
-  SETBACK
-  AC DISCONNECT
-  UTILITY METER
-  JUNCTION BOX
-  INVERTER
-  MAIN SERVICE PANEL

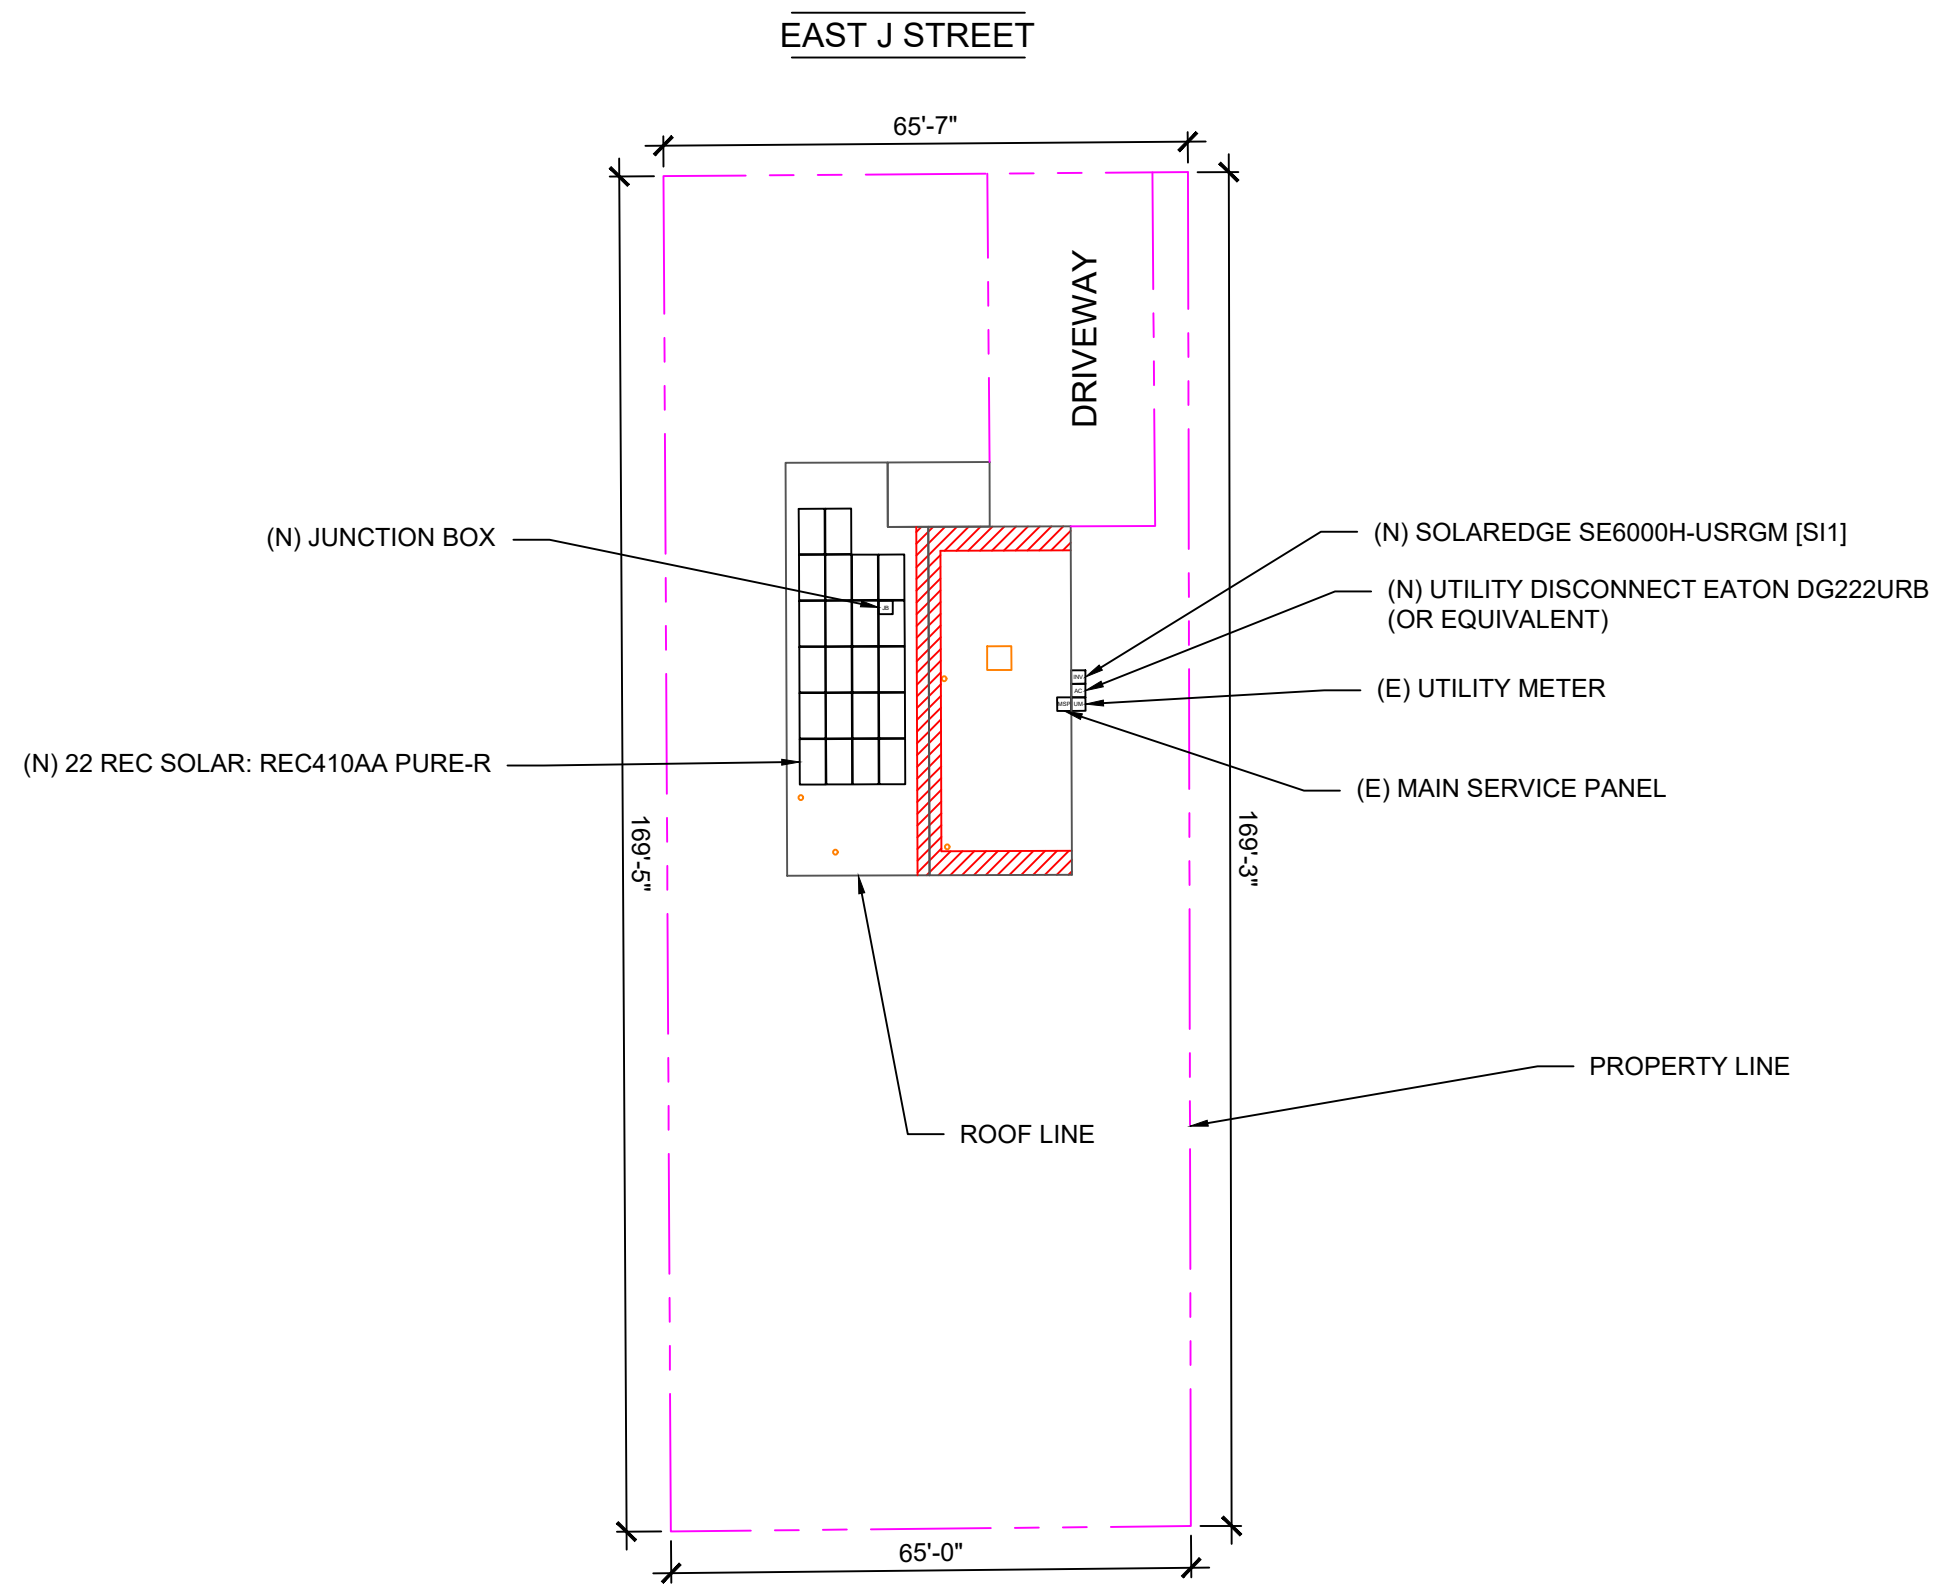

ROOF AREA: 1989 SQ FT

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [S11]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-




**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

**GREG ALBRIGHT**

*Greg Albright*

CONTRACTOR LICENSE:  
 ELECTRICAL CONTRACTOR U.34043













**SITE PLAN**  
 SCALE: 1/24" = 1'-0"

1

SITE PLAN			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-2


**LEGEND:**

-  CHIMNEY
-  PIPE VENT
-  MODULES
-  CONDUIT
-  SETBACK
-  AC DISCONNECT
-  UTILITY METER
-  JUNCTION BOX
-  INVERTER
-  MAIN SERVICE PANEL

TOTAL ROOF AREA: 1989 SQ FT  
 TOTAL ARRAY AREA: 458.02 SQ FT  
 ARRAY COVERAGE: 23.03%  
 SYSTEM DISTRIBUTED WEIGHT: 2.28 LBS  
 ROCKIT SMART SLIDE POINT-LOAD: 27.45 LBS



STRUCTURAL ONLY

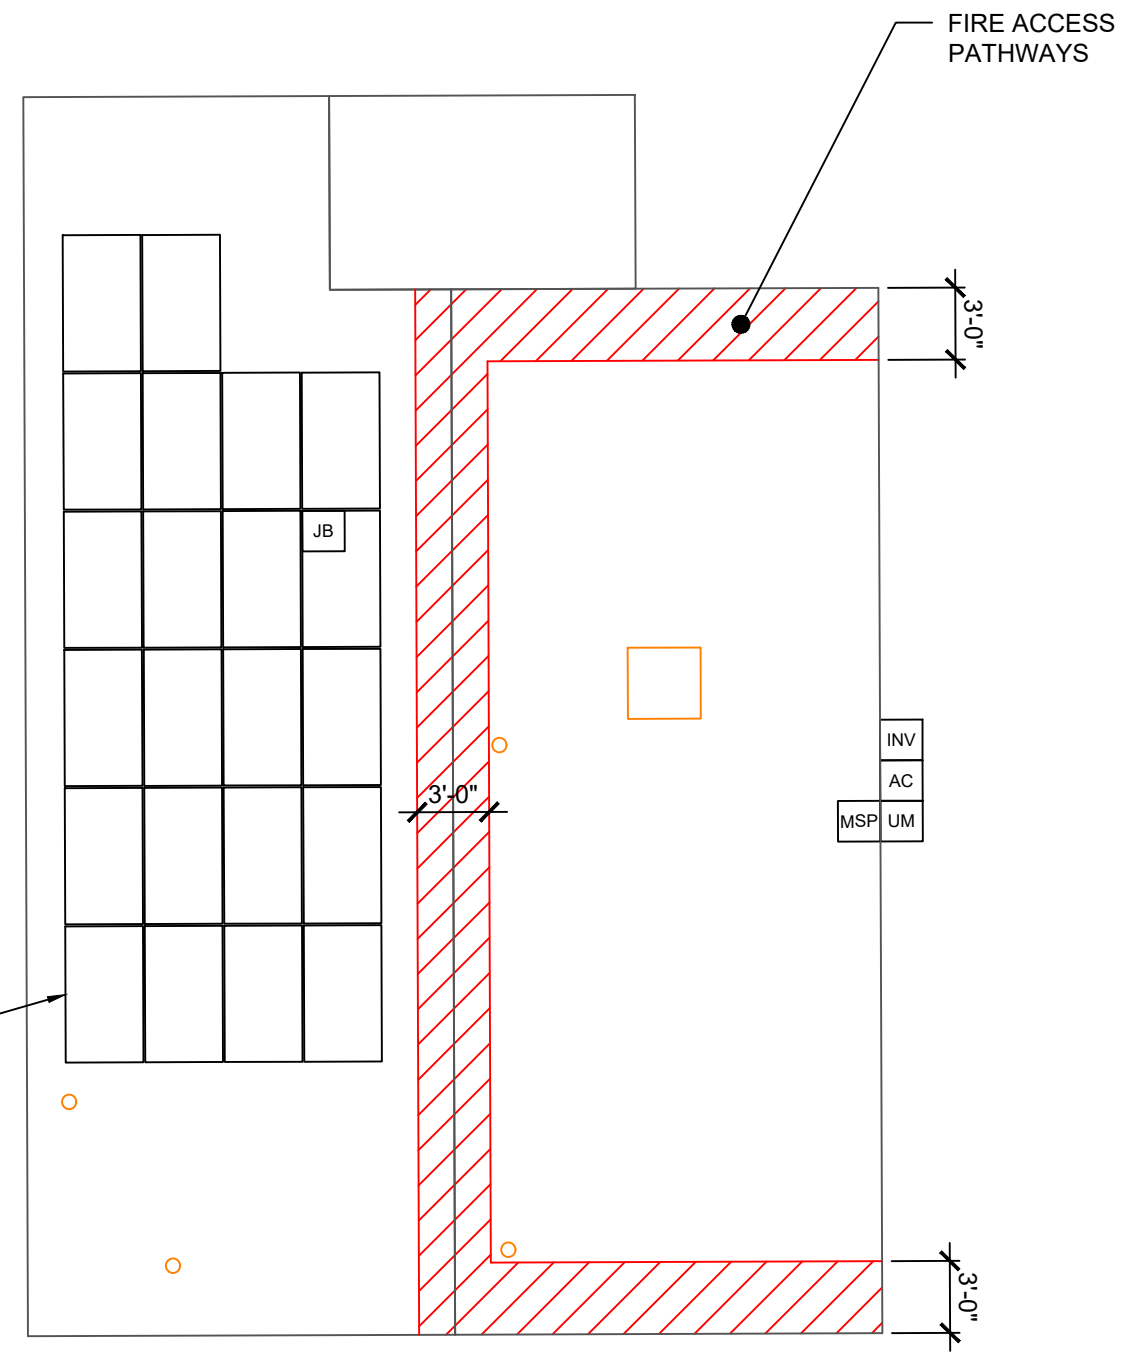

(N) 22 REC SOLAR: REC410AA PURE-R

ROOF AREA: 1989 SQ FT

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [S1]


REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

**GREG ALBRIGHT**

CONTRACTOR LICENSE:  
 ELECTRICAL CONTRACTOR U.34043



**ROOF PLAN**  
 SCALE: 1/8" = 1'-0"

1

- NOTES:**
- EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNTS
  - ATTACHED CLAMPS AT 25% FROM THE EDGE AND 50% FROM THE CENTER OF THE MODULES
  - JUNCTION BOX IS MOUNTED TO THE RAIL.

ROOF PLAN WITH MODULES LAYOUT

JOB NO: 351348	DATE: 7/12/2023	DESIGNED BY: A.W.	SHEET: PV-2A
-------------------	--------------------	----------------------	-----------------

# ROOF DETAILS:

TOTAL ROOF AREA: 1989 SQ FT  
 TOTAL ARRAY AREA: 458.02 SQFT  
 ARRAY COVERAGE: 23.03%  
 SYSTEM DISTRIBUTED WEIGHT: 2.28 LBS  
 ROCKIT SMART SLIDE POINT-LOAD: 27.45 LBS



STRUCTURAL ONLY

## ROOF AREA STATEMENT

ROOF	MODULE QUANTITY	ROOF PITCH	ARRAY PITCH	AZIMUTH	ROOF AREA	ARRAY AREA
ROOF 1	22	28	28	269	949 SQ FT	458.02 SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA  
 PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [S11]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



FREEDOM FOREVER LLC  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

GREG ALBRIGHT

CONTRACTOR LICENSE:  
 ELECTRICAL CONTRACTOR U.34043

## ROOF DETAILS


JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-2B




**TABLE 1 - ARRAY INSTALLATION**

	ROOF PITCH	ROOFING TYPE	ATTACHMENT TYPE	FRAMING TYPE1	MAX UNBRACED LENGTH(FT.)1	RAFTER/TRUSS SISTERING	PENETRATION PATTERN2	MAX ATTACHMENT SPACING (IN.)2	MAX RAIL OVERHANG(I N.)3
ROOF 1	28	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X6 RAFTER @ 24" OC	6.00'	NOT REQ'D	STAGGERED	72" OC	24"

1. CONTRACTOR TO VERIFY FRAMING TYPE AND MAX UNBRACED LENGTH PRIOR TO INSTALLATION. IF THE ABOVE INFORMATION DOES NOT MATCH FIELD CONDITIONS, NOTIFY ENGINEER OF RECORD IMMEDIATELY.
2. WHERE COLLAR TIES OR RAFTER SUPPORTS EXIST, CONTRACTOR SHALL USE RAFTERS WITH COLLAR TIES AS ATTACHMENT POINTS.
3. WHERE APPLICABLE FOR RAILED ATTACHMENT INSTALLATIONS.

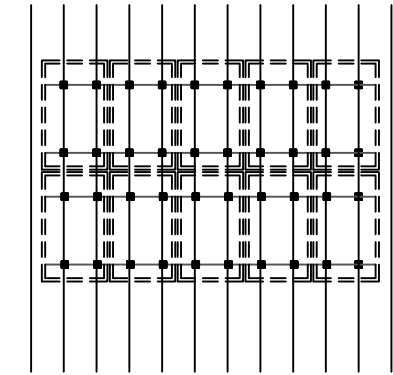

**STACKED DETAIL**  
For Illustration purposes only

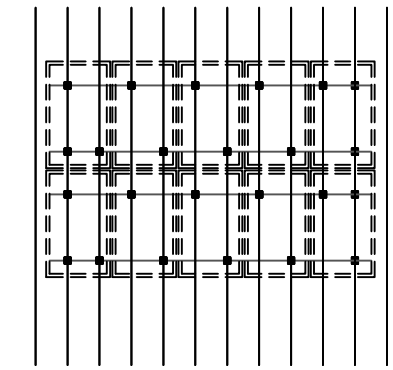


**STAGGERED DETAIL**  
For Illustration purposes only


CLIENT:  
ALLISON SCHAEFER  
303 EAST J STREET, ERWIN, NC 28339  
AHJ: HARNETT COUNTY (NC)  
UTILITY: DUKE ENERGY  
PHONE: (585) 794-0133  
EMAIL: SCHAEFERA28@YAHOO.COM  
FINANCE: OTHER

SYSTEM:  
SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
SYSTEM SIZE (AC): 6.000 kW @ 240V  
MODULES: 22 X REC SOLAR: REC410AA PURE-R  
OPTIMIZERS: 22 X SOLAREEDGE P505  
INVERTER: SOLAREEDGE SE6000H-USRGM [S1]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-

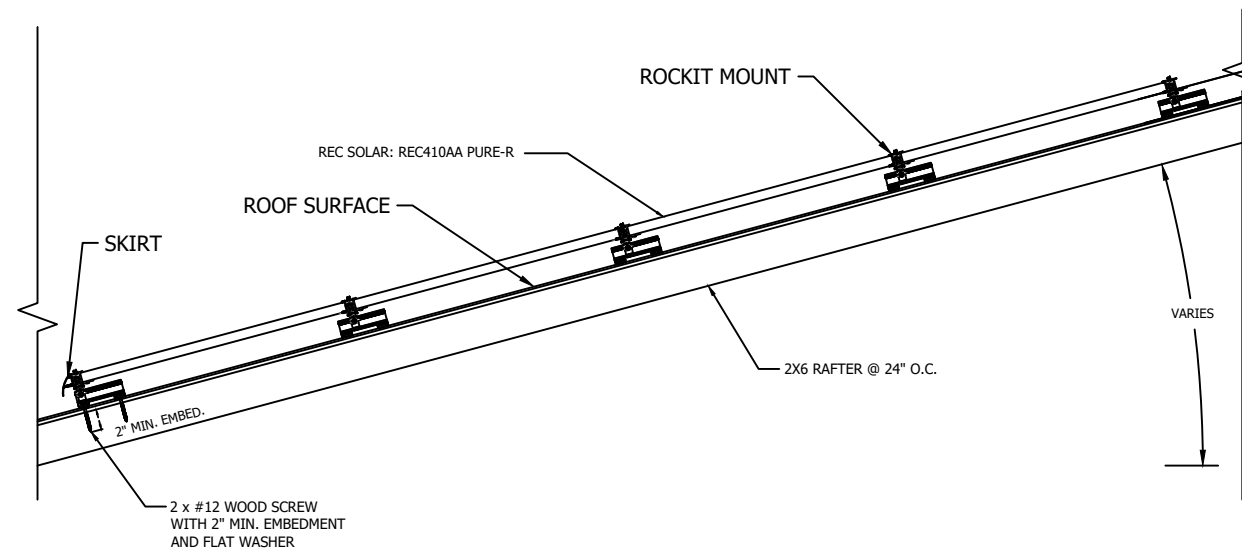

**SOLAR PV ARRAY SECTION VIEW**  
Scale: NTS

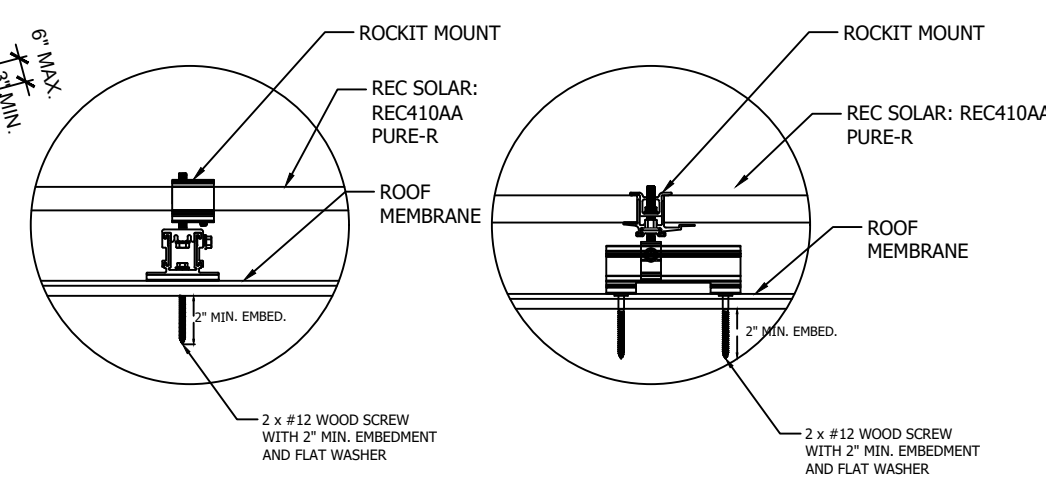


**ATTACHMENT DETAIL**  
Scale: NTS

**freedom FOREVER**  
FREEDOM FOREVER LLC  
415 INDUSTRIAL CT., GREER, SC 29651  
Tel: (800) 385-1075  
**GREG ALBRIGHT**  
  
CONTRACTOR LICENSE:  
ELECTRICAL CONTRACTOR U.34043

MOUNTING DETAILS			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-3

BACKFEED BREAKER SIZING					
MAX. CONTINUOUS OUTPUT 25.00A @ 240V					
25.00	X	1.25	=	31.25AMPS	35A BREAKER - OK
SEE 705.12 OF 2017 NEC					
200	X	1.20	=	240	
240	-	200	=	40A ALLOWABLE BACKFEED	

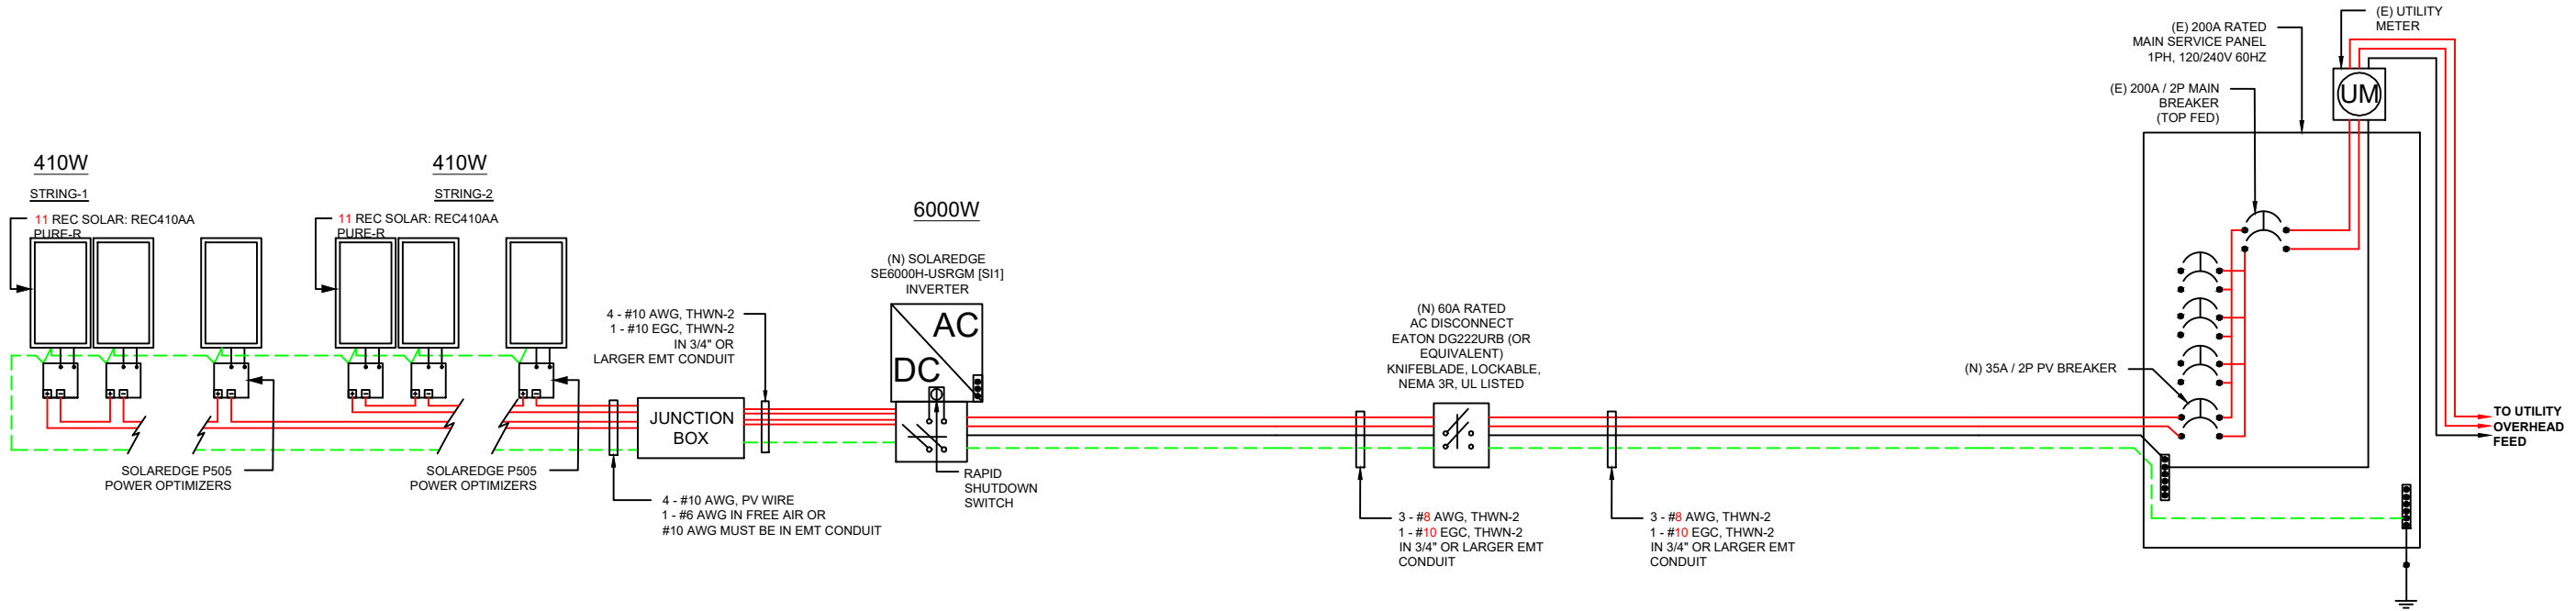

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [SI1]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-

**freedom FOREVER**

FREEDOM FOREVER LLC  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

**GREG ALBRIGHT**

CONTRACTOR LICENSE:  
 ELECTRICAL CONTRACTOR U.34043

**NOTE:**  
 CONDUIT AND CONDUCTORS SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS

THREE LINE DIAGRAM			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-4

WIRE SCHEDULE												
RACEWAY #	EQUIPMENT				CONDUCTOR QTY.	AWG WIRE SIZE	STARTING ALLOWABLE AMPACITY @ 90°C 310.15(B)(16)	STARTING CURRENT APPLIED TO CONDUCTORS IN RACEWAY	TEMPERATURE CORRECTION FACTOR 310.15(B)(2)(a)	ADJUSTMENT FACTOR FOR MORE THAN 3 CONDUCTORS 310.15(B)(3)(a)	ADJUSTED CONDUCTOR AMPACITY @ 90°C	MAXIMUM CURRENT APPLIED TO CONDUCTORS IN RACEWAY
1	DC	MODULE	TO	OPTIMIZER	2	10	40	11.05	0.91	1	36.40	13.81
2	DC	OPTIMIZER	TO	JUNCTION BOX	2	10	40	15.00	0.91	1	36.40	18.75
3	DC	JUNCTION BOX	TO	INVERTER	4	10	40	15.00	0.91	0.8	29.12	18.75
4	AC	INVERTER	TO	AC DISCONNECT	3	8	55	25.00	0.91	1	50.05	31.25
5	AC	AC DISCONNECT	TO	POI	3	8	55	25.00	0.91	1	50.05	31.25
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				
								----				

CONDUCTOR AMPACITY CALCULATIONS IN ACCORDANCE WITH NEC 690.8.

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA  
 PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [S1]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

**GREG ALBRIGHT**  


**CONTRACTOR LICENSE:**  
 ELECTRICAL CONTRACTOR U.34043

CONDUCTOR CALCULATIONS			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-5

**OCPD SIZES:**

35A BREAKER

**SERVICE LIST:**

NONE

**MATERIAL LIST:**

QTY.	PART	PART #	DESCRIPTION
22	MODULES	PV-117-410	REC SOLAR: REC410AA PURE-R
22	OPTIMIZERS	OPT-130-505	SOLAREEDGE P505 POWER OPTIMIZER - FRAME MOUNTED MODULE ADD-ON
1	JUNCTION BOX	RAC-260-049	600VDC NEMA 3R UL LISTED JUNCTION BOX
2	ELECTRICAL ACCESSORIES	EA-350-326	STAUBLI / MULTI-CONTACT MC4 CONNECTORS (FEMALE)
2	EQUIPMENT ACCESSORIES	EA-350-327	STAUBLI / MULTI-CONTACT MC4 CONNECTORS (MALE)
1	INVERTERS	INV-120-608	SE6000H-US [SI1] RGM 240V INVERTER UL1741 SA CERTIFIED INTEGRATED ARC FAULT PROTECTION AND RAPID SHUTDOWN
1	MONITORING EQUIPMENT	ME-180-502	SOLAREEDGE CELL MODEM
1	DISCONNECTS	EE-321-060	60A RATED 240VAC NEMA 3R UL LISTED
38	FITTINGS/ANCHORS	RAC-265-034	ROCKIT SMART SLIDE
41	FOOTINGS	RAC-265-004	"MFG: ECO FASTEN, ROCKIT COMP COUPLING AL BLK, MFG SKU: 2011021"
38	FITTINGS/ANCHORS	RAC-265-002	"MFG: ECO FASTEN, ROCKIT COMP SLIDE AL BLK, MFG SKU: 2011013"
7	FOOTINGS	RAC-265-028	"MFG: ECO FASTEN, SKIRT AL BLK 35MM & 40MM A80, MFG SKU: 2099012"
5	FITTINGS/ANCHORS	RAC-265-031	"MFG: ECO FASTEN, SKIRT END CAP PLS 35MM&40MM-A, MFG SKU: 2099035"
22	RAILS	RAC-265-018	"MFG: ECO FASTEN, FRAME MLPE MOUNT SS, MFG SKU: 4011012"
76	SCREW	RAC-265-035	ROCKIT SCREW #12X3

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [SI1]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075


GREG ALBRIGHT

**CONTRACTOR LICENSE:**  
 ELECTRICAL CONTRACTOR U.34043

**EQUIPMENT & SERVICE LIST**

<b>JOB NO:</b> 351348	<b>DATE:</b> 7/12/2023	<b>DESIGNED BY:</b> A.W.	<b>SHEET:</b> PV-6
--------------------------	---------------------------	-----------------------------	-----------------------



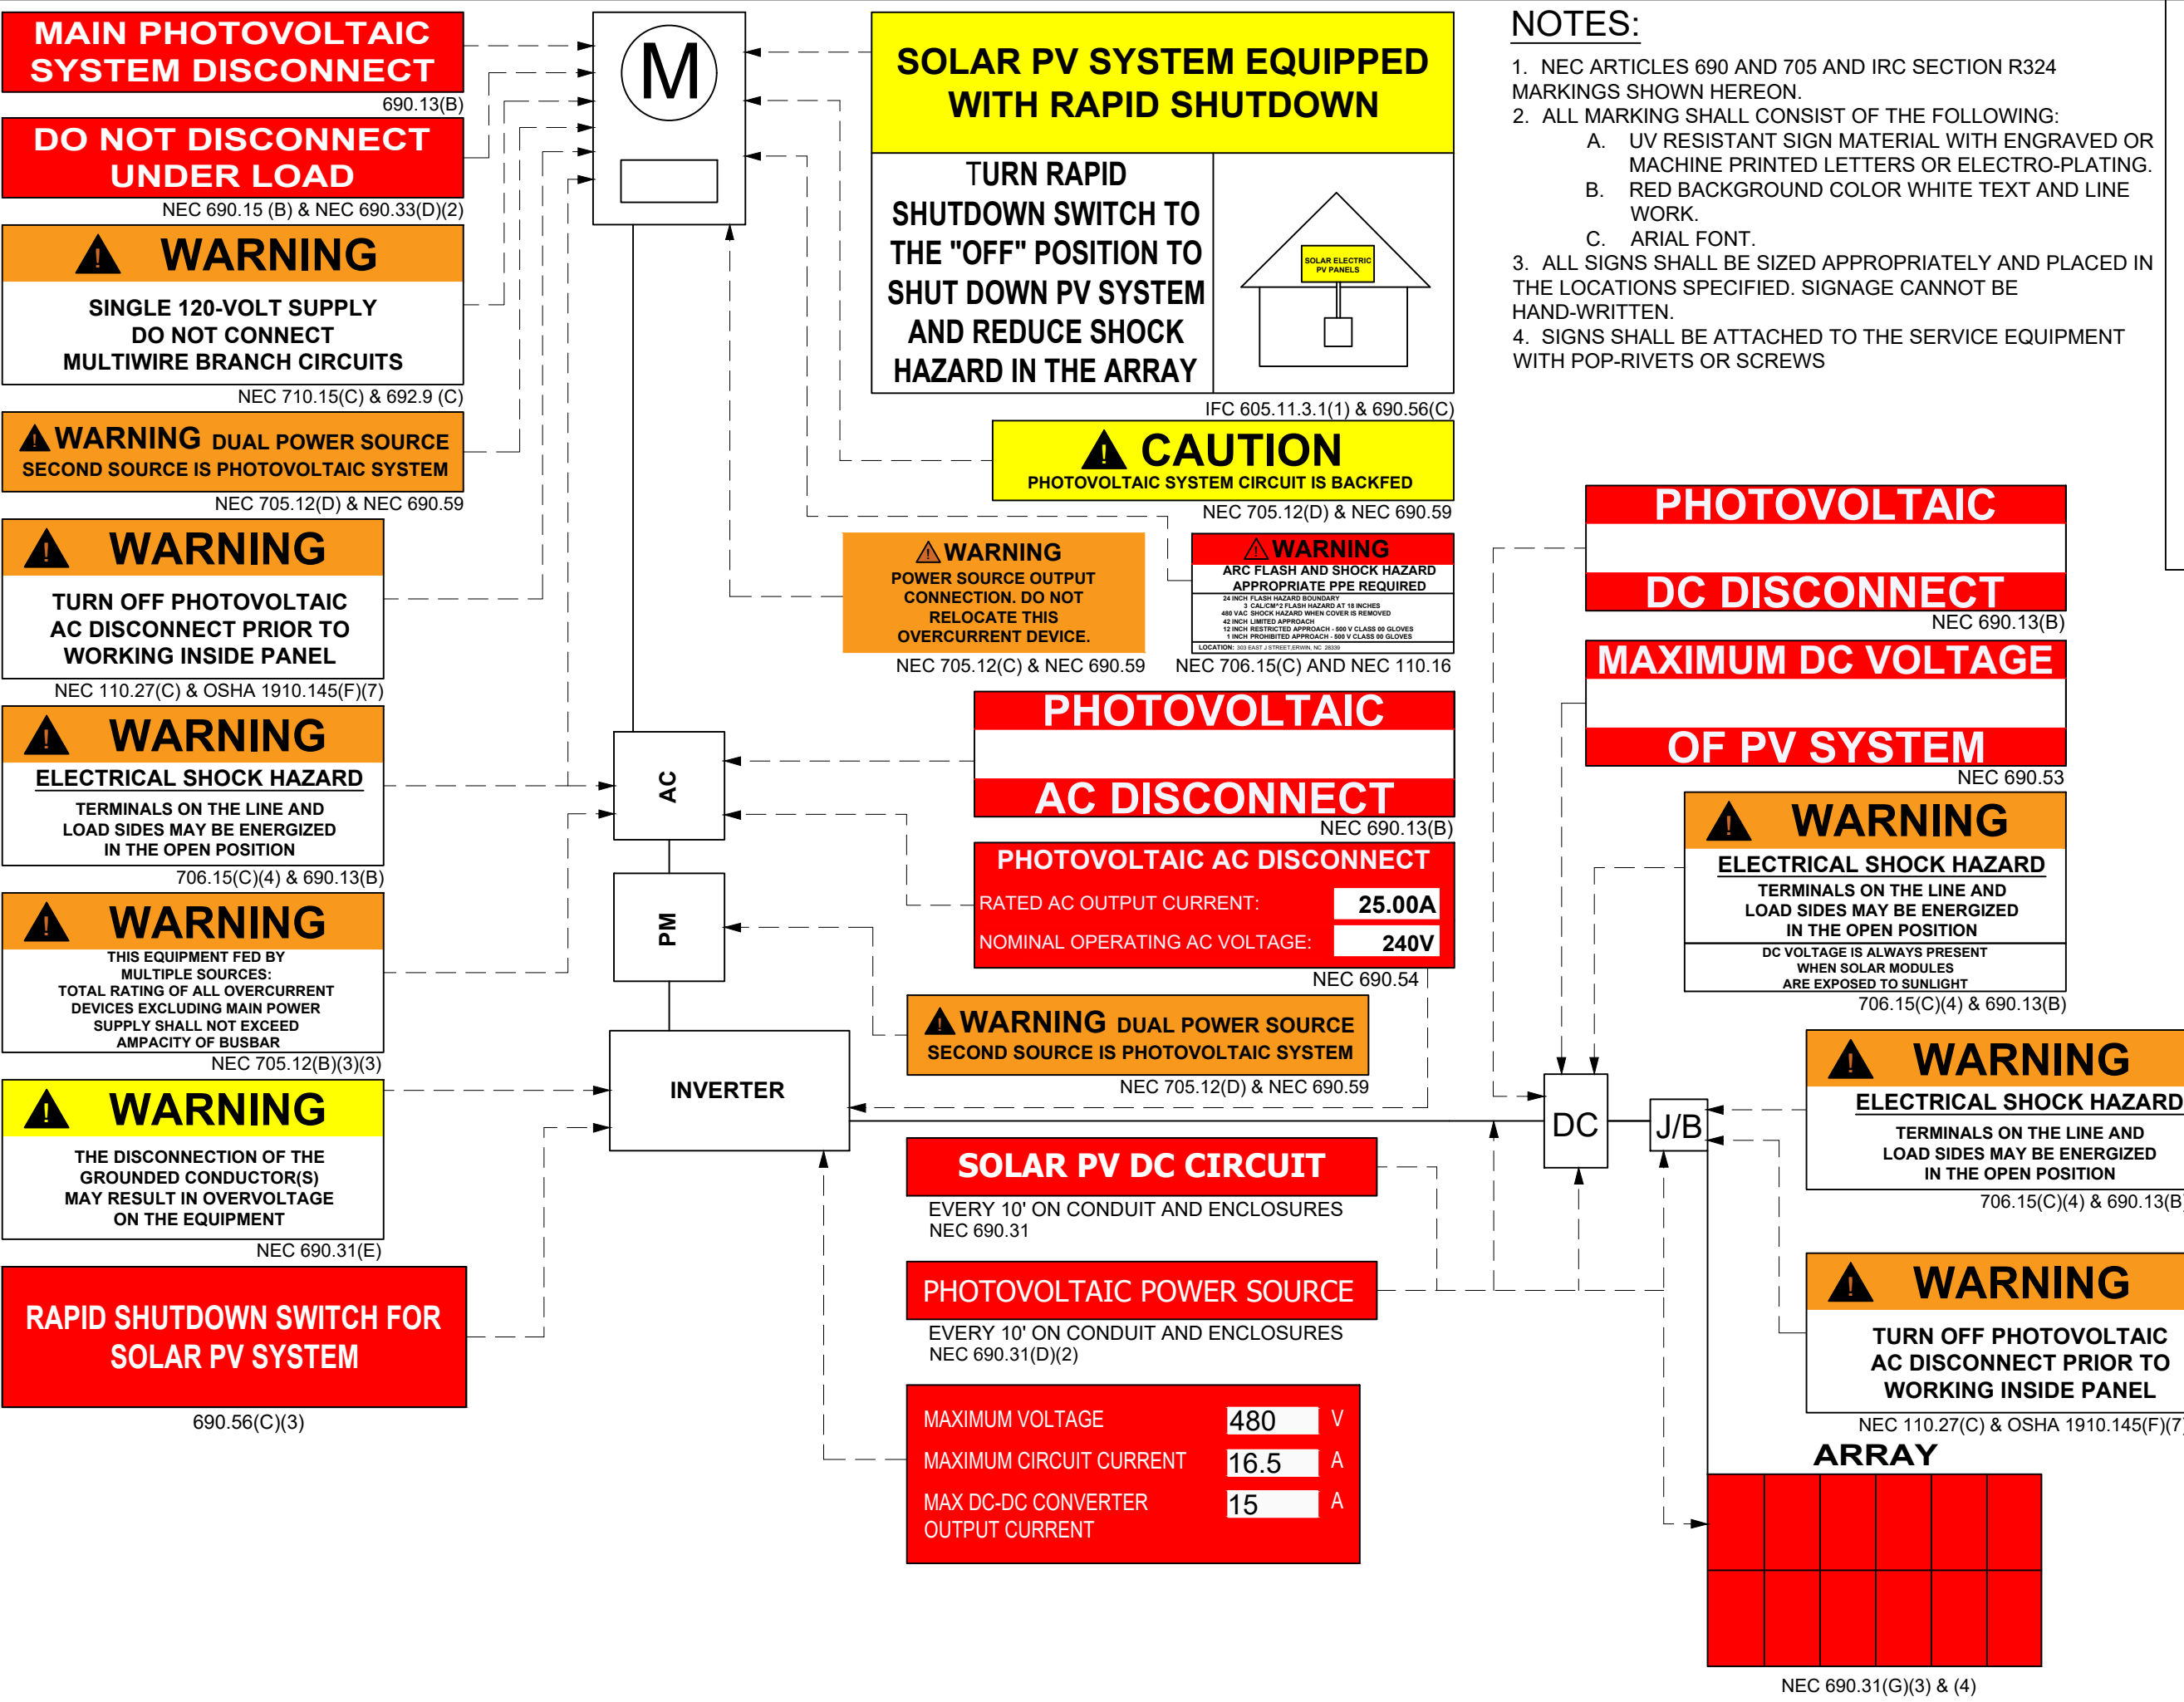

- NOTES:**
- NEC ARTICLES 690 AND 705 AND IRC SECTION R324 MARKINGS SHOWN HEREON.
  - ALL MARKING SHALL CONSIST OF THE FOLLOWING:
    - UV RESISTANT SIGN MATERIAL WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PLATING.
    - RED BACKGROUND COLOR WHITE TEXT AND LINE WORK.
    - ARIAL FONT.
  - ALL SIGNS SHALL BE SIZED APPROPRIATELY AND PLACED IN THE LOCATIONS SPECIFIED. SIGNAGE CANNOT BE HAND-WRITTEN.
  - SIGNS SHALL BE ATTACHED TO THE SERVICE EQUIPMENT WITH POP-RIVETS OR SCREWS

**CLIENT:**  
ALLISON SCHAEFER  
303 EAST J STREET, ERWIN, NC 28339  
AHJ: HARNETT COUNTY (NC)  
UTILITY: DUKE ENERGY  
PHONE: (585) 794-0133  
EMAIL: SCHAEFERA28@YAHOO.COM  
FINANCE: OTHER

**SYSTEM:**  
SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
SYSTEM SIZE (AC): 6.000 kW @ 240V  
MODULES: 22 X REC SOLAR: REC410AA PURE-R  
OPTIMIZERS: 22 X SOLAREEDGE P505  
INVERTER: SOLAREEDGE SE6000H-USRGM [S11]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-

**freedom FOREVER**  
FREEDOM FOREVER LLC  
415 INDUSTRIAL CT., GREER, SC 29651  
Tel: (800) 385-1075  
**GREG ALBRIGHT**  
*Greg Albright*  
CONTRACTOR LICENSE:  
ELECTRICAL CONTRACTOR U.34043


**LABELS**

JOB NO: 351348	DATE: 7/12/2023	DESIGNED BY: A.W.	SHEET: PV-7
-------------------	--------------------	----------------------	----------------

# CAUTION:

POWER TO THIS BUILDING IS  
ALSO SUPPLIED FROM THE  
FOLLOWING SOURCES WITH  
DISCONNECTS AS SHOWN

EAST J STREET

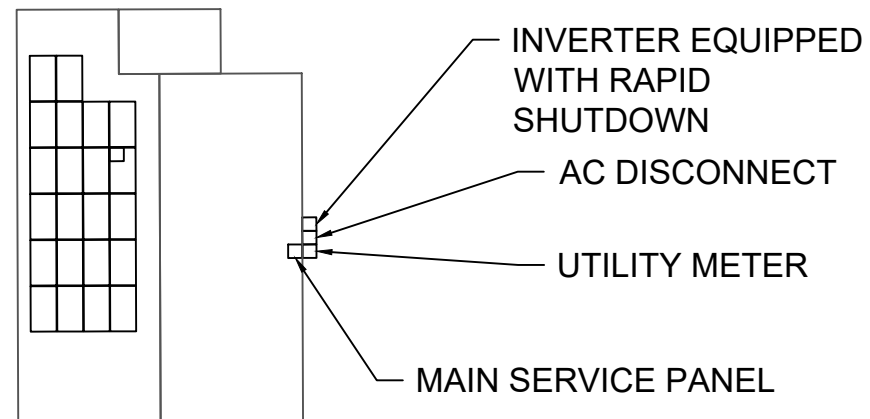

**WARNING**  
**TURN OFF PHOTOVOLTAIC AC DISCONNECT**  
**PRIOR TO WORKING INSIDE PANEL**



**CLIENT:**  
ALLISON SCHAEFER  
303 EAST J STREET, ERWIN, NC 28339  
AHJ: HARNETT COUNTY (NC)  
UTILITY: DUKE ENERGY  
PHONE: (585) 794-0133  
EMAIL: SCHAEFERA28@YAHOO.COM  
FINANCE: OTHER

**SYSTEM:**  
SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
SYSTEM SIZE (AC): 6.000 kW @ 240V  
MODULES: 22 X REC SOLAR: REC410AA  
PURE-R  
OPTIMIZERS: 22 X SOLAREEDGE P505  
INVERTER: SOLAREEDGE SE6000H-USRGM [S1]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



**FREEDOM FOREVER LLC**  
415 INDUSTRIAL CT., GREER, SC 29651  
Tel: (800) 385-1075

**GREG ALBRIGHT**

**CONTRACTOR LICENSE:**  
ELECTRICAL CONTRACTOR U.34043

**SITE PLACARD**

JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-7A


## NOTES:

1. NEC ARTICLES 690 AND 705 AND IRC SECTION R324 MARKINGS SHOWN HEREON.
2. ALL MARKING SHALL CONSIST OF THE FOLLOWING:
  - A. UV RESISTANT SIGN MATERIAL WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PLATING.
  - B. RED BACKGROUND COLOR WHITE TEXT AND LINE WORK.
  - C. AERIAL FONT.
3. ALL SIGNS SHALL BE SIZED APPROPRIATELY AND PLACED IN THE LOCATIONS SPECIFIED. SIGNAGE CANNOT BE HAND-WRITTEN.
4. SIGNS SHALL BE ATTACHED TO THE SERVICE EQUIPMENT WITH POP-RIVETS OR SCREWS.

# SOLAREEDGE OPTIMIZER CHART

1-10    11-20    21-30    31-40    41-50    51-60

1  
2  
3  
4  
5  
6  
7  
8  
9  
10

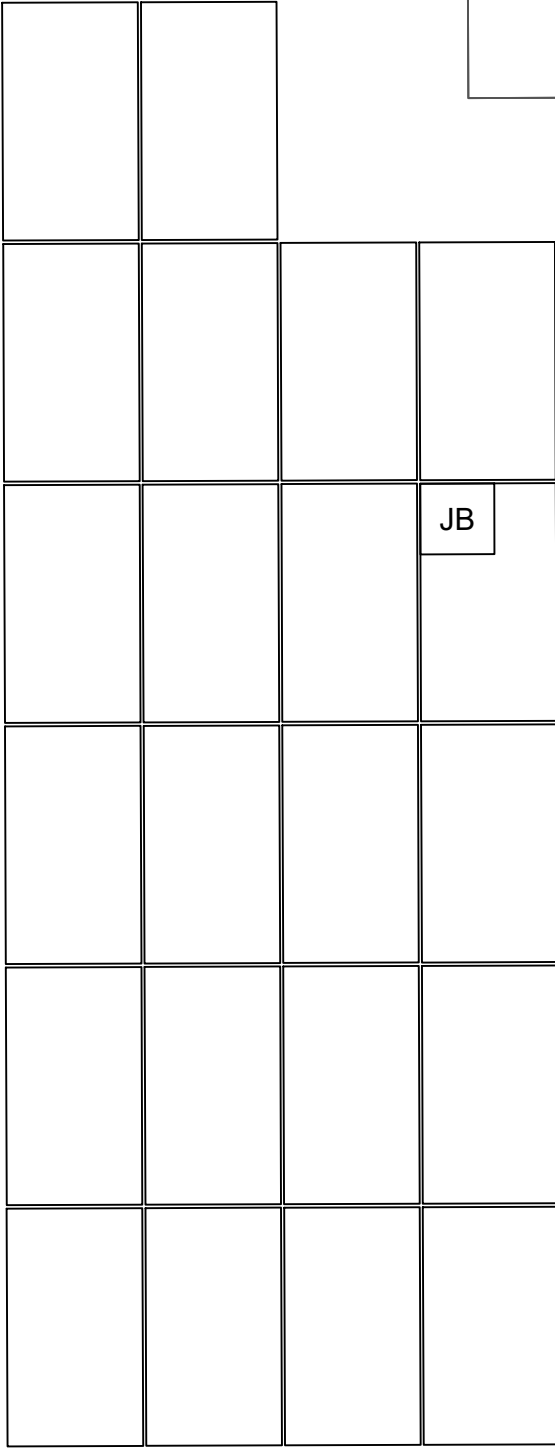
**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA  
 PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [S1]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

**GREG ALBRIGHT**  


**CONTRACTOR LICENSE:**  
 ELECTRICAL CONTRACTOR U.34043

OPTIMIZER CHART			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-8

# SAFETY PLAN

# MARK UP KEY

### INSTRUCTIONS:

- USE SYMBOLS IN KEY TO MARK UP THIS SHEET.
- SAFETY PLAN MUST BE MARKED BEFORE JOB STARTS AS PART OF THE PRE-PLAN
- DOCUMENT ALL ADDITIONAL HAZARDS ON THIS PAGE & MAKE NOTES ON THE JHA SHEET

### INCIDENT REPORTING:

INJURIES - CALL INJURY HOTLINE

**(855) 400-7233**

*\*If injury is life threatening, call 911 first THEN the Injury Hotline*

NON-INJURIES - USE MOBILE INCIDENT REPORTING

(Auto, Property Damage, Near Miss)



### NEAREST OCCUPATIONAL/INDUSTRIAL CLINIC:

NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

### NEAREST HOSPITAL:

NAME: \_\_\_\_\_


ADDRESS: \_\_\_\_\_

### SAFETY COACH CONTACT INFORMATION:

NAME: \_\_\_\_\_

PHONE NUMBER: \_\_\_\_\_

ALL EMPLOYEES ON SITE SHALL BE MADE AWARE OF THE SAFETY PLAN AND SIGN INDICATING THAT THEY ARE AWARE OF THE HAZARDS ON-SITE AND THE PLAN FOR WORKING SAFELY.

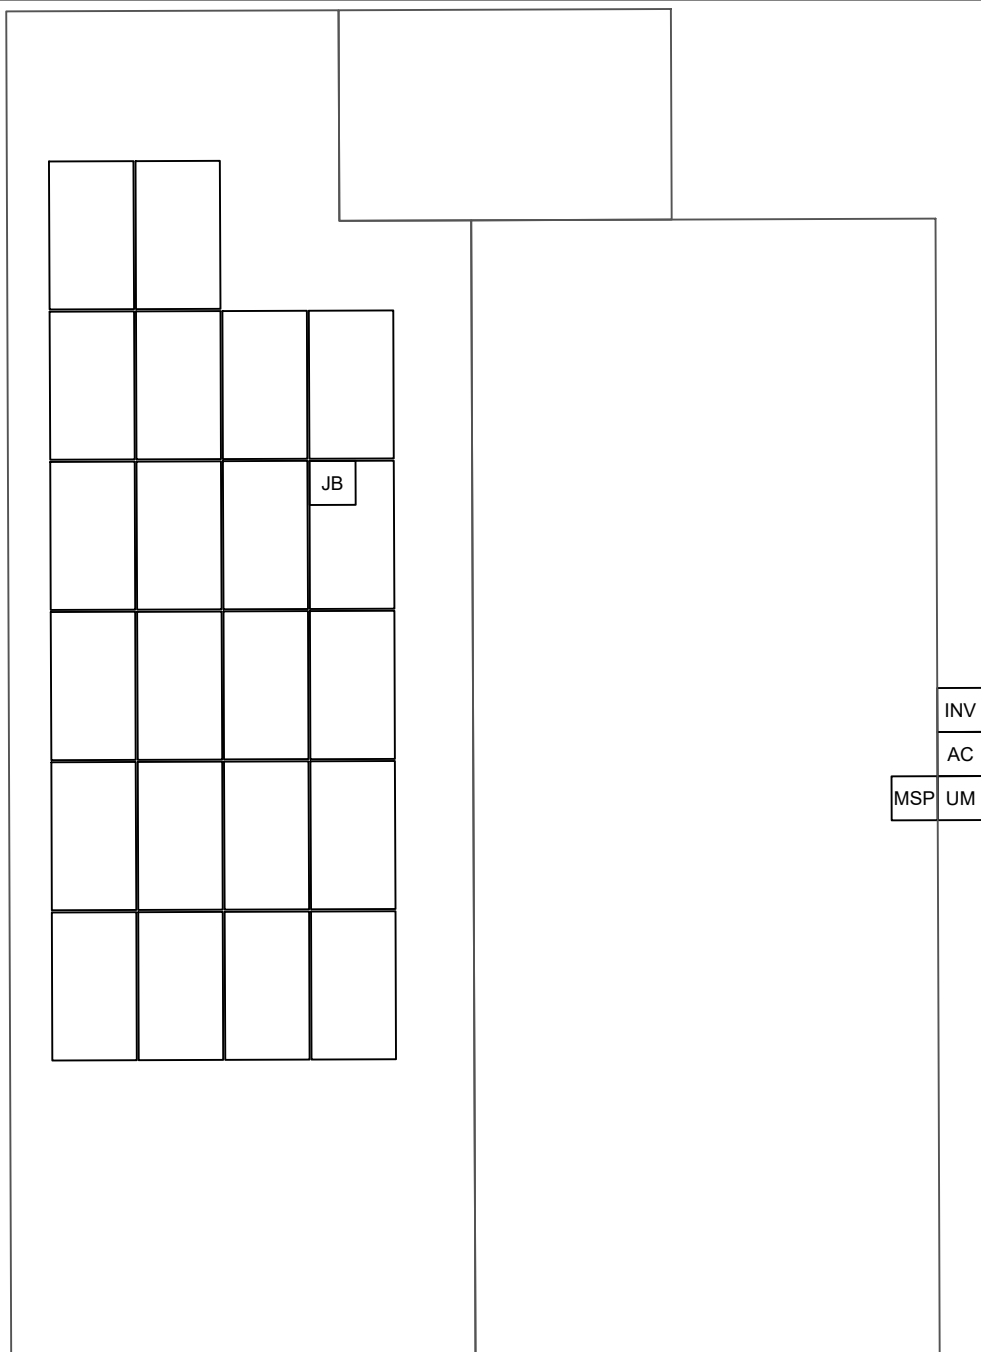

- P PERMANENT ANCHOR
- T TEMPORARY ANCHOR
- IL INSTALLER LADDER
- B JUNCTION / COMBINER BOX
- S STUB-OUT
- SKYLIGHT
- NO LADDER ACCESS (STEEP GRADE OR GROUND LEVEL OBSTRUCTIONS)
- RESTRICTED ACCESS
- CONDUIT
- GAS GAS SHUT OFF
- H<sub>2</sub>O WATER SHUT OFF
- 7 SERVICE DROP
- Z POWER LINES

**CLIENT:**  
 ALLISON SCHAEFER  
 303 EAST J STREET, ERWIN, NC 28339  
 AHJ: HARNETT COUNTY (NC)  
 UTILITY: DUKE ENERGY  
 PHONE: (585) 794-0133  
 EMAIL: SCHAEFERA28@YAHOO.COM  
 FINANCE: OTHER

**SYSTEM:**  
 SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
 SYSTEM SIZE (AC): 6.000 kW @ 240V  
 MODULES: 22 X REC SOLAR: REC410AA PURE-R  
 OPTIMIZERS: 22 X SOLAREEDGE P505  
 INVERTER: SOLAREEDGE SE6000H-USRGM [S1]

# BREAK AND WATER LOG

THIS LOG IS TO BE FILLED OUT ANY TIME THE TEMP EXCEEDS **90** DEGREES. THE CREW LEAD AND ROOF LEAD ARE RESPONSIBLE FOR ENSURING THIS IS COMPLETED AND UPLOADED AT THE END OF EVERYDAY WHEN TEMPS EXCEED **90** DEGREES

NAME	0800HRS	0900HRS	1000HRS	1100HRS	1200HRS	1300HRS	1400HRS	1500HRS	1600HRS

NAME	SIGNATURE

DATE: \_\_\_\_\_ TIME: \_\_\_\_\_

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-
-	-	-

**FREEDOM FOREVER LLC**  
 415 INDUSTRIAL CT., GREER, SC 29651  
 Tel: (800) 385-1075

GREG ALBRIGHT

CONTRACTOR LICENSE:  
 ELECTRICAL CONTRACTOR U.34043

SAFETY PLAN			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-9

# JOB HAZARD ANALYSIS

Crew leader to fill out all sections below, hold a pre-job safety meeting with all personnel, and upload this completed document and the Safety Plan to Site Capture

## Ladder Access

- Ladders must be inspected before each use.
  - Extension ladders must be set up on a firm and level surface at a 4-to-1 rise to run angle (or 75 degrees) and the top must be secured to the structure. Extension style ladders placed on uneven, loose or slippery surfaces must additionally have the base firmly anchored or lashed so the base will not slip out.
  - Extension ladders must be used with walk-through devices or the ladder must extend 36" above the stepping off point.
  - A-frame ladders must only be climbed with the ladder spreader bars locked in the open position; A-frame ladders shall not be climbed while in the closed position (ex, closed and used while leaned against a structure).
- Additional notes:

## Mobile Equipment

- Only Qualified operators will operate equipment; operators must maintain a certification on their person for the equipment being operated.
- Type(s) of mobile equipment (Type/Make/Model):
- Qualified operator(s):

## Material Handling and Storage

- Materials will be staged/stored in a way that does not present a hazard to client, personnel or public. Materials stored on the roof will be physically protect from failing or sliding off.

## Fall Protection

- A site-specific plan for fall prevention and protection is required prior to starting work and must remain onsite at all times until work is complete; a fall rescue plan must be outlined and discussed among the crew prior to work start.
- First-person-Up (FPU) must install their anchor and connect before any other task, including installing other anchors. The Last-Person-Down (LPD) must be the only person on a roof uninstalling fall protection.

- FPCP (name and title):
- FPU and LPD (name and title):

## Electrical Safety

- The Electrical Qualified Person (EQP) is required onsite to perform electrical work.
  - All electrical work will be performed with equipment in an electrically safe condition (de-energized) unless approval has been granted prior to work.
  - Service drops and overhead electrical hazards will be identified and protected from contact, as necessary.
- EQP (name and title):

## Public Protection

- The safety of the Client and Public must be maintained at all times.
- The Client and the Public shall be prevented from entering the work zone through the use of barriers and/or signage, as required.
- Company, Client and Public property shall be protected from falling objects.
- Pets (including dogs) shall be secured by their owners prior to work start.
- The Client should not leave pets, family members, or others in charge or care of Employees, Contractors, or Temporary Workers.

- Crew leader responsible for communication with the client:
- Client and public is excluded from work area by barricades (N/A, Yes, No):

## Training and Pre-Job Safety Briefing

- All employees onsite shall be made aware of the specific hazards of this project and review this HJA during a pre-job briefing, and their signature indicates awareness of site conditions and the plan to eliminate any hazards identified prior to and during the project.

- Crew leader (name/title):
- Crew member (name/title):
- Crew member (name/title):
- Crew member (name/title):
- Crew member (name/title):
- Crew member (name/title):

## Airborne Contaminants:

- Asbestos-containing (Transite) piping (ACP) - Do not disturb (move, drill, cut fracture, etc.)
- Asbestos-containing thermal insulation (ACI) and Asbestos-containing duct wrapping (ACW) - do not disturb, no attic or crawlspace access is allowed if work to be performed could cause exposure to personnel, client or public.

- If yes, list specific tasks and protection in place:
- 

## Weather and Environment

- The site supervisor shall forecast the weather conditions at the job site, prior to crew arrival, in order to mitigate any hazards associated with inclement weather (heat, cold, wind, rain, etc.)
  - The site supervisor will utilize a portable wind meter (anemometer) to verify actual onsite wind conditions, by checking at the ground and on any elevated work surface (ex, rooftop) prior to work start, at midday and prior to solar panel staging on a roof.
  - Elevated work involving the moving or maneuvering of solar panels shall cease at 25mph (sustained wind) until wind subsides.
- Forecasted weather maximum temp (degrees f):

## Heat Related Illness Prevention

- Employees shall have access to potable drinking water that is fresh, pure, and suitably cool. The water shall be located as close as practicable to the areas where employees are working. Water shall be supplied in sufficient quantity at the beginning of the work shift to provide at least one quart per employee per hour for drinking for the entire shift. Employees may begin the shift with smaller quantities of water if they identify the location and have effective means for replenishment during the shift to allow employees to drink on quart or more per hour. The frequent drinking of water shall be encouraged.
- Shade shall be present when temperature exceeds 80 degrees Fahrenheit. When the outdoor temperature in the work exceeds 80 degrees Fahrenheit, employees shall have and maintain one or more areas with shade at all times.
- New employees must be acclimatized. New employees will be monitored by their Crew Leader (site supervisor) for the first two (2) weeks of employment or longer when necessary.
- Employees will be allowed and encouraged to implement scheduled breaks during each shift. Employees must take cool-down breaks in the shade any time they feel the need to do so to protect them from overheating. Supervisors are REQUIRED to allow employees any break period they need during high heat conditions.
- Cool Vests are encouraged for all employees at all times during periods of high heat.
- Identify the location of the closest Occupational/Industrial Clinic or Hospital in case a crew member becomes ill.

What is the specific plan to provide and replenish sufficient water for all employees on site?

- If offsite replenish is necessary, where will you go to replenish water (location/address):
- Who will replenish the drinking water (name):

## Restroom facilities

- Employees shall have access to restroom facilities with hand-washing stations. Use of onsite restroom is at the client's discretion (location is annotated below). If client does not give permission, location of suitable restroom facilities with hand-washing stations offsite will be provided. The onsite supervisor will identify location and make arrangements to ensure all employees have access at any point.

- Restroom facilities will be (circle one): Onsite - Offsite
- If Offsite, add location name and address:

## Incident Reporting Procedure

- Contact your Site Supervisor  
Name:  
Phone:
- Contact your Manager  
Name:  
Phone:
- Contact your Site Supervisor  
Name:  
Phone:

With: Your full name, phone number, office location, brief description of what happen and when.

## NOTE ADDITIONAL HAZARDS NOT ADDRESSED ABOVE (add as many as necessary by using additional sheets)

Define the Hazard:	Method/steps to prevent incident:

**CLIENT:**  
ALLISON SCHAEFER  
303 EAST J STREET, ERWIN, NC 28339  
AHJ: HARNETT COUNTY (NC)  
UTILITY: DUKE ENERGY  
PHONE: (585) 794-0133  
EMAIL: SCHAEFERA28@YAHOO.COM  
FINANCE: OTHER

**SYSTEM:**  
SYSTEM SIZE (DC): 22 X 410 = 9.020 kW  
SYSTEM SIZE (AC): 6.000 kW @ 240V  
MODULES: 22 X REC SOLAR: REC410AA  
PURE-R  
OPTIMIZERS: 22 X SOLAREEDGE P505  
INVERTER: SOLAREEDGE SE6000H-USRGM [S11]

REVISIONS		
NO.	REVISED BY	DATE
-	-	-
-	-	-
-	-	-



**FREEDOM FOREVER LLC**  
415 INDUSTRIAL CT., GREER, SC 29651  
Tel: (800) 385-1075

**GREG ALBRIGHT**



**CONTRACTOR LICENSE:**  
ELECTRICAL CONTRACTOR U.34043

SAFETY PLAN			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
351348	7/12/2023	A.W.	PV-10

FOR INSTALLATION REFERENCE ONLY

SCAN QR CODE TO ACCESS REFERENCE LINK

**FREEDOM REFERENCES**



INSTALL HOTLINE

**PV INSTALLATION REFERENCES**



ENPHASE IQ8



SOLAREEDGE HD WAVE



TESLA INVERTER

**BATTERY INSTALLATION REFERENCES**



TESLA POWERWALL 2



SHIFT/SELF CONSUMPTION



SOLAREEDGE ENERGY BANK



SOLAREEDGE LG RESU (BACKUP)



TESLA POWERWALL+ (BACKUP)

# REC ALPHA PURE-R SERIES PRODUCT SPECIFICATIONS

COMPACT PANEL SIZE

9 A PANEL CURRENT  
COMPATIBLE WITH MLPE

430 WP  
223 W/M<sup>2</sup>



ELIGIBLE


  
LEAD FREE  
ROHS COMPLIANT

EXPERIENCE  
  
PERFORMANCE

## REC ALPHA PURE-R SERIES PRODUCT SPECIFICATIONS

### GENERAL DATA

Cell type:	80 half-cut REC heterojunction cells with lead-free, gapless technology
Glass:	3.2 mm solar glass with anti-reflective surface treatment in accordance with EN 12150
Backsheet:	Highly resistant polymer (black)
Frame:	Anodized aluminum (black)
Junction box:	4-part, 4 bypass diodes, lead-free IP68 rated, in accordance with IEC 62790
Connectors:	Stäubli MC4 PV-KBT4/KST4 (4 mm <sup>2</sup> ) in accordance with IEC 62852, IP68 only when connected
Cable:	4 mm <sup>2</sup> solar cable, 1.7 + 1.7 m in accordance with EN 50618
Dimensions:	1730 x 1118 x 30 mm (1.93 m <sup>2</sup> )
Weight:	21.5 kg
Origin:	Made in Singapore

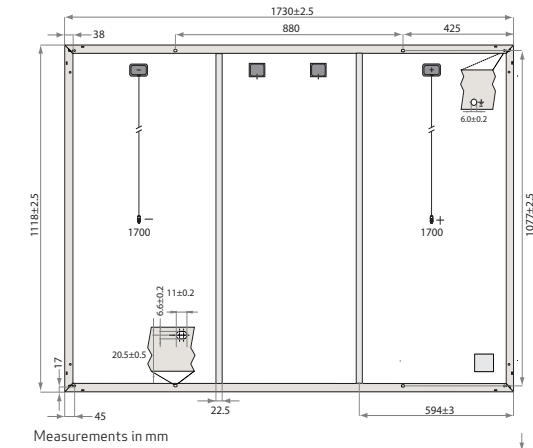

### ELECTRICAL DATA

	Product Code*: RECxxxAA Pure-R			
Power Output - P <sub>MAX</sub> (Wp)	400	410	420	430
Watt Class Sorting - (W)	0/+10	0/+10	0/+10	0/+10
Nominal Power Voltage - V <sub>MPP</sub> (V)	48.8	49.4	50.0	50.5
Nominal Power Current - I <sub>MPP</sub> (A)	8.20	8.30	8.40	8.52
Open Circuit Voltage - V <sub>OC</sub> (V)	58.9	59.2	59.4	59.7
Short Circuit Current - I <sub>SC</sub> (A)	8.80	8.84	8.88	8.91
Power Density (W/m <sup>2</sup> )	207	212	218	223
Panel Efficiency (%)	20.7	21.2	21.8	22.3
Power Output - P <sub>MAX</sub> (Wp)	305	312	320	327
Nominal Power Voltage - V <sub>MPP</sub> (V)	46.0	46.6	47.1	47.6
Nominal Power Current - I <sub>MPP</sub> (A)	6.64	6.70	6.80	6.88
Open Circuit Voltage - V <sub>OC</sub> (V)	55.5	55.8	56.0	56.3
Short Circuit Current - I <sub>SC</sub> (A)	7.11	7.16	7.20	7.24

Values at standard test conditions (STC: air mass AM 1.5, irradiance 1000 W/m<sup>2</sup>, temperature 25°C), based on a production spread with a tolerance of P<sub>MAX</sub>, V<sub>OC</sub> & I<sub>SC</sub> ±3% within one watt class. Nominal module operating temperature (NMOT: air mass AM 1.5, irradiance 800 W/m<sup>2</sup>, temperature 20°C, windspeed 1 m/s). \* Where xxx indicates the nominal power class (P<sub>MAX</sub>) at STC above.

### MAXIMUM RATINGS

Operational temperature:	-40 ... +85°C
System voltage:	1000 V
Test load (front):	+7000 Pa (713 kg/m <sup>2</sup> )*
Test load (rear):	-4000 Pa (407 kg/m <sup>2</sup> )*
Series fuse rating:	25 A
Reverse current:	25 A

\* See installation manual for mounting instructions.  
Design load = Test load / 1.5 (safety factor)

### WARRANTY

	Standard	REC ProTrust	
Installed by an REC Certified Solar Professional	No	Yes	Yes
System Size	All	≤25 kW 25-500 kW	
Product Warranty (yrs)	20	25	25
Power Warranty (yrs)	25	25	25
Labor Warranty (yrs)	0	25	10
Power in Year 1	98%	98%	98%
Annual Degradation	0.25%	0.25%	0.25%
Power in Year 25	92%	92%	92%

The REC ProTrust Warranty is only available on panels purchased through an REC Certified Solar Professional installer. Warranty conditions apply. See [www.recgroup.com](http://www.recgroup.com) for more details.

Available from:

Founded in 1996, REC Group is an international pioneering solar energy company dedicated to empowering consumers with clean, affordable solar power. As Solar's Most Trusted, REC is committed to high quality, innovation, and a low carbon footprint in the solar materials and solar panels it manufactures. Headquartered in Norway with operational headquarters in Singapore, REC also has regional hubs in North America, Europe, and Asia-Pacific.

### CERTIFICATIONS

IEC 61215:2016, IEC 61730:2016, UL 61730	
IEC 62804	PID
IEC 61701	Salt Mist
IEC 62716	Ammonia Resistance
ISO 11925-2	Ignitability (EN 13501-1 Class E)
IEC 62782	Dynamic Mechanical Load
IEC 61215-2:2016	Hailstone (35mm)
IEC 62321	Lead-free acc. to RoHS EU 863/2015
IEC 61730-2:2016	Fire Class C (as per UL 790)
ISO 14001, ISO 9001, IEC 45001, IEC 62941	



### TEMPERATURE RATINGS\*

Nominal Module Operating Temperature:	44°C (±2°C)
Temperature coefficient of P <sub>MAX</sub> :	-0.24 %/°C
Temperature coefficient of V <sub>OC</sub> :	-0.24 %/°C
Temperature coefficient of I <sub>SC</sub> :	0.04 %/°C


\*The temperature coefficients stated are linear values

### DELIVERY INFORMATION

Panels per pallet:	33
Panels per 40 ft GP/high cube container:	858 (26 pallets)
Panels per 13.6 m truck:	924 (28 pallets)

### LOW LIGHT BEHAVIOUR

Typical low irradiance performance of module at STC:

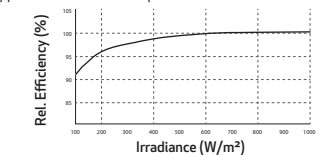

# Power Optimizer

For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505



POWER OPTIMIZER

## PV power optimization at the module-level

- Specifically designed to work with SolarEdge inverters
- Up to 25% more energy
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch losses, from manufacturing tolerance to partial shading
- Flexible system design for maximum space utilization
- Fast installation with a single bolt
- Next generation maintenance with module-level monitoring
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)
- Module-level voltage shutdown for installer and firefighter safety

solaredge.com



## / Power Optimizer

For North America

P320 / P340 / P370 / P400 / P401 / P405 / P485 / P505

Optimizer model (typical module compatibility)	P320 (for 60-cell modules)	P340 (for high-power 60-cell modules)	P370 (for higher-power 60 and 72-cell modules)	P400 (for 72 & 96-cell modules)	P401 (for high power 60 and 72 cell modules)	P405 (for high-voltage modules)	P485 (for high-voltage modules)	P505 (for higher current modules)		
<b>INPUT</b>										
Rated Input DC Power <sup>(1)</sup>	320	350	370	400	405	485	505	W		
Absolute Maximum Input Voltage (Voc at lowest temperature)	48		60	80	60	125 <sup>(2)</sup>		83 <sup>(2)</sup>	Vdc	
MPPT Operating Range	8 - 48		8 - 60	8 - 80	8-60	12.5 - 105		12.5 - 83	Vdc	
Maximum Short Circuit Current (Isc)	11	11.02	11	10.1	11.75	11		14	Adc	
Maximum DC Input Current	13.75			12.5	14.65	12.5		17.5	Adc	
Maximum Efficiency	99.5									
Weighted Efficiency	98.8							98.6		%
Overvoltage Category	II									
<b>OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREEDGE INVERTER)</b>										
Maximum Output Current	15								Adc	
Maximum Output Voltage	60					85				Vdc
<b>OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREEDGE INVERTER OR SOLAREEDGE INVERTER OFF)</b>										
Safety Output Voltage per Power Optimizer	1 ± 0.1								Vdc	
<b>STANDARD COMPLIANCE</b>										
EMC	FCC Part15 Class B, IEC61000-6-2, IEC61000-6-3									
Safety	IEC62109-1 (class II safety), UL1741									
Material	UL94 V-0, UV Resistant									
RoHS	Yes									
<b>INSTALLATION SPECIFICATIONS</b>										
Maximum Allowed System Voltage	1000									Vdc
Compatible inverters	All SolarEdge Single Phase and Three Phase inverters									
Dimensions (W x L x H)	129 x 153 x 27.5 / 5.1 x 6 x 1.1		129 x 153 x 33.5 / 5.1 x 6 x 1.3	129 x 153 x 29.5 / 5.1 x 6 x 1.16	129 x 159 x 49.5 / 5.1 x 6.3 x 1.9		129 x 162 x 59 / 5.1 x 6.4 x 2.3		mm / in	
Weight (including cables)	630 / 1.4		750 / 1.7	655 / 1.5	845 / 1.9		1064 / 2.3		gr / lb	
Input Connector	MC4 <sup>(3)</sup>						Single or dual MC4 <sup>(3)(4)</sup>	MC4 <sup>(3)</sup>		
Input Wire Length	0.16 / 0.52				0.16 or 0.9 / 0.52 or 2.95 <sup>(5)</sup>	0.16 / 0.52			m / ft	
Output Wire Type / Connector	Double Insulated / MC4									
Output Wire Length	0.9 / 2.95			1.2 / 3.9						m / ft
Operating Temperature Range <sup>(6)</sup>	-40 to +85 / -40 to +185									°C / °F
Protection Rating	IP68 / Type 6P									
Relative Humidity	0 - 100									%

(1) Rated power of the module at STC will not exceed the optimizer "Rated Input DC Power". Modules with up to +5% power tolerance are allowed  
 (2) NEC 2017 requires max input voltage be not more than 80V  
 (3) For other connector types please contact SolarEdge  
 (4) For dual version for parallel connection of two modules use P485-4NMDMRM. In the case of an odd number of PV modules in one string, installing one P485 dual version power optimizer connected to one PV module. When connecting a single module seal the unused input connectors with the supplied pair of seals  
 (5) Longer inputs wire length are available for use. For 0.9m input wire length order P401-xxxLxxx  
 (6) For ambient temperature above +85°C / +185°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details

PV System Design Using a SolarEdge Inverter <sup>(7)(8)</sup>	Single Phase HD-Wave	Single phase	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	P320, P340, P370, P400, P401 P405, P485, P505	8	10	18	
Maximum String Length (Power Optimizers)		6	8	14	
		25	25	50 <sup>(9)</sup>	
Maximum Power per String		5700 (6000 with SE7600-US - SE11400-US)	5250	6000 <sup>(10)</sup>	12750 <sup>(11)</sup>
Parallel Strings of Different Lengths or Orientations	Yes				W

(7) For detailed string sizing information refer to: [http://www.solaredge.com/sites/default/files/string\\_sizing\\_na.pdf](http://www.solaredge.com/sites/default/files/string_sizing_na.pdf)  
 (8) It is not allowed to mix P405/P485/P505 with P320/P340/P370/P400/P401 in one string  
 (9) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement  
 (10) For 208V grid: it is allowed to install up to 6,500W per string when the maximum power difference between each string is 1,000W  
 (11) For 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W





# Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US



12-25  
YEAR  
WARRANTY

INVERTERS

## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
APPLICABLE TO INVERTERS WITH PART NUMBER	SEXXXXH-XXXXXBXX4							
<b>OUTPUT</b>								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage Min.-Nom.-Max. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac
AC Output Voltage Min.-Nom.-Max. (183 - 208 - 229)	-	✓	-	✓	-	-	✓	Vac
AC Frequency (Nominal)	59.3 - 60 - 60.5 <sup>(1)</sup>							Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	A
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	A
Power Factor	1, Adjustable - 0.85 to 0.85							
GFDI Threshold	1							A
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes							
<b>INPUT</b>								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded	Yes							
Maximum Input Voltage	480							Vdc
Nominal DC Input Voltage	380							Vdc
Maximum Input Current @240V <sup>(2)</sup>	8.5	10.5	13.5	16.5	20	27	30.5	Adc
Maximum Input Current @208V <sup>(2)</sup>	-	9	-	13.5	-	-	27	Adc
Max. Input Short Circuit Current	45							Adc
Reverse-Polarity Protection	Yes							
Ground-Fault Isolation Detection	600k $\Omega$ Sensitivity							
Maximum Inverter Efficiency	99	99.2						%
CEC Weighted Efficiency	99						99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption	< 2.5							W

(1) For other regional settings please contact SolarEdge support

(2) A higher current source may be used; the inverter will limit its input current to the values stated

# / Single Phase Inverter with HD-Wave Technology

## for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US/  
SE7600H-US / SE10000H-US / SE11400H-US


MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US
<b>ADDITIONAL FEATURES</b>							
Supported Communication Interfaces	RS485, Ethernet, ZigBee (optional), Cellular (optional)						
Revenue Grade Metering, ANSI C12.20	Optional <sup>(3)</sup>						
Consumption metering							
Inverter Commissioning	With the SetApp mobile application using Built-in Wi-Fi Access Point for Local Connection						
Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12	Automatic Rapid Shutdown upon AC Grid Disconnect						
<b>STANDARD COMPLIANCE</b>							
Safety	UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.I.L. M-07						
Grid Connection Standards	IEEE1547, Rule 21, Rule 14 (HI)						
Emissions	FCC Part 15 Class B						
<b>INSTALLATION SPECIFICATIONS</b>							
AC Output Conduit Size / AWG Range	1" Maximum / 14-6 AWG			1" Maximum / 14-4 AWG			
DC Input Conduit Size / # of Strings / AWG Range	1" Maximum / 1-2 strings / 14-6 AWG			1" Maximum / 1-3 strings / 14-6 AWG			
Dimensions with Safety Switch (HxWxD)	17.7 x 14.6 x 6.8 / 450 x 370 x 174			21.3 x 14.6 x 7.3 / 540 x 370 x 185			
Weight with Safety Switch	22 / 10	25.1 / 11.4	26.2 / 11.9	38.8 / 17.6			
Noise	< 25			< 50			
Cooling	Natural Convection						
Operating Temperature Range	-40 to +140 / -40 to +60 <sup>(4)</sup>						
Protection Rating	NEMA 4X (Inverter with Safety Switch)						

(3) Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BNI4. For consumption metering, current transformers should be ordered separately: SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box

(4) Full power up to at least 50°C / 122°F; for power de-rating information refer to: <https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf>

## How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

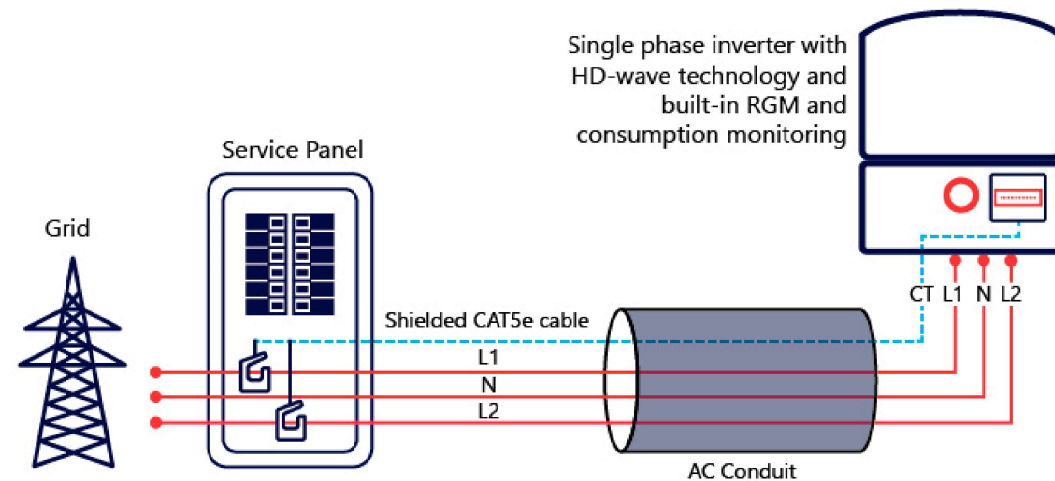

## Product specifications

# Eaton DG222URB

Catalog Number: DG222URB

Eaton General duty non-fusible safety switch, single-throw, 60 A, NEMA 3R, Rainproof, Painted galvanized steel, Two-pole, Two-wire, 240 V

## General specifications

Product Name	Catalog Number
Eaton general duty non-fusible safety switch	DG222URB
	UPC
	782113144238

Product Length/Depth	Product Height
7.38 in	14.38 in

Product Width	Product Weight
8.69 in	9 lb

Warranty	Certifications
Eaton Selling Policy 25-000, one (1) year from the date of installation of the Product or eighteen (18) months from the date of shipment of the Product, whichever occurs first.	UL Listed

	<a href="#">Catalog Notes</a>
	WARNING! Switch is not approved for service entrance unless a neutral kit is installed.



## Product specifications

Product Category  
General duty safety switch

Enclosure material  
Painted galvanized steel

Type  
Non-fusible, single-throw

Fuse configuration  
Non-fusible

Number of wires  
2

Enclosure  
NEMA 3R

Voltage rating  
240V

Amperage Rating  
60A

Number Of Poles  
Two-pole

## Resources

Catalogs  
[Eaton's Volume 2—Commercial Distribution](#)

Multimedia  
[Double Up on Safety](#)  
[Switching Devices Flex Center](#)

Specifications and datasheets  
[Eaton Specification Sheet - DG222URB](#)

Warranty guides  
[Selling Policy 25-000 - Distribution and Control Products and Services](#)




Eaton Corporation plc  
Eaton House  
30 Pembroke Road  
Dublin 4, Ireland  
Eaton.com  
© 2023 Eaton. All Rights Reserved.

Eaton is a registered trademark.  
All other trademarks are property of their respective owners.



[Eaton.com/socialmedia](https://www.eaton.com/socialmedia)

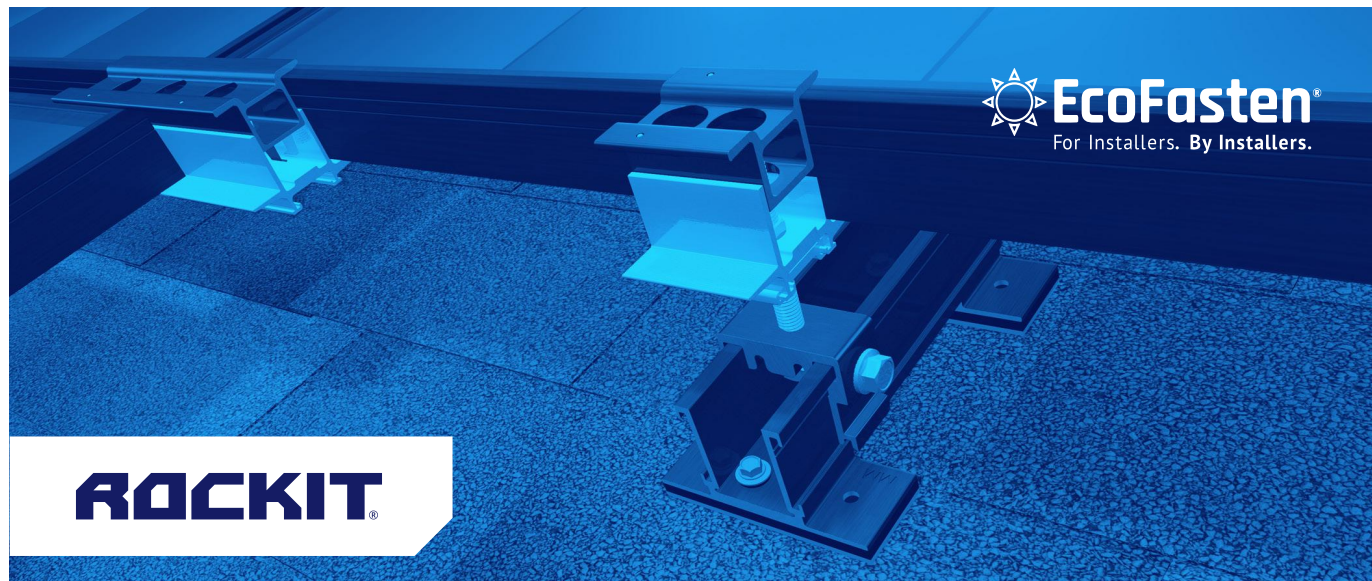


## INTRODUCING ROCKIT SMART SLIDE!

Introducing EcoFasten's patent pending RockIt Smart Slide, our simple solution for quickly installing the popular RockIt rail-less racking system to composition shingle roofs.

### Features & Benefits

- Eliminates the need to pry up shingle courses and install a metal flashing
- Multiple opportunities to find the rafter
- No need for additional material when architectural shingles are not level
- Longer 6.75" slide avoids overlaps in shingle courses
- Integrated flashing utilizes UltraGrip Technology™ to create a watertight seal

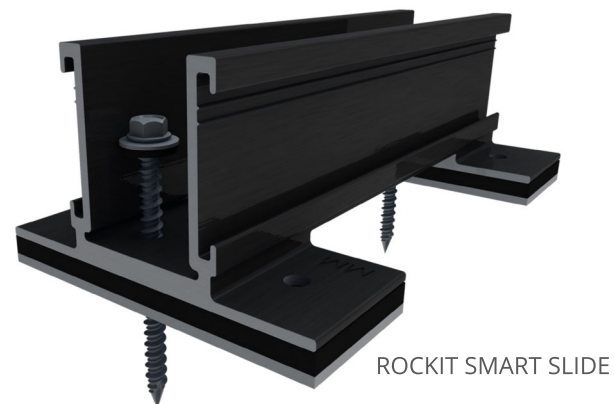


### Required Components:

Part Number:	Description:
2011024	RI SMART SLIDE BLK 6.75"
2011025	RI SMART SCRW #12X3" W/BW

## ROCKIT SMART SLIDE

### Integrated UltraGrip Technology™

Pre-installed sealing pads are compatible with all composition shingle roofs. The compression achieved when fastened to the roof creates a super strong watertight seal. In most cases, the slide can be mounted to the deck without the need for sealant. A layer of flexible foam provides cushioning, which allows the waterproofing sealant to embed deep into the granules of the shingle as well as to flexibly conform over the steps found on architectural-style shingles.

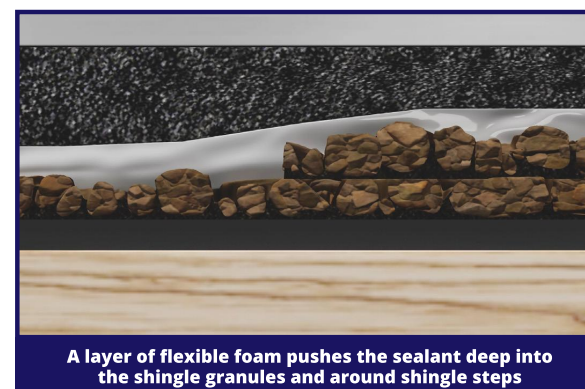

### Testing & Documentation

- [UL441 Rain Report](#)
- [TAS 100 \(A\)-95 Wind and Wind Driven Rain Resistance](#)
- [Mechanical Load Test/Structural Capacity Certification](#)
- [Florida Product Approval](#)
- [RockIt Installation Manual](#)
- [RockIt CutSheets](#)



# RI SMART SLIDE BLK 6.75"

PART NUMBER	DESCRIPTION
2011024	RI SMART SLIDE BLK 6.75"

ITEM NO.	DESCRIPTION
1	ROCKIT SMART SLIDE ASSEMBLY

1) ROCKIT FLASHLESS SLIDE ASSEMBLY

MATERIAL	DESCRIPTION
	ALUMINUM, EPDM, ADHESIVE, TREATED PAPER
FINISH	BLACK

Rev: CS-3

# RI SMART SCREW #12X3" W/BW

PART NUMBER	DESCRIPTION
2011025	RI SMART SCREW #12X3" W/BW

ITEM NO.	DESCRIPTION
1	SELF TAPPING SCREW #12 WITH SEALING WASHER ASSEMBLY

MATERIAL	DESCRIPTION
	STAINLESS STEEL, EPDM RUBBER
FINISH	MILL, BLACK

Rev: CS-2



## ROCKIT

### COMPLETE RAIL-LESS RACKING SYSTEM

The RockIt system is the industry's premier rail-less PV racking system for composition shingle, tile, and metal roofs. Designed in conjunction with the needs of installers, RockIt quickly & easily installs with a single tool. Featuring an easy-to-position alignment slide and a top-down leveling system, RockIt is logistically intelligent with no need to ship or transport long rails. Components are available in a black finish that complements both commercial and residential applications. Conforms to UL 2703.

#### FEATURES & BENEFITS

- Patented watertight technology
- Fully integrated bonding
- Top-down leveling system
- North-South adjustability
- Single tool install
- Florida Product Approved for composition shingle roofs

### STREAMLINED INSTALLATION WITH MINIMAL ROOF PENETRATIONS



## ROCKIT

### ROCKIT COUPLING


The fast installing RockIt Coupling easily attaches to the module frame to bridge the gaps between modules.

### SKIRT

The sleek black Skirt installs first and acts as an alignment guide for the entire array. The Skirt End Cap does double duty as a skirt coupling device and an aesthetically-pleasing finishing touch.

### ROCKIT MOUNT

Featuring integrated bonding pins, the RockIt Mount connects to the Slide and can easily be positioned for fast installation. Features top-down leveling.

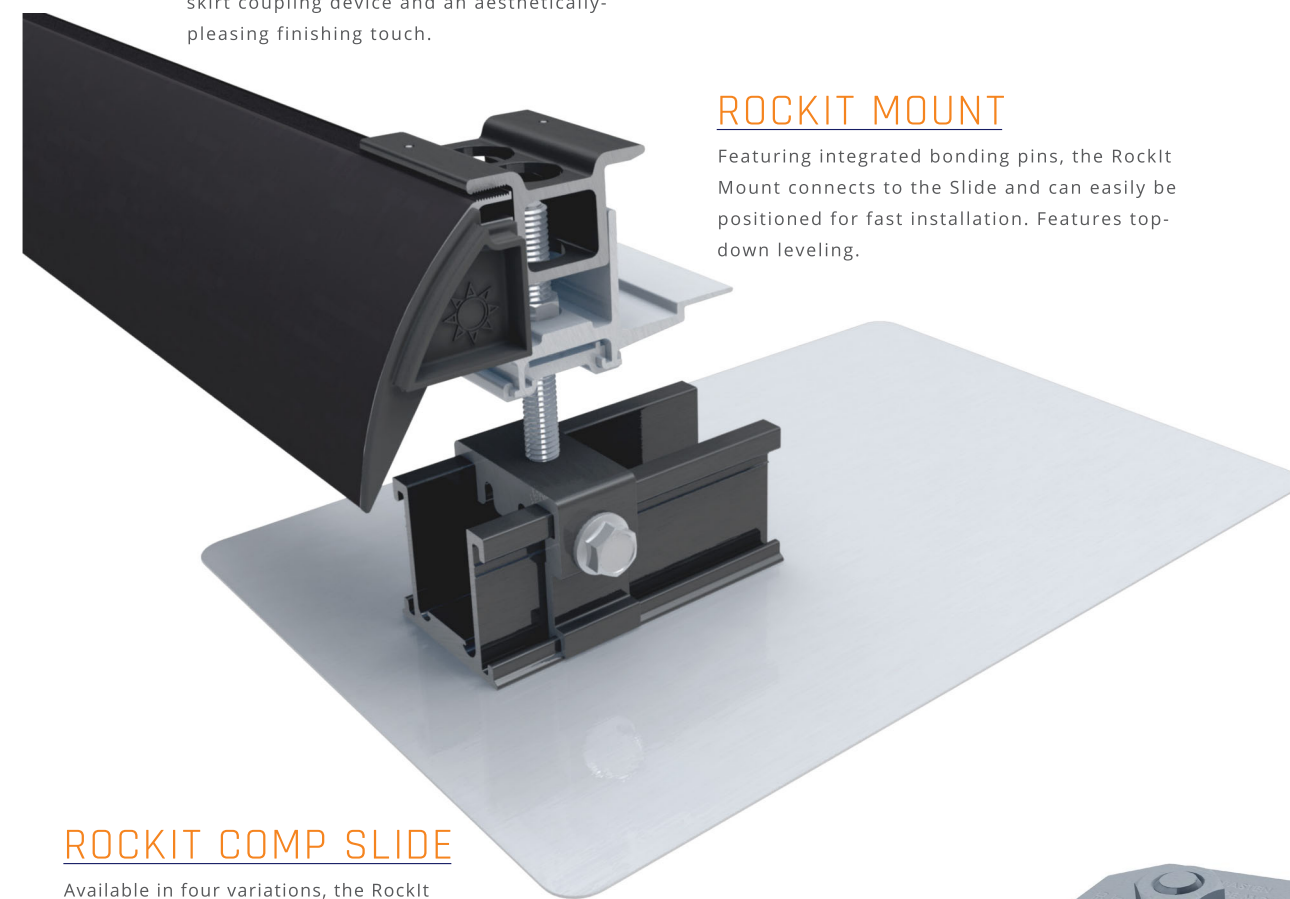


### ROCKIT COMP SLIDE

Available in four variations, the RockIt Slide allows installation on composition shingle, tile, and metal roofs.


### FRAME MLPE MOUNT

Attaches and fully bonds MLPE's (Module Level Power Electronics) to the module frame with a single bolt clip.

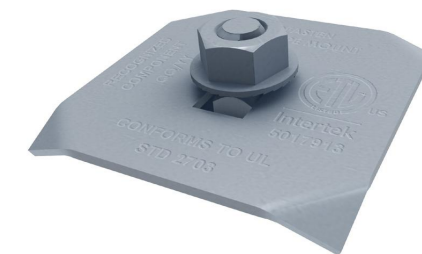



# RI COMP SLIDE AL BLK

PART NUMBER	DESCRIPTION
2011013	RI COMP SLIDE AL BLK

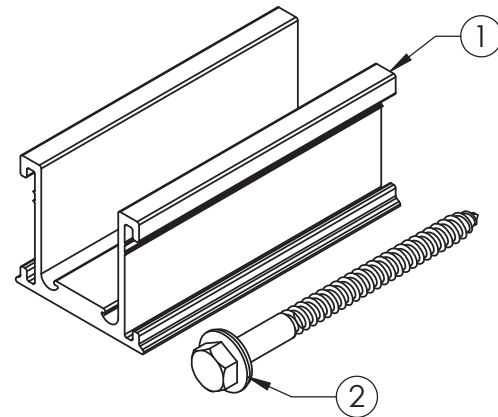

ITEM NO.	DESCRIPTION
1	ROCKIT V3 SLIDECOMP
2	LAG SCREW, 5/16-4", THREAD 3", EPDM BACKED WASHER

1) ROCKIT V3 SLIDECOMP

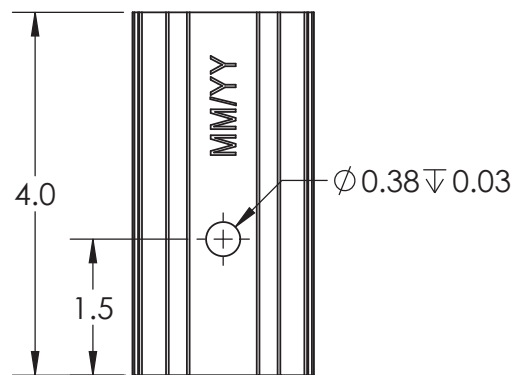


Material	Aluminum
Finish	Black

REV.- CS1

# RI COMP SLIDE AL BLK

2) LAG SCREW, 5/16-4", THREAD 3", EPDM BACKED WASHER

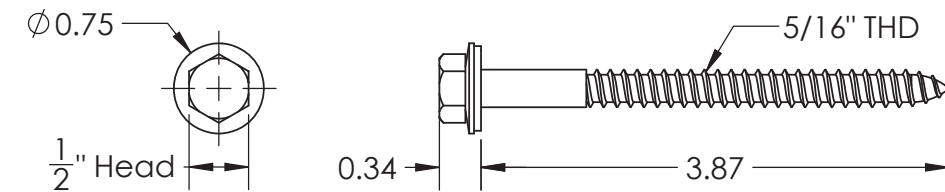


Material	Stainless Steel
Finish	Mill

REV.- CS1


# GF-1 FLASHING GLV BLK 8X10"

PART NUMBER	DESCRIPTION
3012020	GF-1 FLASHING GLV BLK 8X10"

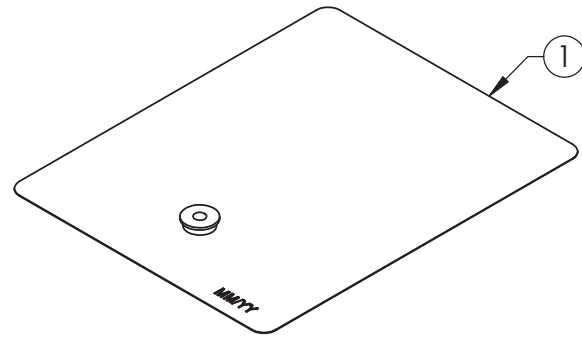

ITEM NO.	DESCRIPTION
1	GF1M-GAL-BLK-810 W/O WASHER ASSEMBLY

1) GF1M-GAL-BLK-810 W/O WASHER ASSEMBLY

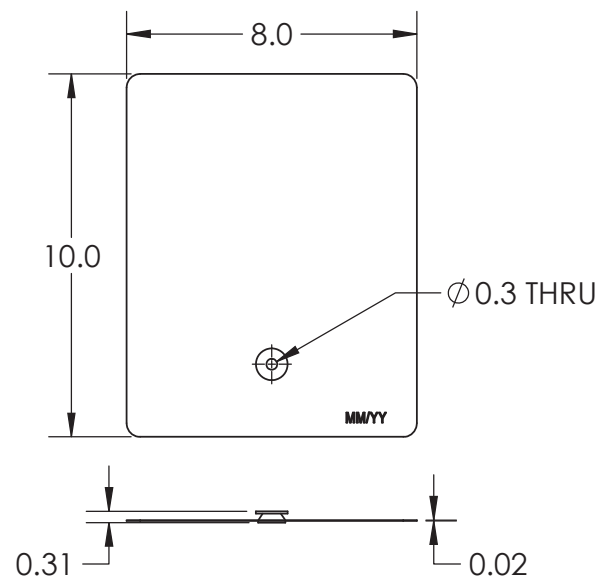

Material	Corrosion Resistant Steel
Finish	Black

REV.- CS1







May 16, 2022

EcoFasten Solar LLC  
4141 W Van Buren St, Ste 2  
Phoenix, AZ 85009  
TEL: (877) 859-3947

Attn.: Eco Fasten Solar LLC - Engineering Department

Re: Report # 2015-05884HG.07.01 – EcoFasten - RockIt System for Gable and Hip Roofs  
Subject: Engineering Certification for the State of North Carolina

PZSE, Inc. – Structural Engineers has provided engineering and span tables for the EcoFasten - RockIt System, as presented in PZSE Report # 2015-05884HG.07.01, "Engineering Certification for the EcoFasten - RockIt System for Gable and Hip Roofs". All information, data, and analysis therein are based on, and comply with, the following building codes and typical specifications:

- Building Codes:
1. ASCE/SEI 7-10, 7-16, Minimum Design Loads for Buildings and Other Structures, by American Society of Civil Engineers
  2. 2015 & 2018 International Building Code
  3. 2015 & 2018 International Residential Code
  4. AC428, Acceptance Criteria for Modular Framing Systems Used to Support Photovoltaic (PV) Panels, November 1, 2012 by ICC-ES
  5. Aluminum Design Manual 2015 & 2018, by The Aluminum Association, Inc.
  6. ANSI/AWC NDS-2015 & 2018, National Design Specification for Wood Construction, by the American Wood Council

Design Criteria:

Risk Category II  
Seismic Design Category = A - E  
Exposure Category = B, C & D  
Basic Wind Speed (ultimate) per ASCE 7-16 = 90 mph to 180 mph  
Ground Snow Load = 0 to 60 (psf)

This letter certifies that the loading criteria and design basis for the EcoFasten - RockIt System Span Tables are in compliance with the above codes.

If you have any questions on the above, do not hesitate to call.

Prepared by:  
PZSE, Inc. – Structural Engineers  
Roseville, CA

DIGITALLY SIGNED

