

August 5, 2023

Current Insight 2852 W. Amini Way South Jordan, UT 84095

> Re: Engineering Services Schmidt Residence 333 Village Bend Drive, Fuquay-Varina NC 11.060 kW System

To Whom It May Concern:

We have received information regarding solar panel installation on the roof of the above referenced structure. Our evaluation of the structure is to verify the existing capacity of the roof system and its ability to support the additional loads imposed by the proposed solar system.

A. Site Assessment Information

- 1. Site visit documentation identifying attic information including size and spacing of framing for the existing roof structure.
- Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information will be utilized for approval and construction of the proposed system.

B. Description of Structure:

Roof Framing: Prefabricated wood trusses at 24" on center. All truss members are constructed of 2x4 dimensional lumber.

Roof Material:Composite Asphalt ShinglesRoof Slope:22 degreesAttic Access:AccessibleFoundation:Permanent

C. Loading Criteria Used

- Dead Load
 - Existing Roofing and framing = 7 psf
 - New Solar Panels and Racking = 3 psf
 - TOTAL = 10 PSF
- Live Load = 20 psf (reducible) 0 psf at locations of solar panels
- Ground Snow Load = 15 psf
- Wind Load based on ASCE 7-10
 - Ultimate Wind Speed = 119 mph (based on Risk Category II)
 - Exposure Category C

Analysis performed of the existing roof structure utilizing the above loading criteria is in accordance with the 2018 North Carolina Residential Code, including provisions allowing existing structures to not require strengthening if the new loads do not exceed existing design loads by 105% for gravity elements and 110% for seismic elements. This analysis indicates that the existing framing will support the additional panel loading without damage, if installed correctly.

D. Solar Panel Anchorage

- 1. The solar panels shall be mounted in accordance with the most recent Ironridge installation manual. If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
- 2. The maximum allowable withdrawal force for a 5/16" lag screw is 229 lbs per inch of penetration as identified in the National Design Standards (NDS) of timber construction specifications. Based on a minimum penetration depth of 2½", the allowable capacity per connection is greater than the design withdrawal force (demand). Considering the variable factors for the existing roof framing and installation tolerances, the connection using one 5/16" diameter lag screw with a minimum of 2½" embedment will be adequate and will include a sufficient factor of safety.
- 3. Considering the wind speed, roof slopes, size and spacing of framing members, and condition of the roof, the panel supports shall be placed no greater than 48" on center.

Based on the above evaluation, this office certifies that with the racking and mounting specified, the existing roof system will adequately support the additional loading imposed by the solar system. This evaluation is in conformance with the 2018 North Carolina Residential Code, current industry standards, and is based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

ulv vours

Scott E. Wyssling, PE North Carolina Licente No. 46546 North Carolina COA P-2308



Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308 Signed 8/05/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



PROJECT INFORMATION

PROPERTY OWNER

NAME:	MELISSA SCHMIDT
PHONE:	-

CONTRACTOR

NAME:

PHONE:

DESIGN SPECIFICATIONS

OCCUPANCY: R-3 CONSTRUCTION TYPE: SINGLE FAMILY RESIDENCE ZONING: RESIDENTIAL WIND EXPOSURE: С AHJ: HARNETT COUNTY UTILITY: DUKE ENERGY PROGRESS

BYLD

APPLICABLE CODES & STANDARDS

RESIDENTIAL: IRC 2015 BUILDING: IBC 2018 ELECTRICAL: NEC 2020 FIRE: IFC 2018



MELISSA SCHMIDT RESIDENCE

NEW PHOTOVOLTAIC SYSTEM

PROJECT - 11.060 kW DC /

9.772 kW AC

Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308 Signed 8/05/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

TYPE OF

INTERCONNECTION: LINE SIDE TAP IN THE MSP

SCOPE OF WORK

SYSTEM SIZE: STC: 28 X 395W = 11.060kW PTC: 28 X 372W = 10.416kW (28) TRINA SOLAR TSM-395 DE09.05(395W) [BLK] MODULE (28) ENPHASE IQ8A-72-2-US MICROINVERTERS (1) 60A FUSED AC DISCONNECT WITH 60A FUSES (1) 125A ENPHASE IQ COMBINER 4/4C BOX

MSP UPGRADE: NO MAIN BREAKER DERATE: NO

50 Harnett 08/14/2023


RACKING & MOUNTING

PV ATTACHMENT TYPE: IRONRIDGE FLASHVUE FOR COMPOSITE SHINGLE ROOF

RACKING TYPE:

IRONRIDGE XR10 RAIL - ROOF MOUNT RACKING HARDWARE

COORDINATES: 35.521481, -78.852405

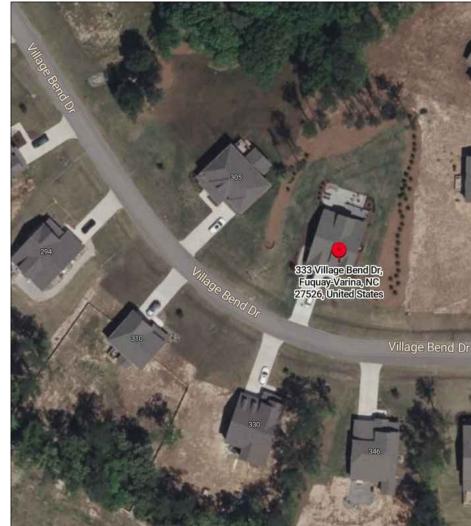

SHEET # T-1 T-2 PV-1 PV-2 PV-3 E-1 E-2 S-1 S-2 S-3 S-4	SHEET NAME COVER SHEET PLAN NOTES SITE PLAN LAYOUT ATTACHMENT DETAILS MOUNTING DETAILS ELECTRICAL DIAGRAM WARNING LABELS SPEC SHEET SPEC SHEET SPEC SHEET SPEC SHEET	BYLD BETTER
S-5	SPEC SHEET	CONTRACTOR
AERIAL	VIEW	BYLD ADDRESS:1213W MOOREHEAD ST, STE500 CHARLOTTE,
	47	DESIGNER: OMS
A AND	Philo Charles	MELISSA SCHMIDT RESIDENCE
OVIIIage Bend Dr, quay-Varina, NC	poom	333 VILLAGE BEND DR, FUQUAY-VARINA NC 27526
26, United States	llage Bend Dr	DATE:8/4/2023
		DESIGN BY
346		Complete Solar A Brighter Way.
and the second s	and the second second	SHEET T1
		COVER SHEET

1.1. PROJECT NOTES:

- 1.2. THIS PHOTOVOLTAIC (PV) SYSTEM SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE (NEC) ARTICLE 690, ALL MANUFACTURERS'S LISTING AND INSTALLATION INSTRUCTIONS, AND THE RELEVANT CODES AS SPECIFIED BY THE AUTHORITY HAVING JURISDICTION'S (AHJ) APPLICABLE CODES.
- 1.3. THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION
- 1.4 GROUND FAULT DETECTION AND INTERRUPTION (GFDI) DEVICE IS INTEGRATED WITH THE MICROINVERTER IN ACCORDANCE WITH NEC 690.5(A)
- 1.5. ALL PV SYSTEM COMPONENTS; MODULES, UTILITY-INTERACTIVE INVERTERS, AND SOURCE CIRCUIT COMBINER BOXES ARE IDENTIFIED AND LISTED FOR USE IN PHOTOVOLTAIC SYSTEMS AS REQUIRED BY NEC 690.4 & NEC 690.60: PV MODULES: UL1703. IEC61730. AND IEC61215. AND NFPA 70 CLASS C FIRE INVERTERS: UL 1741 CERTIFIED, IEEE 1547, 929, 519 COMBINER BOX(ES): UL 1703 OR UL 1741 ACCESSORY
- MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP 1.6. COEFFICIENT FOR VOC. IF UNAVAILABLE, MAX DC VOLTAGE CALCULATED ACCORDING TO NEC 690.7.
- 1.7. ALL INVERTERS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AND SOURCE CIRCUIT COMBINERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (D). SHALL BE INSTALLED ACCORDING TO ANY INSTRUCTIONS FROM LISTING OR LABELING [NEC 110.3].
- ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING 18 CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.

1.9. SCOPE OF WORK:

1.10. PRIME CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE GRID-TIED PHOTOVOLTAIC SYSTEM RETROFIT. PRIME CONTRACTOR WILL BE RESPONSIBLE FOR COLLECTING EXISTING ONSITE REQUIREMENTS TO DESIGN. SPECIFY, AND INSTALL THE EXTERIOR ROOF-MOUNTED PORTION OF THE PHOTOVOLTAIC SYSTEMS DETAILED IN THIS DOCUMENT.

1.11. WORK INCLUDES:

- 1.12. PV ROOF ATTACHMENTS IRONRIDGE FLASHVUE FOR COMPOSITE SHINGLE ROOF
- 1.13. PV RACKING SYSTEM INSTALLATION IRONRIDGE XR10 RAIL ROOF MOUNT RACKING HARDWARE
- 1.14. PV MODULE AND INVERTER INSTALLATION TRINA SOLAR TSM-395 DE09.05(395W) [BLK] MODULES / ENPHASE IQ8A-72-2-US MICROINVERTERS.
- 1.15. PV EQUIPMENT GROUNDING
- 1.16. PV SYSTEM WIRING TO A ROOF-MOUNTED JUNCTION BOX
- 1.17. PV LOAD CENTERS (IF INCLUDED)
- 1.18. PV METERING/MONITORING (IF INCLUDED)
- 1.19. PV DISCONNECTS
- 1.20. PV GROUNDING ELECTRODE & BONDING TO (E) GEC
- 1.21. PV FINAL COMMISSIONING
- 1.22. (E) ELECTRICAL EQUIPMENT RETROFIT FOR PV
- 1.23. SIGNAGE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE
- 1.24. SITE NOTES:
- 1.25. A LADDER WILL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- 1.26. THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES
- 1.27. THE SOLAR PV INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- 1.28. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION NEC 110.26.
- 1.29. ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SERVES TO PROTECT THE BUILDING OR STRUCTURE.

1.30. EQUIPMENT LOCATIONS:

- 1.31. ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS AS REQUIRED BY NEC 110 26
- 1.32. WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC 690.31 (A),(C) AND NEC TABLES 310.15 (B)(2)(A) AND 310.15 (B)(3)(C)
- 1.33. JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES ACCORDING TO NEC 690.34.
- 1.34. ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT.
- 1.35. ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES.
- 1.36. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

1.37. STRUCTURAL NOTES:

- 1.38. RACKING SYSTEM
- 1.39. PV ARRAY WILL BE INSTALLED ACCORDING TO CODE-COMPLIANT INSTALLATION MANUAL. TOP CLAMPS REQUIRE A DESIGNATED SPACE BETWEEN MODULES, AND RAILS MUST ALSO EXTEND
- 1.40. A MINIMUM DISTANCE BEYOND EITHER EDGE OF THE ARRAY/SUBARRAY, ACCORDING TO RAIL MANUFACTURER'S INSTRUCTIONS.
- 1.41. JUNCTION BOX WILL BE INSTALLED PER MANUFACTURERS' SPECIFICATIONS. IF ROOF-PENETRATING TYPE, IT SHALL BE FLASHED SEALED PER LOCAL REQUIREMENTS.
- 1.42. ROOFTOP PENETRATIONS FOR PV RACEWAY WILL BE COMPLETED AND SEALED WITH APPROVED CHEMICAL SEALANT PER CODE BY A LICENSED CONTRACTOR.
- 1.43. ALL PV RELATED ROOF ATTACHMENTS TO BE SPACED NO GREATER THAN THE SPAN DISTANCE SPECIFIED BY THE RACKING MANUFACTURER.
- 1.44. WHEN POSSIBLE, ALL PV RELATED RACKING ATTACHMENTS WILL BE STAGGERED AMONGST THE ROOF FRAMING MEMBERS.

1.45. WIRING & CONDUIT NOTES:

- 1.46. ALL CONDUIT AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.
- 1.47. CONDUCTORS SIZED ACCORDING TO NEC 690.8, NEC 690.7.
- 1.48. VOLTAGE DROP LIMITED TO 1.5%.
- 1.49. DC WIRING LIMITED TO MODULE FOOTPRINT, MICROINVERTER WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY WITH SUITABLE WIRING CLIPS.
- 1.50. AC CONDUCTORS COLORED OR MARKED AS FOLLOWS: PHASE A OR L1-BLACK PHASE B OR L2- RED, OR OTHER CONVENTION IF THREE PHASE PHASE C OR L3- BLUE, YELLOW, ORANGE**, OR OTHER CONVENTION NEUTRAL- WHITE OR GREY IN 4-WIRE DELTA CONNECTED SYSTEMS THE PHASE WITH HIGHER VOLTAGE TO BE MARKED ORANGE [NEC 110.15
- 1.51. GROUNDING NOTES:
- 1.52. GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVISES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR SUCH USE.
- 1.53. PV EQUIPMENT SHALL BE GROUNDED ACCORDING TO NEC 690.43 AND MINIMUM NEC TABLE 250.122.
- 1.54. METAL PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURES CONSIDERED GROUNDED IN ACCORD WITH 250.134 AND 250.136(A).
- 1.55. EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED ACCORDING TO NEC 690.45 AND MICROINVERTER MANUFACTURER'S INSTRUCTIONS.

- 1.56. EACH MODULE WILL BE GROUNDED USING WEEB GROUNDING CLIPS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ. IF WEEBS ARE NOT USED, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE SPECIFIED GROUNDING LUG HOLES PER THE MANUFACTURERS' INSTALLATION REQUIREMENTS.
- 1.57. THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.
- 1.58. GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLORED GREEN OR MARKED GREEN IF #4 AWG OR LARGER [2022 CEC 250 1191
- 1.59. THE GROUNDING ELECTRODE SYSTEM COMPLIES WITH CEC 690.47 AND CEC 250.50 THROUGH 250.106. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM PROVIDED ACCORDING TO CEC 250, CEC 690.47 AND AHJ.
- 1.60. GROUND-FAULT DETECTION SHALL COMPLY WITH CEC 690.41 IN GENERAL AND CEC 690.41 (A)(1) SPECIFICALLY.

1.61. DISCONNECTION AND OVER-CURRENT PROTECTION NOTES:

- 1.62. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING ENERGIZED ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS).
- 1.63. DISCONNECTS TO BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
- 1.64. RAPID SHUTDOWN OF ENERGIZED CONDUCTORS BEYOND 1 FT OF PV ARRAY OR 5 FT INSIDE A BUILDING WITHIN 10 SECONDS. CONTROLLED CONDUCTORS ≤30V AND ≤240VA [CEC 690.12(B)]. LOCATION OF LABEL ACCORDING TO AHJ
- 1.65. ALL OCPD RATINGS AND TYPES SPECIFIED ACCORDING TO CEC 690.8, 690.9, AND 240.
- 1.66. EQUIPMENT THAT IS LISTED, LABELED, OR BOTH SHALL BE INSTALLED AND USED IN ACCORDANCE WITH ANY INSTRUCTIONS INCLUDED IN THE LISTING OR LABELING, CEC 110.3(B),
- 1.67. IF REQUIRED BY AHJ, SYSTEM WILL INCLUDE ARC-FAULT CIRCUIT PROTECTION ACCORDING TO CEC 690.11 AND UL1699B.

1.68. ELECTRICAL INTERCONNECTION NOTES:

- 1.69. THE SUM OF THE UTILITY OCPD AND INVERTER CONTINUOUS INPUT MAY NOT EXCEED 120% OF BUSBAR RATING.
- 1.70. WHEN SUM OF THE PV SOURCES EQUALS >100% OF BUSBAR RATING, PV DEDICATED BACKFEED BREAKERS MUST BE LOCATED OPPOSITE END OF THE BUS FROM THE UTILITY SOURCE OCPD.
- 1.71. AT MULTIPLE PV OUTPUT COMBINER PANEL, TOTAL RATING OF ALL OVERCURRENT DEVICES SHALL NOT EXCEED AMPACITY OF BUSBAR. HOWEVER, THE COMBINED OVERCURRENT DEVICE MAY BE EXCLUDED.
- 1.72. SUPPLY SIDE TAP INTERCONNECTION SHOULD BE CONDUCTORS.
- 1.73. BACKFEEDING BREAKER FOR UTILITY-INTER EXEMPT FROM ADDITIONAL FASTENING



Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308

Signed 8/05/2023 THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED. **ON ANY ELECTRONIC COPIES**

TE. WYSS

ENTRA

CARO

CONTRACTOR

BYLD BETTER

BYLD

ADDRESS:1213W MOOREHEAD ST. STE500 CHARLOTTE. NC 28208 LICENSE #:

DESIGNER: OMS

MELISSA SCHMIDT RESIDENCE

333 VILLAGE BEND DR. **FUQUAY-VARINA** NC 27526


DATE:8/4/2023

DESIGN BY

Complete Solar

A Brighter Way.

SHEET T-2 **PLAN NOTES**

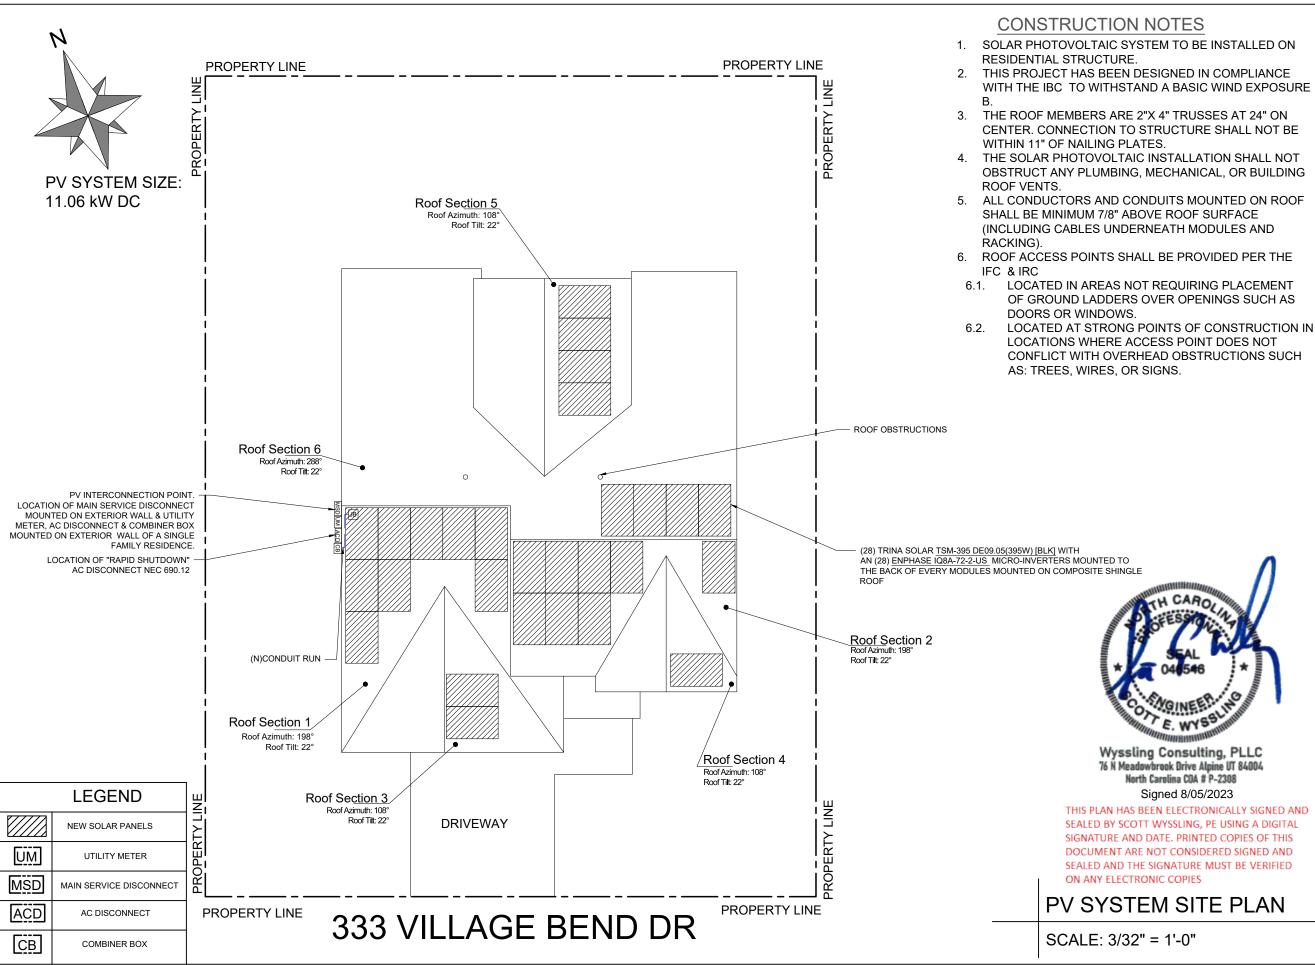



CONTRACTOR

BYLD

ADDRESS:1213W **MOOREHEAD ST.** STE500 CHARLOTTE. NC 28208 LICENSE #:

DESIGNER: OMS

MELISSA SCHMIDT RESIDENCE

333 VILLAGE BEND DR. **FUQUAY-VARINA** NC 27526


DATE:8/4/2023


DESIGN BY

CompleteSolar

A Brighter Way.

SHEET PV-1 SITE PLAN LAYOUT

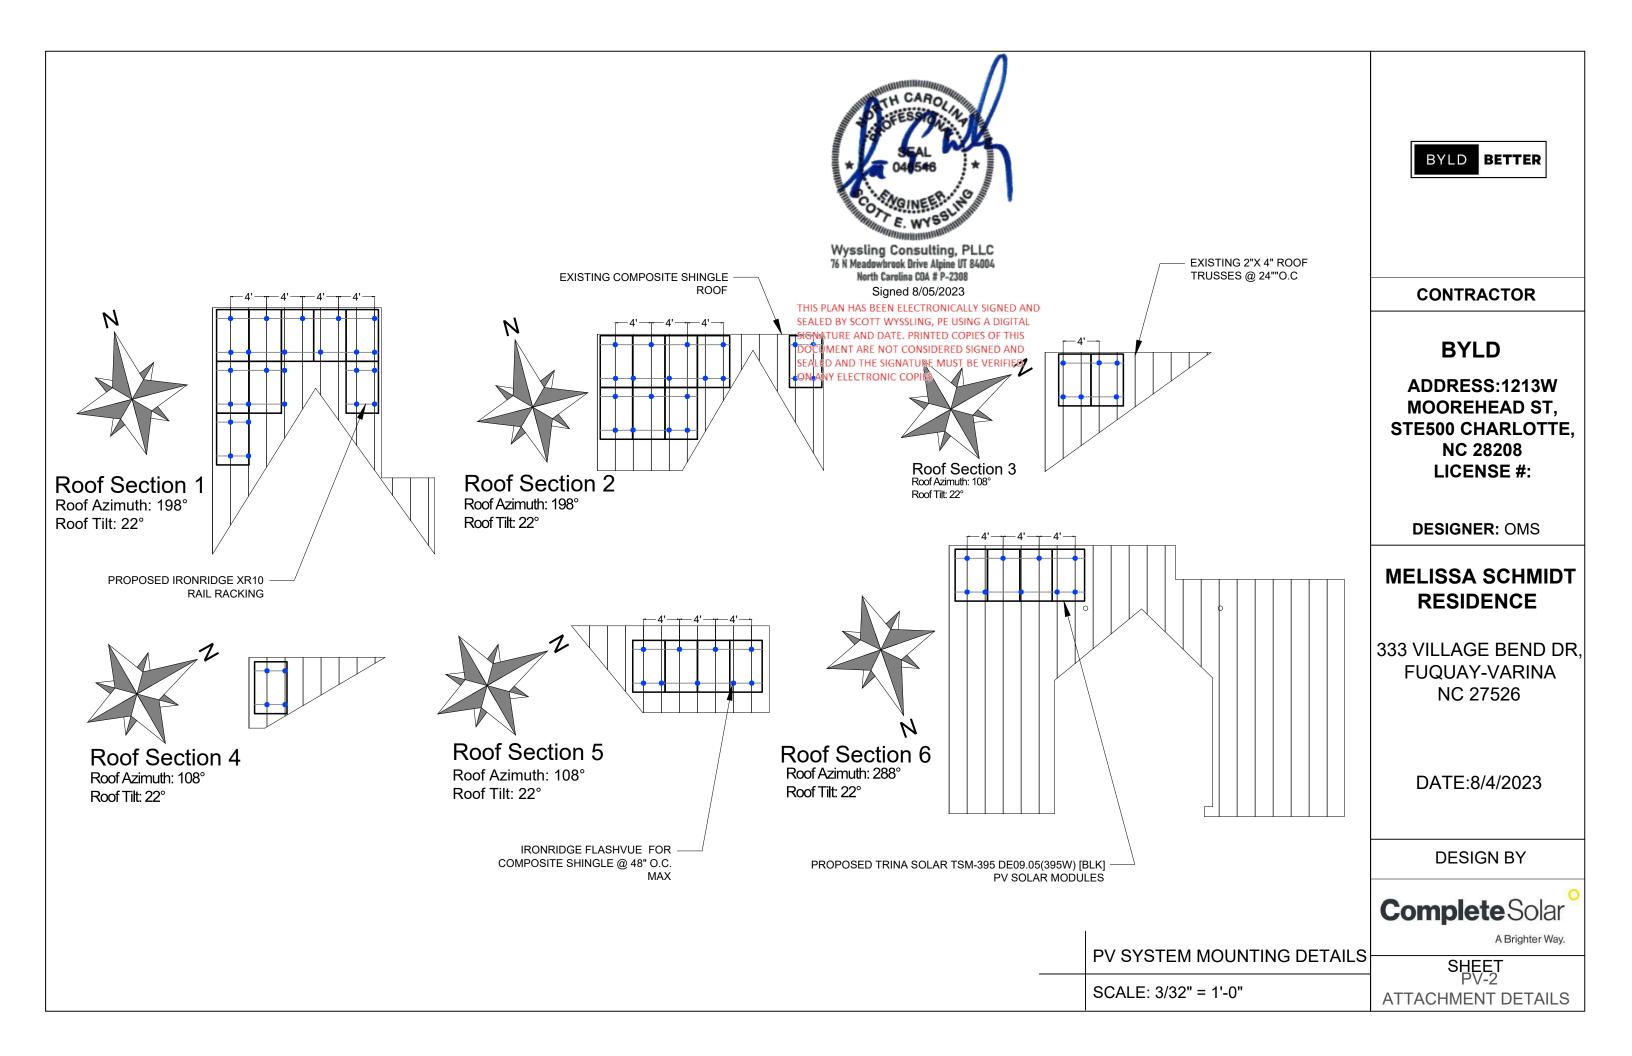

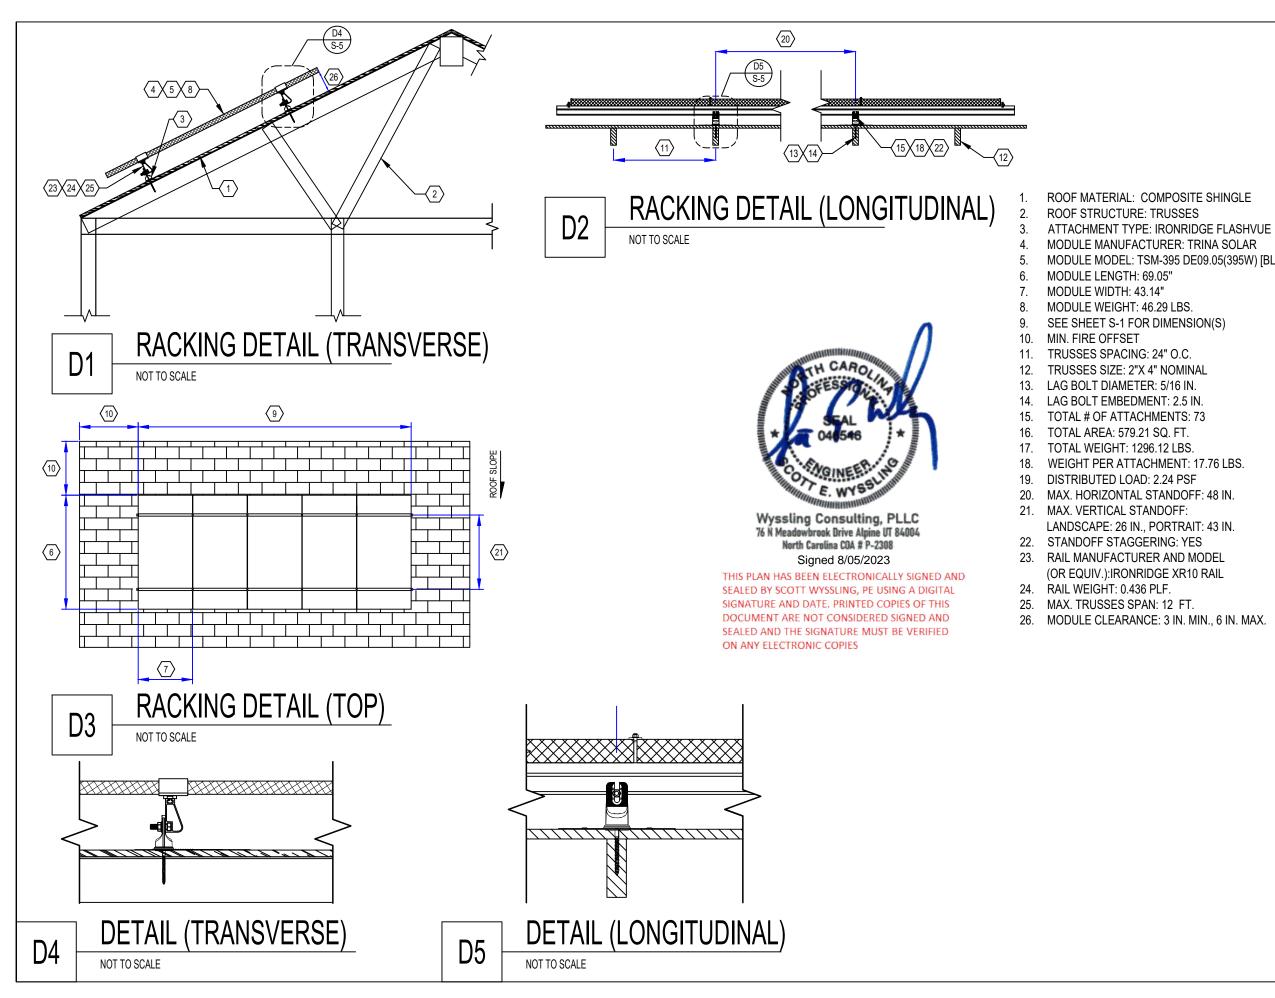

MODULE MODEL: TSM-395 DE09.05(395W) [BLK]



CONTRACTOR

BYLD

ADDRESS:1213W **MOOREHEAD ST,** STE500 CHARLOTTE, NC 28208 LICENSE #:

DESIGNER: OMS

MELISSA SCHMIDT RESIDENCE

333 VILLAGE BEND DR. **FUQUAY-VARINA** NC 27526

DATE:8/4/2023

DESIGN BY

CompleteSolar

A Brighter Way.

SHEET PV-3 MOUNTING DETAILS

	PV Module Rati	ngs @ S⁻	ТС			SYST	EM SUMM	IARY		Inverter F	Ratings	
	TRINA SOLAR TSM-395		5			BRANCH #1 B	BRANCH #2	BRANCH #3	Inverter	ENPHASE		
Nodul	e Make/Model	DE09.05(395W) [BLK]			INVERTERS PER	R BRANCH	10	9	9	Make/Model	IQ8A-72-2-US	
4 5					MAX CONTINUC		14.5A	13.05A	13.05A			
	ower-Point Current (Imp) ower-Point Voltage (Vmp)		11.62 34.0	I						Max DC Volt Rating	60V	BYLD BETTER
	Circuit Voltage (Voc)		41.0		MAX CONTINUC OUTPUT POWEI		3490W	3141W	3141W	Max. Continous	349W	L
· ·	Circuit Current (Isc)		12.21				l		4400014	Output Power		
	eries Fuse (OCPD)		20		ARRAY STC PO				11060W	Max Nominal Voltage	240V	
	al Maximum Power at STC		395V	l ŀ	ARRAY PTC PO				10416W			
Pmax	/				MAX CONTINUC OUTPUT CURRE				40.60A	Max Continuous Output Current	1.45A	
	num System Voltage		1500	<u> </u>					0770\\/		004	CONTRACTOR
/00	emperature Coefficient		-0.25 %/°		MAX CONTINUC OUTPUT POWEI				9772W	Max OCPD Rating	20A	
					OUTPUT POWE	7						BYLD
					DERATED (CEC) AC POWER			10103.52W	DESIGN TEMPE	RATURES	DILD
						1				ASHRAE EXTREME LOW	/ -10°C	ADDRESS:1213W
	Cond	uit and Cor	nductor Sched	ule						ASHRAE 2% HIGH	36°C	MOOREHEAD ST,
Tag	Description	Wire Gauge	# of Conductors	Conduit Ty	pe Conduit Size	-						STE500 CHARLOTTE,
						-						NC 28208
1	Enphase Q cable - THWN-2	10 AWG	3	N/A - Free	Air N/A - Free Air	_						LICENSE #:
1	Bare Copper Ground (EGC/GEC)	6 AWG	1	N/A - Free	Air N/A - Free Air						10	
2	THWN-2	10 AWG	6	ЕМТ	3/4"	-				METER # 3362872 ² MAIN SERVICE DISCO		DESIGNER: OMS
			-			-				SUPPLY SIDE TAP		DESIGNER. OWIS
2	THWN-2 - Ground	10 AWG	1	EMT	3/4"					NEC 705. 11 SUPPLY S	SIDE.	
2A	THWN-2	10 AWG	3	N/A - Free	Air N/A - Free Air					POWER PRODUCTION		MELISSA SCHMIDT
3	THWN-2	6 AWG	3	ЕМТ	3/4"	-						RESIDENCE
		0/11/0				-						
3	THWN-2 - Ground	10 AWG	1	EMT	3/4"	(N) 125	A/240V AC			POINT OF		333 VILLAGE BEND DR
	(N) 28 TRINA SOLAR TSM-395	5 DE09.05(395W)	BLKI MODULES		ł	COMBINE	R BOX WITH			DELIVERY AND		FUQUAY-VARINA
	WITH AN (28) ENPHASE IQ ATTACHED TO THE B/	8A-72-2-US MIC	RO-INVERTER				E IQ ENVOY GATEWAY			INTERCONNECTION		NC 27526
					JT Q							
	PV CIRCUIT 3: 9 MODULES/PARALL				GROUND LEVEL					(M)		
				_	100FEX							
	<u> </u>				TOPENE			(N) 60A		JPPLY-SIDE		DATE:8/4/2023
	PV CIRCUIT 2: 9 MODULES/PARALL				() R '	2A			ONNECT	NEC 705.11		
										EXISTING		
							(E)200A (E)200A (E)200A (E)200A (E)200A		DESIGN BY			
PV CIRCUIT 1: 10 MODULES/PARALLEL												
						Complete Solar						
					\\		N.					-
							A Brighter Way.					
GROUNDING / BONDING, GROUND CLAMPS ARE AT EACH END OF THE EMT CONDUIT WITH THE WIRE THEN FREE (N) JUNCTION BOX							3			3 (E) GROUNI ELECTROD	DING E OR	SHEET
	AIR'D TO THE GROUND CLAMP C			- WITH IRREVER GROUND SPLI	KOIBLE \ /			/ WITH	IN 10' OF	(UFER)		E-1 ELECTRICAL DIAGRAM
								M	ETER			

ELECTRICAL SHOCK HAZARD

TERMINALS ON LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION: INVERTER(S), AC DISCONNECT(S), AC COMBINER PANEL (IF APPLICABLE). PER CODE(S): NEC : 690.13(B) & 706.15(C)(4)

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

LABEL LOCATION:

UTILITY SERVICE ENTRANCE/METER, INVERTER/DC DISCONNECT IF REQUIRED BY LOCAL AHJ, OR OTHER LOCATIONS AS REQUIRED BY LOCAL AHJ. PER CODE(S): NEC : 690.56(c)(2)



POWER SOURCE OUTPUT CONNECTION

DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION: ADJACENT TO PV BREAKER AND ESS OCPD (IF APPLICABLE). PER CODE(S): NEC : 705.12(B)(3)(2).

PHOTOVOLTAIC SYSTEM COMBINER PANEL DO NOT ADD LOADS

LABEL LOCATION: PHOTOVOLTAIC AC COMBINER (IF APPLICABLE).

PHOTOVOLTAIC AC DISCONNECT MAXIMUM AC OPERATING CURRENT: 40.60 AMPS


NOMINAL OPERATING AC VOLTAGE: 240.0 VAC

LABEL LOCATION:

AC DISCONNECT(S), PHOTOVOLTAIC SYSTEM POINT OF INTERCONNECTION. PER CODE(S): NEC : 690.54


SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY.



LABEL LOCATION:

ON OR NO MORE THAT 1 M (3 FT) FROM THE SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED. PER CODE(S): NEC : 690.56(C), NEC : 690.56(C)(1)(a) CAUTIO POWER TO THIS BUILDIN ALSO SUPPLIED FROM T FOLLOWING SOURCES W DISCONNECTS AS SHO

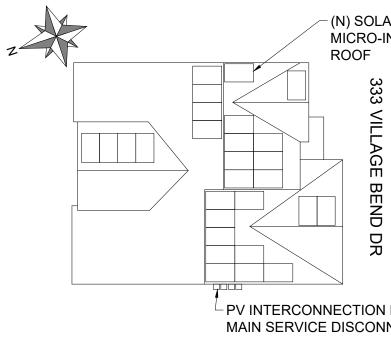

AC DISCONNECT & COM

PERMANENT SIGNAGE NOTES:

- 1. NOT ALL PLACARDS SHOWN MAY BE REQUIRED BY LOCAL AHJ. CONTR REQUIREMENTS WITH LOCAL AHJ BEFORE INSTALLATION.
- ALL PLAQUES AND SIGNAGE REQUIRED BY THE LATEST EDITION OF TH ALTERNATE POWER SOURCE PLACARD SHALL BE METALLIC OR PLAST PRINTED LETTERS IN A CONTRASTING COLOR TO THE PLAQUE. THIS P RIVETS OR SCREWS OR OTHER APPROVED METHOD.
- DIRECTORY PLACARD MARKING CONTENT AND FORMAT: RED BACKGR MINIMUM 3/8" LETTER HIEGHT, ALL CAPITAL LETTERS, ARIAL OR SIMILA WEATHER RESISTANT MATERIAL SUITABLE FOR THE ENVIRONMENT.


SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.

/!\ WARNING

THIS EQUIPMENT FED BY MULTIPLE

LABEL LOCATION: MAIN SERVICE PANEL (IF APPLICABLE). PER CODE(S): NEC : 705.12(B)(3)(3)

NG IS THE VITH WN	BYLD BETTER
R PANELS AND	CONTRACTOR
	BYLD
	ADDRESS:1213W MOOREHEAD ST, STE500 CHARLOTTE, NC 28208 LICENSE #:
	DESIGNER: OMS
POINT. LOCATION OF NECT, UTILITY METER, //BINER BOX.	MELISSA SCHMIDT RESIDENCE
	333 VILLAGE BEND DR, FUQUAY-VARINA NC 27526
	DATE:8/4/2023
RACTOR TO VERIFY PLACARD	DESIGN BY
HE NATIONAL ELECTRICAL CODE TIC, ENGRAVED OR MACHINE PLAQUE WILL BE ATTCHED BY POP ROUND, WHITE LETTERING,	Complete Solar
AR FONT, NON BOLD, REFLECTIVE	SHEET E-2
	WARNING LABELS

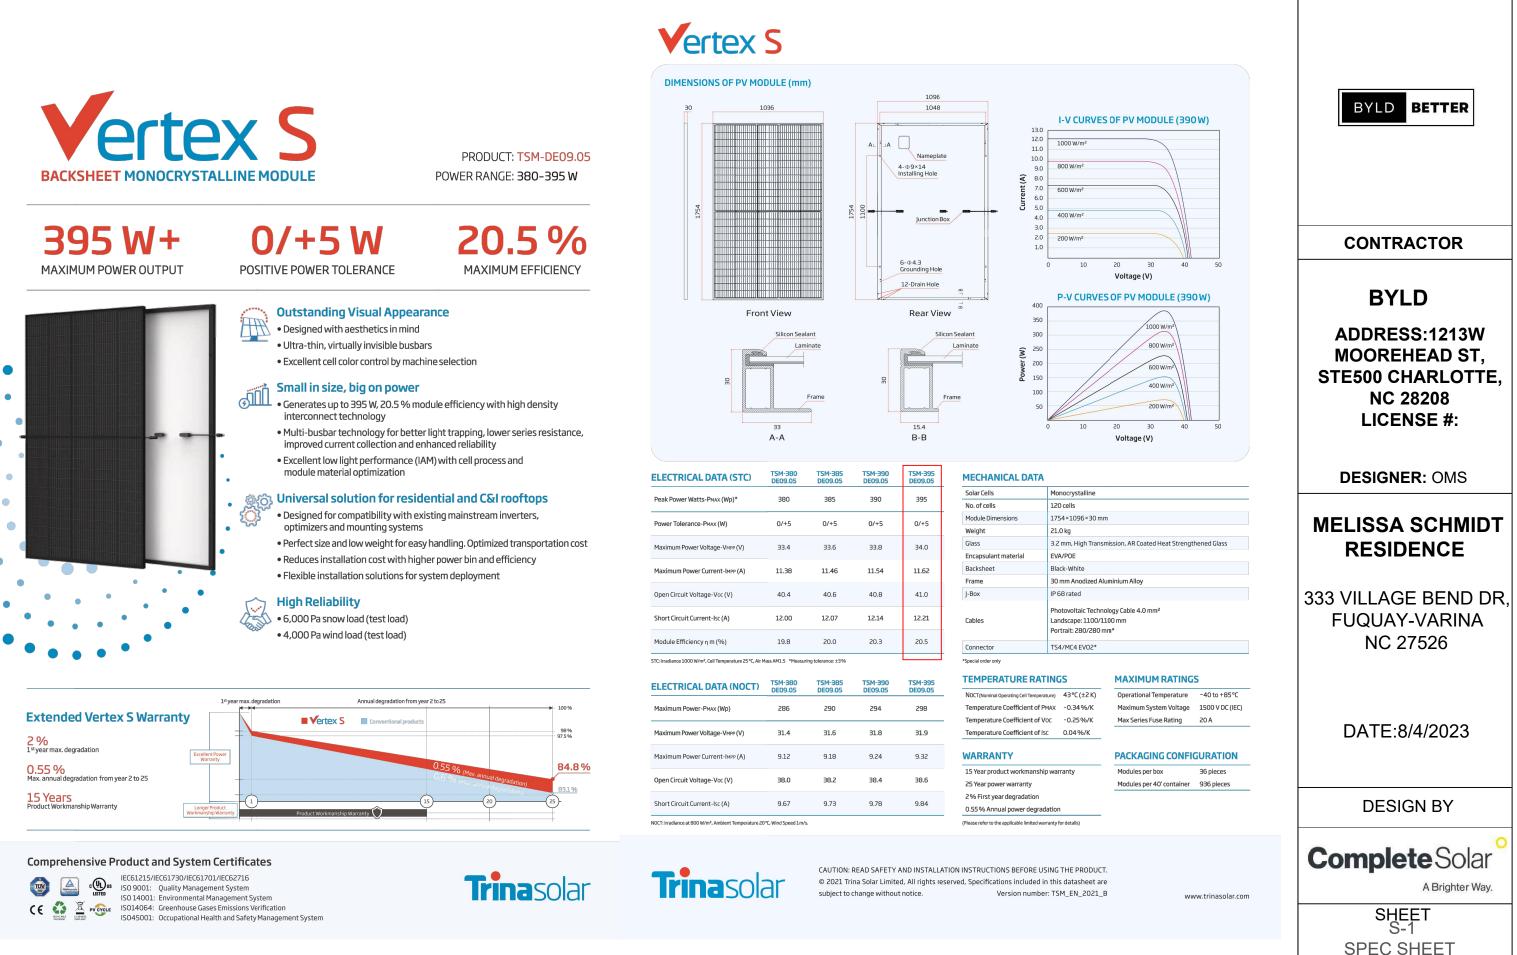







IQ8 Series Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, softwaredefined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application-specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the Enphase IQ Battery, Enphase IQ Gateway, and the Enphase App monitoring hours of power-on testing, enabling an industryand analysis software.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative leading limited warranty of up to 25 years.



IQ8 Series Microinverters are UL Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer's instructions.

© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ8 Microinverters, and other names are trademarks of Enphase Energy, Inc. Data subject to change.

IQ8SE-DS-0001-01-EN-US-2022-03-17

Easy to install

 Lightweight and compact with plug-n-play connectors

DATA SHEET

- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

High productivity and reliability

- Produce power even when the grid is down*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- · Optimized for the latest highpowered PV modules

Microgrid-forming

- · Complies with the latest advanced grid support**
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements

* Only when installed with IQ System Controller 2, meets UL 1741. IQ8H-208V operates only in grid-tied mode. ** IQ8 Series Microinverters supports split phase, 240V. IQ8H-208 supports split phase, 208V only.

100 Series Miereinvertere

IPUT DATA (DC)		IQ8-60-2-US	IQ8PLUS-72-2-US	108M-72-2-US	108A-72-2-US	IQ8H-240-72-2-US	IQ8H-208-72-2-US
commonly used module pairings ²	w	235 - 350	235 - 440	260 - 460	295 - 500	320 - 540+	295 - 500+
lodule compatibility		60-cell/120 half-cell		60-cell/120 half-cell, 6	6-cell/132 half-cell a	nd 72-cell/144 half-ce	I
PPT voltage range	v	27 - 37	29 - 45	33 - 45	36 - 45	38 - 45	38 - 45
perating range	v	25 - 48			25 - 58		
lin/max start voltage	v	30 / 48			30/58		
lax input DC voltage	v	50			60		
ax DC current ³ [module lsc]	А			15	5		
vervoltage class DC port				1			
C port backfeed current	mA			C	i i i i i i i i i i i i i i i i i i i		
V array configuration		1x1 Ungrounded a	array; No additional [OC side protection requi	red; AC side prctecti	on requires max 20A p	er branch circuit
UTPUT CATA (AC)		IQ8-60-2-US	IQ8PLUS-72-2-US	108M-72-2-US	IQ8A-72-2-US	IQ8H-240-72-2-US	IQ8H-208-72-2-US
eak output power	VA	245	300	330	366	384	366
lax continuous output power	VA	240	290	325	349	380	360
ominal (L-L) voltage/range ⁴	v			240 / 211 - 264			208 / 183 - 250
ax continuous output current	А	1.0	1.21	1.35	1.45	1.58	1.73
ominal frequency	Hz			6	D		
xtended frequency range	Hz			50 -	- 68		
C short circuit fault current over cycles	Arms			2			4.4
ax units per 20 A (L-L) branch circuit⁵		16	13	11	11	10	9
otal harmonic distortion				<5	%		
vervoltage class AC port				11	E		
C port backfeed current	mA			30	D		
ower factor setting				1.0	c		
rid-tied power factor (adjustable)				0.85 leading -	0.85 lagging		
eak efficiency	%	97.5	97.6	97.6	97.6	97.6	97.4
EC weighted efficiency	%	97	97	97	97.5	97	97
light-time power consumption	mW			6	D		
ECHANICAL DATA							
mbient temperature range				-40°C to +60°C (-40°F to +140°F)		
elative humidity range				4% to 100% (condensing)		
C Connector type				МС	24		
imensions (HxWxD)				212 mm (8.3") x 175 mm	(6.9") x 30.2 mm (1.2	")	
/eight				1.08 kg (2	2.38 lbs)		
Cooling				Natural convec	ction – no fans		
pproved for wet locations				Ye	s		
ollution degree				PD	03		
nclosure			Class II de	ouble-insulated, corrosi	on resistant polymeri	c enclosure	
nviron. category / UV exposure rating				NEMA Type	6 / outdoor		
DMPLIANCE							
		CA Rule 21 (UL 1741-5	SA), UL 62109-1, UL17	41/IEEE1547, FCC Part 1	15 Class B, ICES-000	3 Class B, CAN/CSA-0	C22.2 NO. 107.1-01
Certifications This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.							
The IQ8H-208 variant will be operating compatibility calculator at https://link current is 10.6A (4) Nominal voltage ra its may vary. Refer to local requiremen	.enpł nge c	ase.com/module-con an be extended beyor	npatibility (3) Maximu Id nominal if required	um continuous input I by the utility. (5)		1Q8SE-DS-0001-0	01-EN-US-2022-03



CONTRACTOR

BYLD

ADDRESS:1213W **MOOREHEAD ST.** STE500 CHARLOTTE, NC 28208 LICENSE #:

DESIGNER: OMS

MELISSA SCHMIDT RESIDENCE

333 VILLAGE BEND DR. FUQUAY-VARINA NC 27526

DATE:8/4/2023

DESIGN BY

CompleteSolar

A Brighter Way.

SHEET S-2 SPEC SHEET Data Sheet Enphase Networking

Enphase IQ Combiner 4/4C X-IQ-AM1-240-4

X-IQ-AM1-240-4C



The **Enphase IQ Combiner 4/4C** with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring
- monitoring

Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed



Enphase IQ Combiner 4/4C

-	
MODEL NUMBER	
IQ Combiner 4 (X-IQ-AM1-240-4)	IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes a silver solar shiel IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C)	IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revent (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes Enphase M (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for syst (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where t the installation area.) Includes a silver solar shield to match the IQ Battery and IQ Sy
ACCESSORIES AND REPLACEMENT PARTS	(not included, order separately)
Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	 Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint dat Ensemble sites 4G based LTE-M1 cellular modem with 5-year Sprint data plan 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-52A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EP
XA-ENV-PCBA-3	Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C
X-IQ-NA-HD-125A	Hold down kit for Eaton circuit breaker with screws.
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating	65 A
Max. continuous current rating (input from PV/storage)	64 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not
Max. total branch circuit breaker rating (input)	80A of distributed generation / 95A with IQ Gateway breaker included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway
Consumption monitoring CT (CT-200-SPLIT)	A pair of 200 A split core current transformers
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with more
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors 60 A breaker branch input: 4 to 1/0 AWG copper conductors Main lug combined output: 10 to 2/0 AWG copper conductors Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellul Mobile Connect cellular modem is required for all Ensemble installations.
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
COMPLIANCE	
Compliance, IQ Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit enphase.com

© 2021 Enphase Energy, All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 10-21-2021 e grade PV production metering (ANSI eld to match the IQ Battery system and

nue grade PV production metering Mobile Connect cellular modem stems up to 60 microinverters. e there is adequate cellular service in System Controller and to deflect heat.

ata plan for

uit breakers.

PLC-01)

ot included)

ounting brackets.

ular modem). Note that an Enphase





CONTRACTOR

BYLD

ADDRESS:1213W MOOREHEAD ST, STE500 CHARLOTTE, NC 28208 LICENSE #:

DESIGNER: OMS

MELISSA SCHMIDT RESIDENCE

333 VILLAGE BEND DR, FUQUAY-VARINA NC 27526

DATE:8/4/2023

DESIGN BY

CompleteSolar

A Brighter Way.

SHEET S-3 SPEC SHEET





XR Rail Family

XR Rail Family


XR10

The XR Rail Family offers the strength of a curved rail in three targeted sizes. Each size design loads, while minimizing material costs. Depending on your location, there is an

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.



Force-Stabilizing Curve

Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

Compatible with Flat & Pitched Roofs





Corrosion-Resistant Materials

All XR Rails are made of marine-grade aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.



XR10 is a sleek, low-profile mounting

rail, designed for regions with light or

remaining light and economical.

6' spanning capability

Clear anodized finish

Rail Selection

Moderate load capability

· Internal splices available

no snow. It achieves 6 foot spans, while





XR100

XR100 is the ultimate residential mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 8 feet.


- · 8' spanning capability
 - Heavy load capability Clear & black anodized finish
 - Internal splices available

 Extreme Clear ar Internal

The following table was prepared in compliance with applicable engineering codes and based on the following criteria: ASCE 7-10, Roof Zone 1, Exposure B, Roof Slope of 7 Building Height of 30 ft. Visit IronRidge.com for detailed span tables and certifications.

	Lo	ad			Rail	Span	
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	
		100					
Non		120					
NOT	le	140	XR10		XR100		XI
		160					
		100					
10.0	10-20	120					
10-2		140					
		160					
30		100					
- 30		160					
40		100					
40		160					
50-7	70	160					
80-9	90	160					

	size supports an XR Rail to			BYLD BETTER
-				CONTRACTOR
solar m extreme more fo • 12' s • Extre • Clear • Intern	00 0 is a heavyweight i ounting rails. It's bu e climates and spar or commercial applie panning capability eme load capability r anodized finish nal splices available and standards	uilt to handle ns 12 feet or cations.		BYLD ADDRESS:1213W MOOREHEAD ST, STE500 CHARLOTTE, NC 28208 LICENSE #:
	of 7 to 27 degre	ees and Mean		DESIGNER: OMS
	10'	12'		MELISSA SCHMIDT RESIDENCE
	XR1000		:	333 VILLAGE BEND DR, FUQUAY-VARINA NC 27526
				DATE:8/4/2023
				DESIGN BY
ersion 1.	11			Complete Solar A Brighter Way.
				SHEET S-4 SPEC SHEET

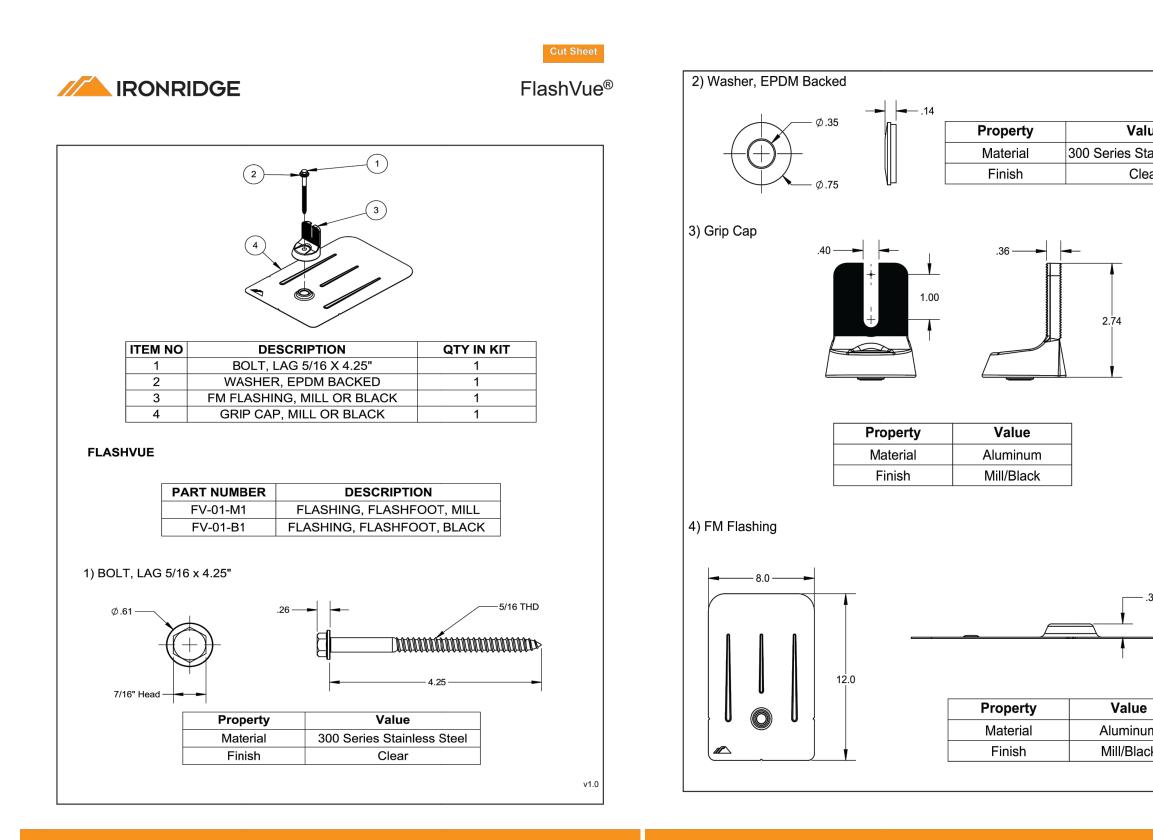

Cut Sheet Iue tainless Steel ear	BYLD BETTER
	CONTRACTOR
	BYLD
	ADDRESS:1213W MOOREHEAD ST, STE500 CHARLOTTE, NC 28208 LICENSE #:
	DESIGNER: OMS
	MELISSA SCHMIDT RESIDENCE
.32	333 VILLAGE BEND DR, FUQUAY-VARINA NC 27526
e um ck	DATE:8/4/2023
v1.01	DESIGN BY
	Complete Solar A Brighter Way.
	SHEET S-5 SPEC SHEET