

10/17/2023



Palmetto Solar

997 Morrison Dr, Ste 200, Charleston, SC, 29403

Subject: Structural Certification for Installation of Residential Solar

Job: Eduardo Carranza

Project Address: 94 Mary Robertson Street, Dunn, NC, 28334

Attn.: To Whom It May Concern

Observation of the condition of the existing framing system was performed by an audit team of Palmetto Solar.

After review of the field observation data, structural capacity calculations were performed in accordance with applicable building codes to determine adequacy of the existing roof framing supporting the proposed panel layout. Please see full Structural Calculations report for details regarding calculations performed and limits of scope of work and liability. The design criteria and structural adequacy are summarized below:

Design Criteria


Code: 2018 NCSBC, IBC 2018, ASCE 7-16

Ult Wind Speed: 120.0 mph

Ground Snow: 20.0 psf

Min Snow Roof: 0.0 psf

Current Renewables Engineering Inc.
Professional Engineer
info@currentrenewableseng.com

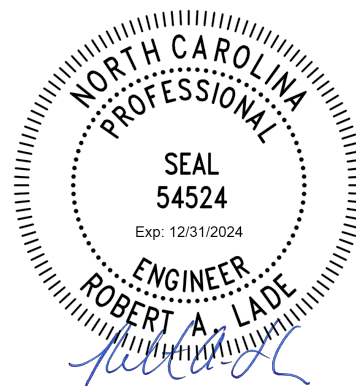

Signed on: 10/17/2023

Summaries:

Check 1: Shingle roofing supported by 2x4 Rafter @ 24 in. OC spacing. The roof is sloped at approximately 18 degrees and has a max beam span of 10.0 ft between supports. Roof is adequate to support the imposed loads. Therefore, no structural upgrades are required.