

76 North Meadowbrook Drive Alpine, UT 84004 office (201) 874-3483 swyssling@wysslingconsulting.com

December 19, 2023

BYLD Better 1213 W Moorehead Street Suite 500 Charlotte. NC 28208

> Re: Engineering Services Hess Residence 11 Braxton Court, Erwin NC 7.600 kW System

To Whom It May Concern:

We have received information regarding solar panel installation on the roof of the above referenced structure. Our evaluation of the structure is to verify the existing capacity of the roof system and its ability to support the additional loads imposed by the proposed solar system.

#### A. Site Assessment Information

- Site visit documentation identifying attic information including size and spacing of framing for the existing roof structure.
- Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information will be utilized for approval and construction of the proposed system.

## B. Description of Structure:

Roof Framing: Prefabricated wood trusses with all truss members constructed of 2x4

dimensional lumber at 24" on center.

Roof Material: Composite Asphalt Shingles

Roof Slope: 30 & 34 degrees
Attic Access: Accessible
Foundation: Permanent

## C. Loading Criteria Used

Dead Load

- Existing Roofing and framing = 7 psf
- New Solar Panels and Racking = 3 psf
- TOTAL = 10 PSF
- Live Load = 20 psf (reducible) 0 psf at locations of solar panels
- Ground Snow Load = 15 psf
- Wind Load based on ASCE 7-10
  - Ultimate Wind Speed = 119 mph (based on Risk Category II)
  - Exposure Category C

Analysis performed of the existing roof structure utilizing the above loading criteria is in accordance with the 2018 North Carolina Residential Code (2015 IRC), including provisions allowing existing structures to not require strengthening if the new loads do not exceed existing design loads by 105% for gravity elements and 110% for seismic elements. This analysis indicates that the existing framing will support the additional panel loading without damage, if installed correctly.

## D. Solar Panel Anchorage

- 1. The solar panels shall be mounted in accordance with the most recent Ironridge installation manual. If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
- 2. The maximum allowable withdrawal force for a 5/16" lag screw is 229 lbs per inch of penetration as identified in the National Design Standards (NDS) of timber construction specifications. Based on a minimum penetration depth of 2½", the allowable capacity per connection is greater than the design withdrawal force (demand). Considering the variable factors for the existing roof framing and installation tolerances, the connection using one 5/16" diameter lag screw with a minimum of 2½" embedment will be adequate and will include a sufficient factor of safety.
- 3. Considering the wind speed, roof slopes, size and spacing of framing members, and condition of the roof, the panel supports shall be placed no greater than 48" on center.

Based on the above evaluation, this office certifies that with the racking and mounting specified, the existing roof system will adequately support the additional loading imposed by the solar system. This evaluation is in conformance with the 2018 North Carolina Residential Code, current industry standards, and is based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Scott E. Wyssling, PE North Carolina License 12. 46546

North Carolina COA P-2308



Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308


Signed 12/19/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



## **NEW PV ROOFTOP SYSTEM DESIGN**

14 MODULES - 5.390 KW DC & 7.600 KW AC SYSTEM SIZE BRENNAN HESS RESIDENCE - 11 BRAXTON COURT, ERWIN, NORTH CAROLINA 28339

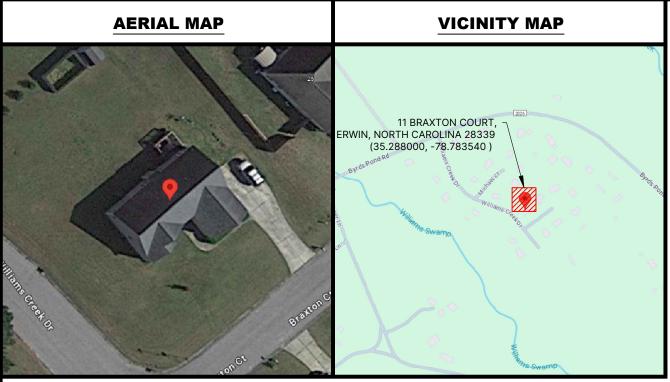

## **SHEET INDEX**

PV-1	COVER SHEET
PV-2	SITE PLAN
PV-3	MOUNTING PLAN
S-1	STRUCTURAL DETAILS
E-1	ELECTRICAL DIAGRAM
E-2	<b>EQUIPMENT INFORMATION</b>
E-3	PV LABELS
PV-4	SITE PHOTOS
SPECS 1-5	MANUFACTURER'S SPECS

## **SCOPE OF WORK**

INSTALL 5.390 KW DC ROOF MOUNTED PV SYSTEM UTILIZING (14) MISSION SOLAR MSE385SX5R [BLK] (1) TESLA INVERTER 7.6KW (14) TESLA OPTIMIZERS (1) TESLA BACKUP GATEWAY IRONRIDGE XR10 RACKING WITH IRONRIDGE - FLASHVUE MOUNTS EXISTING 200 A BUSBAR WITH 200 A MAIN BREAKER TRENCHING: NO

INTERCONNECTION METHOD: LOAD SIDE BREAKER **60A UTILITY AC DISCONNECT** 

## CONTRACTOR

BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500 CHARLOTTE, NC 28208

## **CODE REFERENCE**

HARNETT COUNTY

2017 NATIONAL ELECTRIC CODE (NEC) 2015 INTERNATIONAL BUILDING CODE 2015 INTERNATIONAL RESIDENTIAL CODE

## **DESIGN CRITERIA**

ASCE 7-10 WIND SPEED: 119 MPH EXPOSURE CATEGORY C **GROUND SNOW LOAD: 15 PSF** 

76 N Meadowbrook Drive Alpi

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PEUSING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED

ON ANY ELECTRONIC COPIES

## ENGINEERED PLANS PREPARED BY ENGINEERS IN THE USA



#### **76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004**

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



**BYLD BETTER** 1213 W MOOREHEAD STREET SUITE CHARLOTTE, NC 28208

> HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS				
NO	DATE:	COMMENTS		
1				
2				

## COVER SHEET




Wyssling Consulting, PLLC Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308 Signed 12/19/2023

> **SCOTT E. WYSSLING, P.E.** NORTH CAROLINA LICENSE NO. 46546

DATE:	12/15/2023
DRAWN BY:	JYP
REVIEWED BY:	HEV

**PV-1** 

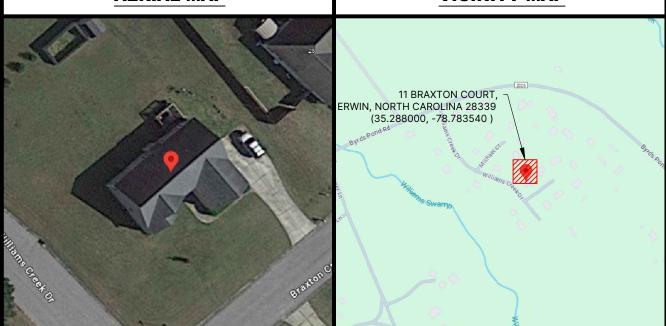

## **GENERAL NOTES**

- CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND REVIEW ALL MANUFACTURER INSTALLATION DOCUMENTS PRIOR TO INITIATING CONSTRUCTION.
- ALL COMPONENTS SHALL BE NEW AND LISTED BY A RECOGNIZED ELECTRICAL TESTING LABORATORY AND LISTED FOR THEIR SPECIFIC APPLICATION.
- OUTDOOR EQUIPMENT SHALL BE NEMA 3R RATED OR BETTER.
- ACCESS TO ELECTRICAL COMPONENTS OVER 150 VOLTS TO GROUND SHALL BE RESTRICTED TO QUALIFIED PERSONNEL
- CONTRACTOR SHALL OBTAIN ELECTRICAL PERMITS PRIOR TO INSTALLATION AND SHALL COORDINATE ALL INSPECTIONS, TESTING COMMISSIONING, AND ACCEPTANCE WITH THE CLIENT, UTILITY CO. AND CITY INSPECTORS AS NEEDED.
- EACH MODULE TO BE GROUNDED USING THE SUPPLIED CONNECTION POINT PER THE MANUFACTURER'S REQUIREMENTS. ALL PV MODULES, EQUIPMENT, AND METALLIC COMPONENTS ARE TO BE BONDED. IF THE EXISTING GROUNDING ELECTRODE SYSTEM CANNOT BE VERIFIED OR IS ONLY METALLIC WATER PIPING, IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSTALL A SUPPLEMENTAL GROUNDING ELECTRODE.
- DC CONDUCTORS SHALL BE RUN IN EMT AND/OR MC (METAL CLAD CABLE) AND SHALL BE LABELED. ALL DC CONDUCTORS RUN INSIDE OF THE STRUCTURE SHALL BE INSTALLED A MINIMUM OF 18" BELOW THE ROOF DECK.
- EXPOSED NON-CURRENT CARRYING METAL PARTS OF ELECTRICAL EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH APPLICABLE NEC.
- CONFIRM LINE SIDE VOLTAGE AT THE ELECTRIC UTILITY SERVICE PRIOR TO CONNECTING INVERTER. VERIFY SERVICE VOLTAGE IS WITHIN INVERTER VOLTAGE OPERATIONAL
- ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT EXPANSION JOINTS AND ANCHOR CONDUIT RUNS AS REQUIRED PER CODE.
- ALL WIRING MUST BE PROPERLY SUPPORTED BY DEVICES OR MECHANICAL MEANS DESIGNED AND LISTED FOR SUCH USE, AND FOR ROOF-MOUNTED SYSTEMS, WIRING MUST BE PERMANENTLY AND COMPLETELY HELD OFF OF THE ROOF SURFACE.
- ALL ROOF PENETRATIONS MUST BE SEALED OR FLASHED.
- EQUIPMENT MAY BE SUBSTITUTED FOR SIMILAR EQUIPMENT BASED ON AVAILABILITY. SUBSTITUTED EQUIPMENT SHALL COMPLY WITH DESIGN CRITERIA.
- REMOVAL OF AN INTERACTIVE INVERTER OR OTHER EQUIPMENT SHALL NOT DISCONNECT THE BONDING CONNECTION BETWEEN THE GROUNDING ELECTRODE CONDUCTOR AND THE PHOTOVOLTAIC SOURCE AND/OR OUTPUT CIRCUIT GROUNDED CONDUCTORS.
- WHENEVER A DISCREPANCY IN THE QUALITY OF EQUIPMENT ARISES ON THE DRAWING OR SPECIFICATIONS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING AND INSTALLING ALL MATERIAL AND SERVICES REQUIRED BY THE STRICTEST CONDITIONS NOTED ON THE DRAWINGS OR IN THE SPECIFICATIONS TO ENSURE COMPLETE COMPLIANCE AND LONGEVITY OF THE OPERABLE SYSTEM REQUIRED BY THE ENGINEERS.

SITE PLAN LEGE	END
UTILITY METER	(M)
MAIN SERVICE PANEL	MSP
GAS METER	GM
AC DISCONNECT	AC
DC DISCONNECT	DC
AC COMBINER PANEL	СОМ
INVERTER	INV
BACKUP INTERFACE	BI
BATTERY	В
PRODUCTION METER	(M)
SUBPANEL	SUB
JUNCTION BOX	JB
FIRE PATHWAY	^
SATELLITE DISH	<b>&amp;</b>
PROPERTY LINE	
ATTIC RUN CONDUIT	
EXTERNAL CONDUIT	
CHIMNEY	
ROOF OBSTRUCTION (TYP.)	0
ROOF VENT (TYP.)	

**UTILITY: DUKE ENERGY PROGRESS** 

INVERTER	
MANUFACTURER/ MODEL	TESLA INVERTER 7.6KW
MAX AC OUTPUT	32 A
AC OUTPUT VOLTAGE	240 V
MAX DC INPUT VOLTAGE	600 V
MAX INPUT CURRENT	11 A
WEIGHTED CEC EFFICIENCY	98.00%
INVERTER WATTAGE	7600 W



## **76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004**

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500

CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS				
NO	DATE:	COMMENTS		
1				
2				

# SITE PLAN MILL E. WYSS

Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308 Signed 12/19/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED

ON ANY ELECTRONIC COPIES

SCALE: 3/32" = 1'-0"

**SCOTT E. WYSSLING, P.E.** NORTH CAROLINA LICENSE NO.

46546		
DATE:	12/15/2023	
DRAWN BY:	JYP	
REVIEWED BY:	HEV	

**PV-2** 

ROOF OBSTRUCTION (TYP.) (N) PV MODULE EQUIPPED W/ 1 ROOF SECTION 1 TESLA (RSD) 1 POWER OPTIMIZER PER MODULE TILT: 34° AZIMUTH: 141° (N) INVERTER (N) AC DISCONNECT (E) UTILITY METER (E) MAIN SERVICE PANEL ROOF ACCESS POINT **ROOF SECTION 2** TILT: 30° AZIMUTH: 219° ROOF ACCESS POINT

FRONT OF HOME

**BRAXTON COURT** 

## **MODULE SPEC AND ROOF INFO:**

PV MODULE TYPE - MISSION SOLAR MSE385SX5R [BLK] (385W) WEIGHT OF INDIVIDUAL PANEL - 49.00 LBS INDIVIDUAL SOLAR PANEL AREA - 21.43 SQ FT ROOF AREA - 2174.4614 SQ FT

ROOF COVERAGE - 13.8%

## **EQUIPMENT LIST:**

(14) MISSION SOLAR MSE385SX5R [BLK] (1) TESLA INVERTER 7.6KW (14) TESLA OPTIMIZERS (1) TESLA BACKUP GATEWAY IRONRIDGE XR10 RACKING WITH IRONRIDGE - FLASHVUE MOUNTS

## **SITE PLAN NOTES:**

- VERIFY ALL OBSTRUCTIONS AND DIMENSIONS IN THE FIELD.
- PROVIDE RAIL SPLICES AS REQUIRED BY MANUFACTURER'S GUIDELINES.
- NO SIGNIFICANT SHADING WILL RESULT FROM EXISTING ROOF OBSTRUCTIONS.
- PV MODULES CANNOT BE INSTALLED OVER OR BLOCK ATTIC, PLUMBING, FURNACE OR WATER HEATER VENTS
- AC DISCONNECT SHALL BE VISIBLE-OPEN TYPE, LOCAKABLE AND READILY ACCESSIBLE. TO BE WITHIN 10' OF THE UTILITY METER

ENGINEERED PLANS PREPARED BY ENGINEERS IN THE USA

## **MOUNTING PLAN** LEGEND

UTILITY METER	(M)
MAIN SERVICE PANEL	MSP
GAS METER	GM
AC DISCONNECT	AC
DC DISCONNECT	DC
AC COMBINER PANEL	СОМ
INVERTER	INV
BACKUP INTERFACE	BI
BATTERY	В
PRODUCTION METER	(PM)
SUBPANEL	SUB
JUNCTION BOX	JB
FIRE PATHWAY	\ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \
SATELLITE DISH	\$
PROPERTY LINE	
ATTIC RUN CONDUIT	
EXTERNAL CONDUIT	
RAIL	
MOUNT	
ROOF FRAMING	
CHIMNEY	
ROOF OBSTRUCTION (TYP.)	0
ROOF VENT (TYP.)	

ROOF OBSTRUCTION (TYP.) 2X4 TRUSSES (TYP.) (N) PV MODULE EQUIPPED W/ 1 ROOF SECTION 1 TESLA (RSD) 1 POWER OPTIMIZER PER MODULE TILT: 34° AZIMUTH: 141°

48" MAX MOUNT SPACING

— ROOF FRAMING 24" ON CENTER

## **MOUNTING PLAN NOTES:**

- VERIFY ALL OBSTRUCTIONS AND DIMENSIONS IN THE FIELD.
- PROVIDE RAIL SPLICES AS REQUIRED BY MANUFACTURER'S GUIDELINES. NO SIGNIFICANT SHADING WILL RESULT FROM EXISTING ROOF OBSTRUCTIONS.
- PV MODULES CANNOT BE INSTALLED OVER OR BLOCK ATTIC, PLUMBING,
- FURNACE OR WATER HEATER VENTS

## **MOUNT QUANTITY:**

1. (32) IRONRIDGE - FLASHVUE ATTACHMENTS DISTRIBUTED LOAD - (ARRAY) WEIGHT/AREA = 2.29 lbs/ft<sup>2</sup> TOTAL WEIGHT OF SYSTEM - 686 lbs

FRONT OF HOME

ROOF SECTION 2 TILT: 30°

AZIMUTH: 219°



SCALE: 3/32" = 1'-0"

ENGINEERED PLANS PREPARED BY ENGINEERS IN THE USA

RAIL (TYP.)

- MOUNT (TYP.)

DESIGN ENGINEER



## **76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004**

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500

CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS				
NO	DATE:	COMMENTS		
1				
2				

## MONTING PLAN

Wyssling Consulting, PLLC 76 N Meadowbrook Drive Alpine UT 84004 North Carolina COA # P-2308 Signed 12/19/2023

E. WYS


THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PEUSING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

**SCOTT E. WYSSLING, P.E.** NORTH CAROLINA LICENSE NO. 46546

12/15/2023 DATE: DRAWN BY: JYP REVIEWED BY:

PV-3

	TILT	AZIMUTH	# OF MODULES	ROOF FRAMING	FRAMING SPACING	ROOF TYPE	MAX MOUNT SPACING	MOUNT TYPE
ROOF SECTION 1	34°	141°	5	2X4 - TRUSSES	24"	COMP SHINGLE	48"	IRONRIDGE - FLASHVUE
ROOF SECTION 2	30°	219°	9	2X4 - TRUSSES	24"	COMP SHINGLE	48"	IRONRIDGE - FLASHVUE

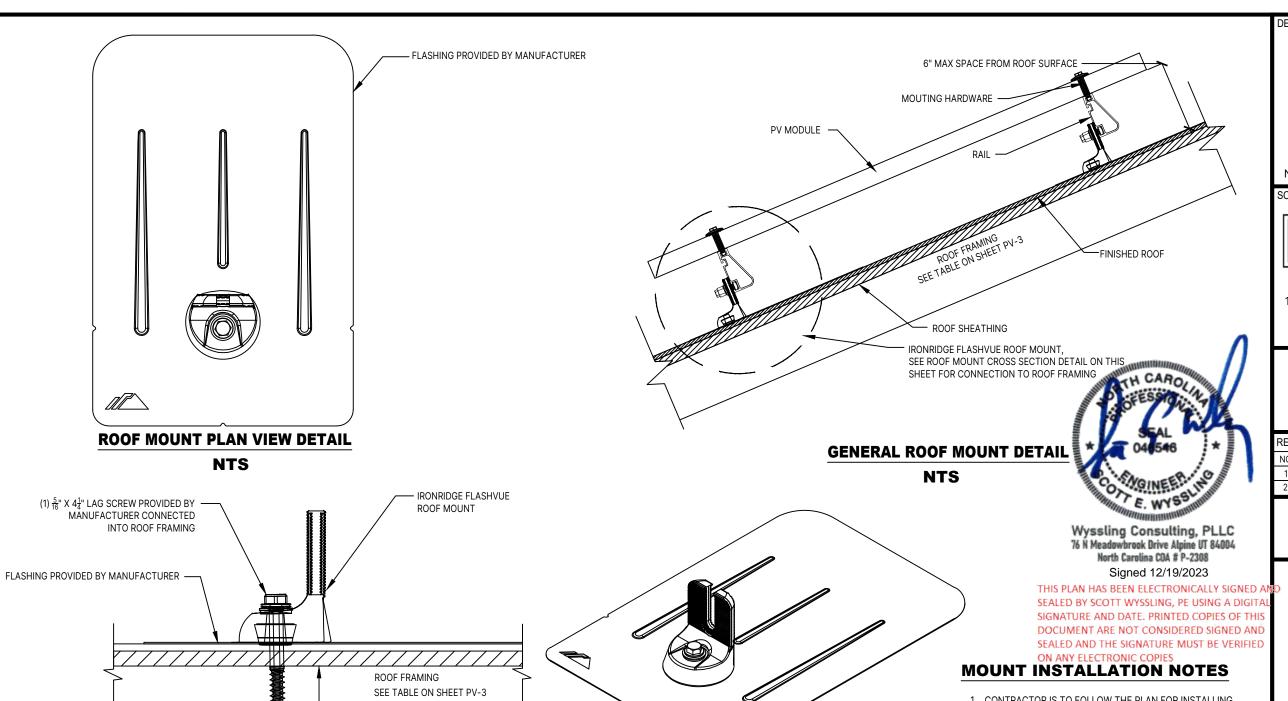

**ROOF MOUNT** 

NTS

- CONTRACTOR IS TO FOLLOW THE PLAN FOR INSTALLING ROOF MOUNTS.
- IF THE CONTRACTOR IDENTIFIES THE ROOF FRAMING IS DIFFERENT FROM WHAT IS IDENTIFIED ON THIS PLAN, CONTRACTOR SHALL NOTIFY THE ENGINEER BEFORE PROCEEDING WITH INSTALLATION.
- 3. CONTRACTOR IS TO LOCATE THE ROOF FRAMING BY UTILIZING A HAMMER.
- 4. WHEN THE ROOF FRAMING IS LOCATED, CONTRACTOR IS TO DRILL A PILOT HOLE TO CONFIRM CENTER OF ROOF FRAMING. IF THE ROOF FRAMING IS MISSED, AND A NEW PILOT HOLE IS TO BE DRILLED, CONTRACTOR TO UTILIZE SILICON/CAULK TO SEAL THE ORIGINAL PILOT HOLE.
- 5. DIRECT TO DECK MOUNTS ARE ONLY TO BE USED WITH APPROVED DESIGN BY THE ENGINEER. DIRECT TO DECK MOUNT INSTALLATION IS NOT A SUBSTITUTION FOR LAG SCREWS INTO ROOF FRAMING.
- 6. CONTRACTOR TO FOLLOW MANUFACTURERS SPECIFICATIONS FOR INSTALLATION AND REQUIRED SCREWS.

DESIGN ENGINEER



## 76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER
1213 W MOOREHEAD STREET SUITE
500
CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVI	SIONS	
NO	DATE:	COMMENTS
1		
2		

## STRUCTURAL DETAILS

SCOTT E. WYSSLING, P.E.

NORTH CAROLINA LICENSE NO. 46546

DATE:	12/15/2023
DRAWN BY:	JYP
REVIEWED BY:	HEV

**S-1** 

ROOF MOUNT CROSS SECTION DETAIL

2.5" MIN EMBEDMENT

NTS

ENGINEERED PLANS PREPARED BY ENGINEERS IN THE USA

			CONDUC	TOR SCHEDUL	.E		
		CONDUC	TORS			GROUND	CONDUIT
TAG ID	WIRES IN CONDUIT	WIRE AWG	TYPE, MATERIAL	AMPACITY	SIZE	TYPE, MATERIAL	
1	3	#10 AWG	PV CABLE	30	#6 AWG	BARE, CU	
2	3	#10 AWG	THWN-2, CU	30	#10 AWG	THHW, CU	3/4" CONDUIT
3	4	#8 AWG	THWN-2, CU	50	#10 AWG	THHW, CU	3/4" CONDUIT
4	4	#8 AWG	THWN-2, CU	50	#10 AWG	THHW, CU	3/4" CONDUIT

### FAULT CURRENT MITIGATION - MINIMUM ADDITIONAL CONDUCTOR TO DISCONNECT

200A TO 400A BUS - SYSTEM **AVAILABLE FAULT CURRENT 21,188A** 

WIRE SIZE	MIN. LENGTH	L- L FAULT CURRENT	L- N FAULT CURRENT
10	7'	9379	6653
8	10'	9935	7726
6	15.5'	9955	7247
4	25'	9811	7096
3	29.5'	9974	7268
2	37.5'	9990	7285
1	46.5'	9967	7261
1/0	57'	9958	7251

# DESIGN ENGINEER

## **76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004**

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT

## BETTER

BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500

> HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS						
NO	DATE:	COMMENTS				
1						
2						

## **DIAGRAM**

CHARLOTTE, NC 28208

## **ELECTRICAL**

#### DATE: 12/15/2023 DRAWN BY: JYP HEV

**E-1** 

## **EQUIPMENT LIST:**

(14) MISSION SOLAR MSE385SX5R [BLK]

(1) TESLA INVERTER 7.6KW

(14) TESLA OPTIMIZERS


(1) TESLA BACKUP GATEWAY

IRONRIDGE XR10 RACKING WITH IRONRIDGE - FLASHVUE MOUNTS

TRENCHING: NO

INTERCONNECTION METHOD: LOAD SIDE BREAKER

60A UTILITY AC DISCONNECT

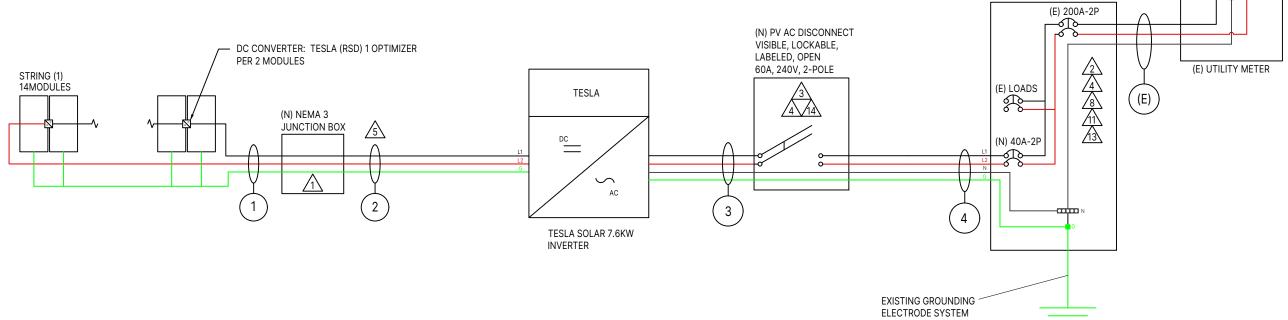

## **GENERAL NOTES**

AC DISCONNECT SHALL BE VISIBLE-OPEN TYPE, LOCKABLE AND READILY ACCESSIBLE. TO BE WITHIN 10' OF THE UTILITY METER

(E) 200A MAIN SERVICE PANEL (E) 200A / 2P MAIN BREAKER

## **SYSTEM SIZE**

AC SYSTEM SIZE: 7.600 kW DC SYSTEM SIZE: 5.390 kW

## **INTERCONNECTION CALCULATIONS**

ITEM	UNIT	PANEL
BUS RATING	AMPS	200A
MAIN OCPD	AMPS	200A
ALLOWED PV PER NEC	AMPS	40A

## **CONDUCTOR CALCULATIONS**

TAG 1 (SEE E-1)	TAG 2 (SEE E-1)	TAG 3 (SEE E-1)	TAG 4 (SEE E-1)
UNDER MODULES, NOT IN CONDUIT	#10 AWG MAX CURRENT = 30A	#8 AWG MAX CURRENT = 50A	#8 AWG MAX CURRENT = 50A
#10 AWG MAX CURRENT = 30A			
		TESLA INVERTER 7.6KW MAX OUTPUT = 32 A	TESLA INVERTER 7.6KW MAX OUTPUT = 32 A
TESLA INVERTER 7.6KW MAX CIRCUIT CURRENT	TESLA INVERTER 7.6KW MAX CIRCUIT CURRENT	32 A * 1.25 A = 40	32 A * 1.25 A = 40
15 A FOR CIRCUIT 2	15 A FOR CIRCUIT 2	RECOMMENDED OCPD = 40	RECOMMENDED OCPD = 40

## **EQUIPMENT INFORMATION**

MODULE	
MANUFACTURER/ MODEL	MISSION SOLAR MSE385SX5R [BLK]
PMAX	385 W
voc	45.03 V
VMP	36.93 V
IMP	10.42 A
ISC	10.97 A
TEMPERATURE COOEFFICIENT OF PMAX	-0.361 %/°C
TEMPERATURE COEFFICIENT OF VOC	-0.262 %/°C

INVERTER	
MANUFACTURER/ MODEL	TESLA INVERTER 7.6KW
MAX AC OUTPUT	32 A
AC OUTPUT VOLTAGE	240 V
MAX DC INPUT VOLTAGE	600 V
MAX INPUT CURRENT	11 A
WEIGHTED CEC EFFICIENCY	98.00%
INVERTER WATTAGE	7600 W



## 76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500 CHARLOTTE, NC 28208

> HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339

5.390 KW DC 7.600 KW AC

REVI	REVISIONS					
NO	DATE:	COMMENTS				
1						
2						

## **EQUIPMENT INFORMATION**

 DATE:
 12/15/2023

 DRAWN BY:
 JYP

 REVIEWED BY:
 HEV

PHOTOVOLTAIC AC DISCONNECT

MAXIMUM AC OPERATING CURRENT: 32
NOMINAL OPERATING AC VOLTAGE: 240

AT POINT OF INTERCONNECTION, MARKED AT DISCONNECTING MEANS [NEC 690.54]

**AWARNING** DUAL POWER SOURCE SECOND SOURCE IS PHTOVOLTAIC SYSTEM

AT POINT OF INTERCONNECTION. [NEC 705.12(C), 690.59]

MAIN PHOTOVOLTAIC SYSTEM DISCONNECT

EACH PV SYSTEM DISCONNECTING MEANS SHALL PLAINLY INDICATE WHETHER IN THE OPEN (OFF) OR CLOSED (ON) POSITION AND BE PERMANENTLY MARKED [NEC. 690.13(B)]

**PHOTOVOLTAIC** 

AT EACH DC DISCONNECTING MEANS [NEC 690.13(B)]

DC DISCONNECT

**PHOTOVOLTAIC** 

AT EACH AC DISCONNECTING MEANS [NEC 690.13(B)]

**AC DISCONNECT** 

WARNING: PHOTOVOLTAIC POWER SOURCE

AT EXPOSED RACEWAYS, CABLE TRAYS, AND OTHER WIRING METHODS; SPACED AT MAXIMUM 10FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS [NEC 690.31(D)(2)]

ELECTRICAL SHOCK HAZARD

DO NO TOUCH TERMINALS

TERMINALS ON BOTH LINE AND LOAD SIDES

MAY BE ENERGIZED IN THE OPEN POSITION

AT BUILDING OR STRUCTURE MAIN DISCONNECTING MEANS. [NEC 690.12(E), NEC 690.13(B)]

## **AWARNING**

THE EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES. SCLUDING MAIN SUPPLY OVERCURRENT DEVICE SHALL NOT EXCEED AMPACITY OF BUSBAR

AWARNING
INVERTER OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUTDOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN ARRAY



RAPID SHUTDOWN
SWITCH FOR SOLAR PV

FOR PV SYSTEMS THAT SHUT DOWN THE ARRAY AND CONDUCTORS LEAVING THE ARRAY: THE TITLE "SOLAR PV SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN" SHALL UTILIZE CAPITALIZED CHARACTERS WITH A MINIMUM HEIGHT OF 3/8 IN. IN BLACK ON YELLOW BACKGROUND, AND THE REMAINING CHARACTERS SHALL BE CAPITALIZED WITH A MINIMUM HEIGHT OF 3/16 IN. IN

BLACK ON WHITE BACKGROUND. [NEC

PERMANENT WARNING LABELS SHALL BE

A PERMANENT WARNING LABEL SHALL BE

APPLIED TO THE DISTRIBUTION

**EQUIPMENT ADJACENT TO THE** 

BACK-FED BREAKER FROM THE

INVERTER.
[NEC 705.12(B)(3)(2)]


690.56(C)(1)(A)]

APPLIED TO DISTRIBUTION EQUIPMENT

A RAPID SHUTDOWN SWITCH SHALL
HAVE A LABEL LOCATED ON OR NO MORE
THAN 3 FT FROM THE SWITCH THAT
INCLUDES THIS WORDING. THE LABEL
SHALL BE REFLECTIVE, WITH ALL
LETTERS CAPITALIZED AND HAVING A
MINIMUM HEIGHT OF 3/8 IN., IN WHITE ON
RED BACKGROUND.[NEC 690.56(C)(2)]

## CAUTION

MULTIPLE SOURCES OF POWER

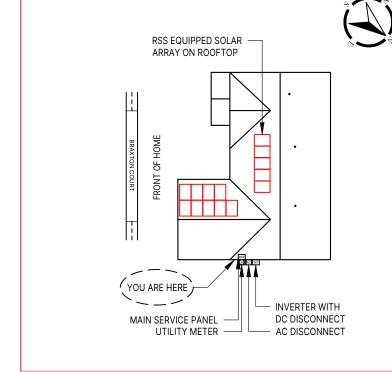

11 BRAXTON COURT, ERWIN, NORTH CAROLINA 28339

LABEL LOCATION: MSP CODE REF: NEC 2017 - 705.10

# DESIGN ENGINEER VISSLING CONSULTING COMMONANTE CAPPTINGE MITH EMALL BURGINESS WALKE

## 76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT

## BYLD BETTER

BYLD BETTER
1213 W MOOREHEAD STREET SUITE
500
CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT

ERWIN, NC 28339 5.390 KW DC 7.600 KW AC SIONS

## REVISIONS NO DATE: COMMENTS 1 2

PV LABELS

## **LABELING NOTES:**

- LABELING REQUIREMENTS BASED ON THE 2020 NATIONAL ELECTRIC CODE, OSHA STANDARD 19010.145, ANSI Z535.
- 2. MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
- 3. LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED [NEC 110.21]
- LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]

 DATE:
 12/15/2023

 DRAWN BY:
 JYP

 REVIEWED BY:
 HEV

**E-3** 





## 76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER
1213 W MOOREHEAD STREET SUITE
500

CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS					
NO	DATE:	COMMENTS			
1					
2					

## SITE PHOTOS

 DATE:
 12/15/2023

 DRAWN BY:
 JYP

 REVIEWED BY:
 HEV



## True American Quality True American Brand

Mission Solar Energy is headquartered in San Antonio, Texas where we manufacture our modules. We produce American, high-quality solar modules ensuring the highest-in-class power output and best-in-class reliability. Our product line is tailored for residential, commercial and utility applications. Every Mission Solar Energy solar module is certified and surpasses industry standard regulations, proving excellent performance over the long term.

Demand the best. Demand Mission Solar Energy.



## Certified Reliability

- Tested to UL 61730 & IEC Standards
- PID resistant
   Resistance to salt mist corrosion

## Advanced Technology

- 6 Busbar Passivated Emitter Rear Contact
   Ideal for all applications

## Extreme Weather Resilience

- Up to 5.400 Pa front load & 3.600 Pa back load
- 40 mm frame



**BAA Compliant for Government Projects** 

Buy American Act
 American Recovery & Reinvestment Act

## CERTIFICATIONS

FRAME-TO-FRAME WARRANTY

Degradation guaranteed not to exceed 2% in year one and 0.58% annually

from years two to 30 with 84.08% capacity guaranteed in year 25.



C-SA2-MKTG-0027 REV 2: 05/05/2021





UL 61730 / IEC 61215 / IEC 61730 / IEC 61701

www.missionsolar.com | info@missionsolar.com

## Class Leading 375-385W

MSE385S

Mission Solar Energy

C-SA2-MKTG-0027 REV 2 05/05/2021

8303 S. New Braunfels Ave., San Antonio, Texas 78235 www.missionsolar.com | info@missionsolar.com

Mission Solar Energy reserves the right to make specification changes without notice.

Incident | Irrd = 600 W/m<sup>2</sup>

Incident Irrd: = 200 W/m<sup>2</sup>

VOLTAGE (V)

CERTIFICATIONS AND TESTS


UL 61730

IEC 61215, 61730, 61701

lerd = 400 : W/m

Cells Temp. =25°C

## MSE PERC 66

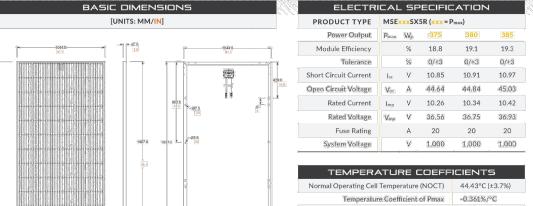

SIDE VIEW	REAR VIEW	naingat asana.co	Chestal C
	NA	OPERATING	S CONDITIONS
RENT-VOLTAGE CL	JRVE	Maximum System Voltage	1,000Vdc
SX5R: 385WP, 66 CELL SOLAR	MODULE	Operating Temperature Range	-40°C (-40°F) to +85°C (185°F)
tics with dependence on irradian	nce and module temperature	Maximum Series Fuse Rating	20A
		Fire Safety Classification	Type 1
incident irrd. = 1000 W/m	<u> </u>	Front & Back Load (UL Standard)	Up to 5,400 Pa front and 3,600 Pa back load, Tested to UL 61730
incident rrd. = 800 W/m		Hail Safety Impact Velocity	25mm at 23 m/s
	12		

ME	ECHANICAL DATA
Solar Cells	P-type mono-crystalline silicon
Cell Orientation	66 cells (6x11)
Module Dimension	1,907mm x 1,044mm x 40mm
Weight	22 kg (49 lbs.)
Front Glass	3.2mm, tempered, low-iron, anti-reflective
Frame	Anodized
Encapsulant	Ethylene vinyl acetate (EVA)
Junction Box	Protection class IP67 with 3 bypass-diodes
Cable	1.0m, Wire 4mm2 (12AWG)
Connector	Staubli PV-KBT4/6II-UR and PV-KST4/6II-UR MC4, Renhe 05-8

Temperature Coefficient of Voc -0.262%/°C

Temperature Coefficient of Isc 0.039%/°C

Container Feet	Ship To	Pallet	Panels	380 W Bin
53'	Most States	30	780	296.40 kW
Double Stack	CA	26	676	256.88 kW
	PALLE	T [26 PAN	ELS]	
Weight 1,274 lbs. (572 kg)	Height 47.56 in (120.80 cm		Width 46 in 16.84 cm)	Length 77 in (195.58 cm)

www.missionsplan.com | info@missionsplan.com

BETTER

**76 N. MEADOWBROOK DRIVE** ALPINE, UTAH 84004 swyssling@wysslingconsulting.com

(201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT

DESIGN ENGINEER

BYLD BETTER 1213 W MOOREHEAD STREET SUITE CHARLOTTE, NC 28208

> HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS			
ı	1 ( L V I	010110	
ı	NO	DATE:	COMMENTS
ı	1		
ı	2		

## **MODULE SPEC SHEET**

DATE: 12/15/2023 DRAWN BY: JYP REVIEWED BY:

**SPECS-1** 







If you have questions or concerns about

For more information, visit www.missio

Class leading power output

-0 to +3%



#### SOLAR INVERTER

#### 3.8 kW | 7.6 kW

Tesla Solar Inverter completes the Tesla home solar system, converting DC power from solar to AC power for home consumption. Tesla's the tesla home solar system is a solar large from the power for home consumption and the following the following power from the following power for home consumption and the following power for home construction and the following power for home construction and the following power for home construction and the following power for home consumption and the following power for home construction and the followrenowned expertise in power electronics has been combined with robust safety features and a simple installation process to produce an outstanding solar inverter that is compatible with both Solar Roof and traditional solar panels. Once installed, homeowners use the Tesla mobile app to manage their solar system and monitor energy consumption, resulting in a truly unique ecosystem experience.

### KEY FEATURES

- Built on Powerwall 2 technology for exceptional efficiency and reliability
- · Wi-Fi, Ethernet, and cellular connectivity with easy over-the-air updates
- Designed to integrate with Tesla Powerwall and Tesla App
- 3.8 kW and 7.6 kW models available

### SOLAR INVERTER

Tesla Solar Inverter provides DC to AC conversion and integrates with the Tesla ecosystem, including Solar Panels, Solar Roof, Powerwall, and vehicle charging, to provide a seamless sustainable energy experience.

#### KEY FEATURES

- Integrated rapid shutdown, arc fault, and ground fault protection
- No neutral wire simplifies installation
- 2x the standard number of MPPTs for high production on complex roofs



### **ELECTRICAL SPECIFICATIONS**

OUTPUT (AC)	3.8 kW	7.6 kW
Nominal Power	3,800 W	7,600 W
Maximum Apparent Power	3,328 VA at 208 V	6,656 VA at 208 V
	3,840 VA at 240 V	7,680 VA at 240 V
Maximum Continuous Current	16 A	32 A
Breaker (Overcurrent Protection)	20 A	40 A
Nominal Power Factor	1 - 0.85 (lead	ing / lagging)
THD (at Nominal Power)	<5%	
INPUT (DC)		
MPPT	2	4
Input Connectors per MPPT	1-2	1-2-1-2
Maximum Input Voltage	600 VDC	
DC Input Voltage Range	60 - 550 VDC	
DC MPPT Voltage Range <sup>1</sup>	60 - 480 VDC	
Maximum Current per MPPT (I <sub>mp</sub> )	11 A	
Maximum Short Circuit Current per MPPT (I)	15 A	

#### PERFORMANCE SPECIFICATIONS


Peak Efficiency <sup>2</sup>	97.5%	98.0%
CEC Efficiency <sup>2</sup>	97.	5%
Allowable DC/AC Ratio	1.	4
Customer Interface	Tesla Mobile App	
Internet Connectivity	Wi-Fi (2.4 GHz, 802 Ethernet, Cellular (	
AC Remote Metering Support	Wi-Fi (2.4 GHz, 802 RS-485	2.11 b/g/n),
Protections	Integrated arc fault (AFCI), Rapid Shut	
Supported Grid Types	60 Hz, 240 V Split F 60 Hz, 208 V Wye	hase
Required Number of Tesla Solar Shutdown Devices per Solar Modul	See Solar Shutdowi e Requirements per l	
Warranty	12.5 years	
<sup>1</sup> Maximum current.		

2 Expected efficiency pending final CEC listing.
3 Cellular connectivity subject to network operator service coverage and signal

### MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 158 mm (26 in x 16 in x 6 in)
Weight	52 lb <sup>4</sup>
Mounting options	Wall mount (bracket)

<sup>4</sup>Door and bracket can be removed for a mounting weight of 37 lb.



### **ENVIRONMENTAL SPECIFICATIONS**

Operating Temperature <sup>5</sup>	-30°C to 45°C (-22°F to 113°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Temperature	-30°C to 70°C (-22°F to 158°F)
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Rating	Type 3R
Ingress Rating	IP55 (Wiring compartment)
Pollution Rating	PD2 for power electronics and terminal wiring compartment, PD3 for all other components
Operating Noise @ 1 m	< 40 db(A) nominal, < 50 db(A) maximum

 $^5$  For the 7.6 kW Solar Inverter, performance may be de-rated to 6.2 kW at 240 V or 5.37 kW at 208 V when operating at temperatures greater than

#### COMPLIANCE INFORMATION

Grid Certifications	UL 1741, UL 1741 SA, IEEE 1547, IEEE 1547.1
Safety Certifications	UL 1699B, UL 1741, UL 1998 (US)
Emissions	EN 61000-6-3 (Residential), FCC 47CFR15.109 (a)

TESLA.COM/ENERGY

TEELR NA 2021-1-14 DESIGN ENGINEER



## **76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004**

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500

CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

	REVI	SIONS	
ı	NO	DATE:	COMMENTS
ı	1		
	2		

## **INVERTER SPEC SHEET**

DATE: 12/15/2023 DRAWN BY: JYP REVIEWED BY:



## SOLAR SHUTDOWN DEVICE

The Tesla Solar Shutdown Device is part of the PV system rapid shutdown (RSD) function in accordance with Article 690 of the applicable NEC. When paired with the Tesla Solar Inverter, the PVRSS is initiated by any loss of AC power.



## ELECTRICAL SPECIFICATIONS

Nominal Input DC Current Rating (I <sub>MP</sub> )	12 A
Maximum Input Short Circuit Current (I <sub>sc</sub> )	15 A
Maximum System Voltage	600 V DC

## RSD MODULE PERFORMANCE

Maximum Number of Devices per String	5
Control	Power Line Excitation
Passive State	Normally open
Maximum Power Consumption	7 W
Warranty	25 years

#### COMPLIANCE INFORMATION

Certifications	UL 1741 PVRSS
	PVRSA (Photovoltaic Rapid
	Shutdown Array)

## **PVRSS**


RSD Initiation Method	Loss of AC power
Compatible Equipment	Tesla Solar Inverter

## **ENVIRONMENTAL SPECIFICATIONS**

Ambient Temperature	-40°C to 50°C (-40°F to 122°F)
Storage Temperature	-30°C to 70°C (-22°F to 158°F)
Enclosure Rating	NEMA 4 / IP65

## MECHANICAL SPECIFICATIONS

Electrical Connections	MC4 Connector
Housing	Plastic
Dimensions	125 mm x 150 mm x 22 mm
	(5 in x 6 in x 1 in)
Weight	350 g (0.77 lb)
Mounting Options	ZEP Home Run Clip
	M4 Screw (#10)
	M8 Bolt (5/16")
	Nail / Wood screw

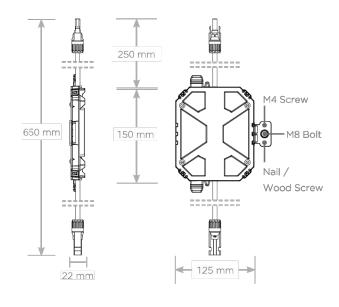

## SOLAR SHUTDOWN DEVICE REQUIREMENTS PER MODULE

The following modules have been certified as part of a PV Rapid Shutdown Array (PVRSA) when installed together with the Tesla Solar Inverter and Tesla Solar Shutdown Devices. See the Tesla Solar Inverter Installation Manual for guidance on installing Tesla Solar Inverter and Solar Shutdown Devices with other modules.

Brand	Model	Required Solar Shutdown Devices
Tesla	Solar Roof V3	1 Solar Shutdown Device per 10 modules
Hanwha	Q.PEAK DUO BLK-G5	1 Solar Shutdown Device per 3 modules
Hanwha	Q.PEAK DUO BLK-G6+	1 Solar Shutdown Device per 3 modules

DESIGN ENGINEER



## 76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER 1213 W MOOREHEAD STREET SUITE 500

CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVISIONS			
NO	DATE:	COMMENTS	
1			
2			

## OPTIMIZER SPEC SHEET

 DATE:
 12/15/2023

 DRAWN BY:
 JYP


 REVIEWED BY:
 HEV

Tech Brief



## XR Rail® Family

## **Solar Is Not Always Sunny** Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame. XR Rails® are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.



### Force-Stabilizing Curve

Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails<sup>®</sup> is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

## Compatible with Flat & Pitched Roofs



XR Rails® are compatible with FlashFoot® and other pitched roof attachments.



IronRidge® offers a range of tilt leg options for flat roof mounting

#### **Corrosion-Resistant Materials**

All XR Rails® are made of 6000-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.



XR Rail<sup>®</sup> Family

The XR Rail® Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail® to match.



#### XR10

XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 6 feet, while remaining light and economical.

- · 6' spanning capability
- Moderate load capability
   Clear & black anodized finish
- Internal splices available



## maximizing spans up to 10 feet.

mounting rail. It supports a range of

wind and snow conditions, while also

- 10' spanning capabilityHeavy load capability
- Clear & black anodized finish
  Internal splices available



**Tech Brief** 

#### XR1000

XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.

- 12' spanning capability
- Extreme load capability
   Clear anodized finish
- Internal splices available

## **Rail Selection**

The table below was prepared in compliance with applicable engineering codes and standards.\* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2e, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit IronRidge.com for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
	90						
None	120						
None	140	XR10		XR100		XR1000	
	160						
	90						
	120						
20	140						
	160						
30	90						
30	160						
40	90						
40	160						
80	160						
120	160						

Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance

2023 IronRidge, Inc. All rights reserved. Visit www.ironridge.com or call 1-800-227-9523 for more information. Version 1.2



## 76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER
1213 W MOOREHEAD STREET SUITE
500
CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVI	SIONS	
NO	DATE:	COMMENTS
1		
2		

## RAIL SPEC SHEET

 DATE:
 12/15/2023

 DRAWN BY:
 JYP

 REVIEWED BY:
 HEV





## FlashVue®

## **Moving Flashing Forward**

We set out to design a flashing that checked all the boxes: fully waterproof, fast and easy to install correctly, economical, and strong enough to handle every environmental condition. FlashVue® does it

The optimized flashing design features a large viewport, for easy alignment with the pilot hole. And the GripCap® and GripCap+® sit snugly in place, so the lag can be driven single-handedly.



## Three-Tier Water Seal, Reimagined

FlashVue®'s seal architecture utilizes three layers of protection. The viewport is elevated 0.30", and provides a "friction-fit" for the GripCap®. The GripCap® fully covers the viewport while a sealing washer adds another layer of protection. And an EPDM washer and lag bolt "seal the deal" in the

"friction-fit" for easy installs. Push snug into the viewport, without worrying it will roll away or rotate while driving the lag.





TAS 100(A)-95


## Large Viewport in Flashing

Ø 0.75"

The large viewport makes it easy to align the flashing with the pilot hole, and drive the lag centered into the rafter. The elevated rim not only provides a sturdy dock for the GripCap® or GripCap+®, but increases water-shedding



## **See Your Pilot Holes**

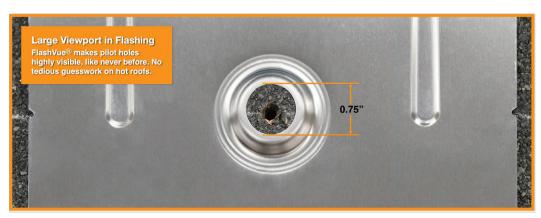

## **Solve Roof Undulations**



## **Trusted Strength & Certification**

Attachment Loading

FlashVue® has been tested and rated to support 1161 (lbs) of uplift and 353 (lbs) of lateral load.

**Structural Certification** 

Designed and certified for compliance with the International Building Code & ASCE/SEI-7.

**Water Seal Ratings** 

Passed both the UL 441 Section 27 "Rain Test" and TAS 100-95 "Wind Driven Rain Test" by Intertek.

**UL 2703 Listed System** 

Conforms to UL 2703 mechanical and bonding requirements. See Flush Mount Manual for more info.





## **76 N. MEADOWBROOK DRIVE ALPINE, UTAH 84004**

swyssling@wysslingconsulting.com (201) 874-3483

NORTH CAROLINA COA NO. P-2308

SOLAR COMPANY/CLIENT



BYLD BETTER 1213 W MOOREHEAD STREET SUITE

CHARLOTTE, NC 28208

HESS, BRENNAN 11 BRAXTON COURT ERWIN, NC 28339 5.390 KW DC 7.600 KW AC

REVI	REVISIONS			
NO	DATE:	COMMENTS		
1				
2				

## **MOUNTING SPEC SHEET**

DATE: 12/15/2023 DRAWN BY: JYP REVIEWED BY:

