

12/12/2023

**Palmetto Solar**



**Subject:** Structural Certification for Installation of Residential Solar

**Job:** Natalie De La Cruz Barragan

**Project Address:** 240 Coleshill Road, Angier, NC, 27501

**Attn.:** To Whom It May Concern

Observation of the condition of the existing framing system was performed by an audit team of Palmetto Solar.

After review of the field observation data, structural capacity calculations were performed in accordance with applicable building codes to determine adequacy of the existing roof framing supporting the proposed panel layout. Please see full Structural Calculations report for details regarding calculations performed and limits of scope of work and liability. The design criteria and structural adequacy are summarized below:

**Design Criteria**


**Code:** 2018 NCSBC, IBC 2015, ASCE 7-10

**Ult Wind Speed:** 117.0 mph

**Ground Snow:** 20.0 psf

**Min Snow Roof:** 0.0 psf

Current Renewables Engineering Inc.  
Professional Engineer  
info@currentrenewableseng.com

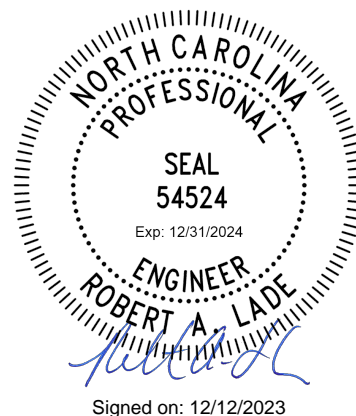

**Summaries:**

**Check 1:** Shingle roofing supported by 2x4 Rafter @ 24 in. OC spacing. The roof is sloped at approximately 27 degrees and has a max beam span of 10.0 ft between supports. Roof is adequate to support the imposed loads. Therefore, no structural upgrades are required.