



LEADING THE WAY  
Structural Engineering Firm  
NC License No. C-2499

168 Quade Drive  
Cary, North Carolina 27513  
www.rbengineering.com

Phone: 919-677-9662 / Cell: 919-280-2695 / Fax: 919-677-9663

E-mail: [rbittler@rbengineering.com](mailto:rbittler@rbengineering.com)

Mr. Wyatt Bailey  
**Yes! Solar Solutions of the Triangle**  
E-mail: [wbailey@yessolarsolutions.com](mailto:wbailey@yessolarsolutions.com)

July 25, 2024

Subject: Roof mounted solar panels – Lloyd Residence  
554 Lambert Lane  
Fuquay-Varina, North Carolina 27526

File No.: RB-249880

Dear Wyatt:

RB Engineering, Inc. is pleased to provide the following summary engineering letter concerning the subject project. The existing roof system is constructed with 2x8 timber rafters at 16 inches on center and a composition asphalt shingle roof. We have reviewed the proposed solar layout and have structurally evaluated the additional proposed roof loading with the following conclusions:

- The total surface area of the new proposed solar array (26 PV modules) is approximately 550 SF. The solar panel installation has been evaluated for an ultimate design wind speed of 115 mph.
- The subject roof mounted PV system attachment method is structurally adequate to transfer the design uplift loads in accordance with the 2018 North Carolina residential building code.
- The existing roof system is structurally adequate to transfer the applicable design loads - including the additional or modified design loading (dead, wind and snow loads) due to the proposed solar panel installation - in accordance with the 2018 North Carolina residential building code.

Our services were provided in accordance with the standard of practice for structural engineering and within the limits imposed by scope, schedule, and budget. If you have any questions or if I can be of further assistance to you on this project, please contact me at (919) 677-9662.

Respectfully submitted,

Ron Bittler, PE  
President / Structural Engineer  
RB Engineering, Inc.



**NEW PHOTOVOLTAIC SYSTEM 11.050kW DC / 11.500kW AC**  
**NEW ENERGY STORAGE SYSTEM 13.500kWh**  
**554 LAMBERT LANE, FUQUAY-VARINA, NC 27526**

**AHJ**

NC-TOWN OF FUQUAY-VARINA

**UTILITY**

DUKE ENERGY PROGRESS


**CODES AND STANDARDS**

ELECTRIC CODE: NEC 2017 WITH NC AMENDMENTS  
 FIRE CODE: NCFC 2018  
 BUILDING CODE: NCBC 2018  
 RESIDENTIAL CODE: NCRC 2018  
 WIND SPEED: 116 MPH  
 SNOW LOAD: 15 PSF  
 HIGH TEMP: 36°C, LOW TEMP: -8.5°C

**SCOPE OF WORK**

(N) 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 (N) 13.500kWh ENERGY STORAGE SYSTEM  
 (26) HANWHA QCELLS Q.TRON BLK M-G2+ 425 MODULE  
 (1) TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY  
 1707000-xx-y (240V) INVERTER  
 (10) TESLA SOLAR SHUTDOWN DEVICE (MCI-1)  
 (1) TESLA BACKUP GATEWAY 2 (1232100-xx-y)

**VICINITY MAP**

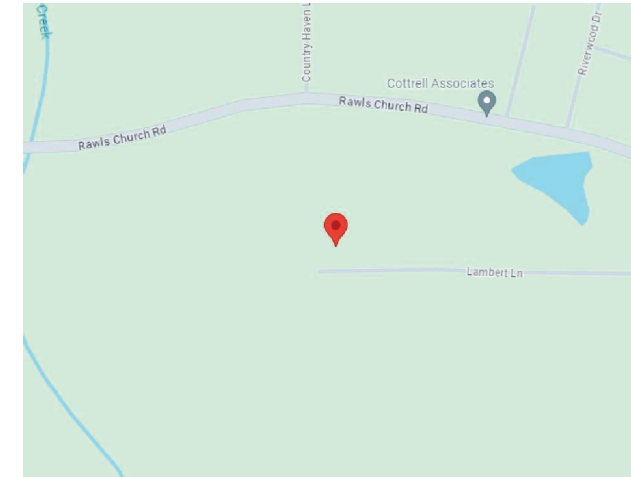

**CONTRACTOR INFORMATION**



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC


**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM

**SHEET CATALOG**

- PV-1** COVER SHEET
- PV-1.1** GENERAL NOTES
- PV-2** SITE PLAN
- PV-3** MOUNTING DETAILS-1
- PV-3.1** MOUNTING DETAILS-2
- PV-3.2** STRUCTURAL DETAILS
- PV-4** SINGLE LINE DIAGRAM
- PV-4.1** ELECTRICAL CALCULATIONS
- PV-5** PLACARDS
- SS** SPEC SHEETS

**Ron Bittler, PE**  
 Digitally signed by Ron Bittler, PE  
 DN: cn=Ron Bittler, PE, o, ou, email=rbittler@rbengineering.com, c=US  
 Date: 2024.07.25 13:33:10 -04'00'



STRUCTURAL REVIEW PROVIDED BY:  
 RONALD P. BITTLER, PE  
 RB ENGINEERING, INC. (C-2499)  
 168 QUADE DRIVE  
 CARY, NC 27513  
 919-677-9662  
 PROJECT #RB-249880

**METER NUMBER: 339 604 106**

<b>PROJECT ID</b>	AUR-1001058
<b>DATE</b>	7/19/2024
<b>CREATED BY</b>	VK
<b>SIGNATURE</b>	

**COVER SHEET**  
**PV-1**

**NOTES:**

1. MODULES ARE LISTED UNDER UL 1703 / UL 61730 AND CONFORM TO THE STANDARDS.
2. INVERTERS ARE LISTED UNDER UL 1741 AND CONFORM TO THE STANDARDS.
3. DRAWINGS ARE DIAGRAMMATIC, INDICATING GENERAL ARRANGEMENT OF THE PV SYSTEM. ACTUAL SITE CONDITIONS MAY VARY.
4. WORKING CLEARANCES AROUND THE NEW PV ELECTRICAL EQUIPMENT SHALL BE MAINTAINED IN ACCORDANCE WITH NEC 110.26.
5. ALL GROUND WIRING CONNECTED TO THE MAIN SERVICE GROUNDING IN MAIN SERVICE PANEL / SERVICE EQUIPMENT.
6. ALL CONDUCTORS SHALL BE 600V, 90°C STANDARD COPPER UNLESS OTHERWISE NOTED.
7. WHEN REQUIRED, A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
8. THE SYSTEM WILL NOT BE INTERCONNECTED BY THE CONTRACTOR UNTIL APPROVAL FROM UTILITY IS RECEIVED.
9. ROOF ACCESS POINT SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS OR DOORS, AND LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREES, WIRES OR SIGNS.
10. PV ARRAY COMBINER / JUNCTION BOX PROVIDES TRANSITION FROM ARRAY WIRING TO CONDUIT WIRING.
11. RACKING SYSTEM SHALL BE LISTED TO UL 2703.
12. FIRE RATING OF EXISTING ROOF ASSEMBLY SHALL BE MAINTAINED WITH ADDITION OF PHOTOVOLTAIC SYSTEM.

**CONTRACTOR INFORMATION**

YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 459-4155

LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE

ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526

COORDINATES: 35.532743, -78.790855

APN: 080664011125

11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID | AUR-1001058

DATE | 7/19/2024

CREATED BY | VK

SIGNATURE

**GENERAL NOTES****PV-1.1**

**SCOPE OF WORK**

- (N) 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
- (N) 13.500kWh ENERGY STORAGE SYSTEM
- (26) HANWHA QCELLS Q.TRON BLK M-G2+ 425 MODULE
- (1) TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY
- 1707000-xx-y (240V) INVERTER
- (10) TESLA SOLAR SHUTDOWN DEVICE (MCI-1)
- (1) TESLA BACKUP GATEWAY 2 (1232100-xx-y)

TOTAL ARRAY AREA = 545.97 SQ.FT  
 TOTAL ROOF AREA = 3146 SQ.FT  
 % ARRAY AREA IN ROOF = 17.35%


- (N) PHOTOVOLTAIC ARRAY ON MP-03
- (N) PHOTOVOLTAIC ARRAY ON MP-04
- (N) JUNCTION BOX NEMA 4X RATED (ATTIC MOUNT)
- (E) FENCE
- (N) PHOTOVOLTAIC ARRAY ON MP-05
- (N) TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY 1707000-xx-y (240V) INVERTER (EXTERIOR)
- (N) AC DISCONNECT (EXTERIOR)
- (E) UTILITY METER WITH MAIN SERVICE PANEL (EXTERIOR)
- (N) TESLA BACKUP GATEWAY 2 (1232100-xx-y) (EXTERIOR)

- (E) FENCE
- (N) (26) HANWHA QCELLS Q.TRON BLK M-G2+ 425 MODULES WITH TESLA SOLAR SHUTDOWN DEVICE (MCI-1) EVERY THREE MODULES
- (N) PHOTOVOLTAIC ARRAY ON MP-02

- (N) PHOTOVOLTAIC ARRAY ON MP-01
- (E) GATE
- (E) BACKUP LOAD PANEL (INTERIOR)

**LEGEND**

- PROPERTY LINE
- FENCE AND GATE LINE
- VENT (ROOF OBSTRUCTION)
- MSP UTILITY METER WITH MAIN SERVICE PANEL
- AC AC DISCONNECT
- GW TESLA GATEWAY 2
- INV INVERTER WITH INTEGRATED SOLAR BATTERY
- BLP BACKUP LOAD PANEL
- JB JUNCTION BOX

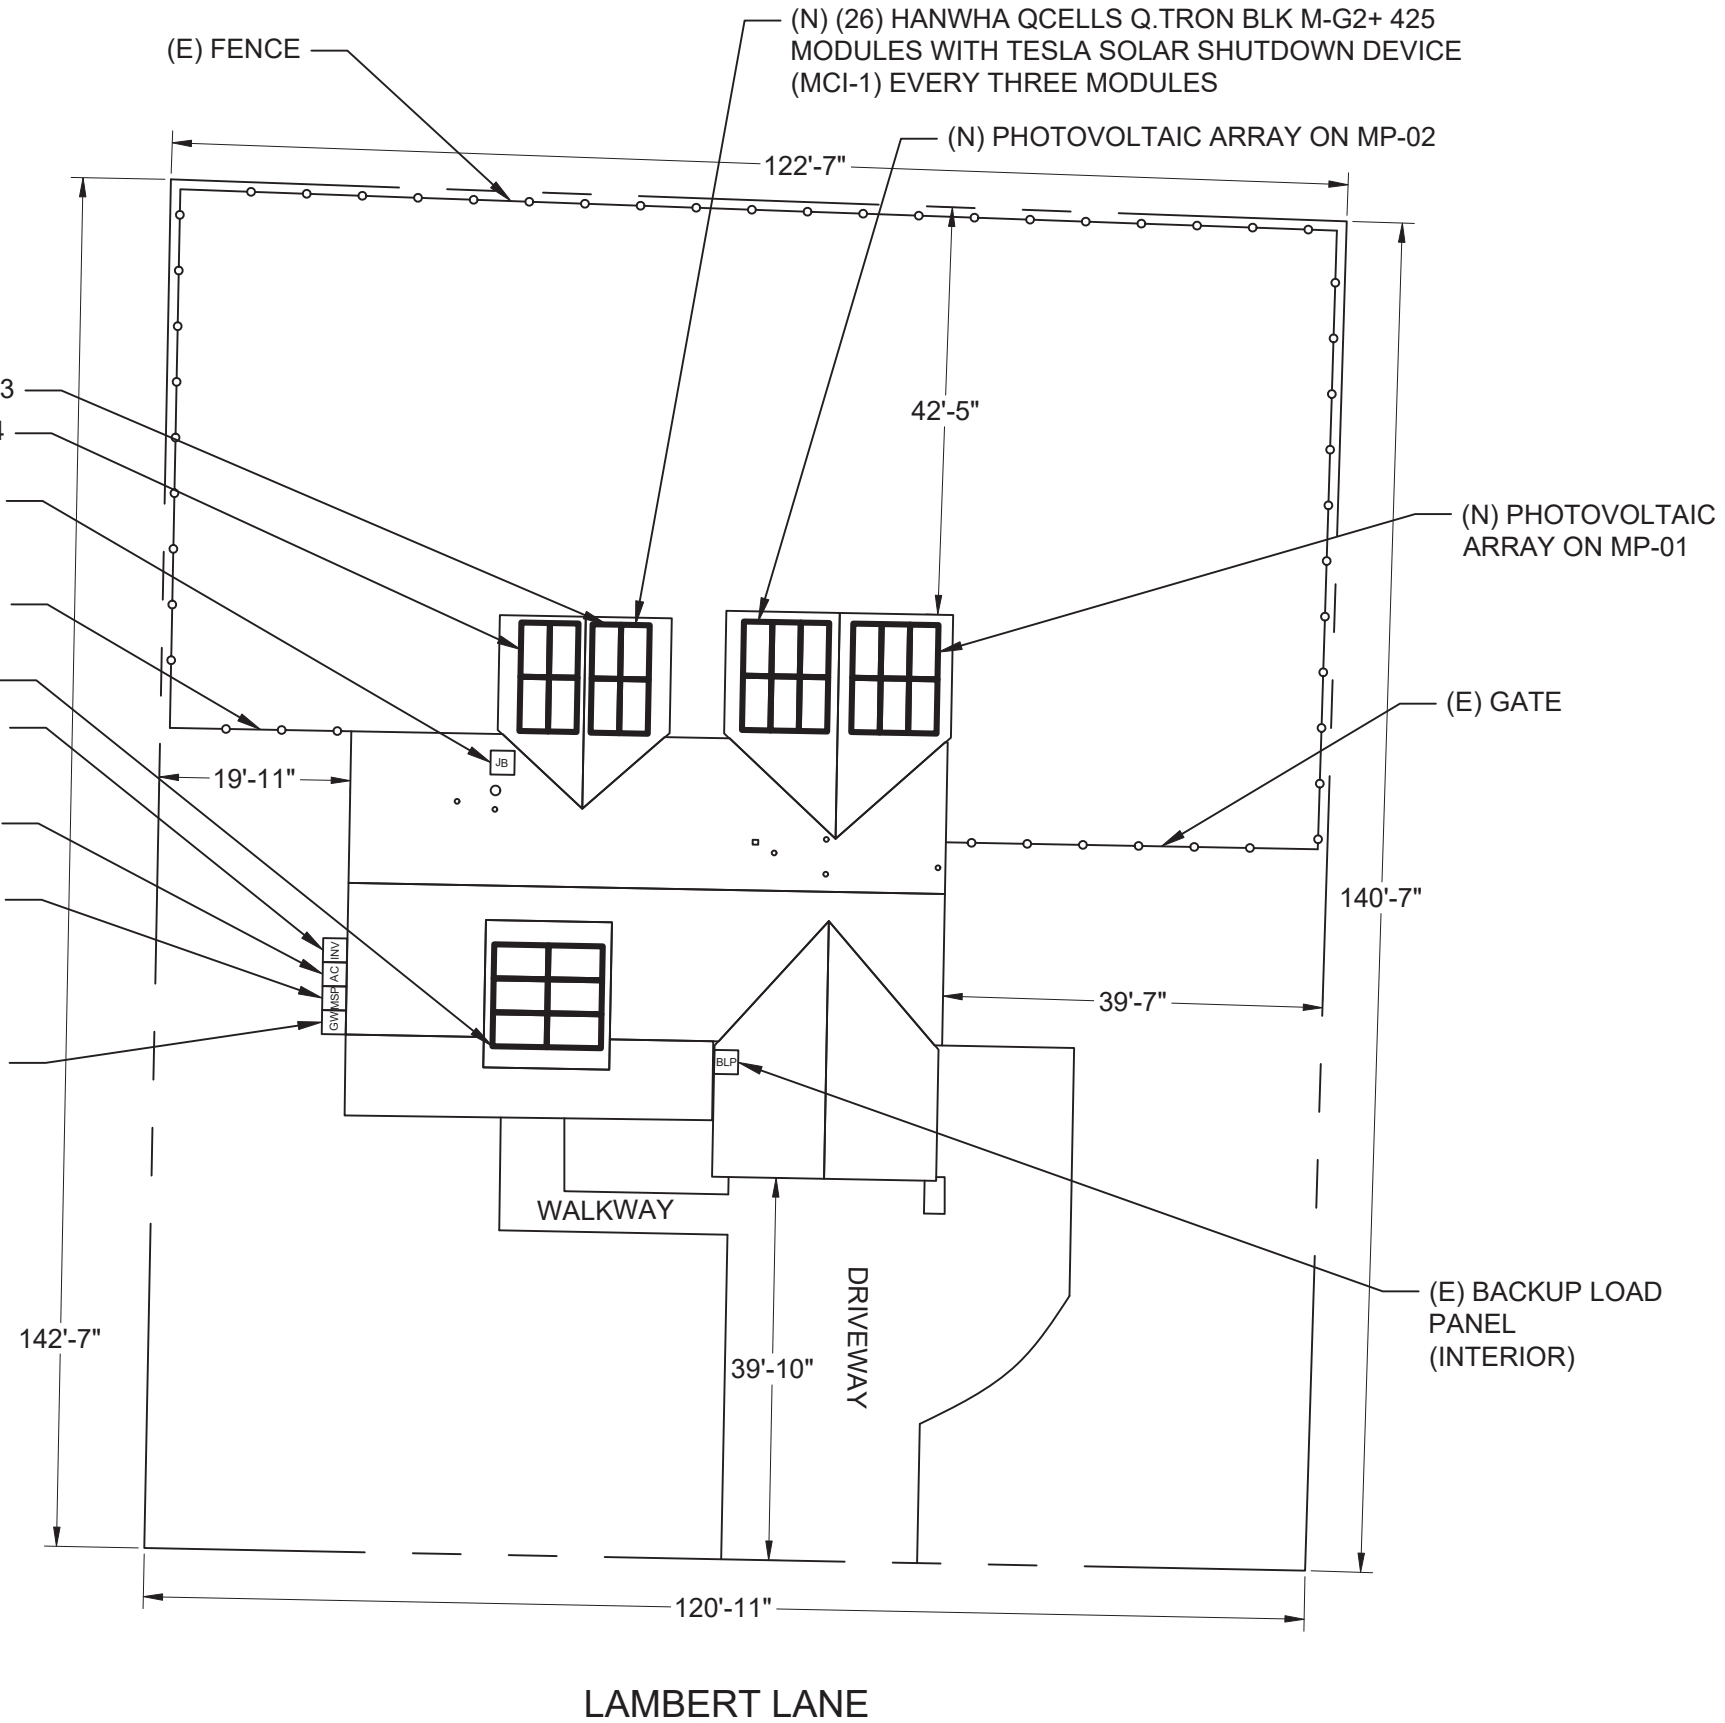

**CONTRACTOR INFORMATION**



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC

**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1001058

DATE 7/19/2024

CREATED BY VK

SIGNATURE

SITE PLAN  
 PV-2



SCALE: 1" = 20'-0"



WIND SPEED: 116 MPH AND SNOW LOAD: 15 PSF

S.NO	AZIMUTH	PITCH	NO. OF MODULES	ARRAY AREA (SQ.FT)	ROOF TYPE	ATTACHMENT	ATTACHMENT QUANTITY	ROOF EXPOSURE	FRAME TYPE	FRAME SIZE	FRAME SPACING	MAX ATTACHMENT SPACING	MAX OVER HANG
MP-01	91°	37°	6	125.99	COMPOSITION SHINGLE	SNAPNRACK FLASHED L FOOT (242-92047, 242-92048, 242-92050, 242-92051)	24	ATTIC	RAFTERS	2" X 8"	16" O.C.	4'-0"	1'-6"
MP-02	271°	37°	6	125.99	COMPOSITION SHINGLE	SNAPNRACK FLASHED L FOOT (242-92047, 242-92048, 242-92050, 242-92051)	24	ATTIC	RAFTERS	2" X 8"	16" O.C.	4'-0"	1'-6"
MP-03	91°	37°	4	83.99	COMPOSITION SHINGLE	SNAPNRACK FLASHED L FOOT (242-92047, 242-92048, 242-92050, 242-92051)	16	ATTIC	RAFTERS	2" X 8"	16" O.C.	4'-0"	1'-6"
MP-04	271°	37°	4	83.99	COMPOSITION SHINGLE	SNAPNRACK FLASHED L FOOT (242-92047, 242-92048, 242-92050, 242-92051)	16	ATTIC	RAFTERS	2" X 8"	16" O.C.	4'-0"	1'-6"
MP-05	181°	18°	6	125.99	COMPOSITION SHINGLE	SNAPNRACK FLASHED L FOOT (242-92047, 242-92048, 242-92050, 242-92051)	24	ATTIC	RAFTERS	2" X 8"	16" O.C.	4'-0"	1'-6"


CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM



07.25.2024

PROJECT ID AUR-1001058


DATE 7/19/2024

CREATED BY VK

SIGNATURE

MOUNTING DETAILS-1  
 PV-3

NOTE: PENETRATIONS ARE STAGGERED.

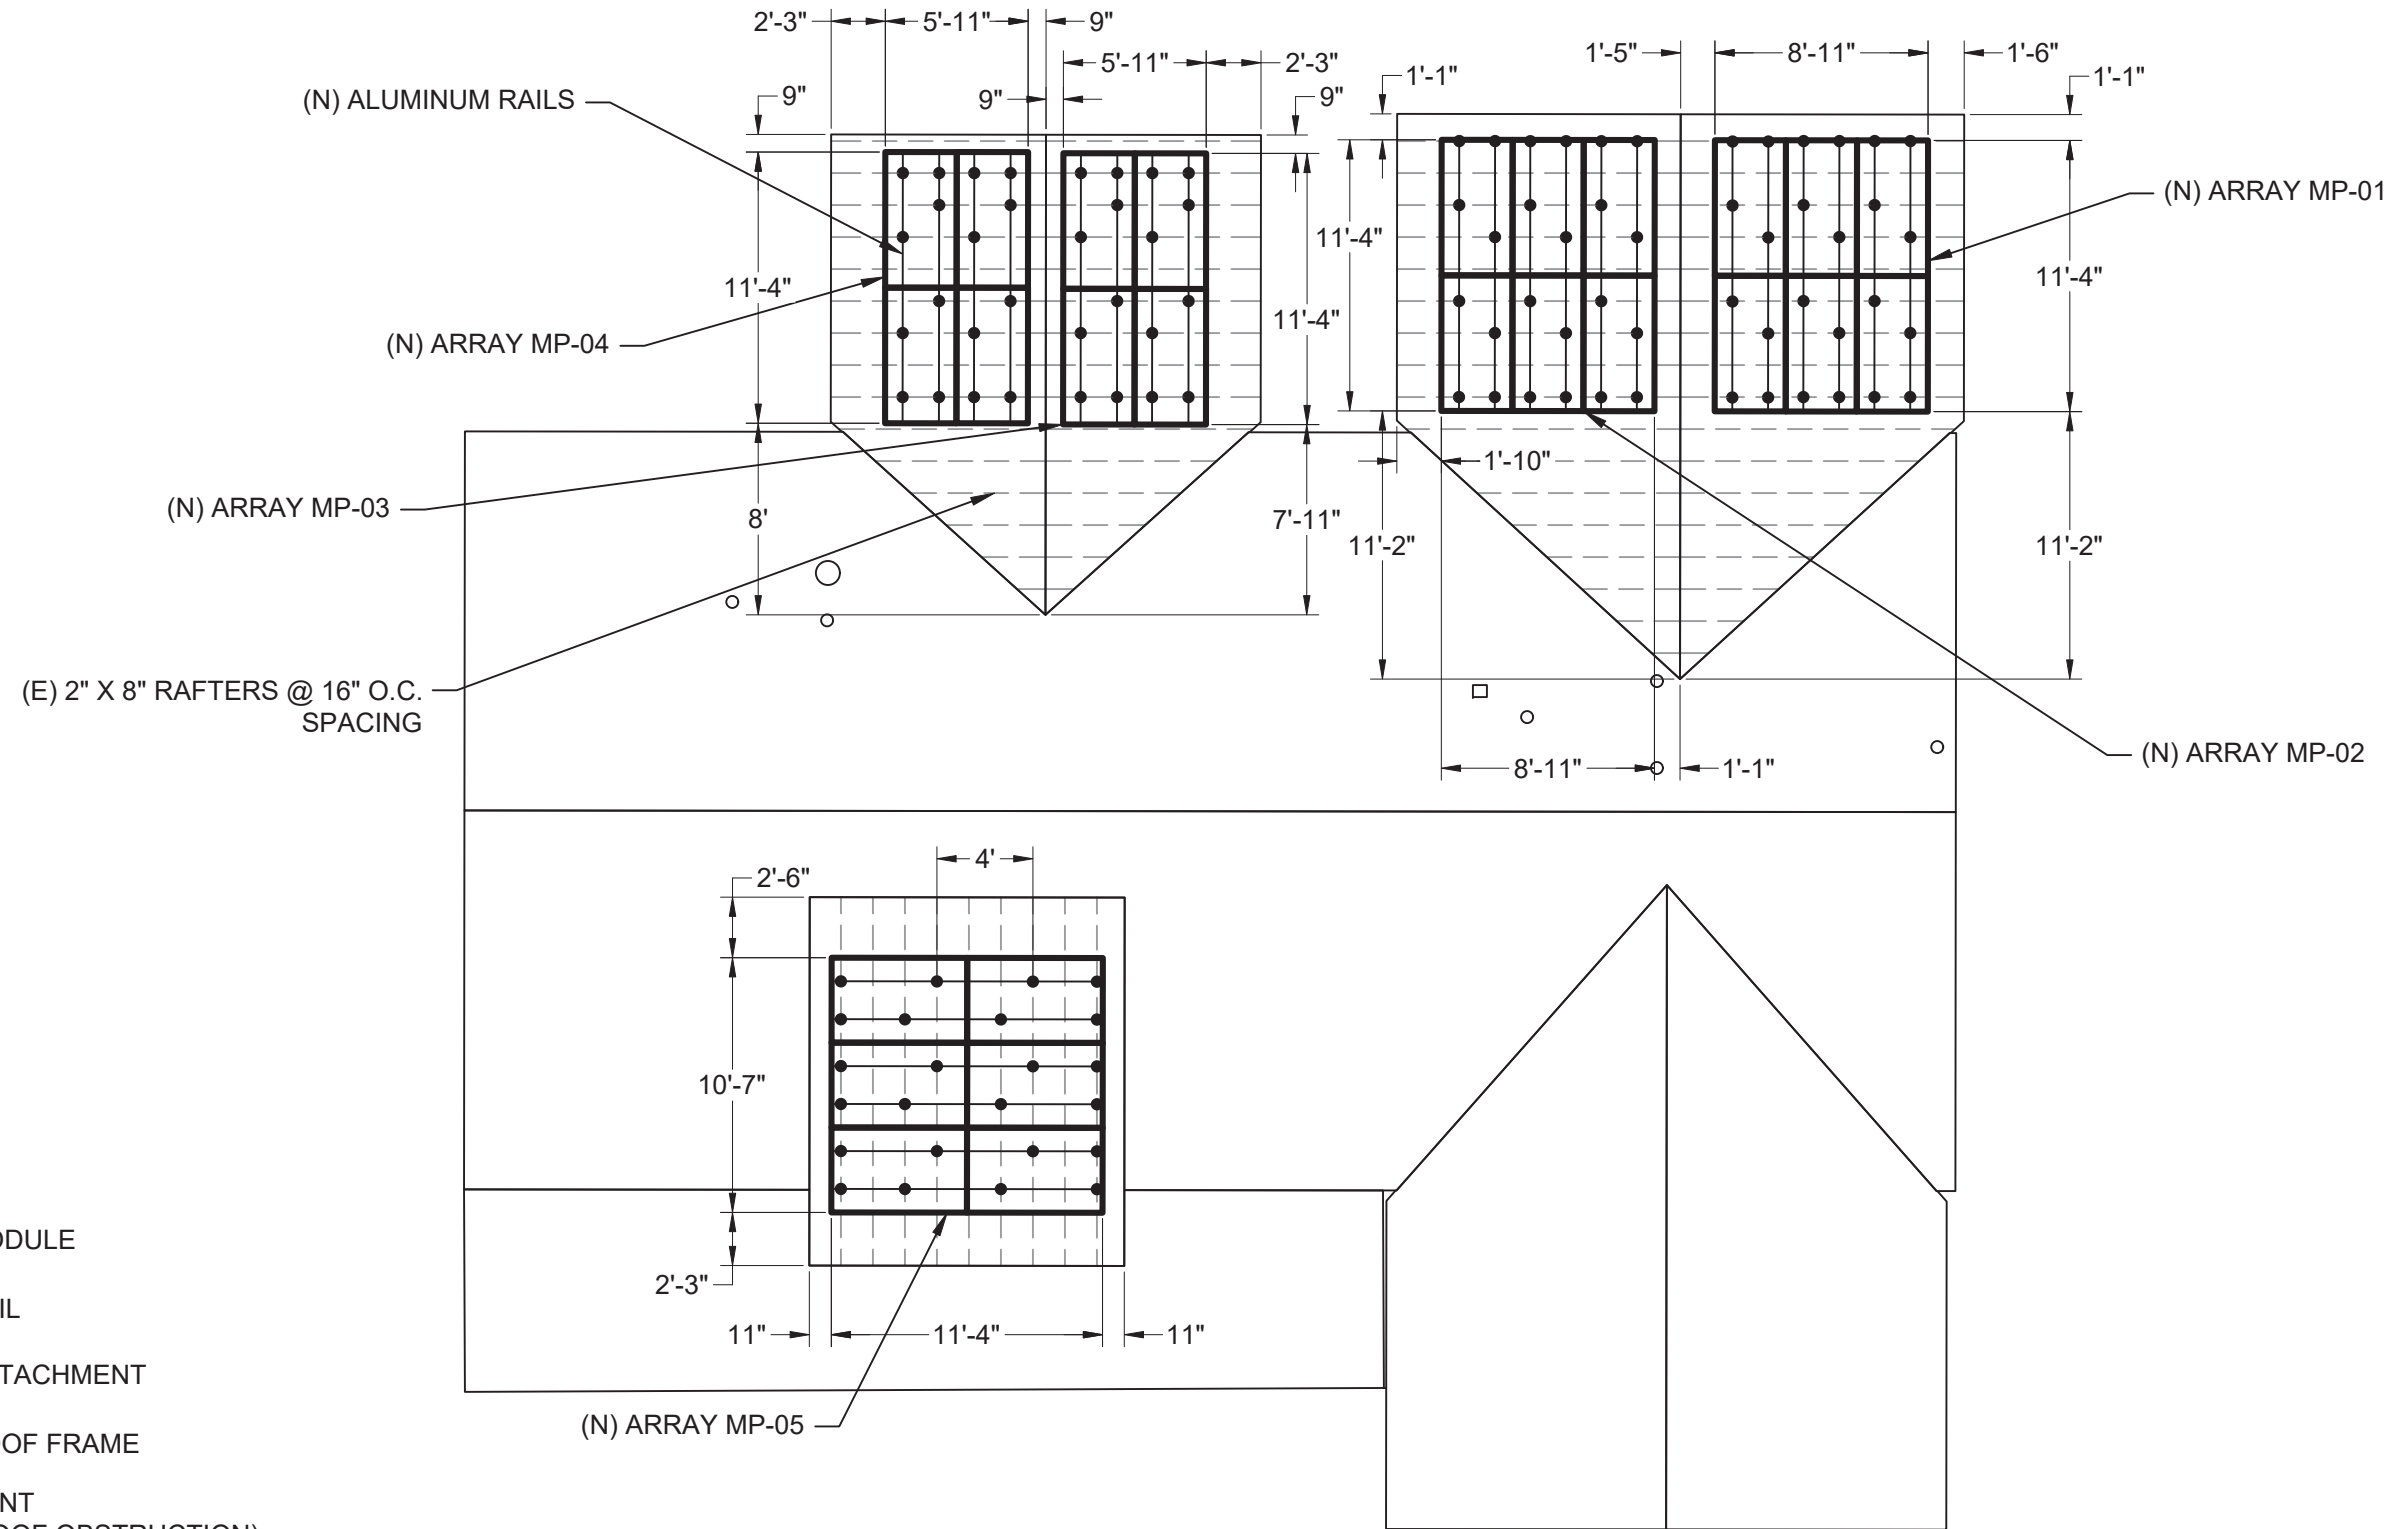

**CONTRACTOR INFORMATION**



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC

**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM



07.25.2024

PROJECT ID AUR-1001058






DATE 7/19/2024

CREATED BY VK

SIGNATURE

**MOUNTING DETAILS-2  
 PV-3.1**

**LEGEND**

-  MODULE
-  RAIL
-  ATTACHMENT
-  ROOF FRAME
-  VENT (ROOF OBSTRUCTION)





SCALE: 1/8" = 1'-0"

### STRUCTURAL NOTES

1. ALL SOLAR PANEL COMPONENTS SHALL BE INSTALLED PER THE MANUFACTURER'S APPROVED INSTALLATION SPECIFICATIONS.
2. THE EXISTING BUILDING'S STRUCTURE SHALL BE VERIFIED AS PROPERLY CONSTRUCTED AND MAINTAINED IN GOOD CONDITION. NO ALLOWANCE HAS BEEN MADE FOR ANY EXISTING DEFICIENCY IN DESIGN, MATERIAL, CONSTRUCTION, OR LACK OF MAINTENANCE FOR THE EXISTING STRUCTURE OR PROPOSED EQUIPMENT. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS, PROPER FIT, AND CLEARANCES IN THE FIELD.
3. IF ANY CONDITION THROUGHOUT THE ASSOCIATED REPORT OR PERMIT DRAWINGS IS NOT REPRESENTED ON-SITE, CONTRACTOR SHALL NOTIFY THE ENGINEER OF RECORD (EOR) OF ANY DISCREPANCIES AND RECEIVE WRITTEN APPROVAL FROM THE EOR BEFORE PROCEEDING WITH INSTALLATION.
4. MISCELLANEOUS ITEMS NOT EXPLICITLY NAMED & SHOWN IN THESE DRAWINGS HAVE NOT BEEN DESIGNED. IT IS RECOMMENDED THAT MATERIAL OF SUITABLE SIZE & STRENGTH BE OBTAINED FROM A REPUTABLE MANUFACTURER FOR MISCELLANEOUS ITEMS.
5. CONTRACTOR SHALL BE RESPONSIBLE TO COMPLETE, SEAL, & WATERPROOF ROOFTOP PENETRATIONS FOR SOLAR RACKING.
6. CONTRACTOR TO PROVIDE MINIMUM 1/4" GAP BETWEEN ALL SOLAR PANELS.
7. PROJECT WINDSPEED IS BASIC WIND SPEED PER CODE UNLESS NOTED OTHERWISE.

### DEAD LOAD CALCULATIONS

BOM	QUANTITY	LBS/UNIT	TOTAL WEIGHT (LBS)
MODULES	26	46.7	1214.2
MID-CLAMP	26	0.17	4.42
END-CLAMP	52	0.3	15.6
RAIL LENGTH	302	0.42	126.84
SPLICE BAR	0	0.52	0
SNAPNRACK FLASHED L FOOT (242-92047, 242-92048, 242-92050, 242-92051)	104	1.3	135.2
MCI DEVICE	10	0.77	7.7
TOTAL WEIGHT OF THE SYSTEM (LBS)			1503.96
TOTAL ARRAY AREA ON THE ROOF (SQ. FT.)			545.97
WEIGHT PER SQ. FT.(LBS)			2.75
WEIGHT PER PENETRATION (LBS)			14.46

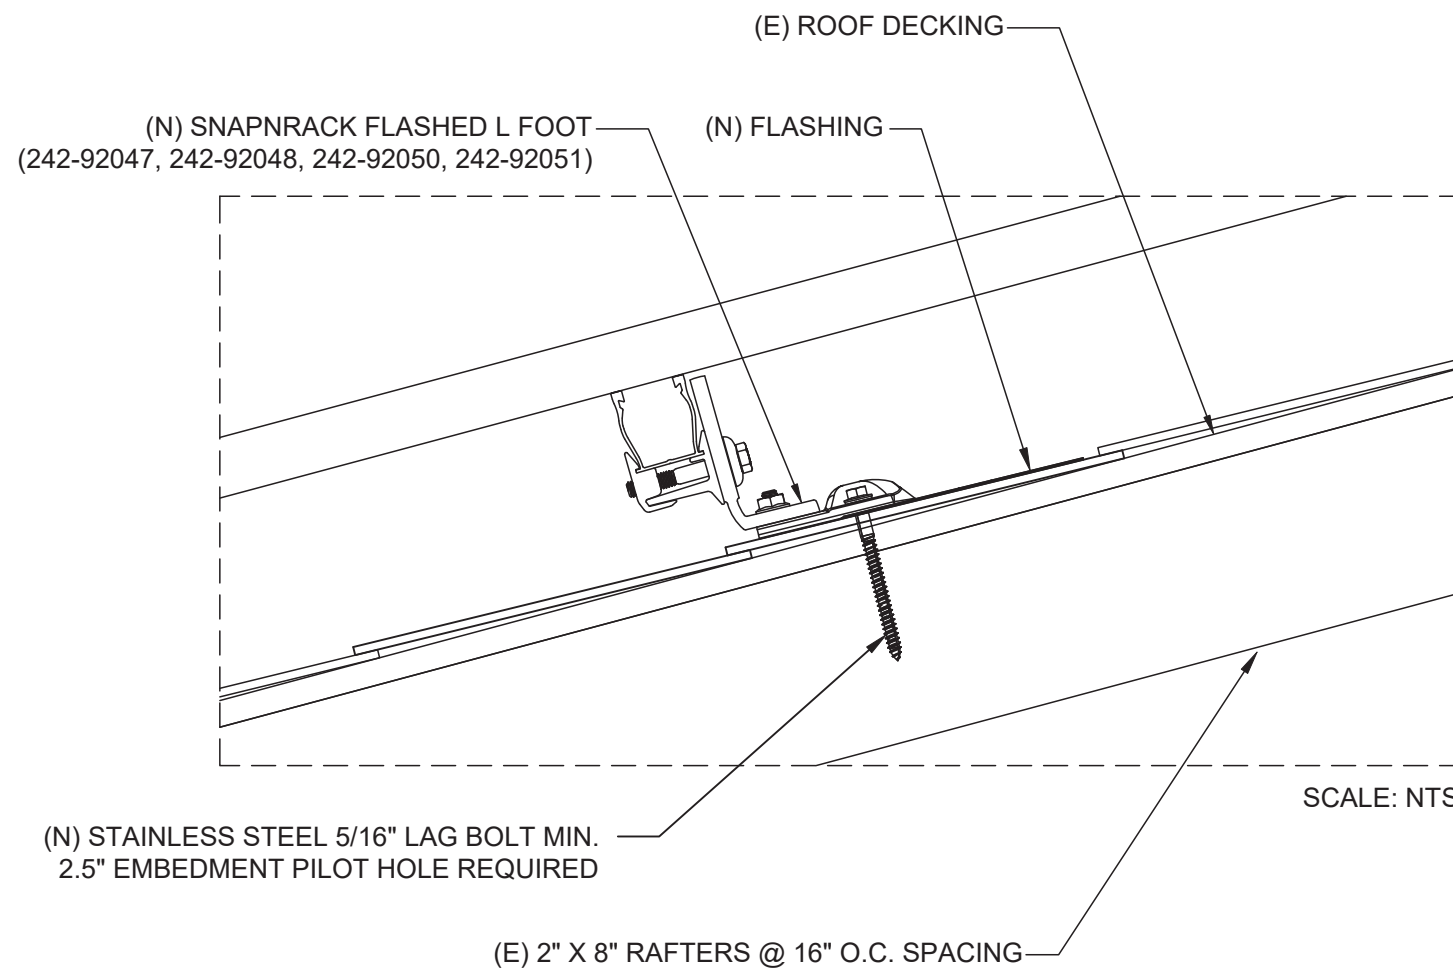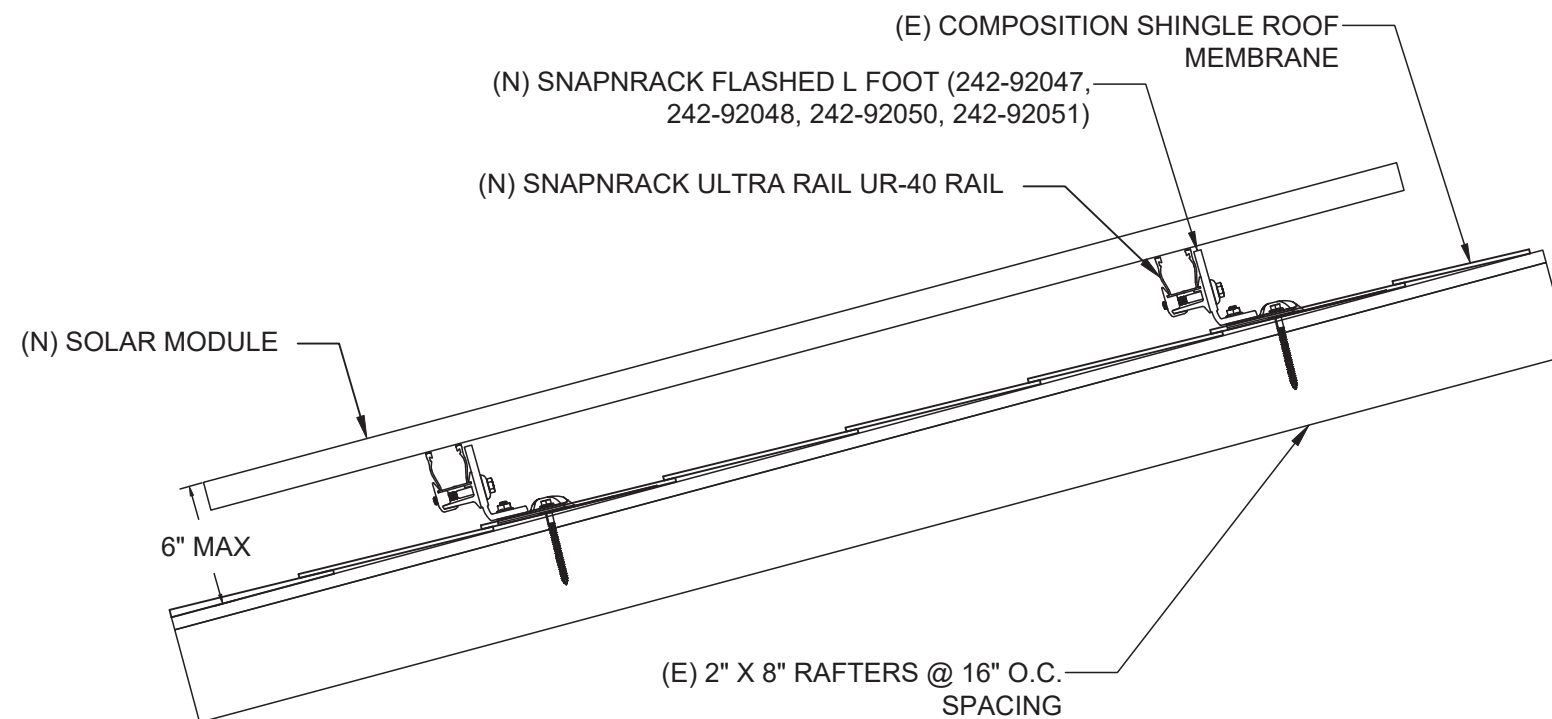

### CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC

### CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM



07.25.2024

PROJECT ID	AUR-1001058
DATE	7/19/2024
CREATED BY	VK
SIGNATURE	

### STRUCTURAL DETAILS PV-3.2

MODULE SPECIFICATIONS	
MODEL	HANWHA QCELLS Q.TRON BLK M-G2+ 425
MODULE POWER @ STC	425W
OPEN CIRCUIT VOLTAGE:Voc	39.03V
MAX POWER VOLTAGE:Vmp	32.74V
SHORT CIRCUIT CURRENT:Isc	13.66A
MAX POWER CURRENT:Imp	12.98A
TEMPERATURE COEFFICIENT:Voc	-0.24%/K
MODULE DIMENSIONS: L x W x H	67.8" x 44.6" x 1.18"
NUMBER OF MODULES	26

INVERTER-1 SPECIFICATIONS	
MODEL	TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY 1707000-xx-y (240V)
POWER RATING	11500W
MAX OUTPUT CURRENT	48A
CEC WEIGHTED EFFICIENCY	97.5%
MAX INPUT CURRENT	15A
MAX DC VOLTAGE	600V
NUMBER OF INVERTER	1

RSD CHARACTERISTICS	
MODEL	TESLA SOLAR SHUTDOWN DEVICE (MCI-1)
NOMINAL INPUT DC CURRENT	12A
MAX SYSTEM VOLTAGE	600VDC
MAX INPUT SHORT CIRCUIT CURRENT	19A
NUMBER OF RSD	10


**CONTRACTOR INFORMATION**



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC

**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM

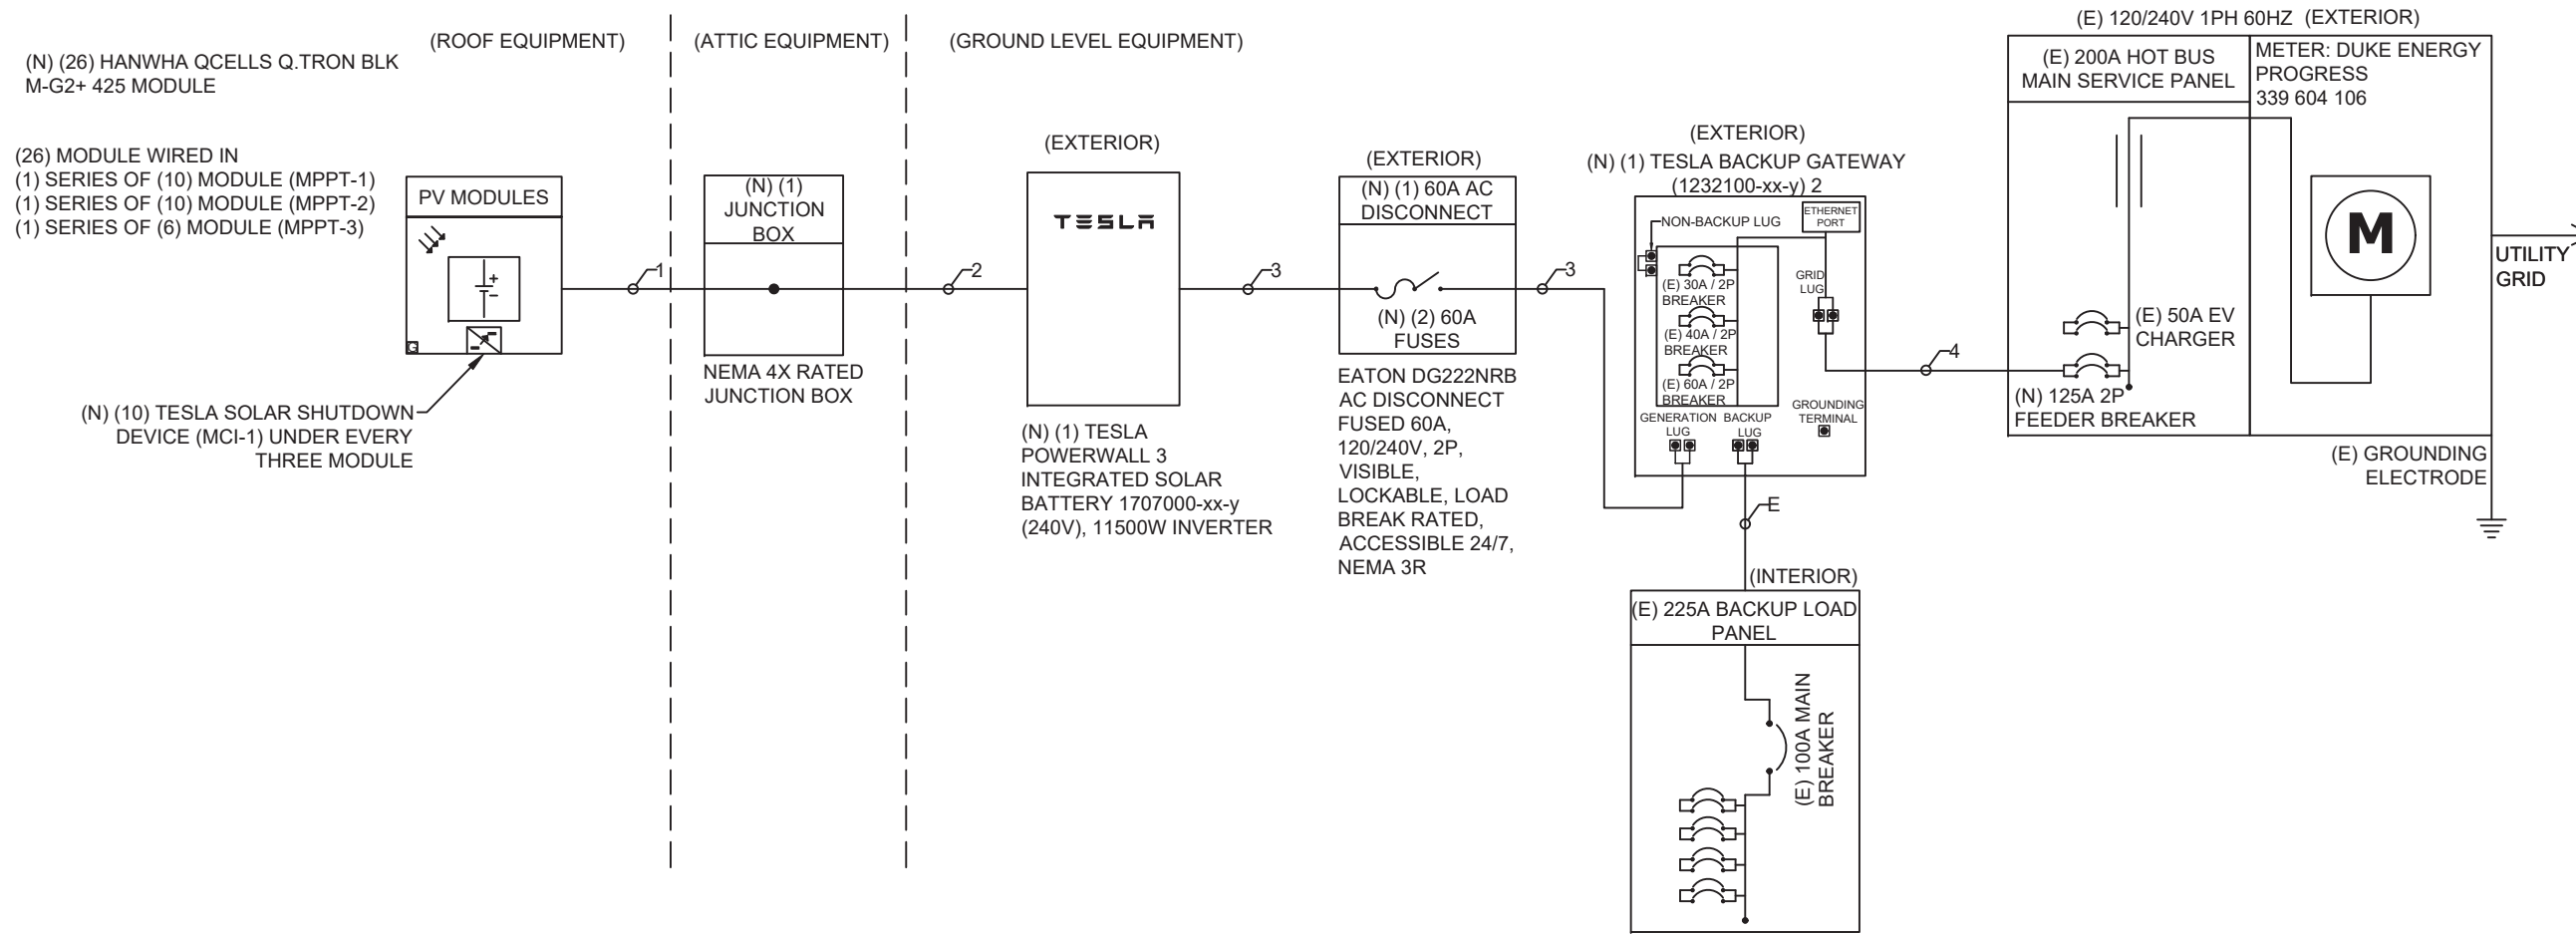

CONDUCTOR SCHEDULE				
TAG ID	CONDUIT SIZE	CONDUCTOR	NEUTRAL	GROUND
1	NONE	(6) 10 AWG THHN/THWN-2	NONE	(1) 10 AWG THHN/THWN-2, EGC
2	3/4" EMT	(6) 10 AWG THHN/THWN-2, Cu	NONE	(1) 10 AWG THHN/THWN-2, EGC
3	1" EMT	(2) 4 AWG THHN/THWN-2, Cu	(1) 4 AWG THHN/THWN-2, Cu	(1) 10 AWG THHN/THWN-2, EGC
4	1-1/4" EMT	(2) 1/0 AWG THHN/THWN-2, Cu	(1) 1/0 AWG THHN/THWN-2, Cu	(1) 6 AWG THHN/THWN-2, EGC
E		EXISTING		

PROJECT ID	AUR-1001058
DATE	7/19/2024
CREATED BY	VK
SIGNATURE	

**SINGLE LINE DIAGRAM  
PV-4**



SYSTEM CHARACTERISTICS	
DC SYSTEM SIZE	11050W
MAX OPEN CIRCUIT VOLTAGE	421.68V
OPERATING VOLTAGE	327.4V
MAX SHORT CIRCUIT CURRENT	51.22A
OPERATING CURRENT	38.94A

OCPD CALCULATION	
MAIN PANEL RATING	= 200A
<b>INVERTER OVERCURRENT PROTECTION:</b>	
INVERTER OVERCURRENT PROTECTION = INVERTER O/P CURRENT * CONTINUOUS LOAD (1.25)	
	= 48 * 1.25
	= 60A
PV OVERCURRENT PROTECTION	= 60A

**CONTRACTOR INFORMATION**



YES SOLAR SOLUTIONS  
 ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
 PHONE NUMBER: (919) 459-4155  
 LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
 LICENSE TYPE: NC GC/ELECTRIC

- ELECTRICAL NOTES**
1. CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC 310.10(D).
  2. CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC 310.10(C).
  3. MAXIMUM DC/AC VOLTAGE DROP SHALL BE NO MORE THAN 2%.
  4. ALL CONDUCTORS SHALL BE IN CONDUIT UNLESS OTHERWISE NOTED.
  5. BREAKER/FUSE SIZES PER NEC 240.
  6. AC EQUIPMENT GROUNDING CONDUCTOR SIZED PER NEC 250.122.
  7. AMBIENT TEMPERATURE CORRECTION FACTOR IS BASED ON NEC 310.15(B)(2)(a).
  8. MAX. SYSTEM VOLTAGE COEFFICIENT IS FROM MODULE MANUFACTURER OR NEC 690.7 WHEN MANUFACTURER COEFFICIENT UNAVAILABLE.
  9. CONDUCTORS ARE SIZED PER NEC TABLE 310.15(B)(16).
  10. CONDUIT SHALL BE INSTALLED MINIMUM 7/8" FROM ROOF SURFACE.

WIRE SIZE CALCULATIONS	
AMBIENT TEMPERATURE @ 36°C	
<b>TAG 1: (DC)</b>	
REQUIRED CONDUCTOR AMPACITY (13.66 * 1.25 * 1.25)	= 21.34A
CORRECTED AMPACITY CALCULATION (0.91 * 1 * 40)	= 36.4A
21.34A < 36.4A (#10 AWG THHN/THWN-2)	
<b>TAG 2: (DC)</b>	
REQUIRED CONDUCTOR AMPACITY (13.66 * 1.25 * 1.25)	= 21.34A
CORRECTED AMPACITY CALCULATION (0.91 * 0.8 * 40)	= 29.12A
21.34A < 29.12A (3/4" EMT, #10 AWG THHN/THWN-2, Cu)	
<b>TAG 3: (AC)</b>	
REQUIRED CONDUCTOR AMPACITY (48 * 1 * 1.25)	= 60A
CORRECTED AMPACITY CALCULATION (0.88 * 1 * 85)	= 74.8A
60A < 74.8A (1" EMT, #4 AWG THHN/THWN-2, Cu)	

**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE  
 ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
 COORDINATES: 35.532743, -78.790855  
 APN: 080664011125  
 11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
 13.500kWh ENERGY STORAGE SYSTEM

DC WIRE SIZING CALCULATIONS BASED ON FOLLOWING EQUATIONS
<b>REQUIRED CONDUCTOR AMPACITY:</b> $I_{sc(A)} * \# \text{ OF PARALLEL STRINGS} = \text{MAX CURRENT PER 690.8(A)(1)} * 125\%$ $= \text{MAX CURRENT PER 690.8(B)(1)}$
<b>CORRECTED AMPACITY CALCULATIONS:</b> $\text{DERATED CONDUCTOR AMPACITY PER 690.8(B)(2)} = \text{AMPACITY} * \text{TEMPERATURE DERATE FACTOR} * \text{CONDUIT FILL DERATE}$ $\text{DERATED CONDUCTOR AMPACITY CHECK : MAX CURRENT PER 690.8(B)(1)} < \text{DERATED CONDUCTOR AMPACITY}$
AC WIRE SIZING CALCULATIONS BASED ON FOLLOWING EQUATIONS
<b>REQUIRED CONDUCTOR AMPACITY:</b> $\text{INVERTER OUTPUT CURRENT} * \# \text{ OF INVERTERS} = \text{MAX CURRENT PER 690.8(A)(3)} * 125\%$ $= \text{MAX CURRENT PER 690.8(B)(1)}$
<b>CORRECTED AMPACITY CALCULATIONS:</b> $\text{DERATED CONDUCTOR AMPACITY PER 690.8(B)(2)} = \text{AMPACITY} * \text{TEMPERATURE DERATE FACTOR} * \text{CONDUIT FILL DERATE}$ $\text{DERATED CONDUCTOR AMPACITY CHECK : MAX CURRENT PER 690.8(B)(1)} < \text{DERATED CONDUCTOR AMPACITY}$

<b>PROJECT ID</b>	AUR-1001058
<b>DATE</b>	7/19/2024
<b>CREATED BY</b>	VK
<b>SIGNATURE</b>	

**ELECTRICAL CALCULATIONS**  
**PV-4.1**



**WARNING**

**ELECTRIC SHOCK HAZARD**

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT

LABEL LOCATION  
AC DISCONNECT, POINT OF INTERCONNECTION  
PER CODE: NEC 690.13

**WARNING:PHOTOVOLTAIC POWER SOURCE**


LABEL LOCATION  
CONDUIT, INVERTER DC DISCONNECT  
PER CODE: NEC 690.31(G)(3)

**PHOTOVOLTAIC AC DISCONNECT**

LABEL LOCATION  
AC DISCONNECT, POINT OF INTERCONNECTION  
PER CODE: NEC 690.13(B)

**SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN**

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



LABEL LOCATION  
AC DISCONNECT, INVERTER DC DISCONNECT, POINT OF INTERCONNECTION  
PER CODE: NEC 690.56(C)(1)(a)

**RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM**

LABEL LOCATION  
INVERTER DC DISCONNECT  
PER CODE: NEC 690.56(C)(3)

**PHOTOVOLTAIC SYSTEM AC DISCONNECT SWITCH**

RATED AC OPERATING CURRENT **48.00** AMPS AC  
AC NOMINAL OPERATING VOLTAGE **240** VAC

LABEL LOCATION  
AC DISCONNECT, POINT OF INTERCONNECTION  
PER CODE: NEC 690.54

**WARNING**

**TRI POWER SOURCE SECOND SOURCE IS PHOTOVOLTAIC SYSTEM THIRD SOURCE IS BATTERY BACKUP SYSTEM.**

LABEL LOCATION  
POINT OF INTERCONNECTION  
PER CODE: NEC 705.12(B)(3)


INVERTER-1

RATED MAXIMUM POWER-POINT CURRENT (I <sub>mp</sub> )	38.94	A
RATED MAXIMUM POWER-POINT VOLTAGE (V <sub>mp</sub> )	327.4	V
MAXIMUM SYSTEM VOLTAGE (V <sub>oc</sub> )	421.68	V
MAXIMUM CIRCUIT CURRENT (I <sub>sc</sub> )	51.22	A

LABEL LOCATION  
INVERTER DC DISCONNECT  
PER CODE: NEC 690.53

**CAUTION: MULTIPLE SOURCES OF POWER**

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN

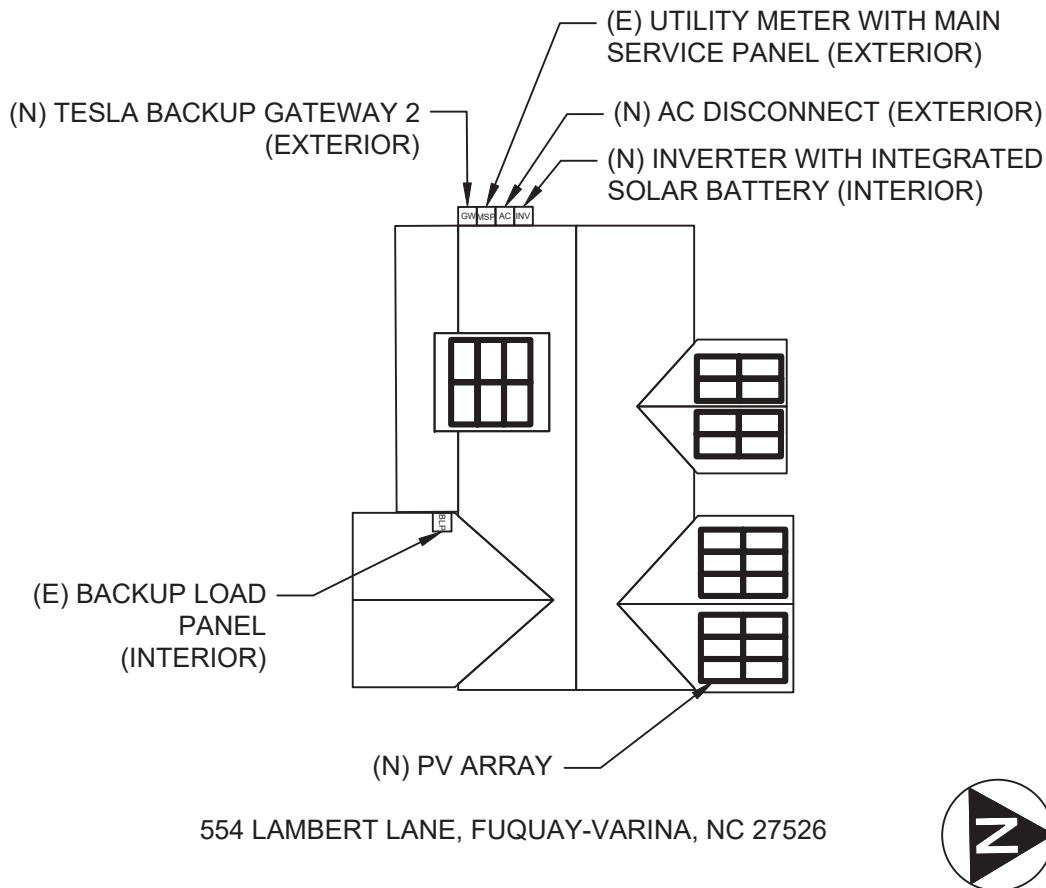

554 LAMBERT LANE, FUQUAY-VARINA, NC 27526

- NOTES**
1. PLACARDS SHALL MEET THE REQUIREMENTS OF ARTICLES 690 AND 705, UNLESS OTHERWISE SPECIFIED PER LOCAL AHJ REQUIREMENTS.
  2. PLACARDS SHALL MEET THE REQUIREMENTS OF SECTION 110.21(B) AS REQUIRED AND SHALL COMPLY WITH ANSI Z535.4-2011, PRODUCT SAFETY SIGNS AND LABELS.
  3. PLACARDS SHALL BE PERMANENTLY AFFIXED TO THE EQUIPMENT OR WIRING METHOD.
  4. PLACARDS SHALL BE SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED AND SHALL NOT BE HANDWRITTEN.
  5. PLACARDS SHALL NOT COVER EXISTING MANUFACTURER LABELS.
  6. WARNING SIGNAGE TEXT SHALL BE MINIMUM 3/8" TALL.

LABEL LOCATION  
SERVICE PANEL  
PER CODE: NEC 705.10

**CONTRACTOR INFORMATION**



YES SOLAR SOLUTIONS  
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
PHONE NUMBER: (919) 459-4155  
LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
LICENSE TYPE: NC GC/ELECTRIC

**CUSTOMER INFORMATION**

NAME: LLOYD RESIDENCE  
ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
COORDINATES: 35.532743, -78.790855  
APN: 080664011125  
11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1001058
DATE	7/19/2024
CREATED BY	VK
SIGNATURE	
PLACARDS	
PV-5	

# Q.TRON BLK M-G2+ SERIES



405-430 Wp | 108 Cells  
22.0% Maximum Module Efficiency

MODEL **Q.TRON BLK M-G2+**



### High performance Qcells N-type solar cells

Q. ANTUM NEO Technology with optimized module layout boosts module efficiency up to 22.0%.



### A reliable investment

Inclusive 25-year product warranty and 25-year linear performance warranty<sup>1</sup>.



### Enduring high performance

Long-term yield security with Anti LeTID Technology, Anti PID Technology<sup>2</sup>, Hot-Spot Protect.



### Extreme weather rating

High-tech aluminium alloy frame, certified for high snow (8100 Pa) and wind loads (3600 Pa).



### Innovative all-weather technology

Optimal yields, whatever the weather with excellent low-light and temperature behaviour.



### The most thorough testing programme in the industry

Qcells is the first solar module manufacturer to pass the most comprehensive quality programme in the industry: The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.

<sup>1</sup> See data sheet on rear for further information.  
<sup>2</sup> APT test conditions according to IEC/TS 62804-12:015, method A (-1500 V, 96 h)

The ideal solution for:




Rooftop arrays on residential buildings



## Q.TRON BLK M-G2+ SERIES

### Mechanical Specification

Format	67.8 in × 44.6 in × 1.18 in (including frame) (1722 mm × 1134 mm × 30 mm)
Weight	46.7 lbs (21.2 kg)
Front Cover	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Black anodised aluminium
Cell	6 × 18 monocrystalline Q. ANTUM NEO solar half cells
Junction box	2.09-3.98 in × 1.26-2.36 in × 0.59-0.71 in (53-101 mm × 32-60 mm × 15-18 mm), Protection class IP67, with bypass diodes
Cable	4 mm <sup>2</sup> Solar cable; (+) ≥ 68.9 in (1750mm), (-) ≥ 68.9 in (1750mm)
Connector	Stäubli MC4; IP68

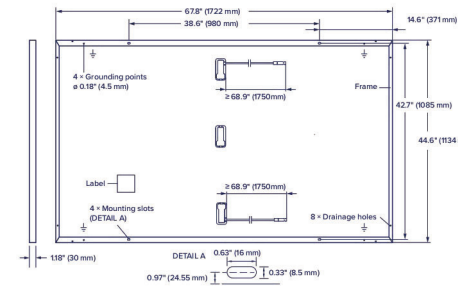


### Electrical Characteristics

POWER CLASS		405	410	415	420	425	430
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC <sup>1</sup> (POWER TOLERANCE +5 W/-0 W)							
Power at MPP <sup>1</sup>	P <sub>MPP</sub> [W]	405	410	415	420	425	430
Short Circuit Current <sup>1</sup>	I <sub>SC</sub> [A]	13.33	13.41	13.49	13.58	13.66	13.74
Open Circuit Voltage <sup>1</sup>	V <sub>OC</sub> [V]	37.91	38.19	38.47	38.75	39.03	39.32
Current at MPP	I <sub>MPP</sub> [A]	12.69	12.76	12.83	12.91	12.98	13.05
Voltage at MPP	V <sub>MPP</sub> [V]	31.93	32.13	32.34	32.54	32.74	32.94
Efficiency <sup>1</sup>	η [%]	≥20.7	≥21.0	≥21.3	≥21.5	≥21.8	≥22.0
MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT <sup>2</sup>							
Power at MPP	P <sub>MPP</sub> [W]	306.1	309.9	313.7	317.5	321.2	325.0
Short Circuit Current	I <sub>SC</sub> [A]	10.74	10.81	10.87	10.94	11.00	11.07
Open Circuit Voltage	V <sub>OC</sub> [V]	35.96	36.23	36.50	36.77	37.04	37.31
Current at MPP	I <sub>MPP</sub> [A]	9.98	10.04	10.10	10.15	10.21	10.27
Voltage at MPP	V <sub>MPP</sub> [V]	30.66	30.87	31.07	31.26	31.46	31.65

<sup>1</sup> Measurement tolerances P<sub>MPP</sub> ±3%; I<sub>SC</sub>, V<sub>OC</sub> ±5% at STC: 1000 W/m<sup>2</sup>, 25 ± 2 °C, AM 1.5 according to IEC 60904-3 • <sup>2</sup> 800 W/m<sup>2</sup>, NMOT, spectrum AM 1.5

### Qcells PERFORMANCE WARRANTY

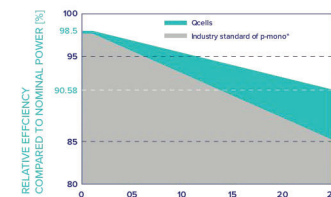


At least 98.5% of nominal power during first year. Thereafter max. 0.33% degradation per year. At least 95.53% of nominal power up to 10 years. At least 90.58% of nominal power up to 25 years.

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Qcells sales organisation of your respective country.

<sup>1</sup> Standard terms of guarantee for the 5 PV companies with the highest production capacity in 2021 (February 2021)

### PERFORMANCE AT LOW IRRADIANCE

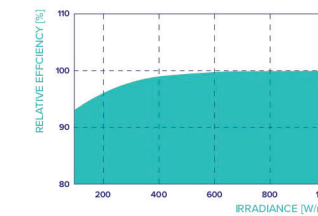

Typical module performance under low irradiance conditions in comparison to STC conditions (25 °C, 1000 W/m<sup>2</sup>).

### TEMPERATURE COEFFICIENTS

Temperature Coefficient of I <sub>SC</sub>	α [%/K]	+0.04	Temperature Coefficient of V <sub>OC</sub>	β [%/K]	-0.24
Temperature Coefficient of P <sub>MPP</sub>	γ [%/K]	-0.30	Nominal Module Operating Temperature	NMOT [°F]	109 ± 5.4 (43 ± 3 °C)

### Properties for System Design

Maximum System Voltage	V <sub>sys</sub> [V]	1000 (IEC)/1000 (UL)	PV module classification	Class II
Maximum Series Fuse Rating	[A DC]	25	Fire Rating based on ANSI/UL 61730	C / TYPE 2
Max. Design Load, Push / Pull <sup>2</sup>	[lbs / ft <sup>2</sup> ]	113 (5400 Pa) / 50 (2400 Pa)	Permitted Module Temperature on Continuous Duty	-40 °F up to +185 °F (-40 °C up to +85 °C)
Max. Test Load, Push / Pull <sup>2</sup>	[lbs / ft <sup>2</sup> ]	169 (8100 Pa) / 75 (3600 Pa)		

<sup>2</sup> See Installation Manual

### Qualifications and Certificates

UL61730-1 & UL61730-2, CE-compliant, Quality Controlled PV - TÜV Rheinland, IEC 61215:2016, IEC 61730:2016, U.S. Patent No. 9,893,215 (solar cells).



<sup>1</sup> Contact your Qcells Sales Representative for details regarding the module's eligibility to be Buy American Act (BAA) compliant.

Qcells pursues minimizing paper output in consideration of the global environment.

Note: Installation instructions must be followed. Contact our technical service for further information on approved installation of this product.  
Hanwha Q CELLS America Inc. 400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA | TEL: +1 949 748 59 96 | EMAIL: hqg-inquiry@qcells.com | WEB: www.qcells.com



Specifications subject to technical changes © Qcells QTRON\_BLK\_M-G2+\_series\_405-430\_DA\_202312\_Rev02\_NA

## CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS  
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
PHONE NUMBER: (919) 459-4155  
LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
LICENSE TYPE: NC GC/ELECTRIC

## CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE  
ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
COORDINATES: 35.532743, -78.790855  
APN: 080664011125  
11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1001058

DATE 7/19/2024

CREATED BY VK

SIGNATURE

MODULE SPEC SHEET  
SS



## Powerwall 3

### Power Everything

Powerwall 3 is a fully **integrated solar and battery system** designed to accelerate the transition to sustainable energy. Customers can receive whole home backup, cost savings, and energy independence by producing and consuming their own energy while participating in grid services. Once installed, customers can manage their system using the Tesla App to customize system behavior to meet their energy goals.

Powerwall 3 achieves this by supporting up to 20 kW DC of solar and providing 11.5 kW AC of continuous power per unit. It has the ability to start heavy loads up to 185 A LRA, meaning a single unit can support the power needs of most homes. Powerwall 3 is designed for mass production, fast and efficient installations, easy system expansion, and simple connection to any electrical service.



## Powerwall 3 Technical Specifications

System Technical Specifications	Model Number	1707000-xx-y
	Nominal Grid Voltage (Input & Output)	120/240 VAC
	Grid Type	Split phase
	Frequency	60 Hz
	Overcurrent Protection Device	Configurable up to 60 A
	Solar to Battery to Home/Grid Efficiency	89% <sup>1,2</sup>
	Solar to Home/Grid Efficiency	97.5% <sup>3</sup>
	Supported Islanding Devices	Backup Gateway 2, Backup Switch
	Connectivity	Wi-Fi (2.4 and 5 GHz), Dual-port switched Ethernet, Cellular (LTE/4G <sup>4</sup> )
	Hardware Interface	Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters
	AC Metering	Revenue Grade (+/- 0.5%)
	Protections	Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters
	Customer Interface	Tesla Mobile App
Warranty	10 years	

Solar Technical Specifications	Maximum Solar STC Input	20 kW
	Withstand Voltage	600 V DC
	PV DC Input Voltage Range	60 — 550 V DC
	PV DC MPPT Voltage Range	150 — 480 V DC
	MPPTs	6
	Maximum Current per MPPT ( $I_{mp}$ )	13 A <sup>5</sup>
	Maximum Short Circuit Current per MPPT ( $I_{sc}$ )	15 A <sup>5</sup>

Battery Technical Specifications	Nominal Battery Energy	13.5 kWh AC <sup>2</sup>
	Maximum Continuous Discharge Power	11.5 kW AC
	Maximum Continuous Charge Power	5 kW AC
	Output Power Factor Rating	0 - 1 (Grid Code configurable)
	Maximum Continuous Current	48 A
	Maximum Output Fault Current	10 kA
	Load Start Capability (1 s)	185 A LRA
	Power Scalability	Up to 4 Powerwall 3 units supported

<sup>1</sup>Typical solar shifting use case.

<sup>2</sup>Values provided for 25°C (77°F), at beginning of life. 3.3 kW charge/discharge power.

<sup>3</sup>Tested using CEC weighted efficiency methodology.

<sup>4</sup>Cellular connectivity subject to network service coverage and signal strength.

<sup>5</sup> Where the DC input current exceeds the MPPT rating, a jumper can be used to combine two MPPTs into a single input to intake DC current up to 26 A  $I_{mp}$  / 30 A  $I_{sc}$ .

## CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 459-4155

LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

## CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE

ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526

COORDINATES: 35.532743, -78.790855

APN: 080664011125

11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1001058

DATE 7/19/2024

CREATED BY VK

SIGNATURE

INVERTER SPEC SHEET  
SS


## Powerwall 3 Technical Specifications

Environmental Specifications	Operating Temperature	-20°C to 50°C (-4°F to 122°F) <sup>6</sup>
	Operating Humidity (RH)	Up to 100%, condensing
	Storage Temperature	-20°C to 30°C (-4°F to 86°F), up to 95% RH, non-condensing, State of Energy (SOE): 25% initial
	Maximum Elevation	3000 m (9843 ft)
	Environment	Indoor and outdoor rated
	Enclosure Rating	NEMA 3R
	Ingress Rating	IPX7 (Battery & Power Electronics) IPX5 (Wiring Compartment)
	Pollution Rating	PD3
	Operating Noise @ 1 m	<50 db(A) typical <62 db(A) maximum

<sup>6</sup> Performance may be de-rated at operating temperatures above 40°C (104°F).

Compliance Information	Certifications	UL 1642, UL 1699B, UL 1741, UL 1741 SA, UL 1741 SB, UL 3741, UL 1973, UL 1998, UL 9540, IEEE 1547-2018, IEEE 1547.1, UN 38.3
	Grid Connection	United States
	Emissions	FCC Part 15 Class B
	Environmental	RoHS Directive 2011/65/EU
	Seismic	AC156, IEEE 693-2005 (high)
	Fire Testing	Meets the unit level performance criteria of UL 9540A

Mechanical Specifications	Dimensions	1099 x 609 x 193 mm (43.25 x 24 x 7.6 in)
	Weight	130 kg (287 lb)
	Mounting Options	Floor or wall mount

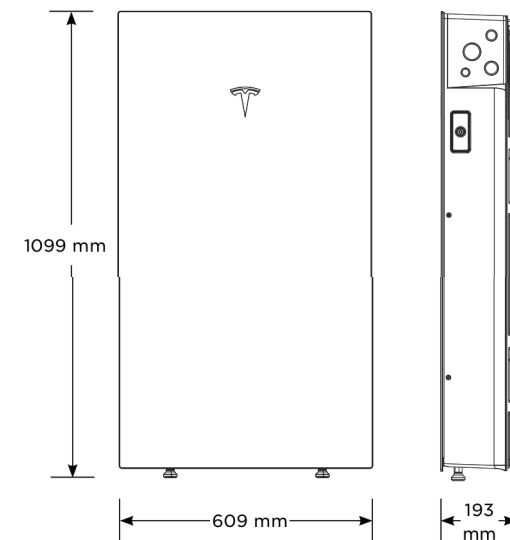

### CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 459-4155

LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

### CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE

ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526

COORDINATES: 35.532743, -78.790855

APN: 080664011125

11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1001058
------------	-------------

DATE	7/19/2024
------	-----------

CREATED BY	VK
------------	----

SIGNATURE	
-----------	--

**INVERTER SPEC SHEET  
SS**

## Backup Gateway 2

Backup Gateway 2 controls connection to the grid when paired with Powerwall 3, automatically detecting outages and providing seamless transition to backup power. Backup Gateway 2 also provides energy metering for solar self-consumption, time-based control, and backup operation.

In this system configuration, Powerwall 3 acts as the Site Controller, with the Backup Gateway 2 Site Controller disabled.

### Performance Specifications

Model Number	1232100-xx-y
AC Voltage (Nominal)	120/240 V
Feed-in Type	Split phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Supply Short Circuit Current	10 kA <sup>8</sup>
Overcurrent Protection Device	100 - 200 A, Service entrance rated <sup>9</sup>
Overvoltage Category	Category IV
Internal Primary AC Meter	Revenue accurate (+/- 0.2%)
Internal Auxiliary AC Meter	Revenue accurate (+/- 2%)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) <sup>10</sup>

User Interface	Tesla App
Operating Modes	Support for solar self-consumption, time-based control, and backup
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200 A 6-space / 12 circuit breakers Siemens QP or Square D HOM breakers rated 10 - 80A or Eaton BR breakers rated 10 - 125A
Warranty	10 years

<sup>10</sup> When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.

<sup>11</sup> The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

### Environmental Specifications


Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

### Compliance Information

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS, CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

### Mechanical Specifications

Dimensions	660 x 411 x 149 mm (26 x 16 x 6 in)
Weight	20.4 kg (45 lb)
Mounting options	Wall mount, Semi-flush mount

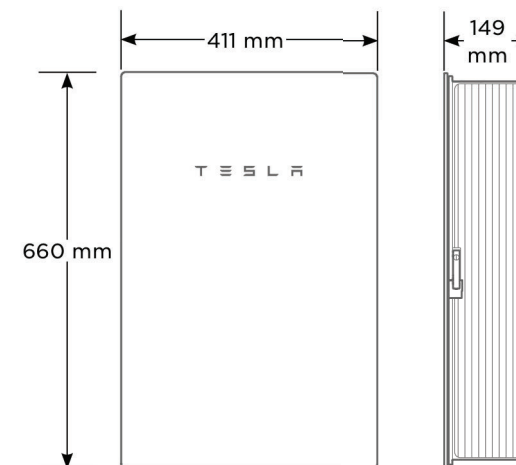

## CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 459-4155

LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

## CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE

ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526

COORDINATES: 35.532743, -78.790855

APN: 080664011125

11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1001058

DATE 7/19/2024

CREATED BY VK

SIGNATURE

GATEWAY SPEC SHEET  
SS



## Solar Shutdown Device Technical Specifications

The Solar Shutdown Device is a Mid-Circuit Interrupter (MCI) and is part of the PV system rapid shutdown (RSD) function in accordance with Article 690 of the applicable NEC. When paired with Powerwall 3, solar array shutdown is initiated by any loss of AC power.

Electrical Specifications	Model	MCI-1	MCI-2
	Nominal Input DC Current Rating ( $I_{MP}$ )	12 A	13 A
	Maximum Input Short Circuit Current ( $I_{SC}$ )	19 A	17 A
	Maximum System Voltage (PVHCS)	600 V DC	1000 V DC <sup>7</sup>
	<sup>7</sup> Maximum System Voltage is limited by Powerwall to 600 V DC.		
RSD Module Performance	Maximum Number of Devices per String	5	5
	Control	Power Line Excitation	Power Line Excitation
	Passive State	Normally Open	Normally Open
	Maximum Power Consumption	7 W	7 W
	Warranty	25 years	25 years
Environmental Specifications	Operating Temperature	-40°C to 50°C (-40°F to 122°F)	-45°C to 70°C (-49°F to 158°F)
	Storage Temperature	-30°C to 70°C (-22°F to 158°F)	-30°C to 70°C (-22°F to 158°F)
	Enclosure Rating	NEMA 4X / IP65	NEMA 4X / IP65
Mechanical Specifications	Electrical Connections	MC4 Connector	MC4 Connector
	Housing	Plastic	Plastic
	Dimensions	125 x 150 x 22 mm (5 x 6 x 1 in)	173 x 45 x 22 mm (6.8 x 1.8 x 1 in)
	Weight	350 g (0.77 lb)	120 g (0.26 lb)
	Mounting Options	ZEP Home Run Clip M4 Screw (#10) M8 Bolt (5/16") Nail / Wood screw	Wire Clip
Compliance Information	Certifications	UL 1741 PVRSE, UL 3741, PVRSA (Photovoltaic Rapid Shutdown Array)	
	RSD Initiation Method	External System Shutdown Switch or Powerwall 3 Enable Switch	

### UL 3741 PV Hazard Control (and PVRSA) Compatibility

The following categories of solar module meet the UL 3741 PVHCS listing when installed with Powerwall 3 and Solar Shutdown Devices.

Tesla Solar Roof	<a href="#">PV Hazard Control System: BIPV compliance document</a>
Tesla or Hanwha (Q.Peak Duo BLK or BLK-G6+) Modules certified for use with ZEP racking	<a href="#">PV Hazard Control System: ZS PVHCS compliance document</a>
Other module and racking combinations	<a href="#">PV Hazard Control System: Generic PV Array compliance document</a>

## CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 459-4155

LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

## CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE

ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526

COORDINATES: 35.532743, -78.790855

APN: 080664011125

11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1001058

DATE 7/19/2024

CREATED BY VK

SIGNATURE

RAPID SHUTDOWN SPEC SHEET  
SS

DESCRIPTION:  
**SNAPNRACK, FLASHED L FOOT**


DRAWN BY:  
M.Watkins



PART NUMBER(S):  
**242-92047, 242-92048, 242-92050, 242-92051**

REVISION:  
**A**

595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA  
PHONE (415) 580-6900 • FAX (415) 580-6902  
THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.

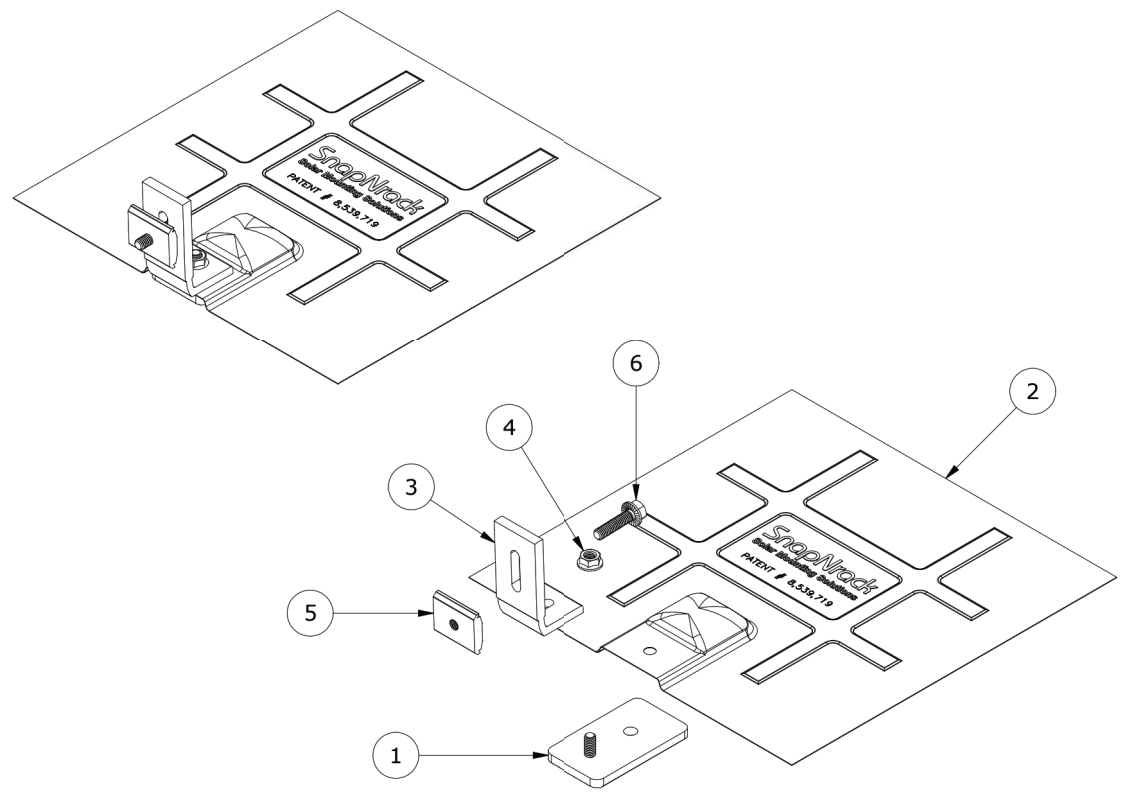

PARTS LIST		
ITEM	QTY	DESCRIPTION
1	1	SNAPNRACK, L FOOT BASE, MILL
2	1	SNAPNRACK, L FOOT FLASHING, 12IN X 12IN, BLACK GALV
3	1	SNAPNRACK L FOOT, COMPOSITION 92DEG, CLEAR / BLACK
4	1	NUT, FLANGE, SERRATED, 5/16IN-18, SS
5	1	SNAPNRACK CHANNEL NUT 5/16IN-18
6	1	BOLT, FLANGED HEX, 5/16IN-18 X 1-1/4IN, SS

MATERIALS:	6000 SERIES ALUMINUM, STAINLESS STEEL	OPTIONS:
DESIGN LOAD (LBS):	309 UP, 1469 DOWN, 251 SIDE	CLEAR / BLACK ANODIZED
ULTIMATE LOAD (LBS):	928 UP, 4406 DOWN, 754 SIDE	GALV STEEL / ALUM FLASHING
TORQUE SPECIFICATION:	10+ LB-FT	
CERTIFICATION:	UL 2703, FILE E359313	
WEIGHT (LBS):	0.90 - 1.25	

DESCRIPTION:  
**SNAPNRACK, FLASHED L FOOT**


DRAWN BY:  
M.Watkins



PART NUMBER(S):  
**242-92047, 242-92048, 242-92050, 242-92051**

REVISION:  
**A**

595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA  
PHONE (415) 580-6900 • FAX (415) 580-6902  
THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.

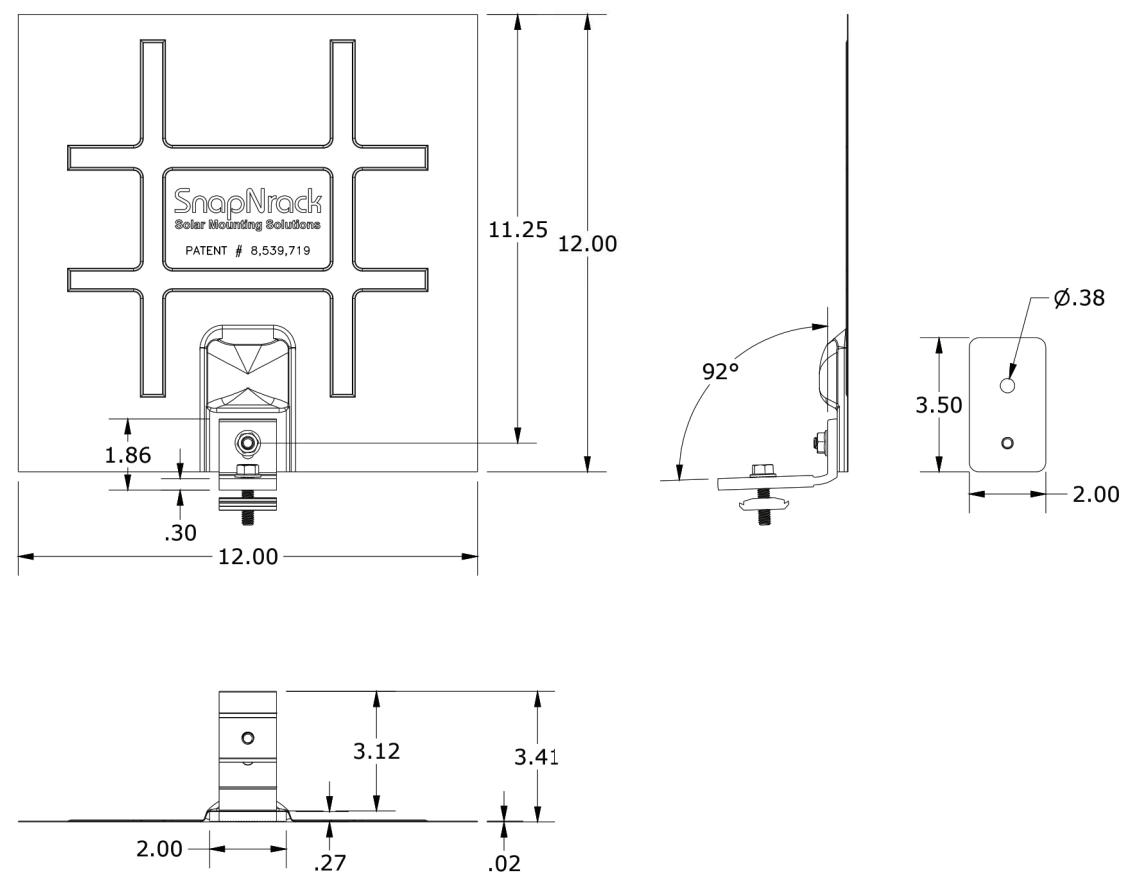

FLASHED L FOOT PROPERTIES		
SKU	FLASHING MATERIAL	L FOOT FINISH
242-92047	SILVER ALUMINUM	CLEAR
242-92048	BLACK ALUMINUM	BLACK
242-92050	BLACK GALV STEEL	CLEAR
242-92051	BLACK GALV STEEL	BLACK

ALL DIMENSIONS IN INCHES

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS  
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
PHONE NUMBER: (919) 459-4155  
LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE  
ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
COORDINATES: 35.532743, -78.790855  
APN: 080664011125  
11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM


PROJECT ID	AUR-1001058
DATE	7/19/2024
CREATED BY	VK
SIGNATURE	

MOUNT SPEC SHEET  
SS



# Ultra Rail

UR-40  
UR-60

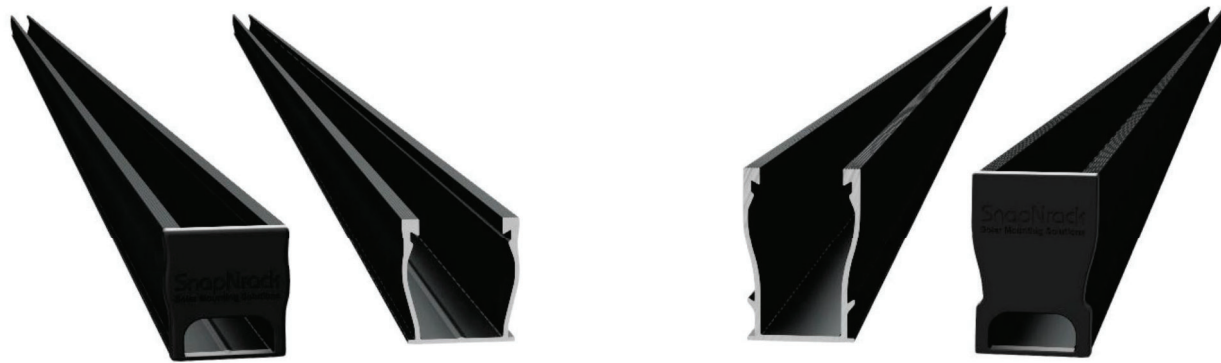

## The Ultimate Value in Rooftop Solar



Industry leading Wire Management Solutions



Mounts available for all roof types



Single Tool Installation



All SnapNrack Module Clamps & Accessories are compatible with both rail profiles

## Start Installing Ultra Rail Today


**RESOURCES** [snapnrack.com/resources](http://snapnrack.com/resources)  
**DESIGN** [snapnrack.com/configurator](http://snapnrack.com/configurator)  
**WHERE TO BUY** [snapnrack.com/where-to-buy](http://snapnrack.com/where-to-buy)

## SnapNrack Ultra Rail System

A sleek, straightforward rail solution for mounting solar modules on all roof types. Ultra Rail features two rail profiles; UR-40 is a lightweight rail profile that is suitable for most geographic regions and maintains all the great features of SnapNrack rail, while UR-60 is a heavier duty rail profile that provides a larger rail channel and increased span capabilities. Both are compatible with all existing mounts, module clamps, and accessories for ease of install.

### The Entire System is a Snap to Install

- New Ultra Rail Mounts include snap-in brackets for attaching rail
- Compatible with all the SnapNrack Mid Clamps and End Clamps customers love
- Universal End Clamps and snap-in End Caps provide a clean look to the array edge

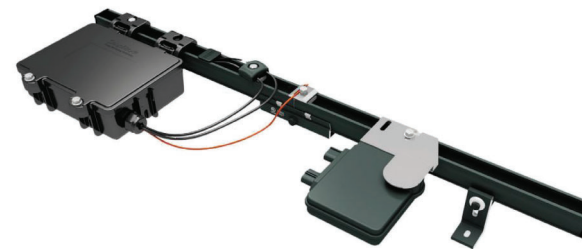

### Unparalleled Wire Management

- Open rail channel provides room for running wires resulting in a long-lasting quality install
- Industry best wire management offering includes Junction Boxes, Universal Wire Clamps, MLPE Attachment Kits, and Conduit Clamps
- System is fully bonded and listed to UL 2703 Standard

### Heavy Duty UR-60 Rail

- UR-60 rail profile provides increased span capabilities for high wind speeds and snow loads
- Taller, stronger rail profile includes profile-specific rail splice and end cap
- All existing mounts, module clamps, and accessories are retained for the same great install experience



## Quality. Innovative. Superior.

SnapNrack Solar Mounting Solutions are engineered to optimize material use and labor resources and improve overall installation quality and safety.

877-732-2860 [www.snapnrack.com](http://www.snapnrack.com) [contact@snapnrack.com](mailto:contact@snapnrack.com)

© 2019 by SnapNrack Solar Mounting Solutions. All rights reserved.

### CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS  
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513  
PHONE NUMBER: (919) 459-4155  
LICENSE NUMBER: NC GC #67356 ; NC ELECTRIC #U.32326  
LICENSE TYPE: NC GC/ELECTRIC

### CUSTOMER INFORMATION

NAME: LLOYD RESIDENCE  
ADDRESS: 554 LAMBERT LANE, FUQUAY-VARINA, NC 27526  
COORDINATES: 35.532743, -78.790855  
APN: 080664011125  
11.050kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM  
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1001058
DATE	7/19/2024
CREATED BY	VK
SIGNATURE	

RAIL SPEC SHEET  
SS