

# PHOTOVOLTAIC ROOF MOUNT SYSTEM

(E) 15 + (N) 20 MODULES-ROOF MOUNTED - 12.975 kW DC, 9.400 kW AC

308 W E ST, ERWIN, NC 28339




TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	

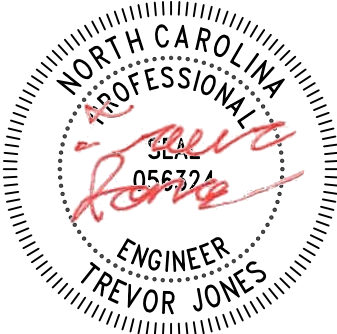

STRUCTURAL ONLY  
04/29/2025

PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE  
  
308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME

COVER SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-1

## PROJECT DATA

PROJECT ADDRESS: 308 W E ST,  
ERWIN, NC 28339

OWNER: JAMES BRADLEY

DESIGNER: ESR

SCOPE: (N) 8.100 kW DC ROOF MOUNT  
SOLAR PV SYSTEM WITH  
(N) 20 JA SOLAR: JAM54S31-405/MR 405W  
PV MODULES WITH  
(N) 20 ENPHASE IQ8PLUS-72-2-US 290W  
MICRO INVERTERS EQUIPPED WITH  
RAPID SHUTDOWN

EXISTING: (E) 4.875 kW DC ROOF MOUNT  
SOLAR PV SYSTEM WITH  
(E) 15 TRINA SOLAR: TSM-325DD06M.05(II)  
325W PV MODULES WITH  
(E) 15 ENPHASE IQ7-60-2-US 240W MICRO  
INVERTERS EQUIPPED WITH RAPID  
SHUTDOWN

AUTHORITIES HAVING JURISDICTION:  
BUILDING: HARNETT COUNTY  
ZONING: HARNETT COUNTY  
UTILITY: DUKE ENERGY PROGRESS

## SHEET INDEX

PV-1 COVER SHEET  
PV-2 SITE PLAN  
PV-3 ROOF PLAN & MODULES  
PV-4 ELECTRICAL PLAN  
PV-5 STRUCTURAL DETAIL  
PV-6 ELECTRICAL LINE DIAGRAM  
PV-7 WIRING CALCULATIONS  
PV-8 LABELS  
PV-9+ EQUIPMENT SPECIFICATIONS

## SIGNATURE


## GENERAL NOTES

- ALL COMPONENTS ARE UL LISTED AND CEC CERTIFIED, WHERE WARRANTED.
- THE SOLAR PV SYSTEM WILL BE INSTALLED IN ACCORDANCE WITH ARTICLE 690 OF THE NEC 2017.
- THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION.
- ALL CONDUCTORS OF A CIRCUIT, INCLUDING THE EGC, MUST BE INSTALLED IN THE SAME RACEWAY, OR CABLE, OR OTHERWISE RUN WITH THE PV ARRAY CIRCUIT CONDUCTORS WHEN THEY LEAVE THE VICINITY OF THE PV ARRAY.
- WHERE METALLIC CONDUIT CONTAINING DC CONDUCTORS IS USED INSIDE THE BUILDING, IT SHALL BE IDENTIFIED AS "CAUTION: SOLAR CIRCUIT" EVERY 10FT.
- HEIGHT OF THE AC DISCONNECT SHALL NOT EXCEED 6'-7" PER NEC CODE 240.24.
- A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH CEC 690.47 AND 250.50 THROUGH 60 AND 250-166 SHALL BE PROVIDED. PER NEC GROUNDING ELECTRODE SYSTEM OF EXISTING BUILDING MAY BE USED AND BONDED TO THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE OR INADEQUATE A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT. GROUND ROD WITH ACORN CLAMP. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN #8 AWG AND NO LARGER THAN #6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM.
- PHOTOVOLTAIC MODULES ARE TO BE CONSIDERED NON-COMBUSTIBLE.
- PHOTOVOLTAIC INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING. MECHANICAL, OR BUILDING ROOF VENTS.
- ALL WIRING MUST BE PROPERLY SUPPORTED BY DEVICES OR MECHANICAL MEANS DESIGNED AND LISTED FOR SUCH USE. WIRING MUST BE PERMANENTLY AND COMPLETELY HELD OFF THE ROOF SURFACE.
- ALL SINAGE TO BE PLACED IN ACCORDANCE WITH THE LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SINAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.
- INVERTER(S) USED IN UNGROUNDED SYSTEM SHALL BE UL 1741 LISTED.
- THE INSTALLATION OF EQUIPMENT AND ALL ASSOCIATED WIRING AND INTERCONNECTION SHALL BE PERFORMED ONLY BY QUALIFIED PERSONS [NEC 690.4(C)]
- ALL OUTDOOR EQUIPMENT SHALL BE NEMA 3R RATED (OR BETTER), INCLUDING ALL ROOF MOUNTED TRANSITION BOXES AND SWITCHES.
- ALL EQUIPMENT SHALL BE PROPERLY GROUNDED AND BONDED IN ACCORDANCE WITH NEC ARTICLE 250.
- SYSTEM GROUNDING SHALL BE IN ACCORDANCE WITH NEC 690.41.
- PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION IN ACCORDANCE WITH NEC 690.12
- DISCONNECTING MEANS SHALL BE LOCATED IN A VISIBLE, READILY ACCESSIBLE LOCATION WITHIN THE PV SYSTEM EQUIPMENT OR A MAXIMUM OF 10 FEET AWAY FROM THE SYSTEM [NEC 690.13(A)]
- ALL WIRING METHODS SHALL BE IN ACCORDANCE WITH NEC 690.31
- WORK CLEARANCES AROUND ELECTRICAL EQUIPMENT WILL BE MAINTAINED PER NEC 110.26(A)(1), 110.26(A)(2) AND 110.26(A)(3).
- ROOFTOP MOUNTED PHOTOVOLTAIC PANELS AND MODULES SHALL BE TESTED, LISTED & IDENTIFIED IN ACCORDANCE WITH UL1703
- ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT EXPANSION JOINTS AND ANCHOR CONDUIT RUNS AS REQUIRED PER NEC.

## VICINITY MAP



## HOUSE PHOTO

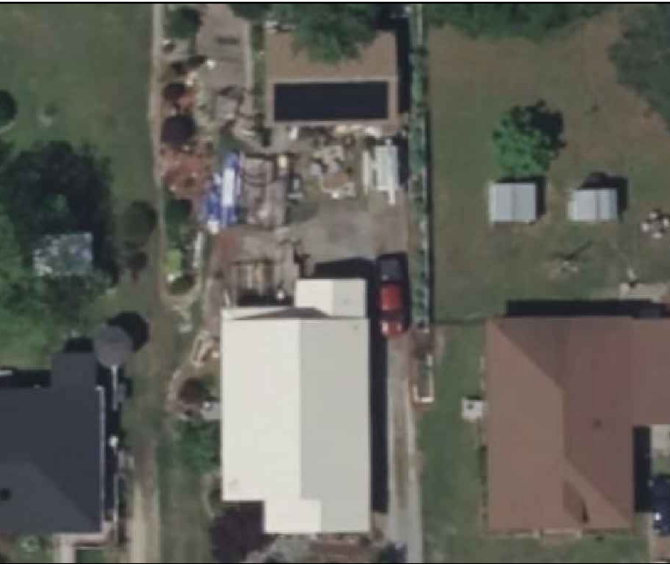

## CODE REFERENCES


2018 NORTH CAROLINA BUILDING CODE  
2018 NORTH CAROLINA RESIDENTIAL CODE  
2018 NORTH CAROLINA FIRE CODE  
2017 NATIONAL ELECTRICAL CODE

PROJECT DESCRIPTION:

(N) 20 X JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
(E) 15 X TRINA SOLAR: TSM-325DD06M.05(II) 325W MONO MODULES  
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES  
DC SYSTEM SIZE: (N) 20 x 405W + (E) 15 X 405W = 9.720 kW DC  
AC SYSTEM SIZE: (N) 20 x 290W + (E) 15 X 240W = 9.400 kW AC

EQUIPMENT SUMMARY  
(N) 20 JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
(N) 20 IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED  
WITH RAPID SHUTDOWN  
(E) 15 TRINA SOLAR: TSM-325DD06M.05(II) 325W MONO MODULES  
(E) 15 ENPHASE IQ7-60-2-US 240W MICRO INVERTERS EQUIPPED  
WITH RAPID SHUTDOWN

(N) ROOF ARRAY AREA #1:- 420.20 SQ FT.



(E) ENPHASE COMBINER BOX  
(E) VISIBLE, LOCKABLE,  
LABELED NON-FUSED AC DISCONNECT (TYP.)

(E) TREE

61.76'

PROPERTY LINE

NOTE: VISIBLE, LOCKABLE, LABELED AC DISCONNECT  
LOCATED WITHIN 10' OF UTILITY METER

(E) 1-STORY NON-HABITABLE  
DETACHED STRUCTURE

(E) (15) TRINA SOLAR: TSM-325DD06M.05(II) 325W  
MONO MODULES WITH  
(E) (15) ENPHASE IQ7-60-2-US 240W  
MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN

(E) FENCE

151.70'

151.50'

1-STORY  
HOUSE

ROOF #1  
(N) (20) JA SOLAR: JAM54S31-405/MR  
405W MONO MODULES WITH ENPHASE  
IQ8PLUS-72-2-US 290W MICRO INVERTERS  
EQUIPPED WITH RAPID SHUTDOWN

(N) ENPHASE COMBINER BOX  
(N) VISIBLE, LOCKABLE,  
LABELED FUSED AC DISCONNECT  
(LOCATED WITHIN 10' OF UTILITY METER)  
(E) UTILITY METER  
(E) MAIN SERVICE PANEL  
(OUTSIDE)  
(E) SUBPANEL  
(INSIDE HOUSE)

EXISTING  
DRIVEWAY

PROPERTY LINE

WEST

64.50'

PROPERTY LINE

DESIGN SPECIFICATION  
OCCUPANCY: II  
CONSTRUCTION: SINGLE-FAMILY  
ZONING: RESIDENTIAL  
GROUND SNOW LOAD: REFER STRUCTURAL LETTER  
WIND EXPOSURE: REFER STRUCTURAL LETTER  
WIND SPEED: REFER STRUCTURAL LETTER



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



STRUCTURAL ONLY  
04/29/2025

PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME

SITE PLAN

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-2

1



SITE PLAN

PV-2

SCALE: 1/16" = 1'-0"

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 20 MODULES  
MODULE TYPE = JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
MODULE WEIGHT = 47.39 LBS / 21.5KG.  
MODULE DIMENSIONS = 67.79" x 44.65" = 21.01 SF

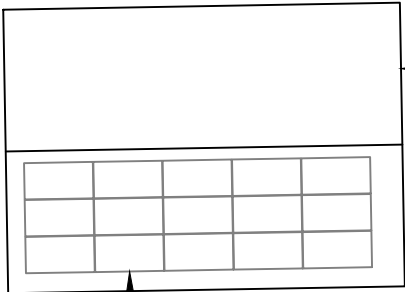

(E) NON-HABITABLE  
DETACHED STRUCTURE

(E) (15) TRINA SOLAR: TSM-325DD06M.05(II) 325W  
MONO MODULES WITH  
(E) (15) ENPHASE IQ7-60-2-US 240W  
MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN

ROOF DESCRIPTION						
ROOF TYPE				ASPHALT SHINGLE		
ROOF	# OF MODULES	ROOF PITCH	AZIMUTH	TRUSS SIZE	TRUSS SPACING	SEAM SPACING
#1	20	27°	89°	2"X4"	24"	9"


ARRAY AREA & ROOF AREA CALC'S (MAIN HOUSE)		
TOTAL PV ARRAY AREA (SQ. FT.)	TOTAL ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)
420.20	1768.24	24



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	

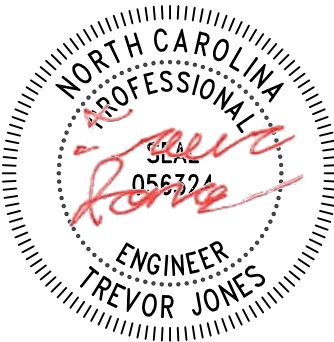

STRUCTURAL ONLY  
04/29/2025

PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME



ROOF PLAN &  
MODULES

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-3

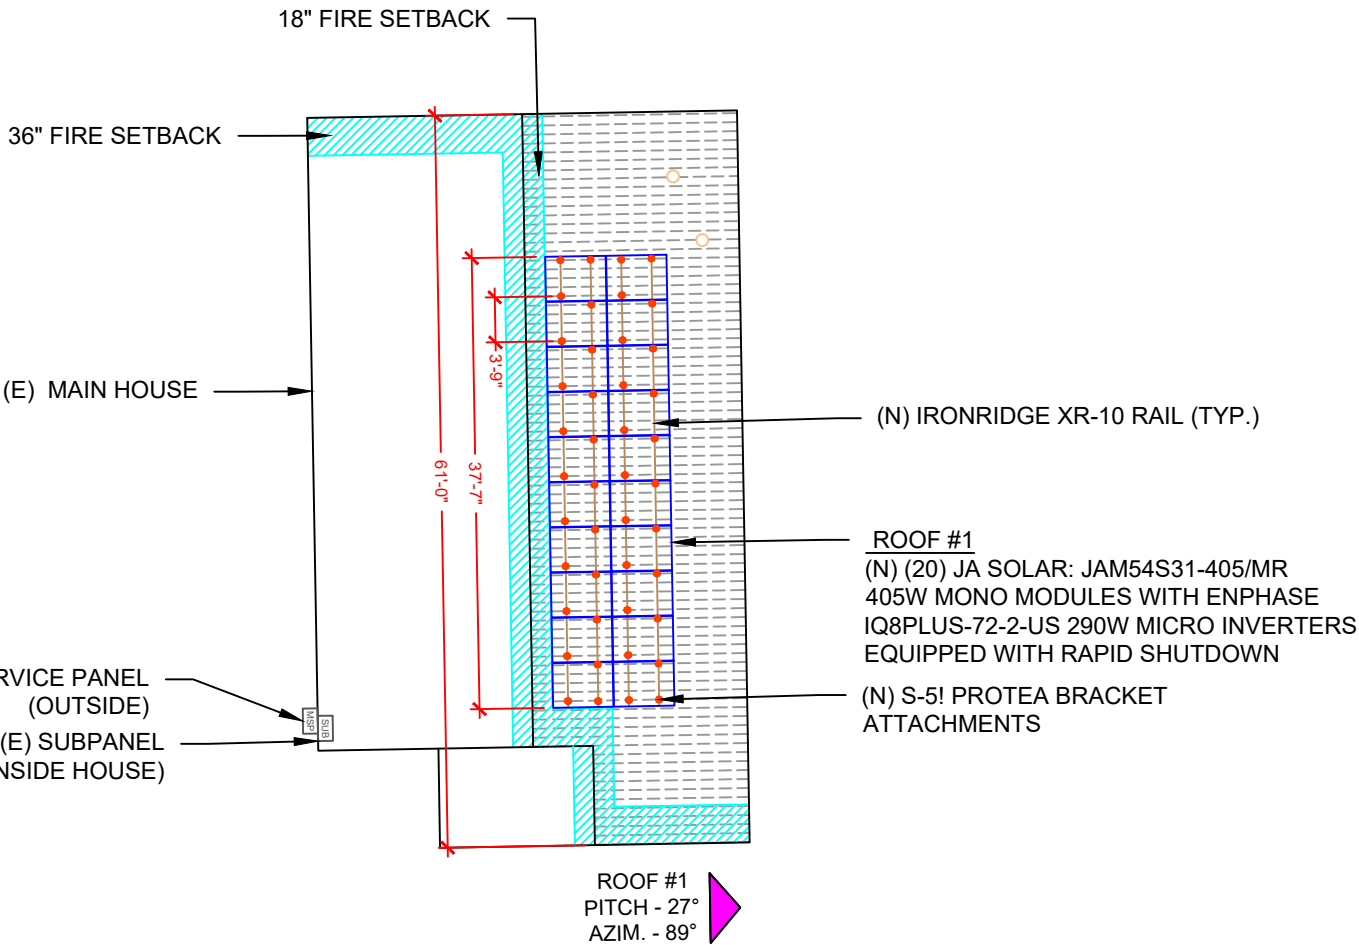



JA SOLAR:  
JAM54S31-405/MR  
405W MODULES

LEGEND

- JUNCTION BOX
- COMBINER BOX
- AC DISCONNECT
- UTILITY METER
- MAIN SERVICE PANEL
- SUBPANEL
- VENT, ATTIC FAN (ROOF OBSTRUCTION)
- ROOF ATTACHMENT
- TRUSS
- CONDUIT

DC SYSTEM SIZE: (N) 20 x 405W + (E) 15X 325W = 14.475 kW DC  
AC SYSTEM SIZE: (N) 20 x 290W + (E) 15 X 240W= 9.400 kW AC  
(N) (20) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
WITH (N) (20) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS  
EQUIPPED WITH RAPID SHUTDOWN  
LOCATED UNDER EACH PANEL (240V)  
(E) (15) TRINA SOLAR: TSM-325DD06M.05(II) 325W MONO MODULES  
WITH (E) (15) ENPHASE IQ7-60-2-US 240W MICRO INVERTERS  
EQUIPPED WITH RAPID SHUTDOWN

CIRCUIT LEGENDS	
<div></div>	(N) CIRCUIT #1
<div></div>	(N) CIRCUIT #2
<div></div>	(E) CIRCUIT #3
<div></div>	(E) CIRCUIT #4

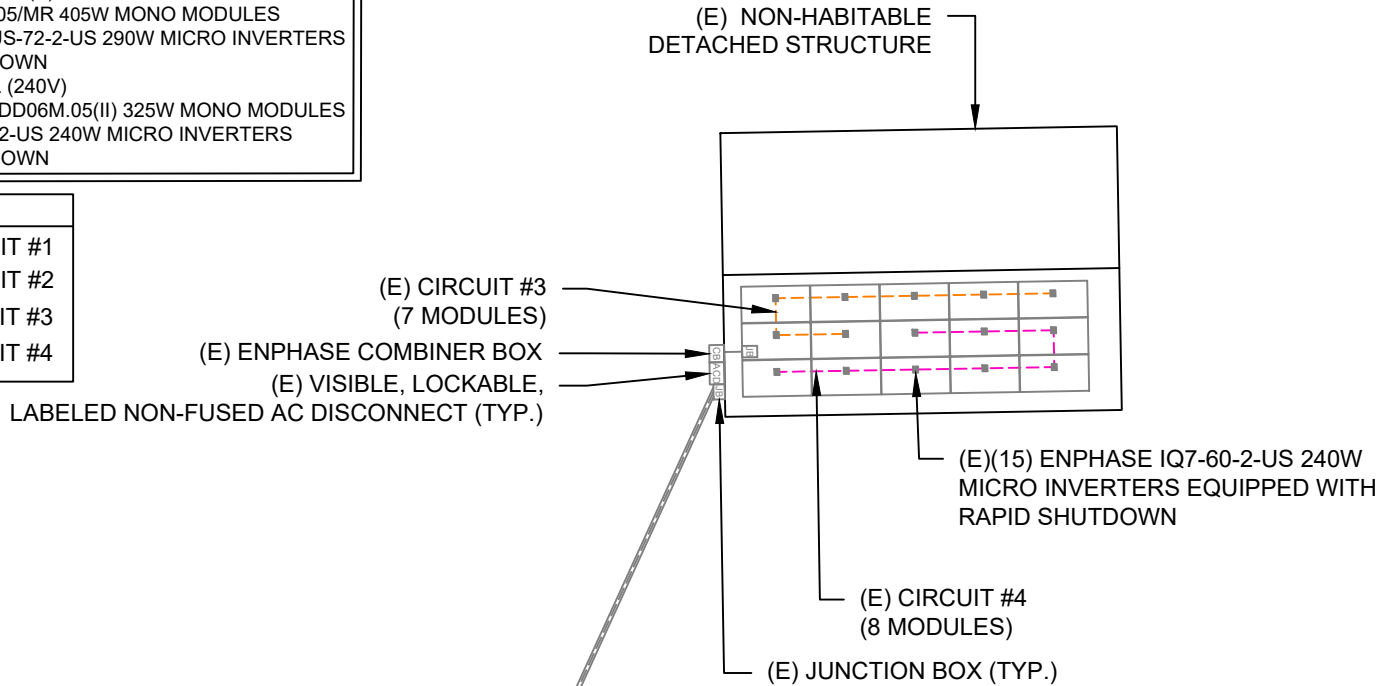

(E) TRENCH TBD ON-SITE

(E) AC TRENCHING

(E) MAIN HOUSE

(N) CIRCUIT #1  
(10 MODULES)

(N) CIRCUIT #2  
(10 MODULES)

(N) (20) ENPHASE IQ8PLUS-72-2-US  
290W MICRO INVERTERS EQUIPPED  
WITH RAPID SHUTDOWN  
LOCATED UNDER EACH PANEL (240V)

(N) ENPHASE COMBINER BOX  
(N) VISIBLE, LOCKABLE,  
LABELED FUSED AC DISCONNECT  
(LOCATED WITHIN 10' OF UTILITY METER)

(E) UTILITY METER  
(E) MAIN SERVICE PANEL  
(OUTSIDE)

(E) SUBPANEL  
(INSIDE HOUSE)

WEST

(N) JUNCTION BOX

(N) CONDUIT

BILL OF MATERIALS	
EQUIPMENT DESCRIPTION	QTY
SOLAR PV MODULES: JA SOLAR: JAM54S31-405/MR 405W MODULE	20
MICRO INVERTERS: ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN	20
JUNCTION BOX: 6"X6"X4" UL LISTED, STEEL WATER TIGHT NEMA TYPE 3R, UL LISTED	1
COMBINER BOX: ENPHASE IQ COMBINER X-IQ-AM1-240-4/4C 120/240VAC, 1ϕ, 3W 125A RATED BUS BAR, NEMA 3R SOLAR LOADS ONLY UL 1741 COMPLIANT	1
20A BREAKER	2
AC DISCONNECT: FUSED AC DISCONNECT, 60A FUSED, (2) 50A FUSES 240V NEMA 3R, UL LISTED	1
IRONRIDGE XR10 RAIL (RAIL 168" (14 FEET) CLEAR) (XR-10-168A)	12
BONDED SPLICE, XR10 (XR10-BOSS-01-M1)	8
UNIVERSAL MODULE CLAMP, CLEAR (UFO-CL-01-A1)	36
END FASTENING OBJECT (END CLAMP, 30-40MM), MILL (UFO-END-01-A1)	8
GROUNDING LUG (XR-LUG-03-A1)	2
S-5! PROTEA BRACKET ATTACHMENTS	48
T-BOLT BONDING HARDWARE (BHW-TB-02-A1) (PRODUCT CODE 590-0116)	48
MICRO INVERTER BONDING HARDWARE T-BOLT (BHW-MI-01-A1) (PRODUCT CODE 270-0152)	20

### LEGEND

<div></div>	- JUNCTION BOX
<div></div>	- COMBINER BOX
<div></div>	- AC DISCONNECT
<div></div>	- UTILITY METER
<div></div>	- MAIN SERVICE PANEL
<div></div>	- SUBPANEL
<div></div>	- VENT, ATTIC FAN (ROOF OBSTRUCTION)
<div></div>	- ROOF ATTACHMENT
<div></div>	- TRUSS
<div></div>	- CONDUIT



### TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	

### PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

### DRAWN BY

ESR

### SHEET NAME

ELECTRICAL PLAN

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

PV-4


1

ELECTRICAL PLAN


PV-4

SCALE: 1/16" = 1'-0"



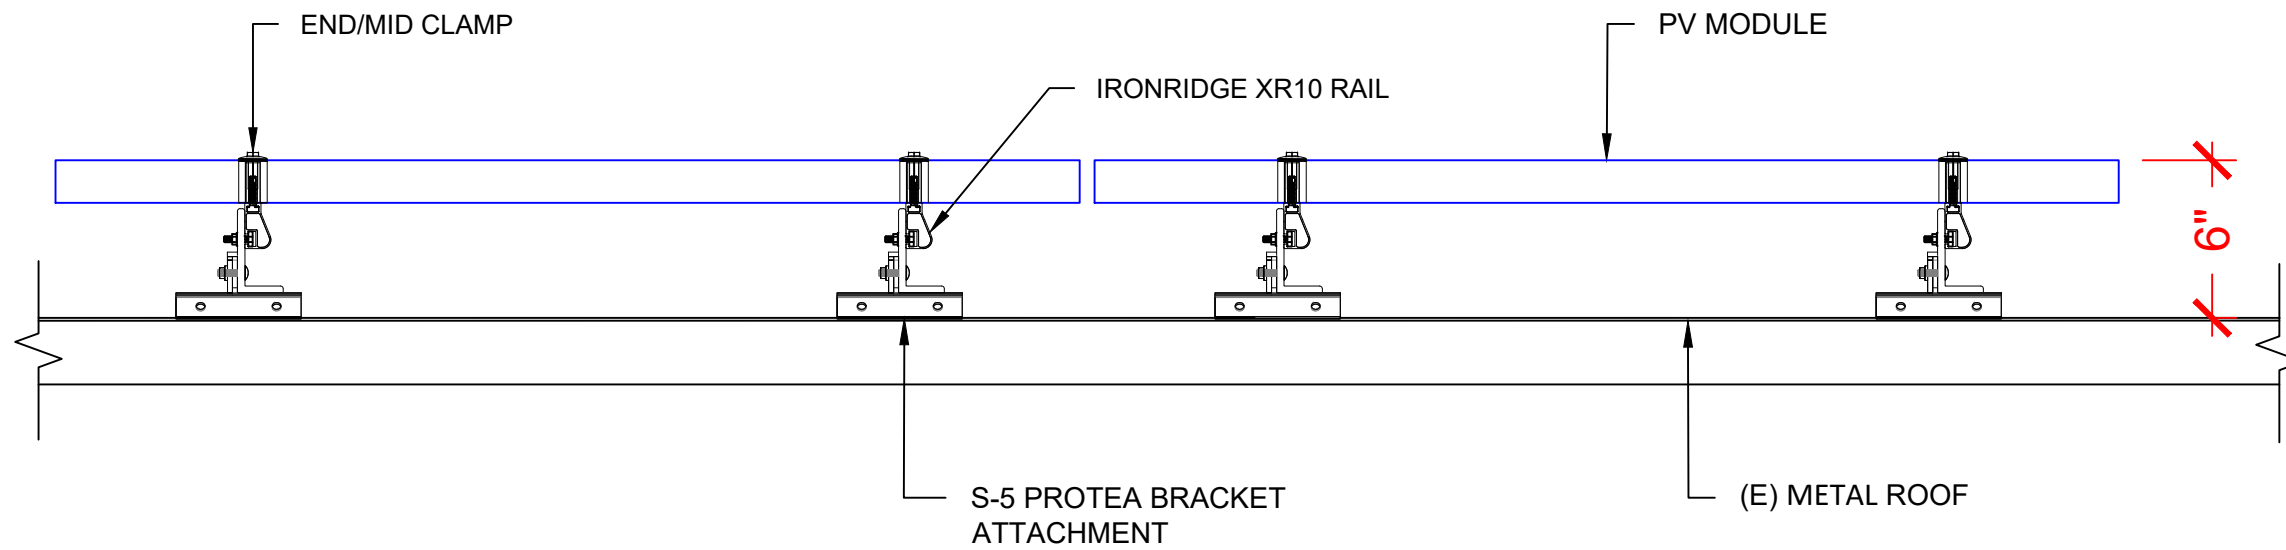

1 ATTACHMENT DETAIL (side view)  
PV-5 SCALE: N.T.S.

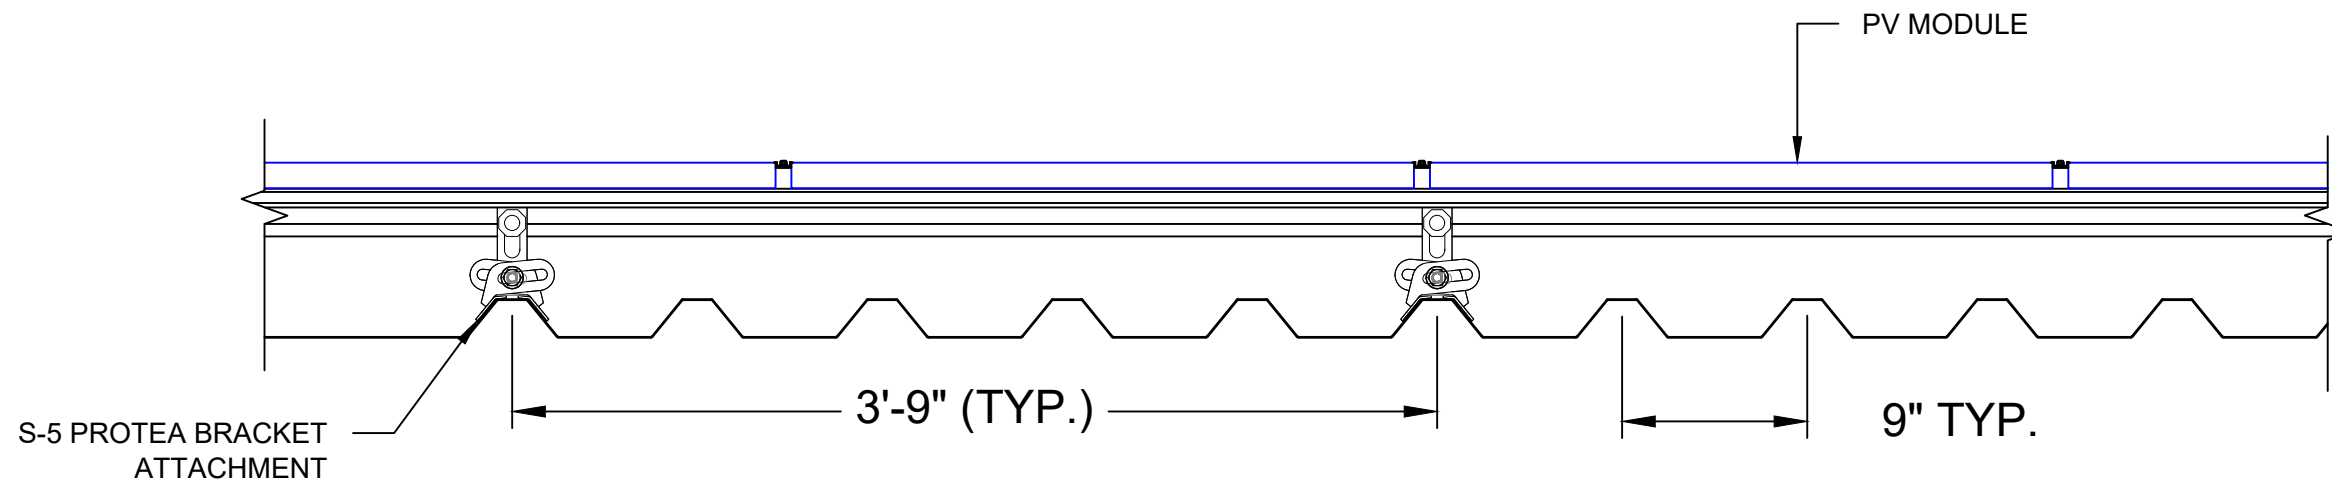

2 ATTACHMENT DETAIL (front view)  
PV-5 SCALE: N.T.S.



**TOP TIER SOLAR SOLUTIONS**  
1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



STRUCTURAL ONLY  
04/29/2025

PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE  
308 W E ST,  
ERWIN, NC 28339

DRAWN BY  
ESR

SHEET NAME  
STRUCTURAL DETAIL

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-5


DC SYSTEM SIZE: (N) 20 x 405W + (E) 15 X 325W = 12.975 kW DC  
AC SYSTEM SIZE: (N) 20 x 290W + (E) 18 X 290W= 9.400 kW AC  
(N) (20) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
WITH (N) (20) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS  
EQUIPPED WITH RAPID SHUTDOWN  
LOCATED UNDER EACH PANEL (240V)  
(E) (15) TRINA SOLAR: TSM-325DD06M.05(II) 325W MONO MODULES WITH  
(E) (15) ENPHASE IQ7-60-2-US 240W MICRO INVERTERS EQUIPPED WITH  
RAPID SHUTDOWN LOCATED UNDER EACH PANEL (240V)  
(02) BRANCH CIRCUITS OF 10 MODULES ARE CONNECTED IN PARALLEL

- INTERCONNECTION NOTES:**
1. INTERCONNECTION SIZING, LIMITATIONS AND COMPLIANCE DETERMINED IN ACCORDANCE WITH [NEC 705.12], AND [NEC 690.59].
  2. GROUND FAULT PROTECTION IN ACCORDANCE WITH [NEC 215.9], [NEC 230.95].
  3. ALL EQUIPMENT TO BE RATED FOR BACKFEEDING.
  4. PV BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUSBAR RELATIVE TO THE MAIN BREAKER.

- DISCONNECT NOTES:**
1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)
  2. AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
  3. DISCONNECT MEANS AND THEIR LOCATION SHALL BE IN ACCORDANCE WITH [NEC 225.31] AND [NEC 225.32].

- GROUNDING & GENERAL NOTES:**
1. PV GROUNDING ELECTRODE SYSTEM NEEDS TO BE INSTALLED IN ACCORDANCE WITH [NEC 690.43]
  2. PV INVERTER IS UNGROUNDED, TRANSFORMER-LESS TYPE.
  3. DC GEC AND AC EGC TO REMAIN UNSPLICED, OR SPLICED TO EXISTING ELECTRODE
  4. ANY EXISTING WIRING INVOLVED WITH PV SYSTEM CONNECTION THAT IS FOUND TO BE INADEQUATE PER CODE SHALL BE CORRECTED PRIOR TO FINAL INSPECTION.
  5. JUNCTION BOX QUANTITIES, AND PLACEMENT SUBJECT TO CHANGE IN THE FIELD - JUNCTION BOX DEPICTED ON ELECTRICAL DIAGRAM REPRESENT WIRE TYPE TRANSITIONS.
  6. AC DISCONNECT NOTED IN EQUIPMENT SCHEDULE OPTIONAL IF OTHER AC DISCONNECTING MEANS IS LOCATED WITHIN 10' OF SERVICE DISCONNECT.
  7. RACEWAYS AND CABLES EXPOSED TO SUNLIGHT ON ROOFTOPS SHOULD BE INSTALLED MORE THAN 7/8" ABOVE THE ROOF USING CONDUIT SUPPORTS.

- RACKING NOTE:**
1. BOND EVERY OTHER RAIL WITH #6 BARE COPPER

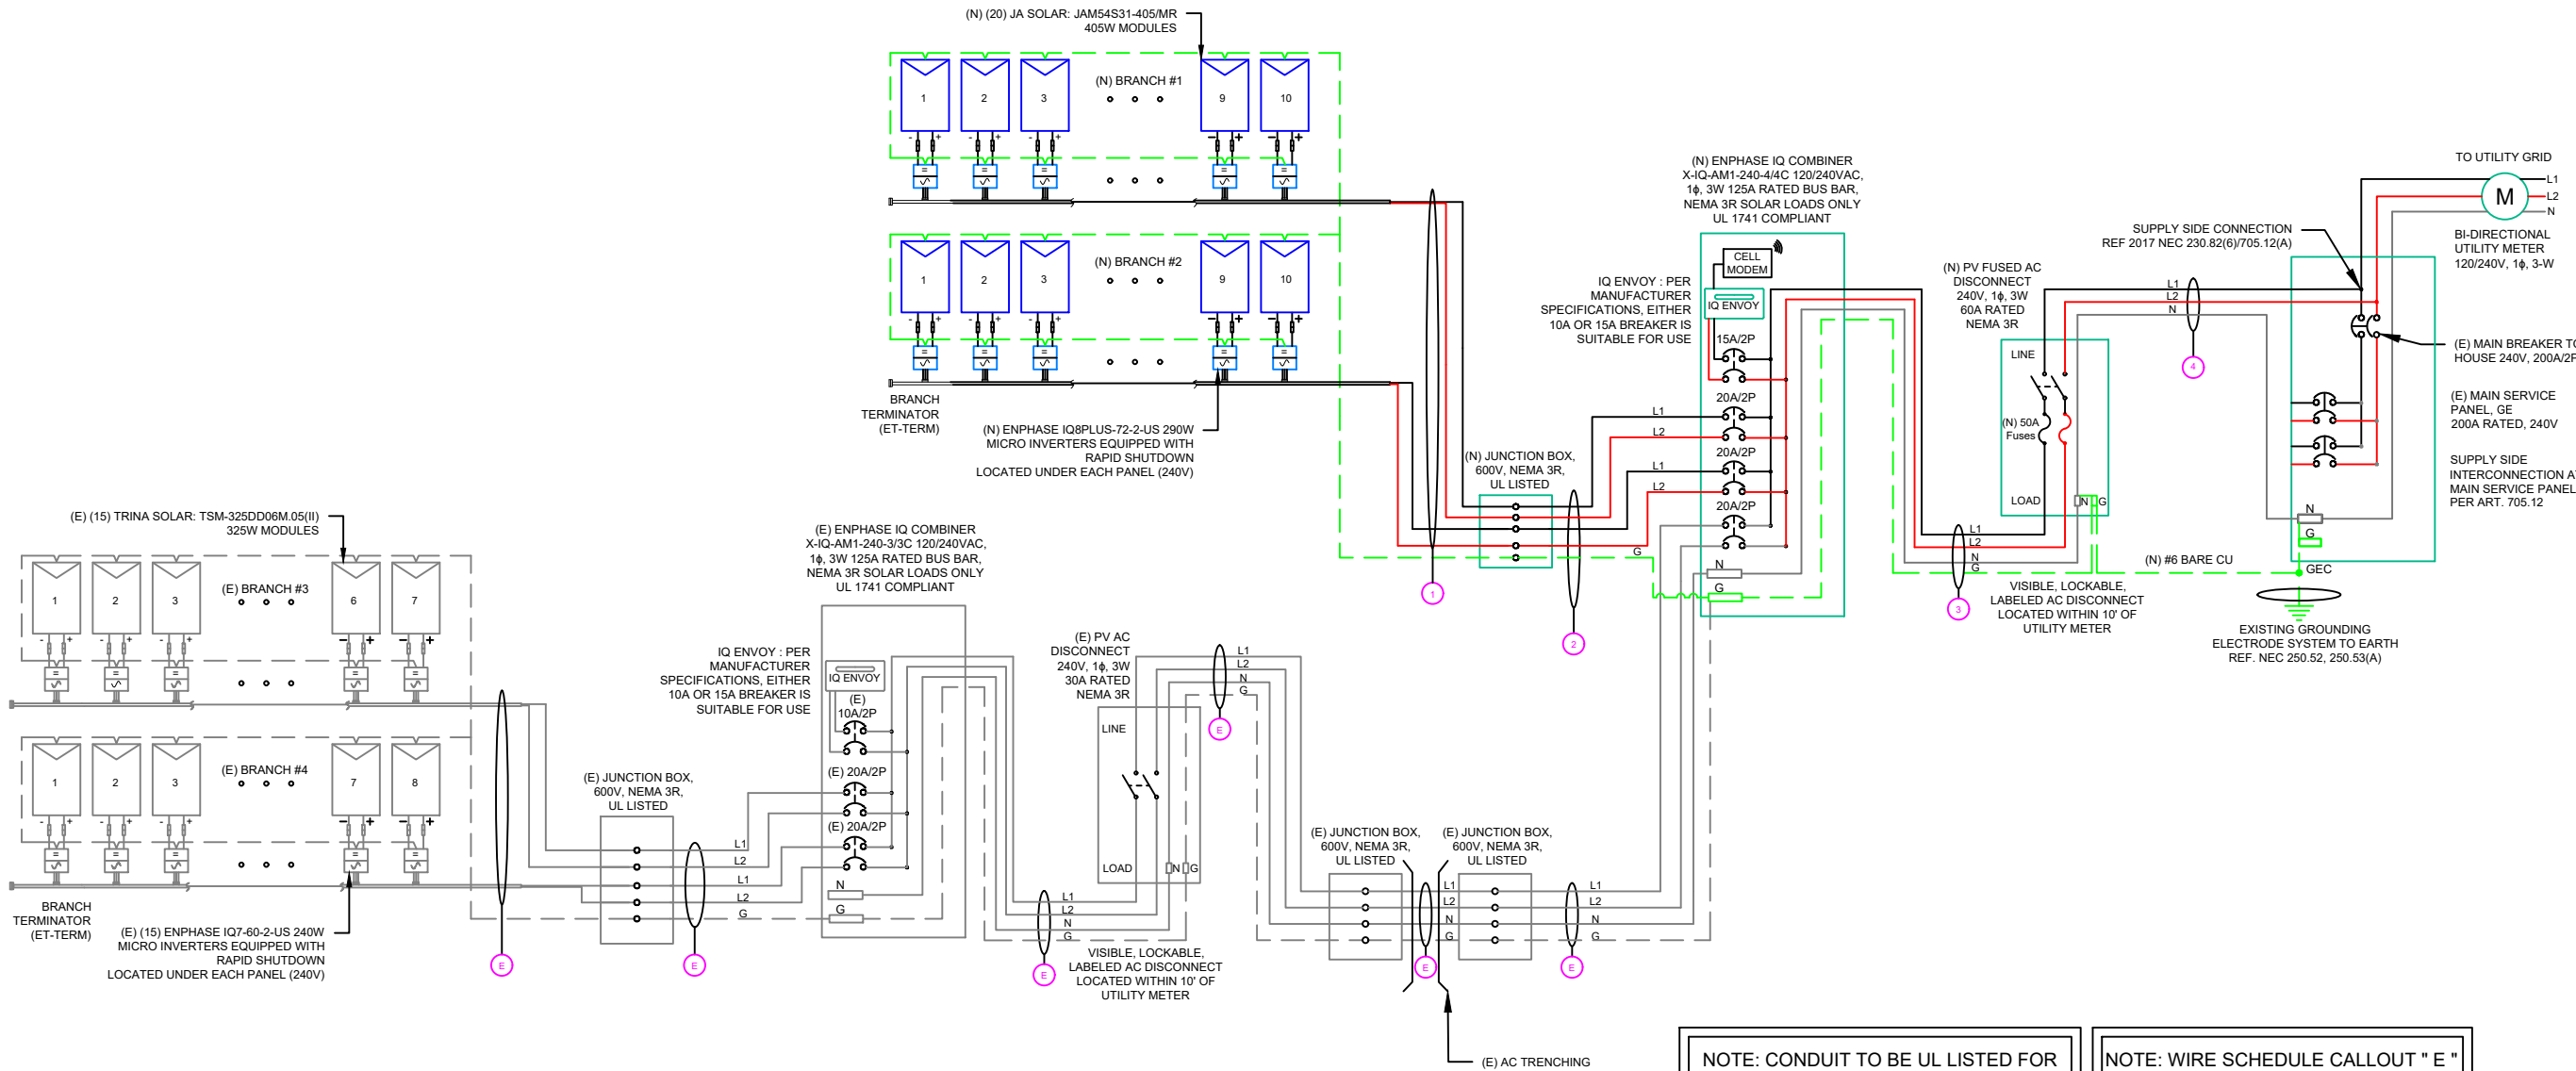

NOTE: CONDUIT TO BE UL LISTED FOR WET LOCATIONS AND UV PROTECTED

NOTE: WIRE SCHEDULE CALLOUT " E " ARE EXISTING SYSTEM

	QTY	CONDUCTOR INFORMATION		CONDUIT TYPE	CONDUIT SIZE
1	(4)	#12AWG -	ENPHASE ENGAGE CABLE (L1 & L2 NO NEUTRAL)	N/A	N/A
	(1)	#6AWG -	BARE COPPER IN FREE AIR		
2	(4)	#10AWG -	CU, THWN-2	EMT OR LFMC	3/4"
	(1)	#10AWG -	CU, THWN-2 GND		
3	(2)	#6AWG -	CU, THWN-2	EMT, LFMC OR PVC	3/4"
	(1)	#6AWG -	CU, THWN-2 N		
	(1)	#6AWG -	CU, THWN-2 GND		
4	(2)	#6AWG -	CU, THWN-2	EMT, LFMC OR PVC	3/4"
	(1)	#6AWG -	CU, THWN-2 N		



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE  
308 W E ST,  
ERWIN, NC 28339

DRAWN BY  
ESR

SHEET NAME  
ELECTRICAL LINE DIAGRAM

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-6

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL #	ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN
MIN/MAX DC VOLT RATING	30V MIN/ 58V MAX
MAX INPUT POWER	235W-440W
NOMINAL AC VOLTAGE RATING	240V/ 211-264V
MAX AC CURRENT	1.21A
MAX MODULES PER CIRCUIT	13 (SINGLE PHASE)
MAX OUTPUT POWER	290 VA

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL #	JA SOLAR: JAM54S31-405/MR 405 W MODULE
VMP	31.21V
IMP	12.98A
VOC	37.23V
ISC	13.87A
TEMP. COEFF. VOC	-0.275%/°C
MODULE DIMENSION	67.79"L x 44.65"W x 1.18"D (In Inch)

AMBIENT TEMPERATURE SPECS	
AMBIENT TEMP (HIGH TEMP 2%)	38°
RECORD LOW TEMP	-9°
MODULE TEMPERATURE COEFFICIENT OF Voc	-0.275%/°C

PERCENT OF VALUES	NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT
.80	4-6
.70	7-9
.50	10-20

AC CALCULATIONS																						
CIRCUIT ORIGIN	CIRCUIT DESTINATION	VOLTAGE (V)	FULL LOAD AMPS "FLA" (A)	FLA*1.25 (A)	OCPD SIZE (A)	NEUTRAL SIZE	GROUND SIZE	CONDUCTOR SIZE	75°C AMPACITY (A)	AMPACITY CHECK #1	AMBIENT TEMP. (°C)	TOTAL CC CONDUCTORS IN RACEWAY	90°C AMPACITY (A)	DERATION FACTOR FOR AMBIENT TEMPERATURE NEC 310.15(B)(2)(a)	DERATION FACTOR FOR CONDUCTORS PER RACEWAY NEC 310.15(B)(3)(a)	90°C AMPACITY DERATED (A)	AMPACITY CHECK #2	FEEDER LENGTH (FEET)	CONDUCTOR RESISTANCE (OHM/KFT)	VOLTAGE DROP AT FLA (%)	CONDUIT SIZE	CONDUIT FILL (%)
CIRCUIT 1	JUNCTION BOX	240	12.1	15.125	20	N/A	BARE COPPER #6 AWG	CU #12 AWG	25	PASS	38	2	30	0.91	1	27.3	PASS			0.46	N/A	#N/A
CIRCUIT 2	JUNCTION BOX	240	12.1	15.125	20	N/A	BARE COPPER #6 AWG	CU #12 AWG	25	PASS	38	2	30	0.91	1	27.3	PASS			0.46	N/A	#N/A
JUNCTION BOX	COMBINER BOX	240	12.1	15.125	20	N/A	CU #10 AWG	CU #10 AWG	35	PASS	38	4	40	0.91	0.8	29.12	PASS	20	1.24	0.250	3/4" EMT	19.79362
COMBINER BOX	AC DISCONNECT	240	39.2	49	50	CU #6 AWG	CU #6 AWG	CU #6 AWG	65	PASS	38	2	75	0.91	1	68.25	PASS	5	0.491	0.080	3/4" EMT	38.04878
AC DISCONNECT	POI	240	39.2	49	50	CU #6 AWG	N/A	CU #6 AWG	65	PASS	38	2	75	0.91	1	68.25	PASS	5	0.491	0.080	3/4" EMT	28.53659

Circuit 1 Voltage Drop	0.870
Circuit 2 Voltage Drop	0.870

ELECTRICAL NOTES


1. ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
2. ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT.
3. WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
4. WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
5. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
6. WHERE SIZES OF JUNCTION BOX, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
7. ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
8. MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
9. MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSKO GBL-4DBT LAY-IN LUG.
10. TEMPERATURE RATINGS OF ALL CONDUCTORS, TERMINATIONS, BREAKERS, OR OTHER DEVICES ASSOCIATED WITH THE SOLAR PV SYSTEM SHALL BE RATED FOR AT LEAST 75 DEGREE C.



**TOP TIER SOLAR SOLUTIONS**

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY  
ESR

SHEET NAME  
WIRING CALCULATIONS

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-7

⚠

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL- 1:  
LABEL LOCATION:  
AC DISCONNECT  
CODE REF: NEC 690.13(B)

⚠

WARNING DUAL POWER SOURCE  
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL- 2:  
LABEL LOCATION:  
UTILITY METER  
MAIN SERVICE PANEL  
SUBPANEL  
CODE REF: NEC 705.12(C) & NEC 690.59

⚠

WARNING

TURN OFF PHOTOVOLTAIC AC  
DISCONNECT PRIOR TO  
WORKING INSIDE PANEL

LABEL- 3:  
LABEL LOCATION:  
MAIN SERVICE PANEL  
SUBPANEL  
MAIN SERVICE DISCONNECT  
COMBINER  
CODE REF: NEC 110.27(C) & OSHA 1910.145 (f) (7)

SOLAR PV SYSTEM EQUIPPED  
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN  
SWITCH TO THE  
"OFF" POSITION TO  
SHUT DOWN PV SYSTEM  
AND REDUCE  
SHOCK HAZARD  
IN THE ARRAY

SOLAR ELECTRIC  
PV PANELS

LABEL- 4:  
LABEL LOCATION:  
AC DISCONNECT  
CODE REF: [NEC 690.56(C)(1)(A)]

RAPID SHUTDOWN SWITCH  
FOR SOLAR PV SYSTEM

LABEL- 5:  
LABEL LOCATION:  
AC DISCONNECT  
CODE REF: NEC 690.56(C)(2)

PHOTOVOLTAIC

AC DISCONNECT

LABEL- 6:  
LABEL LOCATION:  
AC DISCONNECT  
CODE REF: NEC 690.13(B)

PHOTOVOLTAIC  
AC DISCONNECT

NOMINAL OPERATING AC VOLATGE240 V

RATED AC OUTPUT CURRENT39.20 A

LABEL- 7:  
LABEL LOCATION:  
MAIN SERVICE PANEL  
SUBPANEL  
AC DISCONNECT  
CODE REF: NEC 690.54

MAIN PHOTOVOLTAIC  
SYSTEM DISCONNECT

LABEL- 8:  
LABEL LOCATION:  
MAIN SERVICE DISCONNECT (ONLY IF MAIN SERVICE DISCONNECT IS PRESENT)  
CODE REF: NEC 690.13(B)

TOP TIER

SOLAR SOLUTIONS

TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME

LABELS

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-8



Harvest the Sunshine

DEEP BLUE 3.0 Light



405W MBB  
Half-cell Black Module  
JAM54S31 380-405/MR Series

Introduction

Assembled with 11BB PERC cells, the half-cell configuration of the modules offers the advantages of higher power output, better temperature-dependent performance, reduced shading effect on the energy generation, lower risk of hot spot, as well as enhanced tolerance for mechanical loading.



Higher output power



Lower LCOE



Less shading and lower resistive loss




Better mechanical loading tolerance

Superior Warranty

- 25-year product warranty
- 25-year linear power output warranty

0.55% Annual Degradation  
Over 25 years

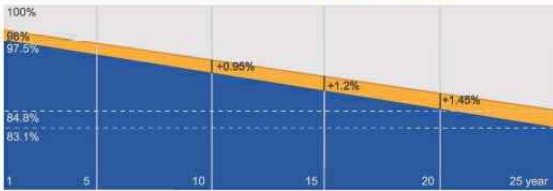

New linear power warranty Standard module linear power warranty

Comprehensive Certificates

- IEC 61215, IEC 61730, UL 61215, UL 61730
- ISO 9001: 2015 Quality management systems
- ISO 14001: 2015 Environmental management systems
- ISO 45001: 2018 Occupational health and safety management systems
- IEC TS 62941: 2016 Terrestrial photovoltaic (PV) modules – Guidelines for increased confidence in PV module design qualification and type approval



JASOLAR

www.jasolar.com


Specifications subject to technical changes and tests.  
JA Solar reserves the right of final interpretation.



JASOLAR

JAM54S31 380-405/MR Series

MECHANICAL DIAGRAMS

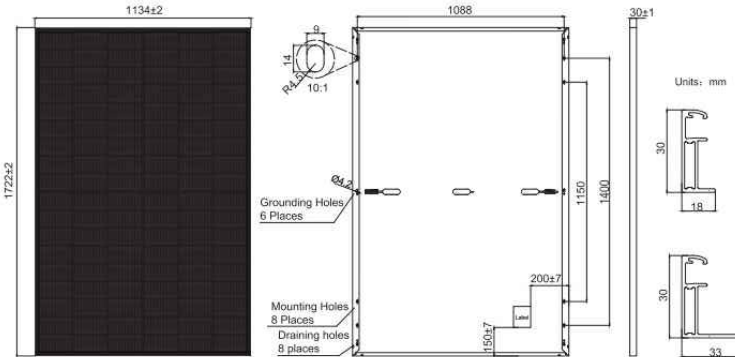

Remark: customized frame color and cable length available upon request

SPECIFICATIONS

Cell	Mono
Weight	21.5kg±3%
Dimensions	1722±2mm×1134±2mm×30±1mm
Cable Cross Section Size	4mm² (IEC) , 12 AWG(UL)
No. of cells	108(6x18)
Junction Box	IP68, 3 diodes
Connector	MC4-EVO2(1500V)
Cable Length (Including Connector)	Portrait: 300mm(+)/400mm(-); Landscape: 1200mm(+)/1200mm(-)
Packaging Configuration	36pcs/Pallet, 864pcs/40ft Container

ELECTRICAL PARAMETERS AT STC

TYPE	JAM54S31 ~380/MR	JAM54S31 ~385/MR	JAM54S31 ~390/MR	JAM54S31 ~395/MR	JAM54S31 ~400/MR	JAM54S31 ~405/MR
Rated Maximum Power(Pmax) [W]	380	385	390	395	400	405
Open Circuit Voltage(Voc) [V]	36.58	36.71	36.85	36.98	37.07	37.23
Maximum Power Voltage(Vmp) [V]	30.28	30.46	30.64	30.84	31.01	31.21
Short Circuit Current(Isc) [A]	13.44	13.52	13.61	13.70	13.79	13.87
Maximum Power Current(Imp) [A]	12.55	12.64	12.73	12.81	12.90	12.98
Module Efficiency [%]	19.5	19.7	20.0	20.2	20.5	20.7
Power Tolerance	±2%					
Temperature Coefficient of Isc(α <sub>Isc</sub> )	+0.045%/°C					
Temperature Coefficient of Voc(β <sub>Voc</sub> )	-0.275%/°C					
Temperature Coefficient of Pmax(γ <sub>Pmp</sub> )	-0.350%/°C					
STC	Irradiance 1000W/m², cell temperature 25°C, AM1.5G					


Remark: Electrical data in this catalog do not refer to a single module and they are not part of the offer.They only serve for comparison among different module types.

ELECTRICAL PARAMETERS AT NOCT


TYPE	JAM54S31 ~380/MR	JAM54S31 ~385/MR	JAM54S31 ~390/MR	JAM54S31 ~395/MR	JAM54S31 ~400/MR	JAM54S31 ~405/MR	OPERATING CONDITIONS	
Rated Max Power(Pmax) [W]	286	290	294	298	302	306	Maximum System Voltage	1000V/1500V DC
Open Circuit Voltage(Voc) [V]	34.36	34.49	34.62	34.75	34.88	35.12	Operating Temperature	-40 °C ~+85 °C
Max Power Voltage(Vmp) [V]	28.51	28.68	28.87	29.08	29.26	29.47	Maximum Series Fuse Rating	25A
Short Circuit Current(Isc) [A]	10.75	10.82	10.89	10.96	11.03	11.10	Maximum Static Load, Front*	5400Pa(112lb/ft²)
Max Power Current(Imp) [A]	10.03	10.11	10.18	10.25	10.32	10.38	Maximum Static Load, Back*	2400Pa(50lb/ft²)
NOCT	Irradiance 800W/m², ambient temperature 20°C, wind speed 1m/s, AM1.5G						NOCT	45±2 °C
							Safety Class	Class II
							Fire Performance	UL Type 1

CHARACTERISTICS


Current-Voltage Curve JAM54S31-405/MR



Power-Voltage Curve JAM54S31-405/MR



Current-Voltage Curve JAM54S31-405/MR



Premium Cells, Premium Modules

Version No. : Global\_EN\_20231130A

TOP TIER  
SOLAR SOLUTIONS

TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	

PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-9





AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

**Applicant:** Shanghai JA Solar Technology Co., Ltd. **Manufacturer:** JA SOLAR VIET NAM COMPANY LIMITED.

**Address:** No. 118, Lane 3111, West Huancheng Road, Fengxian District, 201401 Shanghai **Address:** Lot G, Quang Chau industrial park, Quang Chau Ward, Viet Yen Town, Bac Giang Province, 236110

**Country:** P. R. China **Country:** Vietnam

**Party Authorized To Apply Mark:** Same as Manufacturer  
**Report Issuing Office:** Intertek Testing Services Shanghai Limited

**Control Number:** 5020189 **Authorized by:** for L. Matthew Snyder, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc.  
545 East Algonquin Road, Arlington Heights, IL 60005  
Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Standard(s):	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1: Test Requirements [UL 61215-1:2017 Ed.1 ]
	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1-1: Special Requirements For Testing Of Crystalline Silicon Photovoltaic (PV) Modules [UL 61215-1-1:2017 Ed.1 ]
	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 2: Test Procedures [UL 61215-2:2017 Ed.1 ]
	Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements For Construction [UL 61730-1:2017 Ed.1]
	Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements For Testing [UL 61730-2:2017 Ed.1]
Standard(s):	Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements for Construction [CSA C22.2#61730-1:2019 Ed.2]
	Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements for Testing [CSA C22.2#61730-2:2019 Ed.2]



AUTHORIZATION TO MARK

Product:	Crystalline Silicon Photovoltaic modules
	Brand Name: JA SOLAR 晶澳
Models:	JAM72S03-385/PR, JAP72S03-340/SC, JAM72S10- followed by 395, 400, 405, 410 or 415 followed by /MB, JAM60S10- followed by 330, 335, 340 or 345 followed by /MB, JAM72S10- followed by 395, 400, 405, 410 or 415 followed by /MR, JAM66S10- followed by 365, 365, 370, 375 or 380 followed by /MR, JAM60S10- followed by 330, 335, 340 or 345 followed by /MR, JAM72S09- followed by 370, 375, 380, 385, 390, 395 or 400 followed by /PR, JAM60S09- followed by 310, 315, 320 or 325 followed by /PR, JAM72S09- followed by 375, 380 or 385 followed by /BP, JAM60S09- followed by 315 or 320 followed by /BP, JAM72S10- followed by 385, 390, 395 or 400 followed by /BP, JAM60S10- followed by 320, 325 or 330 followed by /BP, JAM72S10- followed by 380, 385, 390, 395, 400 or 405 followed by /PR, JAM60S10- followed by 320, 325, 330 or 335 followed by /PR, JAM72S12- followed by 365, 370, 375, 380 or 385 followed by /PR, JAM60S12- followed by 305, 310, 315 or 320 followed by /PR, 1JAM78S10- followed by 435, 440, 445, 450 or 455 followed by /MR, 1JAM6(K)-72-335/4BB/1500V, JAM60S17- followed by 320, 325, or 330 followed by /MR, JAM72S20- followed by 430, 435, 440, 445, 450, 455, 460, 465 or 470 followed by /MR, JAM60S20- followed by 355, 360, 365, 370, 375, 380, 385 or 390 followed by /MR, JAM72S30- followed by 530, 535, 540, 545, 550 or 555 followed by /MR, JAM66S30- followed by 490, 495 or 500 followed by /MR, JAM68S11- followed by 355, 360 or 365 followed by /PR, JAM68S11- followed by 345, 350, 355, 360 or 365 followed by /PR(B), JAM76S11- followed by 395, 400, 405, 410 or 415 followed by /PR(B), JAM76S11- followed by 395, 400, 405, 410 or 415 followed by /PR(B)/1000V, JAM78S30-followed by 575, 580, 585, 590, 595, 600, 605 or 610 followed by /GR, JAM72S30-followed by 535, 540, 545, 550, 555 or 560 followed by /GR, JAM66S30-followed by 490, 495, 500 or 505 followed by /GR, JAM60S30-followed by 445, 450, 455 or 460 followed by /GR, JAM54S30-followed by 400, 405, 410, 415 or 420 followed by /GR, JAM78S31-followed by 570, 575, 580, 585 or 590 followed by /GR, JAM72S31-followed by 530, 535 or 540 followed by /GR, JAM66S31-followed by 485, 490 or 495 followed by /GR, JAM60S31-followed by 440, 445 or 450 followed by /GR, JAM54S31-followed by 395, 400 , 405, 410 or 415 followed by /GR, JAM60S31-followed by 430, 435, 440, 445 or 450 followed by /GR/1000V, JAM54S31-followed by 390, 395, 400, 405, 410 or 415 followed by /GR/1000V, JAM54S30-followed by 400, 405, 410, 415, 420 or 425 followed by /MR, JAM72S31-followed by 510, 515, 520, 525, 530, 535, 540 or 545 followed by /MR, JAM54S31-followed by 385, 390, 395, 400 or 405 followed by /MR, JAM54S30-followed by 400, 405, 410, 415, 420 or 425 followed by /MR/1000V, JAM72S31-followed by 510, 515, 520, 525, 530,535, 540 or 545 followed by /MR/1000V, JAM54S31-followed by 385, 390, 395, 400 or 405 followed by /MR/1000V, JAM72S17-followed by 390, 395, 400 or 405 followed by /MR, JAM72S17-followed by 390, 395, 400 or 405 followed by /MR/1000V, JAM78S30- followed by 580, 585, 590, 595, 600 or 605 followed by /MR,JAM72S30-followed by 555, 560, 565, 570, 575, 580 followed by /LR, JAM54S30-followed by 415, 420, 425, 430, 435 followed by /LR, JAM54S31-followed by 415, 420 followed by /LR, JAM54S30-followed by 385, 390, 395, 400, 405, 410 followed by /MB, JAM54S31-followed by 385, 390, 395, 400, 405 followed by /MB, JAM54S30-followed by 410, 415, 420, 425 followed by /LB, JAM54S31-followed by 410, 415 followed by /LB , JAM72S30-followed by 535, 540, 545, 550 followed by /MB, JAM72S31-followed by 525, 530, 535, 540 followed by /MB.



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



PROJECT NAME & ADDRESS	
JAMES BRADLEY RESIDENCE	308 W E ST, ERWIN, NC 28339

DRAWN BY ESR
-----------------

SHEET NAME EQUIPMENT SPECIFICATION
--

SHEET SIZE ANSI B 11" X 17"
-----------------------------------

SHEET NUMBER PV-10
-----------------------





DATA SHEET



# IQ8 and IQ8+ Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application-specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the Enphase IQ Battery, Enphase IQ Gateway, and the Enphase App monitoring and analysis software.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters are UL Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer's instructions.

## Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

## High productivity and reliability

- Produce power even when the grid is down\*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

## Microgrid-forming

- Complies with the latest advanced grid support\*\*
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements

\* Only when installed with IQ System Controller 2, meets UL 1741.

\*\* IQ8 and IQ8Plus supports split phase, 240V installations only.

# IQ8 and IQ8+ Microinverters

INPUT DATA (DC)		IQ8-60-2-US	IQ8PLUS-72-2-US
Commonly used module pairings¹	W	235 – 350	235 – 440
Module compatibility		60-cell/120 half-cell	60-cell/120 half-cell, 66-cell/132 half-cell and 72-cell/144 half-cell
MPPT voltage range	V	27 – 37	29 – 45
Operating range	V	25 – 48	25 – 58
Min/max start voltage	V	30 / 48	30 / 58
Max input DC voltage	V	50	60
Max DC current² [module Isc]	A	15	
Overvoltage class DC port		II	
DC port backfeed current	mA	0	
PV array configuration		1x1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit	
OUTPUT DATA (AC)		IQ8-60-2-US	IQ8PLUS-72-2-US
Peak output power	VA	245	300
Max continuous output power	VA	240	290
Nominal (L-L) voltage/range³	V	240 / 211 – 264	
Max continuous output current	A	1.0	1.21
Nominal frequency	Hz	60	
Extended frequency range	Hz	50 – 68	
AC short circuit fault current over 3 cycles	Arms	2	
Max units per 20 A (L-L) branch circuit⁴		16	13
Total harmonic distortion		<5%	
Overvoltage class AC port		III	
AC port backfeed current	mA	30	
Power factor setting		1.0	
Grid-tied power factor (adjustable)		0.85 leading – 0.85 lagging	
Peak efficiency	%	97.5	97.6
CEC weighted efficiency	%	97	97
Night-time power consumption	mW	60	
MECHANICAL DATA			
Ambient temperature range		-40°C to +60°C (-40°F to +140°F)	
Relative humidity range		4% to 100% (condensing)	
DC Connector type		MC4	
Dimensions (HxWxD)		212 mm (8.3") x 175 mm (6.9") x 30.2 mm (1.2")	
Weight		1.08 kg (2.38 lbs)	
Cooling		Natural convection – no fans	
Approved for wet locations		Yes	
Pollution degree		PD3	
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure	
Environ. category / UV exposure rating		NEMA Type 6 / outdoor	
COMPLIANCE			
Certifications		CA Rule 21 (UL 1741-SA), UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 1071-01  This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.	

(1) No enforced DC/AC ratio. See the compatibility calculator at <https://link.enphase.com/module-compatibility>  
(2) Maximum continuous input DC current is 10.6A (3) Nominal voltage range can be extended beyond nominal if required by the utility. (4) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

IQ8SP-DS-0002-01-EN-US-2022-03-17

TOP TIER  
SOLAR SOLUTIONS

## TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	

### PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

### DRAWN BY

ESR

### SHEET NAME

EQUIPMENT  
SPECIFICATION

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

PV-11



Enphase  
IQ Combiner 4/4C  
X-IQ-AM1-240-4  
X-IQ-AM1-240-4C



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



The **Enphase IQ Combiner 4/4C** with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed

Enphase IQ Combiner 4/4C

MODEL NUMBER	
IQ Combiner 4 (X-IQ-AM1-240-4)	IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes a silver solar shield to match the IQ Battery system and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C)	IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.
ACCESSORIES AND REPLACEMENT PARTS (not included, order separately)	
Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	- Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan for Ensemble sites - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C
X-IQ-NA-HD-125A	Hold down kit for Eaton circuit breaker with screws.
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating	65 A
Max. continuous current rating (input from PV/storage)	64 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation / 95A with IQ Gateway breaker included
Envoy breaker	10A or 15A rating GE/Siemens/Eaton included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway
Consumption monitoring CT (CT-200-SPLIT)	A pair of 200 A split core current transformers
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
COMPLIANCE	
Compliance, IQ Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 02-14-2022



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-12







Tech Brief

XR Rail® Family

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails® are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.

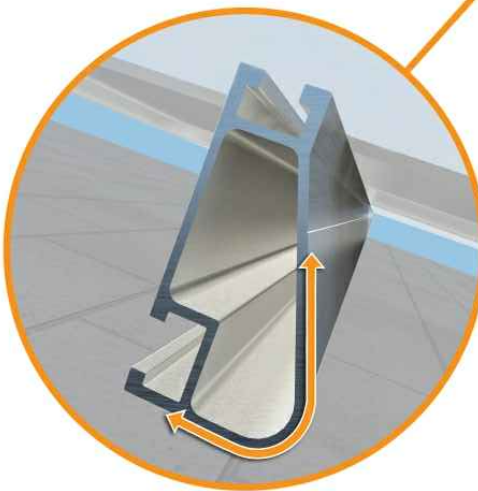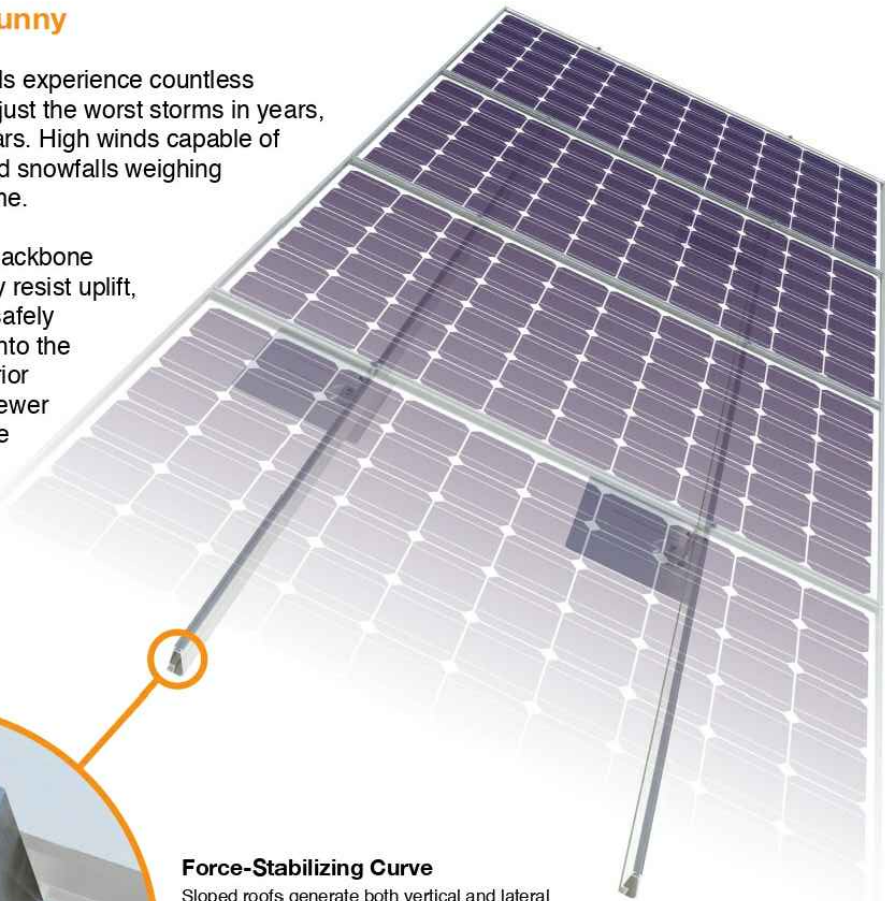

**Force-Stabilizing Curve**  
Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails® is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

**Compatible with Flat & Pitched Roofs**

XR Rails® are compatible with FlashFoot® and other pitched roof attachments.

IronRidge® offers a range of tilt leg options for flat roof mounting applications.

**Corrosion-Resistant Materials**

All XR Rails® are made of 6000-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.

XR Rail® Family

The XR Rail® Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail® to match.

**XR10**

XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 6 feet, while remaining light and economical.

- 6' spanning capability
- Moderate load capability
- Clear & black anodized finish
- Internal splices available

**XR100**

XR100 is a residential and commercial mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 10 feet.

- 10' spanning capability
- Heavy load capability
- Clear & black anodized finish
- Internal splices available

**XR1000**

XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.

- 12' spanning capability
- Extreme load capability
- Clear anodized finish
- Internal splices available

Rail Selection

The table below was prepared in compliance with applicable engineering codes and standards.\* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2e, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit IronRidge.com for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
None	90	XR10		XR100		XR1000	
	120						
	140						
	160						
20	90						
	120						
	140						
	160						
30	90						
	160						
40	90						
	160						
80	160						
120	160						

\*Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance.



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME

EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-13






## UFO® Family of Components

### Simplified Grounding for Every Application

The UFO® family of components eliminates the need for separate grounding hardware by bonding solar modules directly to IronRidge® XR Rails®. All system types that feature the UFO® family—Flush Mount®, Tilt Mount® and Ground Mount®—are fully listed to the UL 2703 standard.

UFO® hardware forms secure electrical bonds with both the module and the rail, resulting in many parallel grounding paths throughout the system. This leads to safer and more reliable installations.

Only for installation and use with IronRidge products in accord with written instructions. See [IronRidge.com/UFO](https://www.ironridge.com/UFO)

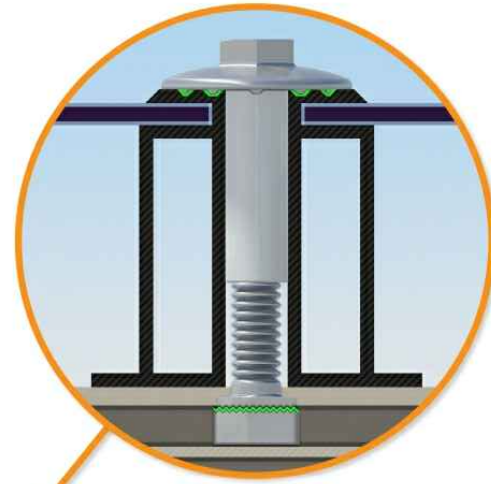

**Universal Fastening Object (UFO®)**  
The UFO® securely bonds solar modules to XR Rails®. It comes assembled and lubricated, and can fit a wide range of module heights.



**Stopper Sleeve**  
The Stopper Sleeve snaps onto the UFO®, converting it into a bonded end clamp.



**BOSS® Splice**  
Bonded Structural Splice connects rails with built-in bonding teeth. No tools or hardware needed.




**Grounding Lug**  
A single Grounding Lug connects an entire row of PV modules to the grounding conductor.



**Bonded Attachments**  
The bonding bolt attaches and bonds the L-foot® to the rail. It is installed with the same socket as the rest of the system.

### System Diagram

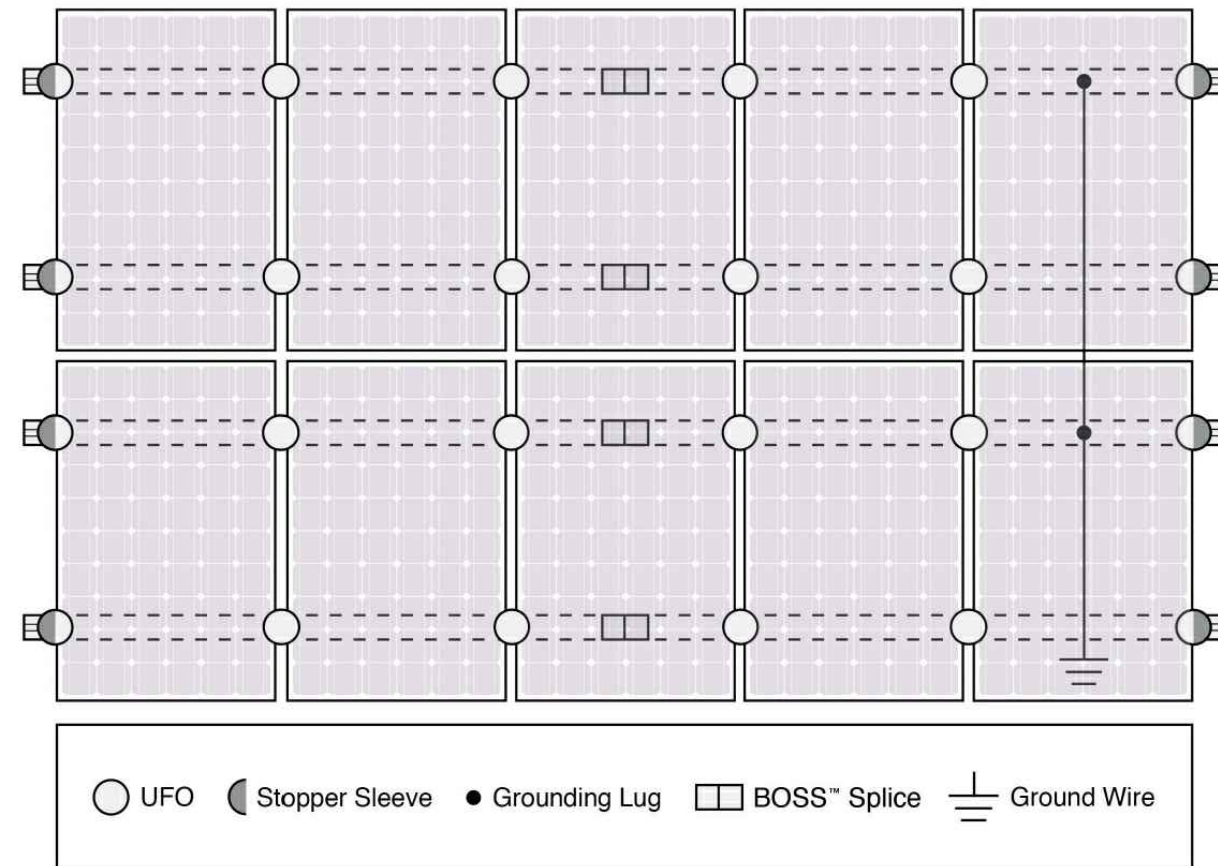

⚠ Approved Enphase microinverters can provide equipment grounding of IronRidge systems, eliminating the need for grounding lugs and field installed equipment ground conductors (EGC). A minimum of two microinverters mounted to the same rail and connected to the same Engage cable is required. Refer to installation manuals for additional details.

### UL Certification

The IronRidge® Flush Mount®, Tilt Mount®, and Ground Mount Systems have been listed to UL 2703 by Intertek Group plc.

UL 2703 is the standard for evaluating solar mounting systems. It ensures these devices will maintain strong electrical and mechanical connections over an extended period of time in extreme outdoor environments.


 [Go to IronRidge.com/UFO](https://www.ironridge.com/UFO)

Cross-System Compatibility			
Feature	Flush Mount	Tilt Mount	Ground Mount
XR Rails®	✓	✓	XR100 & XR1000
UFO®/Stopper	✓	✓	✓
BOSS® Splice	✓	✓	N/A
Grounding Lugs	1 per Row	1 per Row	1 per Array
Microinverters & Power Optimizers	Compatible with most MLPE manufacturers. Refer to system installation manual.		
Fire Rating	Class A	Class A	N/A
Modules	Tested or Evaluated with over 400 Framed Modules. Refer to installation manuals for a detailed list.		

### TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



### PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE  
308 W E ST,  
ERWIN, NC 28339

DRAWN BY  
ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-14



The right way to attach almost anything to metal roofs!

# S-5!®

## The Right Way!

### ProteaBracket™

ProteaBracket™ is the most versatile standing seam metal roof attachment solution on the market, fitting most trapezoidal sheet profiles with and without intermediate insulation. It features an adjustable attachment base and multiple solar module attachment options (illustrated on back) to accommodate varying widths and heights. There are no messy sealants to apply and no chance for leaks; the ProteaBracket comes with factory-applied, adhesive rubber sealant to ensure quick installation and a weather-proof fit.


Installation is simple! The ProteaBracket is mounted directly onto the crown of the panel, straddling the profile. No surface preparation is necessary; simply wipe away excess oil and debris, align, and apply. Secure ProteaBracket through its pre-punched holes, using the hardened drill point S-5!® screws.

ProteaBracket is the perfect match for our S-5-PV Kit and spares you the hassle of cold-bridging! For a solar attachment solution that is both economical and easy to use, choose ProteaBracket.\*

\*When ProteaBracket is used in conjunction with the S-5-PV Kit, an additional nut is required during installation.



S-5!® ProteaBracket™ is a versatile bracket that adjusts easily to most trapezoidal roof profiles.

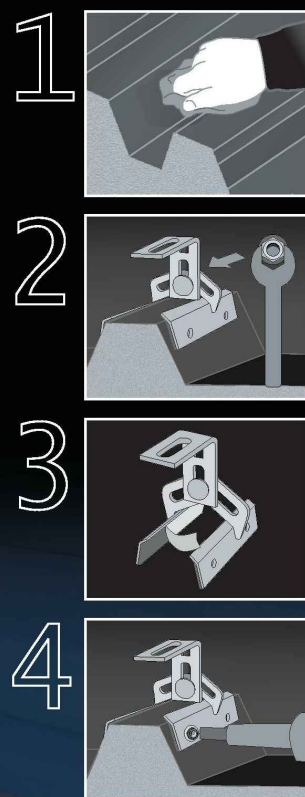

ProteaBracket™

888-825-3432 | [www.S-5.com](http://www.S-5.com)

# S-5!®

## The Right Way!

ProteaBracket™ is the perfect solar attachment solution for most trapezoidal exposed-fastened metal roof profiles! No messy sealants to apply. The factory-applied adhesive rubber sealant weather-proofs and makes installation easy!

Each ProteaBracket™ comes with a factory-applied, adhesive rubber sealant on the base. A structural A2 stainless steel bimetal attachment bracket, ProteaBracket is compatible with most common metal roofing materials. All four pre-punched holes must be used to achieve tested strength. Mounting hardware is furnished with the ProteaBracket. For design assistance, ask your distributor, or visit [www.S-5.com](http://www.S-5.com) for the independent lab test data that can be used for load-critical designs and applications. Also, please visit our website for more information including metallurgical compatibilities and specifications. S-5!® holding strength is unmatched in the industry.

### Multiple Attachment Options:

Side Rail Option




Top Rail Option



S-5-PV Kit Option




### ProteaBracket™

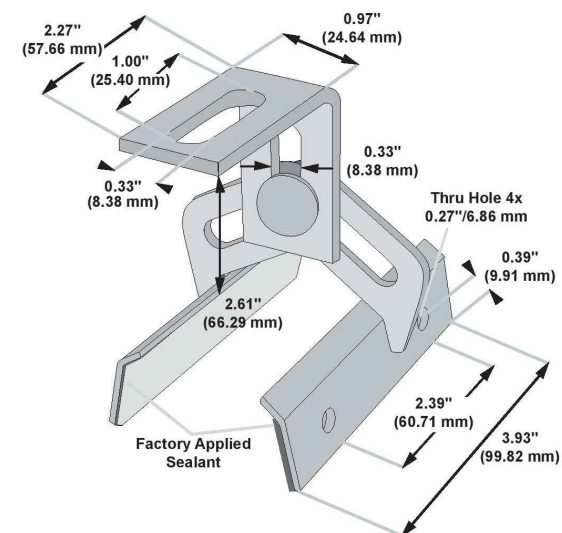

Please note: All measurements are rounded to the second decimal place.

### Example Applications

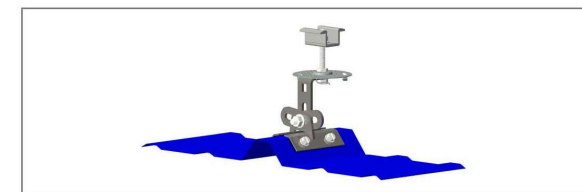

S-5-PV Kit demonstrated with a ProteaBracket on a trapezoidal profile.

### Example Profile



### S-5!® Warning! Please use this product responsibly!

Products are protected by multiple U.S. and foreign patents. For published data regarding holding strength, bolt torque, patents, and trademarks, visit the S-5! website at [www.S-5.com](http://www.S-5.com).

Copyright 2013, Metal Roof Innovations, Ltd. S-5! products are patent protected. S-5! aggressively protects its patents, trademarks, and copyrights. Version 112513.

Distributed by


# TOP TIER

## SOLAR SOLUTIONS

### TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/22/2025	



### PROJECT NAME & ADDRESS

JAMES BRADLEY  
RESIDENCE

308 W E ST,  
ERWIN, NC 28339

DRAWN BY

ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-15