










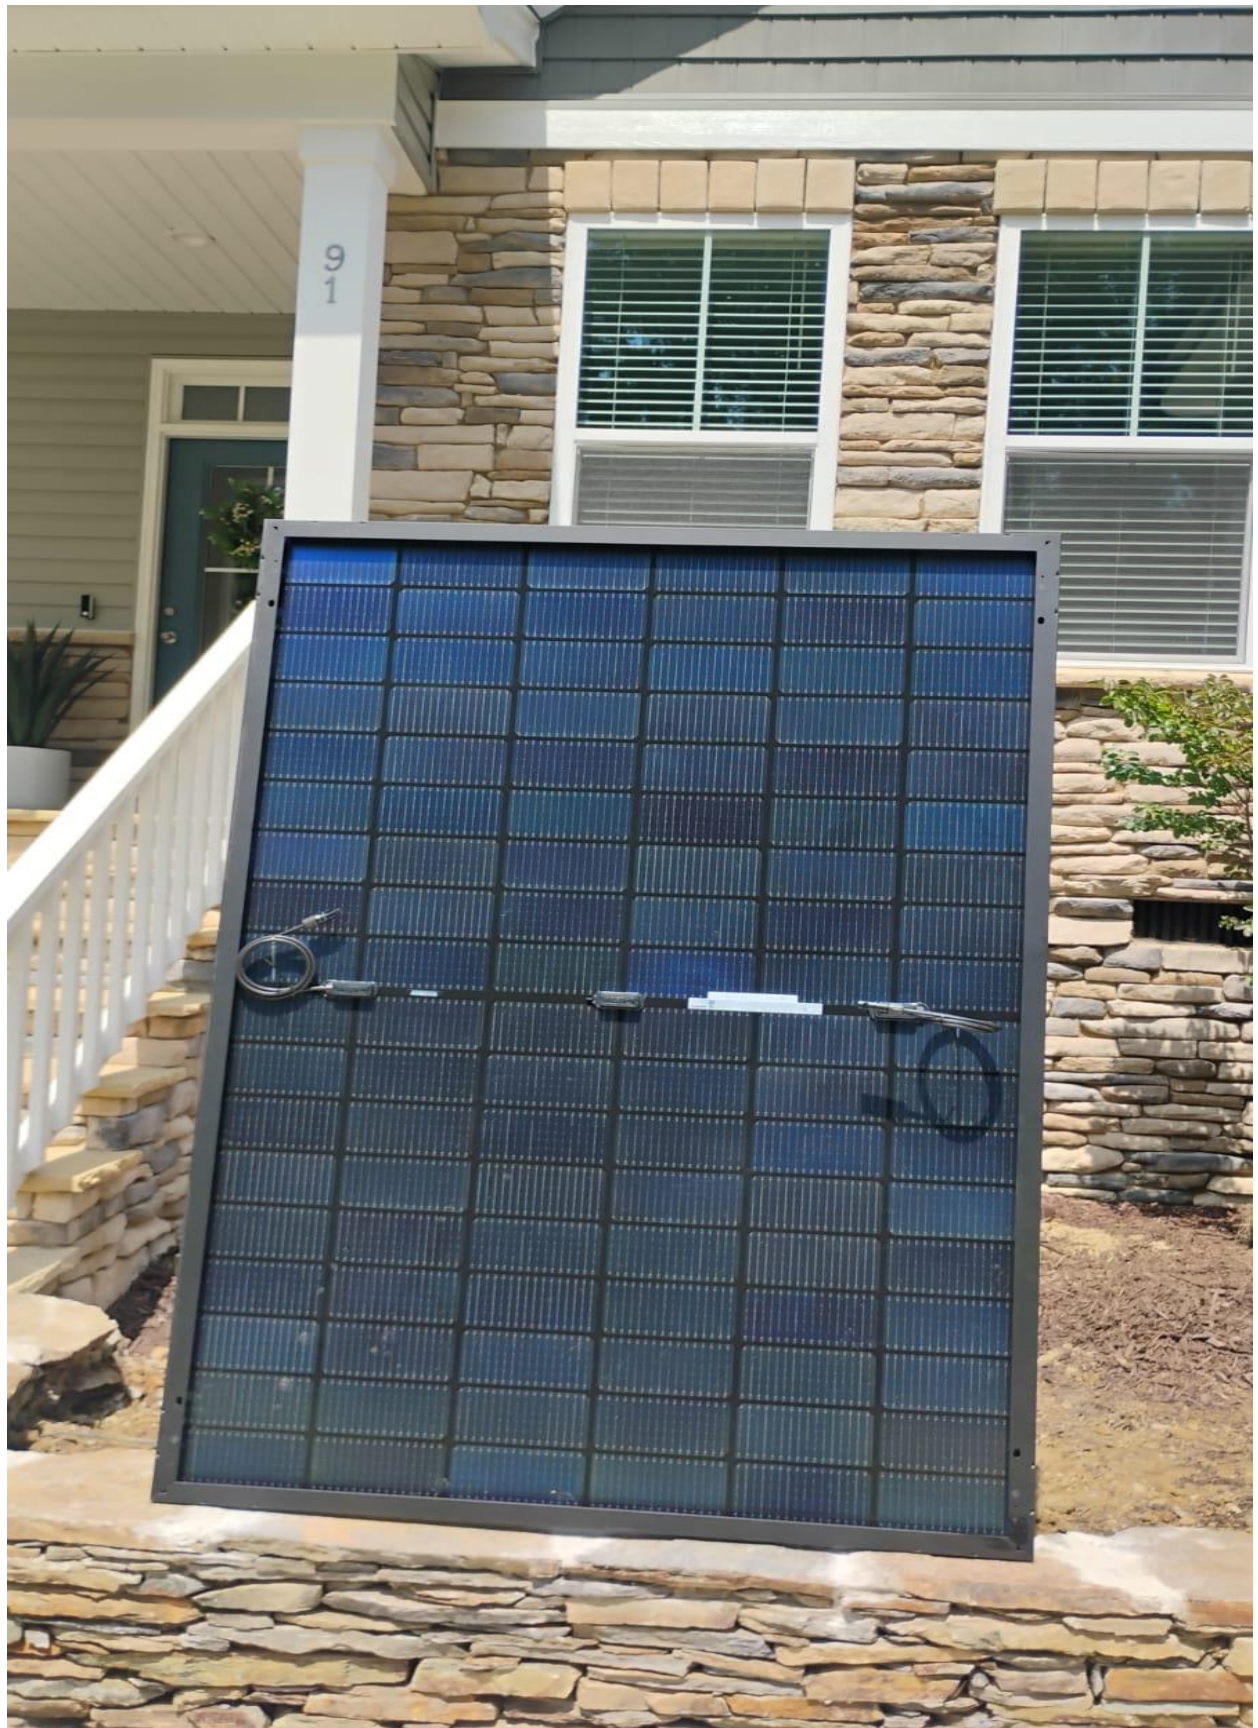










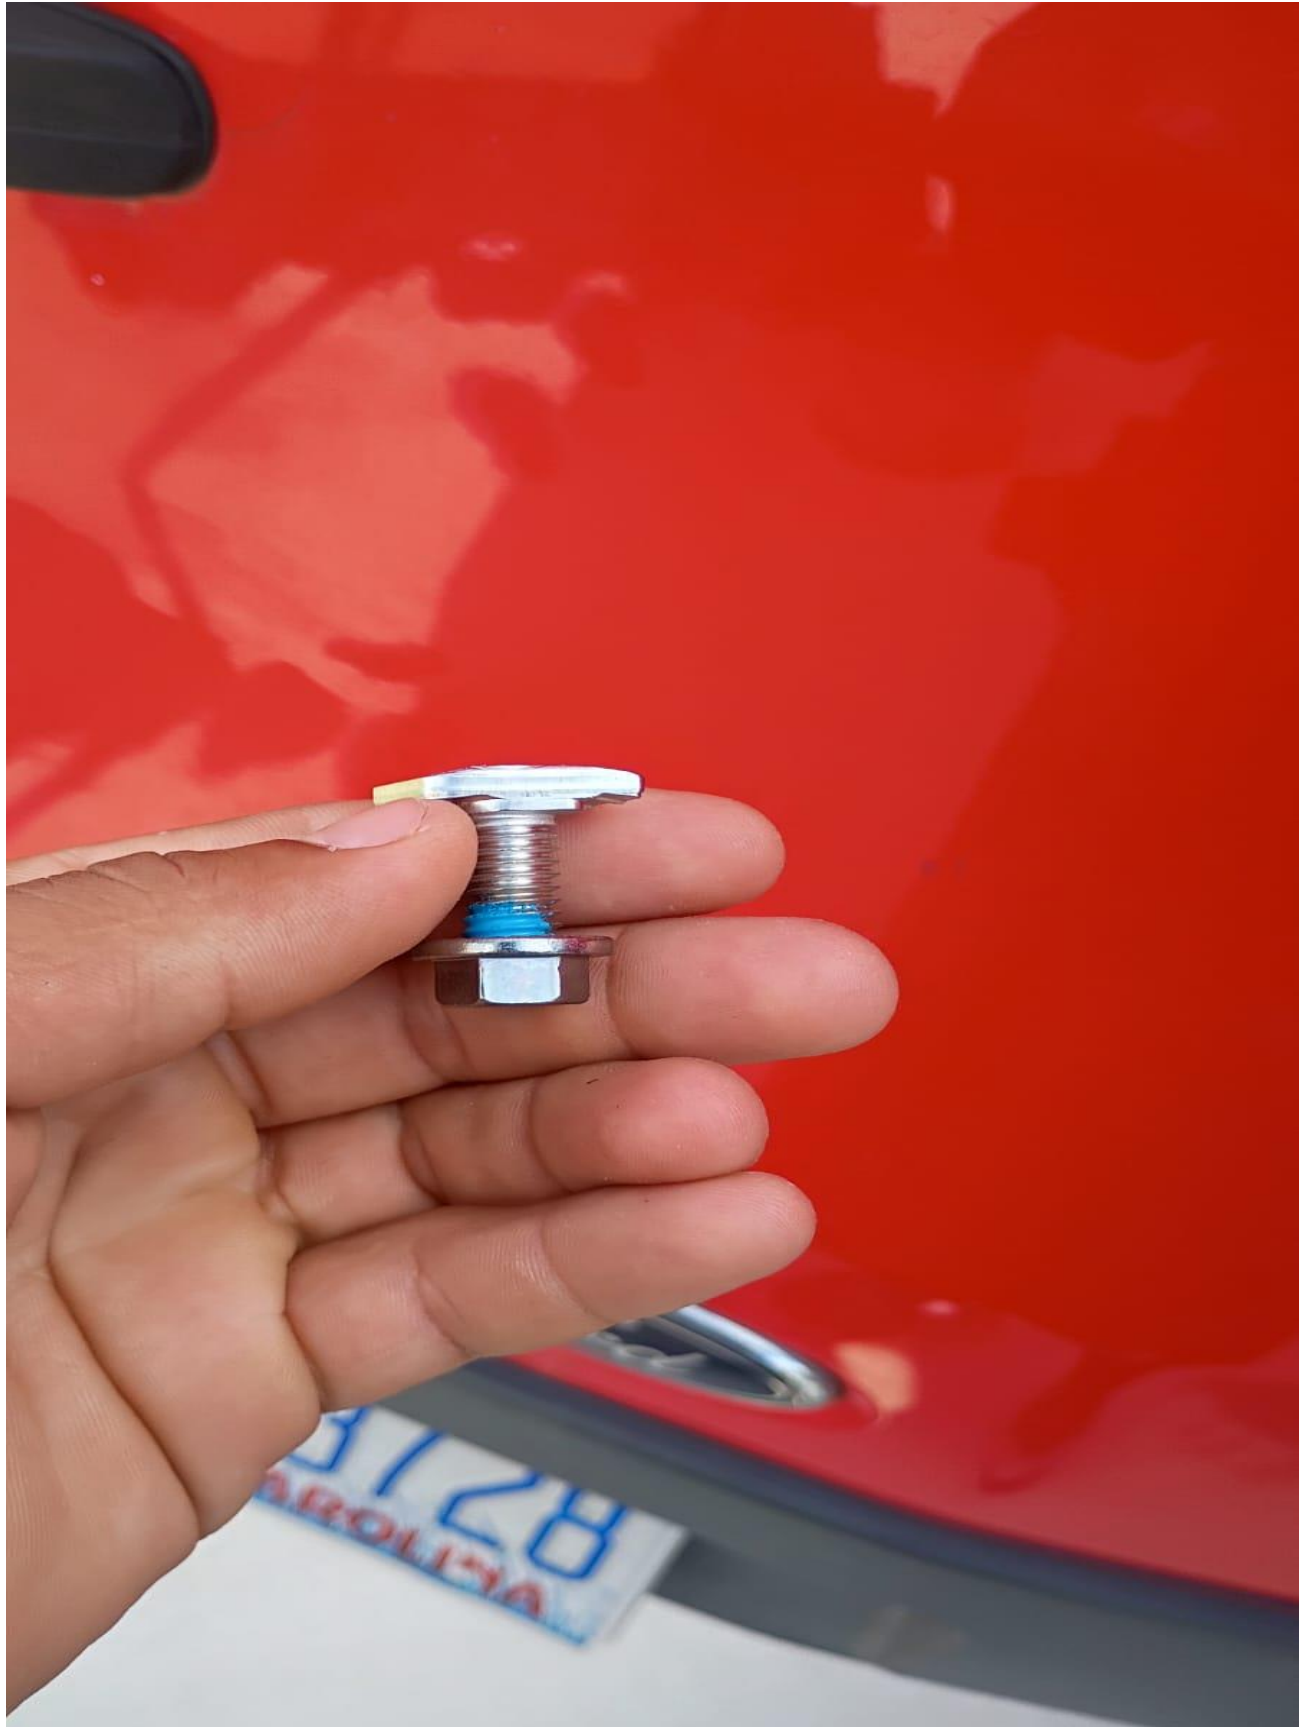































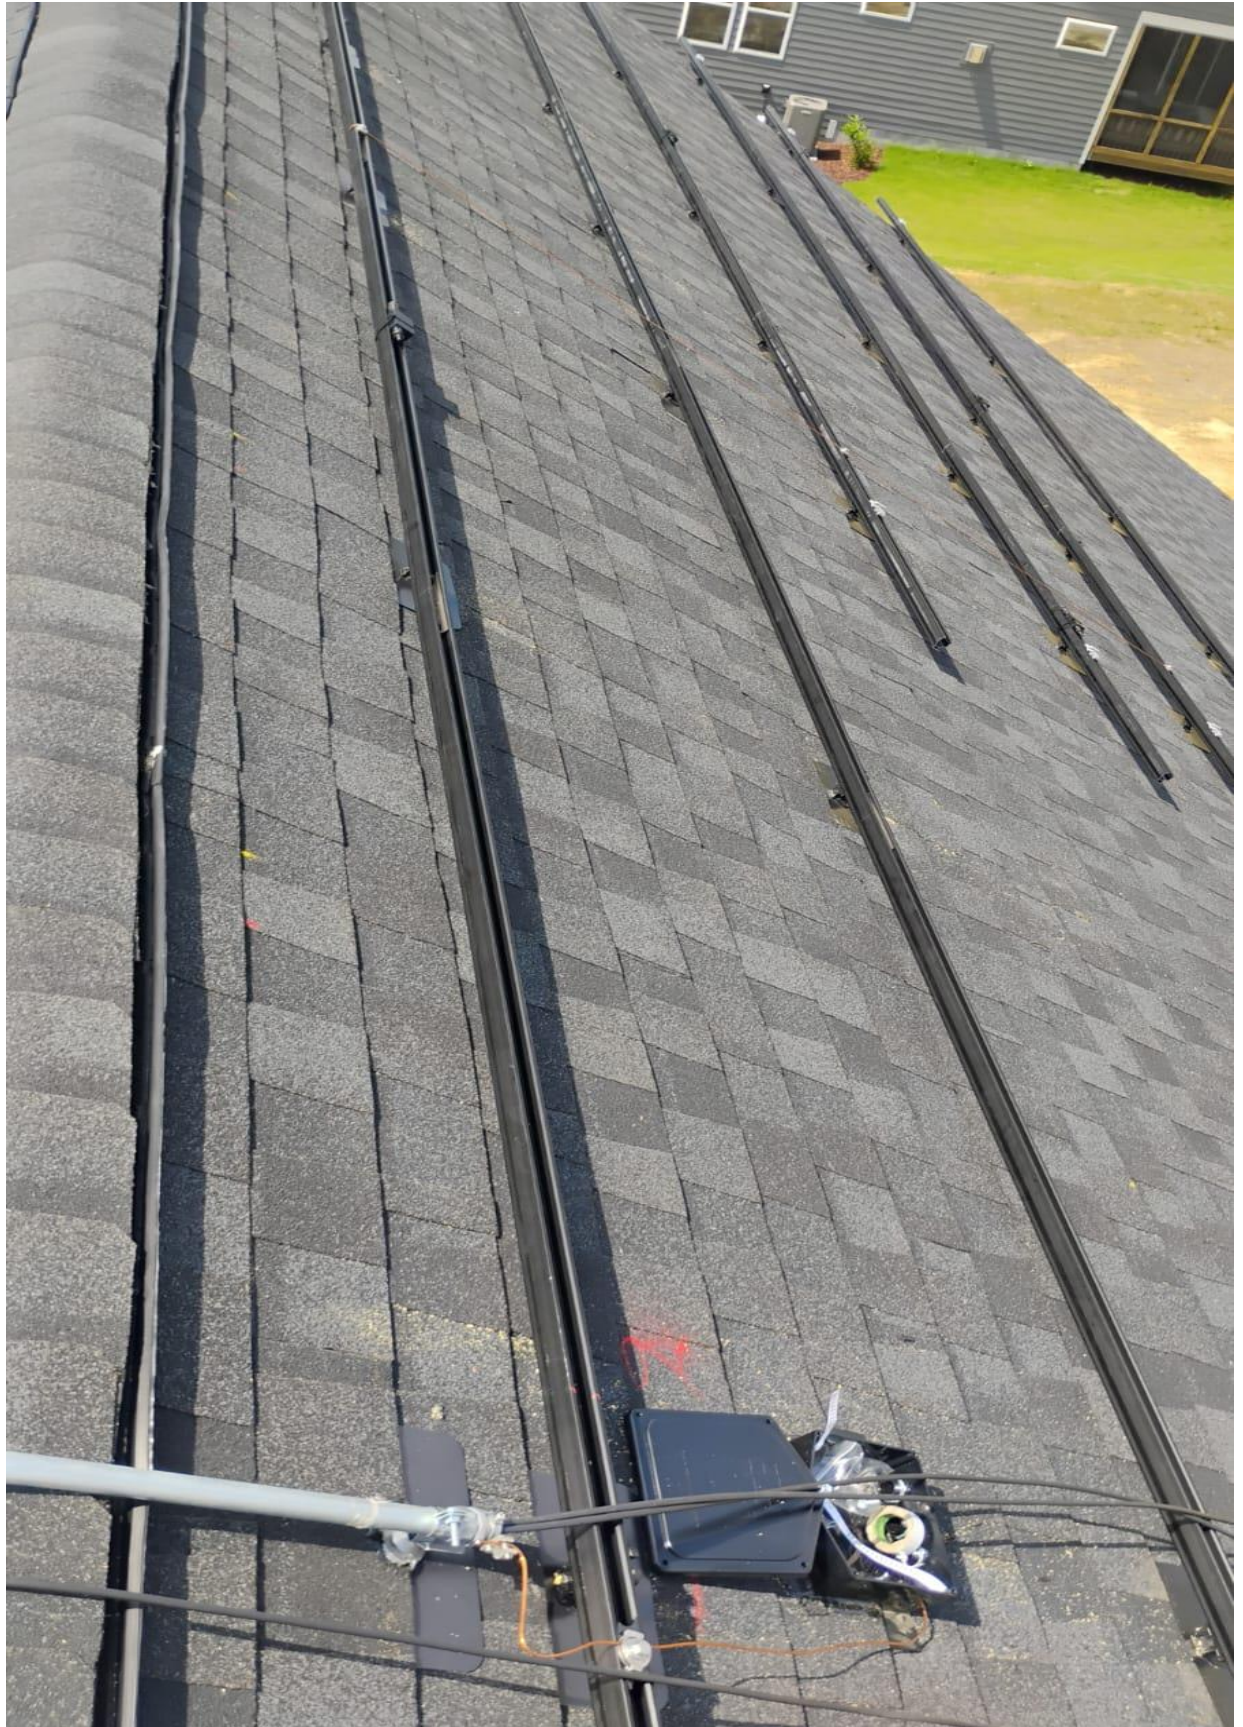







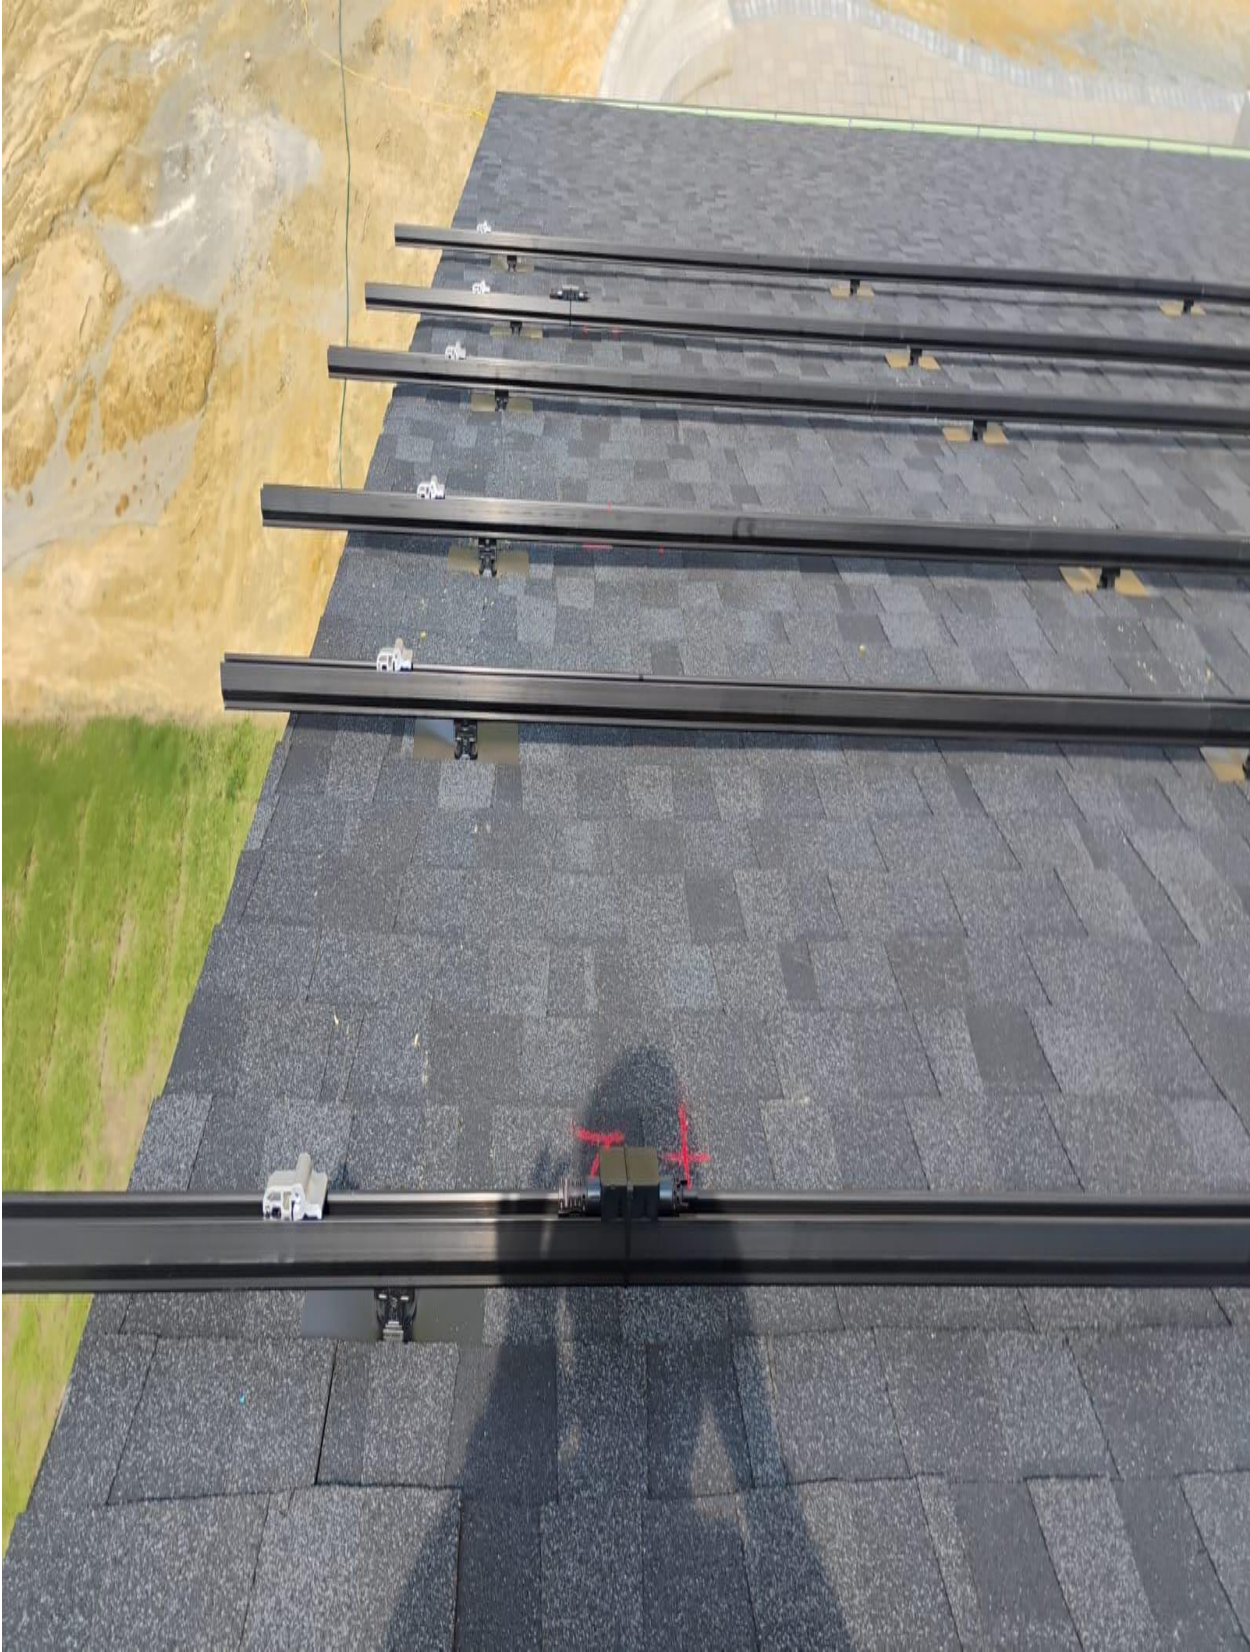



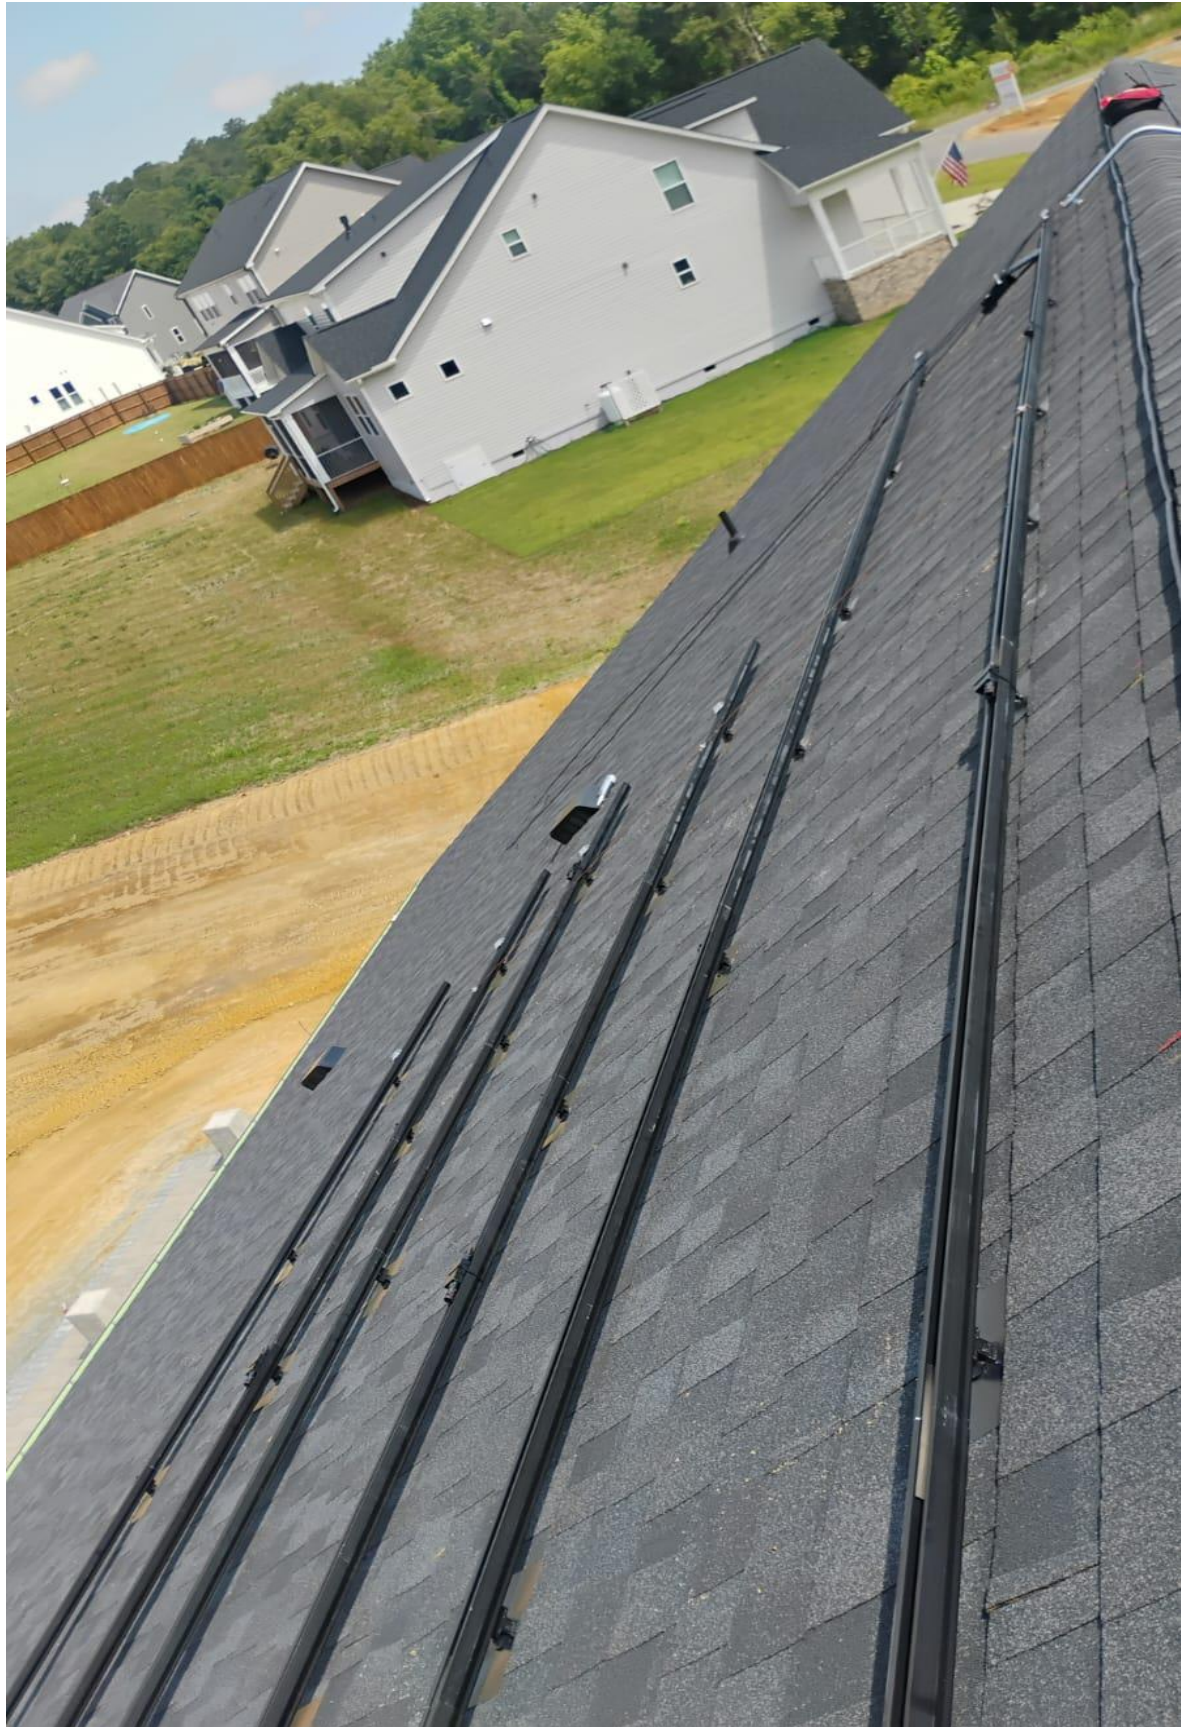



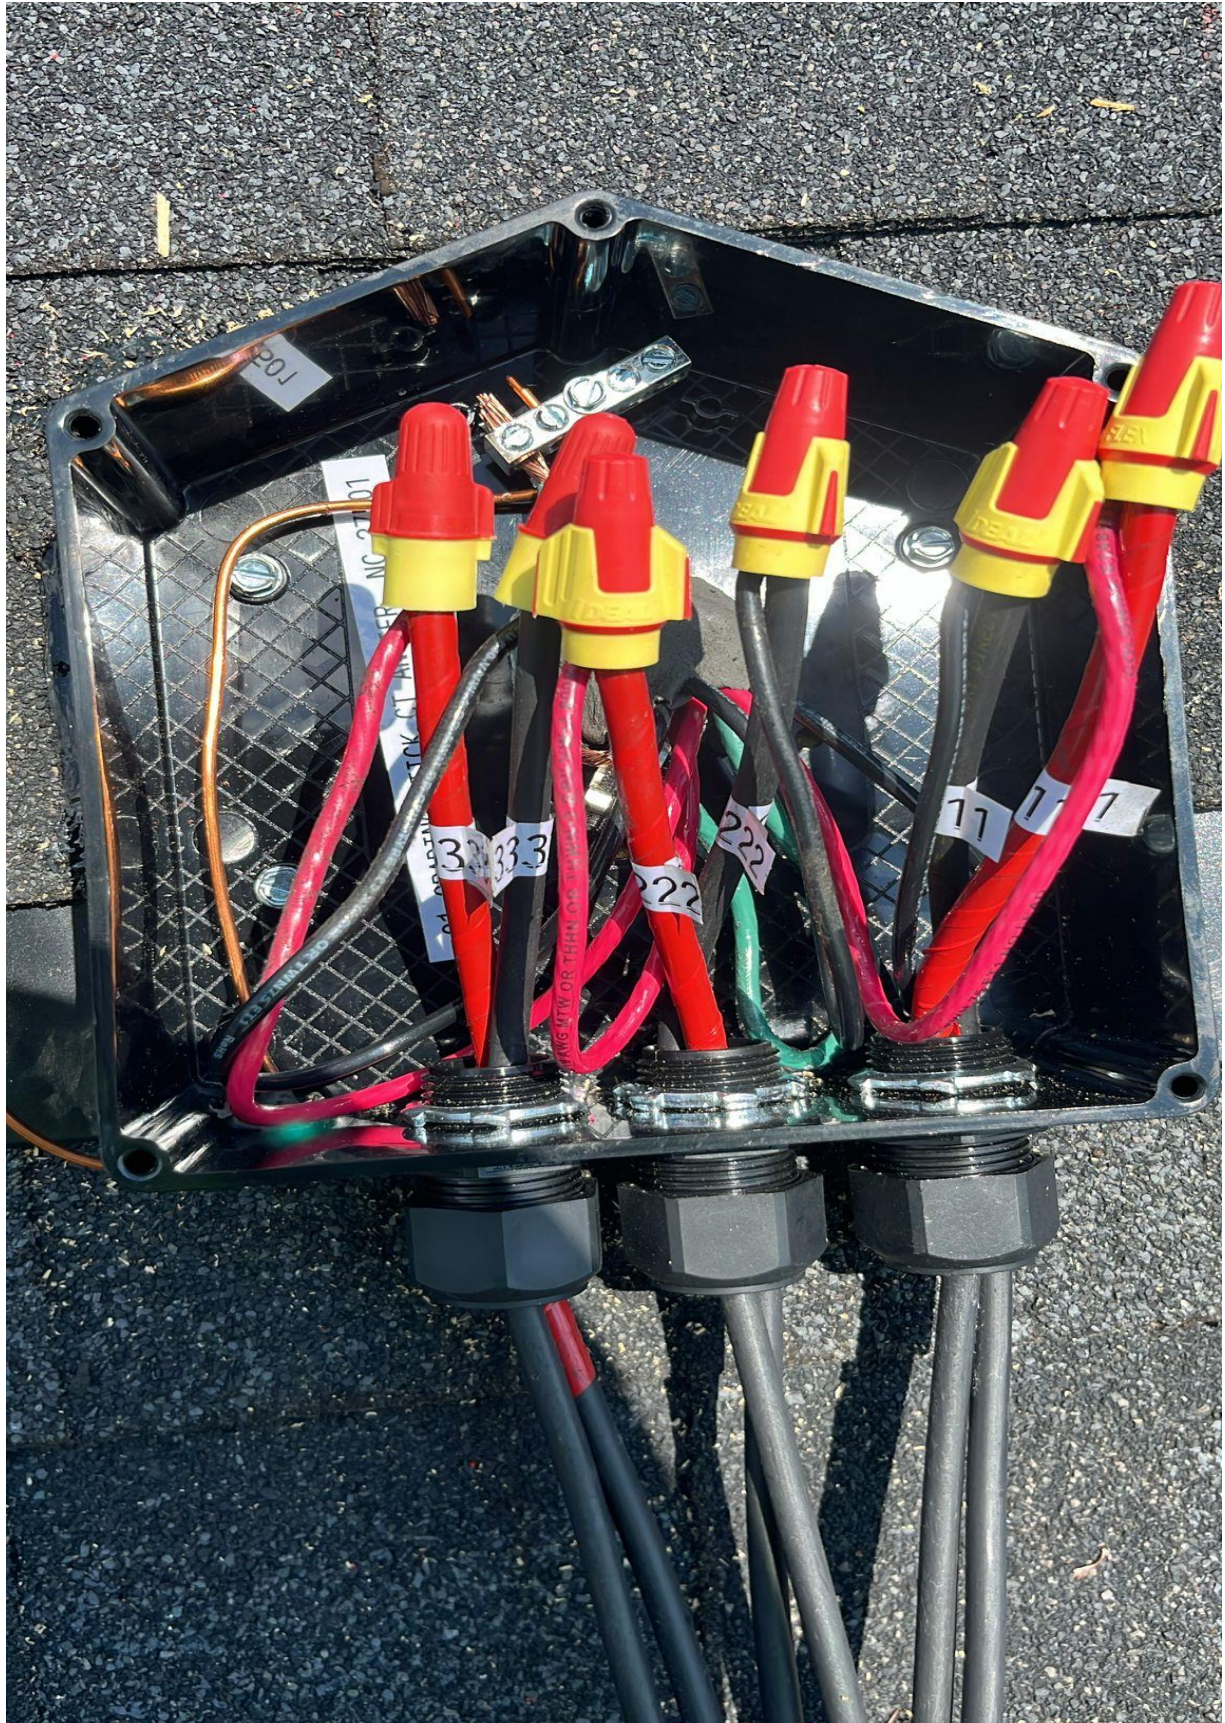





**WARNING: PHOTOVOLTAIC
POWER SOURCE**





EZ
SOLAR

91 GRADING STICK CT ANGIER, NC 27501

JB-1.2


WARNING: PHOTOVOLTAIC
POWER SOURCE

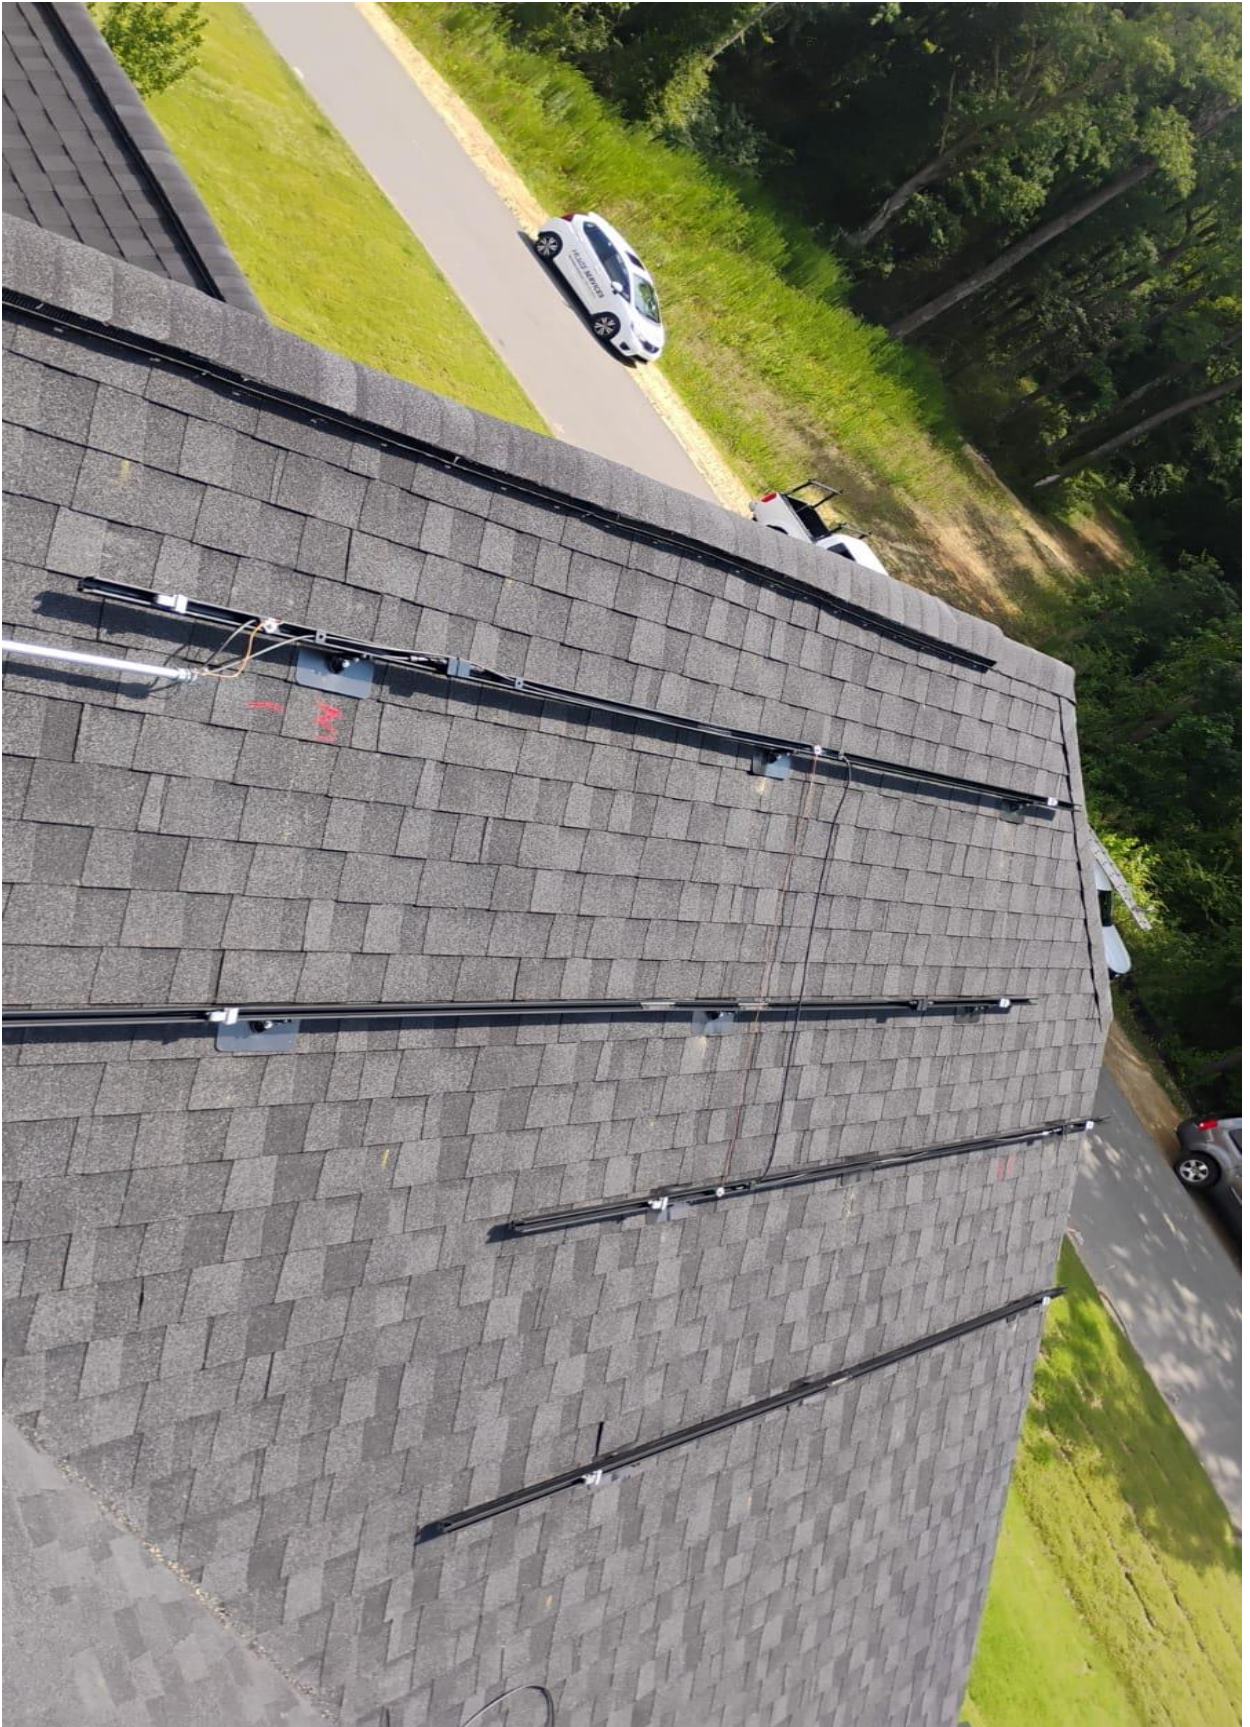

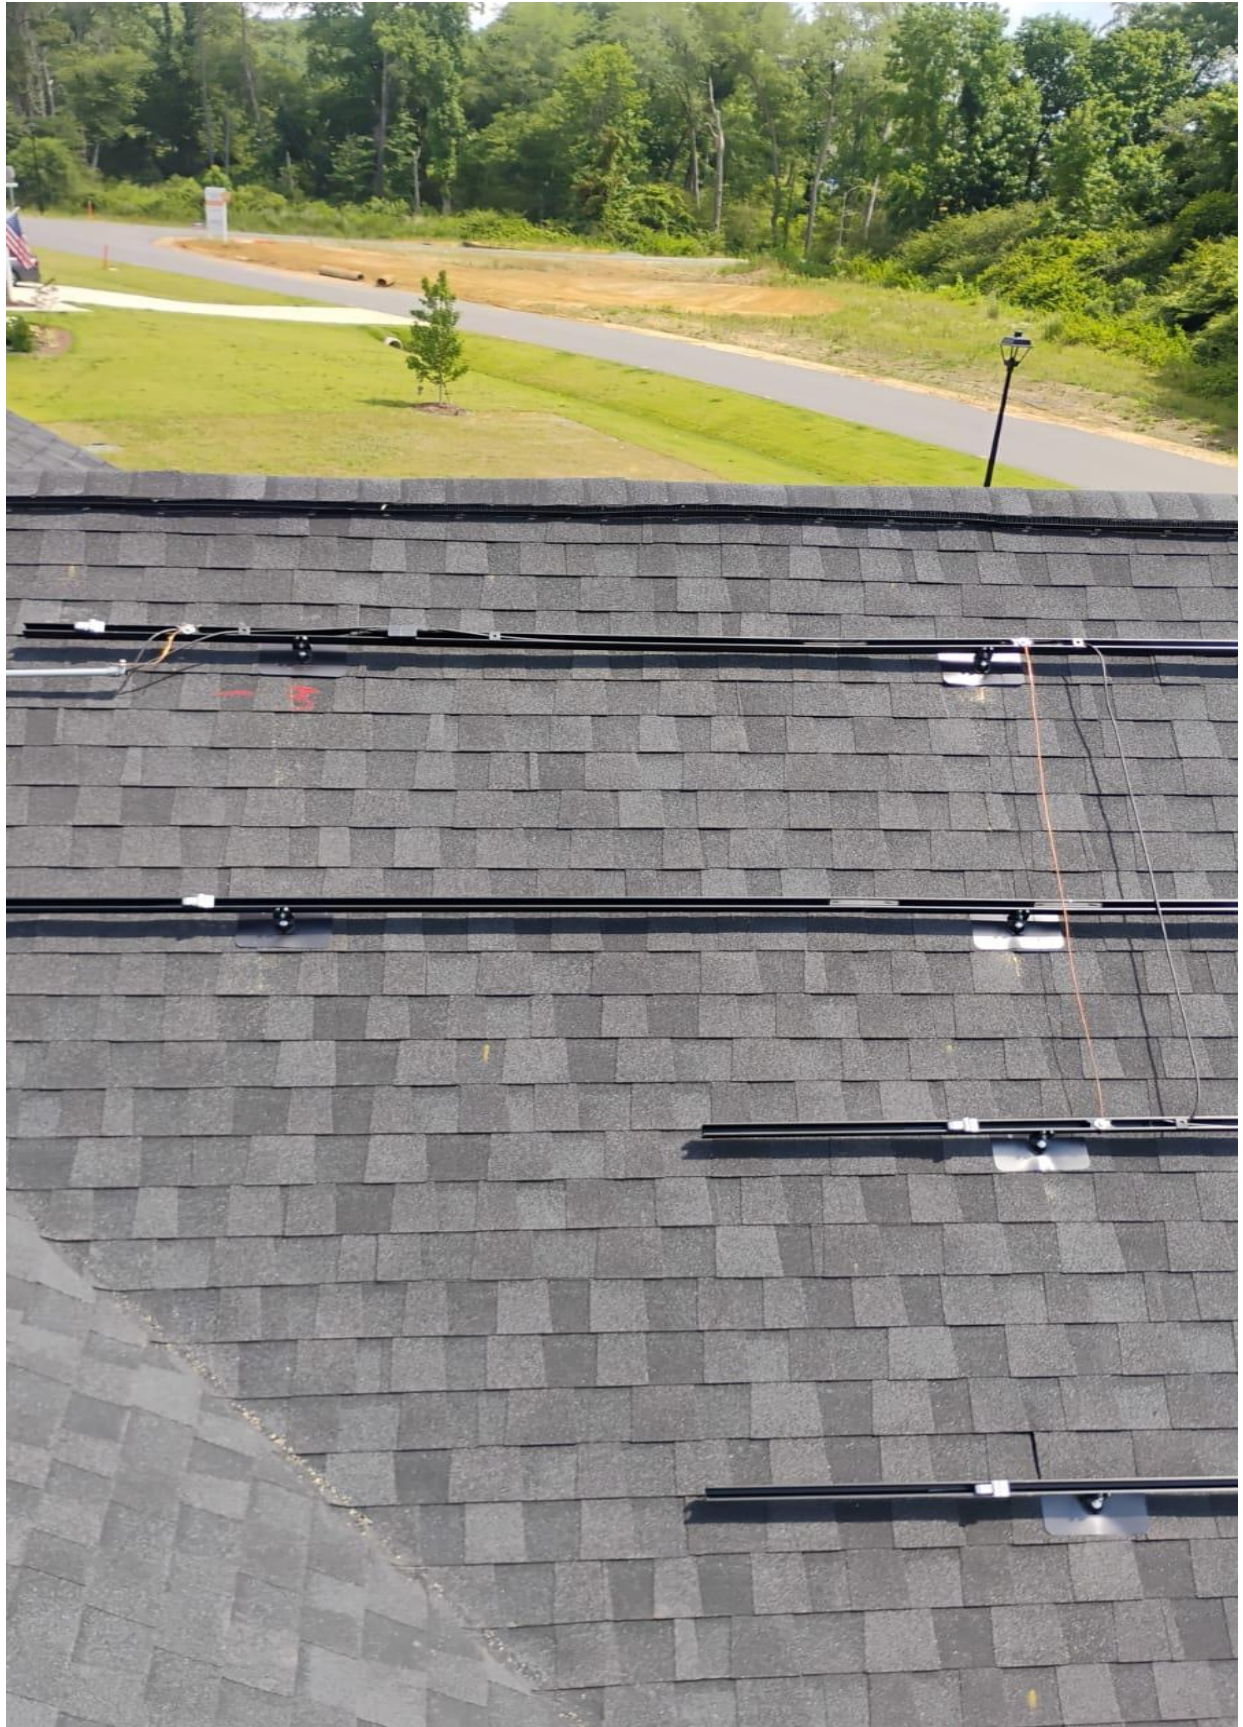





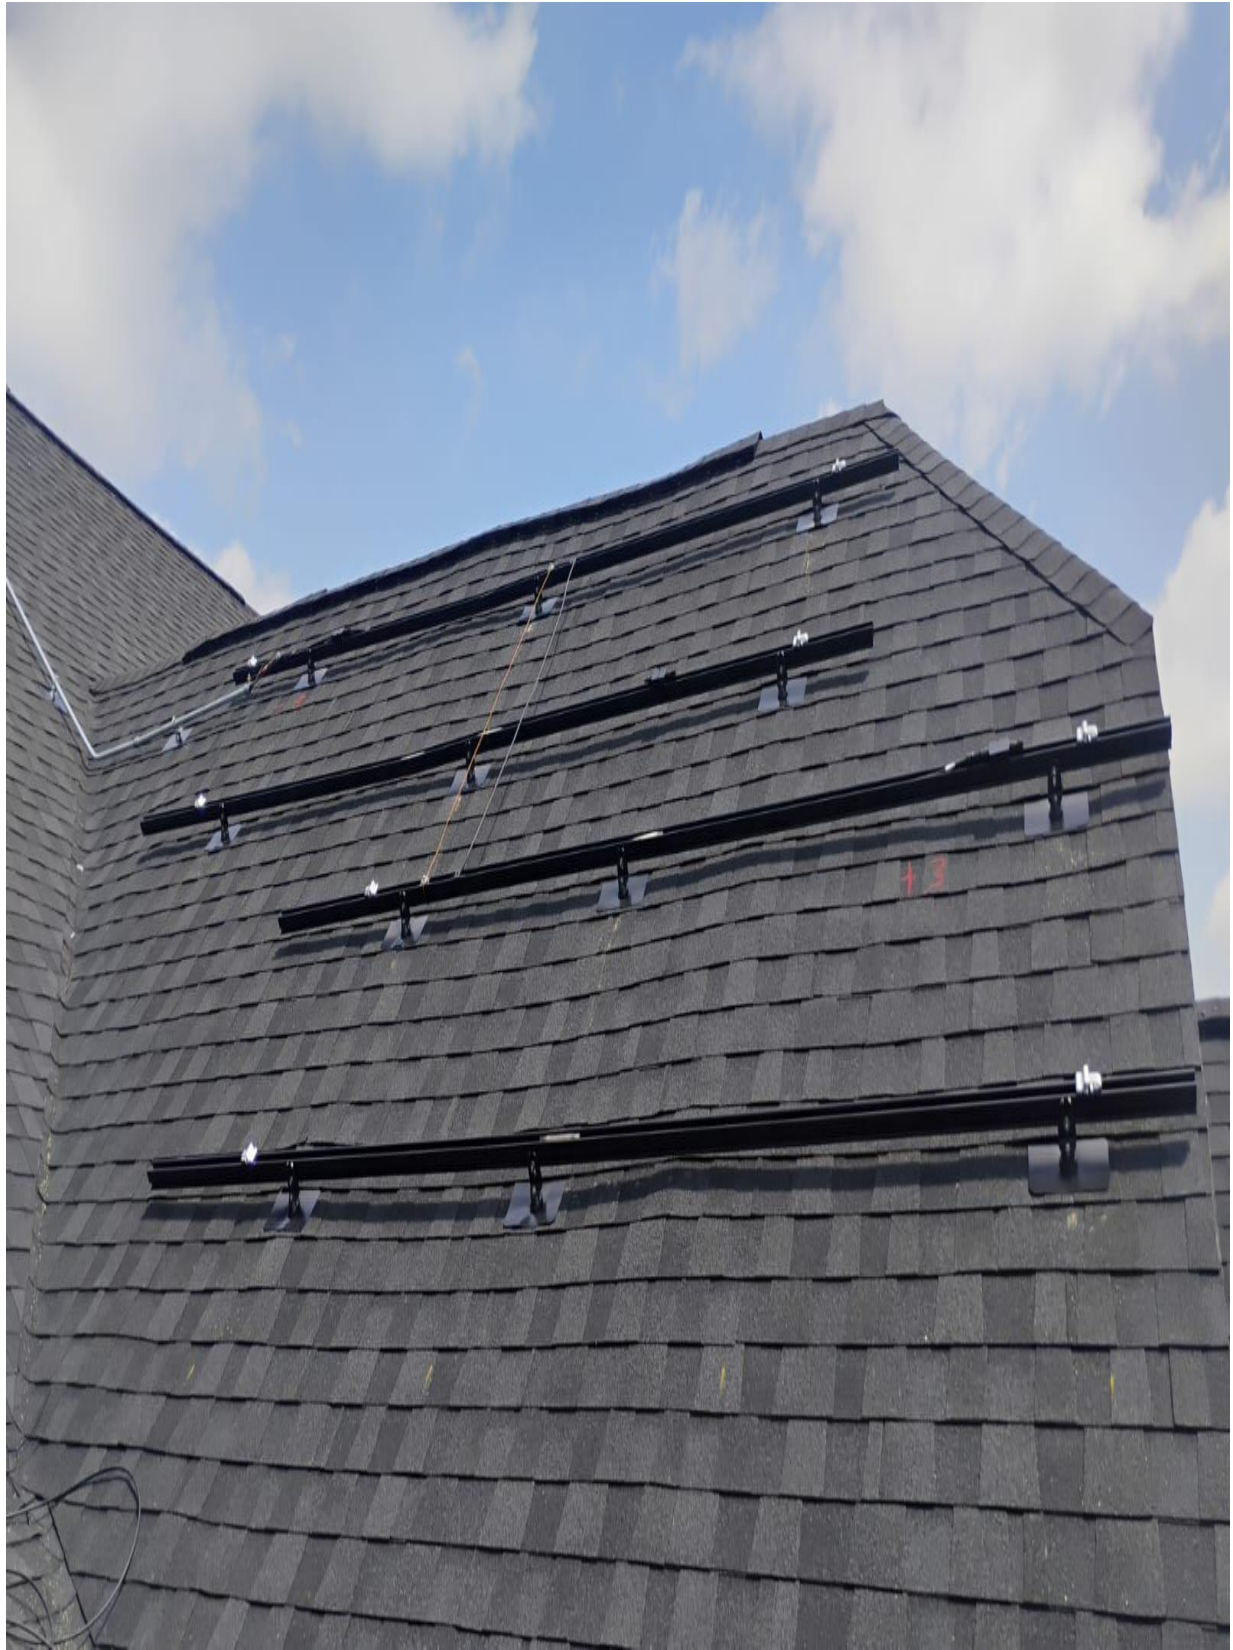













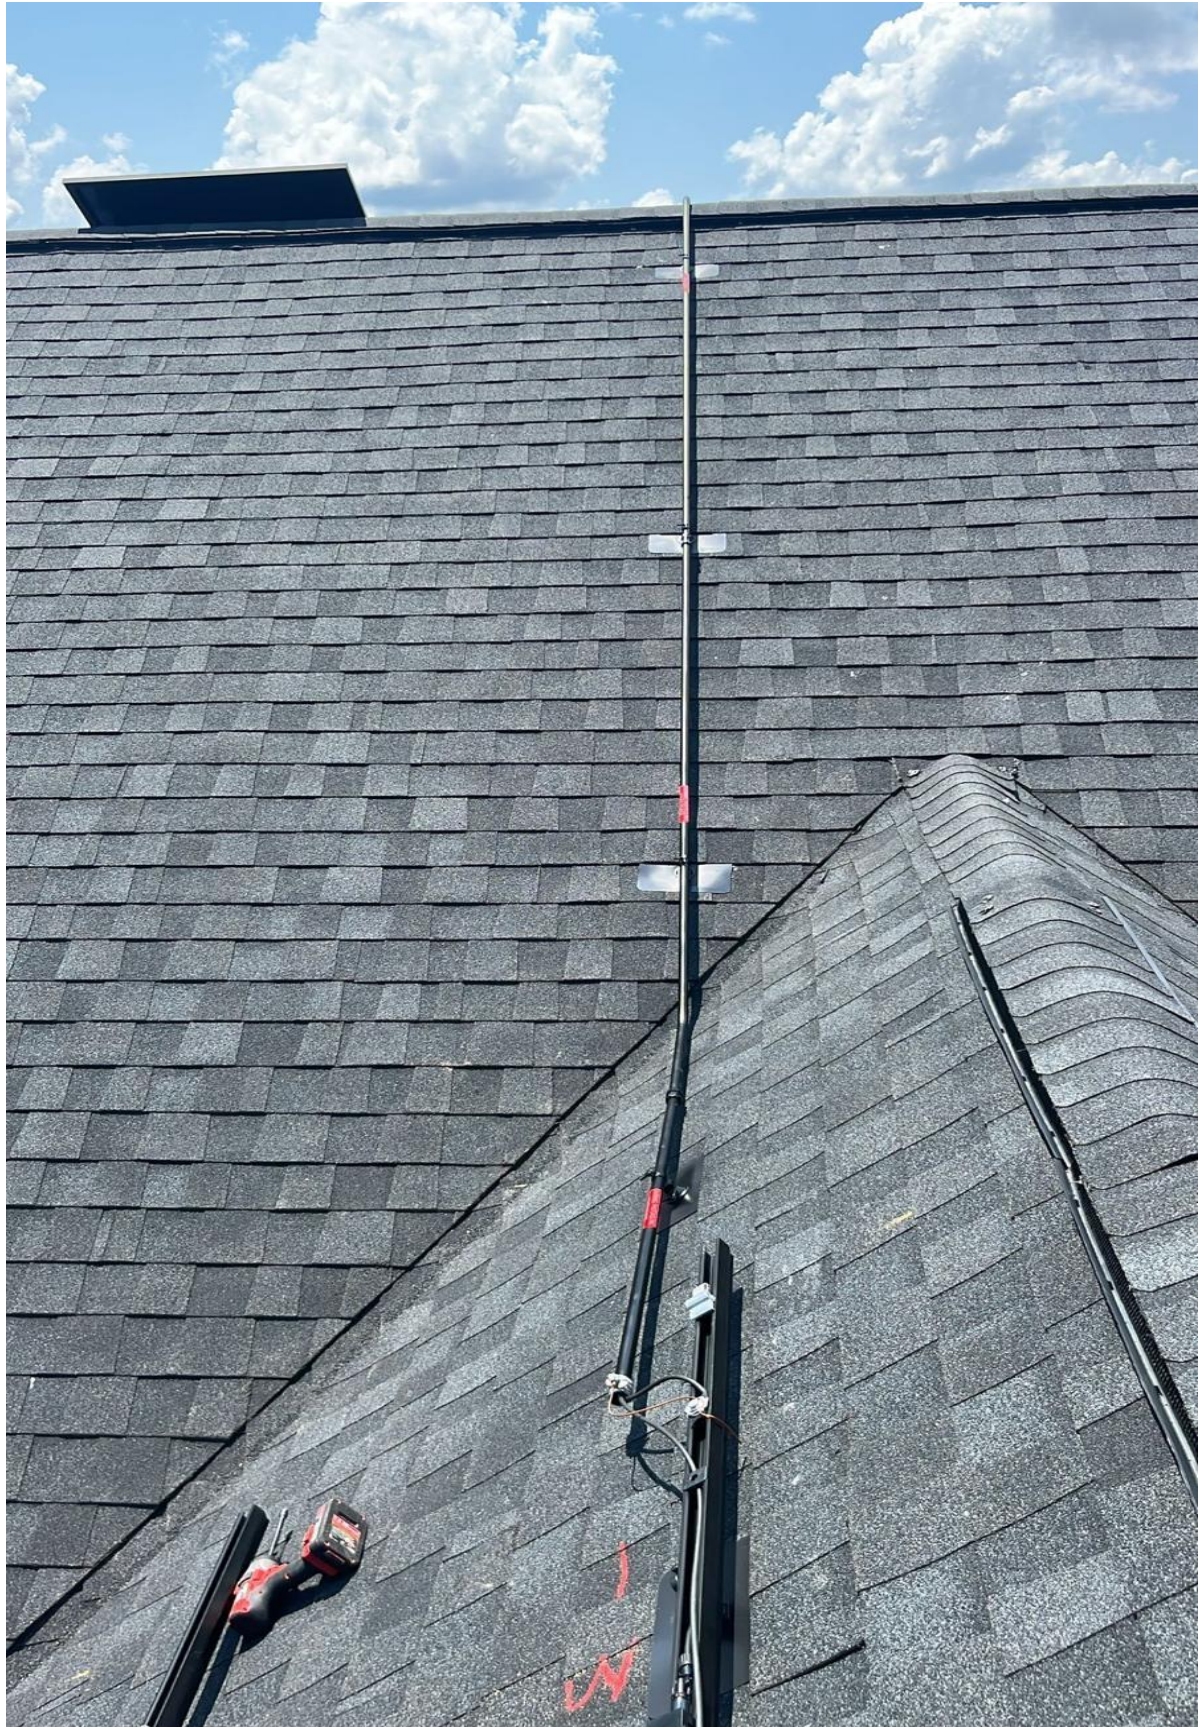

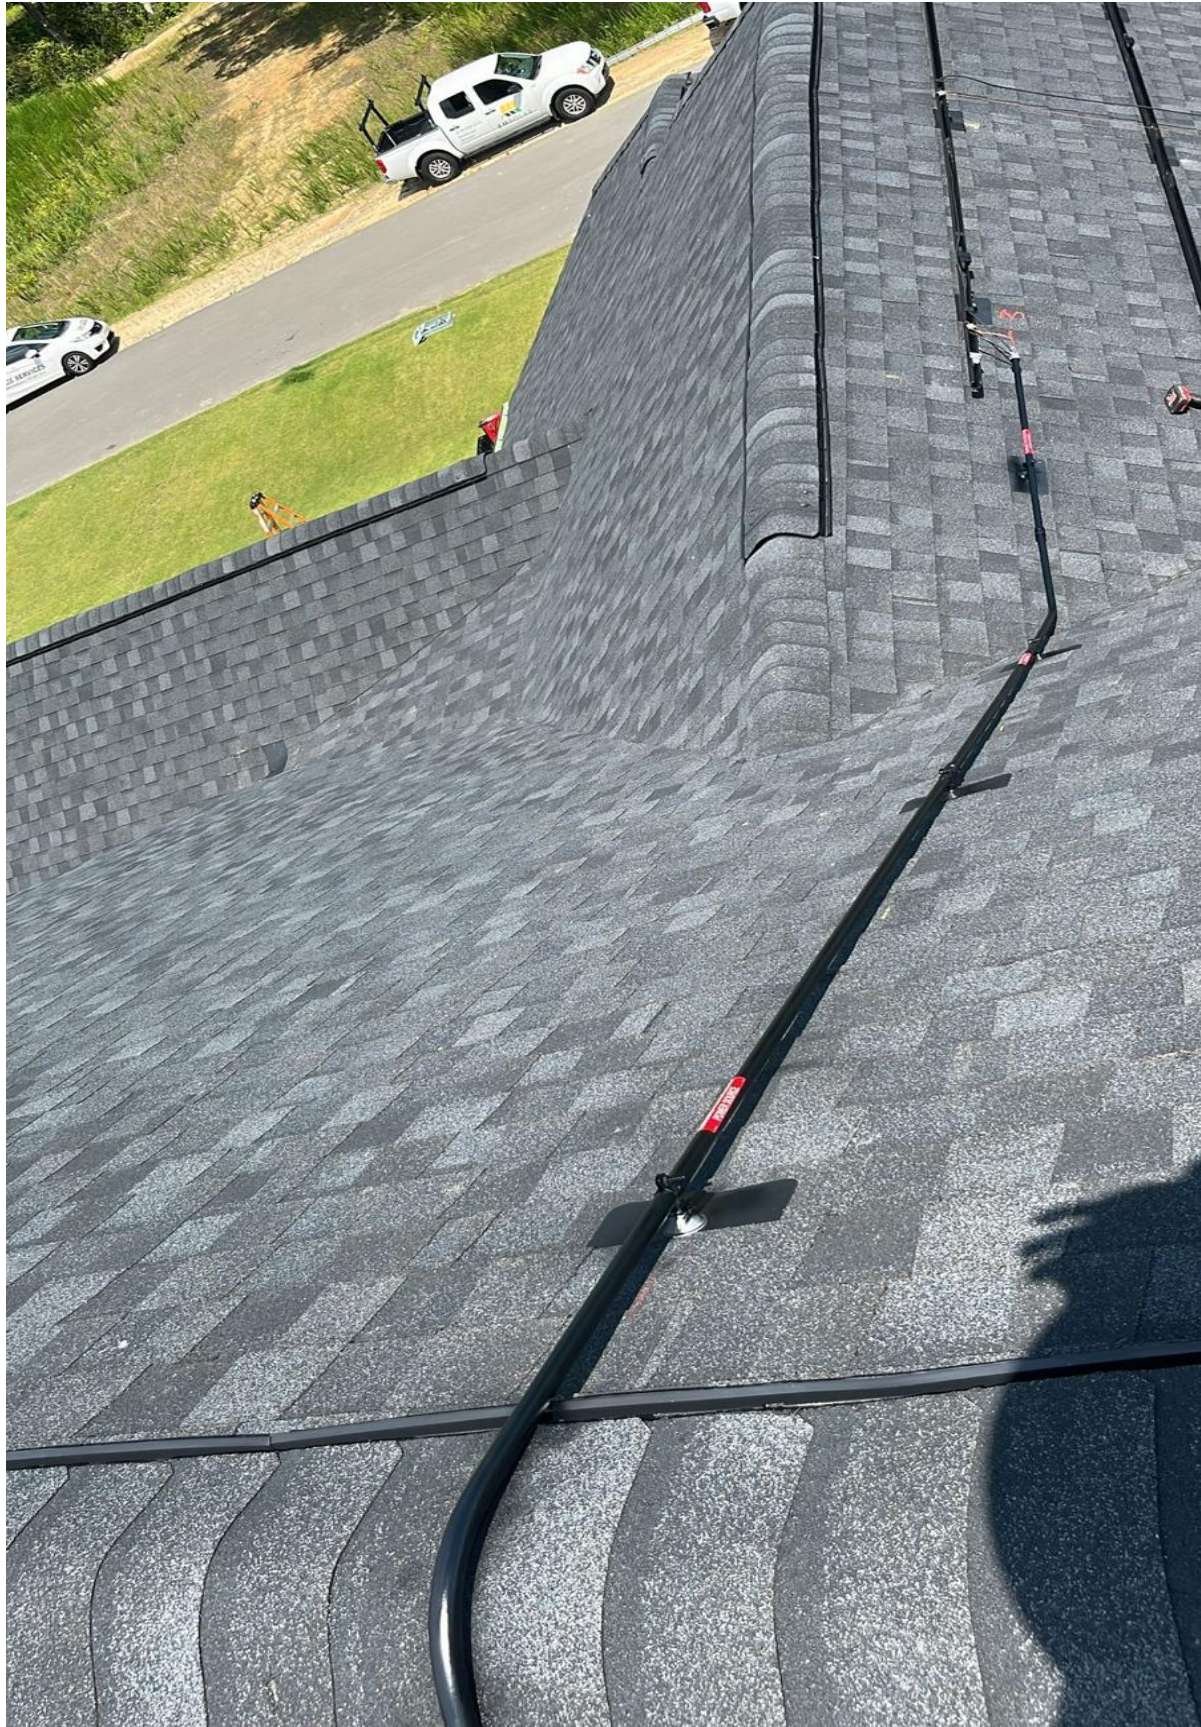

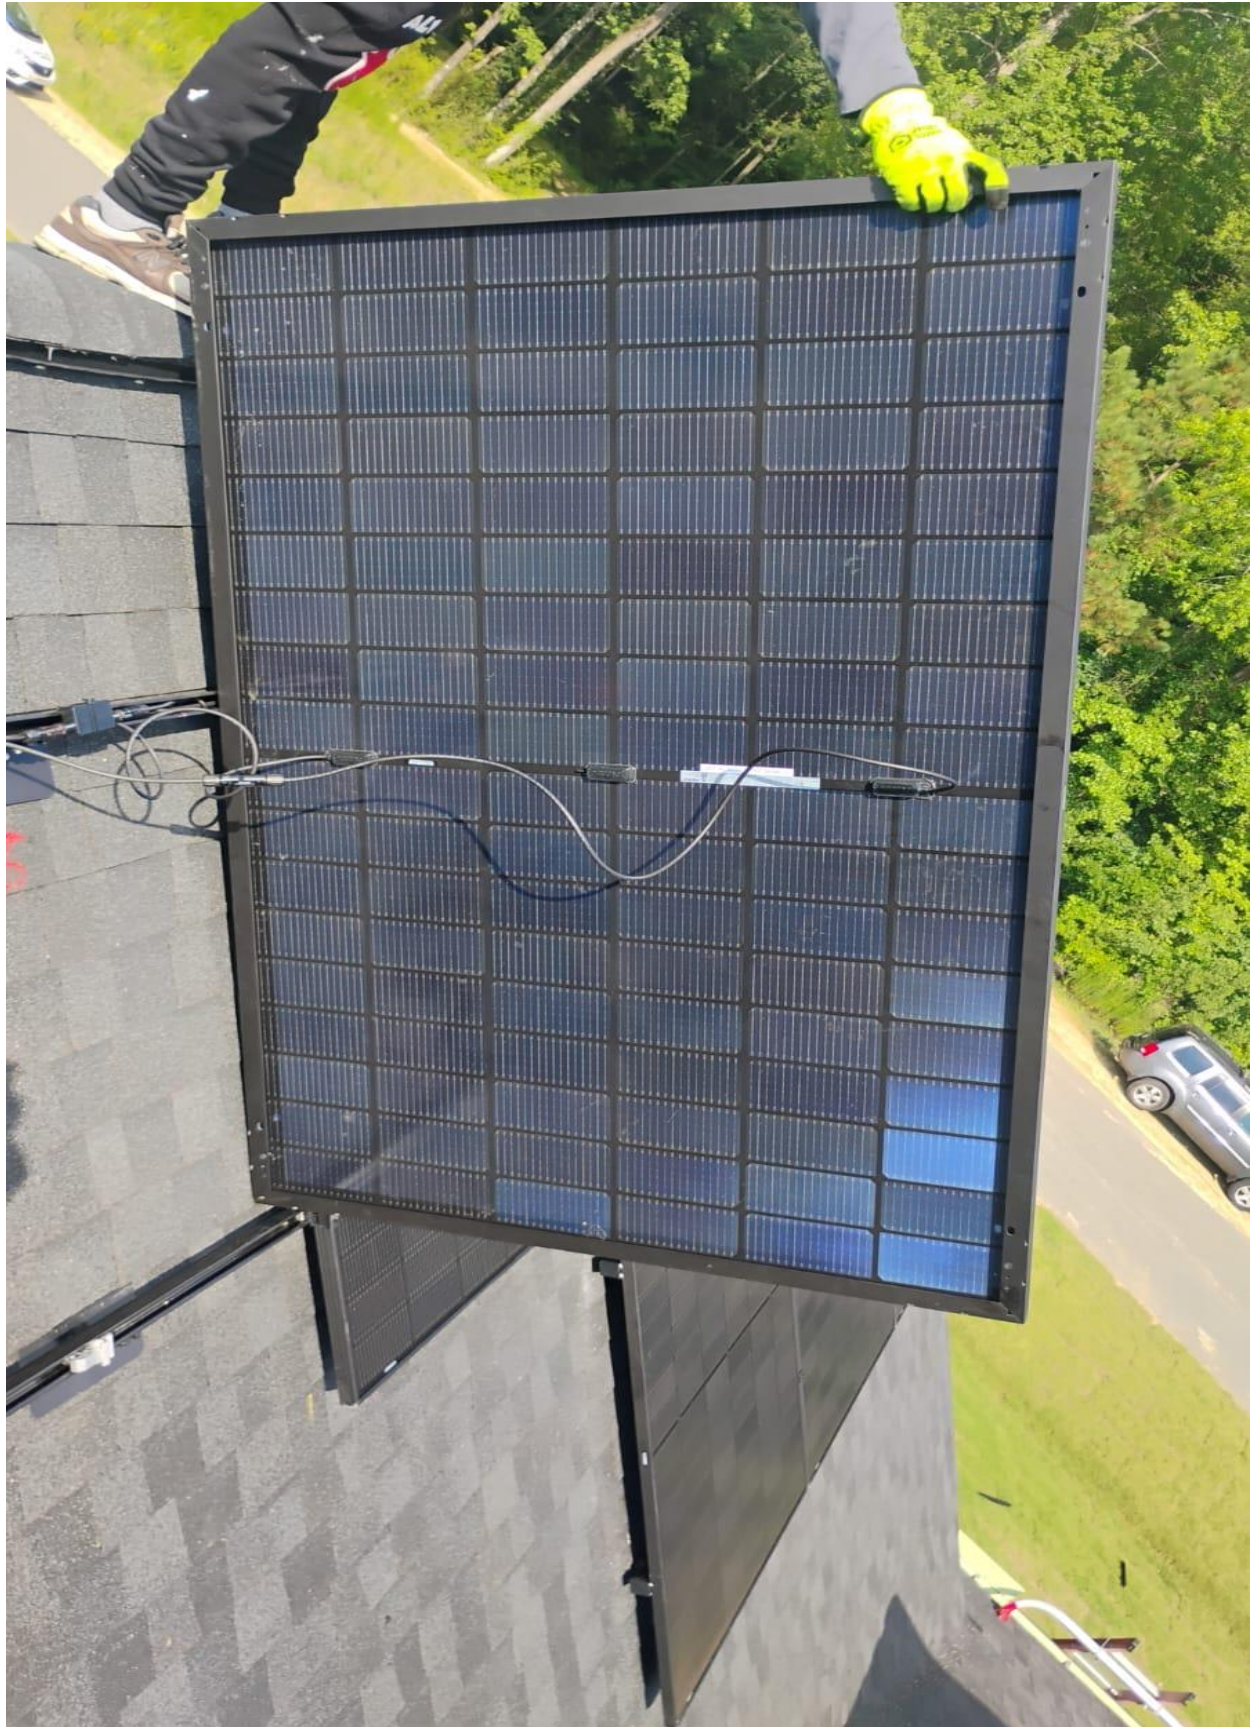

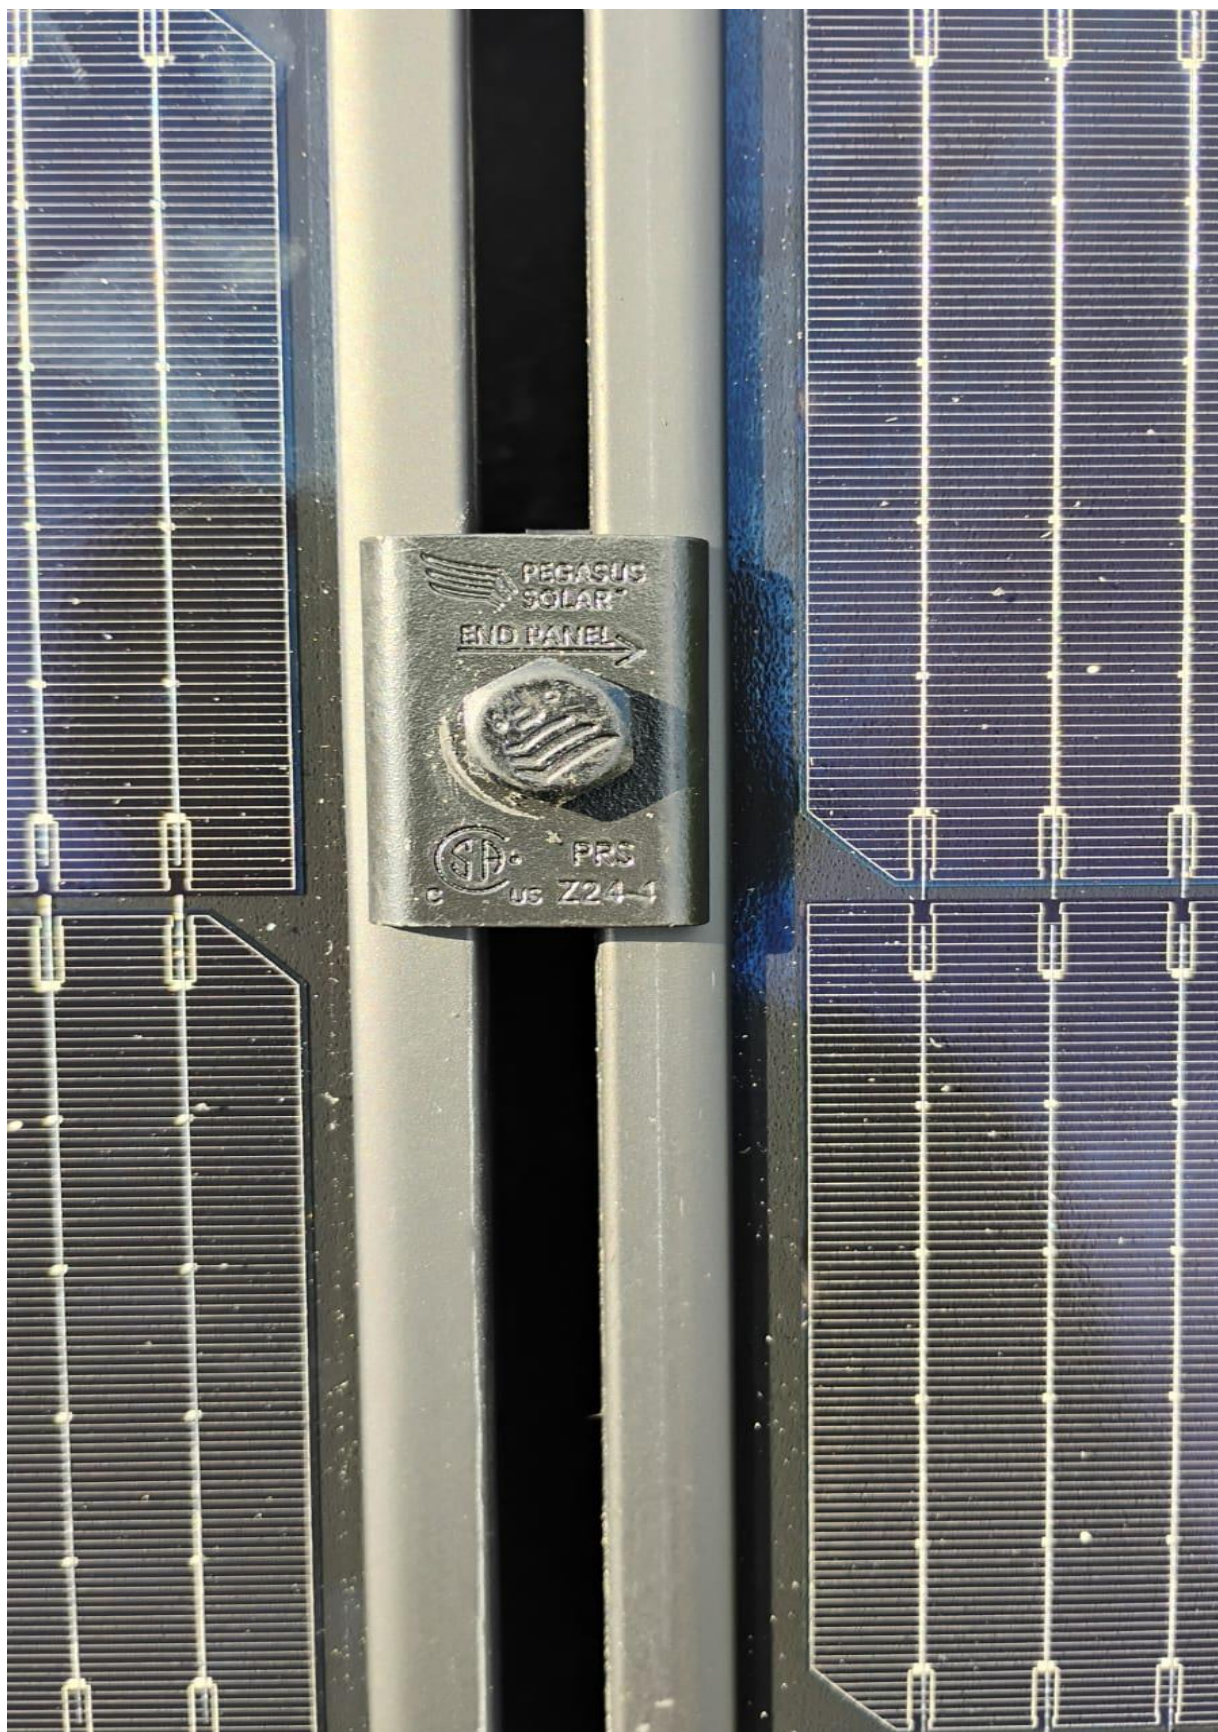





















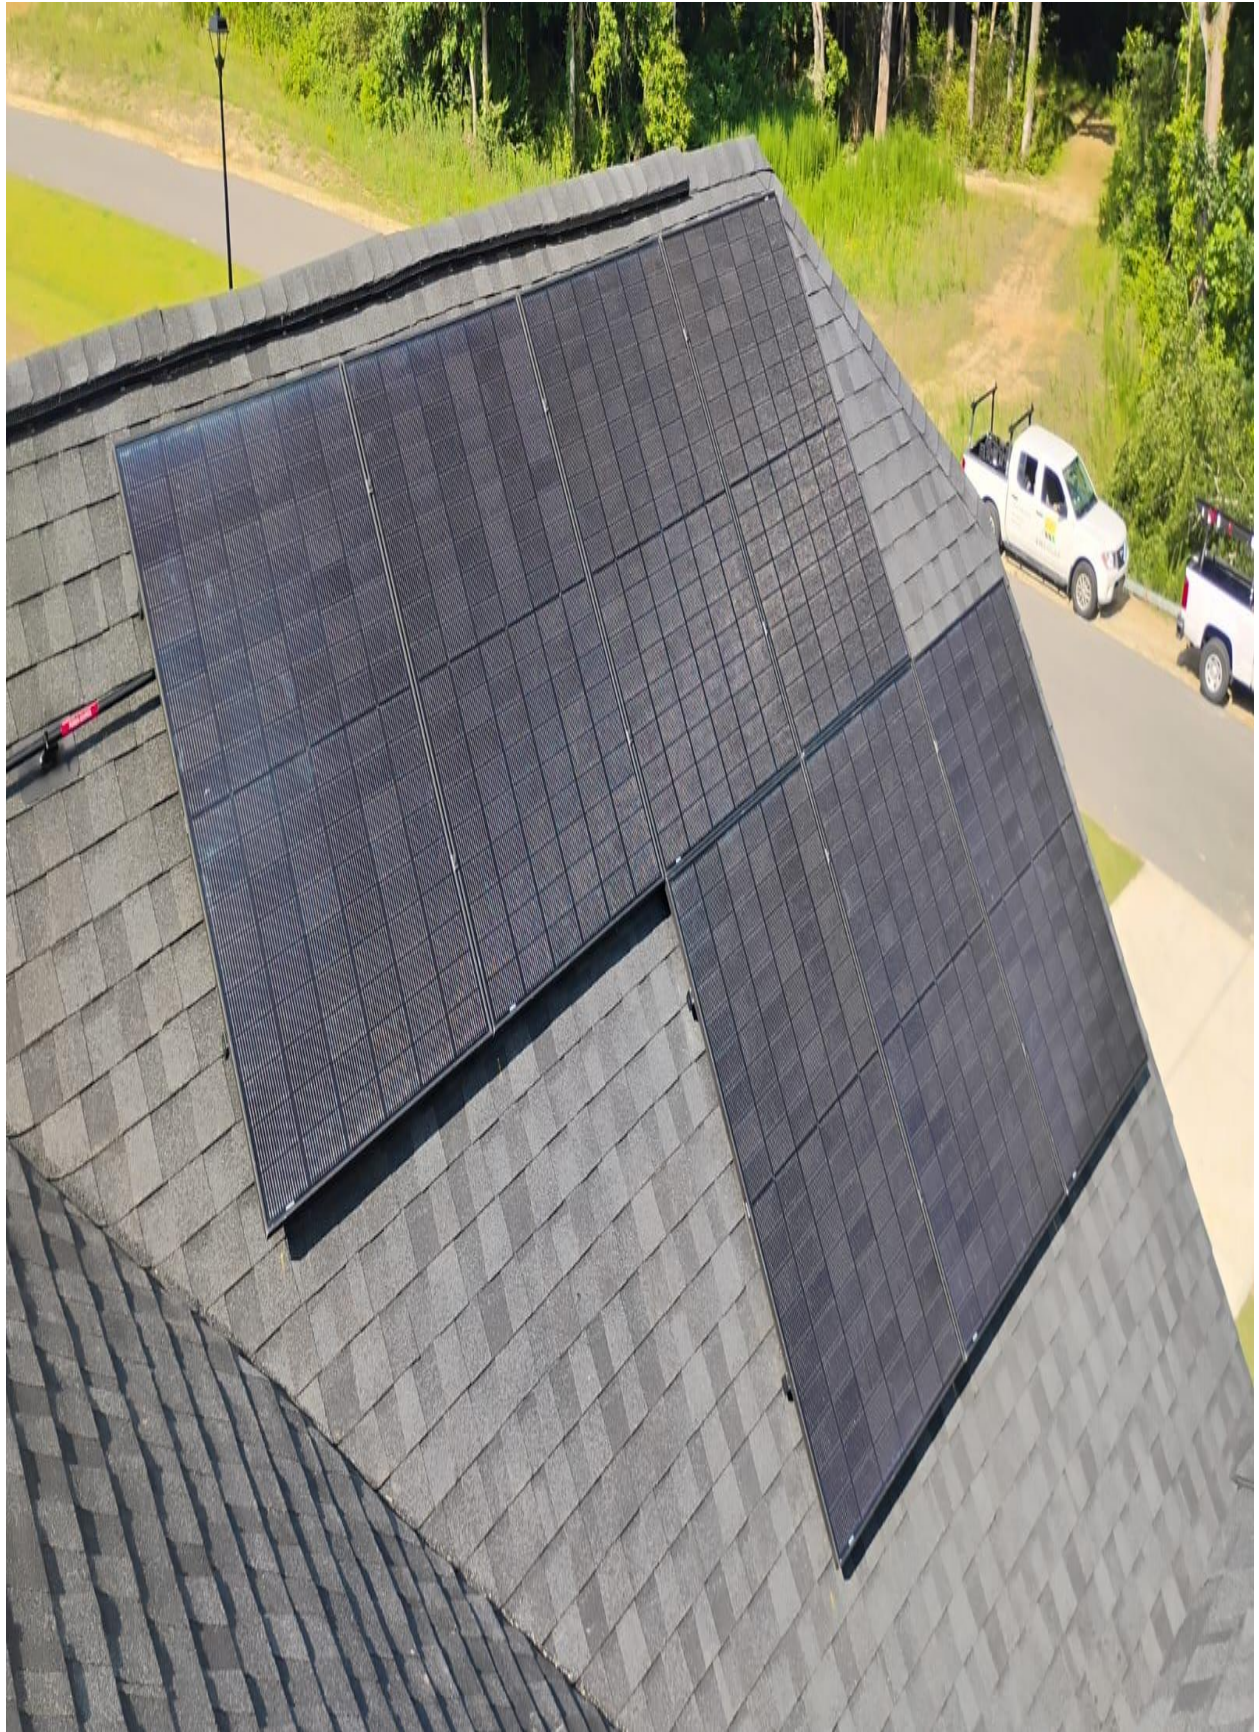

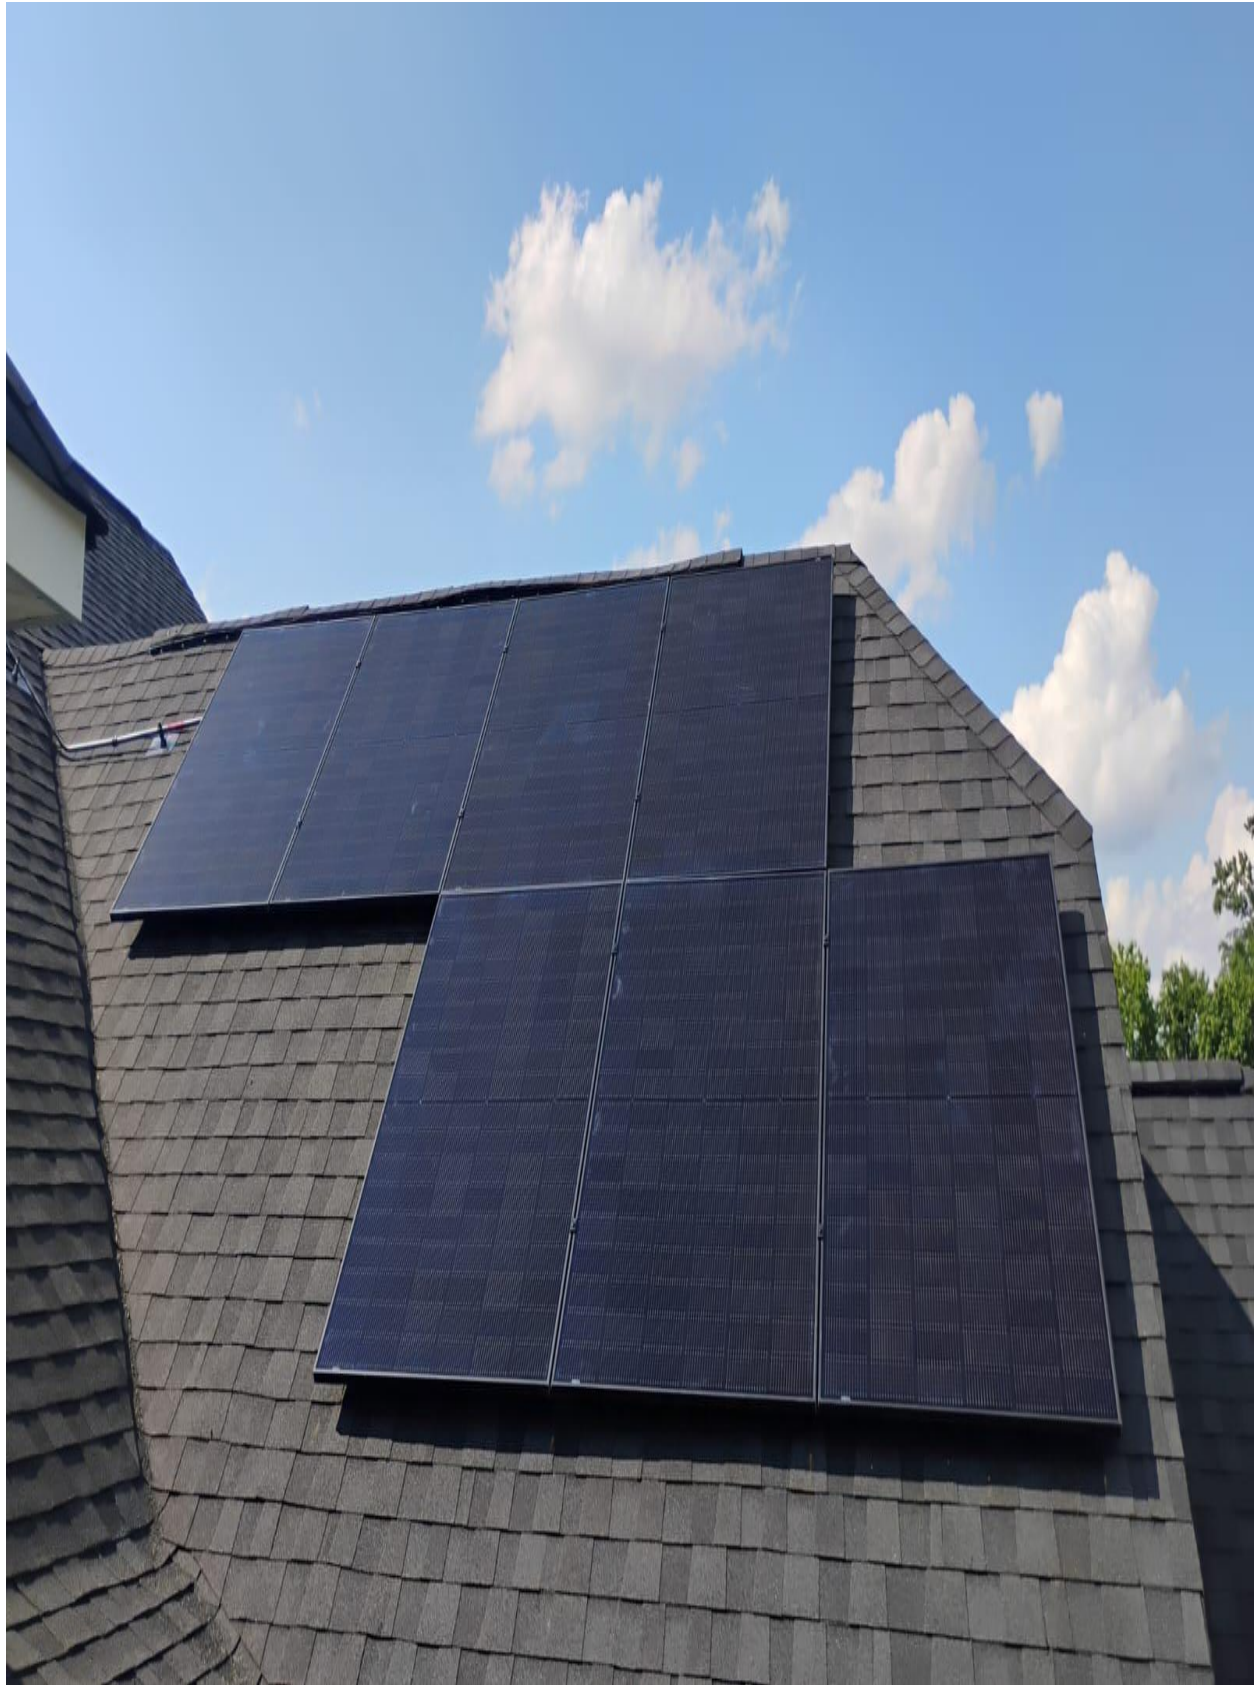
























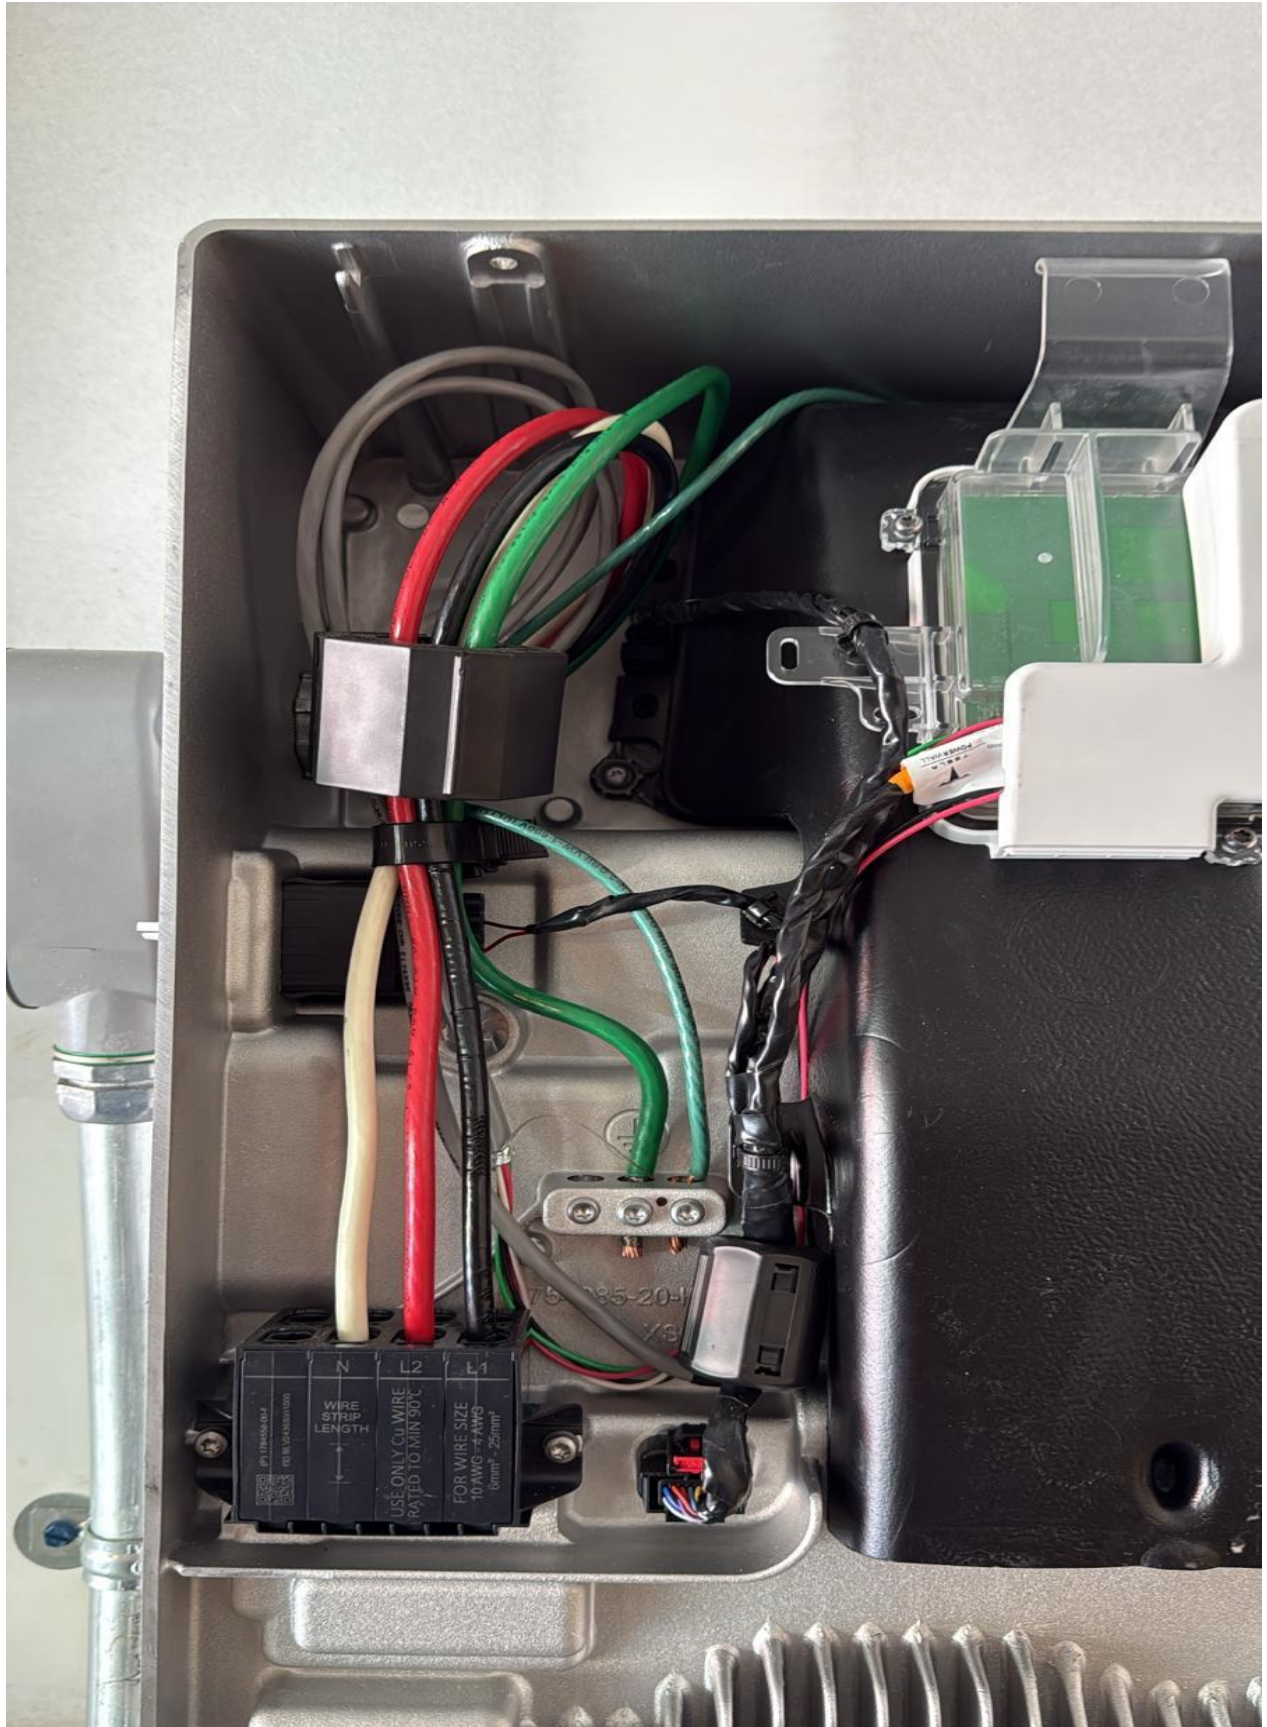


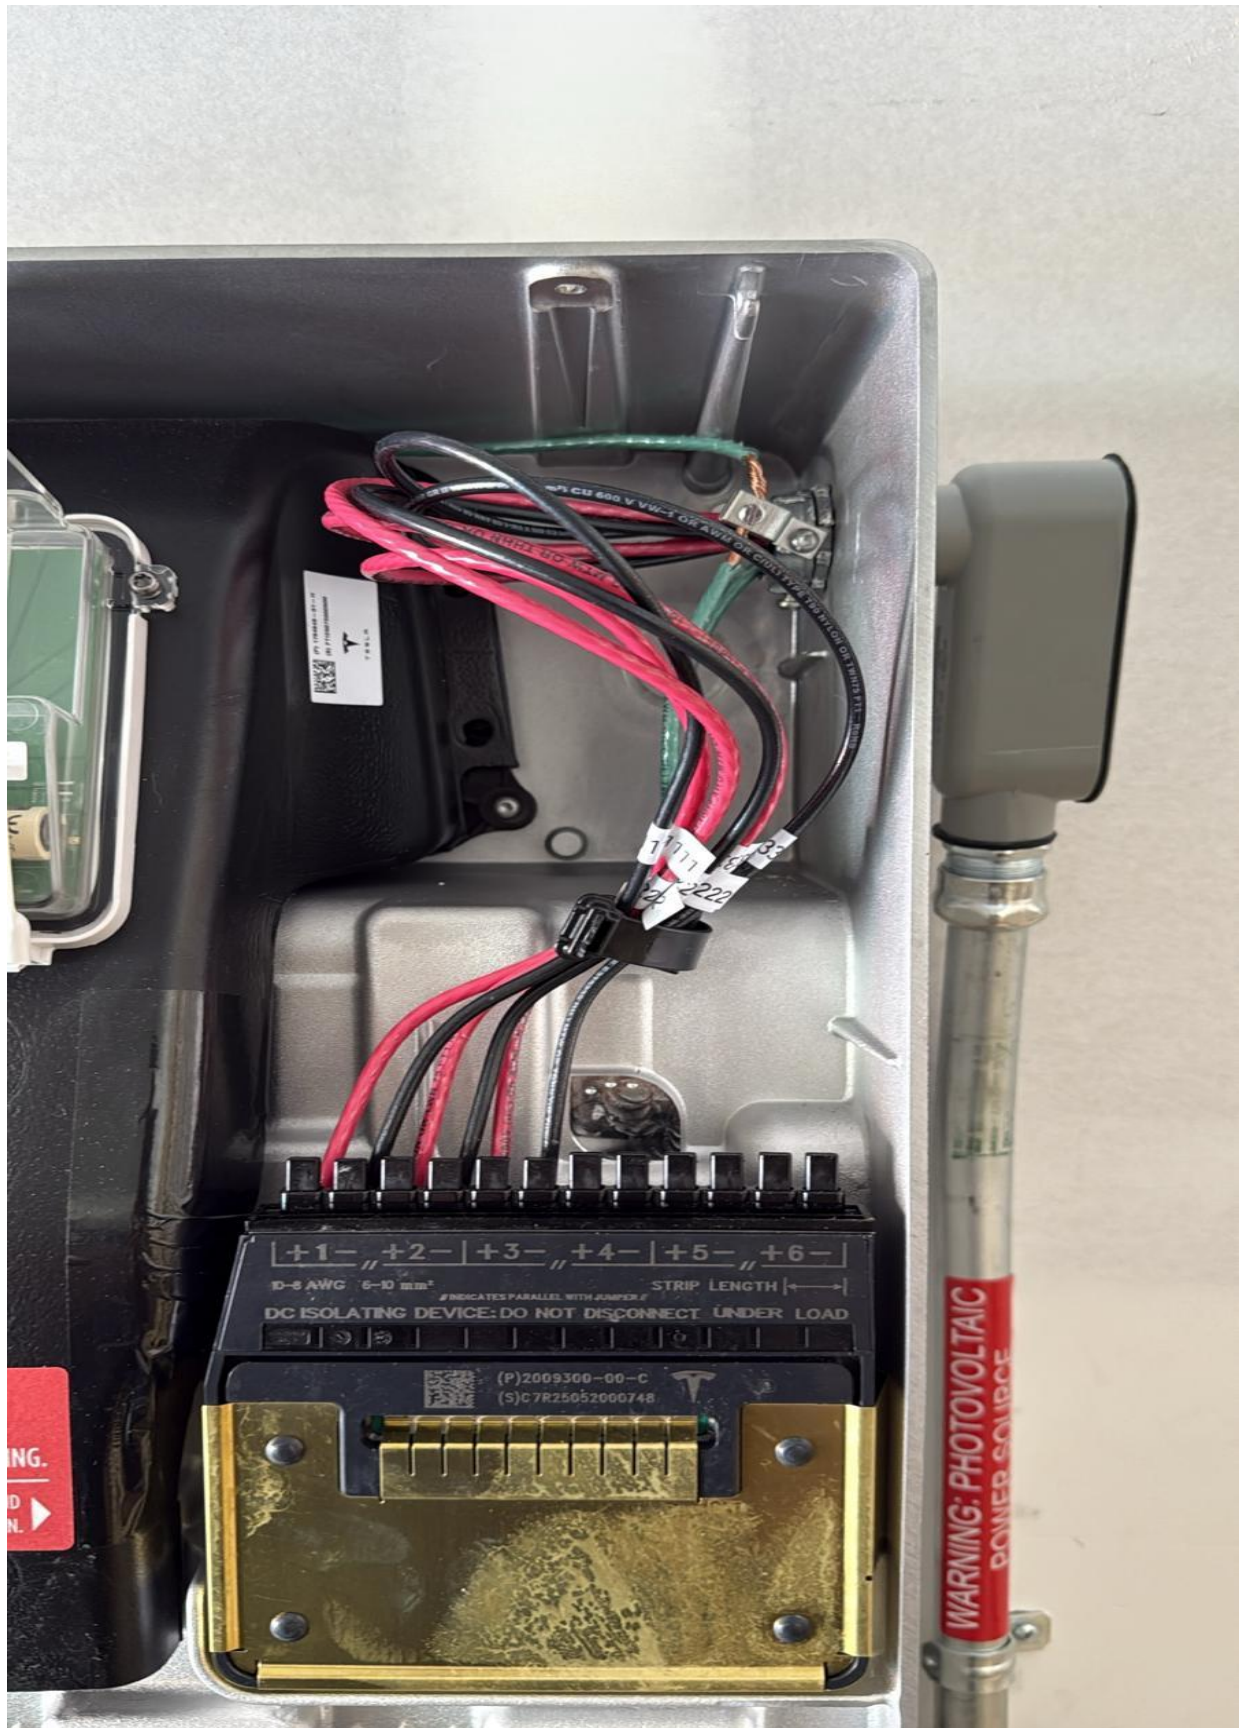


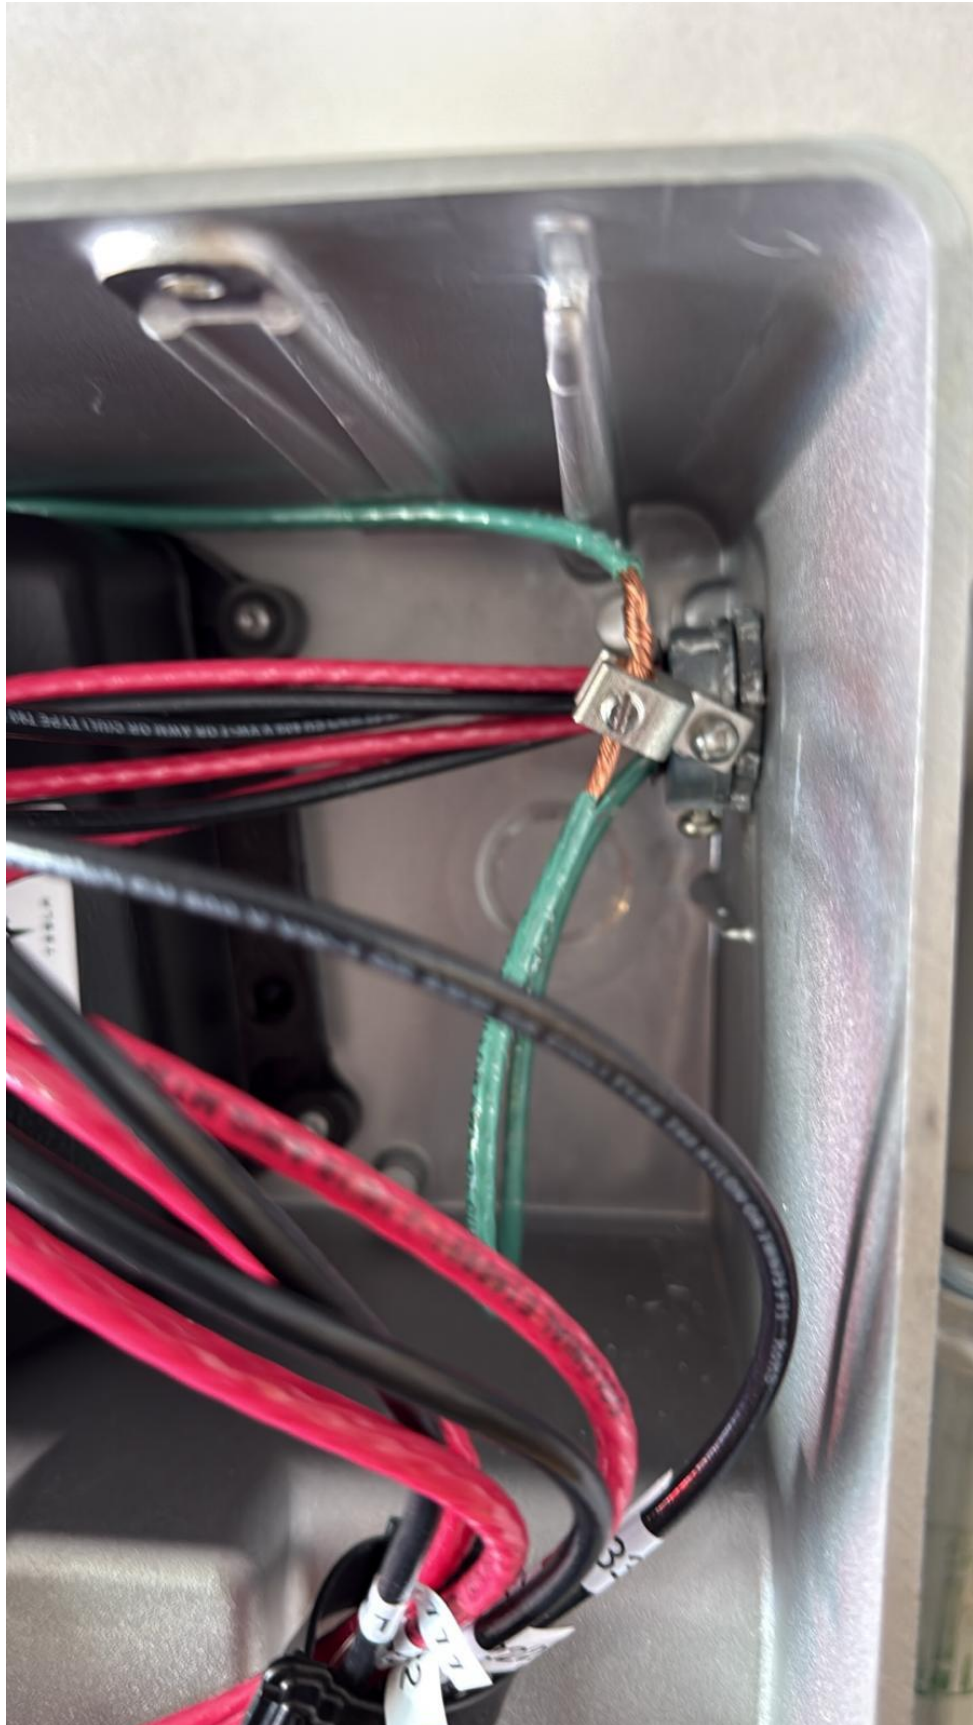








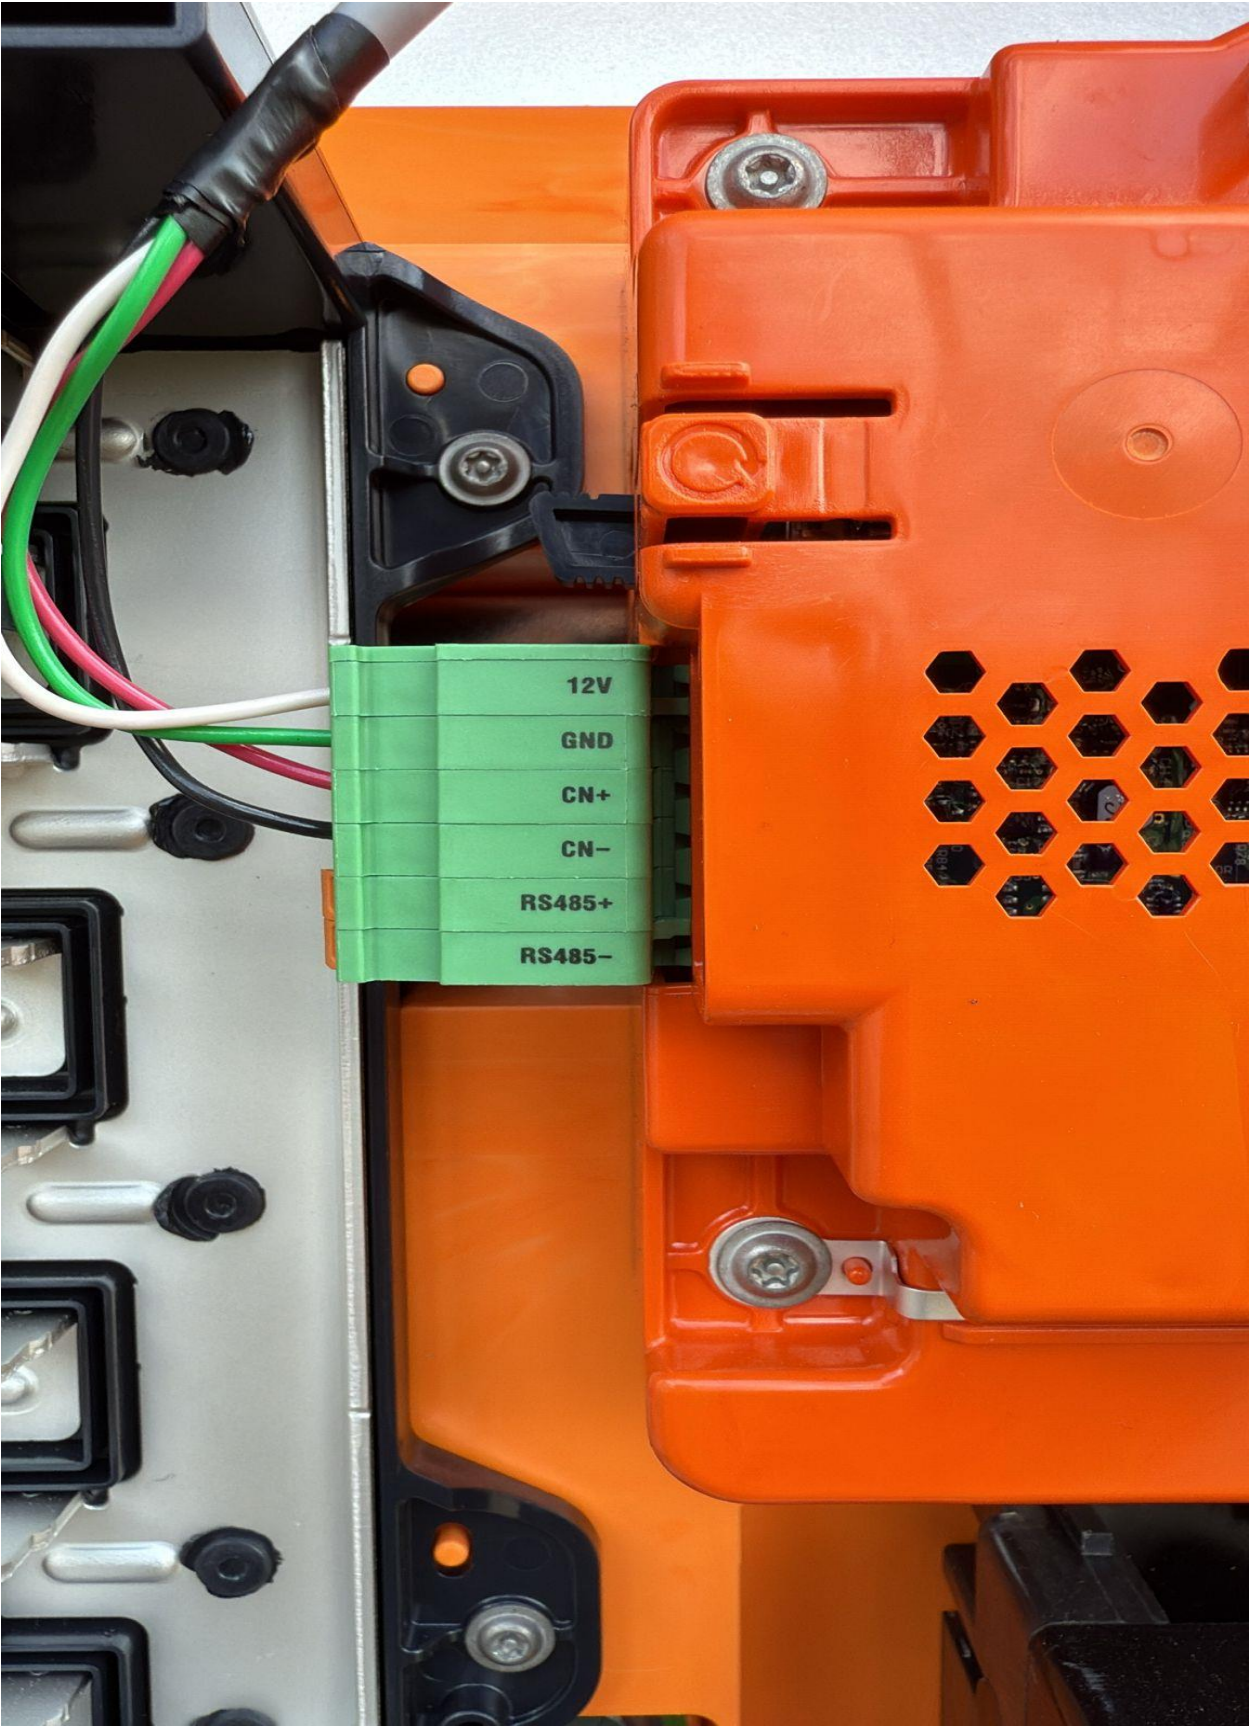

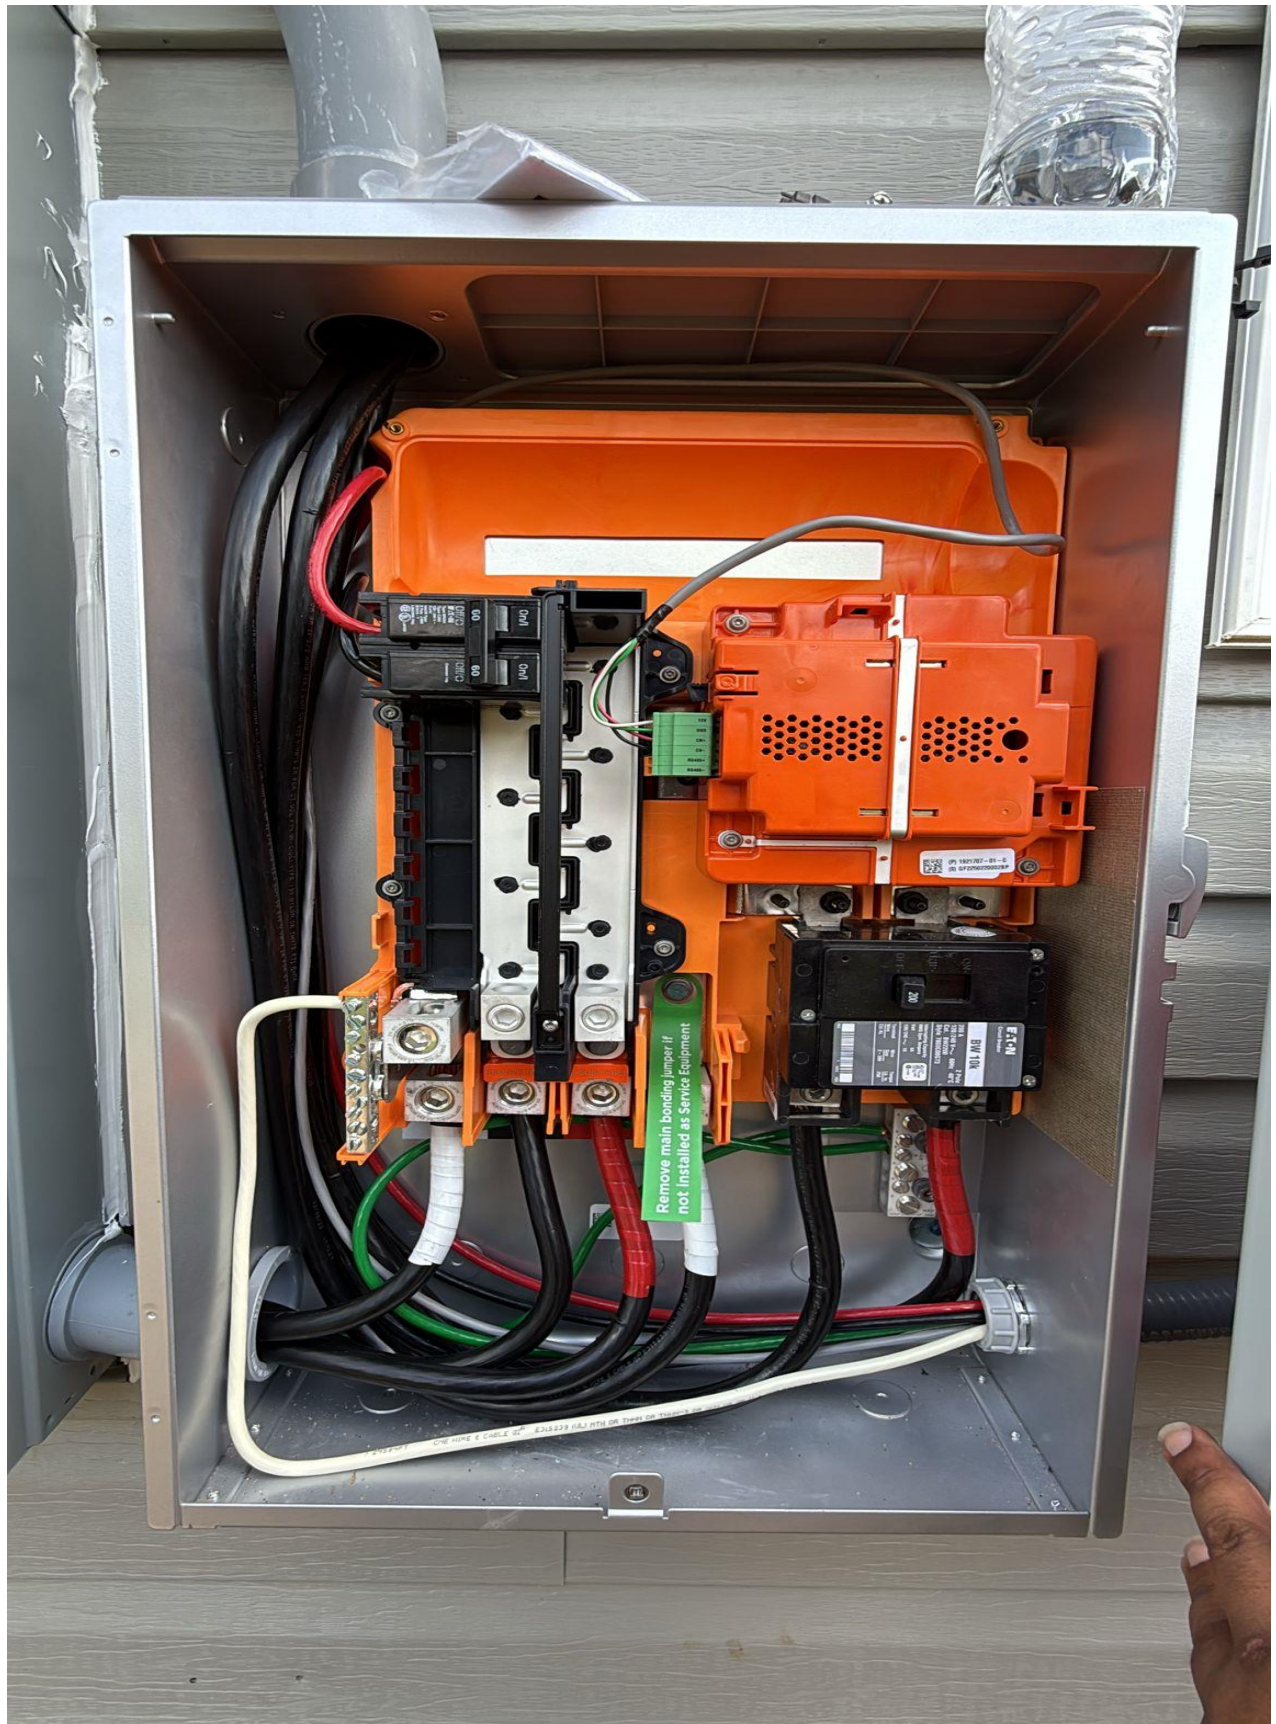

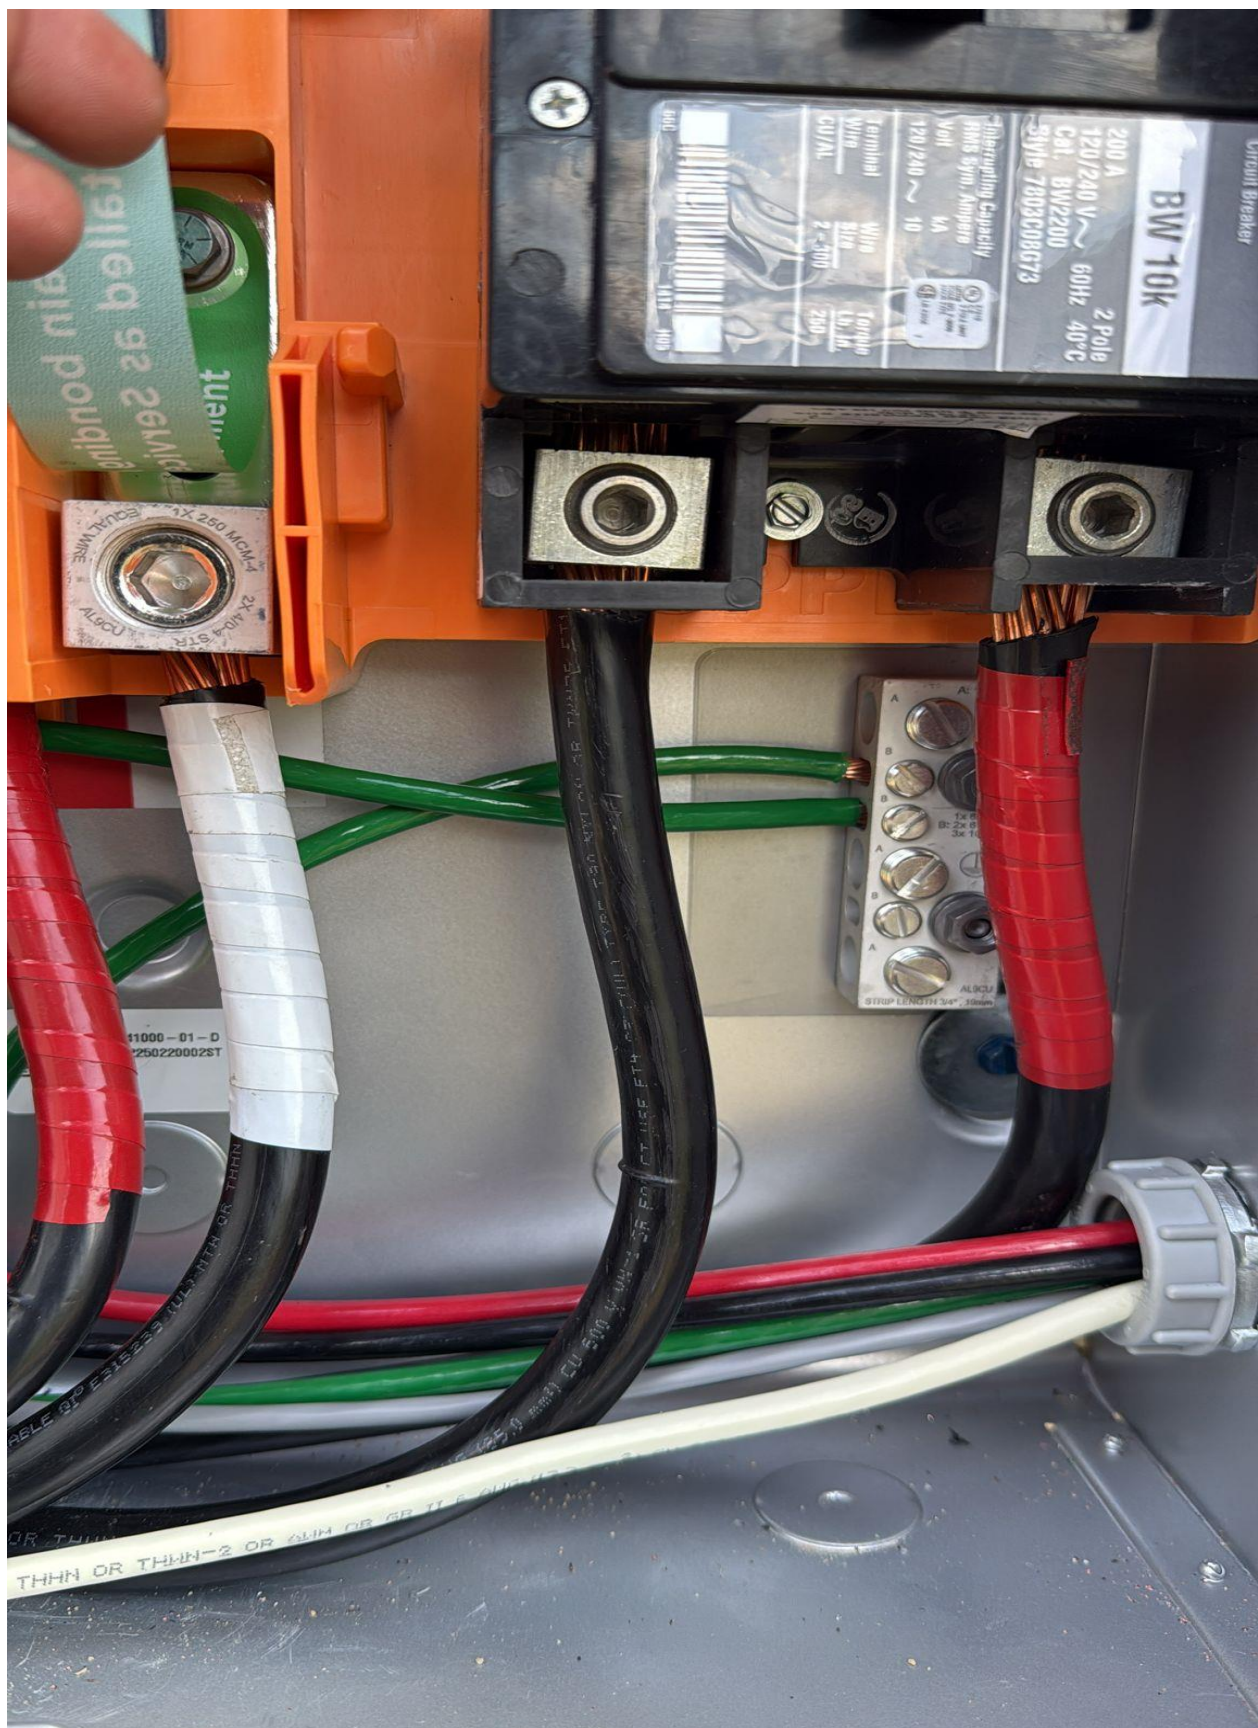

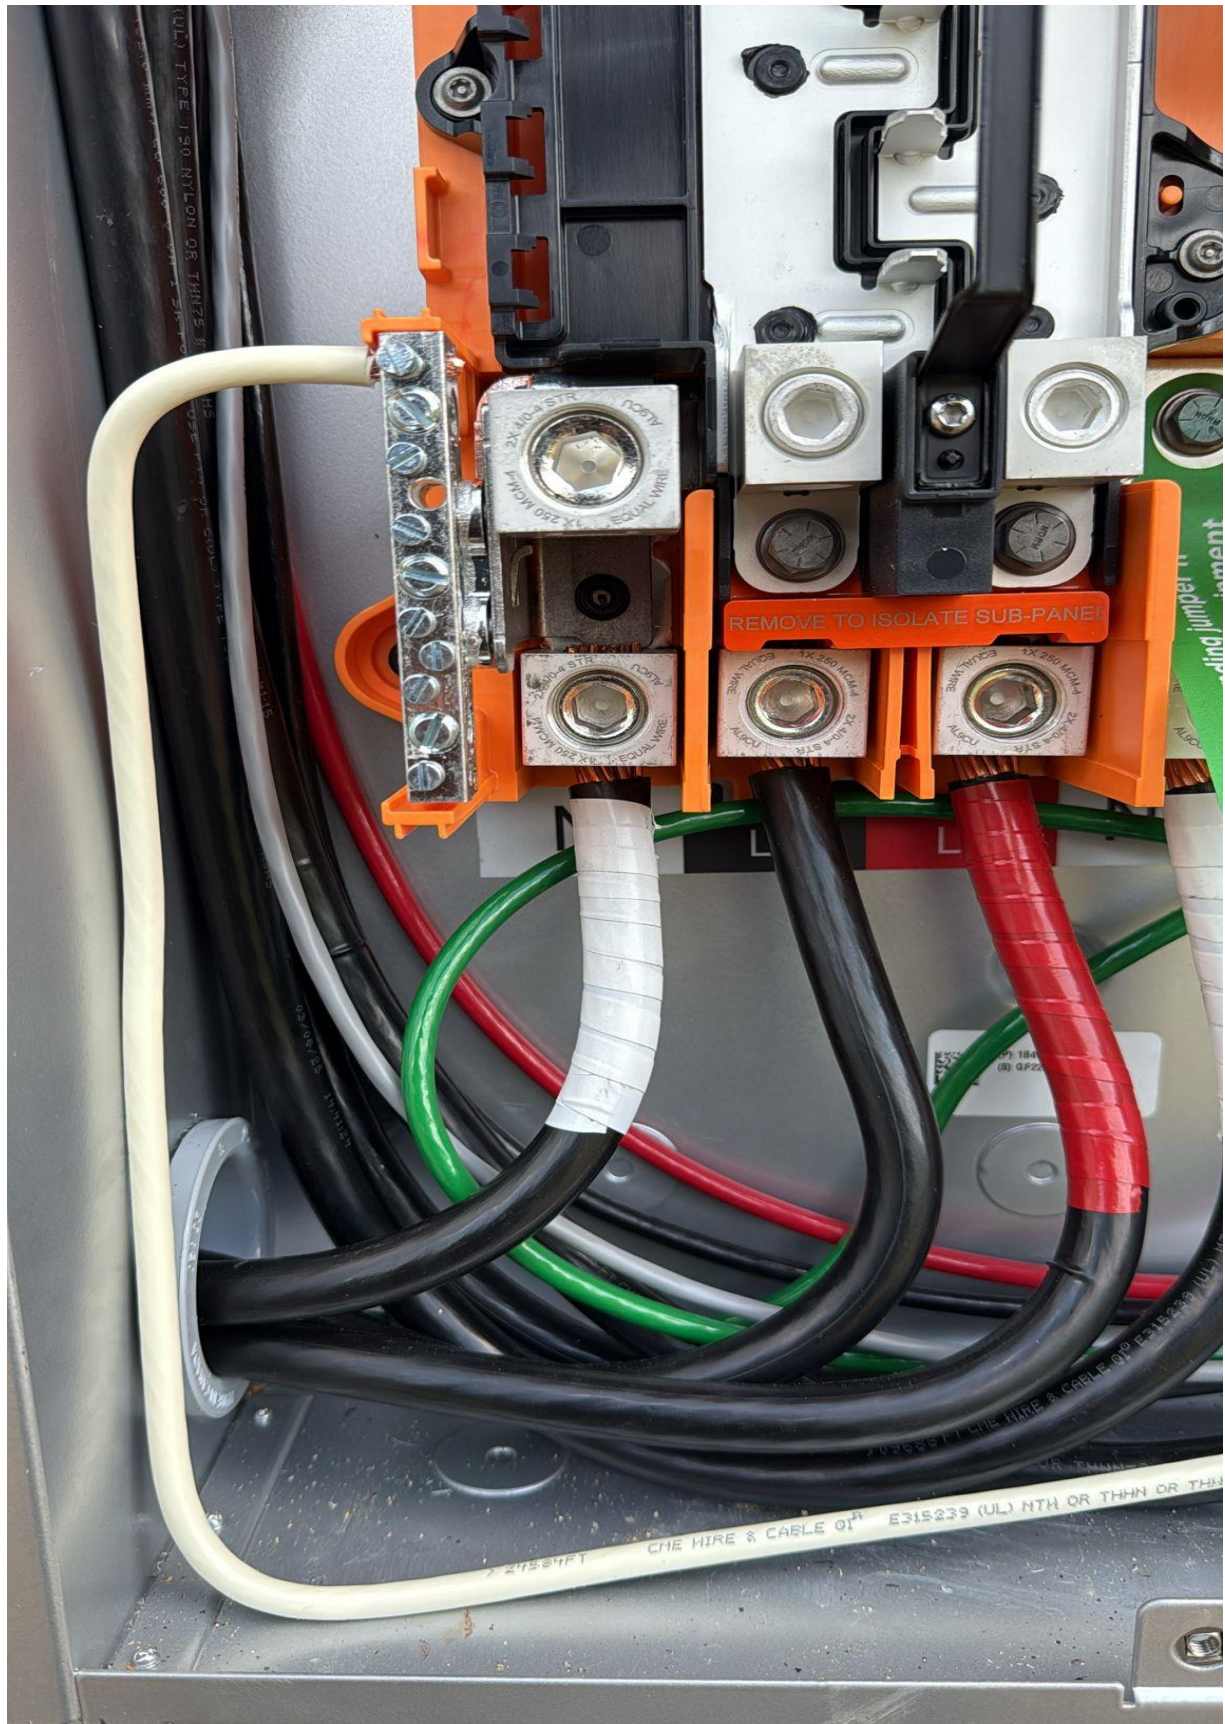

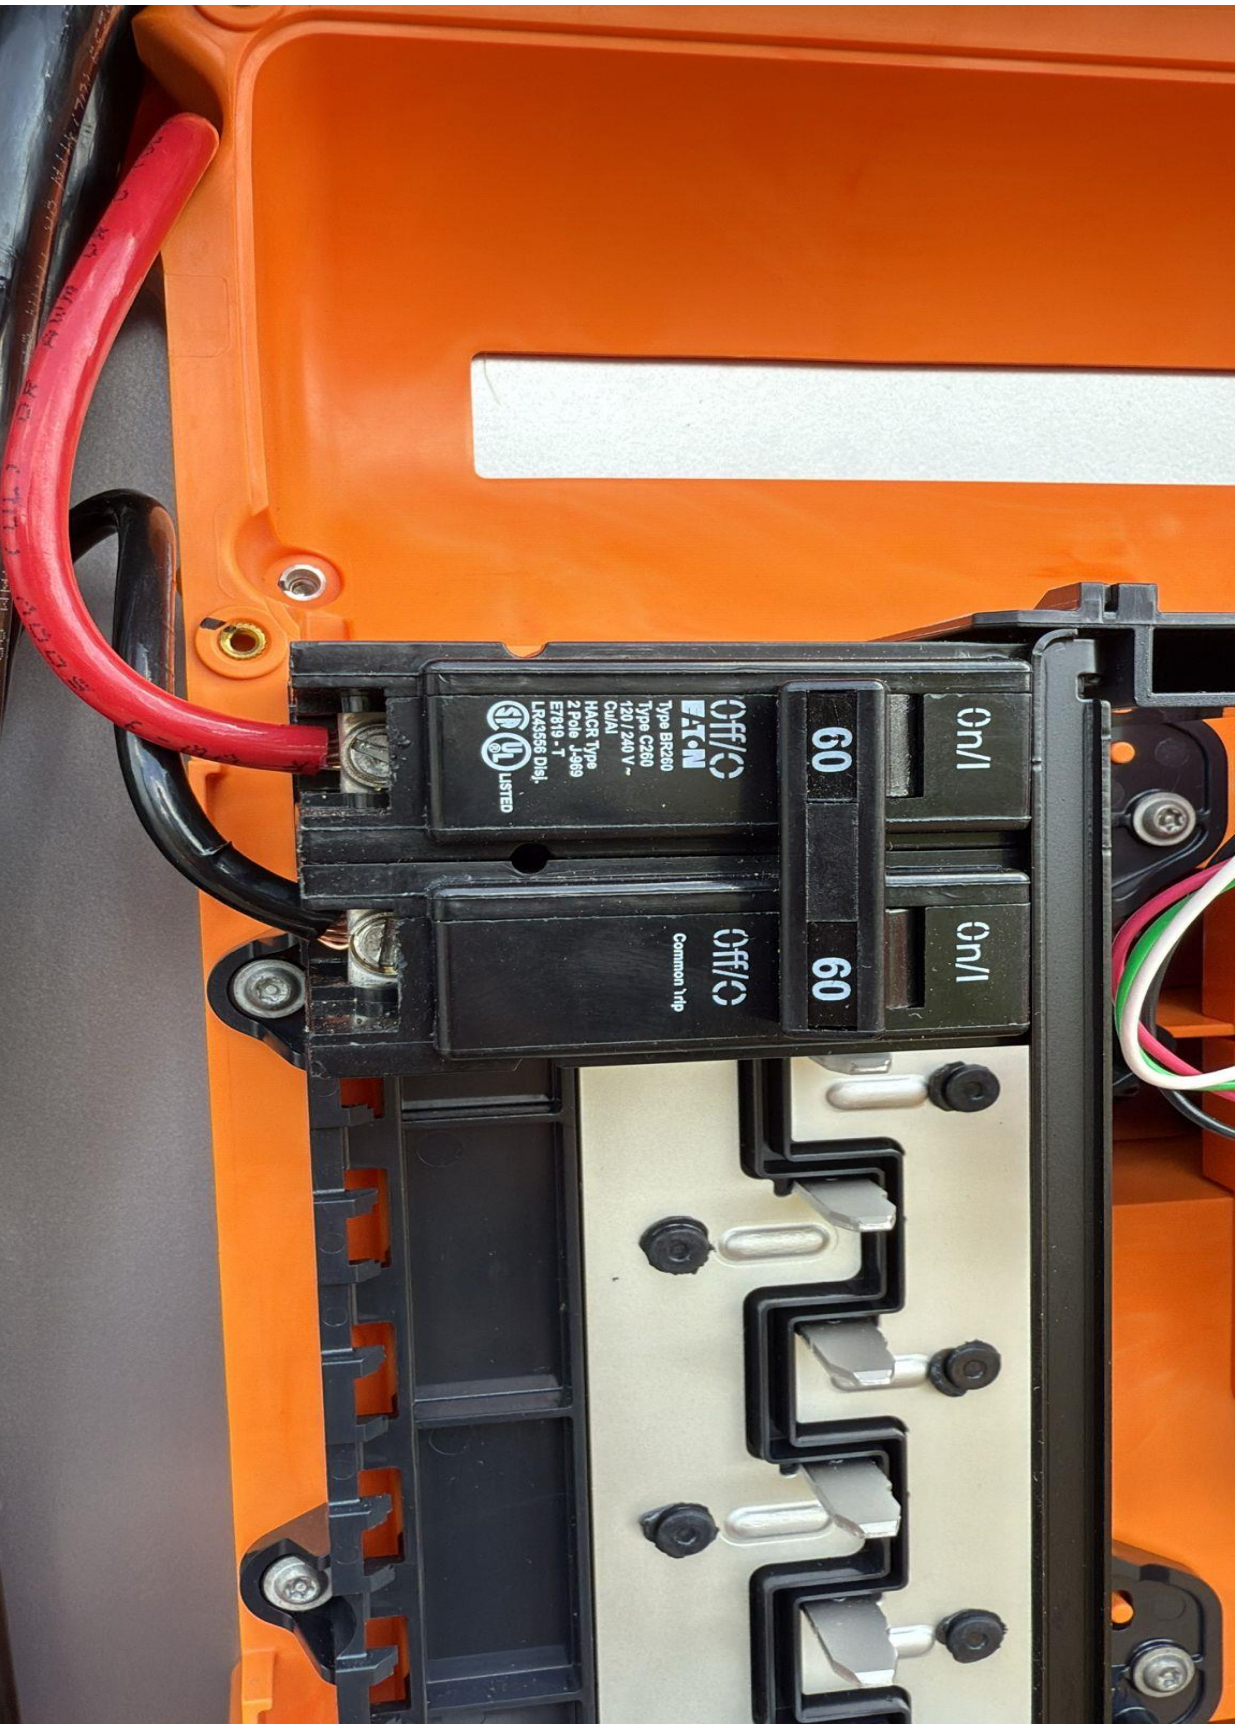



Welcome
Scan to get started




TESLA
GATEWAY



MAIN BATTERY
SYSTEM DISCONNECT

SOLAR AC DISCONNECT LOCATED AT
NORTH SIDE WALL OF THE HOUSE BESIDE
THE UTILITY METER

SERVICE DISCONNECT LOCATED IN THE
BACKUP GATEWAY 3 PANEL

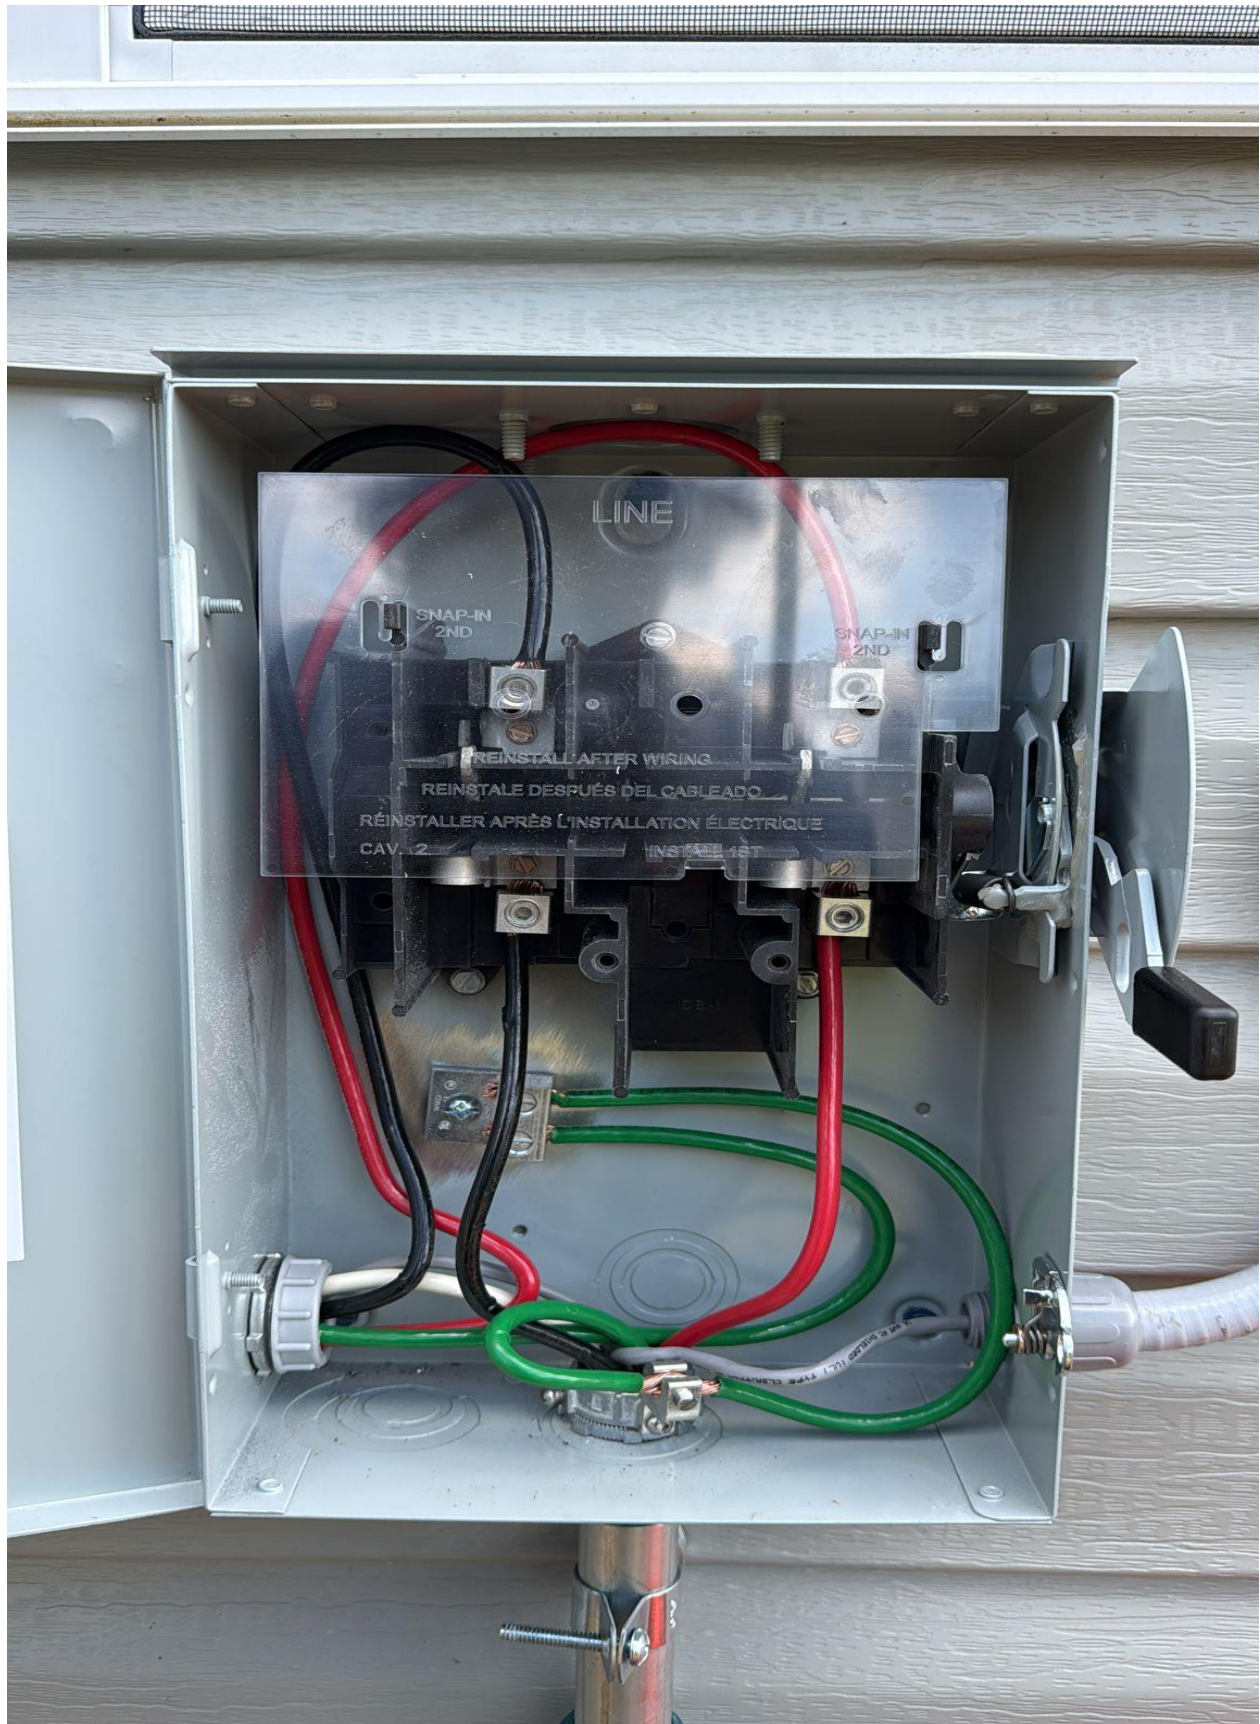

EATON®

General Duty Safety Switch
Interrupteur de sécurité à usage général
Interruptor de seguridad de servicio general

60 A, 240 V~, 60 Hz

Complete ratings inside
Valeurs nominales complètes à l'intérieur
Información completa de capacidades en el interior

Further instructions inside
Autres instructions à l'intérieur
Instrucciones adicionales en el interior

Made in U.S.A. / Fabriqué aux É.-U. / Hecho en E.U.A.



⚠ DANGER
HAZARDOUS VOLTAGE WILL CAUSE
SEVERE INJURY OR DEATH.
• Never operate switch with cover open.
• Turn OFF power at switch.
• Inside. Engage all parts. Close cover before turning power ON.
**TENSION DANGEREUSE. PEUT CAUSER
DES BLESSURES GRAVES OU LA MORT.**
• Ne jamais manipuler l'interrupteur lorsque le couvercle est ouvert.
• Arrêter l'alimentation au point de l'interrupteur avant toute intervention. Manipuler des parties. Fermer le couvercle avant de remettre sous tension.
⚠ PELIGRO
VOLTAJE PELIGROSO. PUEDE CAUSAR
HERIDAS SEVERAS O LA MUERTE.
• Nunca opere el interruptor con la cubierta abierta.
• Desconectar la alimentación del interruptor antes de cualquier trabajo del mismo. Remplazar todas las partes. Cerrar la cubierta antes de reanudar el interruptor.

30-43080



PHOTOVOLTAIC

AC DISCONNECT

**RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM**

**AC DISCONNECT
PHOTOVOLTAIC SYSTEM
POWER SOURCE**

RATED AC
OUTPUT CURRENT **48** AMPS
NOMINAL OPERATING
AC VOLTAGE **240** VOLTS



WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

SERVICE DISCONNECT LOCATED IN THE

BACKUP GATEWAY 3 PANEL

BATTERY DISCONNECT LOCATED IN THE

BACKUP GATEWAY 3 PANEL

ON
I

OFF
O















