

PHOTOVOLTAIC ROOF MOUNT SYSTEM

20 MODULES-ROOF MOUNTED - 8.100 kW DC, 7.600 kW AC

12820 N CAROLINA 27, BROADWAY, NC 27505



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

PROJECT DATA

PROJECT ADDRESS: 12820 N CAROLINA 27,
BROADWAY, NC 27505

OWNER: CRISTINE BROOKS

DESIGNER: ESR

SCOPE: 8.100 kW DC ROOF MOUNT
SOLAR PV SYSTEM WITH
20 JA SOLAR: JAM54S31-405/MR 405W
PV MODULES WITH
20 SOLAREEDGE: S440 POWER OPTIMIZERS AND
01 SOLAREEDGE: SE7600H-US (240V/7600W)
INVERTER
01 10 kWh SOLAREEDGE ENERGY BANK

AUTHORITIES HAVING JURISDICTION:
BUILDING: HARNETT COUNTY
ZONING: HARNETT COUNTY
UTILITY: DUKE ENERGY PROGRESS

SHEET INDEX

PV-1	COVER SHEET
PV-2	SITE PLAN
PV-3	ROOF PLAN & MODULES
PV-4	ELECTRICAL PLAN
PV-5	STRUCTURAL DETAIL
PV-6	ELECTRICAL LINE DIAGRAM
PV-7	WIRING CALCULATIONS
PV-8	LABELS
PV-9+	EQUIPMENT SPECIFICATIONS

SIGNATURE

GENERAL NOTES

1. ALL COMPONENTS ARE UL LISTED AND CEC CERTIFIED, WHERE WARRANTED.
2. THE SOLAR PV SYSTEM WILL BE INSTALLED IN ACCORDANCE WITH ARTICLE 690 OF THE NEC 2017.
3. THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION.
4. ALL CONDUCTORS OF A CIRCUIT, INCLUDING THE EGC, MUST BE INSTALLED IN THE SAME RACEWAY, OR CABLE, OR OTHERWISE RUN WITH THE PV ARRAY CIRCUIT CONDUCTORS WHEN THEY LEAVE THE VICINITY OF THE PV ARRAY.
5. WHERE METALLIC CONDUIT CONTAINING DC CONDUCTORS IS USED INSIDE THE BUILDING, IT SHALL BE IDENTIFIED AS "CAUTION: SOLAR CIRCUIT" EVERY 10FT.
6. HEIGHT OF THE AC DISCONNECT SHALL NOT EXCEED 6'-7" PER NEC CODE 240.24.
7. A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH CEC 690.47 AND 250.50 THROUGH 60 AND 250-166 SHALL BE PROVIDED. PER NEC GROUNDING ELECTRODE SYSTEM OF EXISTING BUILDING MAY BE USED AND BONDED TO THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE OR INADEQUATE A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT. GROUND ROD WITH ACORN CLAMP. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN #8 AWG AND NO LARGER THAN #6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM.
8. PHOTOVOLTAIC MODULES ARE TO BE CONSIDERED NON-COMBUSTIBLE.
9. PHOTOVOLTAIC INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING. MECHANICAL, OR BUILDING ROOF VENTS.
10. ALL WIRING MUST BE PROPERLY SUPPORTED BY DEVICES OR MECHANICAL MEANS DESIGNED AND LISTED FOR SUCH USE. WIRING MUST BE PERMANENTLY AND COMPLETELY HELD OFF THE ROOF SURFACE.
11. ALL SINAGE TO BE PLACED IN ACCORDANCE WITH THE LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SINAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.
12. INVERTER(S) USED IN UNGROUNDED SYSTEM SHALL BE UL 1741 LISTED.
13. THE INSTALLATION OF EQUIPMENT AND ALL ASSOCIATED WIRING AND INTERCONNECTION SHALL BE PERFORMED ONLY BY QUALIFIED PERSONS [NEC 690.4(C)]
14. ALL OUTDOOR EQUIPMENT SHALL BE NEMA 3R RATED (OR BETTER), INCLUDING ALL ROOF MOUNTED TRANSITION BOXES AND SWITCHES.
15. ALL EQUIPMENT SHALL BE PROPERLY GROUNDED AND BONDED IN ACCORDANCE WITH NEC ARTICLE 250.
16. SYSTEM GROUNDING SHALL BE IN ACCORDANCE WITH NEC 690.41.
17. PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION IN ACCORDANCE WITH NEC 690.12
18. DISCONNECTING MEANS SHALL BE LOCATED IN A VISIBLE, READILY ACCESSIBLE LOCATION WITHIN THE PV SYSTEM EQUIPMENT OR A MAXIMUM OF 10 FEET AWAY FROM THE SYSTEM [NEC 690.13(A)]
19. ALL WIRING METHODS SHALL BE IN ACCORDANCE WITH NEC 690.31
20. WORK CLEARANCES AROUND ELECTRICAL EQUIPMENT WILL BE MAINTAINED PER NEC 110.26(A)(1), 110.26(A)(2) AND 110.26(A)(3).
21. ROOFTOP MOUNTED PHOTOVOLTAIC PANELS AND MODULES SHALL BE TESTED, LISTED & IDENTIFIED IN ACCORDANCE WITH UL1703
22. ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT EXPANSION JOINTS AND ANCHOR CONDUIT RUNS AS REQUIRED PER NEC.

VICINITY MAP



HOUSE PHOTO




CODE REFERENCES

2018 NORTH CAROLINA BUILDING CODE
2018 NORTH CAROLINA RESIDENTIAL CODE
2018 NORTH CAROLINA FIRE CODE
2017 NATIONAL ELECTRICAL CODE

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

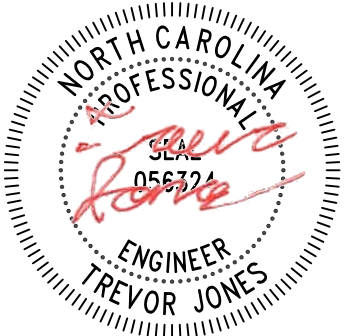

STRUCTURAL ONLY
05/12/2025

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE
12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

COVER SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-1



PROJECT DESCRIPTION:

20 X JA SOLAR: JAM54S31-405/MR 405W MONO MODULES
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES
DC SYSTEM SIZE: 8.100 kW DC
AC SYSTEM SIZE: 7.600 kW AC

EQUIPMENT SUMMARY
20 JA SOLAR: JAM54S31-405/MR 405W MONO MODULES
20 SOLAREEDGE: S440 POWER OPTIMIZERS
01 SOLAREEDGE: SE7600H-US (240V/7600W) INVERTER
01 10 kWh SOLAREEDGE ENERGY BANK


ROOF ARRAY AREA #1:- 105.05 SQ FT.
ROOF ARRAY AREA #2:- 315.15 SQ FT. A

NOTE: VISIBLE, LOCKABLE, LABELED AC DISCONNECT
LOCATED WITHIN 10' OF UTILITY METER

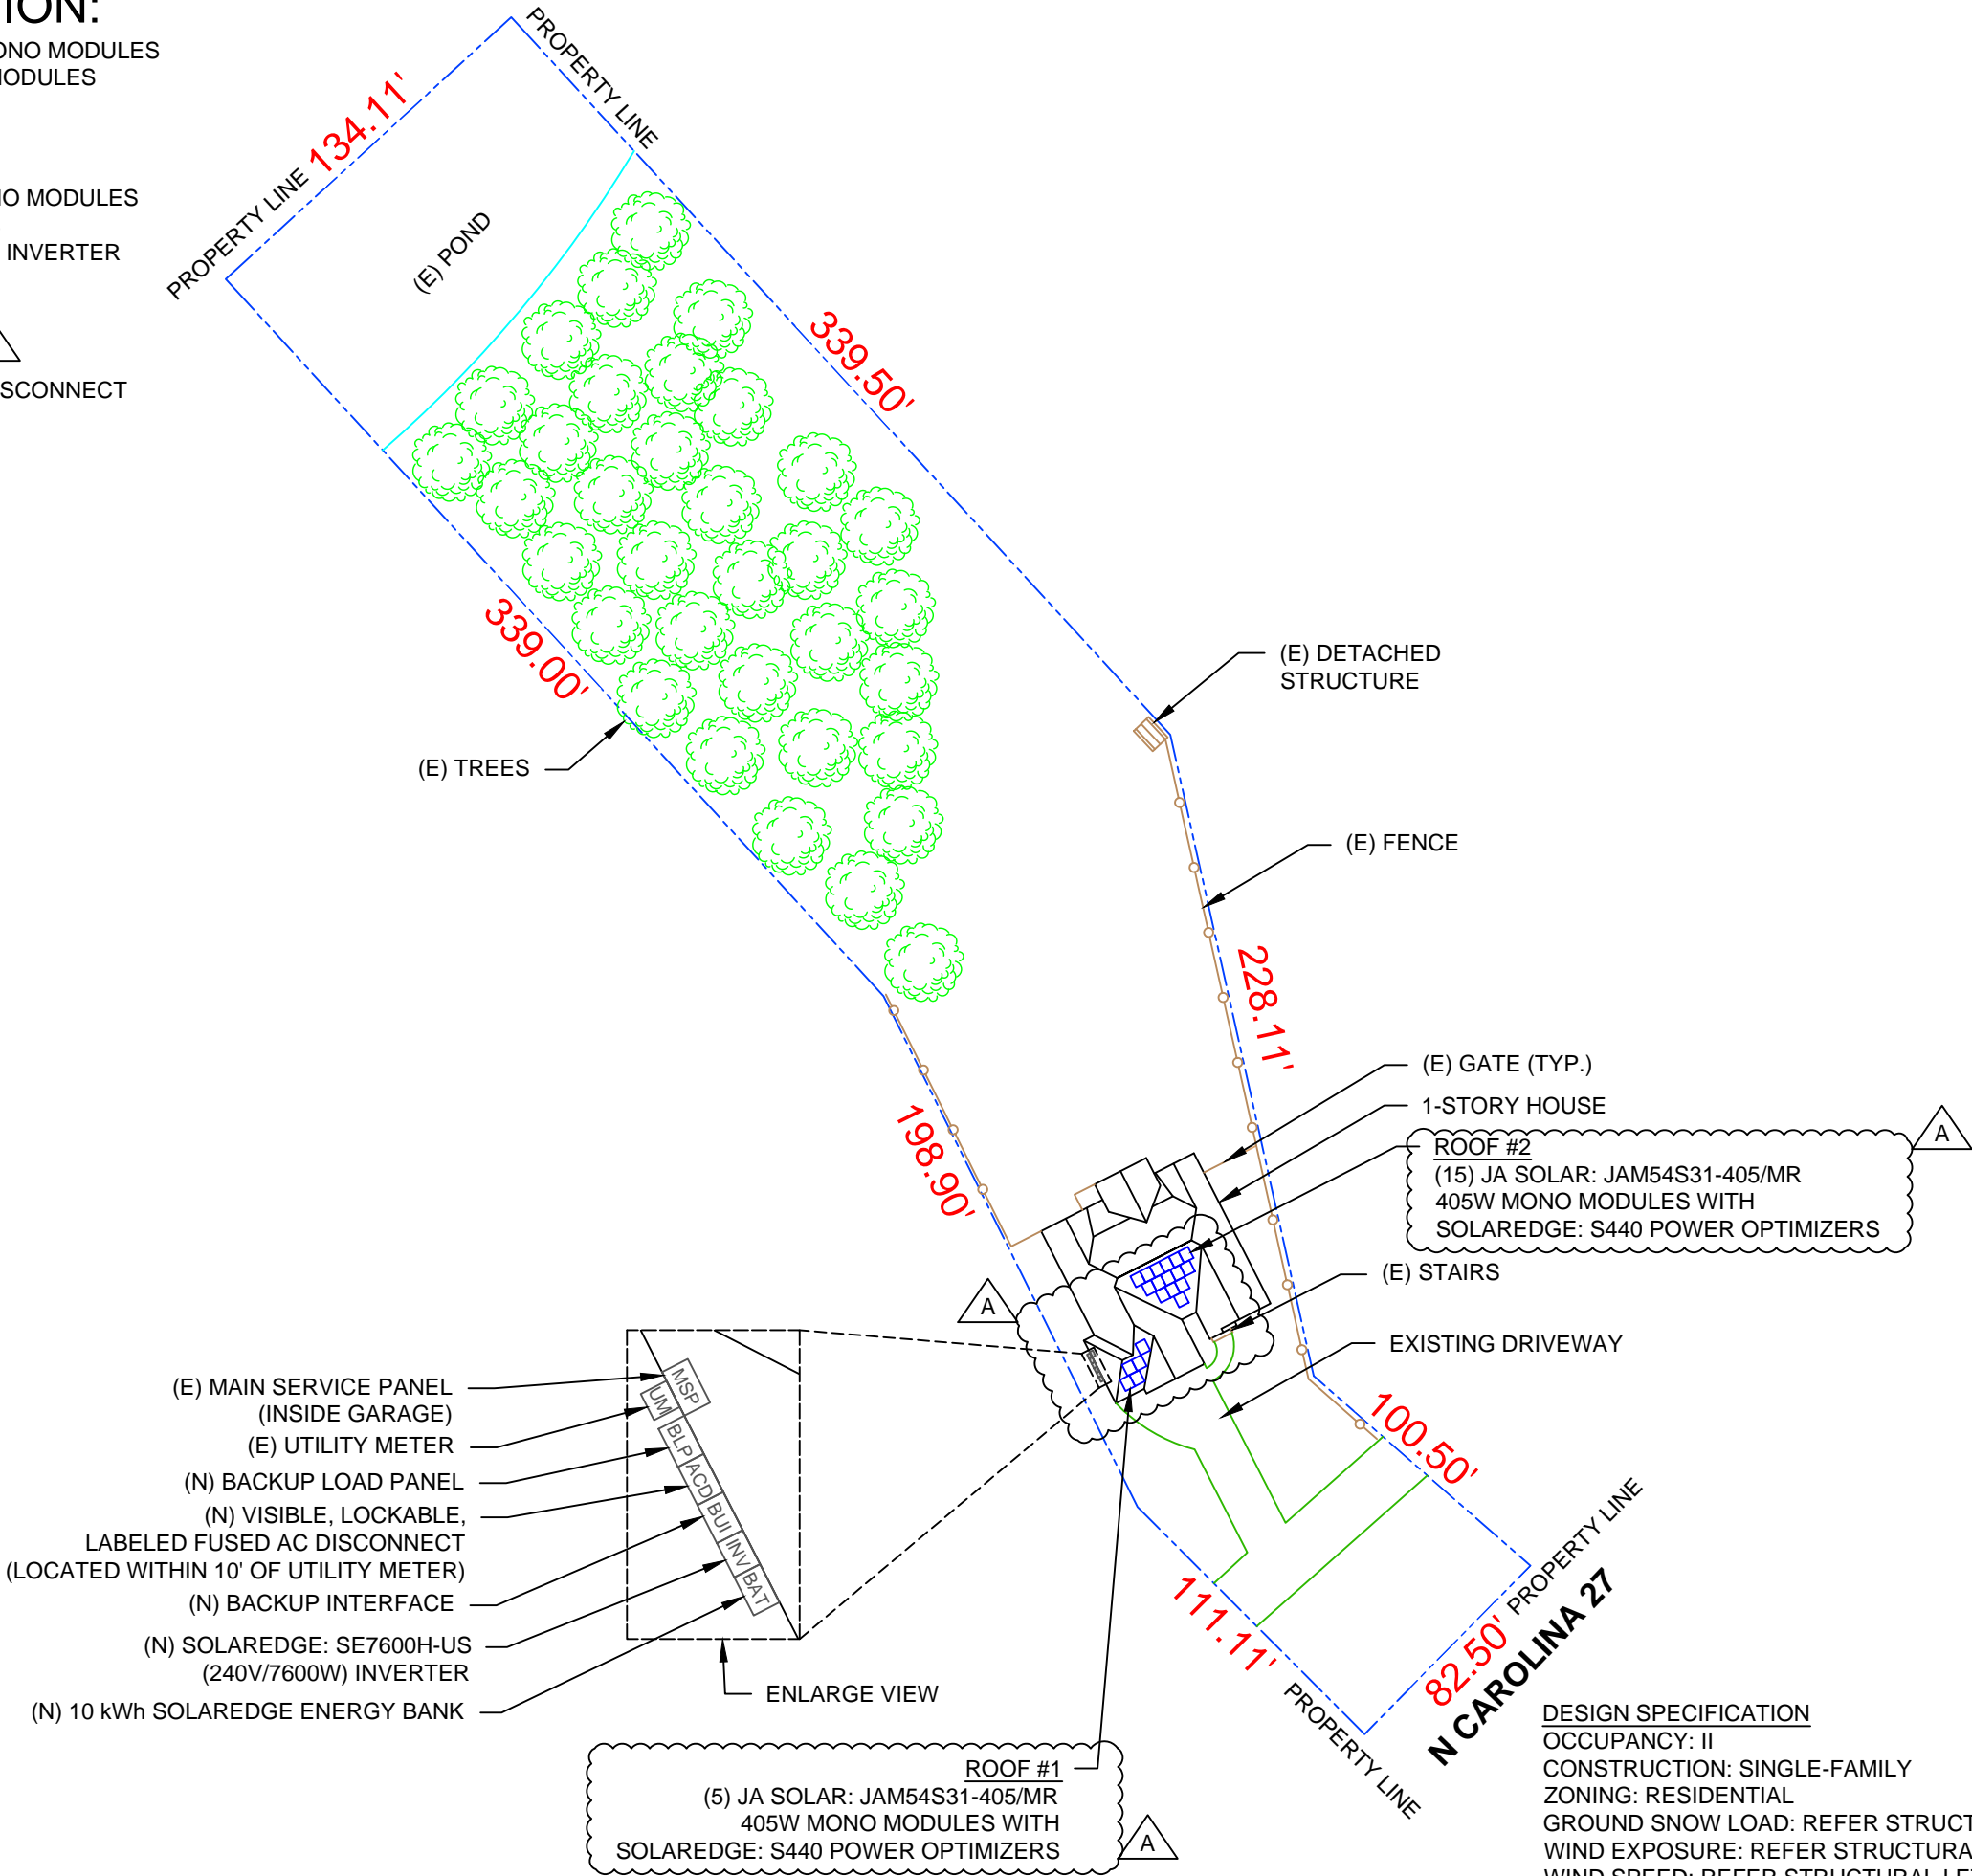

PHILLIPS ENERGY SYSTEMS
7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

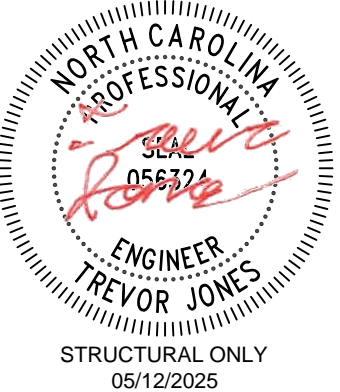

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE
12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

SITE PLAN

SHEET SIZE



ANSI B
11" X 17"

SHEET NUMBER

PV-2

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 20 MODULES
MODULE TYPE = JA SOLAR: JAM54S31-405/MR 405W MONO MODULES
MODULE WEIGHT = 47.39 LBS / 21.5 kg.
MODULE DIMENSIONS = 67.79" x 44.65" = 21.01 SF

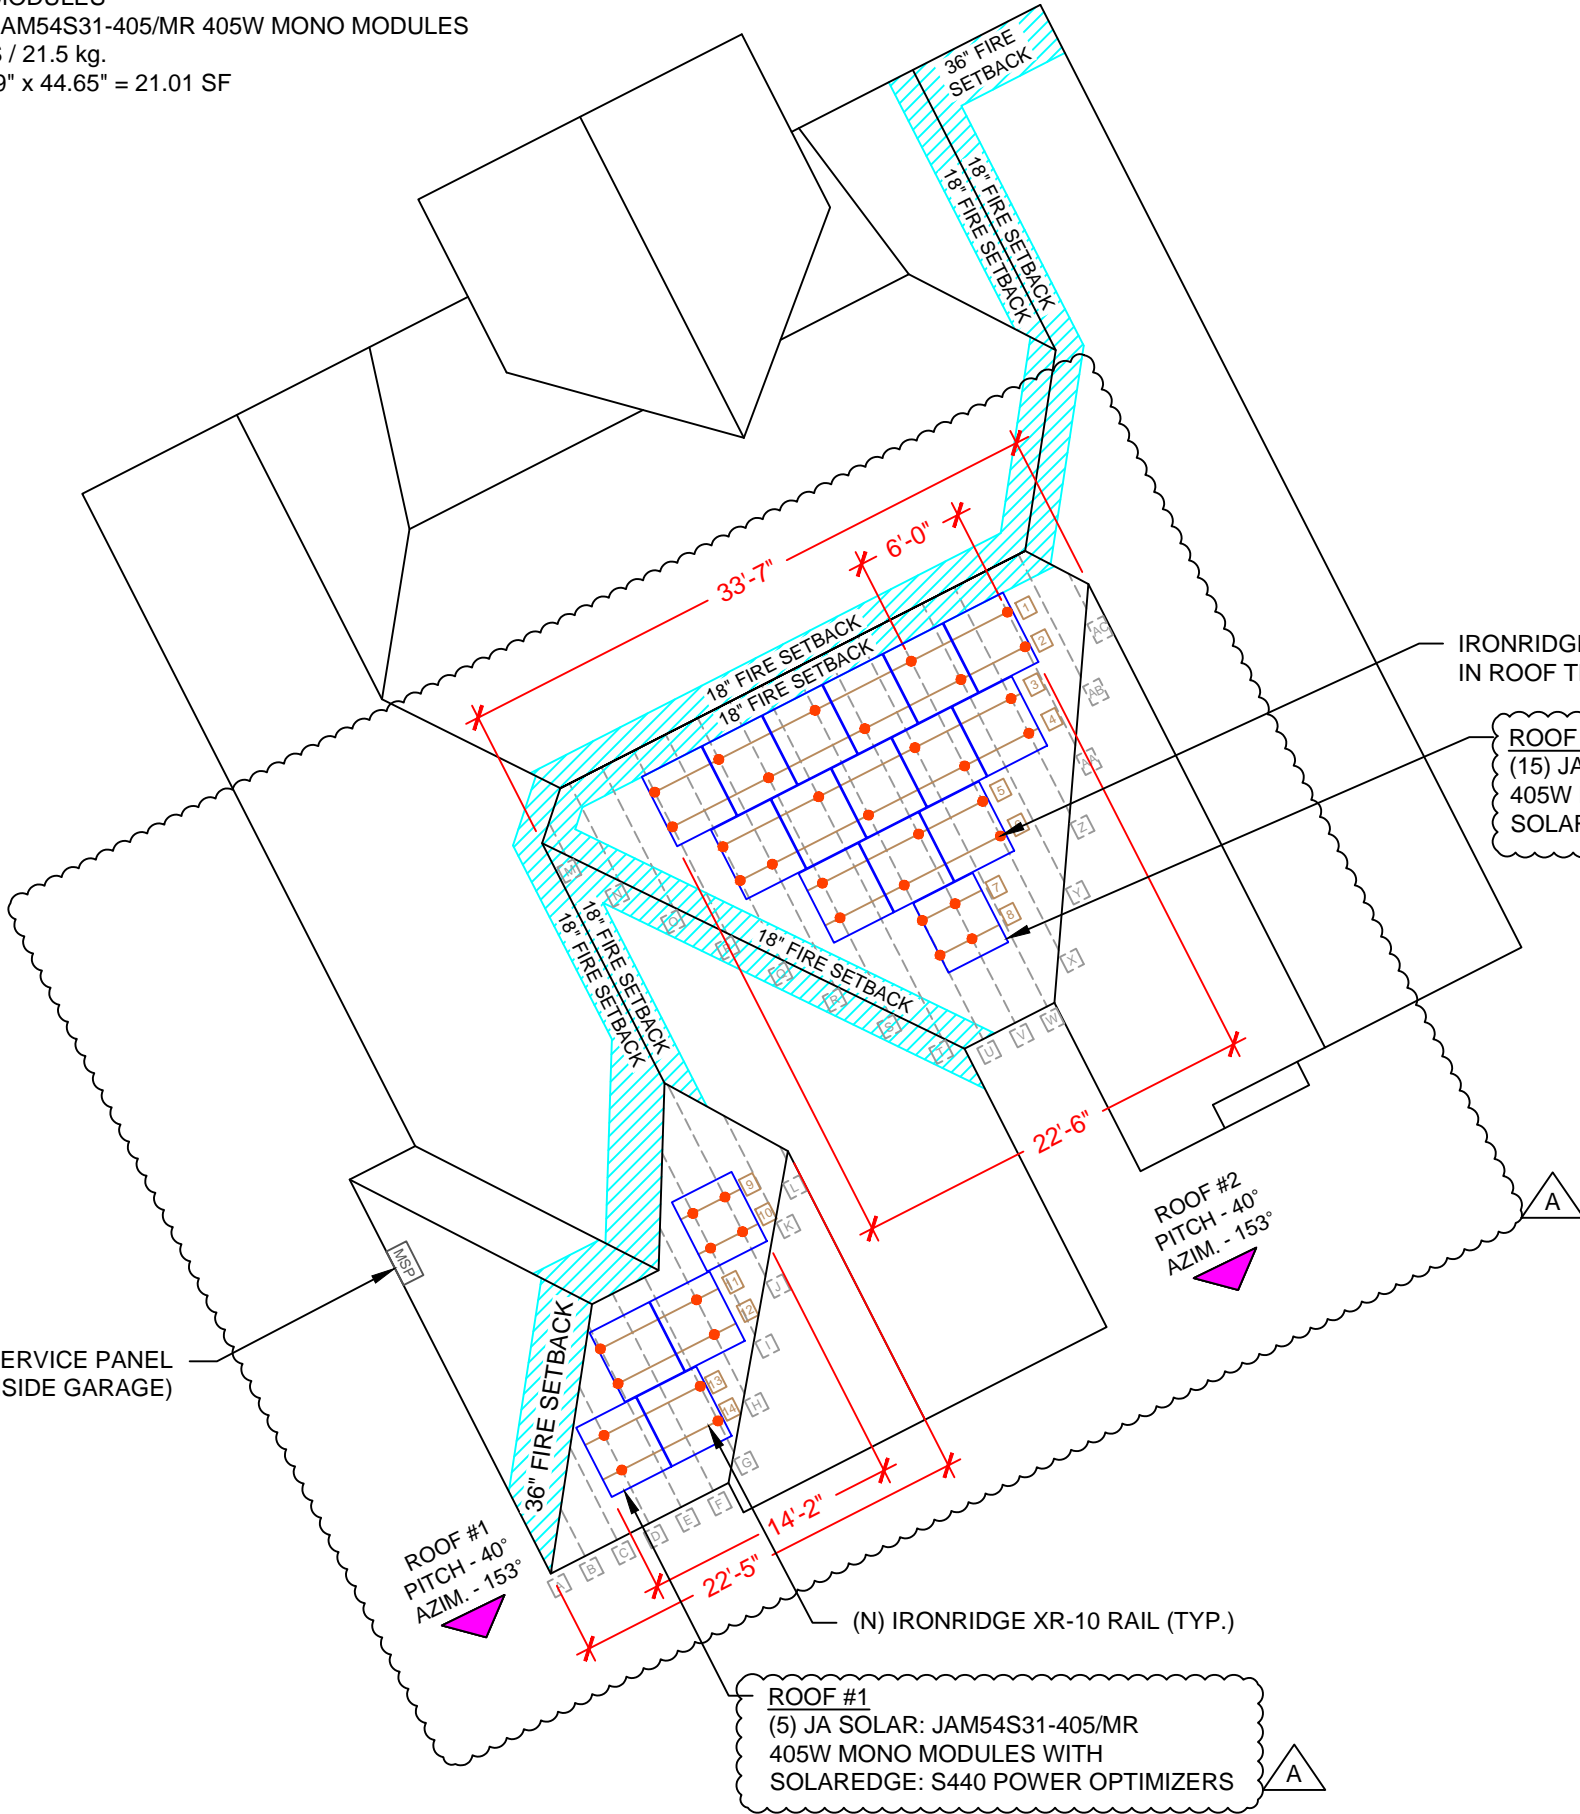


ROOF DESCRIPTION					
ROOF TYPE			ASPHALT SHINGLE		
ROOF LAYER			1 LAYER		
ROOF	# OF MODULES	ROOF PITCH	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	5	40°	153°	2"X4"	24"
#2	15	40°	153°	2"X4"	24"

ARRAY AREA & ROOF AREA CALC'S		
TOTAL PV ARRAY AREA (SQ. FT.)	TOTAL ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)
420.20	3934.51	11

IRONRIDGE HALO ULTRAGRIP ATTACHMENTS IN ROOF TRUSS TOP CHORD ONLY

ROOF #2
(15) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES WITH SOLAREEDGE: S440 POWER OPTIMIZERS

ROOF #2
PITCH - 40°
AZIM. - 153°

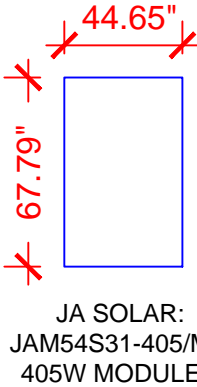

LEGEND

BAT	- SOLAREEDGE BATTERY	SUB	- SUB PANEL
BLP	- BACKUP LOAD PANEL	INV	- INVERTER
BUI	- BACKUP INTERFACE	JB	- JUNCTION BOX
ACD	- AC DISCONNECT		- VENT, ATTIC FAN (ROOF OBSTRUCTION)
UM	- UTILITY METER		- ROOF ATTACHMENT
MSP	- MAIN SERVICE PANEL	---	- TRUSS
		---	- CONDUIT



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL, NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A



PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME
ROOF PLAN &
MODULES

SHEET SIZE


ANSI B
11" X 17"

SHEET NUMBER

PV-3

DC SYSTEM SIZE: 8.100 kW DC
AC SYSTEM SIZE: 7.600 kW AC
(20) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES
WITH (20) SOLAREEDGE: S440 POWER OPTIMIZERS
LOCATED UNDER EACH PANEL AND
01 SOLAREEDGE: SE7600H-US (240V/7600W) INVERTER

STRING LEGENDS	
---	STRING #1
---	STRING #2



STRING #1
(10 MODULES)

STRING #2
(10 MODULES)

- (N) JUNCTION BOX (TYP.)
- (N) CONDUIT
- (E) MAIN SERVICE PANEL (INSIDE GARAGE)
- (E) UTILITY METER
- (N) BACKUP LOAD PANEL
- (N) VISIBLE, LOCKABLE, LABELED FUSED AC DISCONNECT (LOCATED WITHIN 10' OF UTILITY METER)
- (N) BACKUP INTERFACE
- (N) SOLAREEDGE: SE7600H-US (240V/7600W) INVERTER
- (N) 10 kWh SOLAREEDGE ENERGY BANK

(20) SOLAREEDGE:
S440 POWER OPTIMIZERS

N CAROLINA 27

BILL OF MATERIALS	
EQUIPMENT DESCRIPTION	QTY
SOLAR PV MODULES: JA SOLAR: JAM54S31-405/MR 405W MODULE	20
OPTIMIZERS: SOLAREEDGE: S440 POWER OPTIMIZERS	20
INVERTER: SOLAREEDGE: SE7600H-US (240V/7600W) INVERTER	1
BATTERY: 10 kWh SOLAREEDGE ENERGY BANK	1
BACKUP INTERFACE: SOLAREEDGE BACKUP INTERFACE BI-NUSGN-03 200A RATED, 240V NEMA 3R, UL LISTED	1
CURRENT TRANSFORMER: SOLAREEDGE SLIM CURRENT TRANSFORMER SECT-SPL-225A-T-20 225A RATED, 240V	1
JUNCTION BOXES: JUNCTION BOX UL 1741, NEMA 3R CSA C22.2 NO.290	2
AC DISCONNECT: FUSED AC DISCONNECT, 60A FUSED, (2) 60A FUSES 240V NEMA 3R, UL LISTED	1
IRONRIDGE XR10 RAIL (RAIL 168" (14 FEET) CLEAR) (XR-10-168A)	18
BONDED SPLICE, XR10 (XR10-BOSS-01-M1)	4
UNIVERSAL MODULE CLAMP, CLEAR (UFO-CL-01-A1)	26
END FASTENING OBJECT (END CLAMP, 30-40MM), MILL (UFO-END-01-A1)	28
GROUNDING LUG (XR-LUG-03-A1)	7
IRONRIDGE HALO ULTRAGRIP ATTACHMENTS (QM-HUG-01-M1)	44
RD STRUCTURAL SCREW,3.0L (HW-RD1430-01-M1)	88
T-BOLT BONDING HARDWARE (BHW-TB-02-A1) (PRODUCT CODE 590-0116)	44
OPTIMIZER BONDING HARDWARE T-BOLT (BHW-MI-01-A1) (PRODUCT CODE 270-0152)	20



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

ELECTRICAL PLAN

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-4

LEGEND

BAT - SOLAREEDGE BATTERY	SUB - SUB PANEL
BLP - BACKUP LOAD PANEL	INV - INVERTER
BUI - BACKUP INTERFACE	JB - JUNCTION BOX
ACD - AC DISCONNECT	○ - VENT, ATTIC FAN (ROOF OBSTRUCTION)
UM - UTILITY METER	● - ROOF ATTACHMENT
MSP - MAIN SERVICE PANEL	--- - TRUSS
	--- - CONDUIT




PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

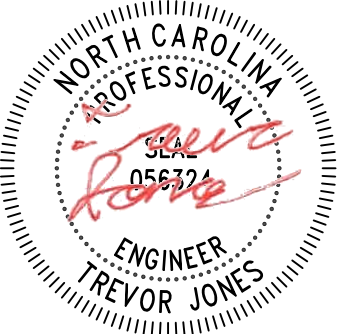

STRUCTURAL ONLY
05/12/2025

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME


STRUCTURAL DETAIL

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-5

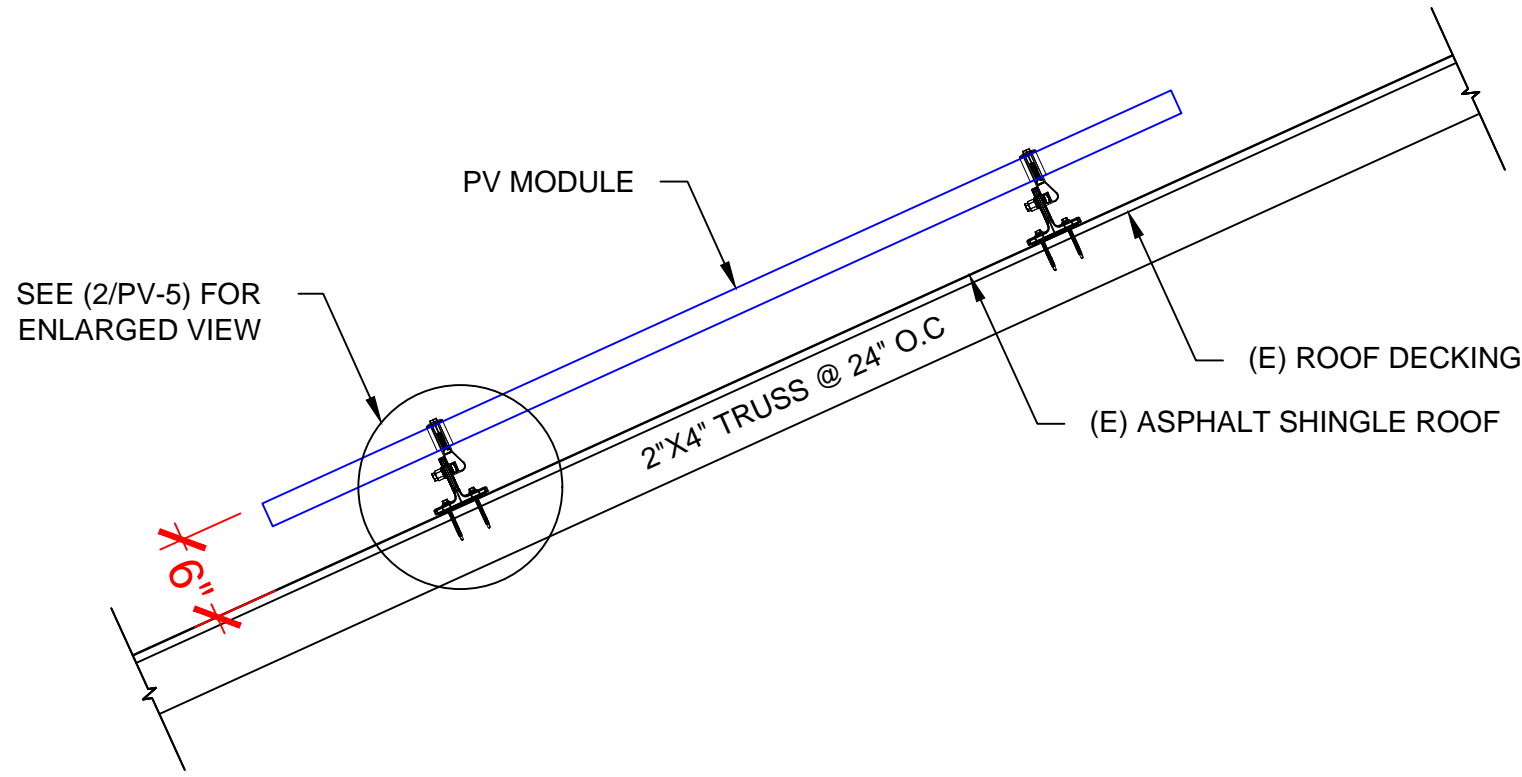


1

STRUCTURAL ATTACHMENT (Side view)

PV-5

SCALE: N.T.S

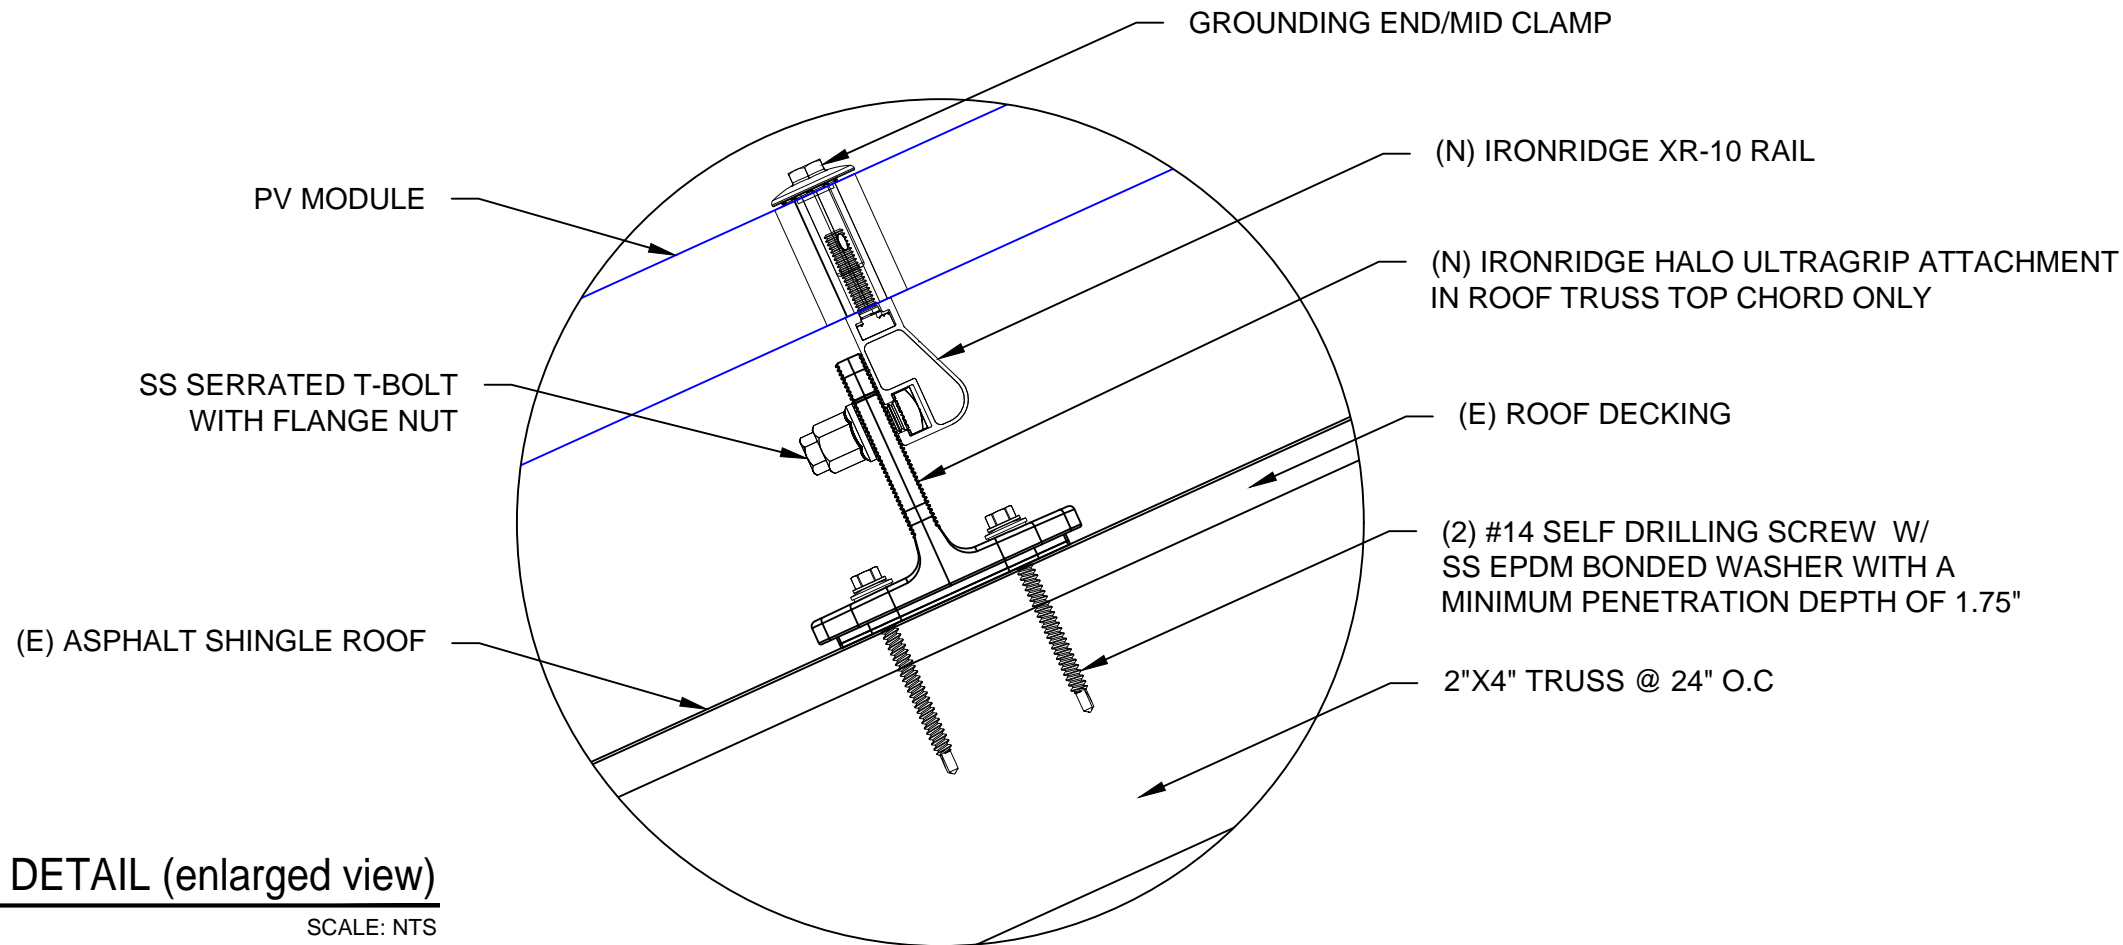

2

ATTACHMENT DETAIL (enlarged view)

PV-5

SCALE: NTS

DC SYSTEM SIZE: 8.100 kW DC
AC SYSTEM SIZE: 7.600 kW AC

- (20) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES
WITH (20) SOLAREEDGE: S440 POWER OPTIMIZERS
LOCATED UNDER EACH PANEL (240V) AND
(01) SOLAREEDGE: SE7600H-US (240V/7600W) INVERTER
(02) STRINGS OF 10 MODULES ARE CONNECTED IN SERIES

INTERCONNECTION NOTES:

1. INTERCONNECTION SIZING, LIMITATIONS AND COMPLIANCE DETERMINED IN ACCORDANCE WITH [NEC 705.12], AND [NEC 690.59].
2. GROUND FAULT PROTECTION IN ACCORDANCE WITH [NEC 215.9], [NEC 230.95].
3. ALL EQUIPMENT TO BE RATED FOR BACKFEEDING.
4. PV BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUSBAR RELATIVE TO THE MAIN BREAKER.

DISCONNECT NOTES:


1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)
2. AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
3. DISCONNECT MEANS AND THEIR LOCATION SHALL BE IN ACCORDANCE WITH [NEC 225.31] AND [NEC 225.32].

GROUNDING & GENERAL NOTES:

1. PV GROUNDING ELECTRODE SYSTEM NEEDS TO BE INSTALLED IN ACCORDANCE WITH [NEC 690.43]
2. PV INVERTER IS UNGROUNDED, TRANSFORMER-LESS TYPE.
3. DC GEC AND AC EGC TO REMAIN UNSPLICED, OR SPLICED TO EXISTING ELECTRODE
4. ANY EXISTING WIRING INVOLVED WITH PV SYSTEM CONNECTION THAT IS FOUND TO BE INADEQUATE PER CODE SHALL BE CORRECTED PRIOR TO FINAL INSPECTION.
5. JUNCTION BOX QUANTITIES, AND PLACEMENT SUBJECT TO CHANGE IN THE FIELD - JUNCTION BOX DEPICTED ON ELECTRICAL DIAGRAM REPRESENT WIRE TYPE TRANSITIONS.
6. AC DISCONNECT NOTED IN EQUIPMENT SCHEDULE OPTIONAL IF OTHER AC DISCONNECTING MEANS IS LOCATED WITHIN 10' OF SERVICE DISCONNECT.
7. RACEWAYS AND CABLES EXPOSED TO SUNLIGHT ON ROOFTOPS SHOULD BE INSTALLED MORE THAN 7/8" ABOVE THE ROOF USING CONDUIT SUPPORTS.

RACKING NOTE:

1. BOND EVERY OTHER RAIL WITH #6 BARE COPPER

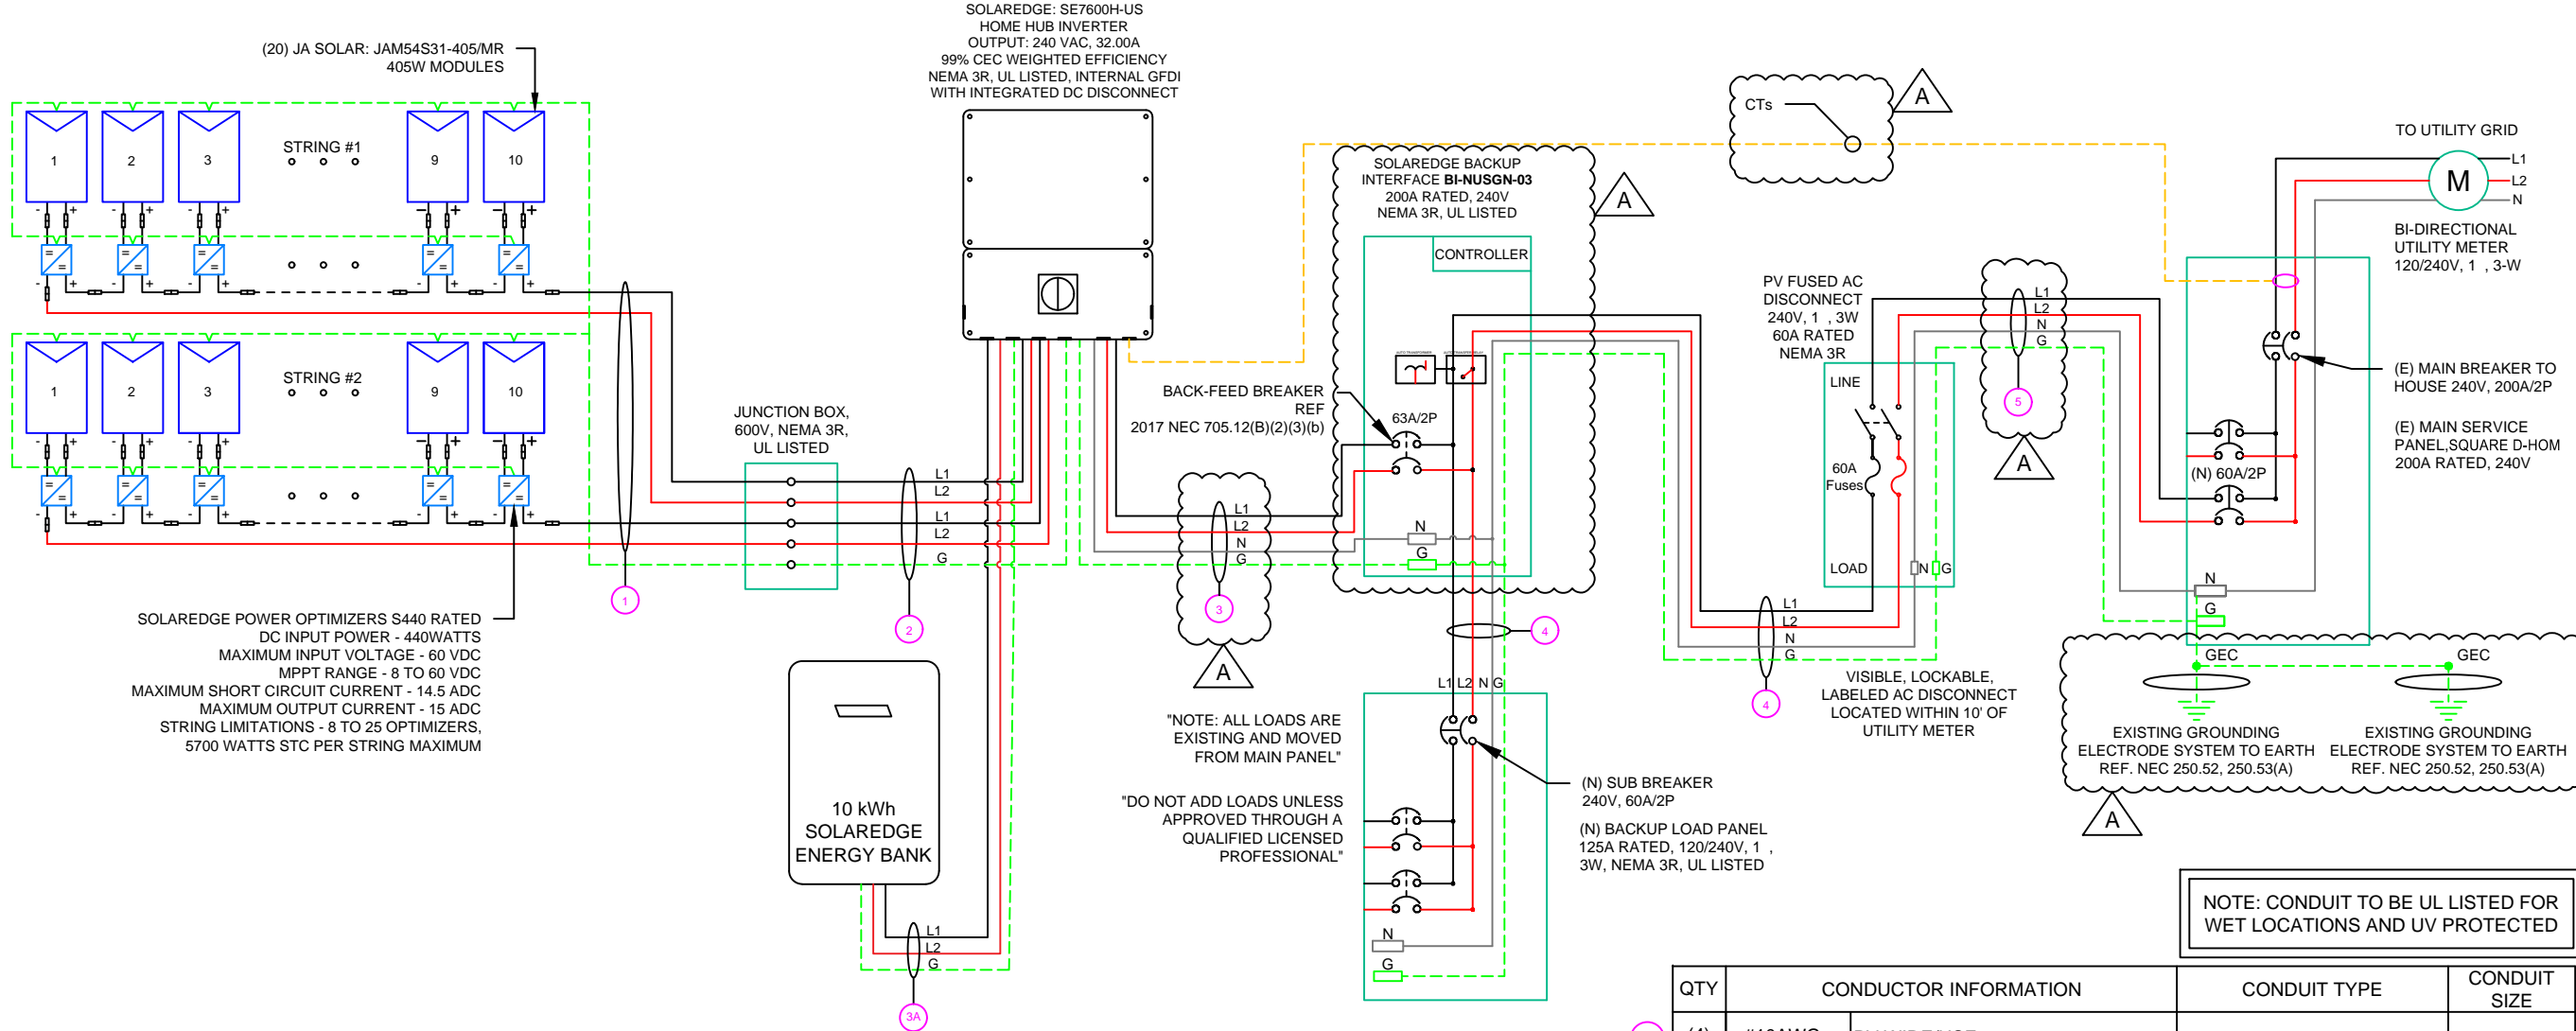

QTY	CONDUCTOR INFORMATION		CONDUIT TYPE	CONDUIT SIZE
(4)	#10AWG -	PV WIRE/USE-2	N/A	N/A
(1)	#6AWG -	BARE COPPER IN FREE AIR		
(4)	#10AWG -	CU, THWN-2	EMT OR LFMC IN ATTIC	3/4"
(1)	#10AWG -	CU, THWN-2 GND		
(2)	#6AWG -	CU, THWN-2	EMT, LFMC OR PVC	3/4"
(1)	#6AWG -	CU, THWN-2 N		
(1)	#8AWG -	CU, THWN-2 GND	EMT, LFMC OR PVC	1"
(2)	#10AWG -	CU, THWN-2		
(1)	#10AWG -	CU, THWN-2 GND	EMT, LFMC OR PVC	3/4"
(2)	#4AWG -	CU, THWN-2		
(1)	#4AWG -	CU, THWN-2 N	EMT, LFMC OR PVC	3/4"
(1)	#8AWG -	CU, THWN-2 GND		
(2)	#6AWG -	CU, THWN-2	EMT, LFMC OR PVC	3/4"
(1)	#6AWG -	CU, THWN-2 N		
(1)	#8AWG -	CU, THWN-2 GND		



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

ELECTRICAL LINE DIAGRAM

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-6

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL #	JA SOLAR: JAM54S31-405/MR 405W MODULE
VMP	31.21V
IMP	12.98A
VOC	37.23V
ISC	13.87A
TEMP. COEFF. VOC	-0.275%/°C
MODULE DIMENSION	67.79"L x 44.65"W x 1.18"D (In Inch)

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL #	SOLAREEDGE: SE7600H-US (240V/7600W) INVERTER
NOMINAL AC POWER	7.600 kW
NOMINAL OUTPUT VOLTAGE	240 VAC
NOMINAL OUTPUT CURRENT	32.00A

PERCENT OF VALUES	NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT
.80	4-6
.70	7-9
.50	10-20

AMBIENT TEMPERATURE SPECS	
AMBIENT TEMP (HIGH TEMP 2%)	38°
RECORD LOW TEMPERATURE	-11°
MODULE TEMPERATURE COEFFICIENT OF Voc	-0.275%/°C

DC FEEDER CALCULATIONS																					
CIRCUIT ORIGIN	CIRCUIT DESTINATION	VOLTAGE (V)	FULL LOAD AMPS "FLA" (A)	FLA*1.25 (A)	OCPD SIZE (A)	GROUND SIZE	CONDUCTOR SIZE	75°C AMPACITY (A)	AMPACITY CHECK #1	AMBIENT TEMP. (°C)	TOTAL CC CONDUCT ORS IN RACEWAY	90°C AMPACITY (A)	DERATION FACTOR FOR AMBIENT TEMPERATURE NEC 310.15(B)(2)(a)	DERATION FACTOR FOR CONDUCTORS PER RACEWAY NEC 310.15(B)(3)(a)	90°C AMPACITY DERATED (A)	AMPACITY CHECK #2	FEEDER LENGTH (FEET)	CONDUCTOR RESISTANCE (OHM/KFT)	VOLTAGE DROP AT FLA (%)	CONDUIT SIZE	CONDUIT FILL (%)
STRING 1	JUNCTION BOX	380	15.00	18.75	20	BARE COPPER #6 AWG	CU #10 AWG	35	PASS	38	2	40	0.91	1	36.4	PASS	5	1.24	0.049	N/A	#N/A
STRING 2	JUNCTION BOX	380	15.00	18.75	20	BARE COPPER #6 AWG	CU #10 AWG	35	PASS	38	2	40	0.91	1	36.4	PASS	5	1.24	0.049	N/A	#N/A
JUNCTION BOX	INVERTER	380	15.00	18.75	20	CU #10 AWG	CU #10 AWG	35	PASS	38	4	40	0.91	0.8	29.12	PASS	25	1.24	0.245	3/4" EMT	19.79%
SOLAREEDGE BANK	INVERTER	380	13.16	16.45	20	CU #10 AWG	CU #10 AWG	35	PASS	38	2	40	0.91	1	36.4	PASS	5	1.24	0.043	3/4" EMT	11.88%
String 1 Voltage Drop																			0.294		
String 2 Voltage Drop																			0.294		

AC FEEDER CALCULATIONS																						
CIRCUIT ORIGIN	CIRCUIT DESTINATION	VOLTAGE (V)	FULL LOAD AMPS "FLA" (A)	FLA*1.25 (A)	OCPD SIZE (A)	NEUTRAL SIZE	GROUND SIZE	CONDUCTOR SIZE	75°C AMPACITY (A)	AMPACITY CHECK #1	AMBIENT TEMP. (°C)	TOTAL CC CONDUCTORS IN RACEWAY	90°C AMPACITY (A)	DERATION FACTOR FOR AMBIENT TEMPERATURE NEC 310.15(B)(2)(a)	DERATION FACTOR FOR CONDUCTORS PER RACEWAY NEC 310.15(B)(3)(a)	90°C AMPACITY DERATED (A)	AMPACITY CHECK #2	FEEDER LENGTH (FEET)	CONDUCTOR RESISTANCE (OHM/KFT)	VOLTAGE DROP AT FLA (%)	CONDUIT SIZE	CONDUIT FILL (%)
INVERTER	BACKUP INTERFACE	240	32	40	63	CU #6 AWG	CU #8 AWG	CU #6 AWG	65	PASS	38	2	75	0.91	1	68.25	PASS	5	0.491	0.065	3/4" EMT	35.40%
BACKUP INTERFACE	BACKUP LOAD PANEL	240	60	60	60	CU #4 AWG	CU #8 AWG	CU #4 AWG	85	PASS	38	2	95	0.91	1	86.45	PASS	5	0.308	0.077	1" EMT	32.85%
BACKUP INTERFACE	AC DISCONNECT	240	32	40	60	CU #4 AWG	CU #8 AWG	CU #4 AWG	85	PASS	38	2	95	0.91	1	86.45	PASS	5	0.308	0.041	1" EMT	32.85%
AC DISCONNECT	MAIN SERVICE PANEL	240	32	40	60	CU #6 AWG	CU #8 AWG	CU #6 AWG	65	PASS	38	2	75	0.91	1	68.25	PASS	5	0.491	0.065	3/4" EMT	35.40%
CUMULATIVE VOLTAGE DROP																			0.065			



ELECTRICAL NOTES

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE RATED UPTO 600V FOR RESIDENTIAL AND 1000V FOR COMMERCIAL AND 90 DEGREE C WET ENVIRONMENT.
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
- WHERE SIZES OF JUNCTION BOX, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
- MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
- TEMPERATURE RATINGS OF ALL CONDUCTORS, TERMINATIONS, BREAKERS, OR OTHER DEVICES ASSOCIATED WITH THE SOLAR PV SYSTEM SHALL BE RATED FOR AT LEAST 75 DEGREE C.



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-7

PHOTOVOLTAIC POWER SOURCE

EVERY 10' ON CONDUIT & ENCLOSURES

LABEL- 1:
LABEL LOCATION:
DC/EMT CONDUIT RACEWAY
SOLADECK / JUNCTION BOX
CODE REF: NEC 690.31 (D)(2)



WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY
BE ENERGIZED IN THE OPEN POSITION

LABEL- 2:
LABEL LOCATION:
AC DISCONNECT
CODE REF: NEC 690.13(B)



WARNING

DUAL POWER SUPPLY

SOURCE: UTILITY GRID AND
PV SOLAR ELECTRIC SYSTEM

LABEL- 3:
LABEL LOCATION:
MAIN SERVICE PANEL
CODE REF: NEC 705.12(C) & NEC 690.59

SOLAR PV BREAKER:

BREAKER IS BACKFED
DO NOT RELOCATE

LABEL-4:
LABEL LOCATION:
MAIN SERVICE PANEL
CODE REF: NEC 705.12(C) & NEC 690.59




WARNING

POWER SOURCE OUTPUT
CONNECTION. DO NOT
RELOCATE THIS
OVERCURRENT DEVICE

LABEL- 5:
LABEL LOCATION:
MAIN SERVICE PANEL (ONLY IF SOLAR IS BACK-FED)
SUBPANEL (ONLY IF SOLAR IS BACK-FED)
CODE REF: NEC 705.12(B)(3)(2)

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN THE ARRAY



LABEL- 6:
LABEL LOCATION:
AC DISCONNECT
CODE REF: [NEC 690.56(C)(1)(A)]

RAPID SHUTDOWN SWITCH
FOR SOLAR PV SYSTEM

LABEL- 7:
LABEL LOCATION:
INVERTER
CODE REF: NEC 690.56(C)(2)

DC DISCONNECT

LABEL- 8:
LABEL LOCATION:
INVERTER
CODE REF: NEC 690.13(B)

AC DISCONNECT
PHOTOVOLTAIC SYSTEM
POWER SOURCE

NOMINAL OPERATING AC VOLATGE 240 V

RATED AC OUTPUT CURRENT 32.00 A

LABEL- 9:
LABEL LOCATION:
AC DISCONNECT
CODE REF: NEC 690.54

MAXIMUM VOLTAGE 480 V

MAXIMUM CIRCUIT CURRENT 40.00 A

MAXIMUM RATED OUTPUT
CURRENT OF THE CHARGE
CONTROLLER OR DC-TO-DC
CONVERTER (IF INSTALLED)

LABEL- 10:
LABEL LOCATION:
ON THE RIGHT SIDE OF THE INVERTER (PRE-EXISTING ON THE INVERTER)
CODE REF: NEC 690.53



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

LABELS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-8

Harvest the Sunshine

DEEP BLUE 3.0 Light

Mono

405W MBB
Half-cell Black Module
JAM54S31 380-405/MR Series

Introduction

Assembled with 11BB PERC cells, the half-cell configuration of the modules offers the advantages of higher power output, better temperature-dependent performance, reduced shading effect on the energy generation, lower risk of hot spot, as well as enhanced tolerance for mechanical loading.

Higher output power

Lower LCOE

Less shading and lower resistive loss

Better mechanical loading tolerance

Superior Warranty

• 25-year product warranty

• 25-year linear power output warranty

0.55% Annual Degradation Over 25 years

Comprehensive Certificates

• IEC 61215, IEC 61730, UL 61215, UL 61730

• ISO 9001: 2015 Quality management systems

• ISO 14001: 2015 Environmental management systems

• ISO 45001: 2018 Occupational health and safety management systems

• IEC TS 62941: 2016 Terrestrial photovoltaic (PV) modules – Guidelines for increased confidence in PV module design qualification and type approval

JA SOLAR

JAM54S31 380-405/MR Series

MECHANICAL DIAGRAMS

Remark: customized frame color and cable length available upon request

SPECIFICATIONS

Cell	Mono
Weight	21.5kg±3%
Dimensions	1722±2mm×1134±2mm×30±1mm
Cable Cross Section Size	4mm² (IEC) , 12 AWG(UL)
No. of cells	108(6x18)
Junction Box	IP68, 3 diodes
Connector	MC4-EVO2(1500V)
Cable Length (Including Connector)	Portrait: 300mm(+)/400mm(-); Landscape: 1200mm(+)/1200mm(-)
Packaging Configuration	36pcs/Pallet, 864pcs/40ft Container

ELECTRICAL PARAMETERS AT STC

TYPE	JAM54S31 -380/MR	JAM54S31 -385/MR	JAM54S31 -390/MR	JAM54S31 -395/MR	JAM54S31 -400/MR	JAM54S31 -405/MR
Rated Maximum Power(Pmax) [W]	380	385	390	395	400	405
Open Circuit Voltage(Voc) [V]	36.58	36.71	36.85	36.98	37.07	37.23
Maximum Power Voltage(Vmp) [V]	30.28	30.46	30.64	30.84	31.01	31.21
Short Circuit Current(Isc) [A]	13.44	13.52	13.61	13.70	13.79	13.87
Maximum Power Current(Imp) [A]	12.55	12.64	12.73	12.81	12.90	12.98
Module Efficiency [%]	19.5	19.7	20.0	20.2	20.5	20.7
Power Tolerance	±2%					
Temperature Coefficient of Isc(α_Isc)	+0.045%/°C					
Temperature Coefficient of Voc(β_Voc)	-0.275%/°C					
Temperature Coefficient of Pmax(γ_Pmp)	-0.350%/°C					
STC	Irradiance 1000W/m², cell temperature 25°C, AM1.5G					

Remark: Electrical data in this catalog do not refer to a single module and they are not part of the offer.They only serve for comparison among different module types.

ELECTRICAL PARAMETERS AT NOCT

TYPE	JAM54S31 -380/MR	JAM54S31 -385/MR	JAM54S31 -390/MR	JAM54S31 -395/MR	JAM54S31 -400/MR	JAM54S31 -405/MR	OPERATING CONDITIONS	
Rated Max Power(Pmax) [W]	286	290	294	298	302	306	Maximum System Voltage	1000V/1500V DC
Open Circuit Voltage(Voc) [V]	34.36	34.49	34.62	34.75	34.88	35.12	Operating Temperature	-40 C ~+85 C
Max Power Voltage(Vmp) [V]	28.51	28.68	28.87	29.08	29.26	29.47	Maximum Series Fuse Rating	25A
Short Circuit Current(Isc) [A]	10.75	10.82	10.89	10.96	11.03	11.10	Maximum Static Load Front* Maximum Static Load Back*	5400Pa(112lb/ft²) 2400Pa(50lb/ft²)
Max Power Current(Imp) [A]	10.03	10.11	10.18	10.25	10.32	10.38	NOCT	45±2 C
NOCT	Irradiance 800W/m², ambient temperature 20°C, wind speed 1m/s, AM1.5G						Safety Class	Class II
							Fire Performance	UL Type 1

CHARACTERISTICS

Current-Voltage Curve JAM54S31-405/MR

Power-Voltage Curve JAM54S31-405/MR

Current-Voltage Curve JAM54S31-405/MR

Premium Cells, Premium Modules

Version No. : Global_EN_20231130A

PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-9

JA SOLAR

www.jasolar.com

Specifications subject to technical changes and tests.
JA Solar reserves the right of final interpretation.

AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

Applicant: Shanghai JA Solar Technology Co., Ltd. **Manufacturer:** JA SOLAR VIET NAM COMPANY LIMITED.

Address: No. 118, Lane 3111, West Huancheng Road, Fengxian District, 201401 Shanghai **Address:** Lot G, Quang Chau industrial park, Quang Chau Ward, Viet Yen Town, Bac Giang Province, 236110

Country: P. R. China **Country:** Vietnam

Party Authorized To Apply Mark: Same as Manufacturer
Report Issuing Office: Intertek Testing Services Shanghai Limited

Control Number: 5020189 **Authorized by:** for L. Matthew Snyder, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc.
545 East Algonquin Road, Arlington Heights, IL 60005
Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Standard(s): Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1: Test Requirements [UL 61215-1:2017 Ed.1]

Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1-1: Special Requirements For Testing Of Crystalline Silicon Photovoltaic (PV) Modules [UL 61215-1-1:2017 Ed.1]

Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 2: Test Procedures [UL 61215-2:2017 Ed.1]

Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements For Construction [UL 61730-1:2017 Ed.1]

Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements For Testing [UL 61730-2:2017 Ed.1]

Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements for Construction [CSA C22.2#61730-1:2019 Ed.2]

Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements for Testing [CSA C22.2#61730-2:2019 Ed.2]

AUTHORIZATION TO MARK

Product:	Crystalline Silicon Photovoltaic modules
Brand Name:	JA SOLAR 晶澳
Models:	JAM72S03-385/PR, JAP72S03-340/SC, JAM72S10- followed by 395, 400, 405, 410 or 415 followed by /MB, JAM60S10- followed by 330, 335, 340 or 345 followed by /MB, JAM72S10- followed by 395, 400, 405, 410 or 415 followed by /MR, JAM66S10- followed by 365, 365, 370, 375 or 380 followed by /MR, JAM60S10- followed by 330, 335, 340 or 345 followed by /MR, JAM72S09- followed by 370, 375, 380, 385, 390, 395 or 400 followed by /PR, JAM60S09- followed by 310, 315, 320 or 325 followed by /PR, JAM72S09- followed by 375, 380 or 385 followed by /BP, JAM60S09- followed by 315 or 320 followed by /BP, JAM72S10- followed by 385, 390, 395 or 400 followed by /BP, JAM60S10- followed by 320, 325 or 330 followed by /BP, JAM72S10- followed by 380, 385, 390, 395, 400 or 405 followed by /PR, JAM60S10- followed by 320, 325, 330 or 335 followed by /PR, JAM72S12- followed by 365, 370, 375, 380 or 385 followed by /PR, JAM60S12- followed by 305, 310, 315 or 320 followed by /PR, 1JAM78S10- followed by 435, 440, 445, 450 or 455 followed by /MR, 1JAM6(K)-72-335/4BB/1500V, JAM60S17- followed by 320, 325, or 330 followed by /MR, JAM72S20- followed by 430, 435, 440, 445, 450, 455, 460, 465 or 470 followed by /MR, JAM60S20- followed by 355, 360, 365, 370, 375, 380, 385 or 390 followed by /MR, JAM72S30- followed by 530, 535, 540, 545, 550 or 555 followed by /MR, JAM66S30- followed by 490, 495 or 500 followed by /MR, JAM68S11- followed by 355, 360 or 365 followed by /PR, JAM68S11- followed by 345, 350, 355, 360 or 365 followed by /PR(B), JAM76S11- followed by 395, 400, 405, 410 or 415 followed by /PR(B), JAM76S11- followed by 395, 400, 405, 410 or 415 followed by /PR(B)/1000V, JAM78S30-followed by 575, 580, 585, 590, 595, 600, 605 or 610 followed by /GR, JAM72S30-followed by 535, 540, 545, 550, 555 or 560 followed by /GR, JAM66S30-followed by 490, 495, 500 or 505 followed by /GR, JAM60S30-followed by 445, 450, 455 or 460 followed by /GR, JAM54S30-followed by 400, 405, 410, 415 or 420 followed by /GR, JAM78S31-followed by 570, 575, 580, 585 or 590 followed by /GR, JAM72S31-followed by 530, 535 or 540 followed by /GR, JAM66S31-followed by 485, 490 or 495 followed by /GR, JAM60S31-followed by 440, 445 or 450 followed by /GR, JAM54S31-followed by 395, 400, 405, 410 or 415 followed by /GR, JAM60S31-followed by 430, 435, 440, 445 or 450 followed by /GR/1000V, JAM54S31-followed by 390, 395, 400, 405, 410 or 415 followed by /GR/1000V, JAM54S30-followed by 400, 405, 410, 415, 420 or 425 followed by /MR, JAM72S31-followed by 510, 515, 520, 525, 530, 535, 540 or 545 followed by /MR, JAM54S31-followed by 385, 390, 395, 400 or 405 followed by /MR, JAM54S30-followed by 400, 405, 410, 415, 420 or 425 followed by /MR/1000V, JAM72S31-followed by 510, 515, 520, 525, 530,535, 540 or 545 followed by /MR/1000V, JAM54S31-followed by 385, 390, 395, 400 or 405 followed by /MR/1000V, JAM72S17-followed by 390, 395, 400 or 405 followed by /MR, JAM72S17-followed by 390, 395, 400 or 405 followed by /MR/1000V, JAM78S30- followed by 580, 585, 590, 595, 600 or 605 followed by /MR,JAM72S30-followed by 555, 560, 565, 570, 575, 580 followed by /LR, JAM54S30-followed by 415, 420, 425, 430, 435 followed by /LR, JAM54S31-followed by 415, 420 followed by /LR, JAM54S30-followed by 385, 390, 395, 400, 405, 410 followed by /MB, JAM54S31-followed by 385, 390, 395, 400, 405 followed by /MB, JAM54S30-followed by 410, 415, 420, 425 followed by /LB, JAM54S31-followed by 410, 415 followed by /LB, JAM72S30-followed by 535, 540, 545, 550 followed by /MB, JAM72S31-followed by 525, 530, 535, 540 followed by /MB.



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-10

Residential Power Optimizer

For North America

S440 / S500B / S650B



POWER OPTIMIZER

PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detects abnormal PV connector behavior, preventing potential safety issues
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Faster installations with simplified wire management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)

solaredge.com



Residential Power Optimizer

For North America

S440 / S500B / S650B

	S440	S500B	S650B	
INPUT				
Rated Input DC Power ⁽¹⁾	440 ⁽²⁾	500 ⁽³⁾	650	W
Absolute Maximum Input Voltage (Voc)	60	125	85	Vdc
MPPT Operating Range	8 – 60	12.5 – 105	12.5 – 85	Vdc
Maximum Input Current (Maximum Isc of Connected PV Module) ⁽²⁾	14.5	15		Adc
Maximum Input Short Circuit Current ⁽⁴⁾		18.75		Adc
Maximum Efficiency		99.5		%
Weighted Efficiency		98.6		%
Overvoltage Category		II		
OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREdge INVERTER)				
Maximum Output Current		15		Adc
Maximum Output Voltage	60	80		Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREdge INVERTER OR INVERTER OFF)				
Safety Output Voltage per Power Optimizer		1 ± 0.1		Vdc
STANDARD COMPLIANCE				
Photovoltaic Rapid Shutdown System		CSA C22.2#330, NEC 2014 – 2023		
EMC		FCC Part 15 Class B; IEC 61000-6-2; IEC 61000-6-3		
Safety		CSA C22.2#107.1; IEC 62109-1 (Class II Safety); UL 1741		
Material		UL 94 V-0, UV Resistant		
RoHS		Yes		
Fire Safety		VDE-AR-E 2100-712:2013-05		
INSTALLATION SPECIFICATIONS				
Maximum Allowed System Voltage		1000		Vdc
Dimensions (W x L x H)	129 x 155 x 30 / 5.07 x 6.10 x 1.18	129 x 165 x 45 / 5.07 x 6.49 x 1.77		mm / in
Weight	720 / 1.6	790 / 1.74		gr / lb
Input Connector		MC4		
Input Wire Length		0.1 / 0.32		m / ft
Output Connector		MC4		
Output Wire Length		(+) 2.3, (-) 0.10 / (+) 7.54, (-) 0.32		m / ft
Operating Temperature Range ⁽⁵⁾		-40 to +85		°C
Protection Rating		IP68 / NEMA6P		
Relative Humidity		0 – 100		%

(1) Rated power of the module at STC will not exceed the power optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed.
(2) For S440 with part number S440-1GM4MRMP, the Rated Input DC Power is 650W, and the Maximum Input Current is 15A.
(3) For installations after Aug 1st, 2024, the Rated Input DC Power for S500B is 650W.
(4) The Maximum Input Short Circuit Current is adjusted for worst case conditions of ambient temperature, irradiance, bifacial gain, and so on, in accordance with NEC and CSA.
(5) Power derating is applied for ambient temperatures above +85°C / +185°F for S440, and for ambient temperatures above +75°C / 167°F for S500B and S650B. Refer to the [Power Optimizers Temperature Derating](#) technical note for more details.

PV System Design Using a SolarEdge Inverter [®]		SolarEdge Home Wave/Hub Single Phase	Three Phase for 208V Grid	Three Phase for 277/480V Grid	
Minimum String Length (Power Optimizers)	S440	8	10	18	
	S500B, S650B	6	8	14	
Maximum String Length (Power Optimizers)		25		50 ^③	
Maximum Usable Power Delivered per String		5700	6000	12,750	W
Maximum Allowed Connected Power per String ^② ④	Inverters with Rated AC Power ≤ 5700W	Per the inverter's maximum input DC power ^⑧	One string: 7200 Two strings or more: 7800	15,000	W
	Inverters with Rated AC Power of 6000W	5700			
	Inverters with Rated AC Power ≥ 7600W	6800, only when connected to at least two strings			
Parallel Strings of Different Lengths or Orientations		Yes			

(6) It is not allowed to mix S-series and P-series Power Optimizers in new installations in the same string.
(7) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement.
(8) Refer to the [Single String Design Guidelines](#) application note for details.
(9) For the 208V grid, the maximum is permitted only when the difference in connected power between strings is 1,000W or less.
(10) For the 240V or 277/480V grids, the maximum is permitted only when the difference in connected power between strings is 2,000W or less.


© SolarEdge Technologies, Ltd. All rights reserved. SOLAREdge, the SolarEdge logo, OPTIMIZED BY SOLAREdge are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: September 17, 2024 DS-000018-NA. Subject to change without notice.



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

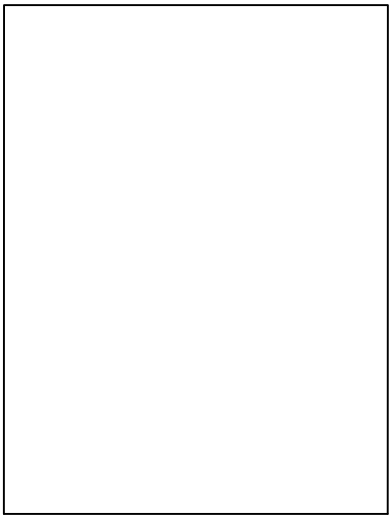

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER

PV-11

SolarEdge Home Hub Inverter
Single Phase, for North America
For Inverters Assembled in the USA

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US



HOME BACKUP

Single phase inverter for storage and backup applications

- The ultimate home energy manager in charge of PV production, battery storage, backup operation during a power outage*, EV Charging, and smart energy devices
- Record-breaking 99% weighted efficiency with up to 300% DC oversizing
- Supports LRA – can provide the required energy for HVAC systems starting during backup operation
- Integrates seamlessly with the complete SolarEdge Home Smart Energy Ecosystem, through SolarEdge Home Network
- Module-level monitoring and visibility of battery status, PV production, and self-consumption data
- Fast and easy installation – small and lightweight, with reduced commissioning time
- A scalable solution that supports future homeowner needs through easy connection to a growing ecosystem of products
- Advanced safety features with integrated arc fault protection and rapid shutdown for 690.11 and 690.12
- Advanced reliability with automotive-grade components
- Embedded revenue grade production data, ANSI C12.20 Class 0.5
- IP65-rated, for indoor and outdoor installations

*Requires additional hardware and firmware version upgrade.

solaredge.com



SolarEdge Home Hub Inverter

Single Phase, for North America

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US

Model Number ⁽¹⁾⁽²⁾	SE3800H-US	SE5700H-US	SE7600H-US	SE10000H-US	SE11400H-US	Units
OUTPUT – AC ON GRID						
Rated AC Power	3800 @ 240V 3300 @ 208V	5760 @ 240V 5000 @ 208V	7600	10000	11,400 @ 240V 10,000 @ 208V	W
Maximum AC Power Output	3800 @ 240V 3300 @ 208V	5760 @ 240V 5000 @ 208V	7600	10000	11,400 @ 240V 10,000 @ 208V	W
AC Output Voltage (Nominal)	208 / 240					Vac
AC Output Voltage (Range)	183 – 264					Vac
AC Frequency Range (min - nom - max)	59.3 – 60 – 60.5 ⁽³⁾					Hz
Maximum Continuous Output Current	16	24	32	42	48	A
GFDI Threshold	1					A
Total Harmonic Distortion (THD)	< 3					%
Power Factor	1, adjustable -0.85 to 0.85					
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes					
Charge Battery from AC (if allowed)	Yes					
Typical Nighttime Power Consumption	< 2.5					W
OUTPUT – AC STAND-ALONE (BACKUP) ⁽⁴⁾⁽⁵⁾						
Rated AC Power in Stand-alone Operation	11,400 ⁽⁶⁾					W
Maximum Stand-alone Capacity	11,400					W
AC L-L Output Voltage Range in Stand-alone Operation	211 – 264					Vac
AC L-N Output Voltage Range in Stand-alone Operation	105 – 132					Vac
AC Frequency Range in Stand-alone (min - nom - max)	55 – 60 – 65					Hz
Maximum Continuous Output Current in Stand-alone Operation	48					A
GFDI	1					A
THD	< 5					%
OUTPUT – SOLAREEDGE HOME EV CHARGER AC						
Rated AC Power	9600					W
AC Output Voltage Range	211 – 264					Vac
On-Grid AC Frequency Range (min - nom - max)	59.3 – 60 – 60.5					Hz
Maximum Continuous Output Current @240V (grid, PV and battery)	40					Aac
INPUT – DC (PV AND BATTERY)						
Transformer-less, Ungrounded	Yes					
Max Input Voltage	480					Vdc
Nom DC Input Voltage	380					Vdc
Reverse-Polarity Protection	Yes					
Ground-Fault Isolation Detection	600kΩ Sensitivity					
INPUT – DC (PV)						
Maximum DC Power @ 240V	11,400	11,520	15,200	20,000	22,800	W
Maximum DC Power @ 208V	6600	10,000	-	-	20,000	W
Maximum Input Current ⁽⁷⁾ @ 240V	20	30.5	40	53	60	Adc
Maximum Input Current ⁽⁷⁾ @ 208V	17.5	27	-	-	53	Adc
Maximum Input Short Circuit Current	45					Adc
Maximum Inverter Efficiency	99.2					%
CEC Weighted Efficiency	98.5		99		99 @ 240V 98.5 @ 208V	%
2-pole Disconnection	Yes					


(1) These specifications apply to inverters with part numbers SExxxxH-USMNUxxx5 and SExxxxH-USMNFxxx5 and connection unit model number DCD-1PH-US-PxH-F-x.
(2) Inverters with part number SExxxxH-USMNFxxx5 are intended for upgrade installations only, as part of the "Re-Energize" program. Use on non-upgrade installations will revoke the product warranty.
(3) For other regional settings please refer to the SolarEdge Inverters, Power Control Options Application Note.
(4) Not designed for non-grid connected applications and requires AC for commissioning. Stand-alone (backup) functionality is only supported for the 240V grid.
(5) For LRA (Locked Rotor Amperage) values please refer to the LRA for NAM Application Note.
(6) For models SE7600H-US and below, the rated AC stand-alone power is configurable between 7600W or 11,400W from CPU version 4.20.xx.
(7) A higher current source may be used. The inverter will limit its input current to the values stated.



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL, NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

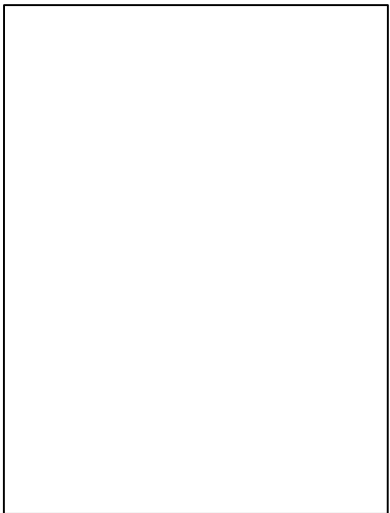

PROJECT NAME & ADDRESS	
CRISTINE BROOKS RESIDENCE	12820 N CAROLINA 27, BROADWAY, NC 27505

DRAWN BY ESR
SHEET NAME EQUIPMENT SPECIFICATION
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-12

/ SolarEdge Home Hub Inverter

Single Phase, for North America

SE3800H-US / SE5700H-US / **SE7600H-US** / SE10000H-US / SE11400H-US

Model Number ⁽¹⁾⁽²⁾	SE3800H-US	SE5700H-US	SE7600H-US	SE10000H-US	SE11400H-US	Units
OUTPUT – DC (BATTERY)						
Supported Battery Types	SolarEdge Home Battery, LG RESU Prime					
Number of Batteries per Inverter	Up to 3 SolarEdge Home Battery, up to 2 LG RESU Prime					
Continuous Power ⁽⁸⁾	11,400 @ 240V 3800 @ 208V	11,400 @ 240V 5000 @ 208V	11400 @240V	11,400 @ 240V 10,000 @ 208V		W
Peak Power ⁽⁸⁾	11,400 @ 240V 3800 @ 208V	11,400 @ 240V 5000 @ 208V	11400 @240V	11,400 @ 240V 10,000 @ 208V		W
Maximum Input Current	30					Adc
2-pole Disconnection	Up to the inverter's rated stand-alone power					
SMART ENERGY CAPABILITIES						
Consumption Metering	Built-in ⁽⁹⁾					
Stand-alone & Battery Storage	With Backup Interface (purchased separately) for service up to 200A; up to 3 inverters					
EV Charging	Direct connection to the SolarEdge Home EV Charger					
ADDITIONAL FEATURES						
Supported Communication Interfaces	RS485, Ethernet, Cellular ⁽¹⁰⁾ , Wi-Fi (optional), SolarEdge Home Network (optional)					
Revenue Grade Metering, ANSI C12.20	Built-in ⁽⁹⁾					
Integrated AC, DC and Communication Connection Unit	Yes					
Inverter Commissioning	With the SetApp mobile application using built-in Wi-Fi Access Point for local connection					
DC Voltage Rapid Shutdown (PV and Battery)	Yes, NEC 690.12					
STANDARD COMPLIANCE						
Safety	UL 1741, UL 1741SA, UL 1741SB, UL 1699B, CSA 22.2#107.1, C22.2#330, C22.3#9, ANSI/CAN/UL 9540					
Grid Connection Standards	IEEE1547 and IEEE-1547.1, Rule 21, Rule 14H					
Emissions	FCC Part 15 Class B					
INSTALLATION SPECIFICATIONS						
AC Terminals	L1, L2, N terminal blocks, PE busbar for inverter connection L1, L2 terminal blocks, PE busbar for EV Charger AC connection					
DC Terminals	4 x terminal block pairs for PV input; 1 x terminal block pair for battery input					
AC Output and EV AC Output Conduit Size / AWG Range	1" maximum / 14-4 AWG					
DC Input (PV and Battery) Conduit Size / AWG Range	1" maximum / 14-6 AWG					
Dimensions with Connection Unit (H x W x D)	21.06 x 14.6 x 8.2 / 535 x 370 x 208					in / mm
Weight with Connection Unit	44.9 / 20.3					lb / kg
Noise	< 50					dBA
Cooling	Natural Convection					
Operating Temperature Range	-40 to +140 / -40 to +60 ⁽¹¹⁾					°F / °C
Protection Rating	NEMA 4X					


(8) Discharge power is limited up to the inverter's rated AC power for on-grid and stand-alone applications, as well as up to the installed batteries' rating.
(9) For consumption metering current transformers should be ordered separately: SECT-SPL-225A-T-20 or SEACT1250-400NA-20. Revenue grade metering is only for production metering.
(10) Information concerning the data plan terms & conditions is available in [SolarEdge Communication Plan Terms and Conditions](#).
(11) Full power up to at least 50°C / 122°F; for power derating information refer to the [Temperature Derating Technical Note for North America](#).



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A



PROJECT NAME & ADDRESS	
CRISTINE BROOKS RESIDENCE	12820 N CAROLINA 27, BROADWAY, NC 27505

DRAWN BY ESR
SHEET NAME EQUIPMENT SPECIFICATION
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-13

SolarEdge Home Backup Interface

For North America

BI-E / BI-N



12
YEAR
WARRANTY

HOME BACKUP

Backup Interface for Flexible Backup

- Automatically provides backup power to home loads in the event of grid interruption
- Full flexibility in which loads to back up – the entire home or selected loads
- Scalable solution to support higher power and higher capacity
- Built-in Auto Transformer that supports 5kW of Phase Imbalance
- Built-in PCS certified* Energy Meter readies the Backup Interface to be part of the Busbar Current Management**
- Seamless integration with the SolarEdge Home Hub Inverter to manage and monitor both PV generation and energy storage
- Generator connection support

* Only applicable to Backup Interface with part number BI-xxxxx-03. Backup Interface with part number BI-xxxxx-02 includes a built-in Auto Transformer and Energy Meter that is NOT PCS certified.
** Only applicable to Backup Interface with part number BI-xxxxx-03.

solaredge.com

solaredge

/ SolarEdge Home Backup Interface

For North America

BI-E / BI-N

Applicable to Backup Interface with Part Number	BI-xxxxx-02	BI-xxxxx-03	
Model	BI-E	BI-N	Units
INPUT FROM GRID			
AC Current Input	200		A
AC Output Voltage (Nominal)	240		Vac
AC Output Voltage Range	211 – 264		Vac
AC Frequency (Nominal)	60		Hz
AC Frequency Range	59.3 – 60.5		Hz
Microgrid Interconnection Device Rated Current	200		A
Service Side AC Main Circuit Breaker Rated Current	200	N/A	A
Service Side AC Main Circuit Breaker Interrupt Current	10,000	N/A	A
Grid Disconnection Switchover Time	<100		ms
OUTPUT TO MAIN DISTRIBUTION PANEL			
Maximum AC Current Output	200		A
AC L-L Output Voltage (Nominal)	240		Vac
AC L-L Output Voltage Range	211 – 264		Vac
AC Frequency (Nominal)	60		Hz
AC Frequency Range	59.3 – 60.5		Hz
Maximum Inverters AC Current Output in Backup Operation	144		A
Imbalance Compensation in Backup Operation	5000		W
AC L-N Output Voltage in Backup (Nominal)	120		V
AC L-N Output Voltage Range in Backup	105 – 132		V
AC Frequency Range in Backup	55 – 65		Hz
INPUT FROM INVERTER			
Number of Inverter Inputs	Up to 3		
Maximum Rated AC Power in On-Grid and Backup Operation	11,400		W
Maximum Continuous Current in On-Grid and Backup Operation	48		A
Factory Installed Inverter Input AC Circuit Breaker	40/63 ^m		A
Upgradability	Up to 3 x 40A/63A ^m CB		
GENERATOR			
Maximum Rated AC Power	22,500		W
Maximum Continuous Input Current	94		Aac
Dry Contact Switch Voltage Rating	250 / 30		Vac / Vdc
Dry Contact Switch Current Rating	5		A
2-wire Start Switch	Yes		
ADDITIONAL FEATURES			
Installation Type	Suitable for use as service equipment	For main lug only	
Number of Communication Inputs	2		
Communication	RS485		
PCS Certified Energy Meter (for Import/Export) ^m	1% accuracy		
Manual Control Over Microgrid Interconnection Device	Yes		

(1) Backup Interface with part number BI-xxxxx-03 includes one 63A circuit breaker. Backup Interface with part number BI-xxxxx-02 includes one 40A circuit breaker.
(2) 63A circuit breaker supports up to one 11.4kW inverter, and 40A circuit breaker supports up to one 7.6kW inverter. 20A, 30A, and 50A breakers can be used for inverters with lower power ratings (On-Grid and Backup Operation). The circuit breaker kits are available with the following part numbers:
• For 63A, CB-UPG-63-01
• For 40A, CB-UPG-40-01
(3) Backup Interface with part number BI-xxxxx-02 includes an Energy Meter that is NOT PCS certified.



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY
ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
PV-14

A

/ SolarEdge Home Backup Interface

For North America

BI-E/BI-N

Applicable to Backup Interface with Part Number	BI-xxxx-02 / BI-xxxx-03		
Model	BI-E	BI-N	Units
STANDARD COMPLIANCE			
Safety	UL1741; CSA 22.2 NO. 107		
	UL869A	N/A	
Emissions	FCC Part 15 Class B		
INSTALLATION SPECIFICATIONS			
Supported Inverters	StorEdge Single Phase Inverter; SolarEdge Home Hub Inverter		
AC from Grid Conduit Size / AWG Range	2" conduit / 4 – 4/0 AWG		
AC to Loads Conduit Size / AWG Range	2" conduit / 4 – 4/0 AWG		
AC Inverter Conduit Size / AWG Range	1" conduit / 14 – 4 AWG		
AC Generator Input Conduit Size / AWG Range	1" conduit / 8 – 3 AWG		
Communication Conduit Size / AWG Range	3/4" conduit / 24 – 10 AWG		
Weight	73 / 33		lb / kg
Cooling	Fan (user replaceable)		
Noise	< 50		dBA
Operating Temperature Range	(-) 40 to (+) 122 / (-) 40 to (+) 50		°F / °C
Protection Rating	NEMA 3R; IP44		
Dimensions (H x W x D)	20.59 x 13.88 x 8.62 / 523.5 x 352.5 x 219		in / mm


A



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A



PROJECT NAME & ADDRESS	
CRISTINE BROOKS RESIDENCE	12820 N CAROLINA 27, BROADWAY, NC 27505

DRAWN BY
ESR

SHEET NAME
EQUIPMENT SPECIFICATION

SHEET SIZE
ANSI B 11" X 17"

SHEET NUMBER
PV-15

SolarEdge Energy Bank
10kWh Battery
For North America



HOME BACKUP

Optimized for SolarEdge Energy Hub Inverters⁽¹⁾

- Maximized system performance, gaining more energy to store and use for on-grid and backup power applications
- Integrates with the complete SolarEdge residential offering, providing a single point of contact for warranty, support, training, and simplified logistics & operations
- DC coupled battery featuring superior overall system efficiency, from PV to battery to grid
- Scalable solution for increased power and capacity with multiple SolarEdge inverters and batteries
- Solar, storage, EV charging, and smart devices all monitored and managed by a single app to optimize solar production, consumption and backup* power
- Wireless communication to the inverter, reducing wiring, labor and installation faults
- Simple plug and play installation, with automatic SetApp-based configuration
- Includes multiple safety features for battery protection

* Backup application are subject to local regulation and may require additional components and firmware upgrade

solaredge.com



SolarEdge Energy Bank
10kWh Battery
For North America

BAT-10K1P ⁽²⁾		
BATTERY SPECIFICATION		
Usable Energy (100% depth of discharge)	9700	Wh
Continuous Output Power	5000	W
Peak Output Power (for 10 seconds)	7500	W
Peak Roundtrip Efficiency	> 94.5	%
Warranty ⁽³⁾	10	Years
Voltage Range	350-450	Vdc
Communication Interfaces	Wireless*	
Batteries per Inverter	Up to 3 ⁽⁴⁾	
STANDARD COMPLIANCE		
Safety	UL1642, UL1973, UL9540, UN38.3	
Emissions	FCC Part 15 Class B	
MECHANICAL SPECIFICATIONS		
Dimensions (W x H x D)	31.1 x 46.4 x 9.84 / 790 x 1179 x 250	in / mm
Weight	267 / 121	lb / kg
Mounting ⁽⁵⁾	Floor or wall mount ⁽⁶⁾	
Operating Temperature ⁽⁷⁾	+14 to +122 / -10 to +50	°F / °C
Storage Temperature (more than 3 months)	+14 to +86 / -10 to +30	°F / °C
Storage Temperature (less than 3 months)	-22 to +140 / -30 to +60	°F / °C
Altitude	6562 / 2000	ft / m
Enclosure Protection	IP55 / NEMA 3R - indoor and outdoor (water and dust protection)	
Cooling	Natural convection	
Noise (at 1m distance)	<25	dBA

* The SolarEdge Energy Bank is designed for use with SolarEdge Energy Net for wireless communication. The inverter might require a matching SolarEdge Energy Net Plug-In (more details below).
Using RS485 could reduce the usable energy to 9500Wh.
(1) Please refer to the SolarEdge Energy Bank battery connections and configuration application note for compatible inverters.
(2) These specifications apply to part number BAT-10K1P50B-01.
(3) For warranty details please refer to the SolarEdge Energy Bank battery Limited Warranty.
(4) Installations with multiple SolarEdge Energy Bank batteries connected to a single inverter require a pair of branch connectors (DC + and DC -) per battery excluding the last battery. Support for 3 batteries is pending supporting inverter firmware. The branch connectors should be purchased separately.
(5) Installation and mounting requires handles that should be purchased separately. Please refer to the Accessories' PN table below.
(6) The floor stand is purchased separately. One floor stand is required per SolarEdge Energy Bank battery. Please refer to the Accessories' PN table below.
(7) Please note that operating the SolarEdge Energy Bank at extreme temperatures for extended durations of time may void the Energy Bank's warranty coverage. Please see the Energy Bank Limited Product Warranty for additional details.


SolarEdge Energy Bank Battery – Accessories (purchased separately)	
Accessory	PN
Floor stand	IAC-RBAT-FLRSTD-01
Branch connectors set (includes a pair of DC + and DC - connectors) Required for installations with multiple SolarEdge Energy Bank batteries with a single inverter	IAC-RBAT-USYCBL-01
Handles	IAC-RBAT-HANDLE-01
SolarEdge Energy Net Plug-in	ENET-HBNP-01
Battery inverter extension cable 2m long (MC4 to terminal block)	IAC-RBAT-10M420-01

© SolarEdge Technologies Ltd. All rights reserved. SOLAREDGE, the SolarEdge logo, OPTIMIZED BY SOLAREDGE are trademarks or registered trademarks of SolarEdge Technologies, Ltd.. All other trademarks mentioned herein are trademarks of their respective owners. Date: 11/2021 DS-000026-3.6-NA. Subject to change without notice.



PHILLIPS ENERGY SYSTEMS
7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A



PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE
12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY ESR
SHEET NAME EQUIPMENT SPECIFICATION
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-16




Tech Brief

XR Rail® Family

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails® are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.

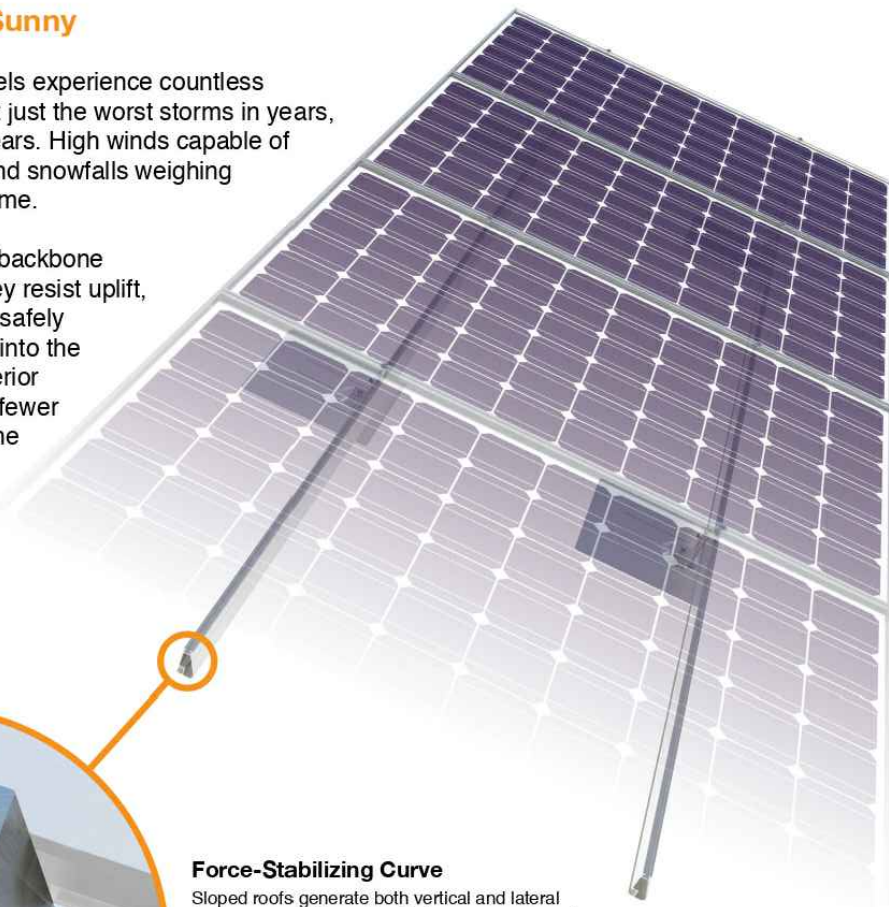

Force-Stabilizing Curve

Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails® is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

Compatible with Flat & Pitched Roofs



XR Rails® are compatible with FlashFoot® and other pitched roof attachments.



IronRidge® offers a range of tilt leg options for flat roof mounting applications.

Corrosion-Resistant Materials

All XR Rails® are made of 6000-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.



XR Rail® Family

The XR Rail® Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail® to match.



XR10

XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 6 feet, while remaining light and economical.

- 6' spanning capability
- Moderate load capability
- Clear & black anodized finish
- Internal splices available



XR100

XR100 is a residential and commercial mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 10 feet.

- 10' spanning capability
- Heavy load capability
- Clear & black anodized finish
- Internal splices available



XR1000

XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.

- 12' spanning capability
- Extreme load capability
- Clear anodized finish
- Internal splices available

Rail Selection

The table below was prepared in compliance with applicable engineering codes and standards.* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2e, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit IronRidge.com for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
None	90	XR10		XR100		XR1000	
	120						
	140						
	160						
20	90						
	120						
	140						
	160						
30	90						
	160						
40	90						
	160						
80	160						
120	160						

*Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance.



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-17



UFO® Family of Components


Tech Brief

Simplified Grounding for Every Application

The UFO® family of components eliminates the need for separate grounding hardware by bonding solar modules directly to IronRidge® XR Rails®. All system types that feature the UFO® family—Flush Mount®, Tilt Mount® and Ground Mount®—are fully listed to the UL 2703 standard.

UFO® hardware forms secure electrical bonds with both the module and the rail, resulting in many parallel grounding paths throughout the system. This leads to safer and more reliable installations.

Only for installation and use with IronRidge products in accord with written instructions. See [IronRidge.com/UFO](https://www.ironridge.com/UFO)

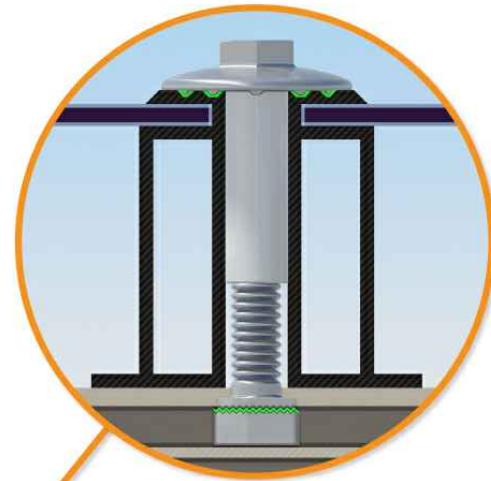

Universal Fastening Object (UFO®)

The UFO® securely bonds solar modules to XR Rails®. It comes assembled and lubricated, and can fit a wide range of module heights.



Stopper Sleeve

The Stopper Sleeve snaps onto the UFO®, converting it into a bonded end clamp.



BOSS® Splice

Bonded Structural Splice connects rails with built-in bonding teeth. No tools or hardware needed.



Grounding Lug


A single Grounding Lug connects an entire row of PV modules to the grounding conductor.



Bonded Attachments

The bonding bolt attaches and bonds the L-foot® to the rail. It is installed with the same socket as the rest of the system.

System Diagram

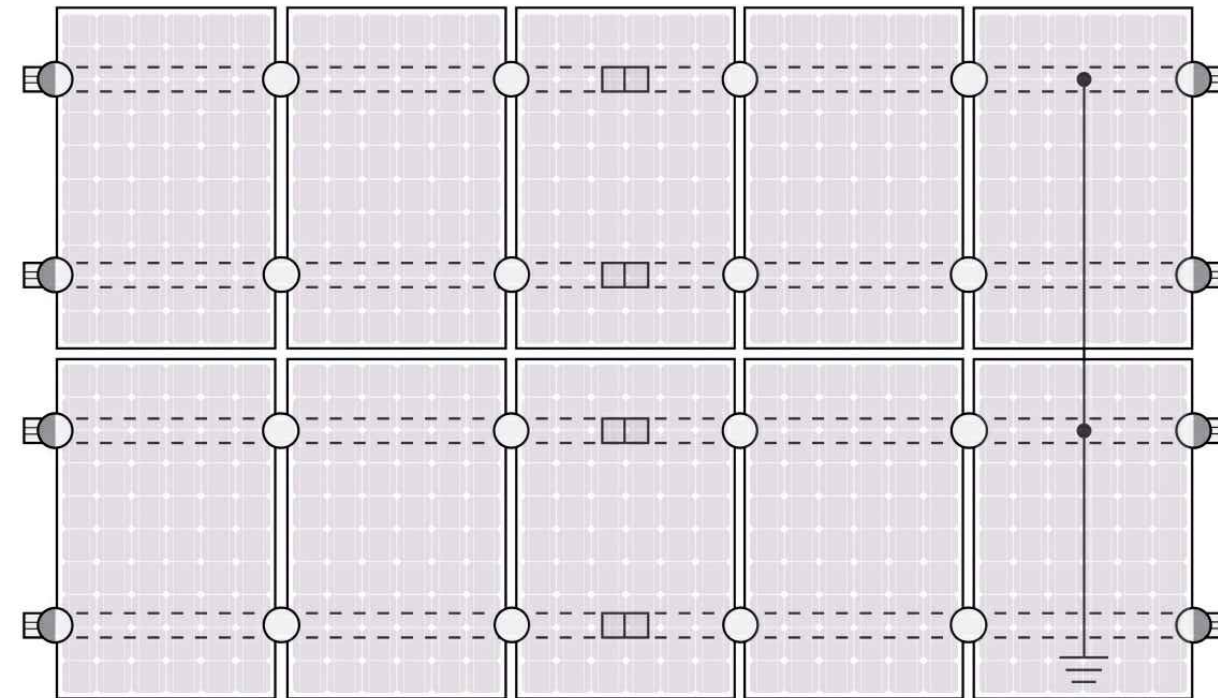

○ UFO ◐ Stopper Sleeve ● Grounding Lug □ BOSS™ Splice — Ground Wire

Approved Enphase microinverters can provide equipment grounding of IronRidge systems, eliminating the need for grounding lugs and field installed equipment ground conductors (EGC). A minimum of two microinverters mounted to the same rail and connected to the same Engage cable is required. Refer to installation manuals for additional details.

UL Certification

The IronRidge® Flush Mount®, Tilt Mount®, and Ground Mount Systems have been listed to UL 2703 by Intertek Group plc.

UL 2703 is the standard for evaluating solar mounting systems. It ensures these devices will maintain strong electrical and mechanical connections over an extended period of time in extreme outdoor environments.

[Go to IronRidge.com/UFO](https://www.ironridge.com/UFO)

Cross-System Compatibility

Feature	Flush Mount	Tilt Mount	Ground Mount
XR Rails®	✓	✓	XR100 & XR1000
UFO®/Stopper	✓	✓	✓
BOSS® Splice	✓	✓	N/A
Grounding Lugs	1 per Row	1 per Row	1 per Array
Microinverters & Power Optimizers	Compatible with most MLPE manufacturers. Refer to system installation manual.		
Fire Rating	Class A	Class A	N/A
Modules	Tested or Evaluated with over 400 Framed Modules. Refer to installation manuals for a detailed list.		



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-18



QuickMount® Halo UltraGrip

Cut Sheet

1

RD STRUCTURAL SCREW PN RD-1430-01-M1
SOLD SEPARATELY
SHOWN FOR REFERENCE

Release Liner
shown for reference

ITEM NO	DESCRIPTION	QTY IN KIT
1	QM Halo UltraGrip(Mill or Black)	1

PART NUMBER	DESCRIPTION
QM-HUG-01-M1	Halo UltraGrip - Mill
QM-HUG-01-B1	Halo UltraGrip - Black

Cut Sheet

1. Halo UltraGrip

3.35

.38

3.83

1.63

.40

.34

2.99

1.56

Ø.26

Property	Value
Material	3000 Series Aluminium
Finish	Mill or Black



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

--	--	--

PROJECT NAME & ADDRESS		
CRISTINE BROOKS RESIDENCE	12820 N CAROLINA 27, BROADWAY, NC 27505	

DRAWN BY ESR


SHEET NAME EQUIPMENT SPECIFICATION
--

SHEET SIZE ANSI B 11" X 17"

SHEET NUMBER PV-19




QuickMount® RD Structural Screw

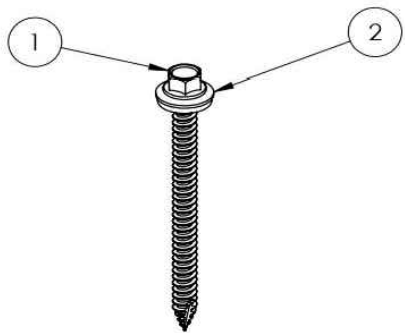

ITEM NO	DESCRIPTION	QTY IN KIT
1	Self Drilling Screw, #14, Wood Tip	1
2	Washer, EPDM Backed	1

PART NUMBER	DESCRIPTION
RD-1430-01-M1	RD Structural Screw

1. Self Drilling Screw, #14, Wood Tip

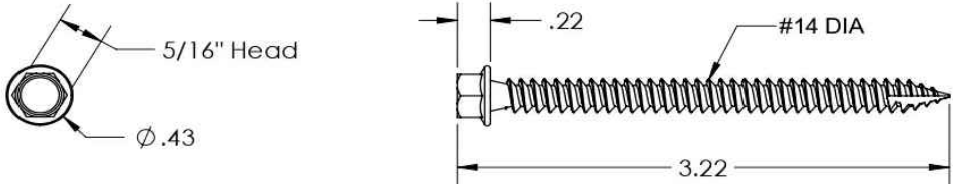

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

2. Washer, EPDM Backed



Property	Value
Material	300 Series Stainless Steel
Finish	Clear



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

--

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY
ESR

SHEET NAME
EQUIPMENT SPECIFICATION

SHEET SIZE
ANSI B 11" X 17"

SHEET NUMBER
PV-20

ITEM NO.	PART NUMBER	DESCRIPTION	QTY
1	JB-1.2 BODY	POLYCARBONATE WITH UV INHIBITORS	1
2	JB-1.2 LID	POLYCARBONATE WITH UV INHIBITORS	1
3	#10 X 1-1/4" PHILLIPS PAN HEAD SCREW		6
4	#8 X 3/4" PHILLIPS PAN HEAD SCREW		6

SIZE	DWG. NO.	REV
B	JB-1.2	
SCALE: 1:2	WEIGHT: 1.45 LBS	SHEET 1 OF 3

TORQUE SPECIFICATION:	15-20 LBS
CERTIFICATION:	UL 1741, NEMA 3R CSA C22.2 NO. 290
WEIGHT:	1.45 LBS



SIZE	DWG. NO.	REV
B	JB-1.2	
SCALE: 1:2	WEIGHT: 1.45 LBS	SHEET 2 OF 3



PHILLIPS ENERGY SYSTEMS

7901 ALLEN BLACK RD, MINT HILL,
NC 28227, UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	04/16/2025	
REVISION	05/12/2025	A

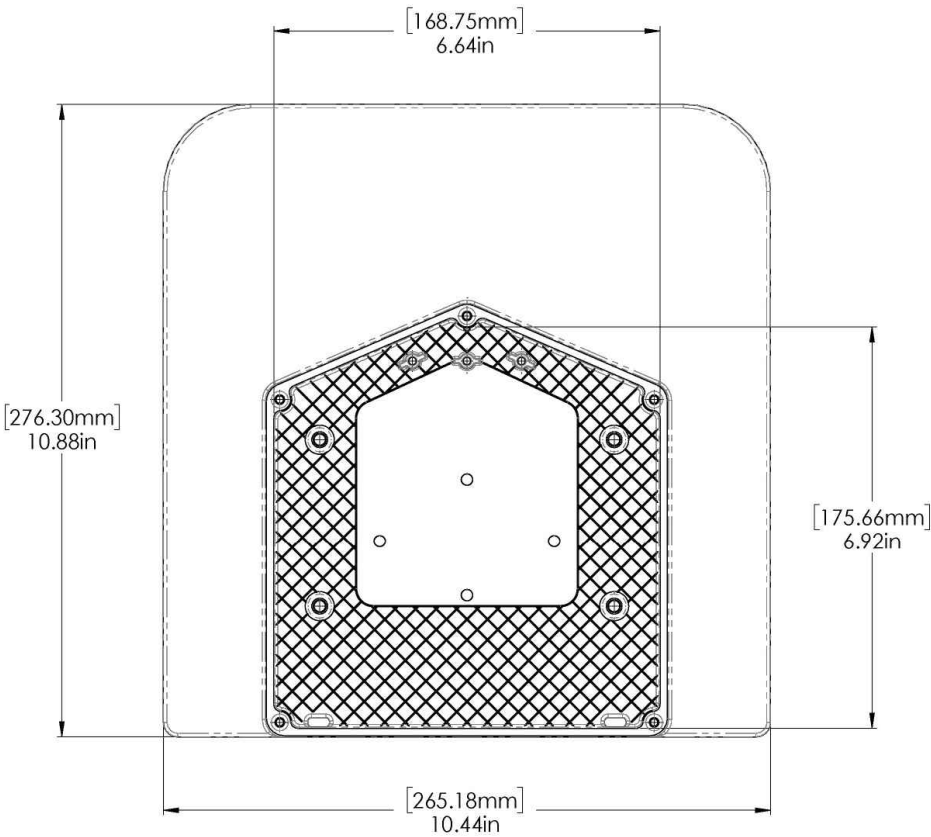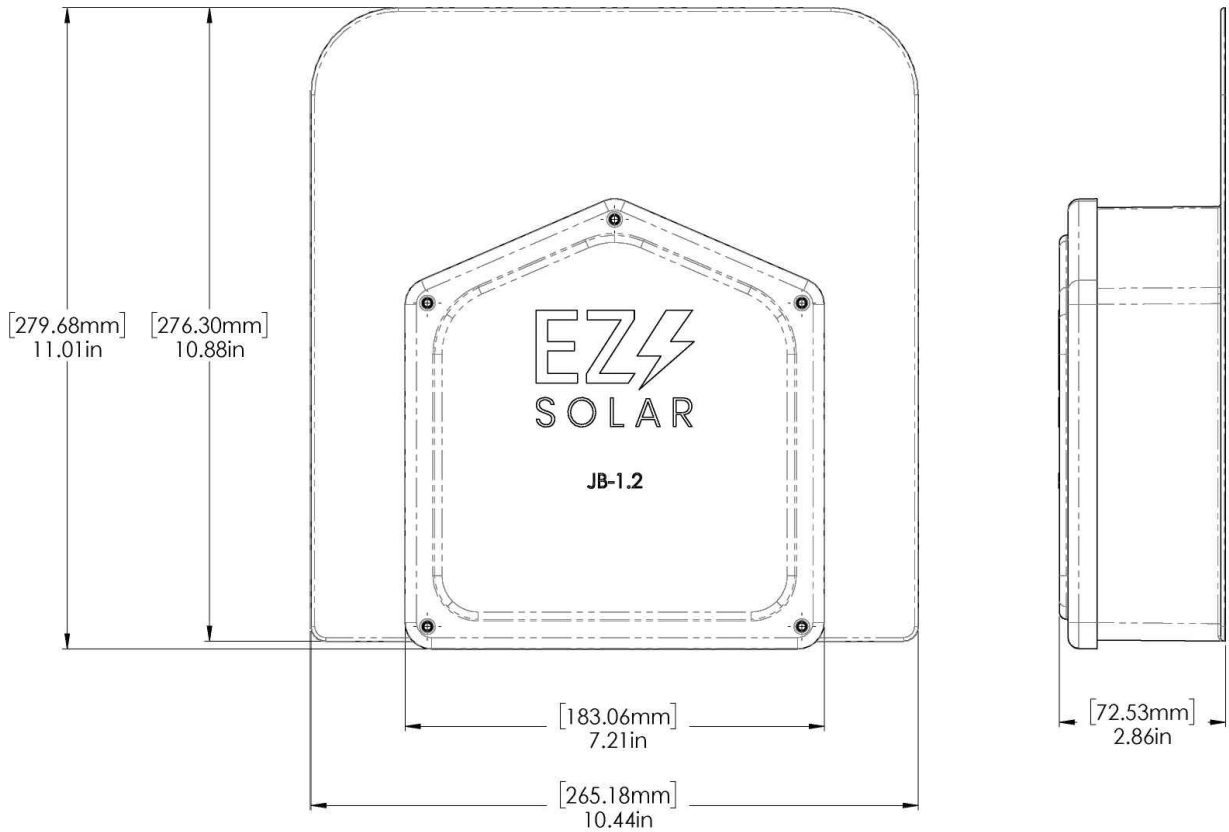

PROJECT NAME & ADDRESS

CRISTINE BROOKS
RESIDENCE

12820 N CAROLINA 27,
BROADWAY, NC 27505

DRAWN BY

ESR

SHEET NAME

EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-21